



**MIAMI-DADE COUNTY**  
**BUILDING CODE COMPLIANCE OFFICE (BCCO)**  
**PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA**  
**METRO-DADE FLAGLER BUILDING**  
**140 WEST FLAGLER STREET, SUITE 1603**  
**MIAMI, FLORIDA 33130-1563**  
 (305) 375-2901 FAX (305) 372-6339

**NOTICE OF ACCEPTANCE (NOA)**

[www.miamidade.gov/buildingcode](http://www.miamidade.gov/buildingcode)

**DAB Door Company, Inc.**  
**12195 NW 98<sup>th</sup> Avenue**  
**Hialeah Gardens, FL 33018**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: 16'-2" Wide x 16' High Steel Sectional Garage Door w/ Window Lite Option**

**APPROVAL DOCUMENT:** Drawing No. **02-21**, titled "Sectional Garage Door", dated 09/10/02, with last revision E dated 01/06/10, sheets 1 through 5 of 5, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E., bearing the Miami-Dade County Product Control renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 09-0128.02** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



*Handwritten signature and date: 03/11/10*

**NOA No. 10-0216.04**  
**Expiration Date: July 21, 2015**  
**Approval Date: March 31, 2010**  
**Page 1**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawing No. **02-21**, titled "Sectional Garage Door", dated 09/10/02, with last revision E dated 01/06/10, sheets 1 through 5 of 5, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E.

**B. TESTS**


1. Test Report on Large Missile Impact Test and Cyclic Wind Pressure Test, of "Sectional Residential Door with Windows", prepared by Hurricane Engineering & Testing Inc., Report No. **HETI 03-1328**, dated 07/15/03, signed and sealed by Rafael E. Droz-Seda, P.E.
2. Test Report on Uniform Static Air Pressure Test, of "Sectional Residential Door" prepared by Hurricane Engineering & Testing Inc., Report No. **HETI 03-1329**, dated 07/15/03, signed and sealed by Rafael E. Droz-Seda, P.E.
3. Test Report on Tensile Test per ASTM E-8 of "Sectional Residential Door (skin)", prepared by Hurricane Engineering & Testing Inc, Report No. **HETI 03-T078**, dated 10/31/03, signed and sealed by Rafael E. Droz-Seda, P.E.  
*"Submitted under NOA # 05-0228.02"*
4. Test report on Salt Spray (Corrosion) Test per ASTM B 117 of a painted G-40 steel panels, prepared by Celotex Corporation, Test Report No. **258592**, dated 08/17/98, signed by W. A. Jackson, P.E.  
*"Submitted under NOA # 03-0210.04"*

**C. CALCULATIONS**

1. Anchor verification calculations prepared by Al-Farooq Corporation, complying with F.B.C 2007, dated 12/19/08, signed and sealed by Humayoun Farooq, P.E.  
*"Submitted under NOA # 09-0128.02"*

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO)



03/11/10

---

Carlos M. Utrera, P.E.  
Product Control Examiner  
NOA No. 10-0216.04  
Expiration Date: July 21, 2015  
Approval Date: March 31, 2010

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **08-0305.02**, issued to SABIC Innovative Plastics, for their Lexan Sheet Products, approved on 04/24/08 and expiring on 07/17/13.
  2. Notice of Acceptance No. **07-1016.07**, issued to Insulfoam, LLC, for their Insulfoam Expanded Polystyrene Insulation, approved on 11/29/07 and expiring on 11/29/12.
  3. Notice of Acceptance No. **07-1107.08**, issued to Dyplast Products, LLC, for their Expanded Polystyrene Block Type Insulation, approved on 02/28/08 and expiring on 01/11/12.
  4. Notice of Acceptance No. **07-0301.10**, issued to Dyplast Products, LLC, for their Dyplast ISO-C1 Polyisocyanurate Insulation, approved on 06/07/07 and expiring on 01/11/12.
- 
1. Test Report on Accelerated Weathering Using Xenon Arc Light Apparatus Test per ASTM G155 of "PVC Extrusion Material", prepared by Hurricane Engineering & Testing, Inc., Report No. **HETI 04-A002**, dated 09/27/04, signed and sealed by Rafael E. Droz-Seda, P.E.
  2. Test Reports on Tensile Test per ASTM D638 of "PVC Extrusion Material", prepared by Hurricane Engineering & Testing Inc., Report No. **HETI 04-T251**, dated 11/29/04 signed and sealed by I. Ghia, P.E.
  3. Test Report on Self-Ignition Temperature Test, Rate of Burn Test and Smoke Density Test of "REHAU non-foam PVC extrusion material", prepared by ETC Laboratories, Report No. **04-761-15019.0**, dated 05/06/04, signed and sealed by J. L. Doldan, P.E.  
*"Submitted under NOA # 05-0228.02"*

**F. STATEMENTS**

1. Change of engineer letter issued by Al-Farooq Corporation, dated 01/08/10, signed and sealed by Arshad Viqar, P.E.
  2. No change to product letter issued by DAB Door Company, Inc, dated 02/09/10, signed by Roseanne Berger.
- 
1. Statement letter of code conformance issued by Al-Farooq Corporation, dated 12/05/08, signed and sealed by Humayoun Farooq, P.E.
  2. Statement letter of no financial interest issued by Al-Farooq Corporation, dated 12/05/08, signed and sealed by Humayoun Farooq, P.E.  
*"Submitted under NOA # 09-0128.02"*




03/11/10

---



Carlos M. Utrera, P.E.  
Product Control Examiner  
NOA No. 10-0216.04  
Expiration Date: July 21, 2015  
Approval Date: March 31, 2010

no.	date	description
A	12.09.02	REV. PER BCCO COMMENTS
B	01.19.05	DOORS W/ WDW. OPTION ADDED
C	05.20.05	REV. PER BCCO COMMENTS
D	12.17.08	UPDATED FOR 2007 FBC
E	01.06.10	ENGR. NAME CHANGED

date:	09-10-02
scale:	1/2"=1'-0"
dr. by:	HAMID
chk. by:	
drawing no.	02-21
sheet 1 of 5	

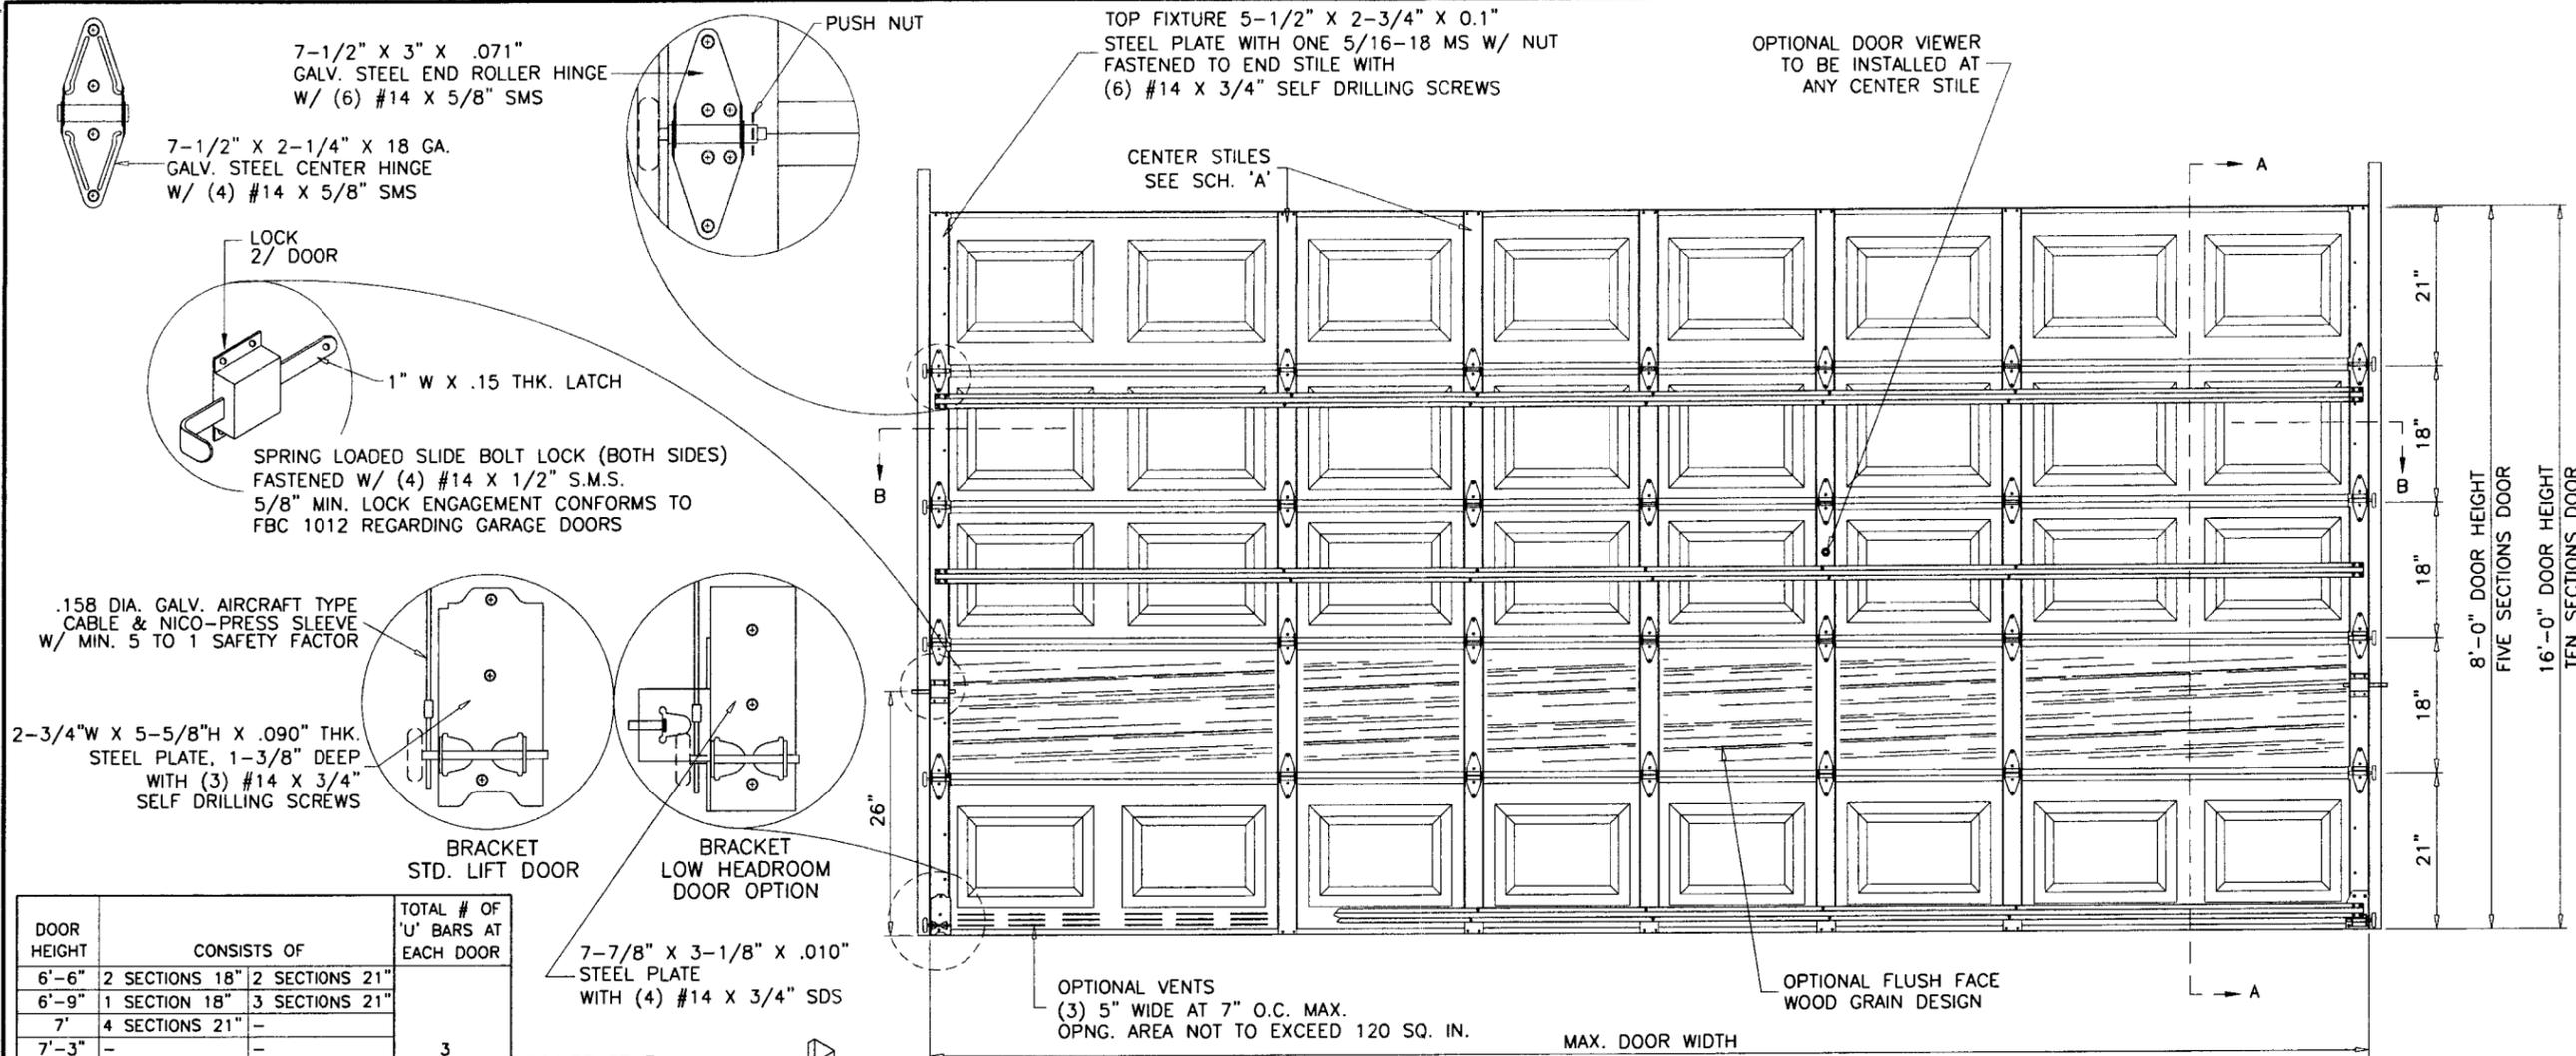

DOOR HEIGHT	CONSISTS OF		TOTAL # OF 'U' BARS AT EACH DOOR
6'-6"	2 SECTIONS 18"	3 SECTIONS 21"	3
6'-9"	1 SECTION 18"	3 SECTIONS 21"	
7'	4 SECTIONS 21"	-	
7'-3"	-	-	
7'-6"	5 SECTIONS 18"	-	
7'-9"	4 SECTIONS 18"	1 SECTION 21"	
8'	3 SECTIONS 18"	2 SECTIONS 21"	4
8'-3"	2 SECTIONS 18"	3 SECTIONS 21"	
8'-6"	1 SECTION 18"	4 SECTIONS 21"	
8'-9"	5 SECTIONS 21"	-	
9'	6 SECTIONS 18"	-	
9'-3"	5 SECTIONS 18"	1 SECTION 21"	
9'-6"	4 SECTIONS 18"	2 SECTIONS 21"	
9'-9"	3 SECTIONS 18"	3 SECTIONS 21"	
10'	2 SECTIONS 18"	4 SECTIONS 21"	5
10'-3"	1 SECTION 18"	5 SECTIONS 21"	
10'-6"	6 SECTIONS 21"	-	
10'-9"	6 SECTIONS 18"	1 SECTION 21"	
11'	5 SECTIONS 18"	2 SECTIONS 21"	
11'-3"	4 SECTIONS 18"	3 SECTIONS 21"	
11'-6"	3 SECTIONS 18"	4 SECTIONS 21"	
11'-9"	2 SECTIONS 18"	5 SECTIONS 21"	
12'	1 SECTIONS 18"	6 SECTIONS 21"	6
12'-3"	7 SECTIONS 21"	-	
12'-6"	6 SECTIONS 18"	2 SECTIONS 21"	
12'-9"	5 SECTIONS 18"	3 SECTIONS 21"	
13'	4 SECTIONS 18"	4 SECTIONS 21"	
13'-3"	3 SECTIONS 18"	5 SECTIONS 21"	
13'-6"	2 SECTIONS 18"	6 SECTIONS 21"	
13'-9"	1 SECTION 18"	7 SECTIONS 21"	
14'	8 SECTIONS 21"	-	
14'-3"	6 SECTIONS 18"	3 SECTIONS 21"	
14'-6"	5 SECTIONS 18"	4 SECTIONS 21"	
14'-9"	4 SECTIONS 18"	5 SECTIONS 21"	
15'	3 SECTIONS 18"	6 SECTIONS 21"	
15'-3"	2 SECTIONS 18"	7 SECTIONS 21"	
15'-6"	1 SECTION 18"	8 SECTIONS 21"	
15'-9"	9 SECTIONS 21"	-	
16'	6 SECTIONS 18"	4 SECTIONS 21"	

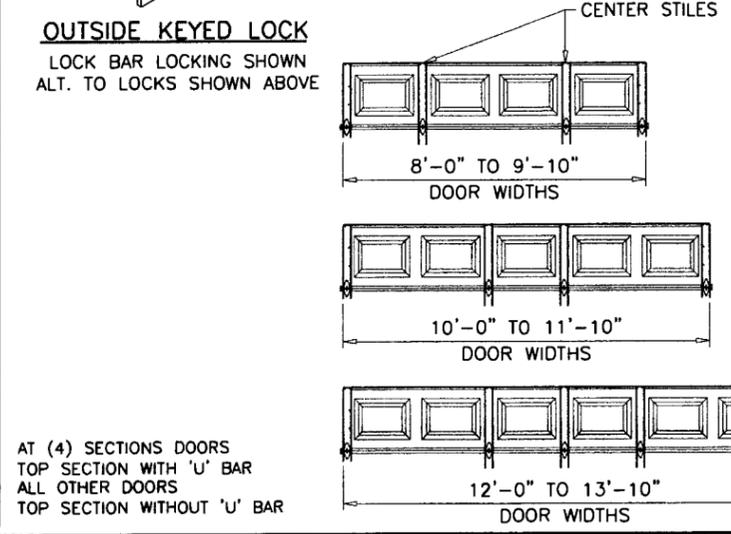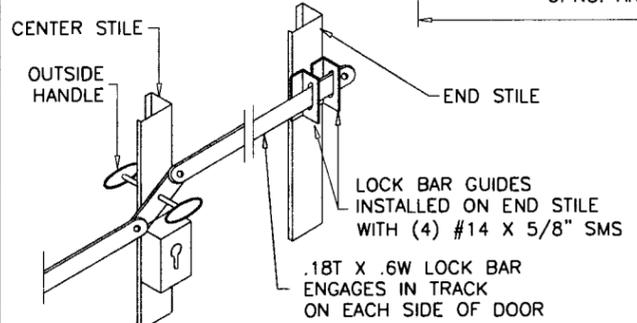

SCHEDULE 'A'

CENTER STILES CONFIGURATION	
DOOR WIDTHS	# OF CENTER STILES
8'-0" TO 9'-10"	2
10'-0" TO 11'-10"	2
12'-0" TO 13'-10"	3
14'-0" TO 15'-10"	4
15'-11" TO 16'-2"	5

**INSIDE ELEVATION**  
 RAISED PANEL EMBOSSED DOOR

**DAB DOOR MODEL 824**  
 MAX. SIZE 16'-2" WIDE X 16'-0" HIGH  
 24 GA. ROLL FORMED STEEL

DESIGN PRESSURE RATING = + 36.0 PSF  
 - 44.0 PSF


THIS PRODUCT IS RATED FOR LARGE MISSILE IMPACT

**GENERAL NOTES**


1. THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE.
2. ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
3. ALL BOLTS, NUTS AND WASHERS SHALL BE ZINC PLATED CARBON STEEL.
4. ANCHORING OR LOADING CONDITIONS OTHER THAN THOSE SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.
5. A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

Engr: ARSHAD VIQAR  
 CIVIL  
 F.L.A. PE # 38863  
 C.A.N. 3538  
  
 JAN 08 2010


**PRODUCT RENEWED**  
 as complying with the Florida Building Code  
 Acceptance No 10-0216.04  
 Expiration Date 07/21/2015  
 By   
 Miami Dade Product Control Division

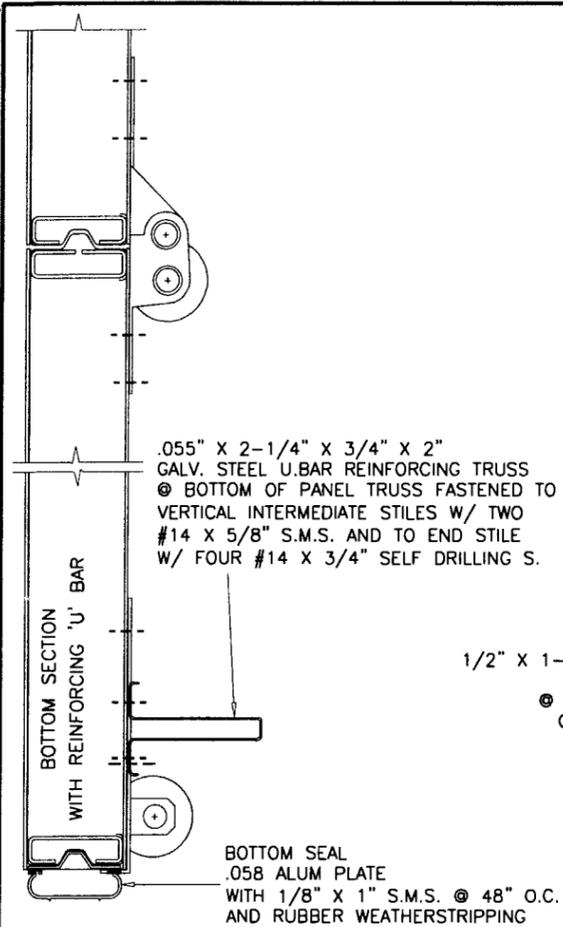



1ST SECTION (BOTTOM)

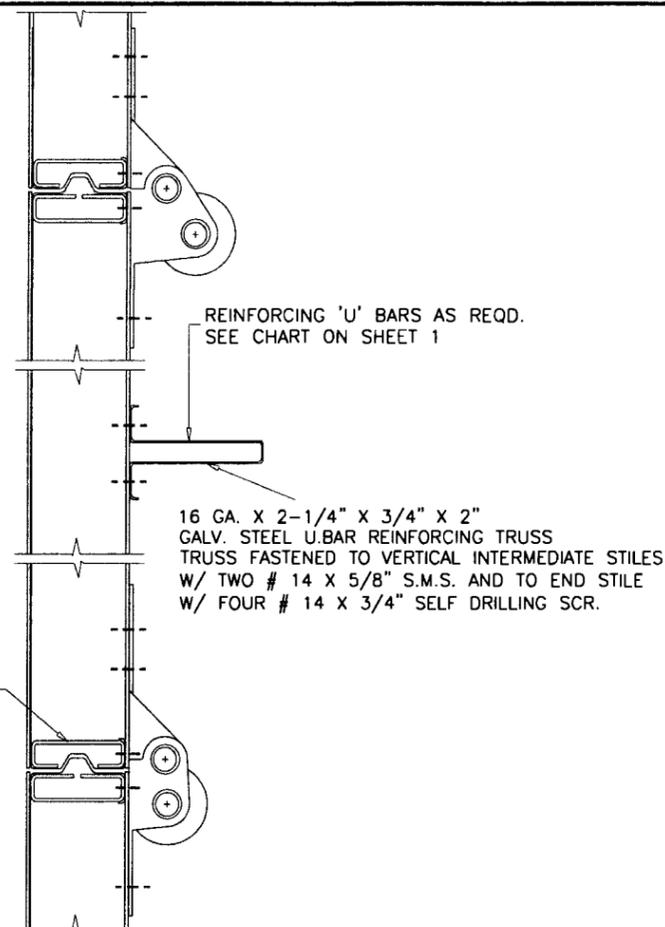

INTERMEDIATE SECTION  
WITH OR W/O REINFORCING

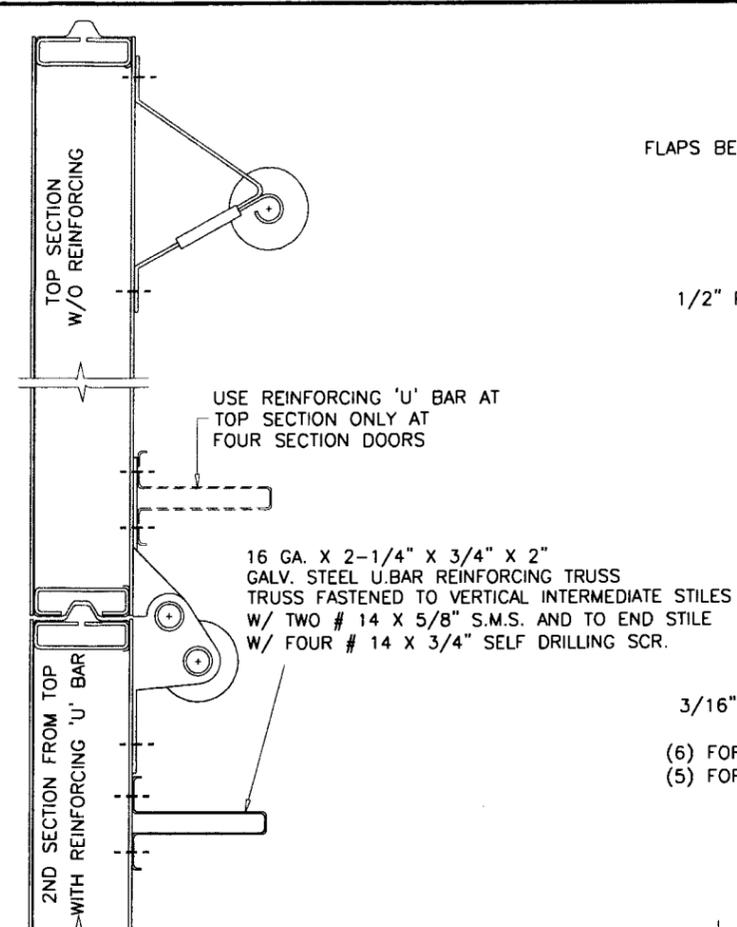

TOP SECTION

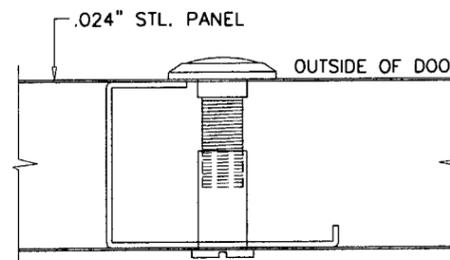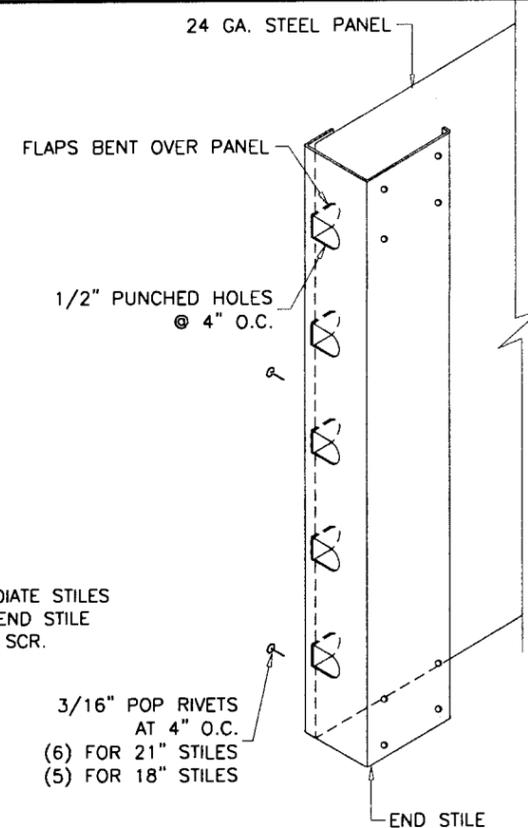


SOLID BRASS DOOR VIEWER

BY 'SCHLAGE SECURITY HARDWARE'  
INSTALLED IN 9/16" DIA. HOLES IN CENTER STILE  
POSITIONED AT EYE LEVEL

**ANCHORS:**

- 3/8" DIA. POWER-BOLT BY 'POWERS'**
- A) 2" MIN. EMBED INTO CONCRETE (3000 PSI MIN.)  
2" MIN. EDGE DISTANCE
- 3/8" DIA. HLC SLEEVE BY 'HILTI'**
- B) 1-1/4" MIN. EMBED INTO CONCRETE OR FILLED BLOCK  
2-1/4" MIN. EDGE DISTANCE INTO CONCRETE  
4" MIN. EDGE DISTANCE INTO FILLED BLOCK

CONCRETE f'c = 3000 PSI MIN.  
C-90 GROUT FILLED BLOCK f'm = 2000 PSI MIN.

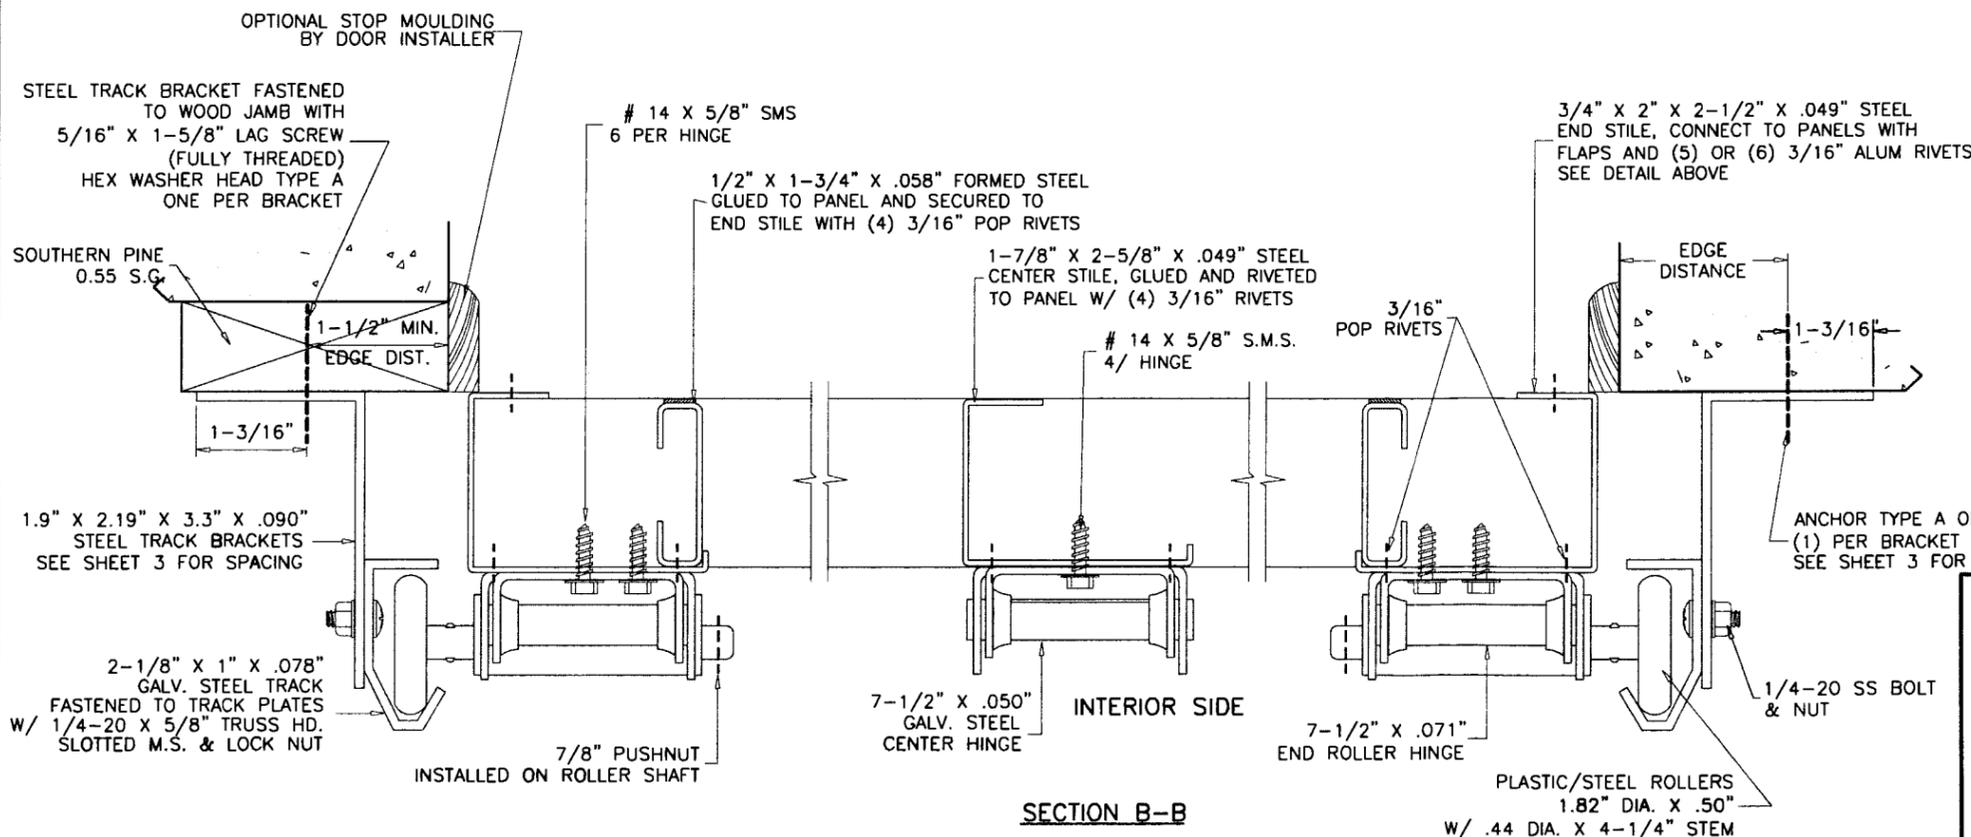

SECTION B-B

Engr: ARSHAD VIQAR  
CIVIL  
FLA. PE # 38863  
C.A.N. 3538

*Am*

JAN 08 2010

**PRODUCT RENEWED**  
as complying with the Florida  
Building Code  
Acceptance No 10-0216.04  
Expiration Date 07/21/2015

By *[Signature]*  
Miami Dade Product Control  
Division

**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
GARAGE\02-21DAB



SECTIONAL GARAGE DOOR  
**DAB DOORS INC.**  
12195 N.W. 98 TH. AVE.  
HIALEAH GARDENS, FL. 33018  
TEL. (305) 556 - 6624

no	date	by	description
A	12.09.02	REV. PER BCCO COMMENTS	
B	01.19.05	NO CHANGE THIS SHEET	
C	05.20.05	REV. PER BCCO COMMENTS	
D	12.17.08	UPDATED FOR 2007 FBC	
E	01.06.10	ENGR. NAME CHANGED	

date: 09-10-02  
scale: -  
dr. by: HAMID  
chk. by:

drawing no.  
**02-21**


sheet 2 of 5

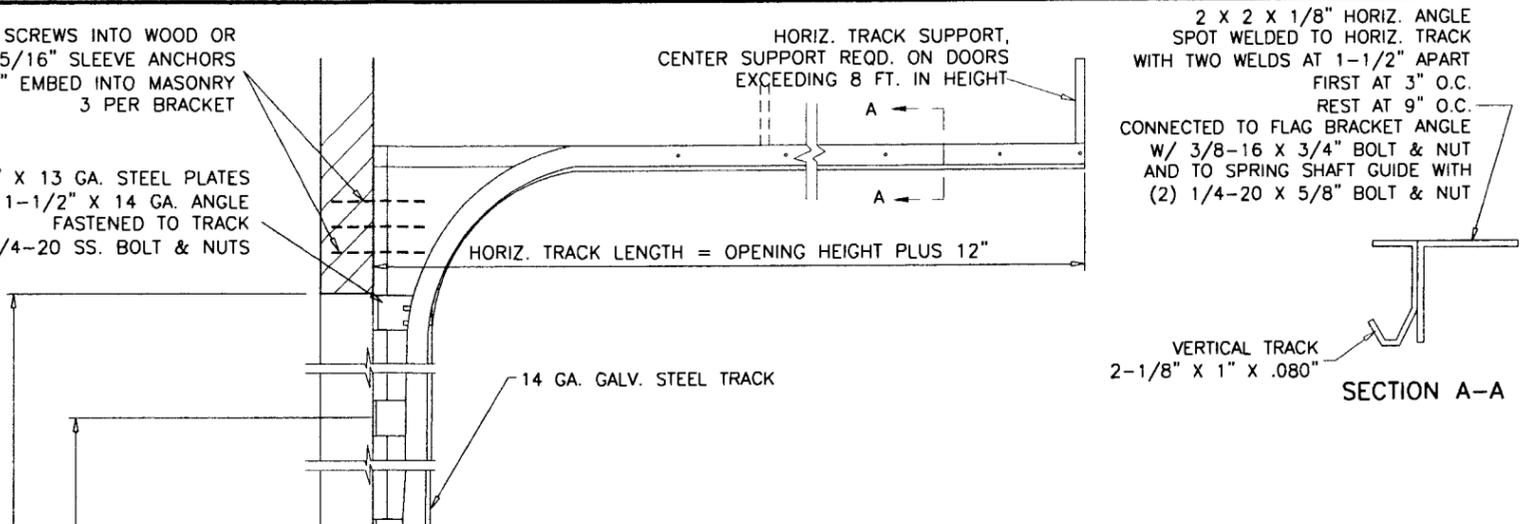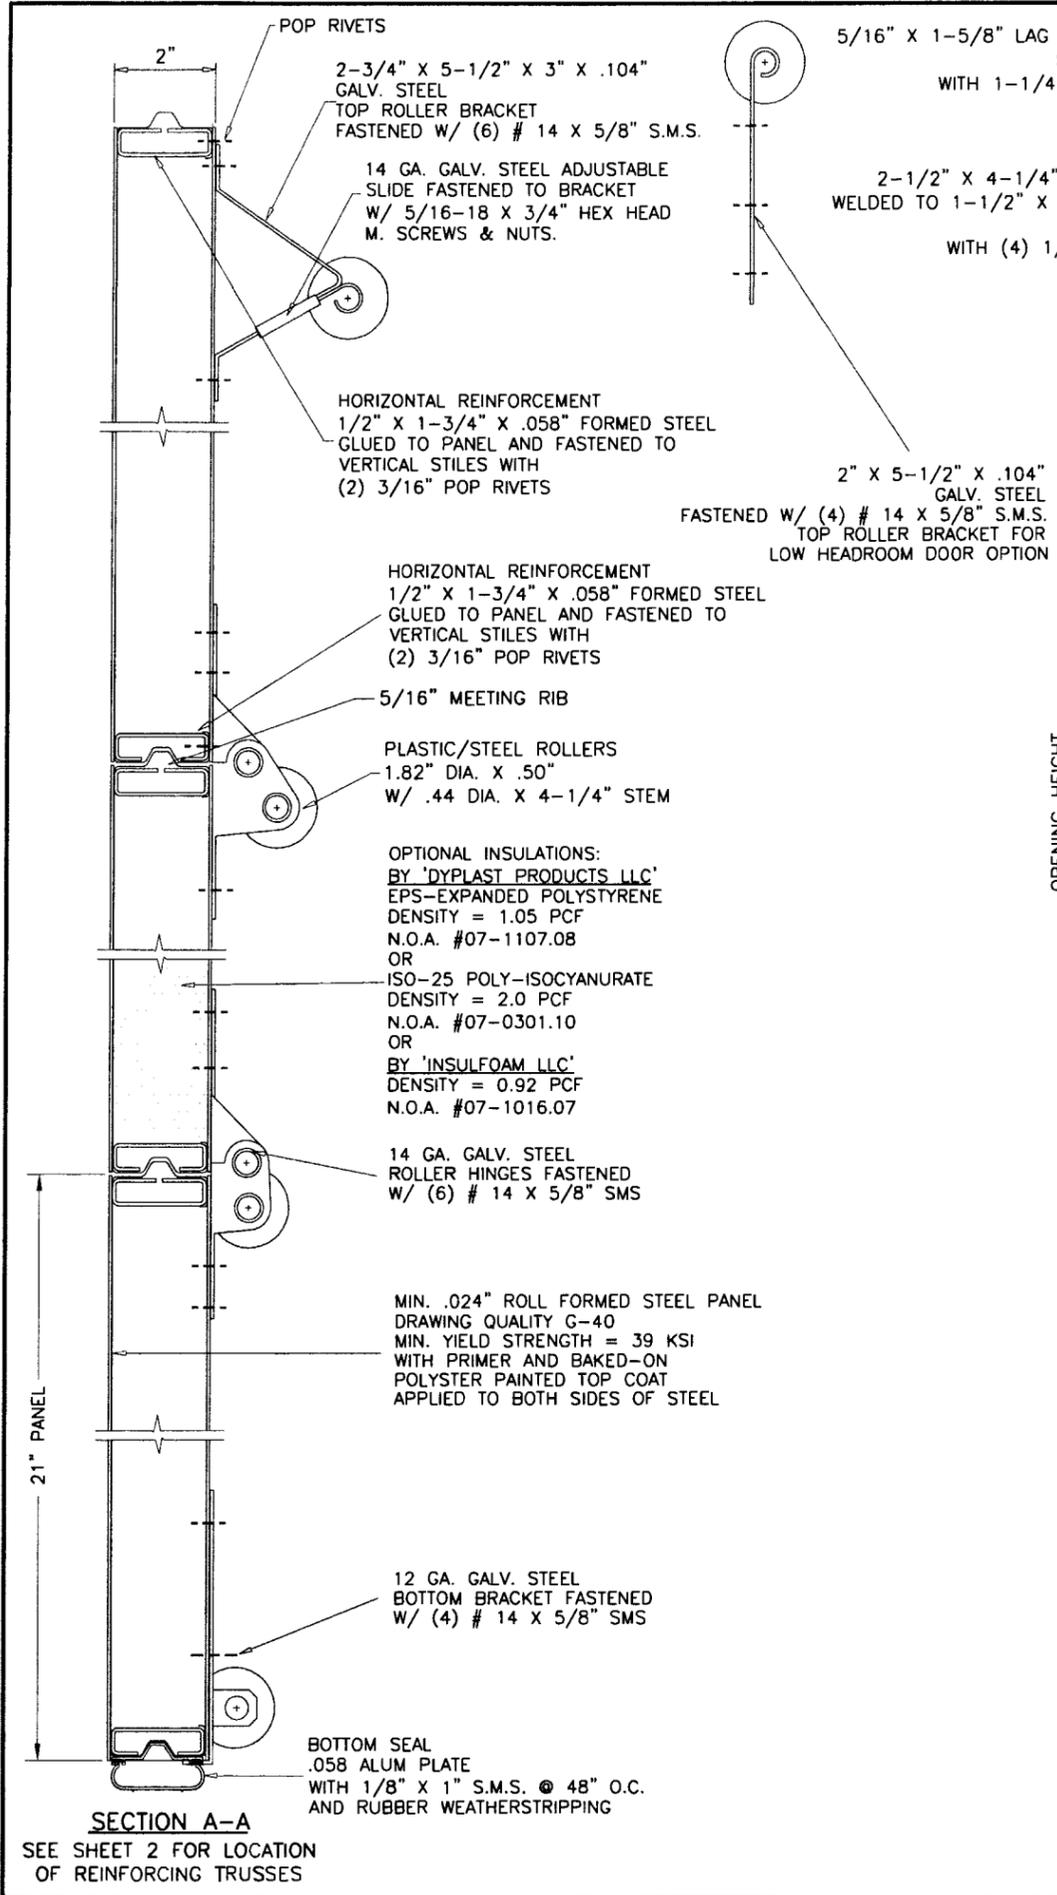

DOOR HEIGHT	* SECTION HEIGHTS					BRACKET PLACEMENTS							
	1ST	2ND	3RD	4TH	5TH	B1	B2	B3	B4	B5	B6	B7	B8
6'-0"	18"	18"	18"	18"	N/A	1"	11-3/4"	23"	34"	45"	56"	67"	-
6'-6"	21"	18"	18"	21"	N/A	1"	11-3/4"	23"	34"	45"	56"	67"	-
7'-0"	21"	21"	21"	21"	N/A	1"	11-3/4"	23"	34"	45"	56"	67"	-
7'-6"	18"	18"	18"	18"	18"	1"	11-3/4"	23"	34"	45"	56"	67"	78-1/4"
8'-0"	21"	18"	18"	18"	21"	1"	11-3/4"	23"	34"	45"	56"	67"	78-1/4"

\*-SECTIONS ARE NUMBERED STARTING AT THE BOTTOM FOR DOORS MORE THAN 8 FT. HIGH, USE ADDITIONAL TRACK BRACKETS AT 10" O.C.

1.9" X 2.19" X 3.3" X .090" STEEL TRACK BRACKETS 2-3/16" HIGH CONNECTED TO TRACK WITH (1) 1/4" BOLTS & NUTS.

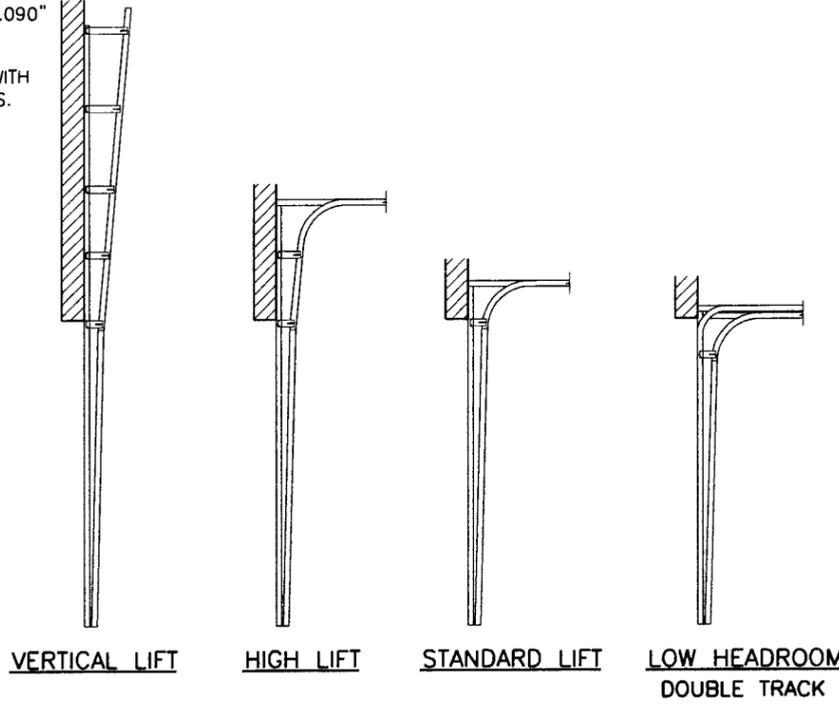

AVAILABLE TRACK OPTIONS

Engr: ARSHAD VIQAR  
 CIVIL  
 FLA. PE # 38863  
 C.A.N. 3538  
 JAN 08 2010

PRODUCT RENEWED  
 as complying with the Florida Building Code  
 Acceptance No 10-0216-09  
 Expiration Date 07/21/2015  
 By: *[Signature]*  
 Miami Trade Product Control Division

**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 GARAGE\02-21DAB

SECTIONAL GARAGE DOOR  
**DAB DOORS INC.**  
 12195 N.W. 98 TH. AVE.  
 HIALEAH GARDENS, FL. 33018  
 TEL. (305) 556 - 6624

no	date	by	description
A	12.09.02		REV. PER BCCO COMMENTS
B	01.19.05		NO CHANGE THIS SHEET
C	05.20.05		REV. PER BCCO COMMENTS
D	12.17.08		UPDATED FOR 2007 FBC
E	01.06.10		ENGR. NAME CHANGED

date: 09-10-02  
 scale: -  
 dr. by: HAMID  
 ch. by:  
 drawing no. 02-21  
 sheet 3 of 5

**WOOD FRAME BUILDINGS**

STUD WALLS OR DOOR OPENING (NOT BY DAB DOORS) SHALL BE FRAMED SOLID BY NOT LESS THAN (3) 2X6 PRESSURE TREATED GRADE 2 SYP OR BETTER WOOD STUDS.  
 STUD WALLS TO BE CONT. FROM FOOTING TO TIE BEAM. ENGINEER OF RECORD TO VERIFY ADEQUACY OF THE SUPPORTING STRUCTURE.

**WOOD BUCK CONNECTION TO MASONRY**

TRACK SHALL BE SECURED WITH CONT. STEEL ANGLE TO PRESSURE TREATED 2X6 SYP WOOD JAMBS WHICH SHALL BE ANCHORED TO GROUTED REINFORCED MASONRY BLOCK WALL OR CONC. COLUMN WITH

1/4" ULTRACON BY 'ELCO' WITH SPACING OF 16" O.C. INTO BLOCK WALL, WITH 2-1/4" MIN. EMBED 13" O.C. INTO 3000 PSI CONCRETE, WITH 1-3/4" MIN. EMBED 2-1/2" MIN. EDGE DISTANCE


1/4" TAPPER BY 'POWERS' WITH SPACING OF 11" O.C. INTO BLOCK WALL, WITH 1-1/2" MIN. EMBED 13" O.C. INTO 3000 PSI CONCRETE, WITH 1-3/4" MIN. EMBED 3" MIN. EDGE DISTANCE

3/8" CONFLX BY 'ELCO' OR 3/8" LDT BY 'ITW' WITH SPACING OF 23" O.C. INTO 3000 PSI CONCRETE, WITH 2-1/2" MIN. EMBED 3" MIN. EDGE DISTANCE

3/8" HLC SLEEVE BY 'HILTI' WITH SPACING OF 13" O.C. INTO BLOCK WALL, WITH 1-1/4" MIN. EMBED, 4" MIN. EDGE DIST. 15" O.C. INTO 3000 PSI CONCRETE, WITH 1-1/4" MIN. EMBED AND 2-1/2" MIN. EDGE DISTANCE

THE BLOCK WALL CELLS SHALL BE GROUT FILLED AND REINFORCED WITH FOUR # 5 BARS EXTENDING INTO FOOTING AND INTO TIE BEAMS ALL BARS SHALL BE CONTINUOUS FROM TIE BEAMS TO FOOTING.

**PREPARATION OF JAMBS BY OTHERS**

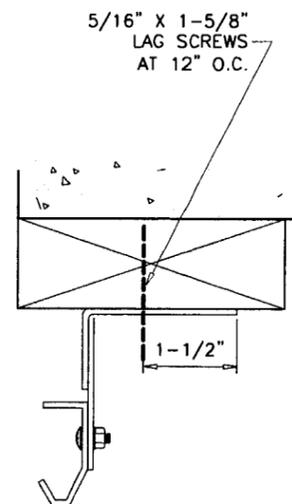

STEEL STRUCTURE BY OTHERS MUST SUPPORT THE LOADS IMPOSED BY DOOR SYSTEM

5/16" DIA. BOLTS WITH WASHER & NUT AT 12" O.C. MAX.

1-1/4" x 2-1/2" x 14 GA CONT. STEEL ANGLE  
 12 GA. GALV. STEEL FLAT BRACKETS ±3" LONG AT 12" O.C. IN DOOR OPNG. AT 18" O.C. ABOVE DOOR OPNG. CONNECTED TO CONT. ANGLE W/ (3) SPOT WELDS AT EACH SIDE

2-1/8" x 1" x 14 GA. GALV. STEEL TRACK FASTENED TO TRACK PLATES W/ (2) 1/4-20x5/8" TRUSS HD. SLOTTED M.S. & LOCK NUT

ANCHOR SPACING				
ANCHORS	STRUCTURE	EMBED	SPACING	EDGE DIST.
3/8" HLC SLEEVE BY 'HILTI'	CONC.	1-1/4"	8"	2"
3/8" HLC SLEEVE BY 'HILTI'	FILLED BLOCK	1-1/4"	8"	4"
3/8" DYNABOLT BY 'ITW'	CONC.	1-1/2"	8"	2-1/2"
3/8" DYNABOLT BY 'ITW'	FILLED BLOCK	1-1/2"	8"	3-3/4"
3/8" POWER-BOLT BY 'POWERS'	CONC.	2"	8"	2"
3/8" SLEEVE-ALL BY 'SIMPSONS'	CONC.	1-1/2"	8"	3"

CONCRETE f'c = 3000 PSI MIN.  
 C-90 GROUT FILLED BLOCK f'm = 2000 PSI MIN.

**ALTERNATE TRACK INSTALLATION**

Engr: ARSHAD VIQAR  
 CIVIL  
 FLA. PE # 38863  
 C.A.N. 3538

*Arshad Viqar*  
 JAN 08 2010

**PRODUCT RENEWED**  
 as complying with the Florida Building Code  
 Acceptance No. 10-0216.04  
 Expiration Date 01/21/2015  
 By *[Signature]*  
 Miami/Dade Product Control Division


revisions:

no	date	description
A	12.09.02	REV. PER BCCO COMMENTS
B	01.19.05	NO CHANGE THIS SHEET
C	05.20.05	REV. PER BCCO COMMENTS
D	12.17.08	UPDATED FOR 2007 FBC
E	01.06.10	ENGR. NAME CHANGED


date: 09-10-02  
 scale: -  
 dr. by: HAMID  
 chk. by:

drawing no.  
**02-21**




\* PLASTIC COMPLIES WITH SECTION 2612 OF FBC 2007 SEE EVIDENCE PAGE

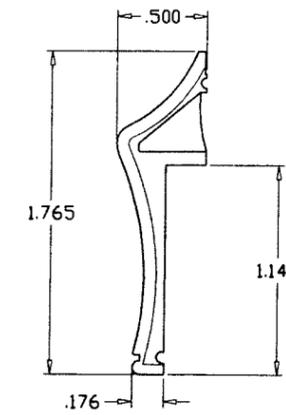


\* EXTERIOR FRAME  
RIGID PVC ONE PIECE INJECTION

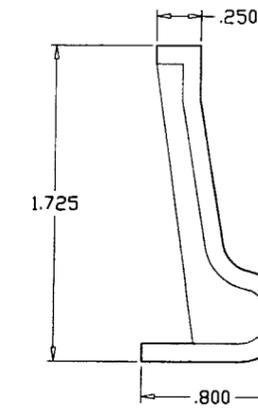

\* INTERIOR FRAME  
RIGID PVC ONE PIECE INJECTION

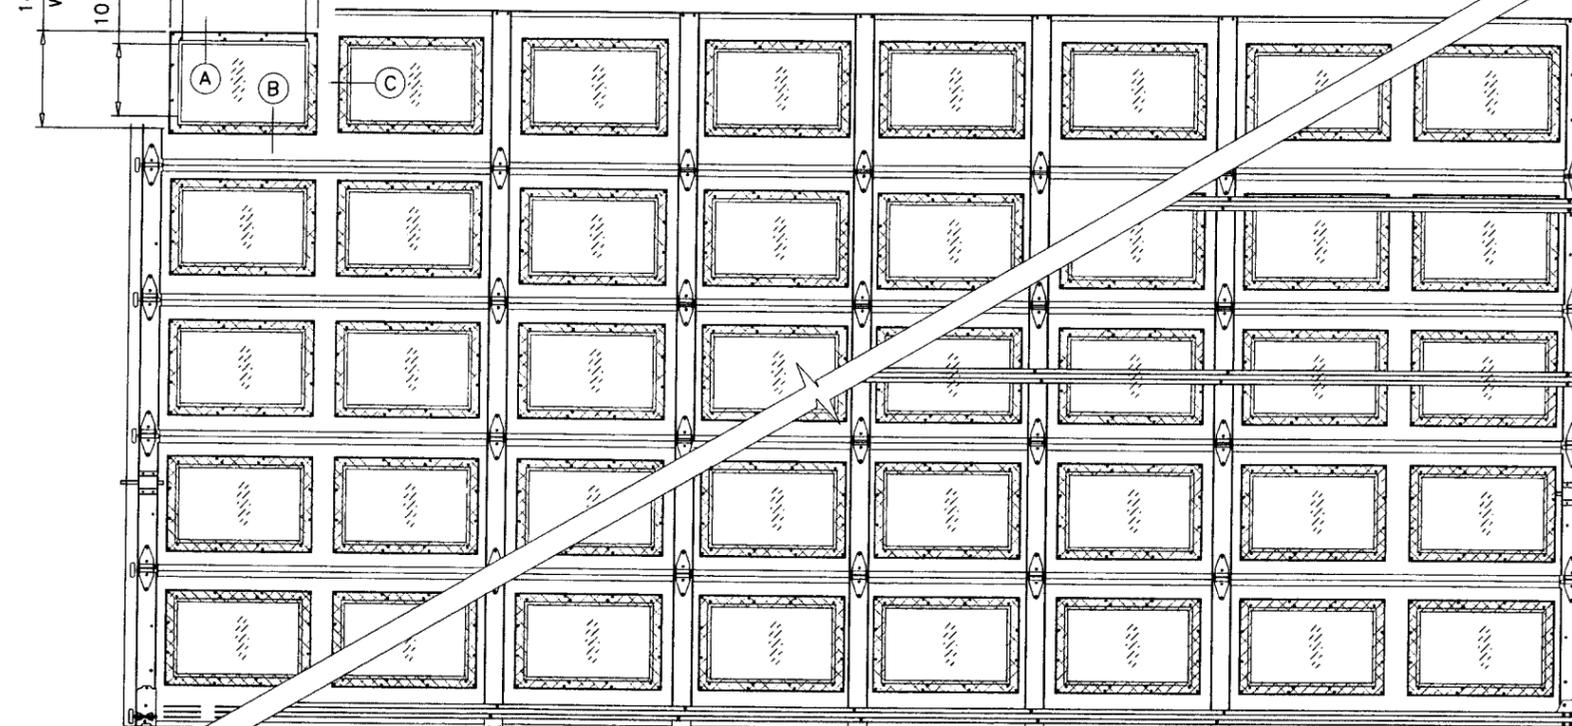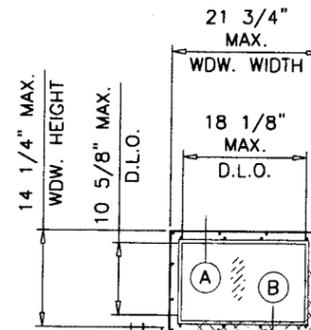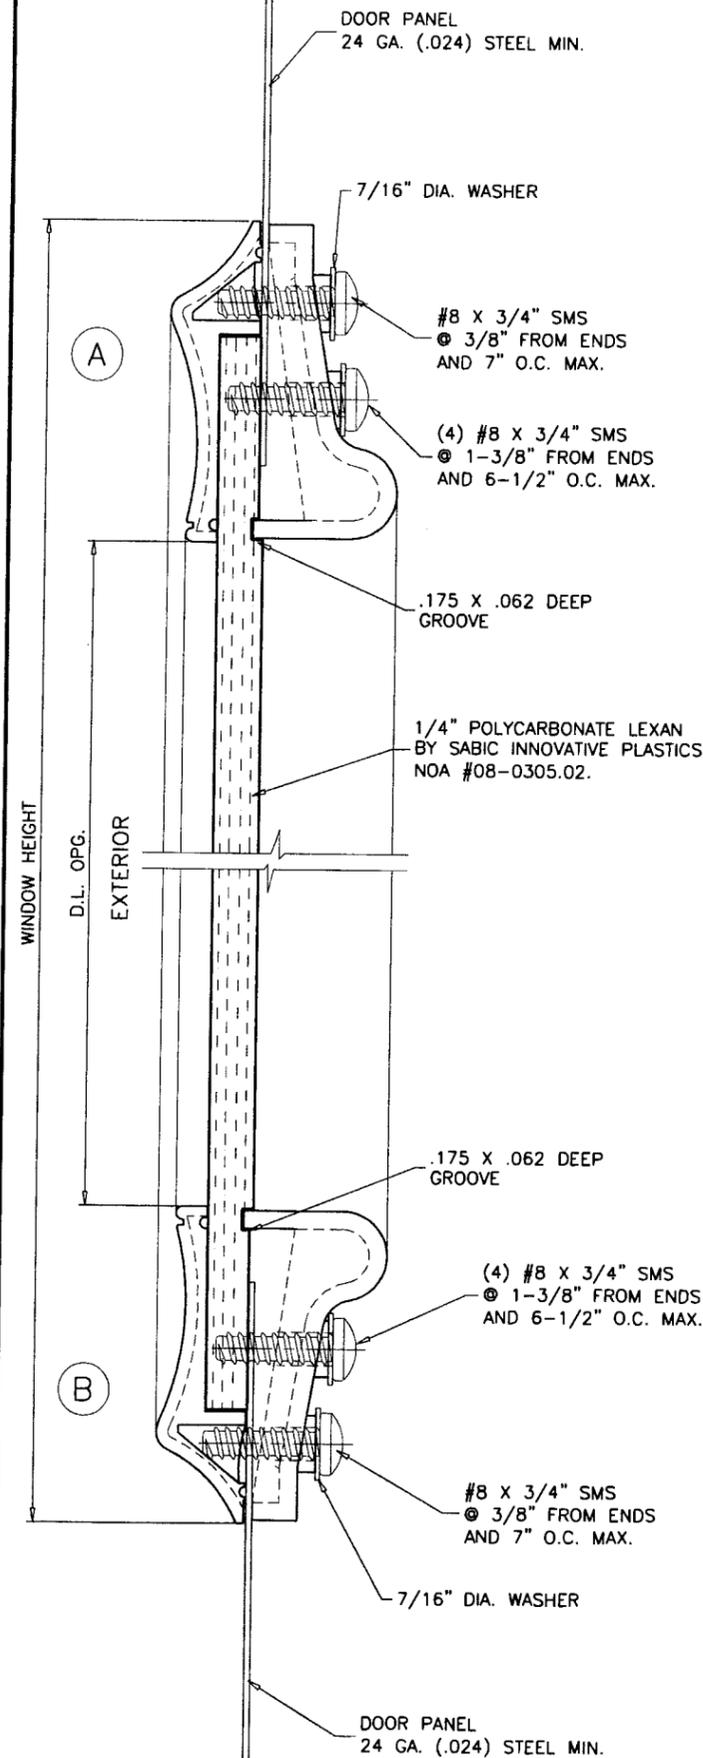

INSIDE ELEVATION  
RAISED PANEL EMBOSSED DOOR WITH OPTIONAL WINDOWS

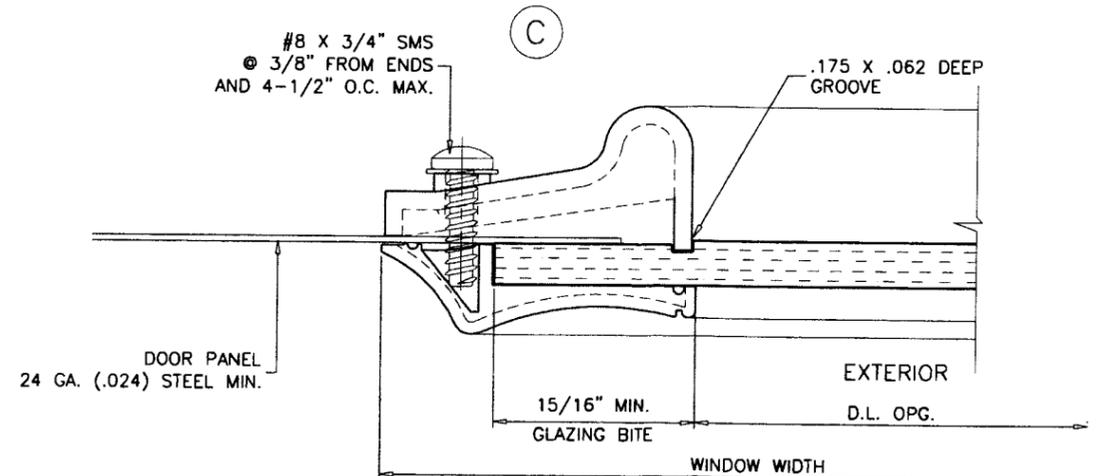

Engr: ARSHAD VIQAR  
CIVIL  
FLA. PE # 38863  
C.A.N. 3538

*Arj*

JAN 08 2010

PRODUCT RENEWED  
as complying with the Florida  
Building Code  
Acceptance No 10-0216-09  
Expiration Date 07/21/2015

By *[Signature]*  
Miami Trade Product Control  
Division

**a f c**

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
GARAGE \02-21DAB

SECTIONAL GARAGE DOOR

**DAB DOORS INC.**  
12195 N.W. 98 TH. AVE.  
HIALEAH GARDENS, FL. 33018  
TEL. (305) 556 - 6624

revisions:		no	date	by	description
B	01.19.05				DOORS W/ WDW. OPTION ADDED
C	05.20.05				REV. PER BCCO COMMENTS
D	12.17.08				UPDATED FOR 2007 FBC
E	01.06.10				ENGR. NAME CHANGED

date: 09-10-02  
scale: -  
dr. by: HAMID  
chk. by:

drawing no.  
**02-21**

sheet 5 of 5