



BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208

Miami, Florida 33175-2474

T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/building/home/asp

NOTICE OF ACCEPTANCE (NOA)

E.S. Windows, LLC
10653 NE Quaybridge Ct.
Miami, FL 33138

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Section and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 9000 Aluminum Outswing French Door-L.M.I.

APPROVAL DOCUMENT: Drawing No. **W08-66**, titled "Series- 9000 Alum Outswing French Door (L.M.I.)", sheets 1 through 10.1 of 10.1, dated MAR 03, 2011, prepared by AL-Farooq Corporation, , signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large Missile Impact Resistant

Limitation:

1. The Single Door with Transom is limited to Maximum Design Pressure $DP = \pm 90$ PSF.
2. Only Single Door w/ High Threshold option item E-2B (part # ES-9026) is rated for external Positive +120 PSF Water Resistant Rating.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **08-0813.04** and consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**

MIAMI-DADE COUNTY
APPROVED

NOA No 10-0301.03
Expiration Date: October 13, 2013
Approval Date: March 31, 2011

Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS (transferred from file # **08-0813.04**)

1. Manufacturer's die drawings and sections.
2. Drawing No. **W08-66**, titled "Series- 9000 Alum Outswing French Door (L.M.I.)", sheets 1 through 10.1 of 10.1, dated MAR 03, 2011, prepared by AL-Farooq Corporation, , signed and sealed by Javad Ahmad, P.E.

B. TESTS (transferred from file # **08-0813.04**)

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94(Not performed)
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

Along with marked-up drawings and installation diagram of an Alum. Outswing Entrance Door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5554**, dated 05/10/08, signed and sealed by Carlos S. Rionda, P.E.

2. Test reports on: 1) Uniform Static Air Pressure Test,
 - 2) Large Missile Impact Test per FBC, TAS 201-94
 - 3) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings of an Alum. Outswing Entrance Door, prepared by FTL, Inc., Test Report No. **FTL-5556**, dtd 04/27/08, signed and sealed by Carlos S. Rionda, P.E.

3. Additional Test reports along with marked-up Dwg. of a single (X) aluminum outswing door per TAS 201, 202 (Full) and 203-94, issued by Fenestration Testing lab, Inc., Test Report No. **FTL-5992**, dtd 09/09/09, reissued on 2/2/11 signed & sealed by Marlin D. Brinson, P. E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al Farooq Corporation, dated 01/08/10, 06/15/10, 11/02/10, 12/17/10 and last revised on 01/13/11, signed and sealed by Javad Ahmad, P.E
2. Glazing complies w/ ASTM E-1300-02 & -04

D. QUALITY ASSURANCE

1. Miami Dade Building and Neighborhood Compliance Department (BNC).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **07-1116.04** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass ® Plus**", expiring on 01/14/12.
2. Notice of Acceptance No. **10-0922.09** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite PVB, Interlayer**" dated January 05, 2006, expiring on 12/11/11.

F. STATEMENTS

1. Statement letter of conformance and "No financial statement, dated June 07, 2010, signed and sealed by Javad Ahmad, P.E.
2. Statement of Lab compliance, as part of above referenced test reports.

G. OTHER

1. This NOA **revises** NOA # **08-0813.04**, expired on 10/13, 2013.
2. Distribution agreement ES Windows-Energia Solar, S.A. and ES Windows, LLC, dated 10/20/10, signed by Ms Carla G. Torrente and Andres Chamorro respectively.
3. Test proposals # **07-4070** & **09-0165**, approved by BCCO.


Ishaq I. Chanda, P.E.

Product Control Examiner

NOA No 10-0301.03

Expiration Date: October 13, 2013

Approval Date: March 31, 2011

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

SERIES 9000 **ALUMINUM OUTSWING ENTRANCE DOOR**

SEE CHARTS ON THIS SHEET FOR DESIGN LOAD CAPACITY OF
SINGLE DOORS WITH OR WITHOUT TRANSOMS.

SEE CHARTS ON SHEET 2 FOR DESIGN LOAD CAPACITY OF
DOUBLE DOORS WITH OR WITHOUT TRANSOMS.

DOORS CAN ALSO BE USED WITH SERIES 8000 OR SERIES 9500
STOREFRONT SYSTEM UNDER SEPARATE APPROVAL.
FOR DOORS WITH STOREFRONT SYSTEM SEE SEPARATE NOA FOR
DOOR MULLION CAPACITY AND ANCHORING REQUIREMENTS.

THE LOWEST VALUE RESULTING FROM DOOR CAPACITY CHARTS
OR STOREFRONT NOA WILL APPLY TO ENTIRE SYSTEM.

DOORS ARE NOT APPROVED FOR INSTALLATION WHERE WATER
RESISTANCE IS REQUIRED EXCEPT SINGLE DOORS USING
ES-9026 (HIGH THRESHOLD OPTION) IS APPROVED FOR WATER
INFILTRATION RESISTANCE.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING
HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO
TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS
EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS
ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO
CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS
OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

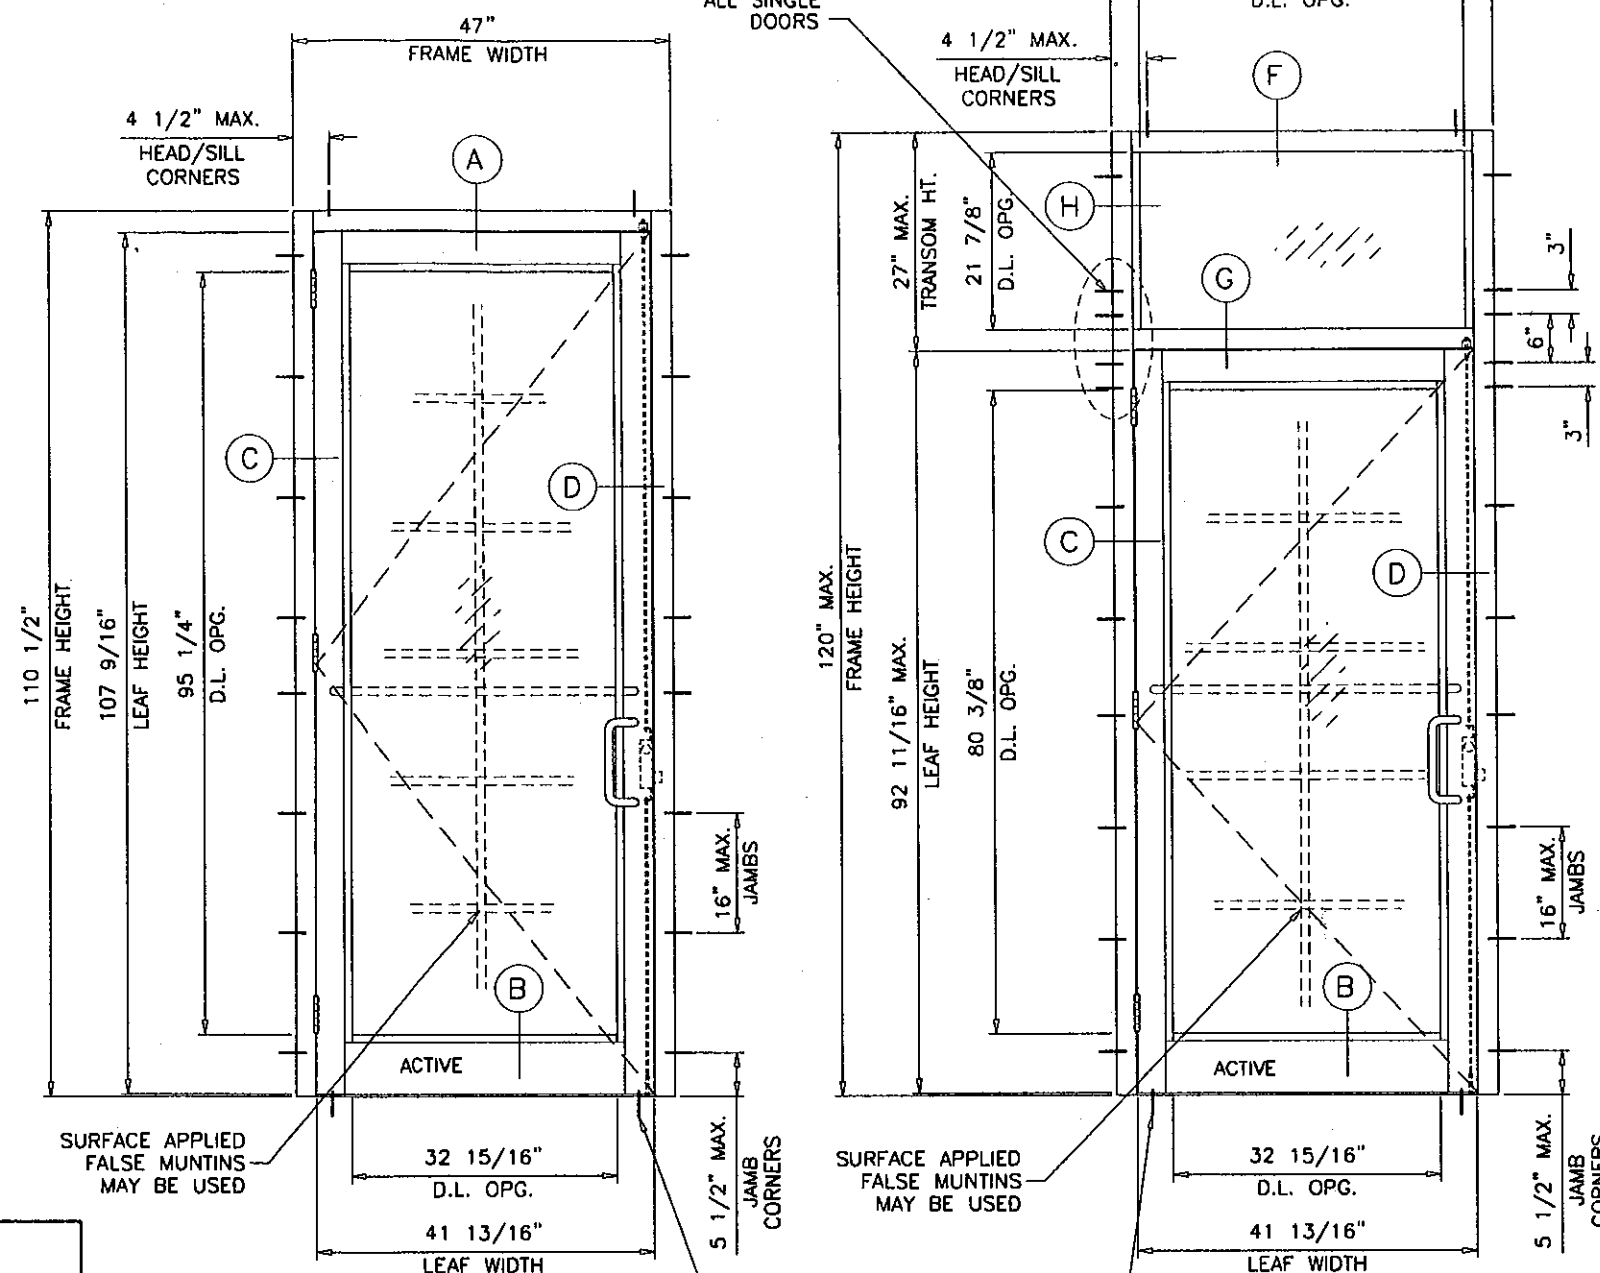


TABLE #1 DOORS LOAD CAPACITY - PSF								
SINGLE DOORS WITHOUT TRANSOM (X) OR WITH TRANSOM* (O/X)								
DOOR DIMS.		GLASS		LOCKS			HINGES	
		TYPE 'A'	TYPE 'B'/'C'	OPTION #1	OPTION #2	OPTION #3	OPTION #1	OPTION #2
FRAME WIDTH	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
47"	98-1/2"	80.0	120.0	80.0	90.0	120.0	80.0	120.0
47"	110-1/2"	80.0	120.0	80.0	90.0	120.0	80.0	120.0

SEE SHEET 8 FOR GLASS TYPES DESCRIPTION
SEE SHEET 9 FOR LOCKS AND HINGES DESCRIPTION

TABLE #2 ANCHORS LOAD CAPACITY - PSF						
SINGLE DOORS WITHOUT TRANSOM (X) OR WITH TRANSOM* (O/X)						
DOOR DIMS.		1/2" SHIM SPACE		1/4" SHIM SPACE		
		ANCHOR TYPE 'B'	ANCHOR TYPE 'C'	ANCHOR TYPE 'A'	ANCHOR TYPE 'B'	ANCHOR TYPE 'D'
FRAME WIDTH	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
40"	110-1/2"	102.0	120.0	109.0	120.0	120.0
47"	110-1/2"	87.0	115.0	93.0	117.0	120.0

SEE SHEET 3 FOR ANCHOR DESCRIPTION

TYPICAL ELEVATION (X)

PRODUCT REVISION
as complying with the Florida
Building Code
Acceptance No. 10-0301.03
Expiration Date 10/13/2013
By: [Signature]
[Signature]

SINGLE DOORS WITH OR WITHOUT TRANSOMS
USE CHARTS AS FOLLOWS
FOR THE CORRESPONDING DOOR SIZE
1- FOR GLASS TYPE, LOCK AND HINGE OPTIONS
OBTAIN LOAD CAPACITIES FROM TABLE 1.
2- FOR ANCHORS TYPE/SHIMSPACE OBTAIN
LOAD CAPACITIES FROM TABLE 2.
3- TRANSOMS FOR SINGLE DOORS ARE LIMITED
TO ±90.0 PSF*
THE LOWEST VALUES FROM STEPS 1, 2 AND 3
WILL GOVERN.

TYPE A, B OR C ANCHORS AT
STD. AND HIGH THRESHOLD.
TYPE B & C AT SADDLE THRESHOLD

TYPICAL ELEVATION (O/X)

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70392
C.A.N. 3538
MAR 03 2011

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 262-6978 FAX (305) 262-6978
COMP-ANL\W08-66ESW

SERIES-9000 ALUM OUTSWING FRENCH DOOR (L.M.I.)
E.S. WINDOWS LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 249-0840 FAX. (305) 249-0842

revisions:

no	date	by	description
B	12.15.09		HIGH SILL & INSUL. GLASS ADD.
C	06.08.10		REV. PER BCCO COMMENTS
D	10.28.10		REV. PER BCCO COMMENTS
E	12.15.10		REV. PER BCCO COMMENTS
F	01.05.11		REV. PER BCCO COMMENTS

date: 07-14-08
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:

drawing no.
W08-66
sheet 1 of 10.1

- DOUBLE DOORS WITH OR WITHOUT TRANSOMS
USE CHARTS AS FOLLOWS
FOR THE CORRESPONDING DOOR SIZE
- 1- FOR GLASS TYPE, LOCK AND HINGE OPTIONS OBTAIN LOAD CAPACITIES FROM TABLE 3.
 - 2- FOR JAMB ANCHORS, TYPE/SHIMSPACE OBTAIN LOAD CAPACITIES FROM TABLE 4.
 - 3- FOR HEAD ANCHORS, TYPE/SHIMSPACE OBTAIN LOAD CAPACITIES FROM TABLE 5.
 - 4- USE TYPE AA, BB OR CC ANCHORS AT SILL AS APPLICABLE. SEE SADDLE SILL ANCHOR CAPACITY - SEE TABLE 5A BELOW.
- THE LOWEST VALUES FROM STEPS 1, 2, 3 AND 4 WILL GOVERN.

TABLE #3 DOORS LOAD CAPACITY - PSF DOUBLE DOOR WITHOUT TRANSOM (XX) OR WITH TRANSOM (O/XX)								
DOOR DIMS.		GLASS		LOCKS			HINGES	
		TYPE 'A'	TYPE 'B'/'C'	OPTION #1	OPTION #2	OPTION #3	OPTION #1	OPTION #2
FRAME WIDTH	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
89"	98-1/2"	80.0	90.0	80.0	90.0	90.0	80.0	90.0
89"	110-1/2"	80.0	80.0	80.0	80.0	80.0	80.0	90.0

SEE SHEET 8 FOR GLASS TYPES DESCRIPTION
SEE SHEET 9 FOR LOCKS AND HINGES DESCRIPTION

TABLE #4 JAMB ANCHORS LOAD CAPACITY - PSF DOUBLE DOOR WITHOUT TRANSOM (XX) OR WITH TRANSOM (O/XX)						
DOOR DIMS.		1/2" SHIM SPACE		1/4" SHIM SPACE		
		ANCHOR TYPE 'B'	ANCHOR TYPE 'C'	ANCHOR TYPE 'A'	ANCHOR TYPE 'B'	ANCHOR TYPE 'D'
FRAME WIDTH	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
75"	110-1/2"	90.0	90.0	90.0	90.0	90.0
89"	110-1/2"	87.0	90.0	90.0	90.0	90.0


SEE SHEET 3 FOR ANCHOR DESCRIPTION

TABLE #5 HEAD ANCHORS LOAD CAPACITY - PSF DOUBLE DOOR WITHOUT TRANSOM (XX) OR WITH TRANSOM (O/XX)									
DOOR DIMS.		1/2" SHIM SPACE		3/8" SHIM SPACE			1/4" SHIM SPACE		
		ANCHOR TYPE 'B'	ANCHOR TYPE 'C'	ANCHOR TYPE 'A'	ANCHOR TYPE 'B'	ANCHOR TYPE 'C'	ANCHOR TYPE 'A'	ANCHOR TYPE 'B'	ANCHOR TYPE 'C'
FRAME WIDTH	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
75"	98-1/2"	80.0	90.0	90.0	90.0	90.0	90.0	90.0	90.0
89"		89.0	90.0	76.0	90.0	90.0	90.0	90.0	90.0
75"	110-1/2"	90.0	90.0	80.0	90.0	90.0	90.0	90.0	90.0
89"		79.0	90.0	68.0	90.0	90.0	83.0	90.0	90.0

SEE SHEET 3 FOR ANCHOR DESCRIPTION

TABLE #5A SADDLE SILL ANCHORS LOAD CAPACITY - PSF SINGLE OR DOUBLE DOORS WITH OR WITHOUT TRANSOMS			
DOOR DIMS.		ANCHOR TYPE 'B'	ANCHOR TYPE 'C'
FRAME WIDTH	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)
75"	98-1/2"	86.0	90.0
89"		72.0	90.0
75"	110-1/2"	76.0	90.0
89"		64.0	86.0

SEE SHEET 3 FOR ANCHOR DESCRIPTION

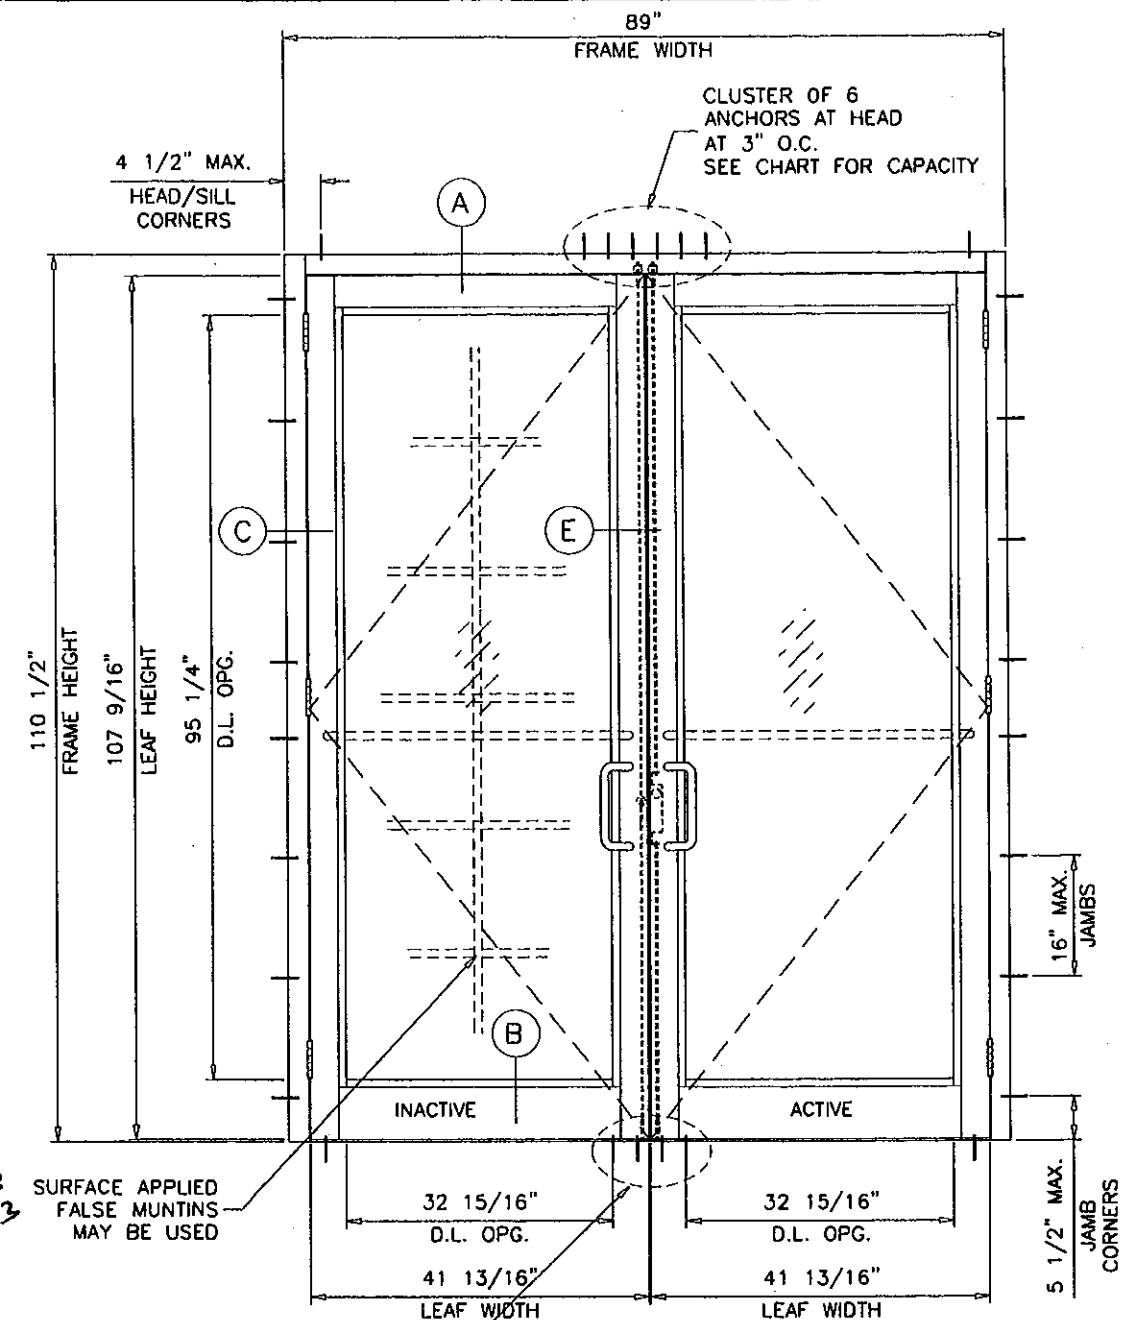

TYPICAL ELEVATION
(XX)

SEE SHEET 3 FOR ELEVATION (O/XX)

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

MAR 03 2011

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL W08-66ESW

SERIES-9000 ALUM OUTSWING FRENCH DOOR (L.M.I.)
E.S. WINDOWS LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 249-0840 FAX. (305) 249-0842

revisions:		by description	
no	date	no	date
B	12.15.09	1	12.15.09
C	06.08.10	2	06.08.10
D	10.28.10	3	10.28.10
E	12.15.10	4	12.15.10
F	01.05.11	5	01.05.11

date: 07-14-08
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W08-66

sheet 2 of 10.1

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A' 1/4" DIA ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 WITH 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY WOOD BUCKS INTO CONCRETE
 WITH 1-1/4" MIN. EMBED INTO CONCRETE

DIRECTLY INTO CONCRETE WITH 1-3/8" EMBED)

DIRECTLY INTO C90 FILLED BLOCK (JAMBS ONLY)
 WITH 1-1/4" MIN. EMBED INTO MASONRY

ANCHOR EDGE DISTANCES

INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.

TYPE 'B' 1/4" DIA KWIK CON II BY 'HILTI' (Fu=163 KSI, Fy=157 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 WITH 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY WOOD BUCKS INTO CONCRETE
 WITH 1-1/4" MIN. EMBED INTO CONCRETE

DIRECTLY INTO CONCRETE WITH 1-3/8" EMBED)

DIRECTLY INTO C90 FILLED BLOCK (JAMBS ONLY)
 WITH 1-1/2" MIN. EMBED INTO MASONRY

ANCHOR EDGE DISTANCES

INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.

TYPE 'C' 5/16" DIA ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 WITH 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY WOOD BUCKS INTO CONCRETE
 WITH 1-1/4" MIN. EMBED INTO CONCRETE

DIRECTLY INTO CONCRETE WITH 1-3/8" EMBED

DIRECTLY INTO C90 FILLED BLOCK (JAMBS ONLY)
 WITH 1-1/2" MIN. EMBED INTO MASONRY

ANCHOR EDGE DISTANCES

INTO CONCRETE AND MASONRY = 2-1/2" MIN. (AT HEAD/SILL)
 INTO CONCRETE AND MASONRY = 2-3/4" MIN. (AT JAMBS)
 INTO WOOD STRUCTURE = 1" MIN.

TYPE 'D' (HEAD OR JAMB)

#14 SMS OR SELF DRILLING SCREWS (Fu=92 KSI, Fy=120 KSI)

D: INTO METAL STRUCTURES

STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)

ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)


(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

ANCHOR EDGE DISTANCES

INTO METAL STRUCTURE = 1/2" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 10-0301.03
 Expiration Date 10/13/2012
 J. Shas. J. Shas. J. Shas.
 Head Date Product Control

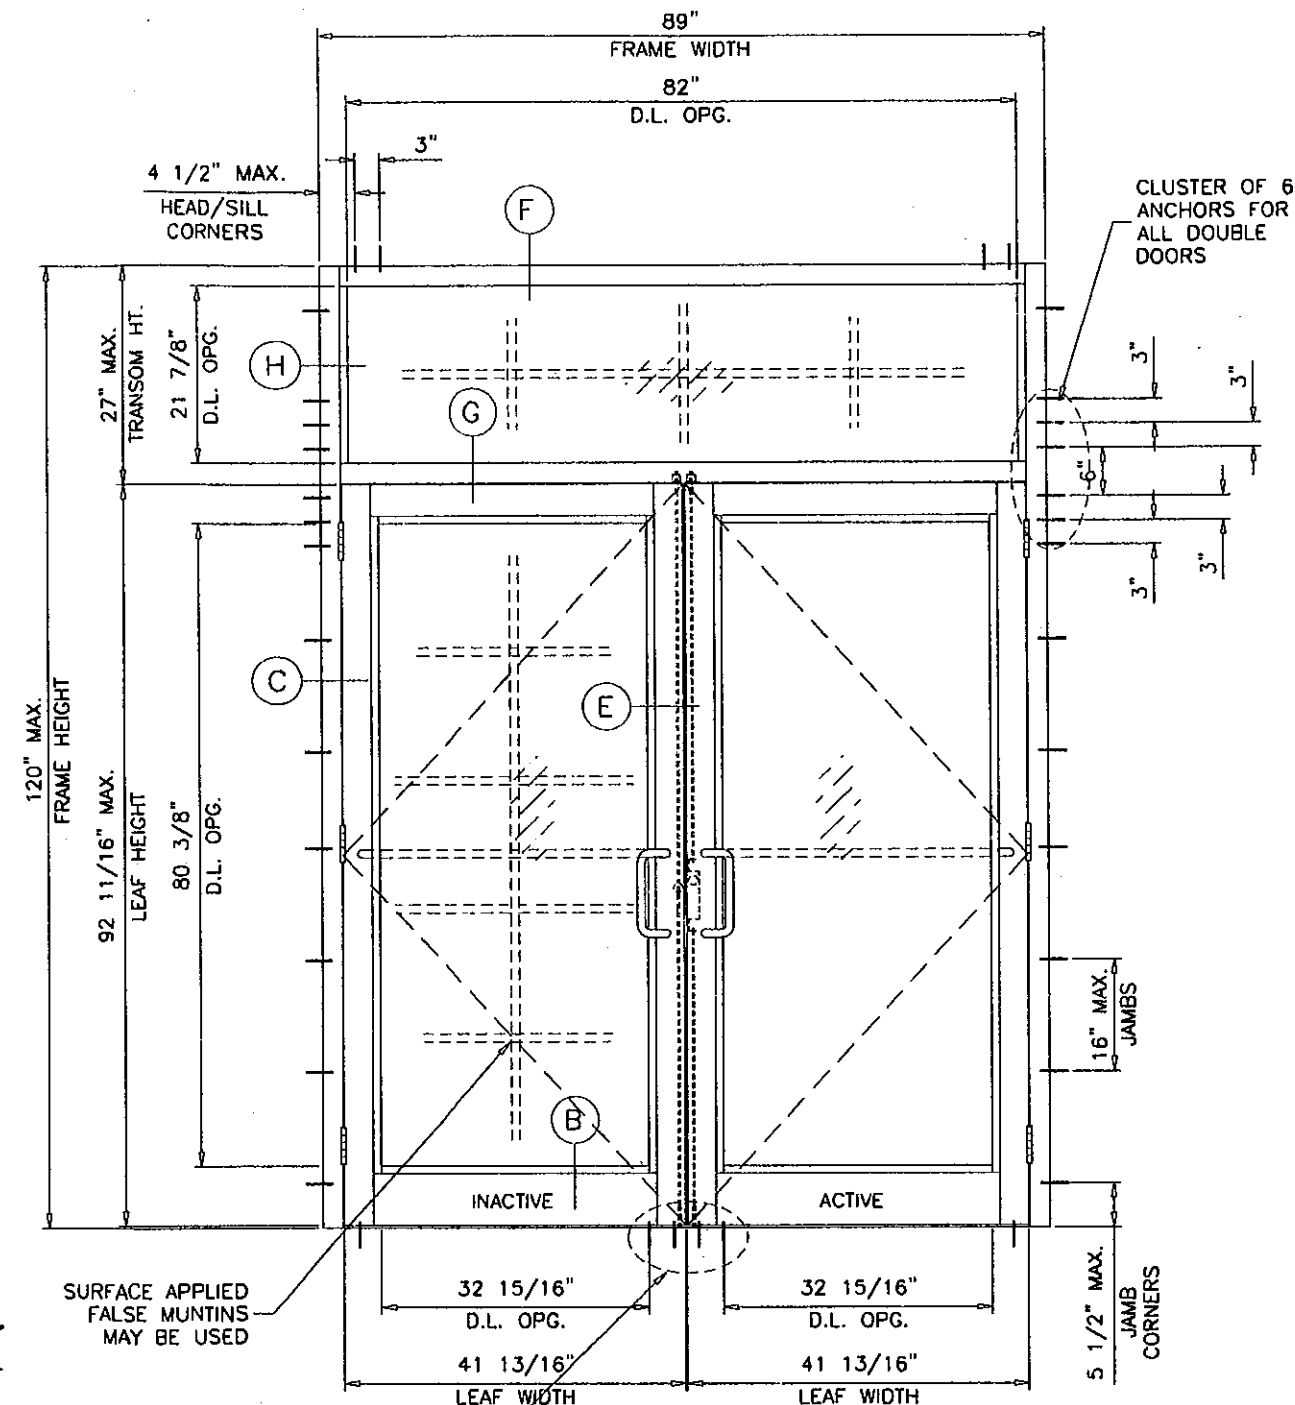

ANCHORS AT SILL
 CLUSTER OF 4 AT 3" O.C.
 TYPE 'A', 'B' OR 'C' AT STD. & HIGH THRESHOLD
 TYPE 'B' OR 'C' AT SADDLE THRESHOLD
 HEAD OR SILL ANCHORS MAY CONTROL

TYPICAL ELEVATION
 (O/XX)

SEE CHARTS ON SHEET 2 FOR DOOR AND TRANSOM LOAD CAPACITY

1x OR 2x WOOD BUCKS AND METAL STRUCTURES NOT BY E.S. WDW.
 MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND
 TRANSFER THEM TO THE BUILDING STRUCTURE.

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

MAJ 03 2011

a f c

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W08-66ESW

SERIES-9000 ALUM OUTSWING FRENCH DOOR (L.M.I.)

E.S. WINDOWS LLC
 5220 N.W. 72 AVE. BAY #4
 MIAMI, FL. 33166
 TEL. (305) 249-0840 FAX. (305) 249-0842

Revisions:		by description	
no	date	no	date
B	12.15.09	NO CHANGE THIS SHEET	
C	06.08.10	NO CHANGE THIS SHEET	
D	10.28.10	REV. PER BCCO COMMENTS	
E	12.15.10	REV. PER BCCO COMMENTS	
F	01.06.11	REV. PER BCCO COMMENTS	

date: 07-14-08


scale: 1/2"=1'-0"




dr. by: HAMID

chk. by:

drawing no.
W08-66

sheet 3 of 10.1

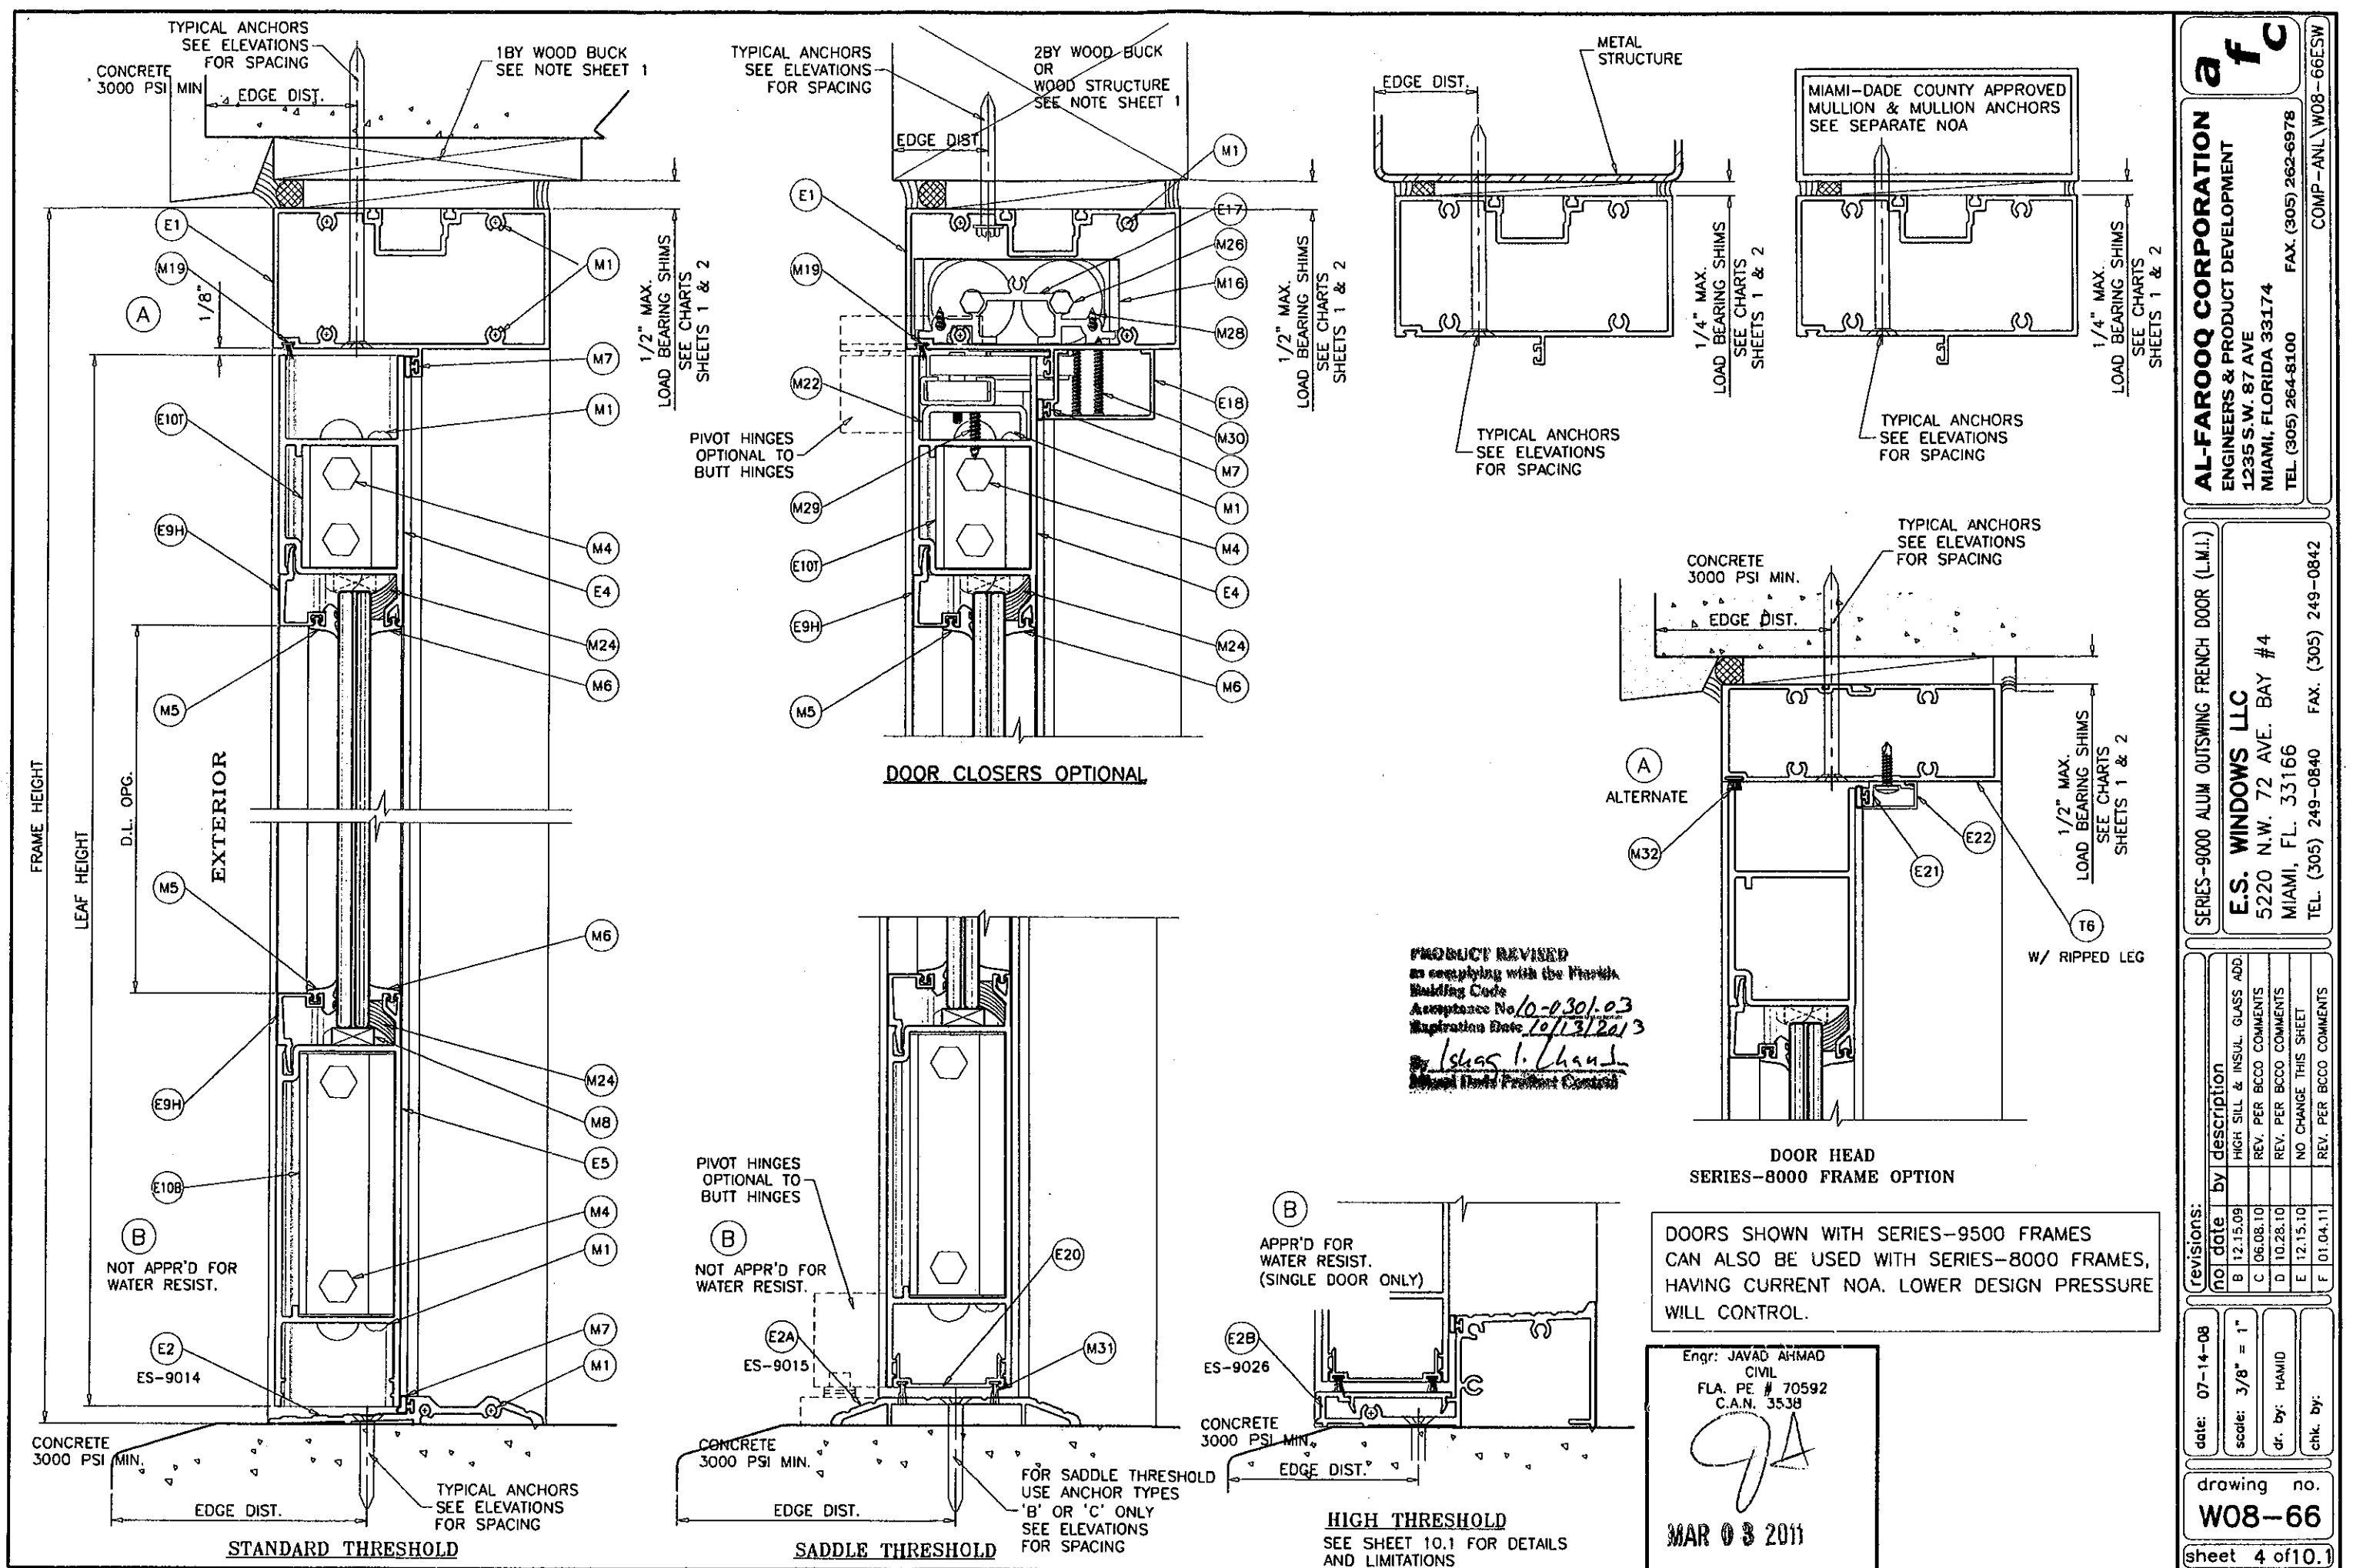

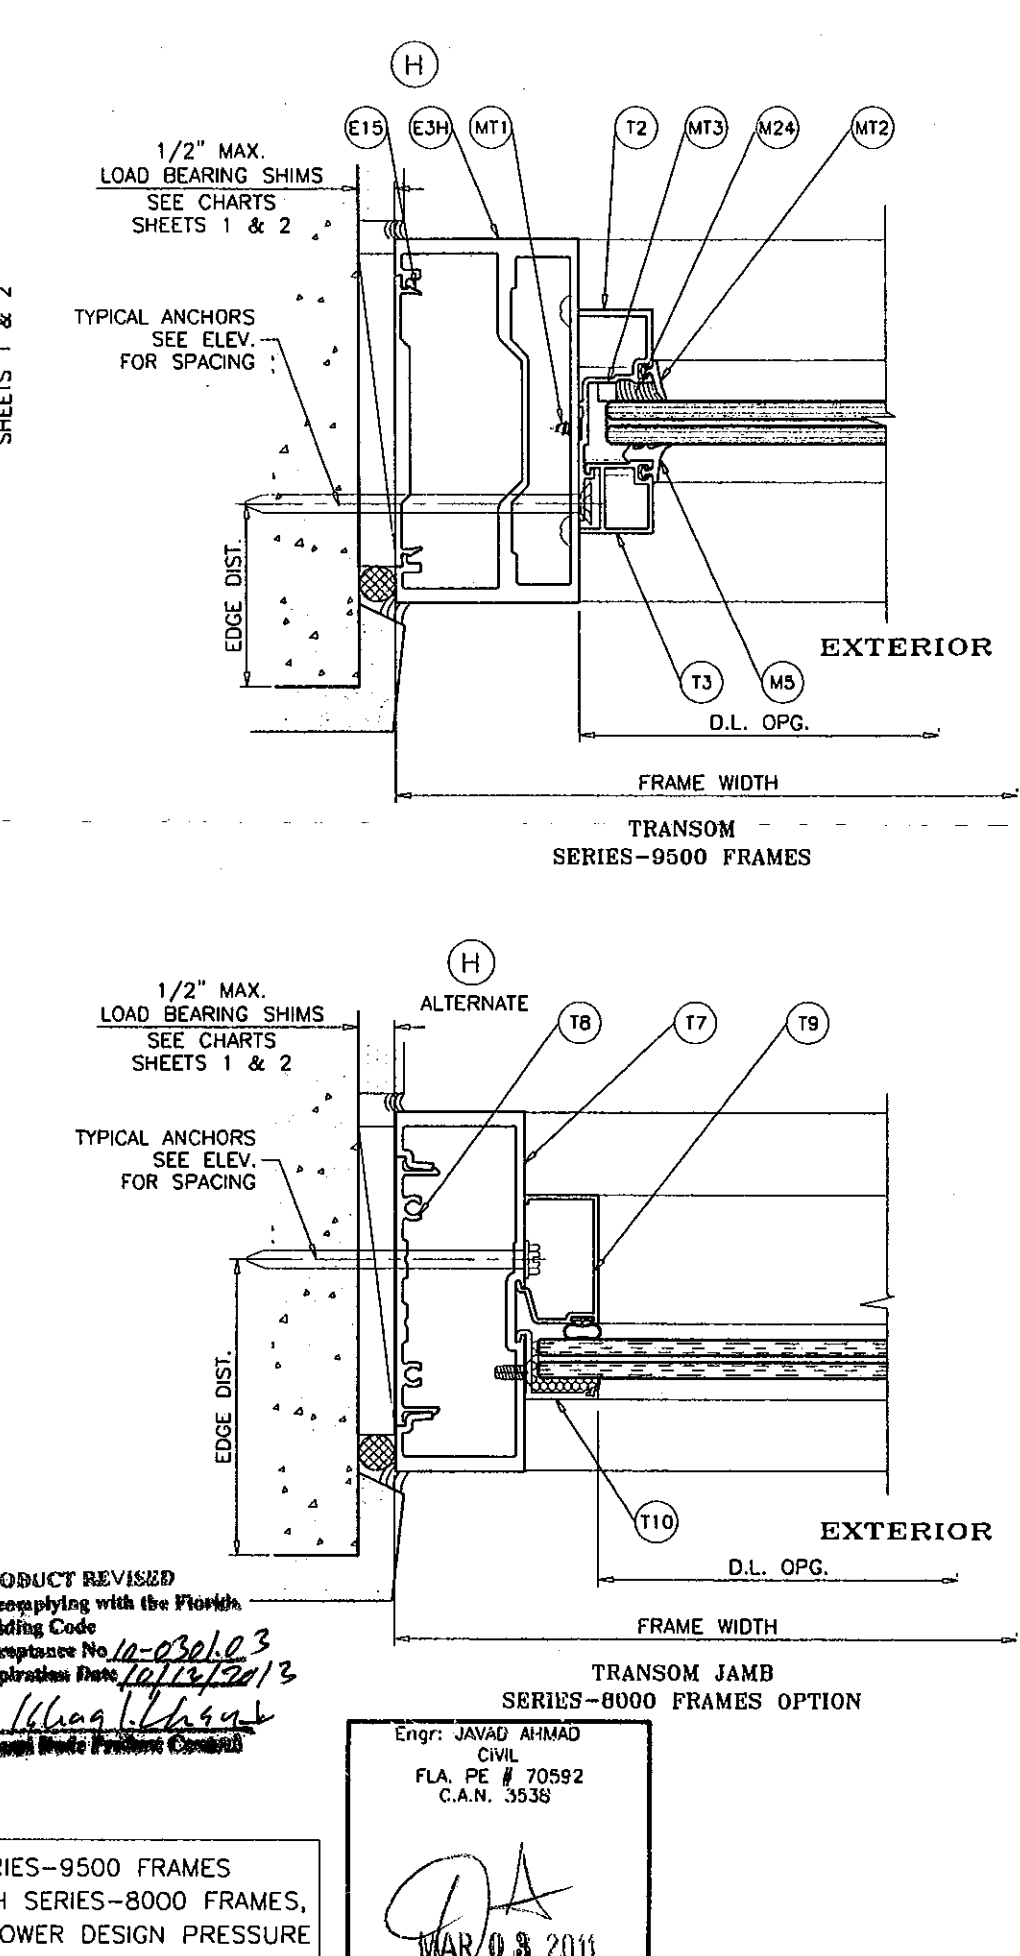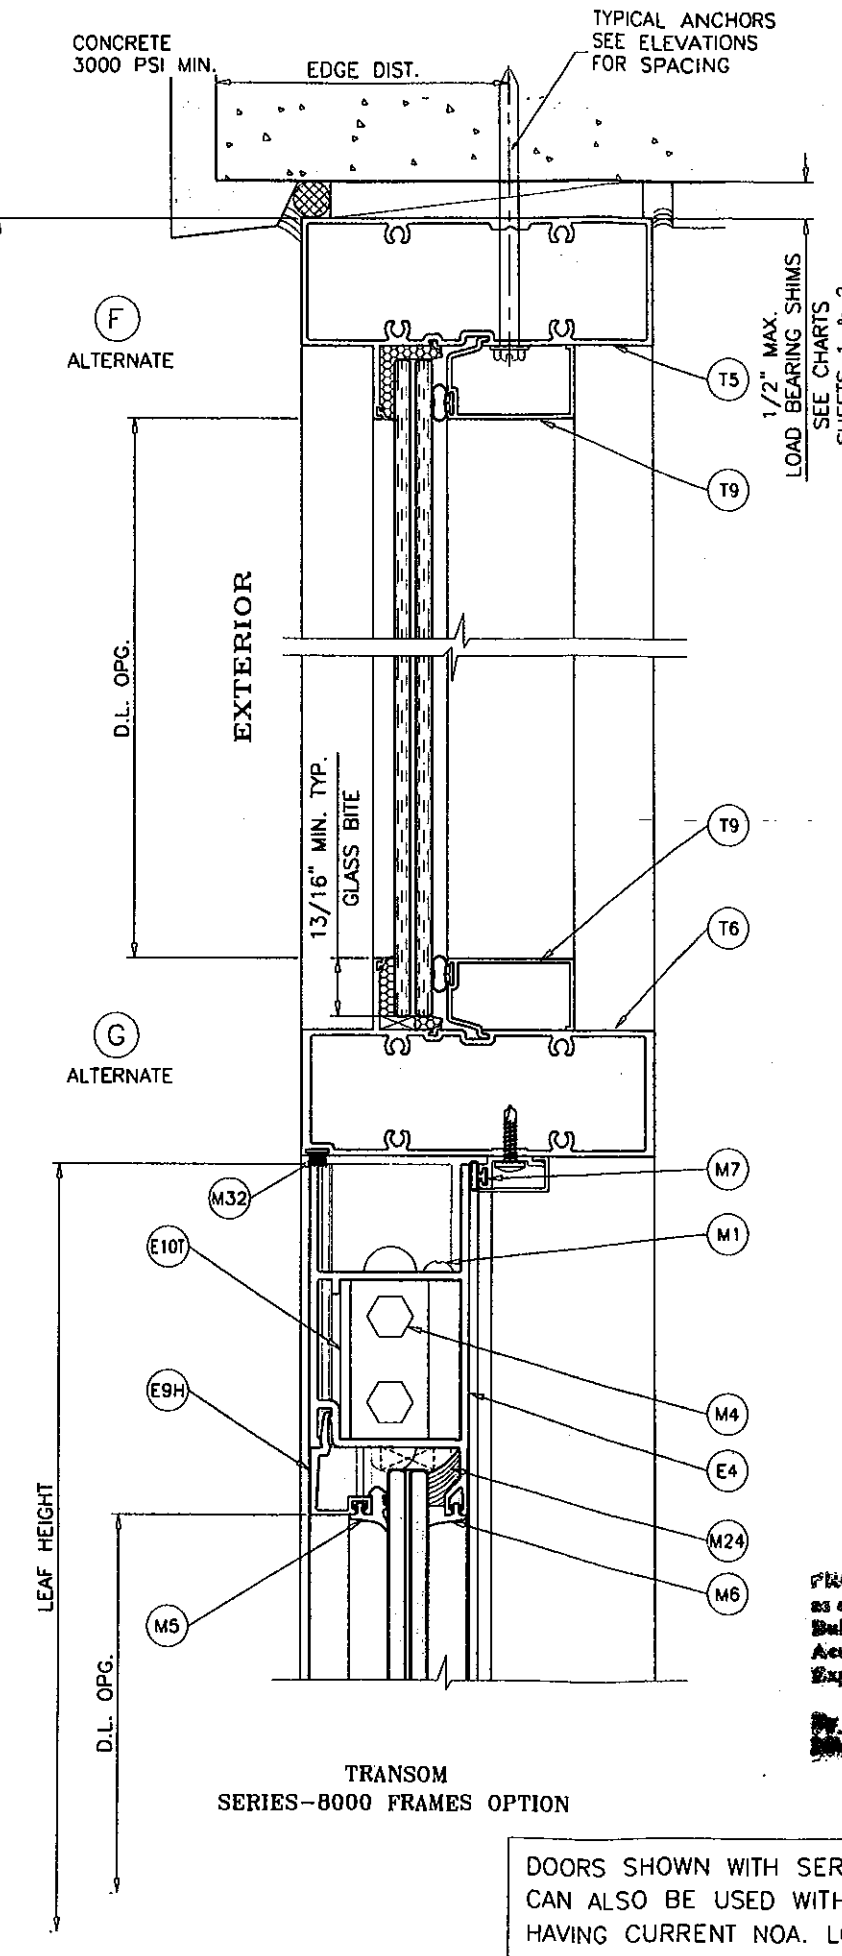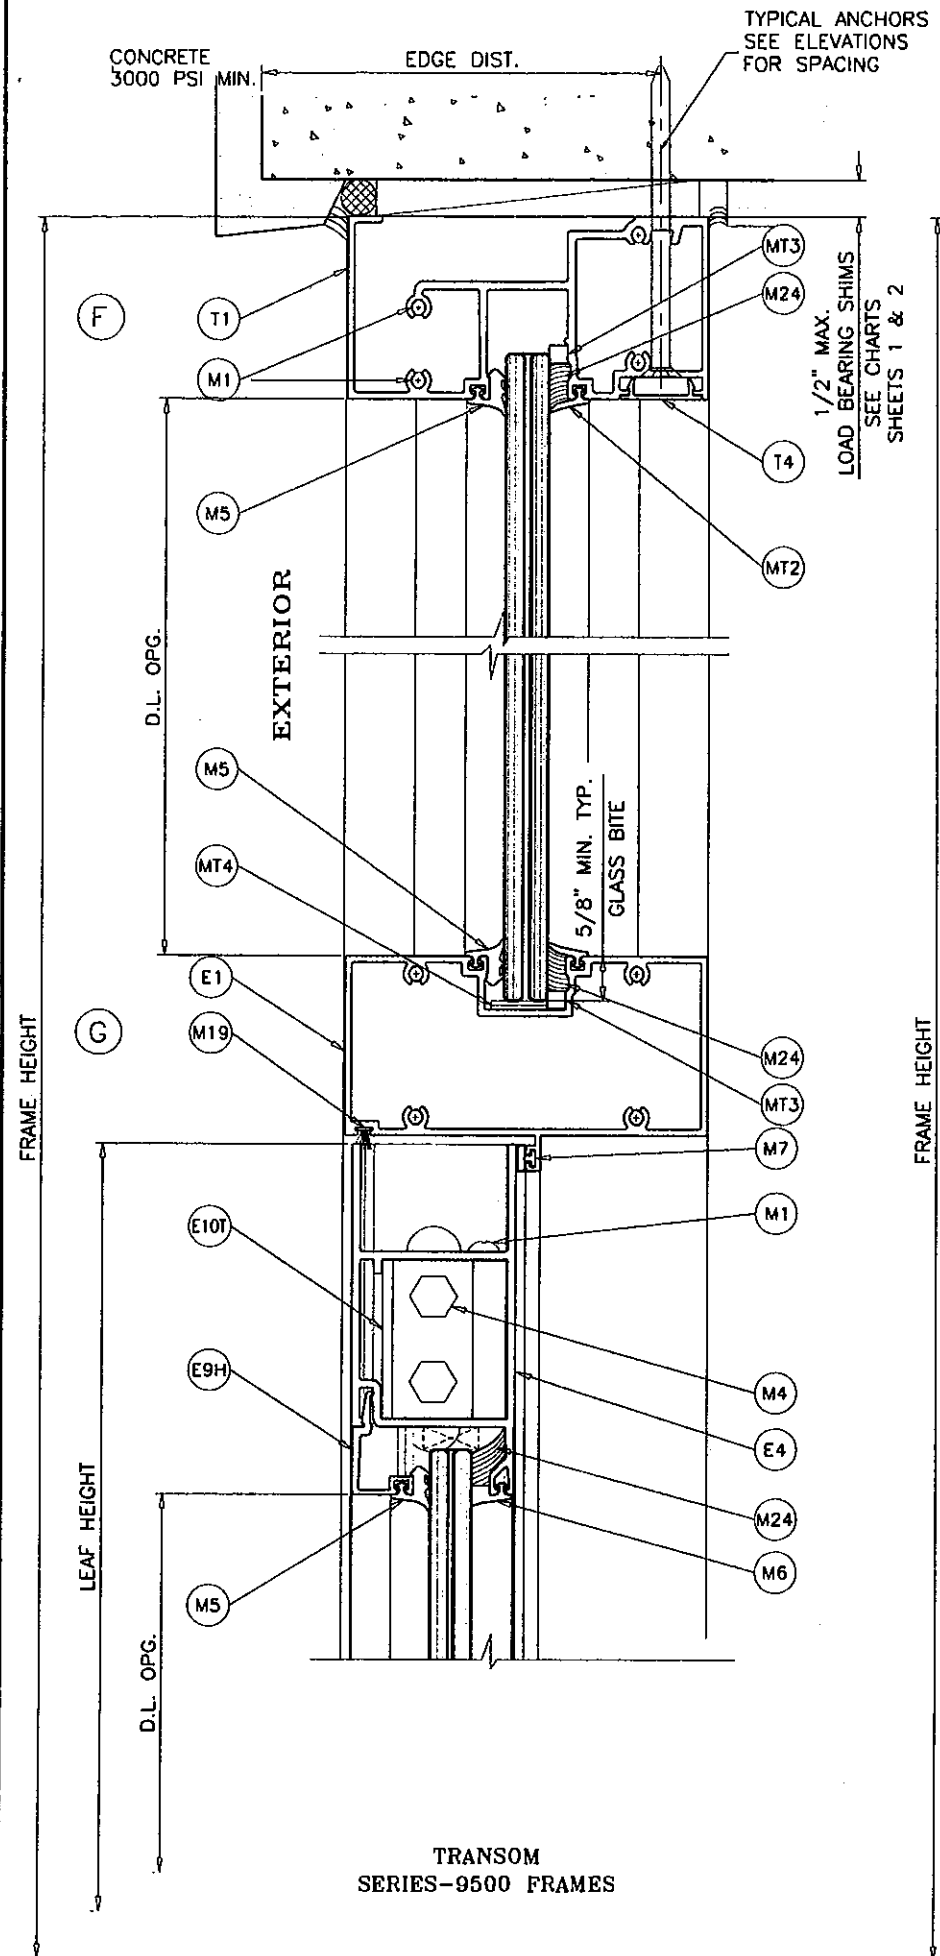

DOORS SHOWN WITH SERIES-9500 FRAMES
CAN ALSO BE USED WITH SERIES-8000 FRAMES,
HAVING CURRENT NOA. LOWER DESIGN PRESSURE
WILL CONTROL.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
MAR 03 2011


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W08-66ESW

E.S. WINDOWS LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 249-0840 FAX. (305) 249-0842

revisions:	
no	description
B	12.15.09 NO CHANGE THIS SHEET
C	06.08.10 REV. PER BCCO COMMENTS
D	10.28.10 NO CHANGE THIS SHEET
E	12.15.10 NO CHANGE THIS SHEET
F	01.04.11 REV. PER BCCO COMMENTS

date: 07-14-08
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-66
sheet 6 of 10.1

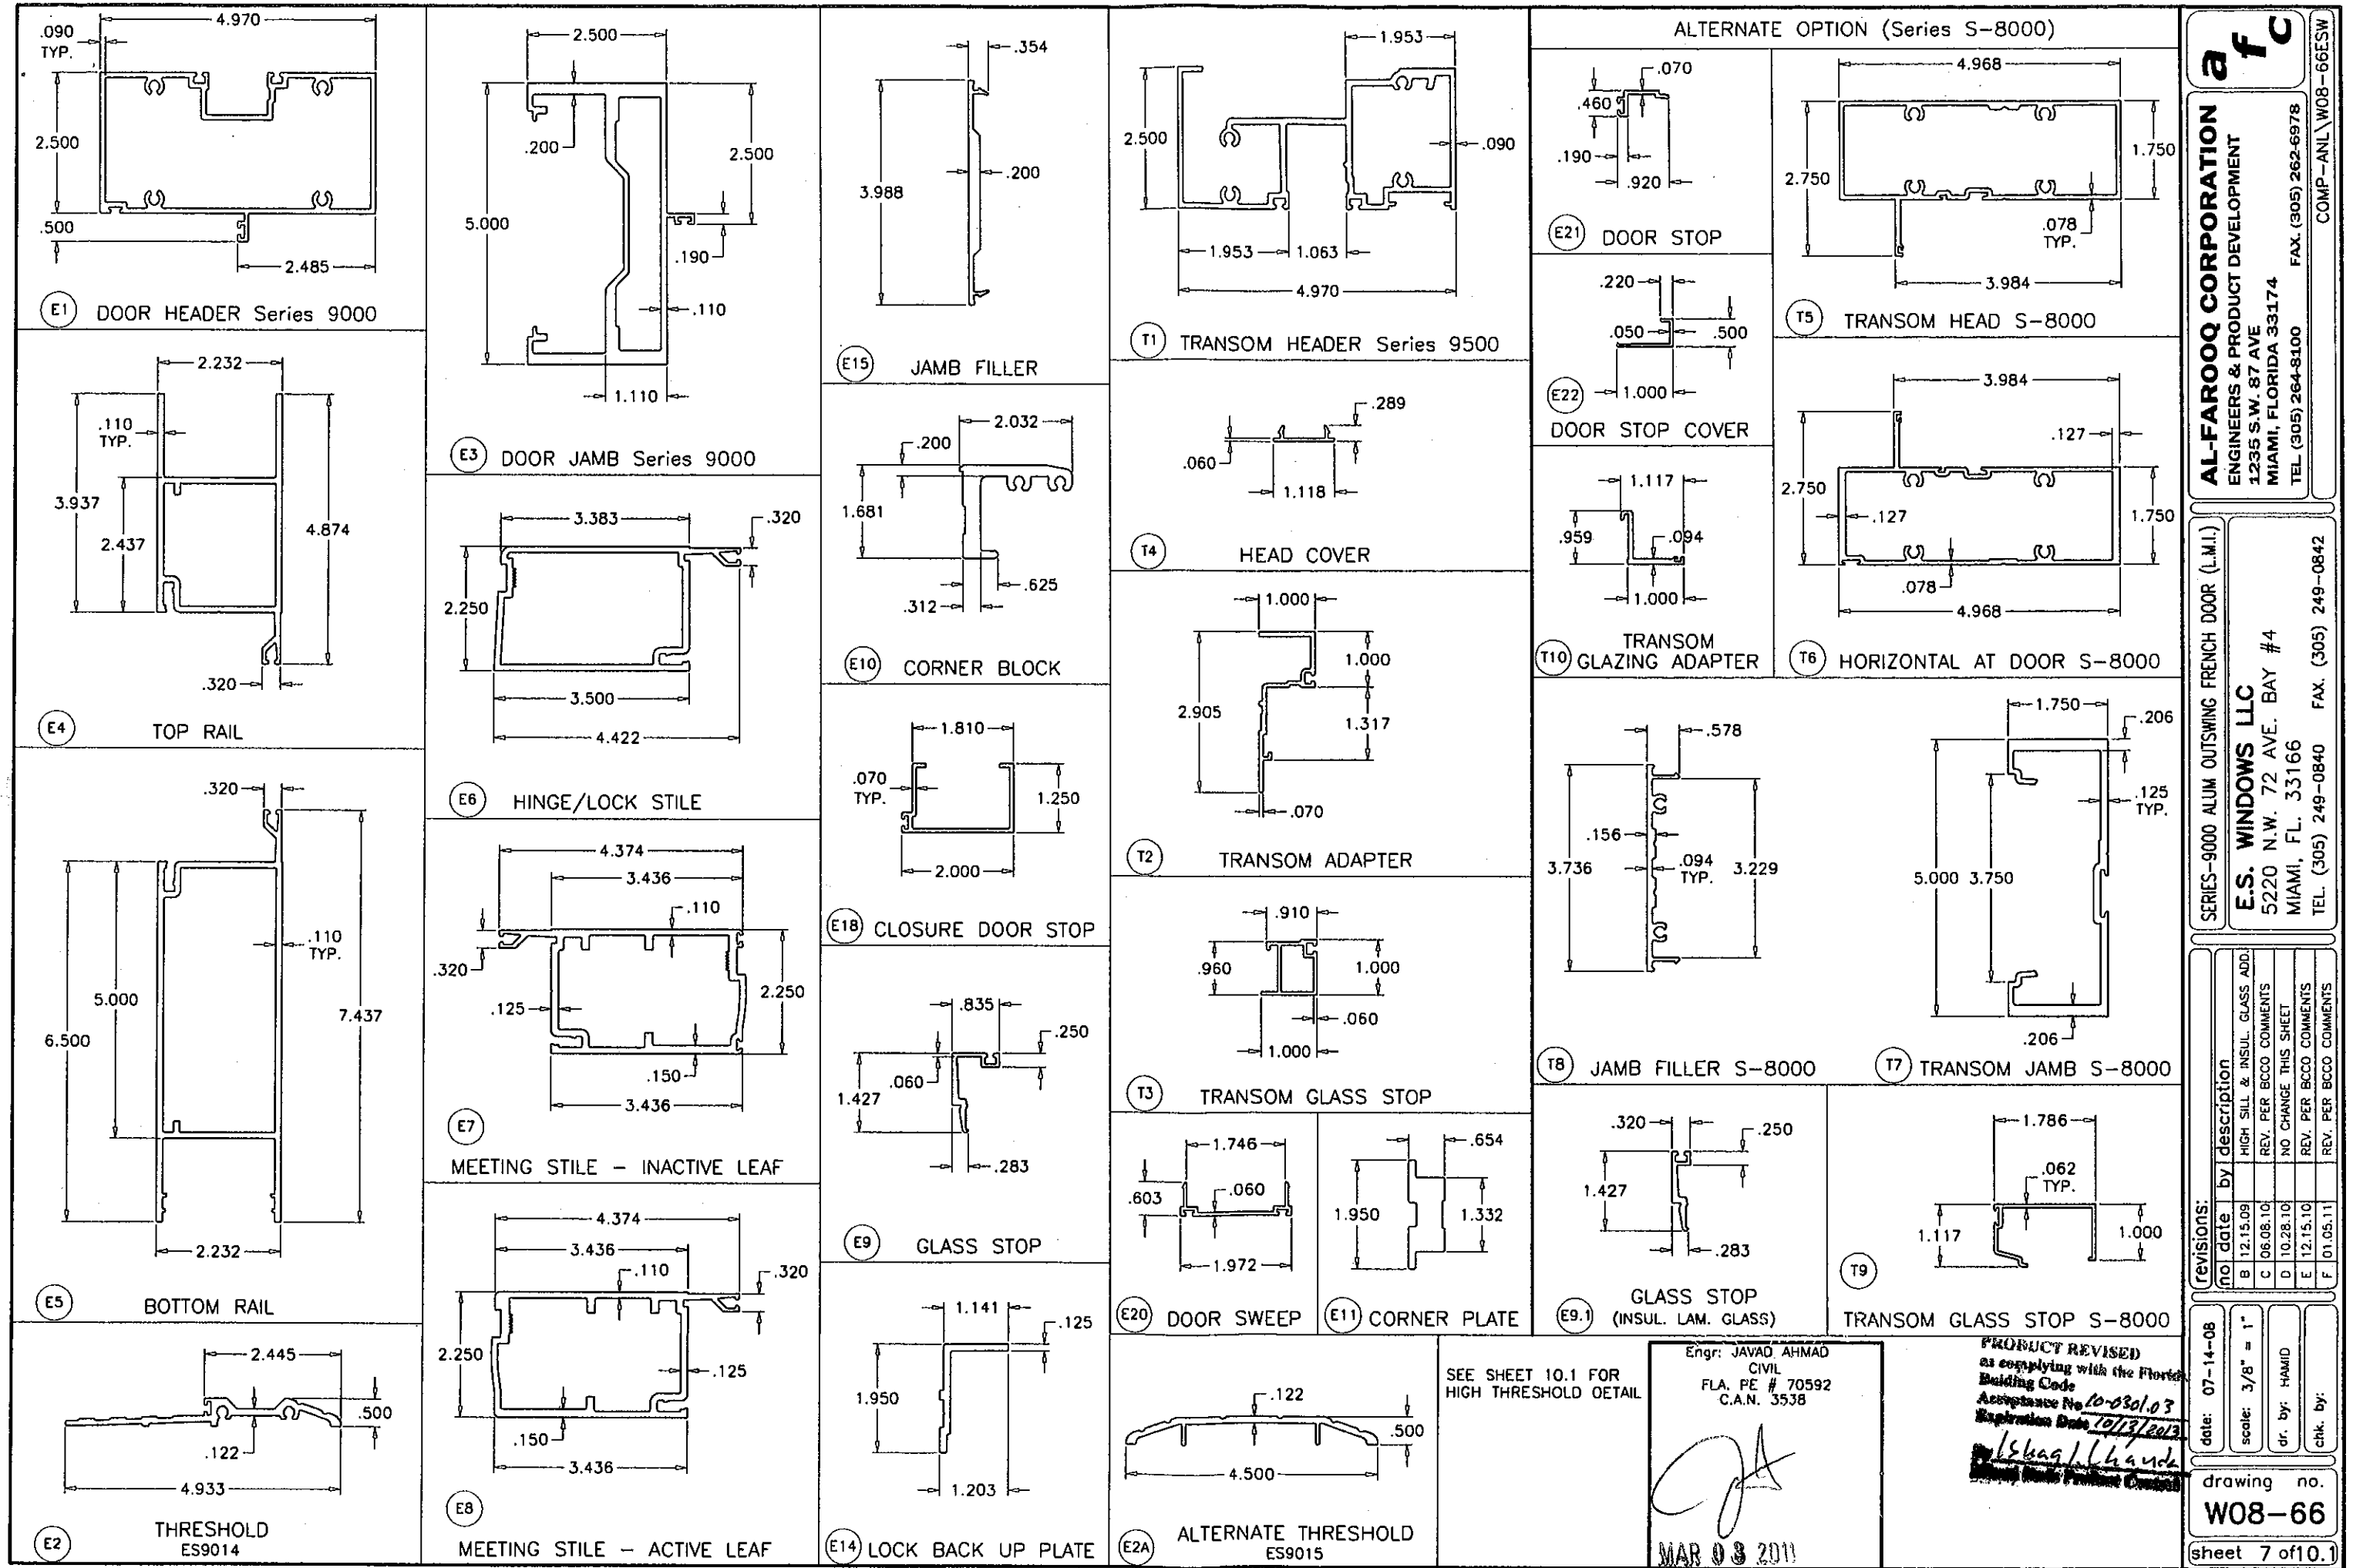

afC

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP - ANL\W08-66ESW

SERIES-9000 ALUM OUTSWING FRENCH DOOR (L.M.I.)
E.S. WINDOWS LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 249-0840 FAX. (305) 249-0842

no	date	by	description
A	12.15.09	B	HIGH SILL & INSUL. GLASS ADD.
B	06.08.10	C	REV. PER BCCO COMMENTS
C	10.28.10	D	NO CHANGE THIS SHEET
D	12.15.10	E	REV. PER BCCO COMMENTS
E	01.05.11	F	REV. PER BCCO COMMENTS

revisions:
date: 07-14-08
scale: 3/8" = 1"
dr. by: HAMID
chk. by:
drawing no.
W08-66
sheet 7 of 10.1

SEE SHEET 10.1 FOR
HIGH THRESHOLD DETAIL

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538




[Signature]

MAR 03 2011

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-0301.03
Expiration Date 10/13/2013
[Signature]
Product Review Complete

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
E1	ES9012	1	DOOR HEADER	6063-T6	-
E2	ES9014	1	STANDARD THRESHOLD	6063-T6	-
E2A	ES9015	1	SADDLE THRESHOLD	6063-T6	-
E2B	ES-9026	1	HIGH THRESHOLD	6063-T6	-
E2C	ES-9027	1	THRESHOLD COVER	6063-T5	-
E3H	ES9013	2	DOOR JAMB - HINGE	6063-T6	-
E4	ES9001	2	TOP RAIL	6063-T5	-
E5	ES9002	2	BOTTOM RAIL	6063-T6	-
E6H	ES9003	2	HINGE/LOCK STILE	6063-T5	-
E7	ES9006	1	MEETING STILE - INACTIVE LEAF	6063-T5	-
E8	ES9007	1	MEETING STILE - ACTIVE LEAF	6063-T5	-
E9H	ES9004	4	HORIZONTAL GLASS STOP	6063-T5	-
E9V	ES9004	4	VERTICAL GLASS STOP	6063-T5	-
E9.1	ES-9029	4	GLASS STOP (INSUL. LAM. GLASS)	6063-T5	-
E10T	ES9008	4	CORNER BLOCK -TOP	6063-T5	-
E10B	ES9008	4	CORNER BLOCK - BOTTOM	6063-T5	-
E11T	ES9009	4	CORNER PLATE - TOP	6063-T5	-
E11B	ES9009	4	CORNER PLATE - BOTTOM	6063-T5	-
E12	ES9010	4	SUPPORT ANGLE	6063-T5	3/4" X 1" X 1/8" X 9" LONG
E13	ES9011	AS ROD.	HINGE BACKUP PLATE REINFORCEMENT	6063-T5	-
E14	ES9020	1	LOCK BACKUP PLATE REINFORCEMENT	6063-T5	-
E15	ES9016	AS RQD.	JAMB FILLER	6063-T6	-
E16	ES9017	AS RQD.	REINFORCEMENT	6063-T6	-
E17	ES9021	1/ CLOSER	CLOSER SUPPORT CLIPS (PAIR)	6063-T5	-
E18	ES9022	1	CLOSER DOOR STOP	6063-T5	-
E19	ES9023	1/ CLOSER	CLOSER COVER PLATE	6063-T5	-
E20	ES9005		DOOR SWEEP	-	-
E21	ES9051		DOOR STOP	-	-
E22	ES9052		DOOR STOP COVER	-	-
M1		28	#12 x 1" P.H. ST/ST SMS	-	-
M2		AS ROD.	#12 - 24 x 1/2" F.H. ST/ST MS	-	-
M3		18	#8 - 32 x 1/2" P.H. ST/ST MS	-	-
M4		16	3/8" - 16 x 1" HEX. BOLT	-	-
M5	ES9000-G01	AS RQD.	WEDGE GASKET	EPDM	DUROMETER 70
M6	ES9000-G02	AS ROD.	SPACER GASKET	EPDM	DUROMETER 70
M7	ES9000-G03	AS ROD.	BULB VINYL, BASE-POLYPROPYLENE, BULB-TPE	-	ULTRAFAB, DUROMETER 73
M8	ES9000-B1	8	SETTING BLOCK	EPDM	DUROMETER 80
M9		AS RQD.	HINGE 4 1/2" x 4"	-	-
M9A		AS RQD.	OFFSET PIVOT HINGE	ALUMINUM	-
M12		1	3 POINT LOCK	-	-
M13		1	KEY CYLINDER	-	-
M14		1	THUMBTURN	-	-
M15		1	2 POINT LOCK	-	-
M16		1/ LEAF	DOOR CLOSURE	-	-
M17		2	PUSH - PULL	-	-
M19	W13273NK	AS RQD.	PILE - HEADER	-	-
M20	W23451NK	AS RQD.	PILE - MTG STILES	-	-
M22	-	1/ CLOSER	CHANNEL SPACER 5/8" X 1-3/4"	-	-
M23		2	THRESHOLD CLIP	-	-
M24		AS ROD.	STRUCTURAL SILICONE	-	-
M25		AS RQD.	SILICONE	-	-
M26		2/ CLOSER	1/4 - 20 x 2" HEX. BOLT	-	-
M27		3/ CLOSER	#10 x 1" P.H. ST/ST SMS	-	-
M28		6/ CLOSER	#10 x 3/4" F.H. ST/ST SMS	-	-
M29		3/ CLOSER	#10 x 1" F.H. ST/ST SMS	-	-
M30		AS RQD.	#8 x 1 1/2" F.H. ST/ST SMS	-	-
M31	W13351NK	AS RQD.	PILE - DOOR SWEEP	-	-
M32	W13275NK	AS RQD.	PILE - HEADER	-	-

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
T1	ES9506		TRANSOM HEADER Series 9500	6063-T6	-
T2	ES9019		TRANSOM ADAPTER	6063-T5	-
T3	ES9018		TRANSOM GLASS STOP	6063-T5	-
T4	ES9502		HEAD COVER	6063-T5	-
MT1			#10 x 1/2" F.H. ST/ST SMS	-	-
MT2			TRIM GASKET	SILICONE	-
MT3			INTERIOR SPACER 1/4" x 1/4"	FOAM	-
MT4			SETTING BLOCKS 1/16" x 3/4"	EPDM	DUROMETER 65
T5	ES8005	AS REQD.	TRANSOM HEAD S-8000	6005-T6	-
T6	ES8013	AS REQD.	HORIZONTAL AT DOOR S-8000	6005-T6	-
T7	ES8012	AS REQD.	TRANSOM JAMB S-8000	6005-T6	-
T8	ES8003	AS REQD.	JAMB FILLER S-8000	6005-T5	-
T9	ES8006	AS REQD.	TRANSOM GLASS STOP S-8000	6063-T5	-
T10	ES8014	AS REQD.	TRANSOM GLAZING ADAPTER	6063-T6	-

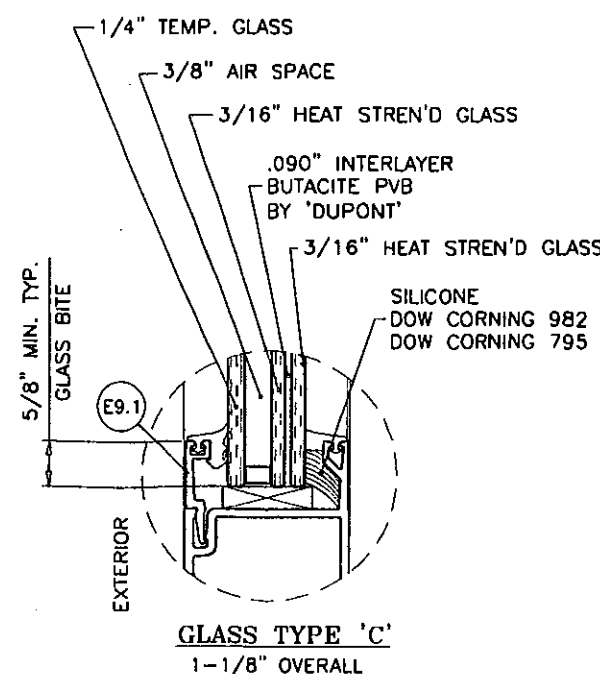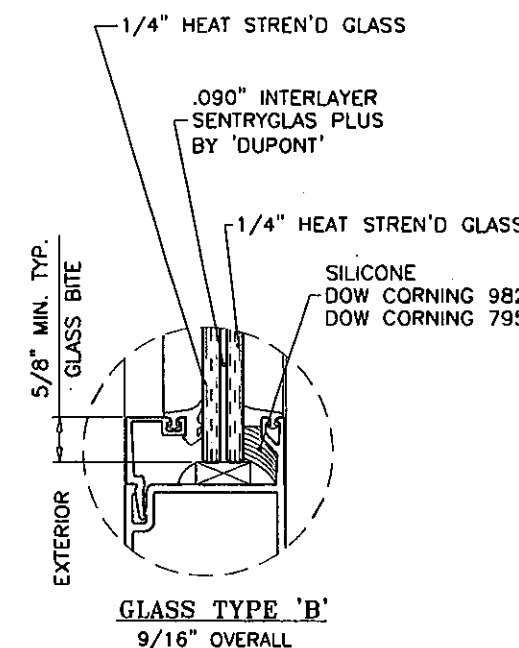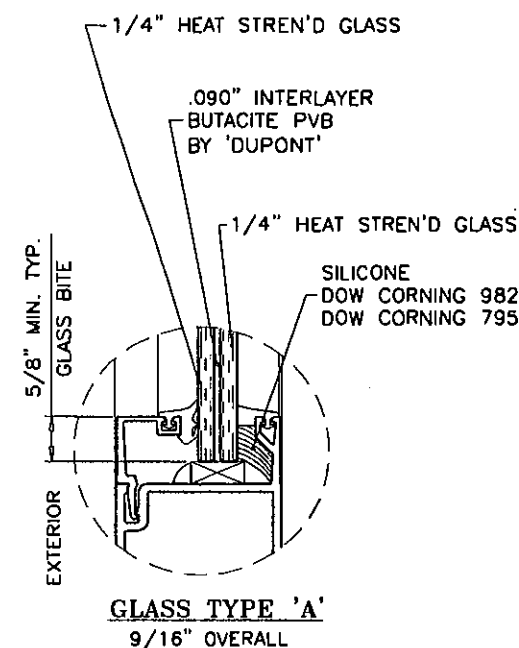

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 10-0301.03
Expiration Date 10/12/2013
10/12/2013
Javad Ahmad

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
[Signature]
MAR 03 2011

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL W08-66ESW

SERIES-9000 ALUM OUTSWING FRENCH DOOR (L.M.I.)
E.S. WINDOWS LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 249-0840 FAX. (305) 249-0842

revisions:	no	date	description
	B	12.15.09	HIGH SILL & INSUL. GLASS ADD
	C	06.08.10	REV. PER BCCO COMMENTS
	D	10.28.10	NO CHANGE THIS SHEET
	E	12.15.10	REV. PER BCCO COMMENTS
	F	01.05.11	REV. PER BCCO COMMENTS

date: 07-14-08
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-66
sheet 8 of 10.1

GLAZING OPTIONS

LOCKS: (See Table #1 or #3 for Load Capacities)


OPTION #1:

CONCEALED VERTICAL ROD PANIC EXIT DEVICE BY 'JACKSON PANIC SYSTEM' #1285 LOCATED AT 41" FROM SILL AT EACH LEAF.
FASTENED WITH

- (1) #14 X 1" HH SELF DRILLING SCREW AT ONE END AND
- (2) #12-24 X 1/2" OH MACHINE SCREWS AT OTHER END

OR
CONCEALED VERTICAL ROD PANIC EXIT DEVICE BY 'ADAMS RITE' LOCATED AT 40" FROM SILL AT EACH LEAF.
FASTENED WITH

- (2) #10-32 X 3/4" FH MACHINE SCREWS AT ONE END AND
- (2) #10-24 X 1/2" FH MACHINE SCREWS AT OTHER END

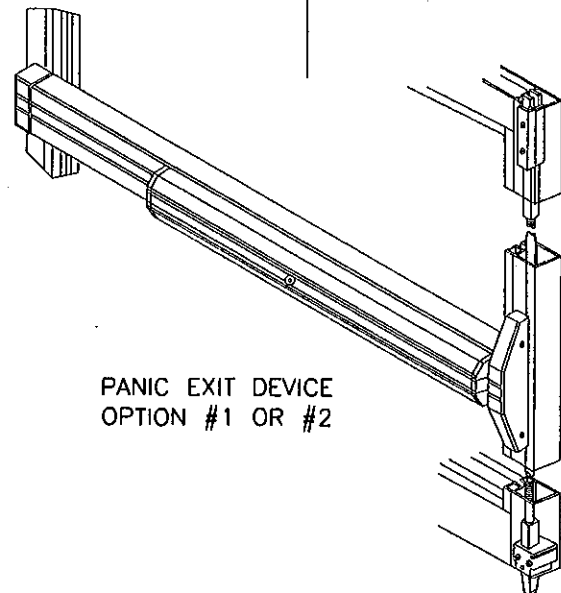

PANIC EXIT DEVICE
OPTION #1 OR #2

OPTION #2:

CONCEALED VERTICAL ROD PANIC EXIT DEVICE BY 'JACKSON PANIC SYSTEM' #2086 LOCATED AT 41" FROM SILL AT EACH LEAF.
FASTENED WITH

- (1) #14 X 1" HH SELF DRILLING SCREW AT ONE END AND
- (2) #12-24 X 1/2" OH MACHINE SCREWS AT OTHER END

OR
CONCEALED VERTICAL ROD PANIC EXIT DEVICE BY 'DOR-O-MATIC' LOCATED AT 40" FROM SILL AT EACH LEAF.
FASTENED WITH

- (2) #12-24 X 1/2" FH MACHINE SCREWS AT ONE END

OPTION #3:

ACTIVE LEAF:


KEY OPERATED THREE POINT LOCK SYSTEM BY 'ADAMS RITE' WITH CONCEALED FLUSH BOLTS AT TOP & BOTTOM OF LOCK STILE AND A THUMB TURN ON THE INTERIOR, LOCATED AT 40" FROM BOTTOM OF PANEL FASTENED WITH

- (2) #12-24 X 1/2" FH MACHINE SCREWS

INACTIVE LEAF:

MANUALLY OPERATED TWO POINT LOCK SYSTEM BY 'ADAMS RITE' WITH CONCEALED FLUSH BOLTS AT TOP & BOTTOM OF LOCK STILE AND A THUMB TURN ON THE INTERIOR, LOCATED AT 40" FROM BOTTOM OF PANEL FASTENED WITH


- (2) #8-32 X 1/4" PH MACHINE SCREWS

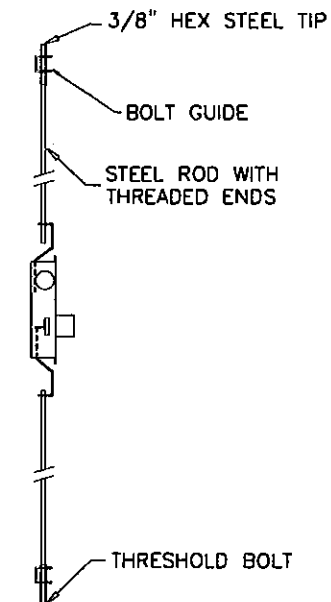

HINGES: (See Table #1 or #3 for Load Capacities)


OPTION #1:

OFFSET PIVOT HINGES
ALUMINUM AT TOP AND BOTTOM
FASTENED TO FRAME AND THRESHOLD WITH
#10-24 X 1/2" FH THREAD CUTTING SCREWS
(2) AT THRESHOLD, (2) AT JAMB BOTTOM
(3) AT FRAME HEAD
HEAVY DUTY BRASS OR BRONZE AT MIDSPAN
FASTENED TO FRAME AND LEAF WITH
(4) 1/4-20 X 5/8" MS

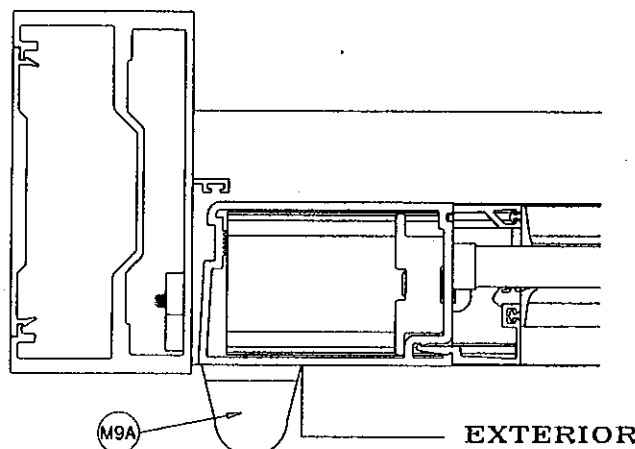

OPTION #2:

4 X 4-1/2" ST. STEEL BALL BEARING BUTT HINGES
LOCATED AT
11" FROM TOP & BOTTOM AND AT MIDSPAN
FASTENED TO DOOR FRAME AND LEAF STILE WITH
(4) #12-24 X 1/2" FH MACHINE SCREWS PER HASP

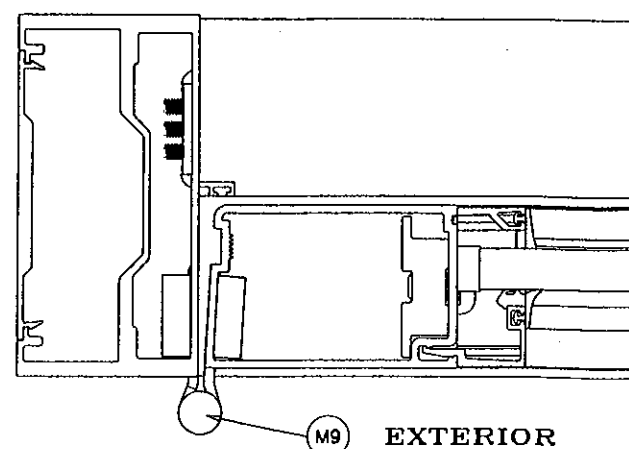

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-0301.03
Expiration Date 10/12/2013
By Ishak L. Chene
Miami Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
MAR 08 2011

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 262-6978
FAX. (305) 262-6978

COMP-ANL\W08-66ESW

SERIES-9000 ALUM OUTSWING FRENCH DOOR (L.M.I.)



E.S. WINDOWS LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 249-0840 FAX. (305) 249-0842

revisions:		no	date	by	description
B	12.15.09				NO CHANGE THIS SHEET
C	06.08.10				REV. PER BCCO COMMENTS
D	10.28.10				NO CHANGE THIS SHEET
E	12.15.10				NO CHANGE THIS SHEET
F	01.05.11				REV. PER BCCO COMMENTS


date: 07-14-08	scale: 3/8" = 1"	dr. by: HAMID	chk. by:
----------------	------------------	---------------	----------

drawing no.
W08-66



sheet 9 of 10.1

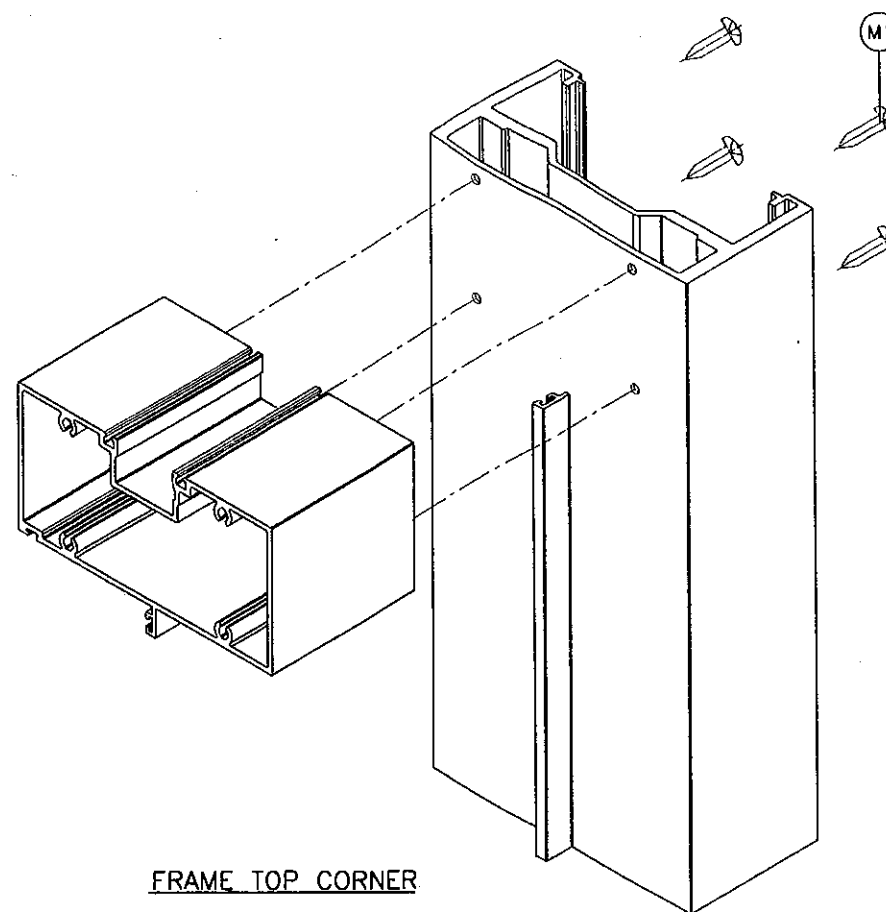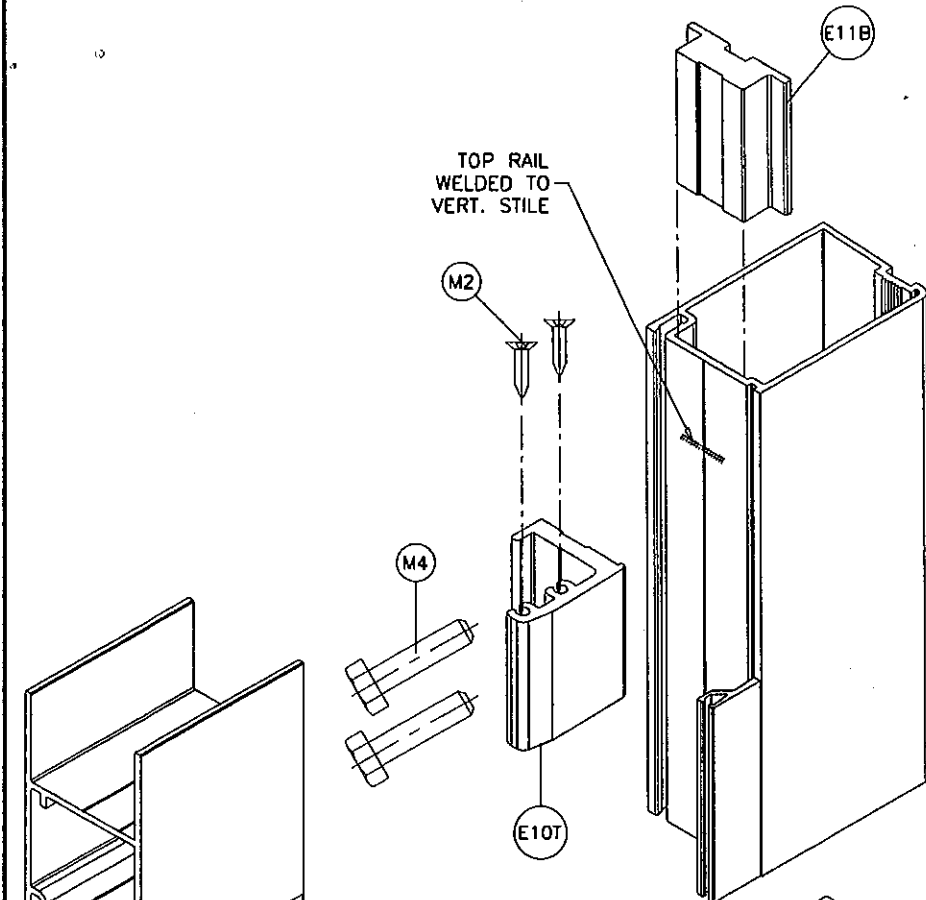

FRAME TOP CORNER

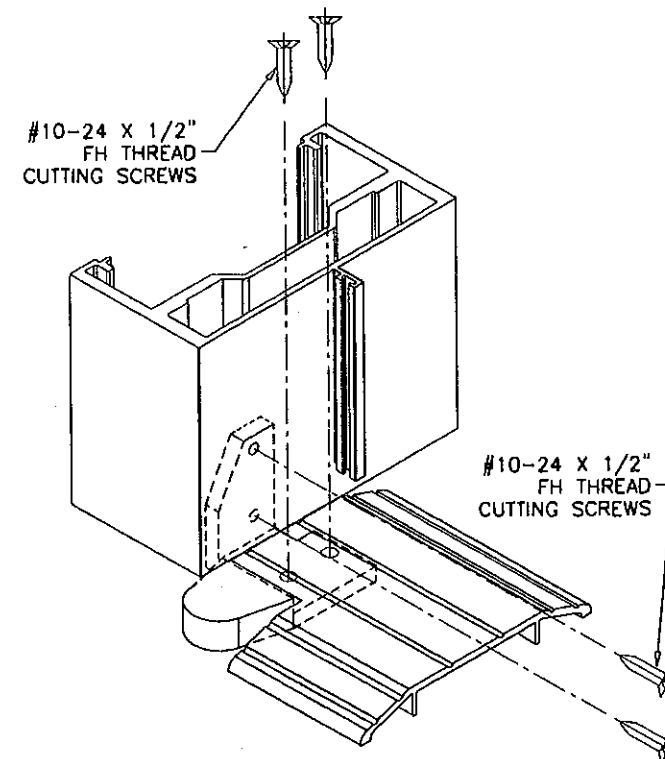

PIVOT THRESHOLD CORNER

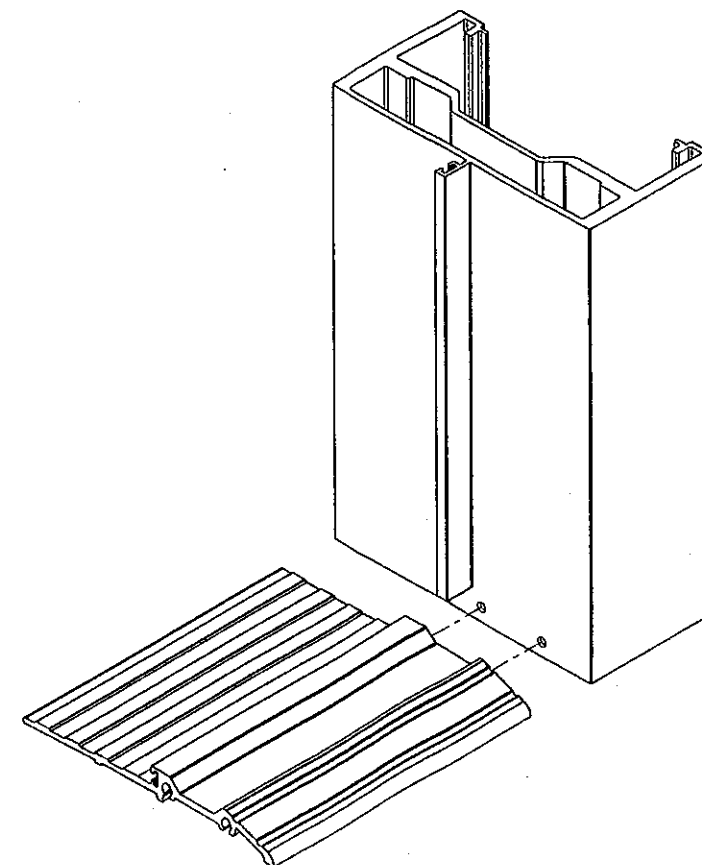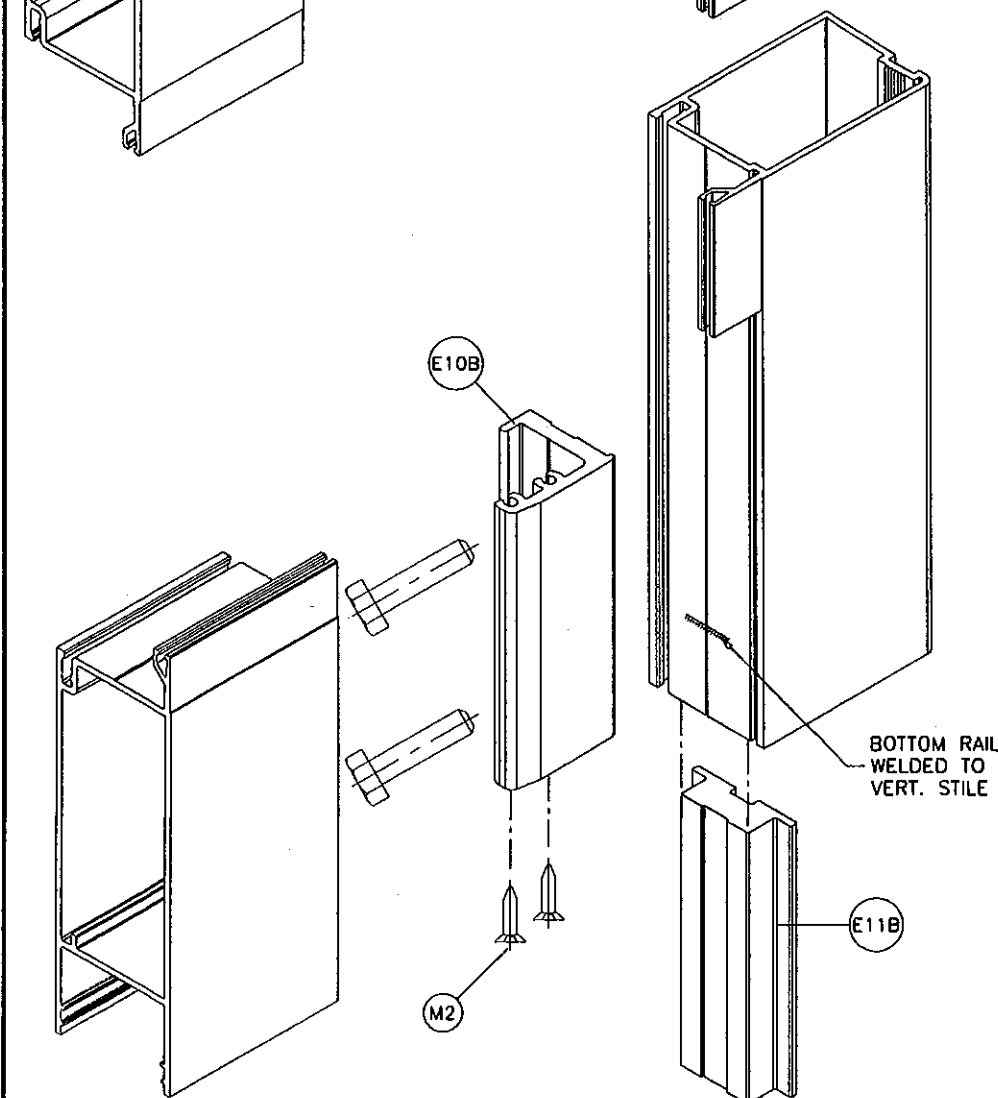

THRESHOLD CORNER

PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No. 10-0301.03
Expiration Date 10/13/2013
By: J. L. L. L. L. L.
Manual Date Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

[Signature]

MAR 08 2011

afc


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP - ANL W08-66ESW

SERIES-9000 ALUM OUTSWING FRENCH DOOR (L.M.I.)
E.S. WINDOWS LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL (305) 249-0840 FAX (305) 249-0842

revisions:	no	date	by	description
	B	12.15.09		NO CHANGE THIS SHEET
	C	06.08.10		NO CHANGE THIS SHEET
	D	10.28.10		NO CHANGE THIS SHEET
	E	12.15.10		NO CHANGE THIS SHEET
	F	01.05.11		REV. PER BCCO COMMENTS


date: 07-14-08
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-66
sheet 10 of 10.1

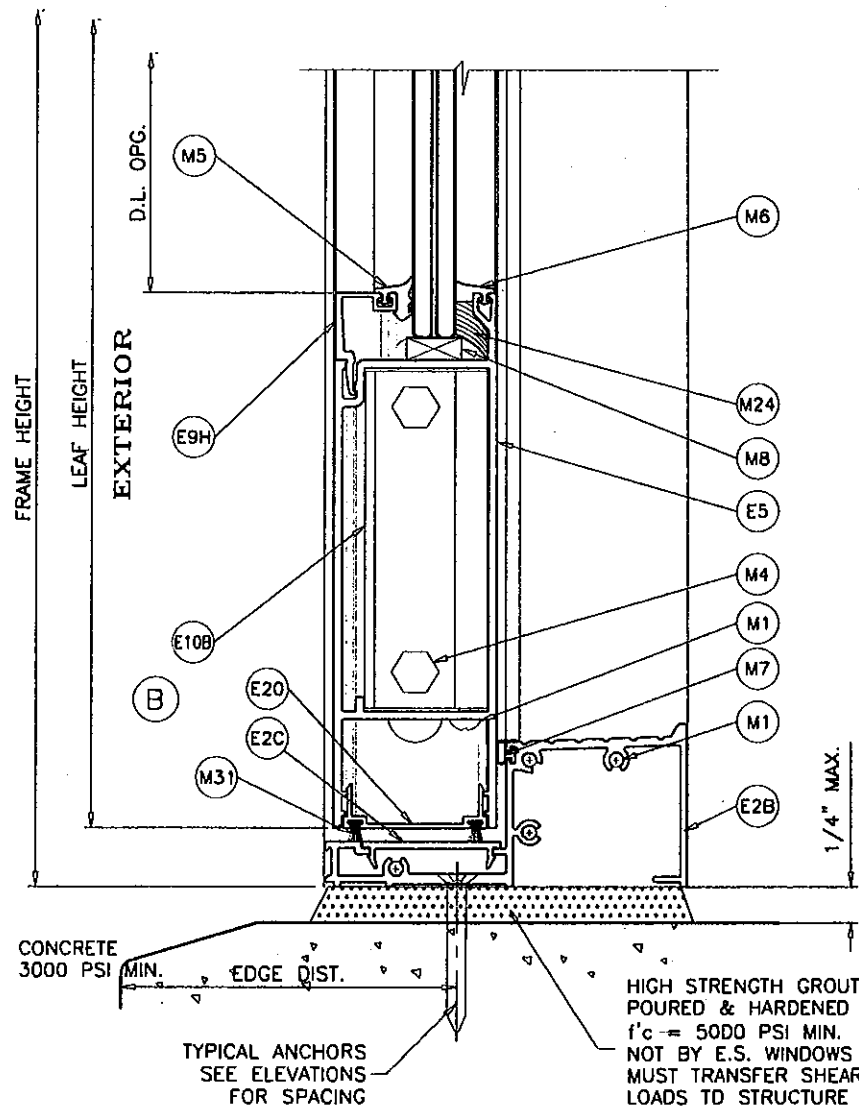


HIGH THRESHOLD OPTION

APPROVED FOR WATER RESISTANCE WHEN USED WITH SINGLE DOORS
NOT APPROVED FOR WATER RESISTANCE WHEN USED WITH DOUBLE DOORS




(E2C) THRESHOLD COVER
ES9027

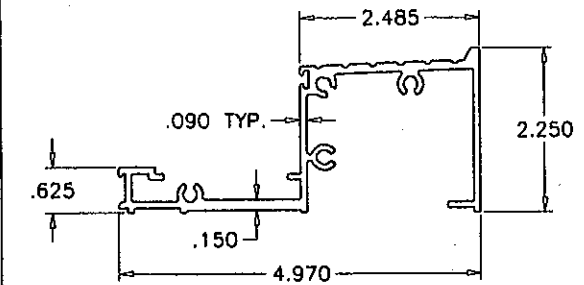

(E2B) HIGH THRESHOLD
ES9026

PRODUCT REVISED
to comply with the Florida
Building Code
Assessment No. 10-030103
Expiration Date 10/13/2013
J. Ghassemi, L.L. Ghassemi
Principal, Project Engineer

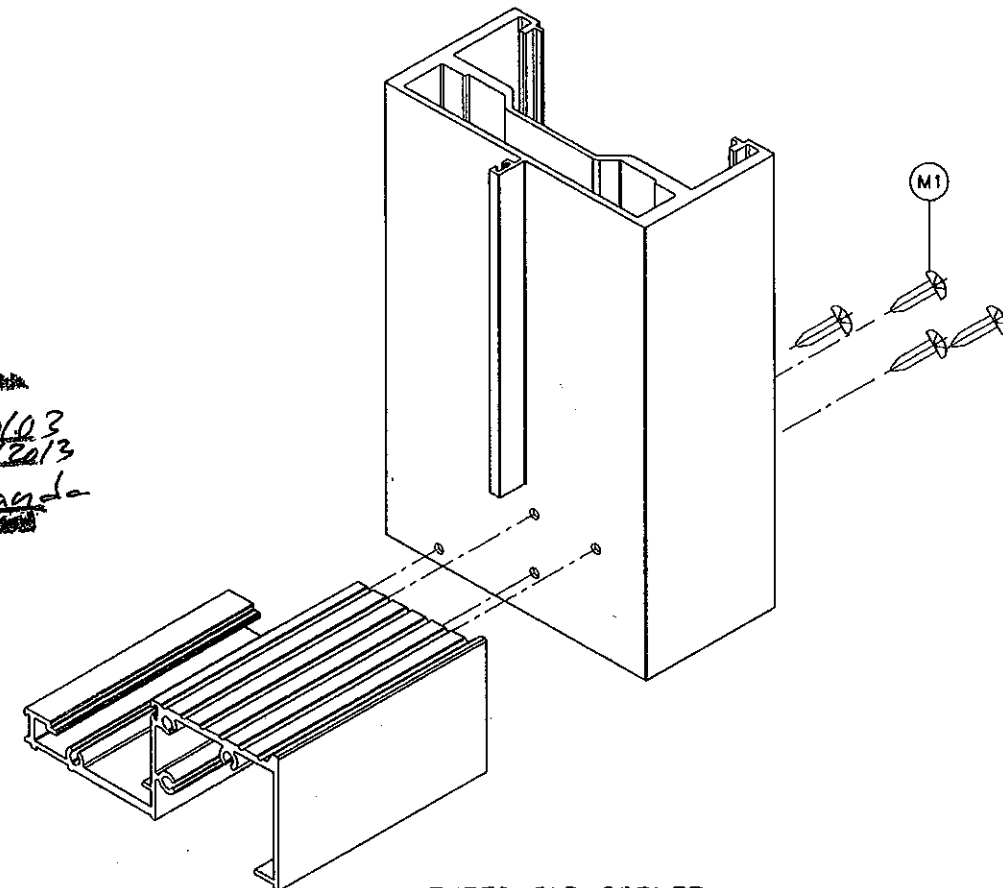

HI-THRESHOLD CORNER

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

[Signature]

MAR 08 2011

af

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W08-66ESW

SERIES-9000 ALUM OUTSWING FRENCH DOOR (L.M.I.)

E.S. WINDOWS LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 249-0840 FAX. (305) 249-0842

revisions:	no	date	by	description
	B	12.15.09		HIGH SILL & INSUL. GLASS ADD.
	C	06.08.10		REV. PER BCCO COMMENTS
	D	10.28.10		NO CHANGE THIS SHEET
	E	12.15.10		REV. PER BCCO COMMENTS
	F	01.05.11		REV. PER BCCO COMMENTS

date: 07-14-08	scale: 3/8" = 1"	dr. by: HAMID	chk. by:
----------------	------------------	---------------	----------

drawing no.
W08-66

sheet 10.1 of 10.1