

**MIAMI-DADE COUNTY**  
 BUILDING CODE COMPLIANCE OFFICE (BCCO)  
 PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
 METRO-DADE FLAGLER BUILDING  
 140 WEST FLAGLER STREET, SUITE 1603  
 MIAMI, FLORIDA 33130-1563  
 (305) 375-2901 FAX (305) 375-2908

[www.miamidade.gov/buildingcode](http://www.miamidade.gov/buildingcode)

**NOTICE OF ACCEPTANCE (NOA)**

**JELD-WEN Inc.**  
**3737 Lakeport Blvd.**  
**Klamath Falls, OR 97601**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Series "Premium" Vinyl (PVC) Sliding Glass Door W/ Reinforcements-L. M. Impact**

**APPROVAL DOCUMENT:** Drawing No. **09-JWN-0004**, titled "premium Atlantic Vinyl (3800)" Sliding Glass Door, sheets 1 through 15 of 15, prepared by Engineering express, dated 06/07/10, signed and sealed by Frank L. Bennardo, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**Limitation:**

1. See applicable limitation of use per Design Pressure tables.
2. Pocket wall is not part of this approval and to be reviewed by AHJ

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



**NOA No 10-0308.04**  
**Expiration Date: August 04, 2015**  
**Approval Date: August 04, 2010**

7/14/10

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections
2. Drawing No. **09-JWN-0004**, titled "premium Atlantic Vinyl (3800)" Sliding Glass Door, sheets 1 through 15 of 15, prepared by Engineering express, dated 06/07/10, signed and sealed by Frank L. Bennardo, P.E.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Forced Entry Test per FBC, TAS 202-94  
5) Large Missile Impact Test per FBC, TAS 201-94,  
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of PVC sliding glass door, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-3576-1** and **NCTL-210-3576-2**, both dated 01/16/08, signed and sealed by Gerard J. Ferrara, P.E.

**C. CALCULATIONS**

1. Anchor verification calculations dated 03/02/10, prepared by Engineering express, dated 06/07/10, signed and sealed by Frank L. Bennardo, P.E.
2. Complies with ASTM-E1300-02 &-04

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**


1. Notice of Acceptance No. **07-1116.04** issued to E.I. DuPont De Nemours & CO., Inc. for "DuPont SentryGlas® Plus", expiring on 01/14/2012.
2. Notice of Acceptance No. **09-0312.02** issued to E.I. DuPont De Nemours & CO., Inc. for "DuPont Butacite", expiring on 12/11/2010.

**F. STATEMENTS**

1. Statement letters of Compliance and "no financial interest", both dated 03/02/10, signed and sealed by Frank L. Bennardo, P.E.
2. Statement letter of lab compliance, part of the above referenced test reports.

**G. OTHER**

1. Notice of Acceptance No. **06-1220.01** issued to Spectus System-A Mikron Company for "White rigid PVC", expiring on 12/26/2011.

  
\_\_\_\_\_  
Ishaq I. Chanda, P.E.  
Product Control Examiner  
NOA No 10-0803.04  
Expiration Date: August 04, 2015  
Approval Date: August 04, 2010

# PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR

## REINFORCED, LARGE MISSILE IMPACT RESISTANT


FRANK L. BENNARDO, P.E.  
#P60046549

06/07/2010

**ENGINEERING EXPRESS**

160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
Ph: (954) 354-0660 Fax: (954) 354-0443  
WWW.ENGP.COM


CERT OF AUTH #9885  
A FRANK L. BENNARDO, P.E., INC. INNOVATION

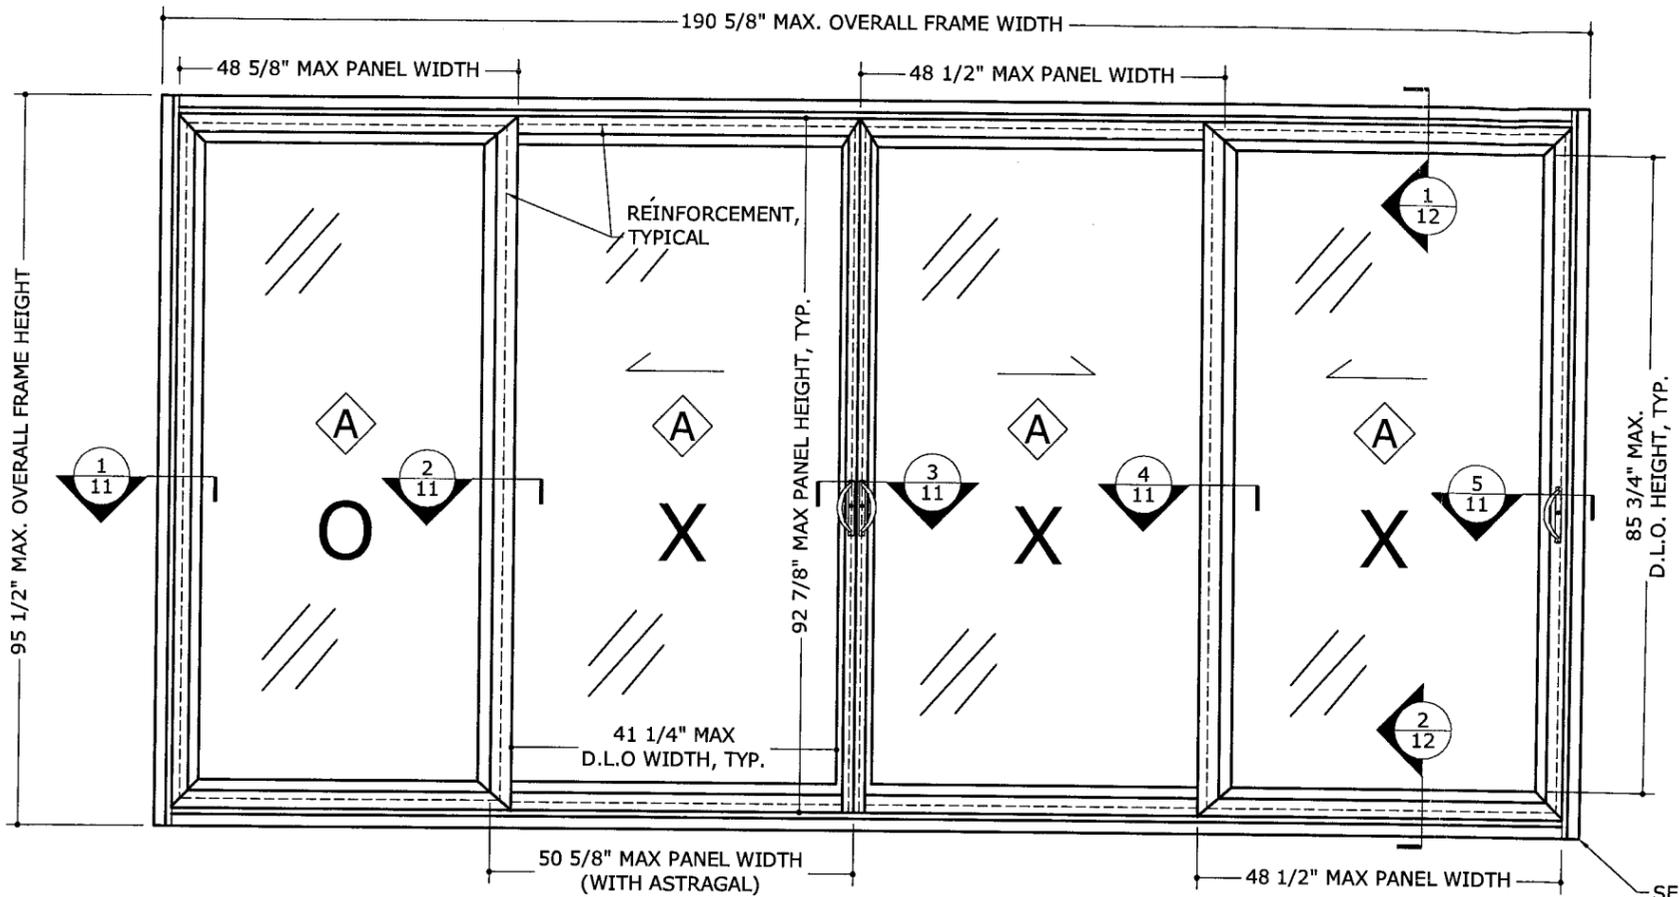

**ALLOWABLE DESIGN PRESSURES**  
WITH GLAZING TYPE 'A'  
**+50 PSF**  
**-50 PSF**

**GLAZING TYPE A**  
1" INSULATED LAMINATED

Approved as complying with the Florida Building Code  
Date **AUGUST 4, 2010**  
NO. **10-0308.04**  
Miami-Dade Product Control Division  
*Shag L. Hunt*

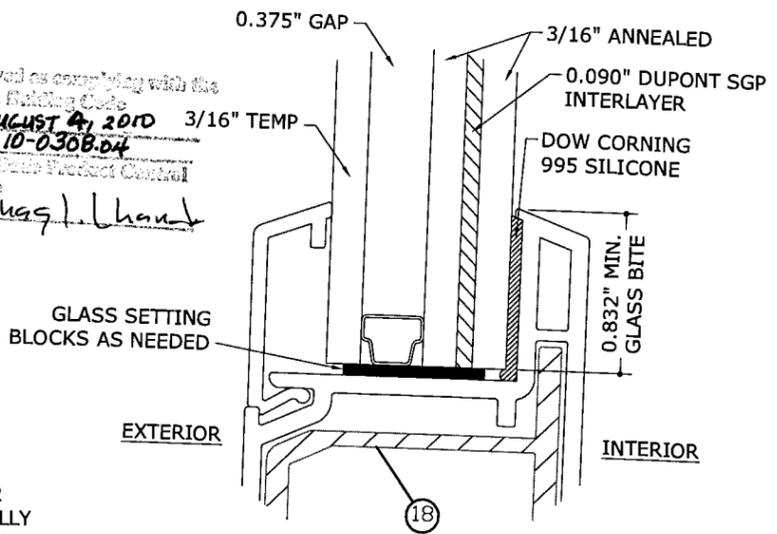


SEE DETAIL 6/12 FOR MECHANICALLY FASTENED FRAME CORNER ASSEMBLY

**1**  
**4-PANEL (OX-XX) BY-PASS WITH MECHANICALLY FASTENED FRAME AND GLAZING TYPE 'A'**  
1 N.T.S. EXTERIOR ELEV

**2**  
**GLAZING DETAIL**  
1 N.T.S.

### GENERAL NOTES

1. THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE 2007 FLORIDA BUILDING CODE, FOR USE WITHIN AND OUTSIDE THE HIGH VELOCITY HURRICANE ZONE, PER TAS 201 / 202 / 203 & ASTM E1300-04 STANDARDS.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
4. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS AND SUBMIT FOR ONE-TIME NOTICE OF ACCEPTANCE FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
5. PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
6. ALL EXTRUSIONS SHALL BE 6063-T6 ALUMINUM ALLOY, UNLESS NOTED OTHERWISE.
7. THE SYSTEM AS DESCRIBED HEREIN IS LARGE MISSILE IMPACT RESISTANT AND DOES NOT REQUIRE IMPACT RESISTANT SHUTTERS.
8. EXTERIOR SEAM OF FRAME CORNERS SHALL BE SEALED WITH SILICONE.
9. ALL BOLTS & WASHERS SHALL BE ZINC COATED STEEL, GALVANIZED STEEL, OR STAINLESS STEEL WITH A MINIMUM TENSILE YIELD STRENGTH OF 60 KSI.
10. PLASTIC COMPONENTS USED WITHIN THE HVHZ MUST MEET ALL APPLICABLE FIRE/SMOKE/UV PERFORMANCE REQUIREMENTS AS SET FORTH IN THE ABOVE-NOTED BUILDING CODE AND SHALL BE SUBMITTED TO THE AUTHORITY HAVING JURISDICTION FOR REVIEW AS REQUIRED.
11. ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR PLATED AS PRESCRIBED IN THE ABOVE-NOTED BUILDING CODE.

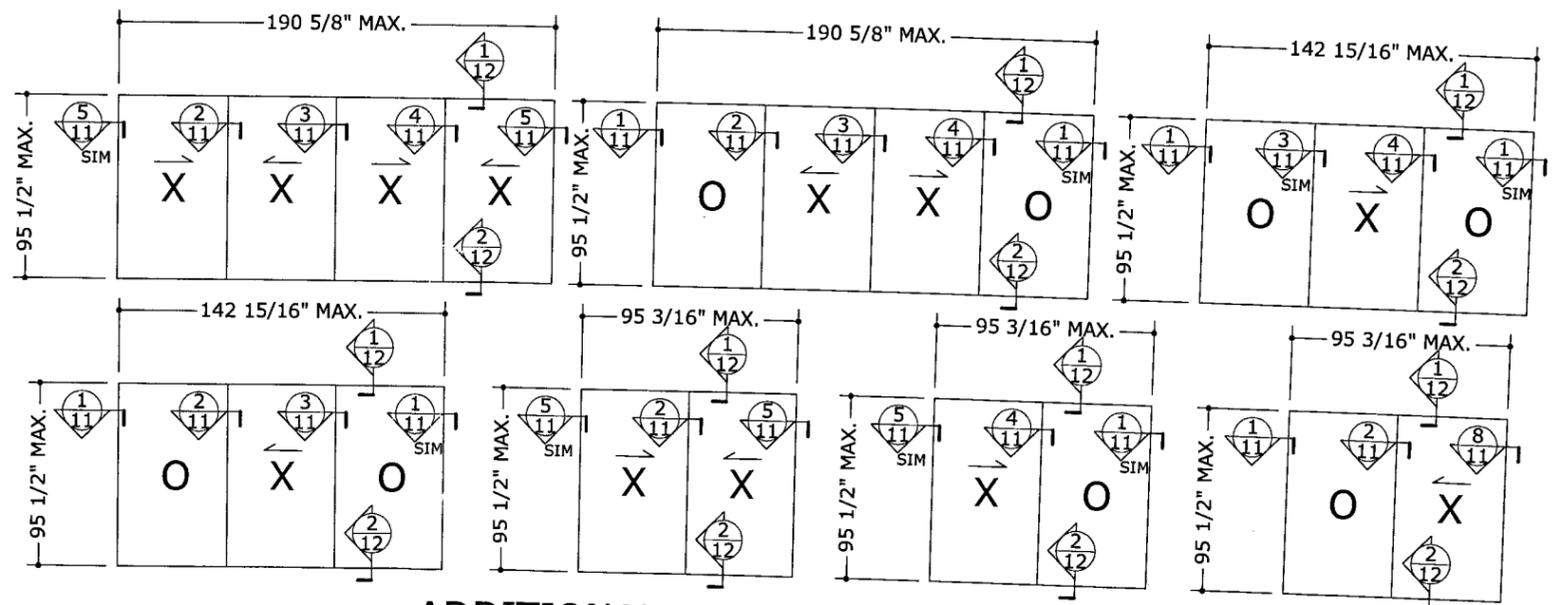

**3**  
**ADDITIONAL ALLOWABLE CONFIGURATIONS (4 PANELS MAX, GLAZING TYPE 'A')**  
1 N.T.S.

**JELDWEN**


355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497-1984  
PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

DRWN/CHKD	DATE
KL/FLB	01/10/10
KL/FLB	06/03/10

09-JWN-0004  
SCALE: 1/8" = 1'-0"  
PAGE DESCRIPTION: 01

1

3/07/2010 - 4:09pm keithl F:\01 Project Files\Jeld-Wen (JWN)\2009\09-JWN-0004 Premium Atlantic Vinyl (3800) SGD LMI (NOA).dwg

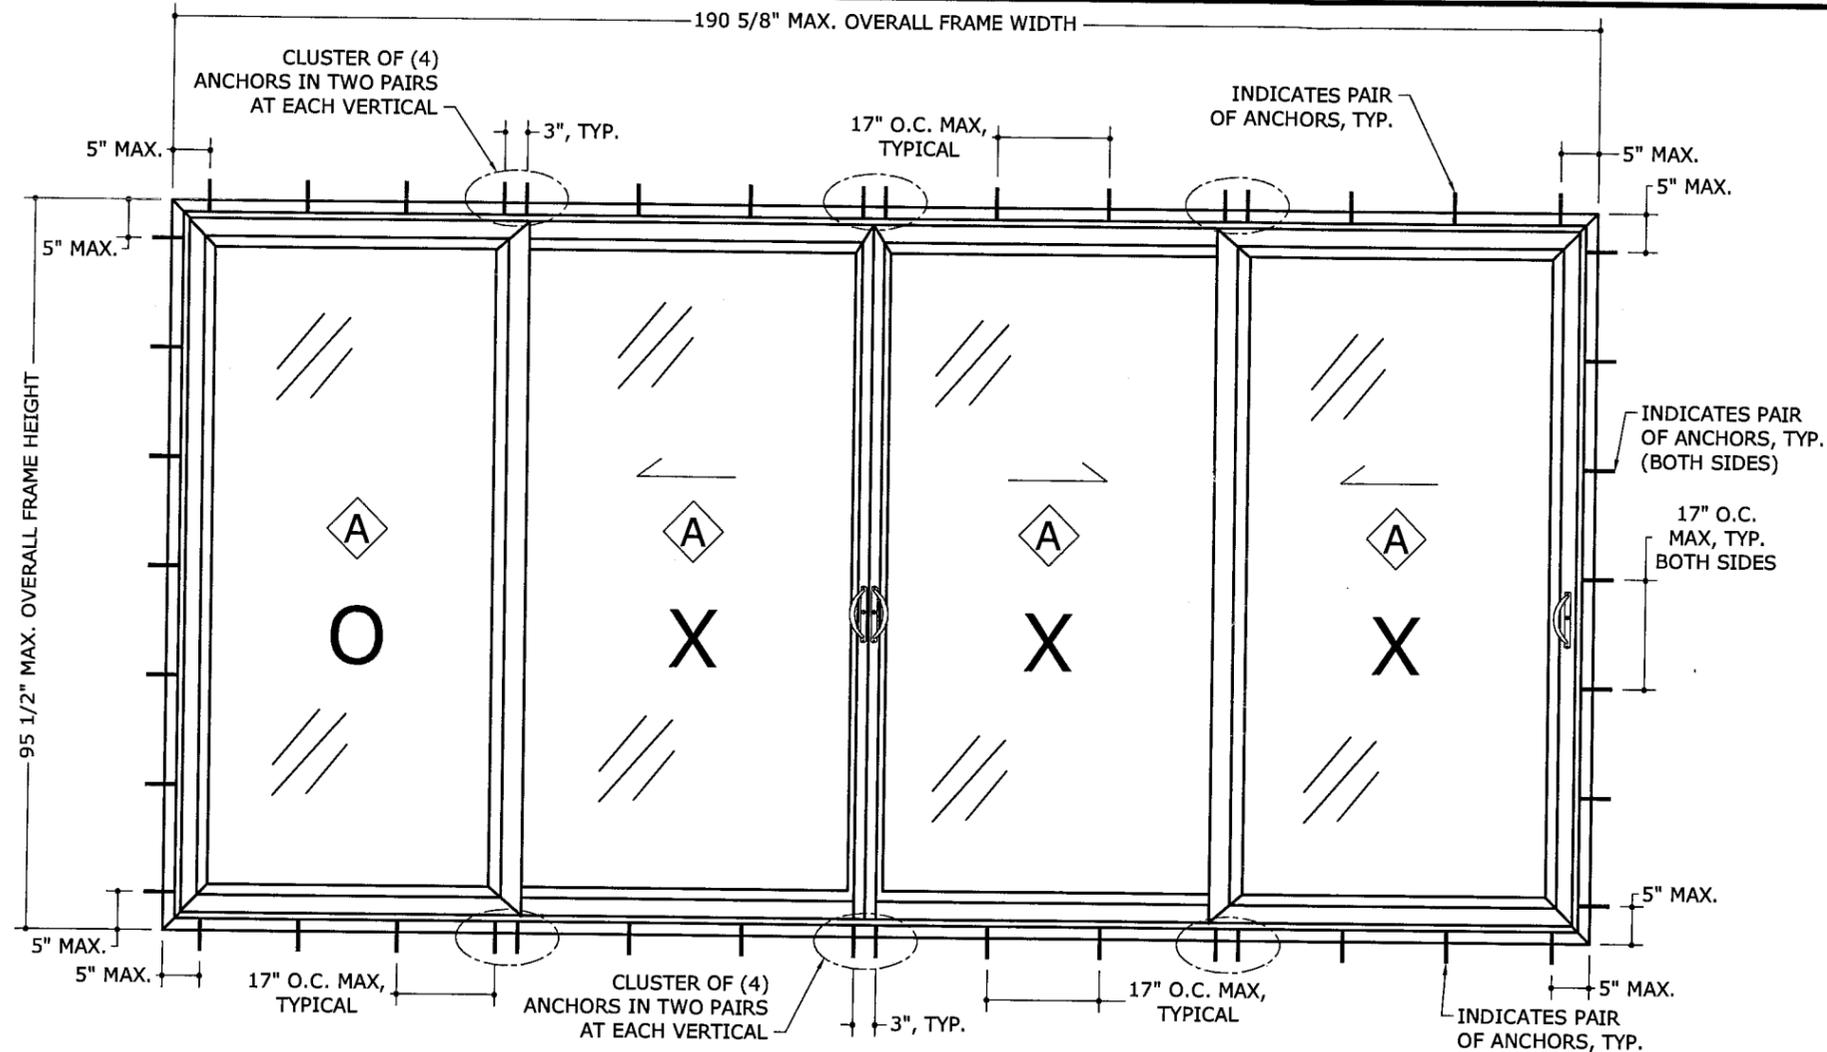

**ALLOWABLE  
DESIGN PRESSURES**  
WITH GLAZING TYPE 'A'

**+50 PSF  
-50 PSF**

**1 ANCHOR ELEVATION: 4-PANEL (OX-XX) BY-PASS WITH MECHANICALLY FASTENED FRAME AND GLAZING TYPE 'A'**  
2 N.T.S. EXTERIOR ELEV

**ANCHOR NOTES:**

1. SEE ANCHOR ELEVATION FOR ANCHOR LOCATIONS AND/OR SPACING.
2. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
3. ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS TO CONCRETE & TO HOLLOW BLOCK.
4. WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
5. WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
6. ANCHOR REQUIREMENTS AS SHOWN HEREIN, INCLUDING MINIMUM EMBEDMENT AND EDGE DISTANCE, EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN WITHIN THE HVHZ, A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE SHALL BE APPLIED FOR AND SECURED FROM THE MIAMI-DADE BUILDING CODE COMPLIANCE OFFICE PRODUCT CONTROL DIVISION. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN OUTSIDE THE HVHZ, THE BUILDING OFFICIAL MAY REQUIRE A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE BE OBTAINED, OR THAT SITE SPECIFIC DOCUMENTS BE PREPARED, SIGNED, DATED AND SEALED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, WHICH DETAIL AND JUSTIFY THE DEVIATION.
7. WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
8. PRESSURE TREATED WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.

**ANCHOR SCHEDULE:**

**TO HOLLOW BLOCK OR 3192 PSI MIN CONCRETE HOST STRUCTURE:**

- 1/4" ITW CARBON STEEL TAPCONS THRU 1X OR 2X WOOD BUCKS OR DIRECTLY INTO MASONRY/ CONCRETE WITH 1-1/4" MIN EMBED AND 2-1/2" EDGE DISTANCE.

**TO WOOD BUCK OR HOST STRUCTURE (G=0.55 MIN WOOD):**

- #14 WOOD SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" EDGE DISTANCE.
- 1/4" LAG SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" EDGE DISTANCE.

FRANK L. BENNARDO, P.E.  
# PE0046549

06/07/2010

**ENGINEERING EXPRESS**  
160 SW 12th AVENUE, # 106  
DEERFIELD BEACH, FL 33442  
Ph: (954) 354-0660 Fax: (954) 354-0443  
WWW.ENGEXP.COM  
CERT. OF AUTH. #9885  
A FRANK L. BENNARDO, P.E., INC. INNOVATION

**JELD-WEN**  
355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497 - 1984

PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	07/10/10
ECOC COMMENTS	KL	FLB	06/03/10


09-JWN-0004  
SCALE: 1/8" = 1'-0"  
PAGE DESCRIPTION:

Approved as complying with the Florida Building Code  
Date **AUGUST 4, 2010**  
NOAS **10-0308-04**  
Miami-Dade Product Control Division  
By *Ishag I. Chugh*

F:\01 Project Files\Jeld-Wen (JWN)\200909-JWN-0004 Premium Atlantic Vinyl 3800 SGD LMI (NOA)\09-JWN-0004\_01c Premium Atlantic Vinyl 3800 SGD LMI (NOA).dwg

FRANK L. BENNARDO, P.E.  
# PE0046549


06/07/2010

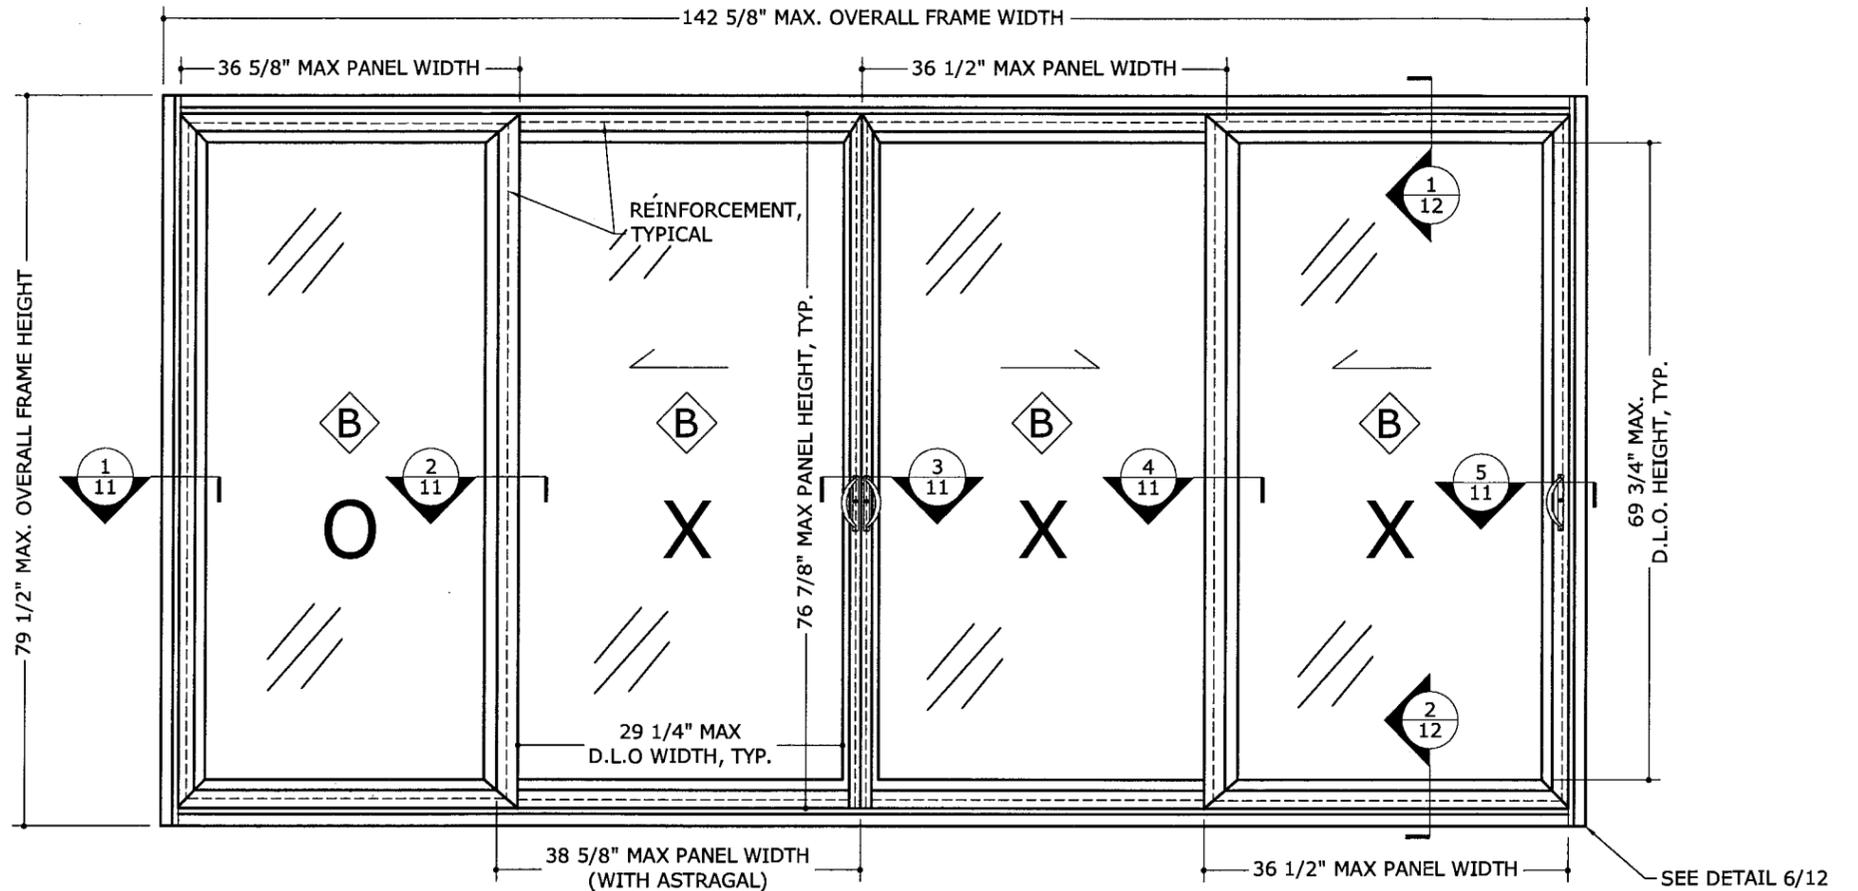

**\*ALLOWABLE DESIGN PRESSURES**  
WITH GLAZING TYPE 'B'  
**+50 PSF**  
**-50 PSF**

- \*LIMITATIONS:**
1. THIS DOOR TO BE USED FOR RESIDENTIAL DWELLING UNITS AND SLEEPING UNITS ONLY.
  2. THIS DOOR CANNOT BE USED AS AN EGRESS EXIT DOOR.


**GLAZING TYPE B**  
1" INSULATED LAMINATED

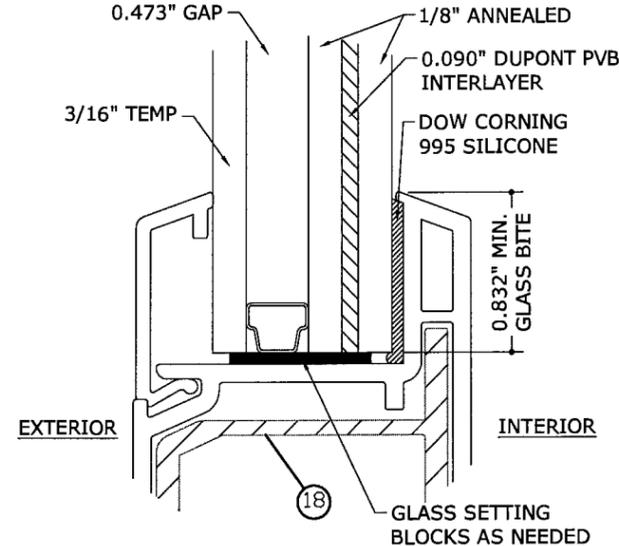

**1**  
**3** N.T.S.

**4-PANEL (OX-XX) BY-PASS WITH MECHANICALLY FASTENED FRAME AND GLAZING TYPE 'B'**

EXTERIOR ELEV

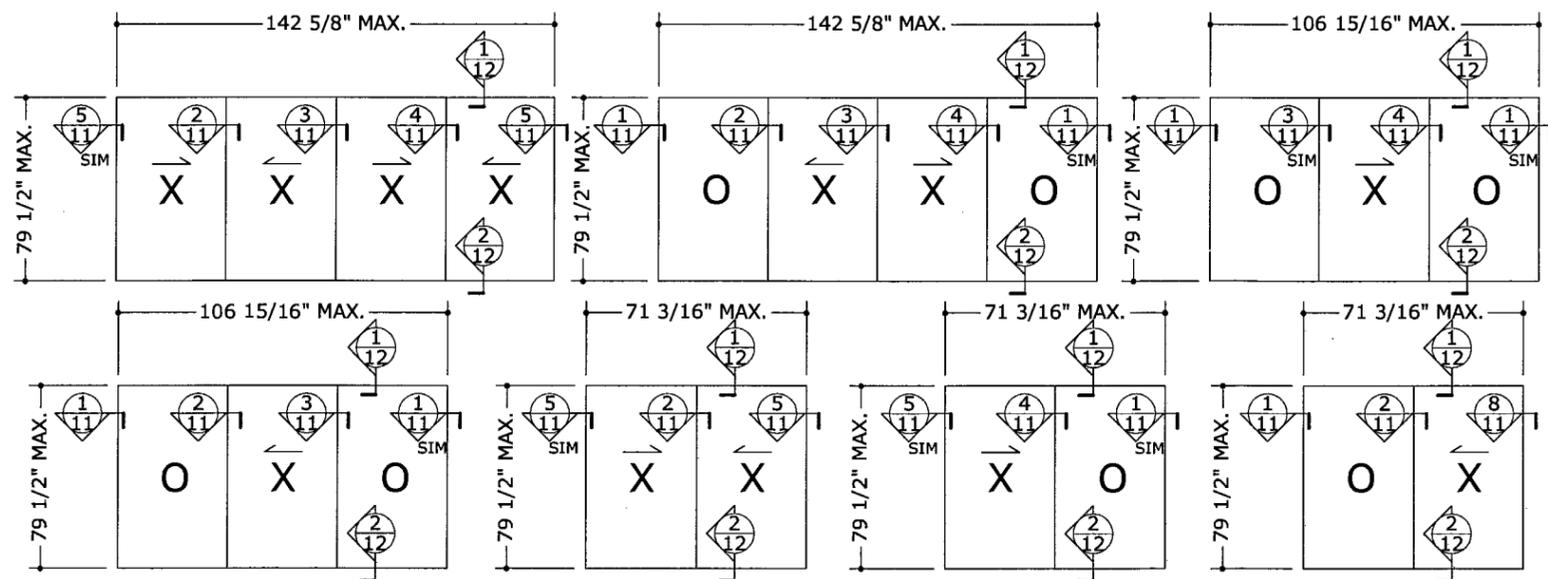

**3**  
**3** N.T.S.

**ADDITIONAL ALLOWABLE CONFIGURATIONS (4 PANELS MAX, GLAZING TYPE 'B')**

**2**  
**3** N.T.S.

**GLAZING DETAIL**

**ENGINEERING EXPRESS**

160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
PH: (954) 354-0660 FAX: (954) 354-0443  
WWW.ENGEXP.COM  
CERT. OF AUTH. #9885  
A FRANK L. BENNARDO, P.E., INC. INNOVATION


**JELD-WEN**  
355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497 - 1984

PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

DRWN	CHKD	DATE
KL	FLB	07/10/10
KL	FLB	06/03/10

09-JWN-0004  
SCALE: 01  
PAGE DESCRIPTION:

Approved as complying with the Florida Building Code  
Date AUGUST 4, 2010  
NOA# 10-0308-04  
Miami Dade Product Control Division  
By Chag L. Chant

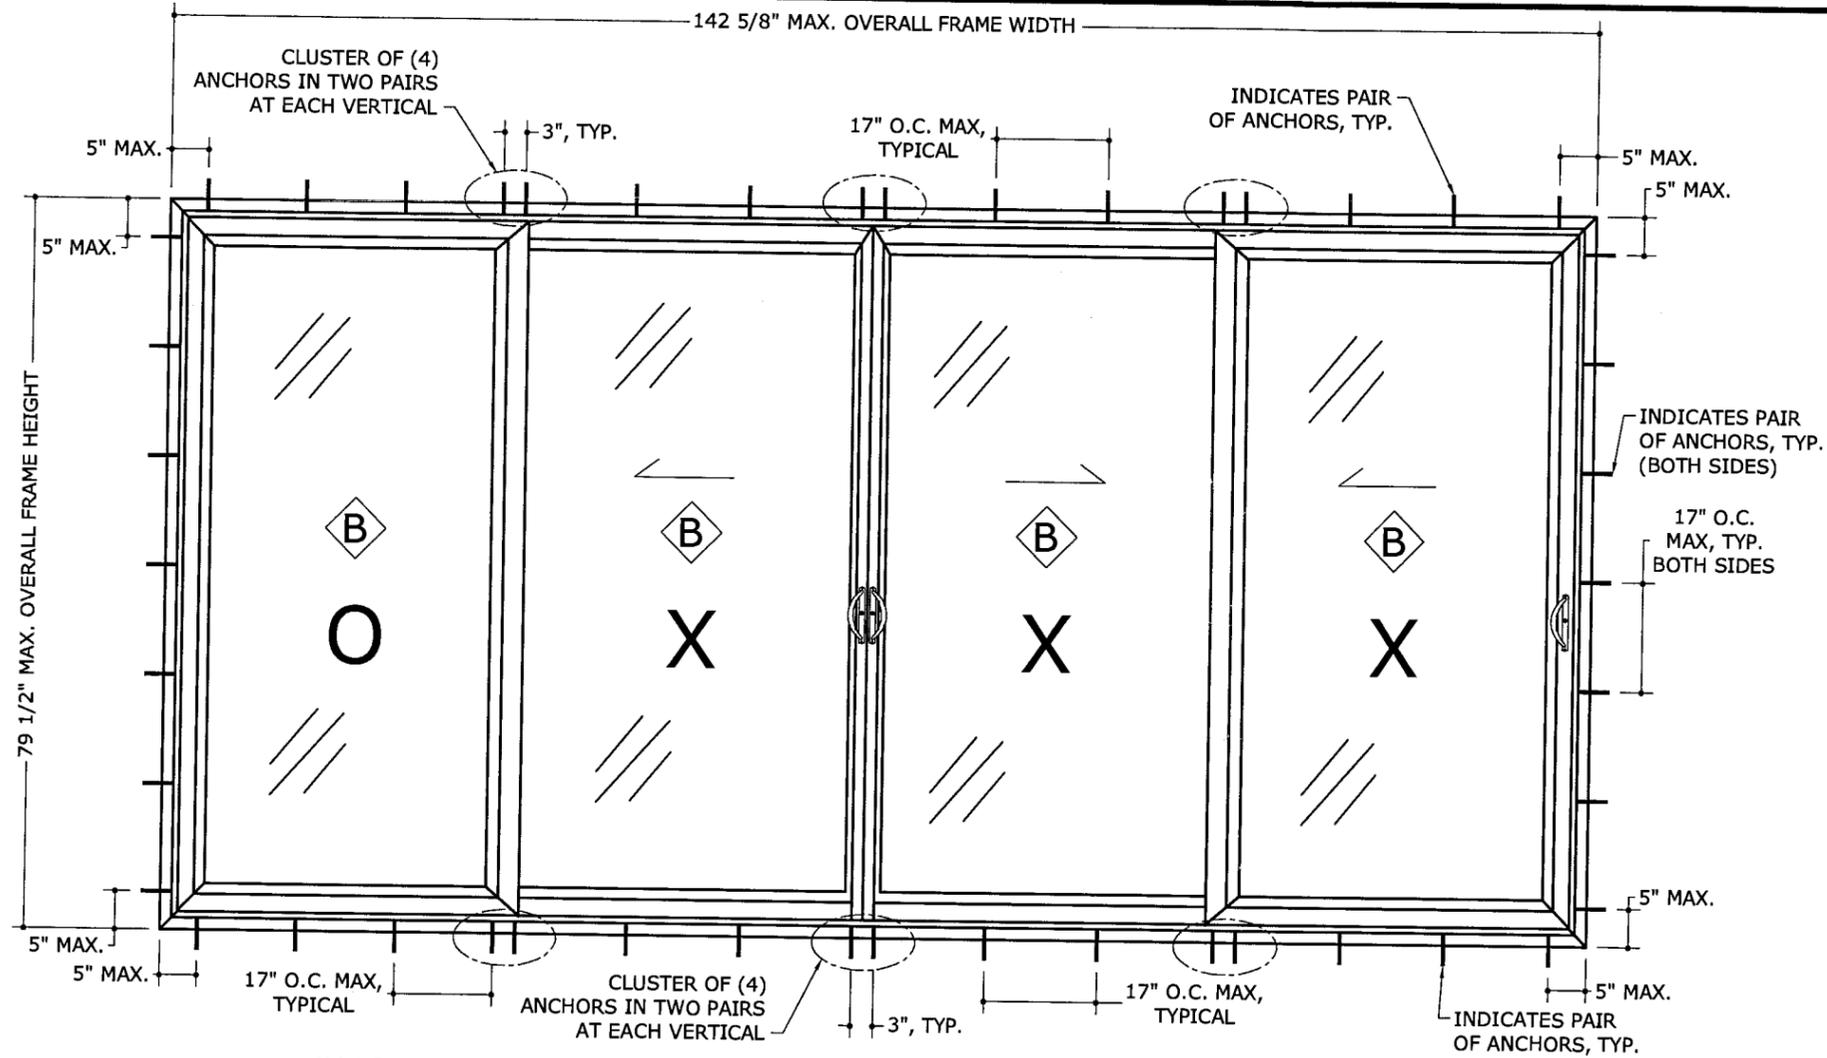

**1**  
**4** ANCHOR ELEVATION: 4-PANEL (OX-XX) BY-PASS WITH MECHANICALLY FASTENED FRAME AND GLAZING TYPE 'B'  
N.T.S. EXTERIOR ELEV

**\*ALLOWABLE DESIGN PRESSURES**  
WITH GLAZING TYPE 'B'  
**+50 PSF**  
**-50 PSF**

- \*LIMITATIONS:**
1. THIS DOOR TO BE USED FOR RESIDENTIAL DWELLING UNITS AND SLEEPING UNITS ONLY.
  2. THIS DOOR CANNOT BE USED AS AN EGRESS EXIT DOOR.

**ANCHOR NOTES:**

1. SEE ANCHOR ELEVATION FOR ANCHOR LOCATIONS AND/OR SPACING.
2. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
3. ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS TO CONCRETE & TO HOLLOW BLOCK.
4. WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
5. WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
6. ANCHOR REQUIREMENTS AS SHOWN HEREIN, INCLUDING MINIMUM EMBEDMENT AND EDGE DISTANCE, EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN WITHIN THE HVHZ, A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE SHALL BE APPLIED FOR AND SECURED FROM THE MIAMI-DADE BUILDING CODE COMPLIANCE OFFICE PRODUCT CONTROL DIVISION. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN OUTSIDE THE HVHZ, THE BUILDING OFFICIAL MAY REQUIRE A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE BE OBTAINED, OR THAT SITE SPECIFIC DOCUMENTS BE PREPARED, SIGNED, DATED AND SEALED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, WHICH DETAIL AND JUSTIFY THE DEVIATION.
7. WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
8. PRESSURE TREATED WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.

**ANCHOR SCHEDULE:**

**TO HOLLOW BLOCK OR 3192 PSI MIN CONCRETE HOST STRUCTURE:**

- 1/4" ITW CARBON STEEL TAPCONS THRU 1X OR 2X WOOD BUCKS OR DIRECTLY INTO MASONRY/ CONCRETE WITH 1-1/4" MIN EMBED AND 2-1/2" EDGE DISTANCE.

**TO WOOD BUCK OR HOST STRUCTURE (G=0.55 MIN WOOD):**

- #14 WOOD SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" EDGE DISTANCE.
- 1/4" LAG SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" EDGE DISTANCE.

FRANK L. BENNARDO, P.E.  
#PE0046549

06/07/2010

**ENGINEERING EXPRESS**  
160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
PH: (954) 354-0660 FAX: (954) 354-0443  
WWW.ENGEXP.COM  
CERT OF AUTH #9885  
A. FRANK L. BENNARDO, P.E., INC. INNOVATION

**JELDWEN**  
355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497 - 1984  
PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	01/10/10
BCCO COMMENTS	KL	FLB	06/03/10

Approved as complying with the Florida Building Code  
Date AUGUST 4, 2010  
NOA# 10-0308-04  
Miami Dade Product Control Division  
By Ishag I. Chaudh

09-JWN-0004  
SCALE: 01  
PAGE DESCRIPTION:

F:\01 Project Files\Jeld-Wen (JWN)\2009\09-JWN-0004 Premium Atlantic Vinyl 3800 SGP LMI (NOA).dwg  
06/07/2010 - 4:10pm keith

06/07/2010

**ENGINEERING EXPRESS**  
160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
PH: (954) 354-0660 FAX: (954) 354-0443  
WWW.ENGEXP.COM  
CERT OF AUTH #9885  
A FRANK L. BENNARDO, P.E., INC. INNOVATION


**JELDOWEN**  
355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497 - 1984  
PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	01/10/10
BCCO COMMENTS	KL	FLB	06/03/10


09-JWN-0004  
SCALE: 01  
PAGE DESCRIPTION:  
15

**ALLOWABLE DESIGN PRESSURES**  
WITH GLAZING TYPE 'A'  
**+50 PSF**  
**-50 PSF**

**GLAZING TYPE A**  
1" INSULATED LAMINATED

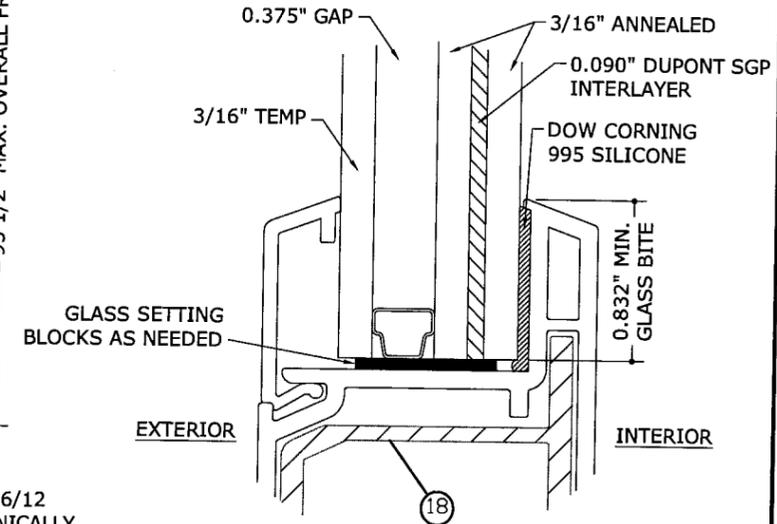


**2 GLAZING DETAIL**  
5 N.T.S.

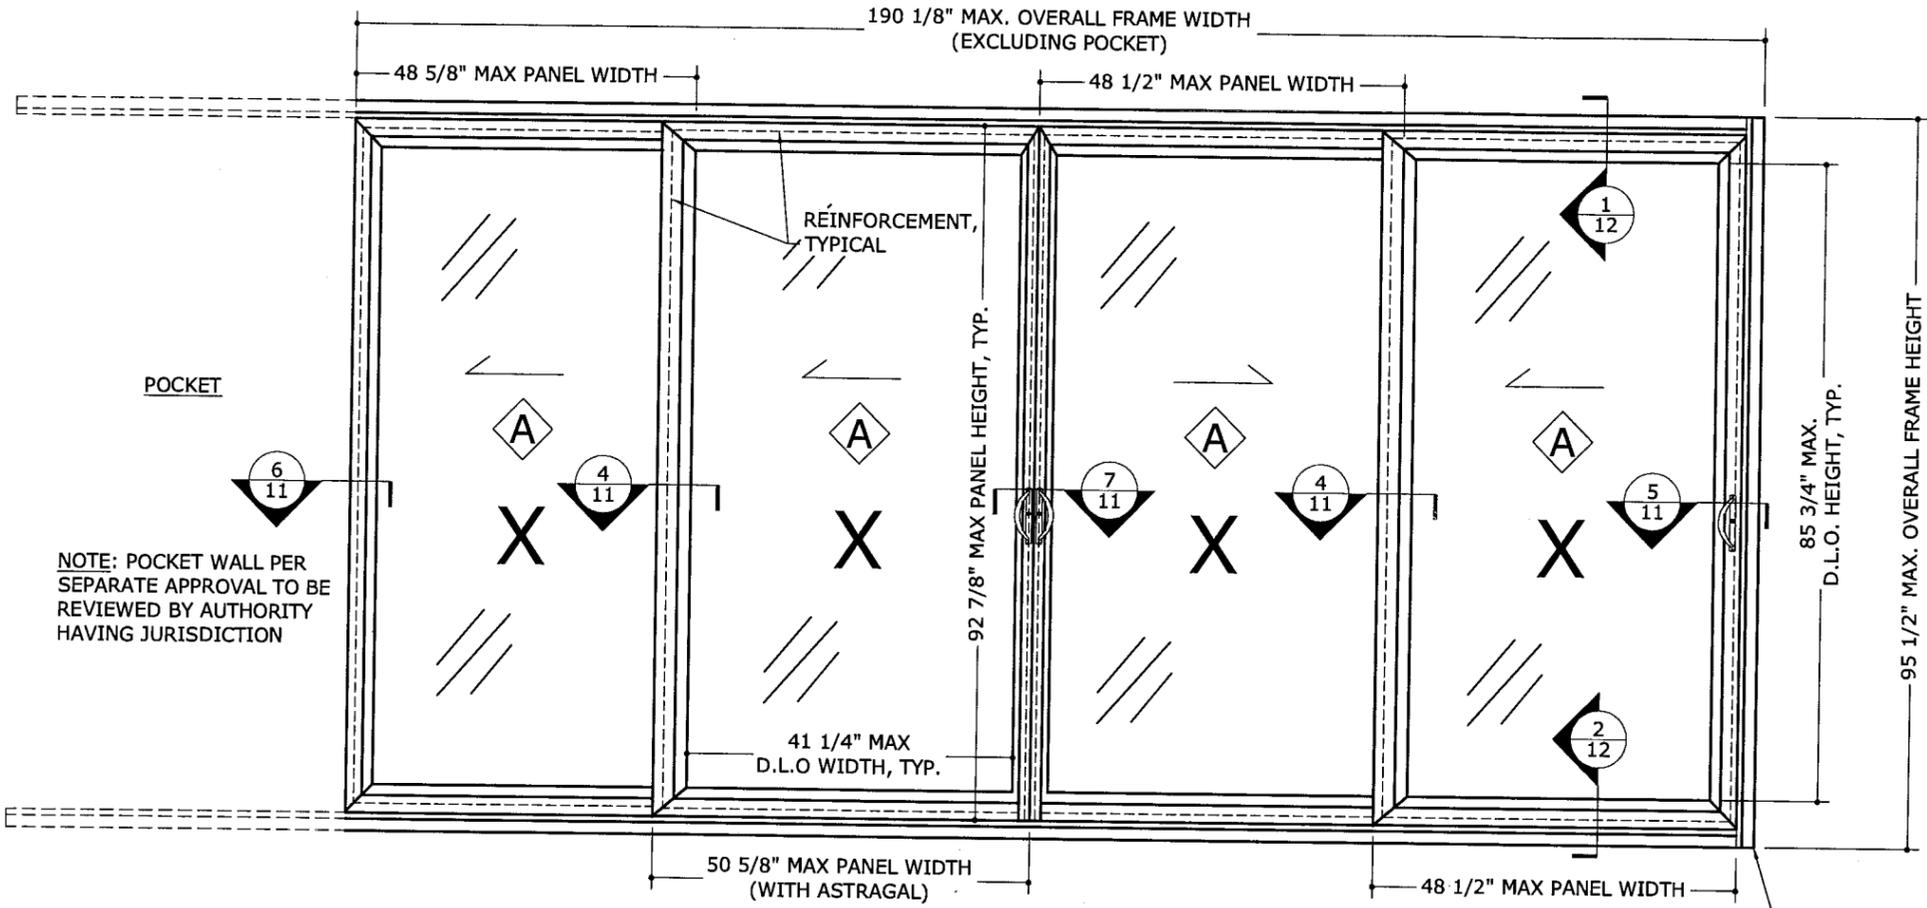

**1 4-PANEL (XpX-XX) POCKET WITH MECHANICALLY FASTENED FRAME AND GLAZING TYPE 'A'**  
5 N.T.S. EXTERIOR ELEV

SEE DETAIL 6/12 FOR MECHANICALLY FASTENED FRAME CORNER ASSEMBLY

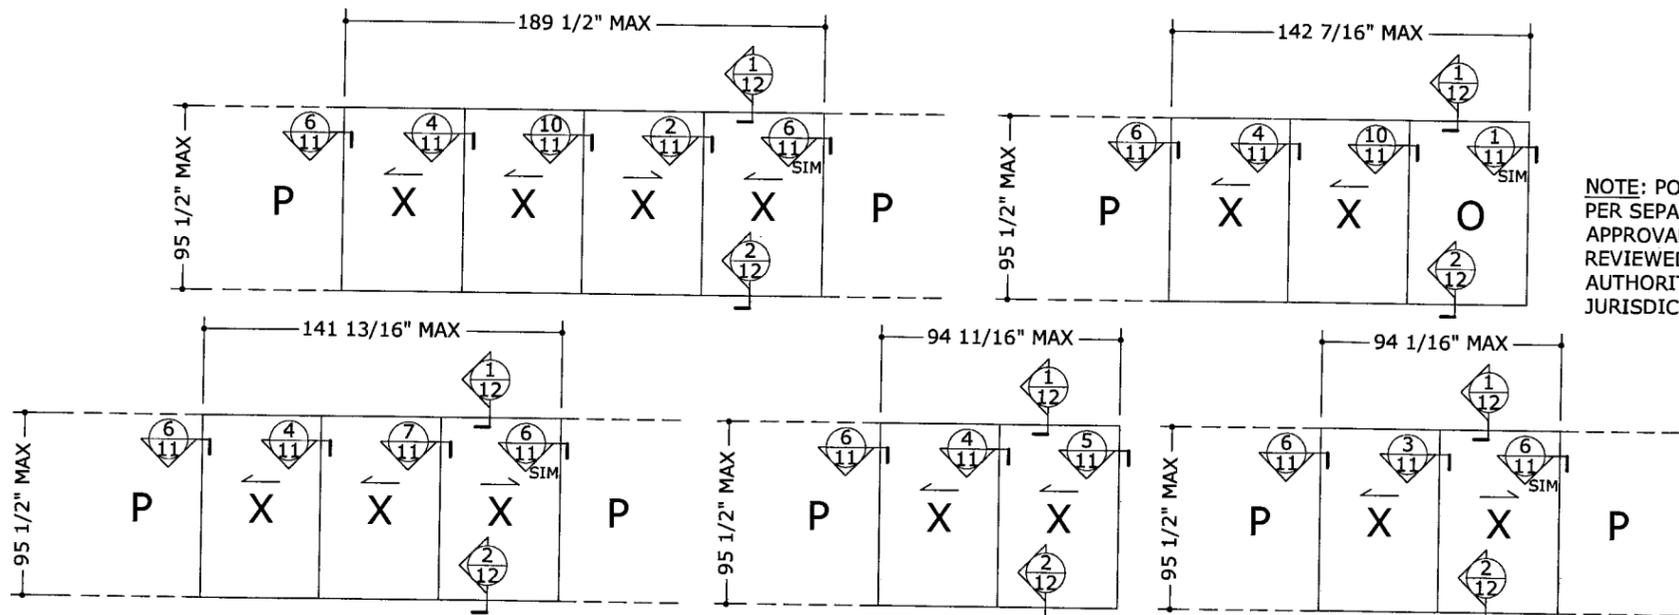

**3 ADDITIONAL ALLOWABLE CONFIGURATIONS (4 PANELS MAX, GLAZING TYPE 'A')**  
5 N.T.S.


NOTE: POCKET WALL PER SEPARATE APPROVAL TO BE REVIEWED BY AUTHORITY HAVING JURISDICTION

NOTE: POCKET WALL PER SEPARATE APPROVAL TO BE REVIEWED BY AUTHORITY HAVING JURISDICTION

F:\01 Project Files\Jeldowen (JWN)\2009\09-JWN-0004 Premium Atlantic Vinyl 3800 SGD LMI (NOA)\09-JWN-0004\_01c Premium Atlantic Vinyl 3800 SGD LMI (NOA).dwg  
06/07/2010 - 4:10pm keithl

Approved as complying with the Florida Building Code  
Date AUGUST 4, 2010  
NOA# 10-0308-04  
Miami Dade Product Control Division  
By Iglag I. Chandra

F:\01 Project Files\Jeld-Wen (JWN)\2009\09-JWN-0004 Premium Atlantic Vinyl 3800 SGD LMI (NOA).dwg  
06/07/2010 - 4:10pm keifhl

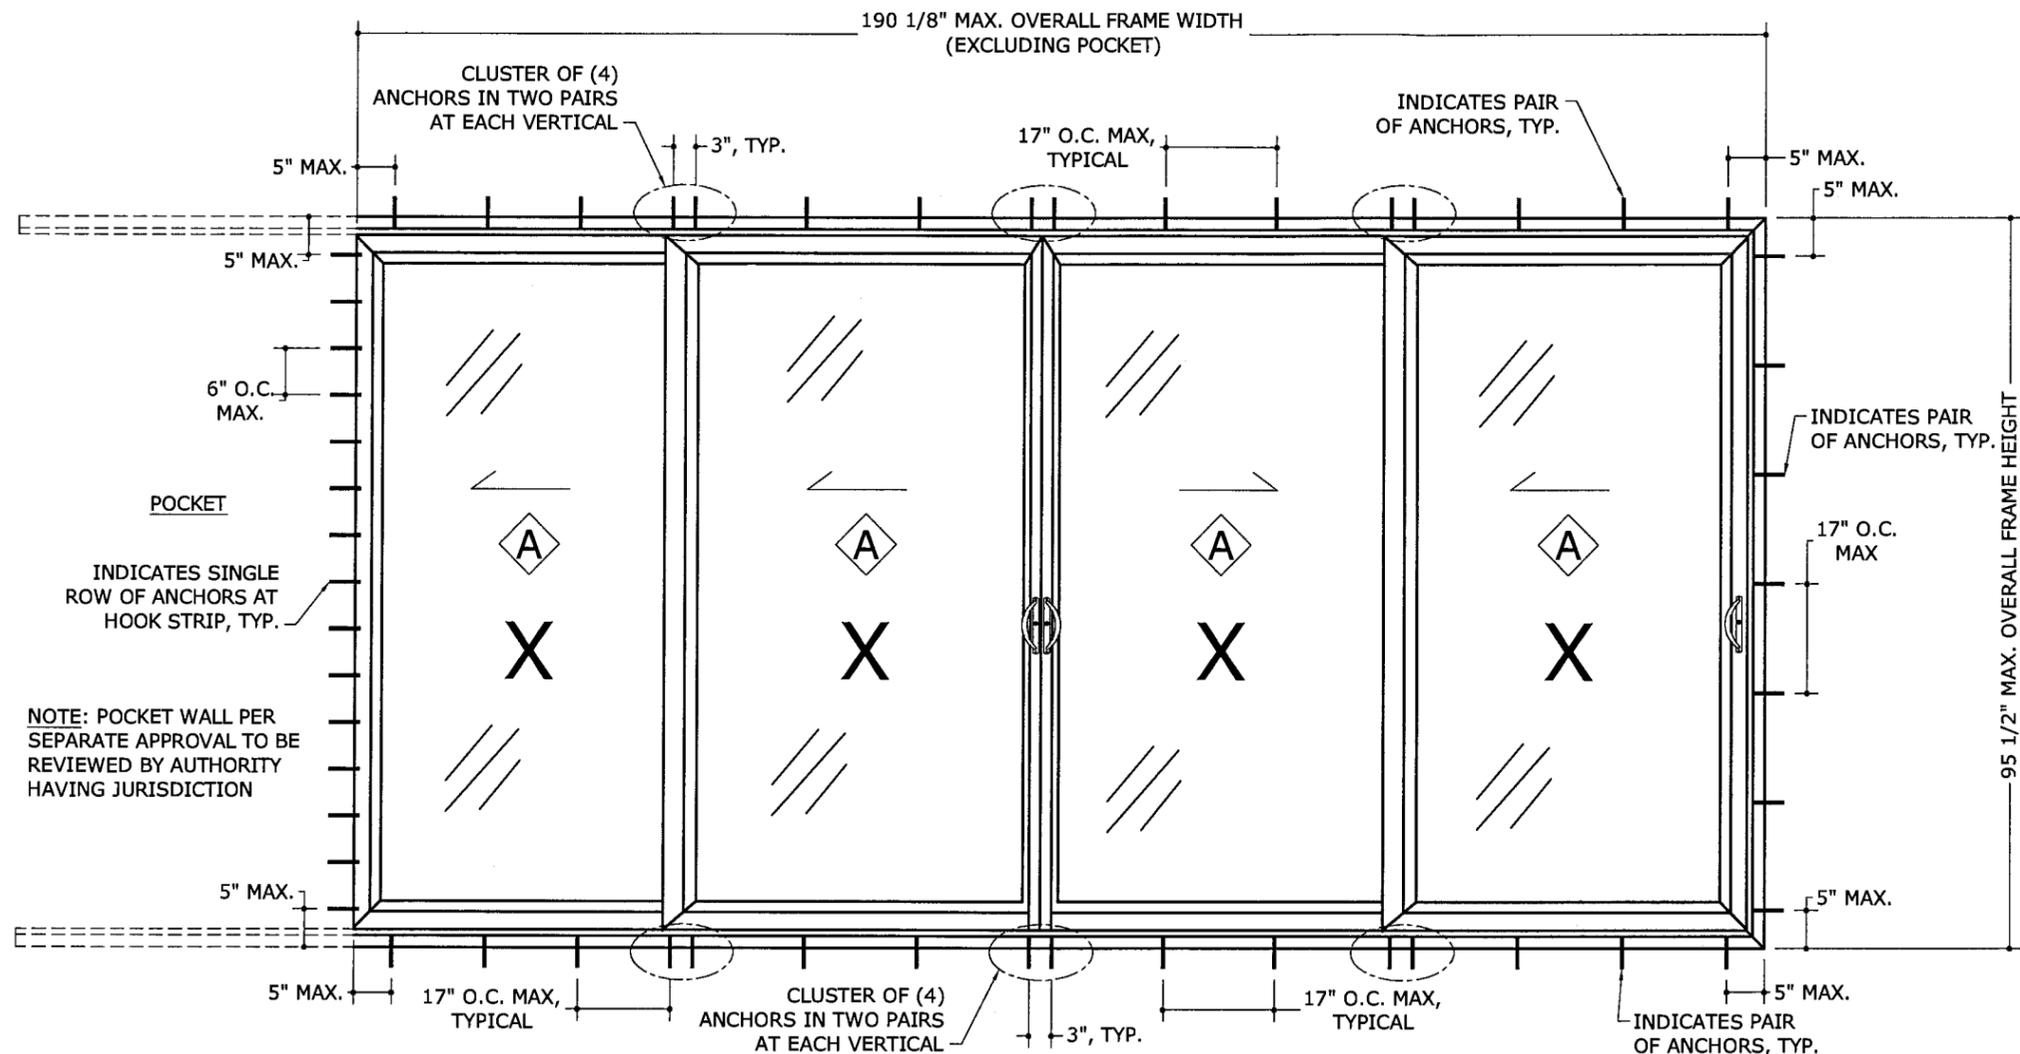

NOTE: POCKET WALL PER SEPARATE APPROVAL TO BE REVIEWED BY AUTHORITY HAVING JURISDICTION

**ALLOWABLE  
DESIGN PRESSURES**  
WITH GLAZING TYPE 'A'  
**+50 PSF  
-50 PSF**

**1** ANCHOR ELEVATION: 4-PANEL (XpX-XX) POCKET WITH MECHANICALLY FASTENED FRAME AND GLAZING TYPE 'A'  
**6** N.T.S. EXTERIOR ELEV

**ANCHOR NOTES:**

1. SEE ANCHOR ELEVATION FOR ANCHOR LOCATIONS AND/OR SPACING.
2. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
3. ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS TO CONCRETE & TO HOLLOW BLOCK.
4. WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
5. WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
6. ANCHOR REQUIREMENTS AS SHOWN HEREIN, INCLUDING MINIMUM EMBEDMENT AND EDGE DISTANCE, EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN WITHIN THE HVHZ, A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE SHALL BE APPLIED FOR AND SECURED FROM THE MIAMI-DADE BUILDING CODE COMPLIANCE OFFICE PRODUCT CONTROL DIVISION. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN OUTSIDE THE HVHZ, THE BUILDING OFFICIAL MAY REQUIRE A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE BE OBTAINED, OR THAT SITE SPECIFIC DOCUMENTS BE PREPARED, SIGNED, DATED AND SEALED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, WHICH DETAIL AND JUSTIFY THE DEVIATION.
7. WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
8. PRESSURE TREATED WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.

**ANCHOR SCHEDULE:**

- TO HOLLOW BLOCK OR 3192 PSI MIN CONCRETE HOST STRUCTURE:**
- 1/4" ITW CARBON STEEL TAPCONS THRU 1X OR 2X WOOD BUCKS OR DIRECTLY INTO MASONRY/ CONCRETE WITH 1-1/4" MIN EMBED AND 2-1/2" EDGE DISTANCE.
- TO WOOD BUCK OR HOST STRUCTURE (G=0.55 MIN WOOD):**
- #14 WOOD SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" EDGE DISTANCE.
  - 1/4" LAG SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" EDGE DISTANCE.

Approved as complying with the Florida Building Code  
Date August 4, 2010  
NOA# 10-0308-04  
Miami Dade Product Control Division  
By Ishag I. Chande

FRANK L. BENNARDO, P.E.  
#PF0046549

06/07/2010

**ENGINEERING EXPRESS®**

160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
PH: (954) 354-0660 FAX: (954) 354-0443  
WWW.ENGPX.COM  
CERT. OF AUTH #9885  
A FRANK L. BENNARDO, P.E., INC. INNOVATION

**JELDWEN**  
355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497 - 1984

PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN CHKD		DATE	
	KL	FLB	KL	FLB
INIT ISSUE			01/10/10	
BCCO COMMENTS			06/03/10	

**09-JWN-0004**


SCALE: 01

PAGE DESCRIPTION:

15

06/07/2010 - 4:10pm keithl F:\01 Project Files\Jeld-Wen (JWN)\200909-JWN-0004 Premium Atlantic Vinyl 3800 SGD LMI (NOA).dwg

06/07/2010

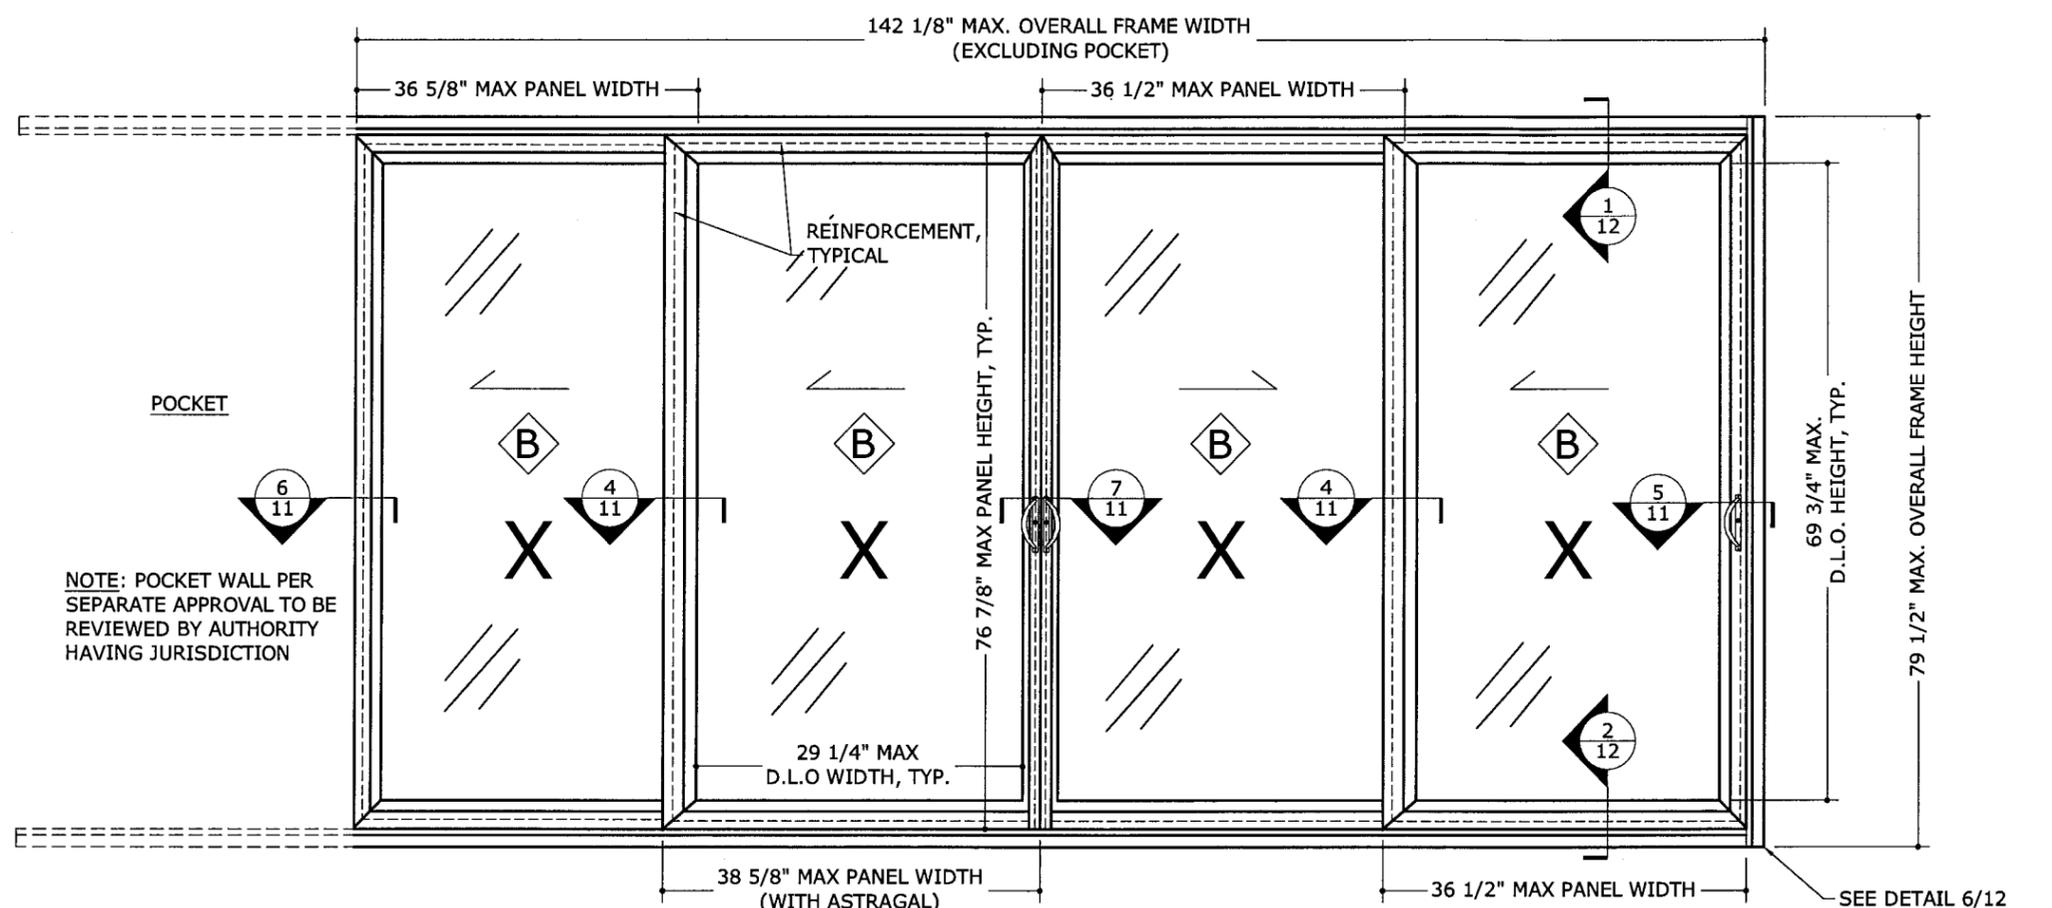


**\*ALLOWABLE DESIGN PRESSURES**  
WITH GLAZING TYPE 'B'  
**+50 PSF**  
**-50 PSF**


- \*LIMITATIONS:**
1. THIS DOOR TO BE USED FOR RESIDENTIAL DWELLING UNITS AND SLEEPING UNITS ONLY.
  2. THIS DOOR CANNOT BE USED AS AN EGRESS EXIT DOOR.

NOTE: POCKET WALL PER SEPARATE APPROVAL TO BE REVIEWED BY AUTHORITY HAVING JURISDICTION

**GLAZING TYPE B**  
1" INSULATED LAMINATED

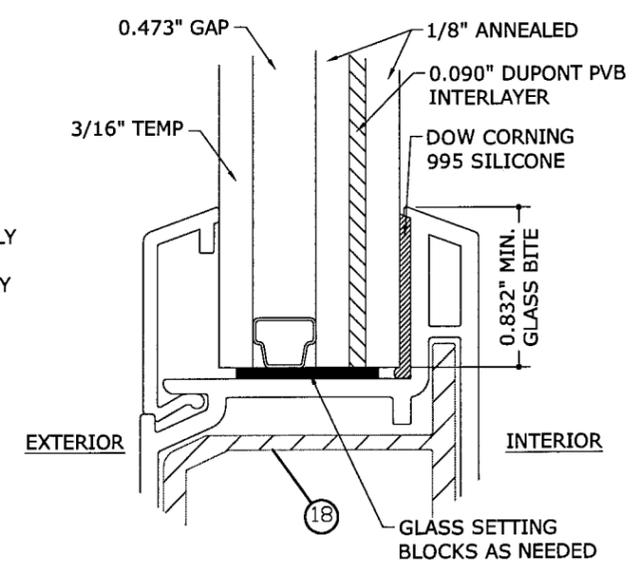

**1**  
**7** N.T.S.  
**4-PANEL (XpX-XX) POCKET WITH MECHANICALLY FASTENED FRAME AND GLAZING TYPE 'B'**  
EXTERIOR ELEV

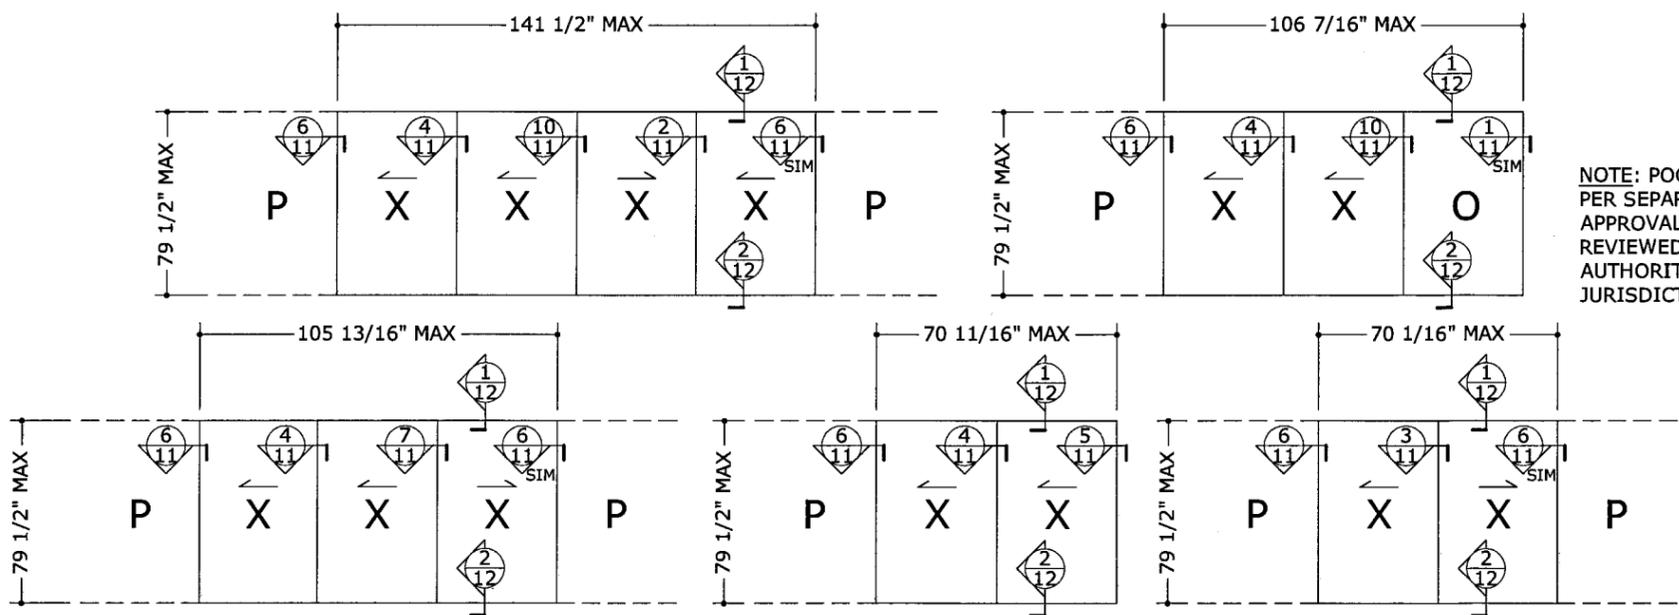

NOTE: POCKET WALL PER SEPARATE APPROVAL TO BE REVIEWED BY AUTHORITY HAVING JURISDICTION

**3**  
**7** N.T.S.  
**GLAZING DETAIL**

**2**  
**7** N.T.S.  
**ADDITIONAL ALLOWABLE CONFIGURATIONS (4 PANELS MAX, GLAZING TYPE 'B')**

**ENGINEERING EXPRESS**  
160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
Ph: (954) 354-0660 Fax: (954) 354-0443  
WWW.ENGEXP.COM  
CERT. OF AUTH #8885  
A FRANK L. BENNARDO, P.E., INC. INNOVATION


**JELDOWEN**  
355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497 - 1984  
PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

DRWN	CHKD	DATE
KL	FLB	01/10/10
KL	FLB	06/03/10

09-JWN-0004  
SCALE: 1/8" = 1'-0"  
PAGE DESCRIPTION:

Approved as complying with the Florida Building Code  
Date AUGUST 4 2010  
NOA# 10-0308-04  
Miami Dade Product Control Division  
By Shag 1 Chant

F:\01 Project Files\Jeld-Wen (JWN)\2009\09-JWN-0004 Premium Atlantic Vinyl 3800 SGD LMI (NOA).dwg  
06/07/2010 - 4:10pm keith

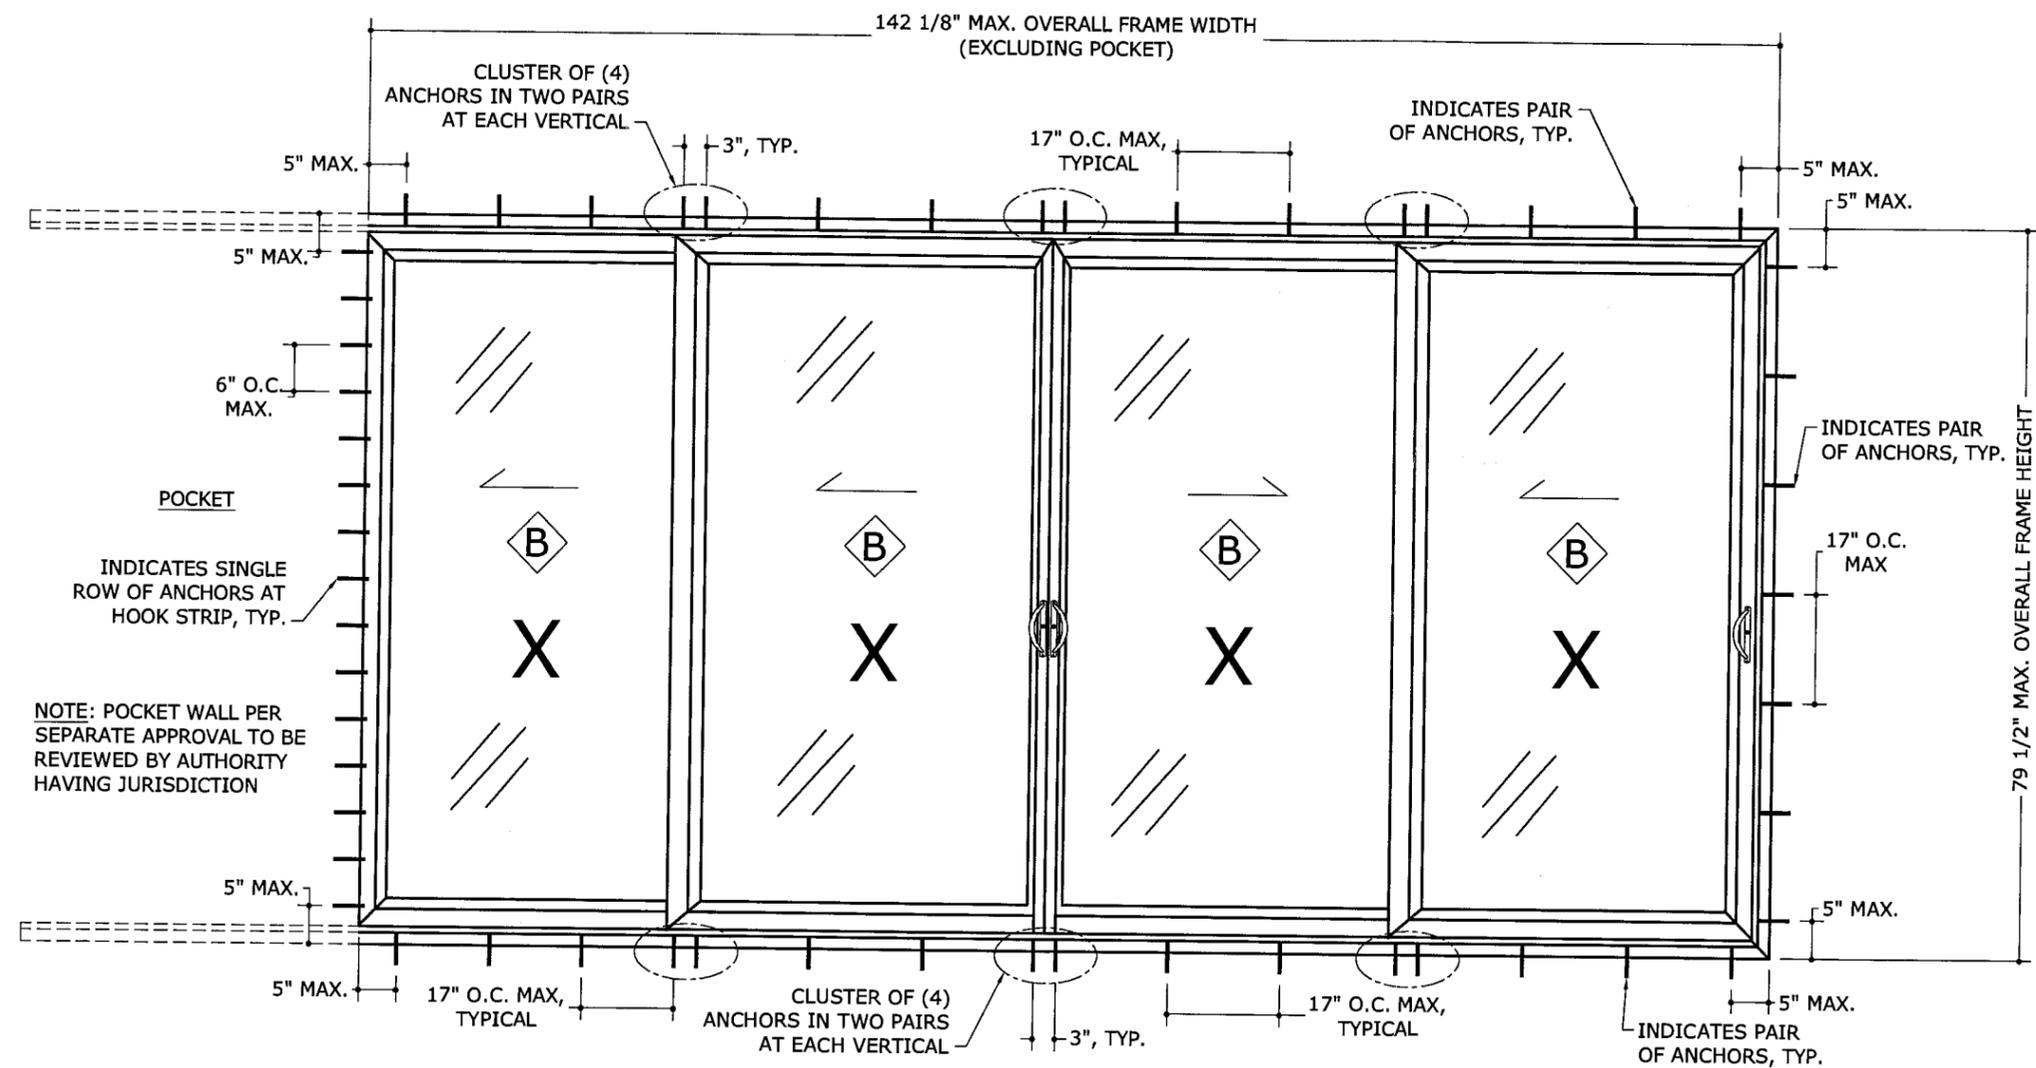

NOTE: POCKET WALL PER SEPARATE APPROVAL TO BE REVIEWED BY AUTHORITY HAVING JURISDICTION

**1**  
**8** ANCHOR ELEVATION: 4-PANEL (XpX-XX) POCKET WITH MECHANICALLY FASTENED FRAME AND GLAZING TYPE 'B'  
N.T.S. EXTERIOR ELEV

**\*ALLOWABLE DESIGN PRESSURES**  
WITH GLAZING TYPE 'B'  
**+50 PSF**  
**-50 PSF**

- \*LIMITATIONS:**
1. THIS DOOR TO BE USED FOR RESIDENTIAL DWELLING UNITS AND SLEEPING UNITS ONLY.
  2. THIS DOOR CANNOT BE USED AS AN EGRESS EXIT DOOR.

**ANCHOR SCHEDULE:**

**TO HOLLOW BLOCK OR 3192 PSI MIN CONCRETE HOST STRUCTURE:**

- 1/4" ITW CARBON STEEL TAPCONS THRU 1X OR 2X WOOD BUCKS OR DIRECTLY INTO MASONRY/ CONCRETE WITH 1-1/4" MIN EMBED AND 2-1/2" EDGE DISTANCE.

**TO WOOD BUCK OR HOST STRUCTURE (G=0.55 MIN WOOD):**

- #14 WOOD SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" EDGE DISTANCE.
- 1/4" LAG SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" EDGE DISTANCE.

**ANCHOR NOTES:**

1. SEE ANCHOR ELEVATION FOR ANCHOR LOCATIONS AND/OR SPACING.
2. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
3. ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS TO CONCRETE & TO HOLLOW BLOCK.
4. WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
5. WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
6. ANCHOR REQUIREMENTS AS SHOWN HEREIN, INCLUDING MINIMUM EMBEDMENT AND EDGE DISTANCE, EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN WITHIN THE HVHZ, A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE SHALL BE APPLIED FOR AND SECURED FROM THE MIAMI-DADE BUILDING CODE COMPLIANCE OFFICE PRODUCT CONTROL DIVISION. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN OUTSIDE THE HVHZ, THE BUILDING OFFICIAL MAY REQUIRE A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE BE OBTAINED, OR THAT SITE SPECIFIC DOCUMENTS BE PREPARED, SIGNED, DATED AND SEALED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, WHICH DETAIL AND JUSTIFY THE DEVIATION.
7. WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
8. PRESSURE TREATED WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.

FRANK L. BENNARDO, P.E.  
# PE0046549

06/07/2010

**ENGINEERING EXPRESS**  
160 SW 12th AVENUE, # 106  
DEERFIELD BEACH, FL 33442  
Ph: (954) 354-0660 Fax: (954) 354-0443  
WWW.ENGEXP.COM  
CERT OF AUTH #9885  
A FRANK L. BENNARDO, P.E., INC. INNOVATION

**JELD-WEN**  
355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497 - 1984  
PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	01/10/10
BCCO COMMENTS	KL	FLB	06/03/10


09-JWN-0004

SCALE: 1/8" = 1'-0" 01


PAGE DESCRIPTION:

Approved as complying with the Florida Building Code  
Date AUGUST 4, 2010  
NOA# 10-0308-04  
Miami Dade Product Control Division  
By Isaac L. Chaud

06/07/2010 - 4:10pm keithl F:\01 Project Files\Jeld-Wen (JWN)\2009\09-JWN-0004 Premium Atlantic Vinyl 3800 SGD LMI (NCA)09-JWN-0004 01c Premium Atlantic Vinyl 3800 SGD LMI (NCA).dwg

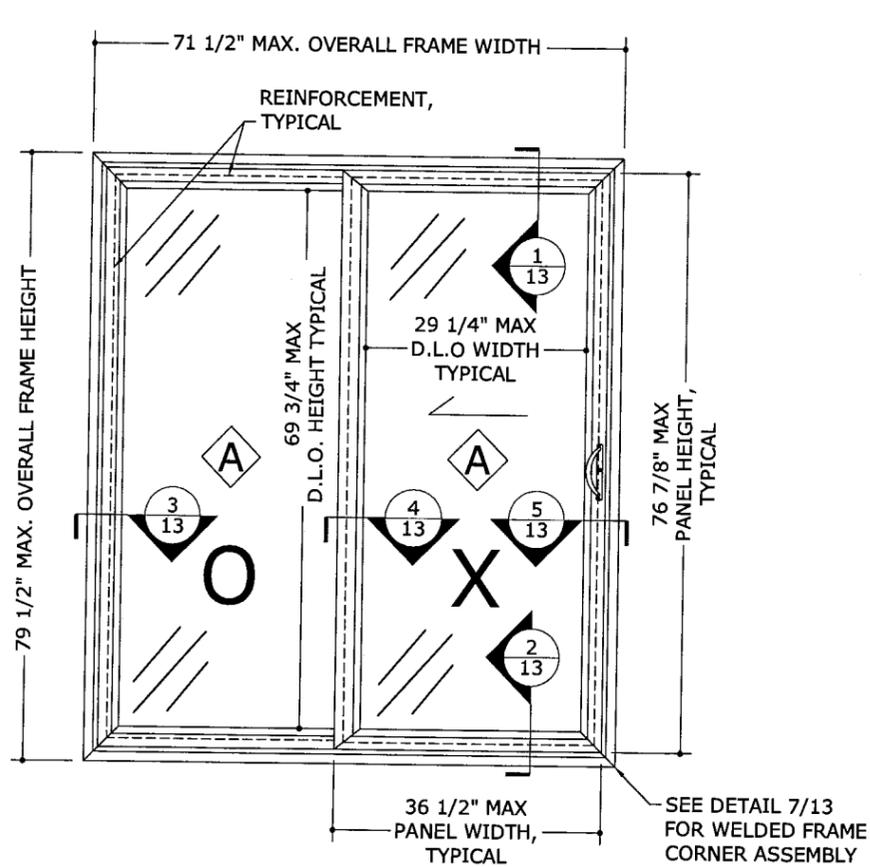

**1**  
**9** N.T.S. EXTERIOR ELEV

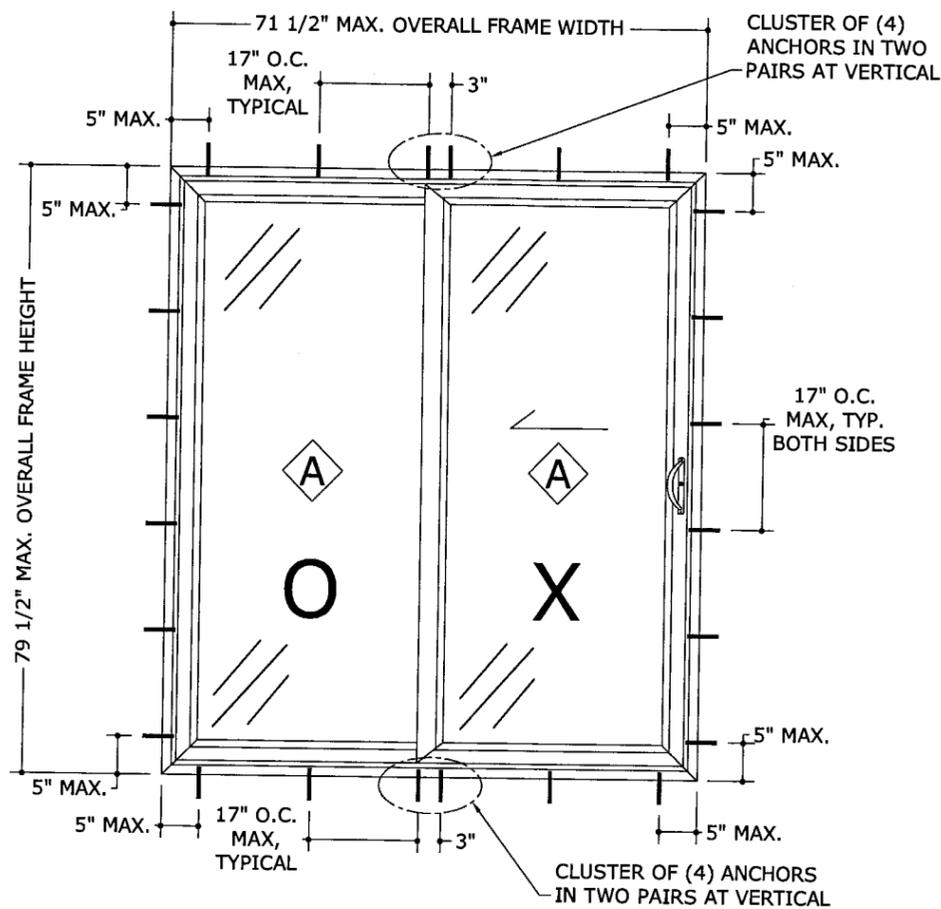


**2**  
**9** N.T.S. EXTERIOR ELEV

**\*ALLOWABLE DESIGN PRESSURES**  
WITH GLAZING TYPE 'A'  
**+50 PSF**  
**-50 PSF**

- \*LIMITATIONS:**
- THIS DOOR TO BE USED FOR RESIDENTIAL DWELLING UNITS AND SLEEPING UNITS ONLY.
  - THIS DOOR CANNOT BE USED AS AN EGRESS EXIT DOOR.

**GLAZING TYPE A**  
1" INSULATED LAMINATED

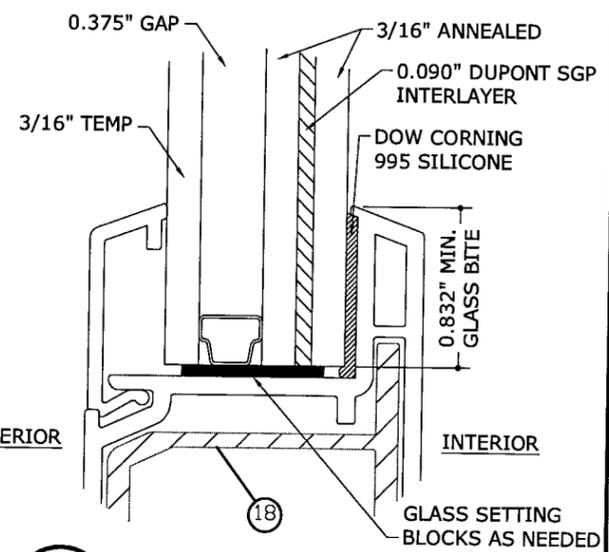

**3**  
**9** N.T.S.

Approved as complying with the Florida Building Code  
Date AUGUST 4, 2010  
NOAH 10-0308-04  
Miami Dade Product Control Division  
By Shag L. L. L...

**ANCHOR SCHEDULE:**  
**TO HOLLOW BLOCK OR 3192 PSI MIN CONCRETE HOST STRUCTURE:**


- 1/4" ITW CARBON STEEL TAPCONS THRU 1X OR 2X WOOD BUCKS OR DIRECTLY INTO MASONRY/ CONCRETE WITH 1-1/4" MIN EMBED AND 2-1/2" EDGE DISTANCE.

**TO WOOD BUCK OR HOST STRUCTURE (G=0.55 MIN WOOD):**

- #14 WOOD SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" EDGE DISTANCE.
- 1/4" LAG SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" EDGE DISTANCE.

**ANCHOR NOTES:**

- SEE ANCHOR ELEVATION FOR ANCHOR LOCATIONS AND/OR SPACING.
- ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
- ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS TO CONCRETE & TO HOLLOW BLOCK.
- WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
- WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
- ANCHOR REQUIREMENTS AS SHOWN HEREIN, INCLUDING MINIMUM EMBEDMENT AND EDGE DISTANCE, EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN WITHIN THE HVHZ, A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE SHALL BE APPLIED FOR AND SECURED FROM THE MIAMI-DADE BUILDING CODE COMPLIANCE OFFICE PRODUCT CONTROL DIVISION. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN OUTSIDE THE HVHZ, THE BUILDING OFFICIAL MAY REQUIRE A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE BE OBTAINED, OR THAT SITE SPECIFIC DOCUMENTS BE PREPARED, SIGNED, DATED AND SEALED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, WHICH DETAIL AND JUSTIFY THE DEVIATION.
- WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
- PRESSURE TREATED WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.

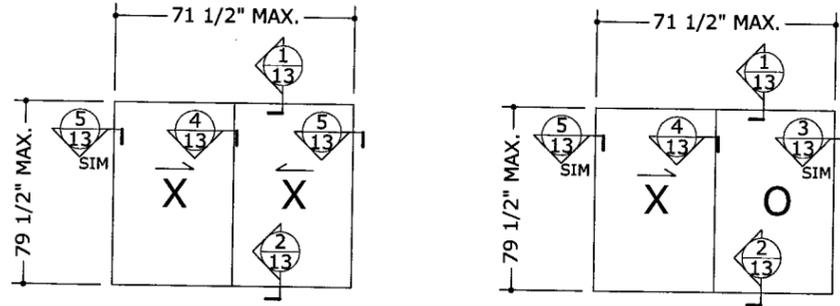

**4**  
**9** N.T.S.


FRANK L. BENNARDO, P.E.  
# PE0046549  
06/07/2010  
**ENGINEERING EXPRESS**  
160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
Ph: (954) 354-0660 Fax: (954) 354-0443  
WWW.ENGEXP.COM  
CERT. OF AUTH #8885  
A. FRANK L. BENNARDO, P.E., INC. INNOVATION

**JELD-WEN**  
355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497 - 1984  
PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE


REMARKS	DRWN	CHKD	DATE
INT ISSUE	KL	FLB	07/10/10
BCCO COMMENTS	KL	FLB	06/03/10

09-JWN-0004  
SCALE: 1/8" = 1'-0"  
PAGE DESCRIPTION:

F:\01 Project Files\Jeld-Wen (JWN)\2009\09-JWN-0004 Premium Atlantic Vinyl 3800 SGD LMI (NOA).dwg 06/07/2010 - 4:10pm keithl

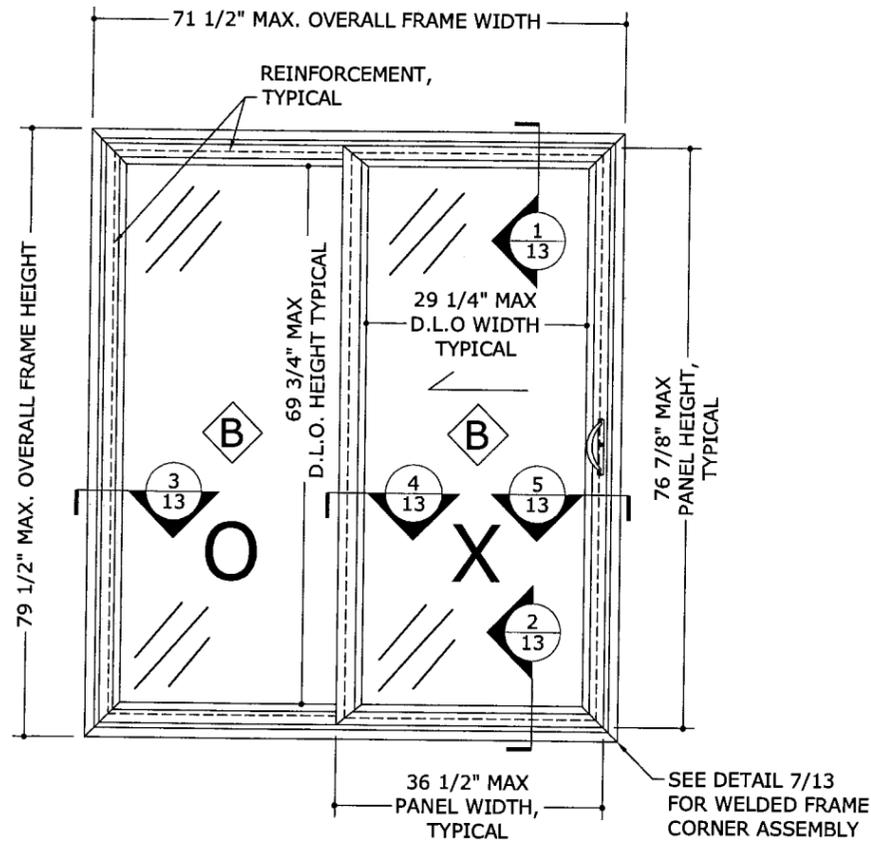

**1**  
**10** N.T.S. EXTERIOR ELEV

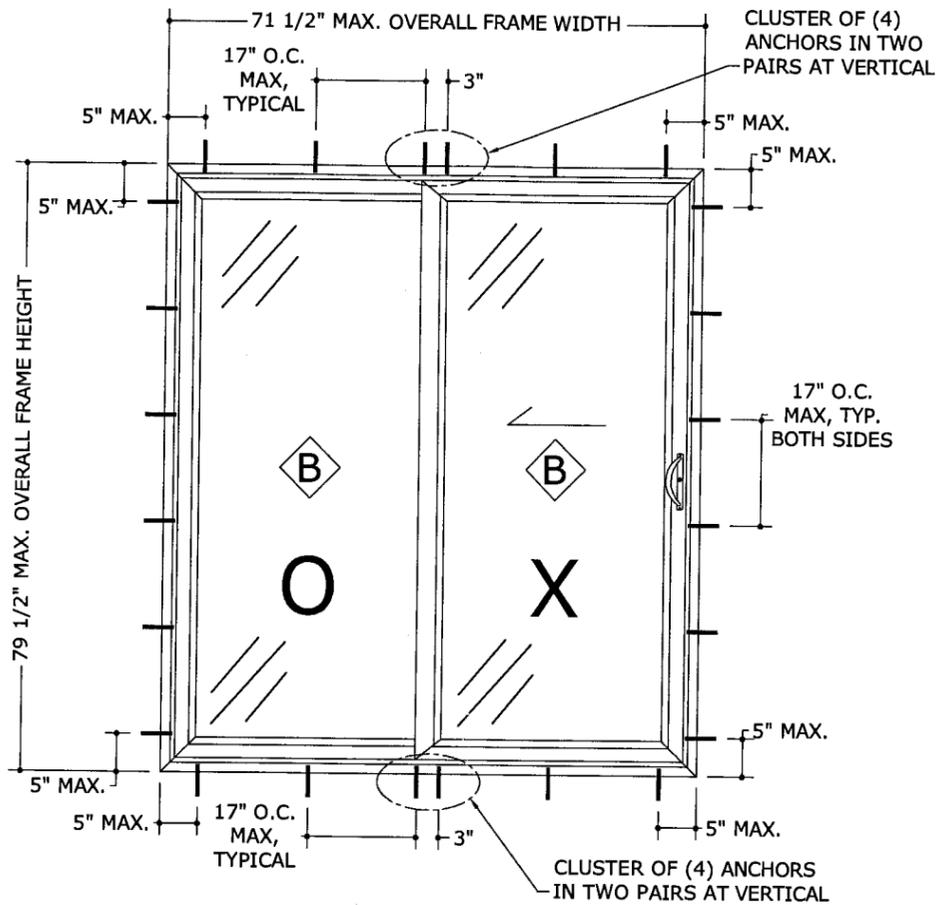


**2**  
**10** N.T.S. EXTERIOR ELEV

**\*ALLOWABLE DESIGN PRESSURES**  
WITH GLAZING TYPE 'B'  
**+65 PSF**  
**-65 PSF**

- \*LIMITATIONS:**
- THIS DOOR TO BE USED FOR RESIDENTIAL DWELLING UNITS AND SLEEPING UNITS ONLY.
  - THIS DOOR CANNOT BE USED AS AN EGRESS EXIT DOOR.

**GLAZING TYPE B**  
1" INSULATED LAMINATED

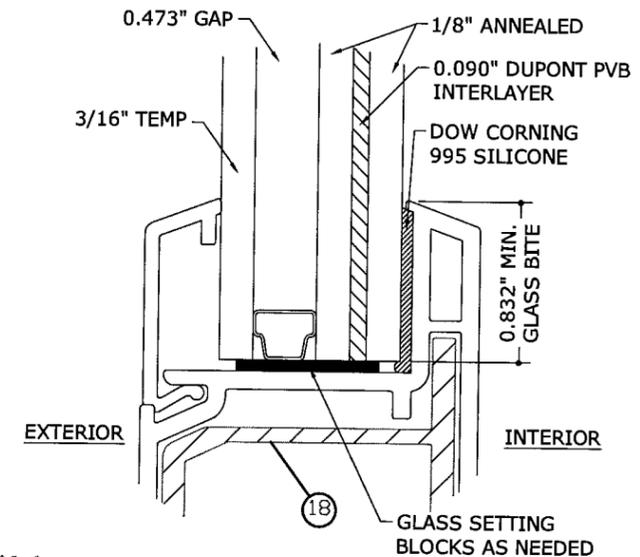

**3**  
**10** N.T.S.


**ANCHOR NOTES:**

- SEE ANCHOR ELEVATION FOR ANCHOR LOCATIONS AND/OR SPACING.
- ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
- ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS TO CONCRETE & TO HOLLOW BLOCK.
- WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
- WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
- ANCHOR REQUIREMENTS AS SHOWN HEREIN, INCLUDING MINIMUM EMBEDMENT AND EDGE DISTANCE, EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN WITHIN THE HVHZ, A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE SHALL BE APPLIED FOR AND SECURED FROM THE MIAMI-DADE BUILDING CODE COMPLIANCE OFFICE PRODUCT CONTROL DIVISION. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN OUTSIDE THE HVHZ, THE BUILDING OFFICIAL MAY REQUIRE A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE BE OBTAINED, OR THAT SITE SPECIFIC DOCUMENTS BE PREPARED, SIGNED, DATED AND SEALED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, WHICH DETAIL AND JUSTIFY THE DEVIATION.
- WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
- PRESSURE TREATED WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.

**ANCHOR SCHEDULE:**

- TO HOLLOW BLOCK OR 3192 PSI MIN CONCRETE HOST STRUCTURE:**
- 1/4" ITW CARBON STEEL TAPCONS THRU 1X OR 2X WOOD BUCKS OR DIRECTLY INTO MASONRY/ CONCRETE WITH 1-1/4" MIN EMBED AND 2-1/2" EDGE DISTANCE.
- TO WOOD BUCK OR HOST STRUCTURE (G=0.55 MIN WOOD):**
- #14 WOOD SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" EDGE DISTANCE.
  - 1/4" LAG SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" EDGE DISTANCE.

Approved as complying with the Florida Building Code  
Date AUGUST 4, 2010  
NOA# 10-0300-04  
Miami Dade Product Control Division  
By Blag I. Chande

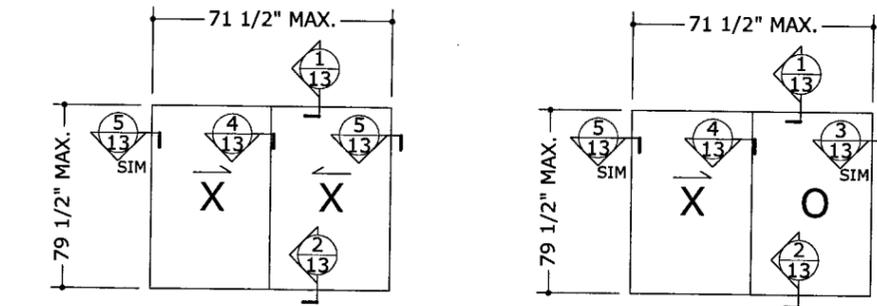

**4**  
**10** N.T.S.

FRANK L. BENNARDO, P.E.  
#PE0046549  
**06/07/2010**  
**ENGINEERING EXPRESS**  
160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
Ph: (954) 354-0660 Fax: (954) 354-0443  
WWW.ENGEXP.COM  
CERT. OF AUTH. #9886  
A FRANK L. BENNARDO, P.E., INC. INNOVATION


**JELD-WEN**  
355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497 - 1984  
PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	07/10/10
BCCO COMMENTS	KL	FLB	06/03/10


**09-JWN-0004**  
SCALE: **10**  
PAGE DESCRIPTION:  
**10**

F:\01 Project Files\Jeld-Wen (JWN)\2009\09-JWN-0004 Premium Atlantic Vinyl 3800 SGD LMI (NOA)\09-JWN-0004 Dtc Premium Atlantic Vinyl 3800 SGD LMI (NOA).dwg


06/07/2010 - 4:10pm keith

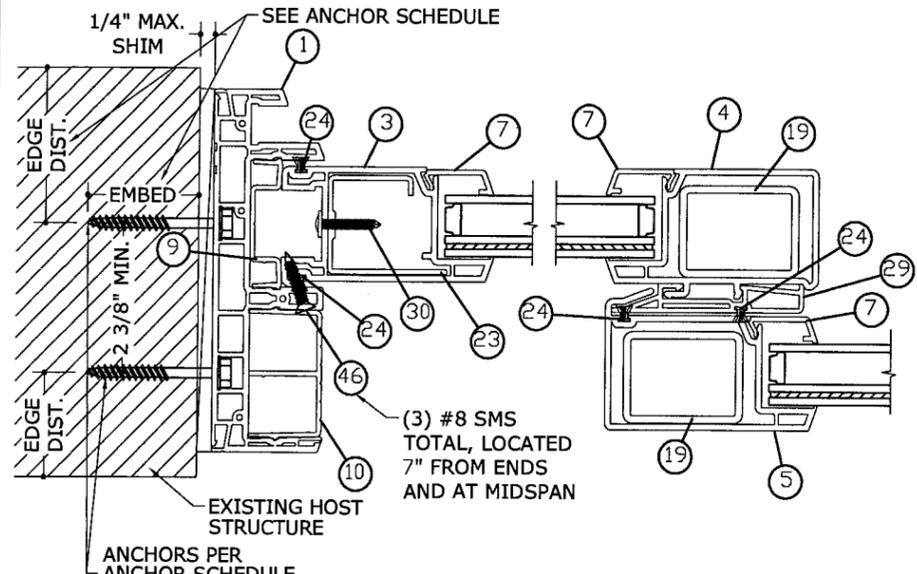


**1** **FIXED LOCK STILE**  
11 4" = 1'-0" HORIZ SECTION

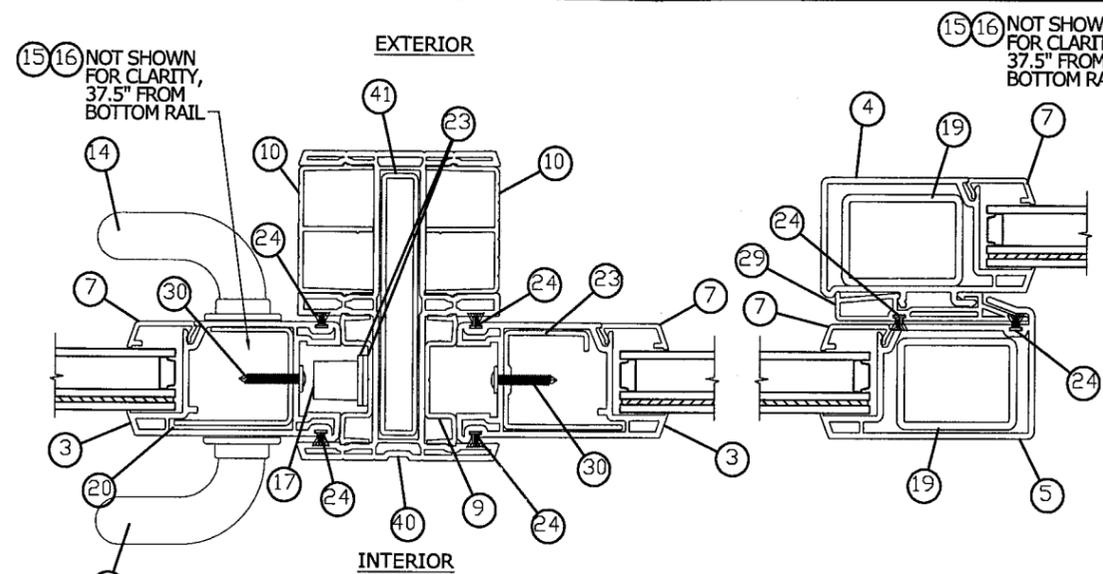


**2** **INTERLOCK**  
11 4" = 1'-0" HORIZ SECTION

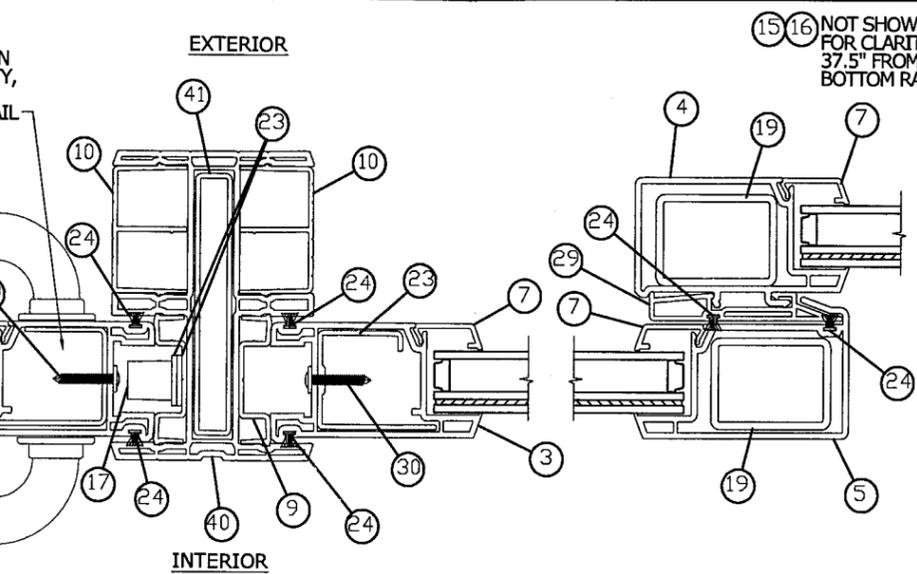


**3** **ASTRAGAL**  
11 4" = 1'-0" HORIZ SECTION

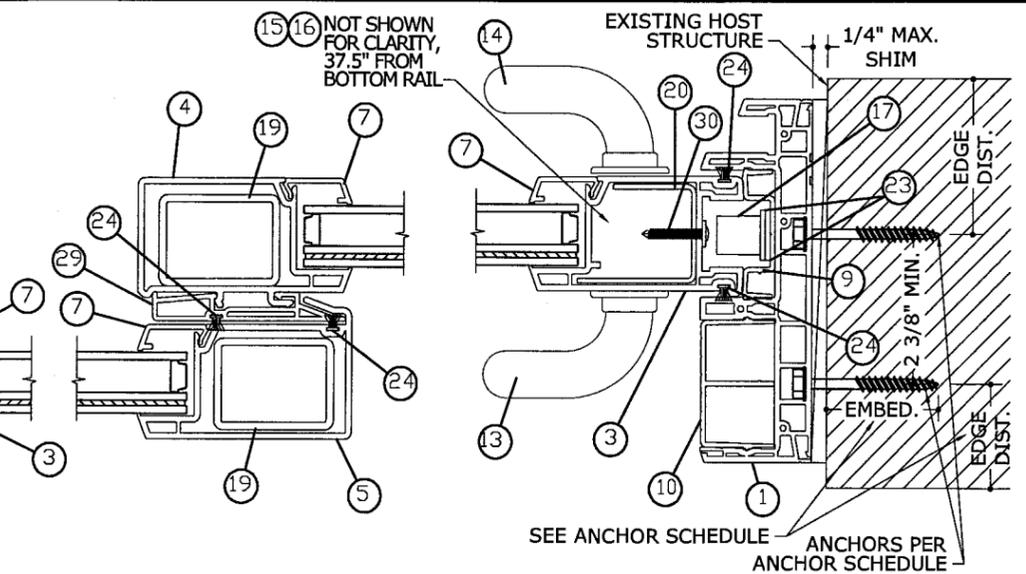


**4** **INTERLOCK**  
11 4" = 1'-0" HORIZ SECTION

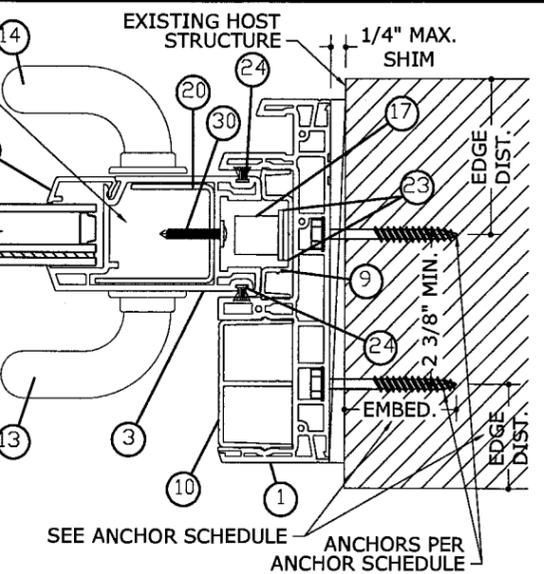

**5** **ACTIVE LOCK STILE**  
11 4" = 1'-0" HORIZ SECTION

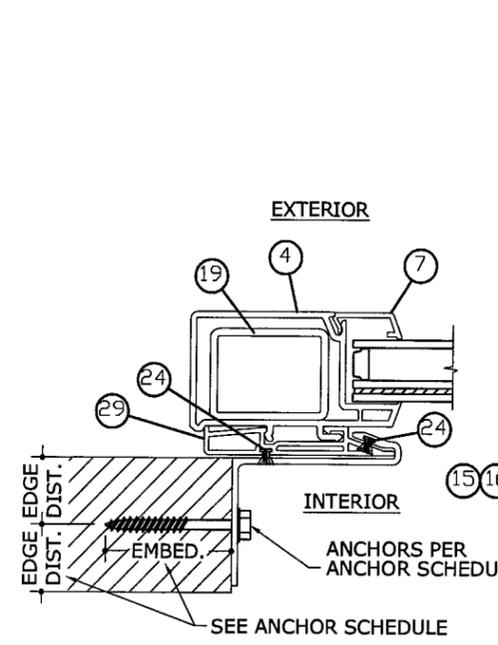


**6** **HOOK STRIP**  
11 4" = 1'-0" HORIZ SECTION

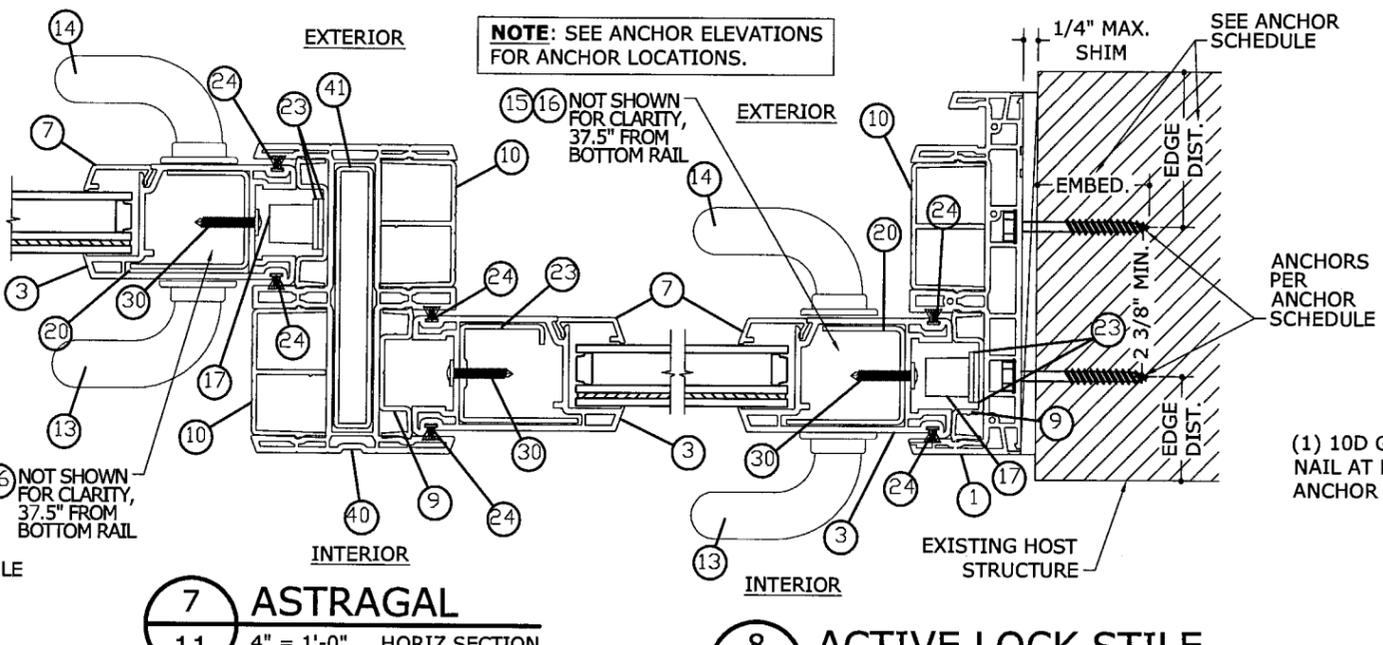


**7** **ASTRAGAL**  
11 4" = 1'-0" HORIZ SECTION

**NOTE:** SEE ANCHOR ELEVATIONS FOR ANCHOR LOCATIONS.

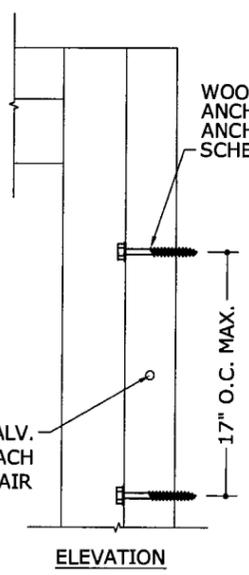

**8** **ACTIVE LOCK STILE**  
11 4" = 1'-0" HORIZ SECTION

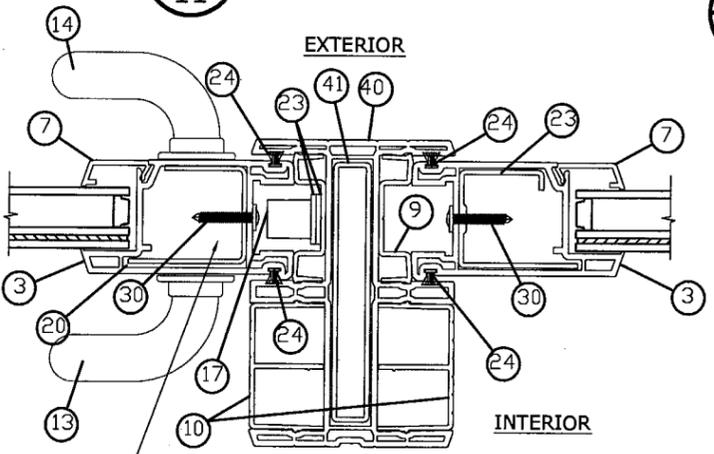

**9** **ALTERNATE ANCHORAGE WITH OPTIONAL NAIL FIN**  
11 4" = 1'-0" ELEV & HORIZ SECTION



**10** **ASTRAGAL**  
11 4" = 1'-0" HORIZ SECTION

NAIL FIN OPTION MAY BE USED WITH HEAD, SILL, OR JAMBS. JAMBS SHOWN HERE.

**NOTE:** NAIL FIN MOUNT IS IN ADDITION TO THE INSTALLATION SCREWS

Approved as complying with the Florida Building Code  
Date **AUGUST 4, 2010**  
NOA# **10-0308-04**  
Miami Dade Product Control Division  
By *(Signature)*

FRANK L. BENNARDO, P.E.  
# PE0046549

06/07/2010

**ENGINEERING EXPRESS**

160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
Ph: (954) 354-0660 Fax: (954) 354-0443  
WWW.ENGGEXP.COM

CERT OF AUTH #9885  
A FRANK L. BENNARDO, P.E., INC. INNOVATION

**JELD-WEN**

355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497-1984

PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE


REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	01/10/10
BCCO COMMENTS	KL	FLB	06/03/10

09-JWN-0004  
SCALE: 1/8" = 1'-0"  
PAGE DESCRIPTION:

11



06/07/2010

**1**  
**12** TYPICAL HEAD DETAIL  
4" = 1'-0" VERT SECTION

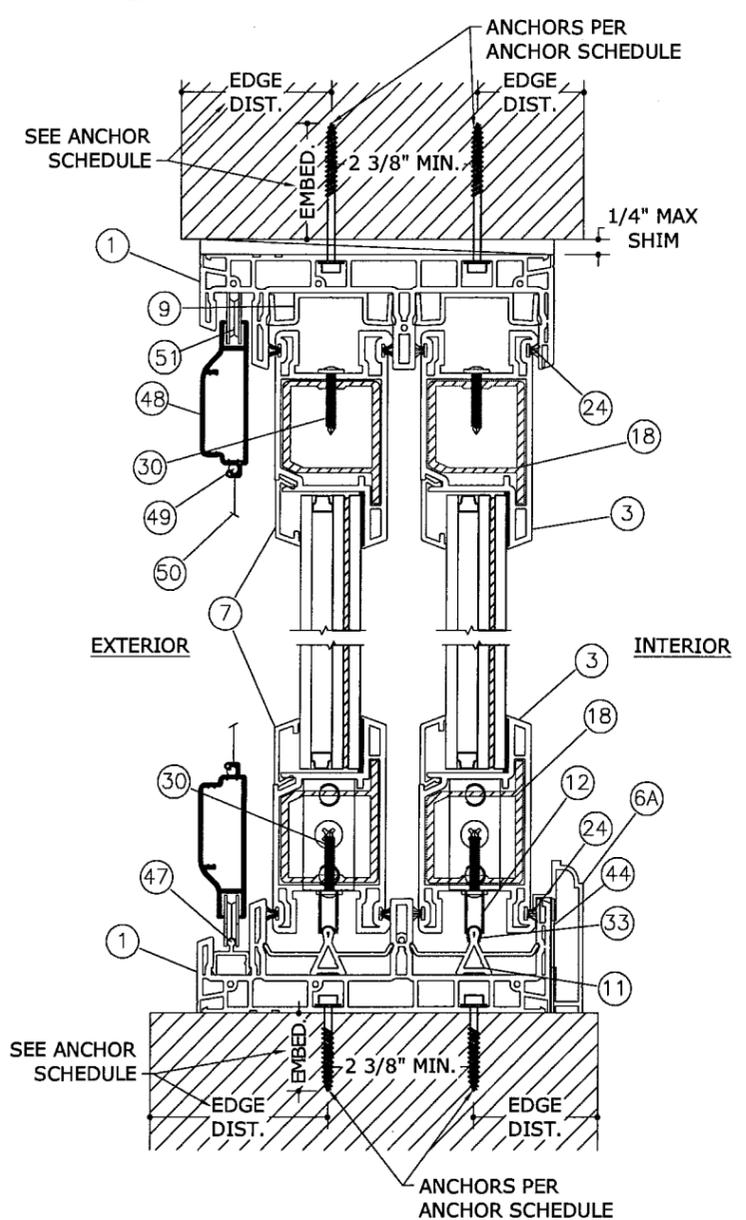



**2**  
**12** MECHANICALLY FASTENED FRAME SILL DETAIL  
4" = 1'-0" VERT SECTION

**3**  
**12** ALTERNATE ANCHORAGE WITH OPTIONAL NAIL FIN  
4" = 1'-0" ELEV

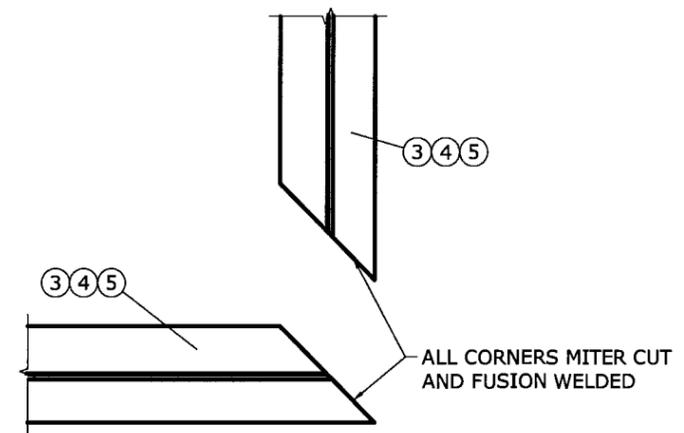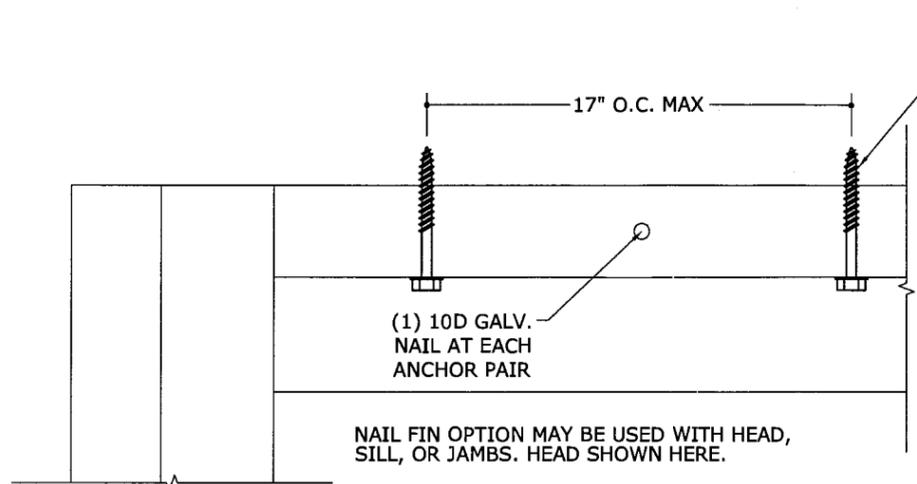

**5**  
**12** TYPICAL PANEL CORNER ASSEMBLY  
N.T.S. ELEV VIEW

**4**  
**12** ALTERNATE ANCHORAGE WITH OPTIONAL NAIL FIN  
4" = 1'-0" HORIZ SECTION

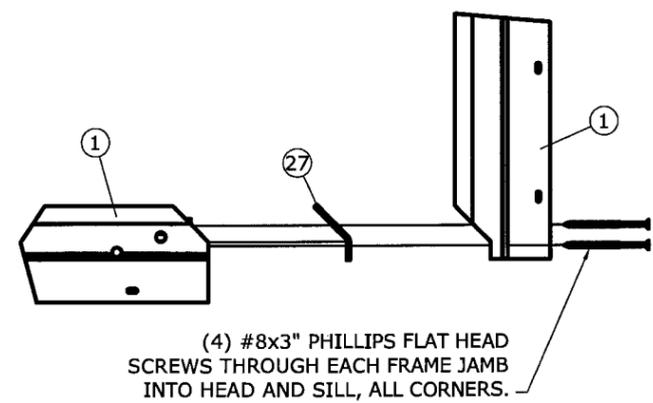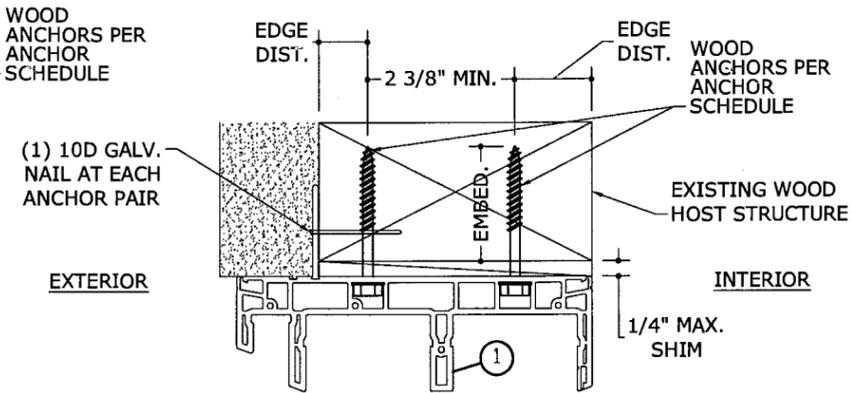

**6**  
**12** TYPICAL MECHANICALLY FASTENED FRAME CORNER ASSEMBLY  
N.T.S. ELEV VIEW

Approved as complying with the  
Florida Building Code  
Date August 4, 2010  
NOAH 10-0308-04  
Miami Dade Product Control  
Division  
By Keith L. L...

**ENGINEERING EXPRESS**  
160 SW 12th Avenue, #106  
Deerfield Beach, FL 33442  
Ph: (954) 354-0660 Fax: (954) 354-0443  
WWW.ENGEXP.COM  
CERT OF AUTH #9885  
A FRANK L. BENNARDO, P.E., INC. INNOVATION

**JELDOWEN**  
355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497 - 1984  
PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE	DRWN	CHKD
INIT ISSUE	01/10/10	KL	FLB
BCCO COMMENTS	06/03/10	KL	FLB

09-JWN-0004  
SCALE: 1/01  
PAGE DESCRIPTION:

F:\01 Project Files\Jeldowen (JWN)\2009\09-JWN-0004 Premium Atlantic Vinyl 3800 SGD LMI (NOA).dwg 06/07/2010 - 4:11pm keithl

06/07/2010

**ENGINEERING EXPRESS**  
160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
Ph: (954) 354-0660 Fax: (954) 354-0443  
WWW.ENGGEXP.COM  
CERT OF AUTH #9885  
A FRANK L. BENNARDO, P.E., INC. INNOVATION

**JELD-WEN**  
355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497-1984  
PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

DRWN	CHKD	DATE
KL	FLB	01/10/10
KL	FLB	06/03/10


  

REMARKS	INIT	ISSUE	DATE
BCCO COMMENTS	KL	FLB	06/03/10



09-JWN-0004  
SCALE: 1/8" = 1'-0"  
PAGE DESCRIPTION: 01

Approved as complying with the Florida Building Code  
Date AUGUST 4, 2010  
NOA# 10-0308-04  
Miami Dade Product Control Division  
By Iskag L. Chaudhry


**1 WELDED FRAME HEAD DETAIL**  
13 4" = 1'-0" VERT SECTION

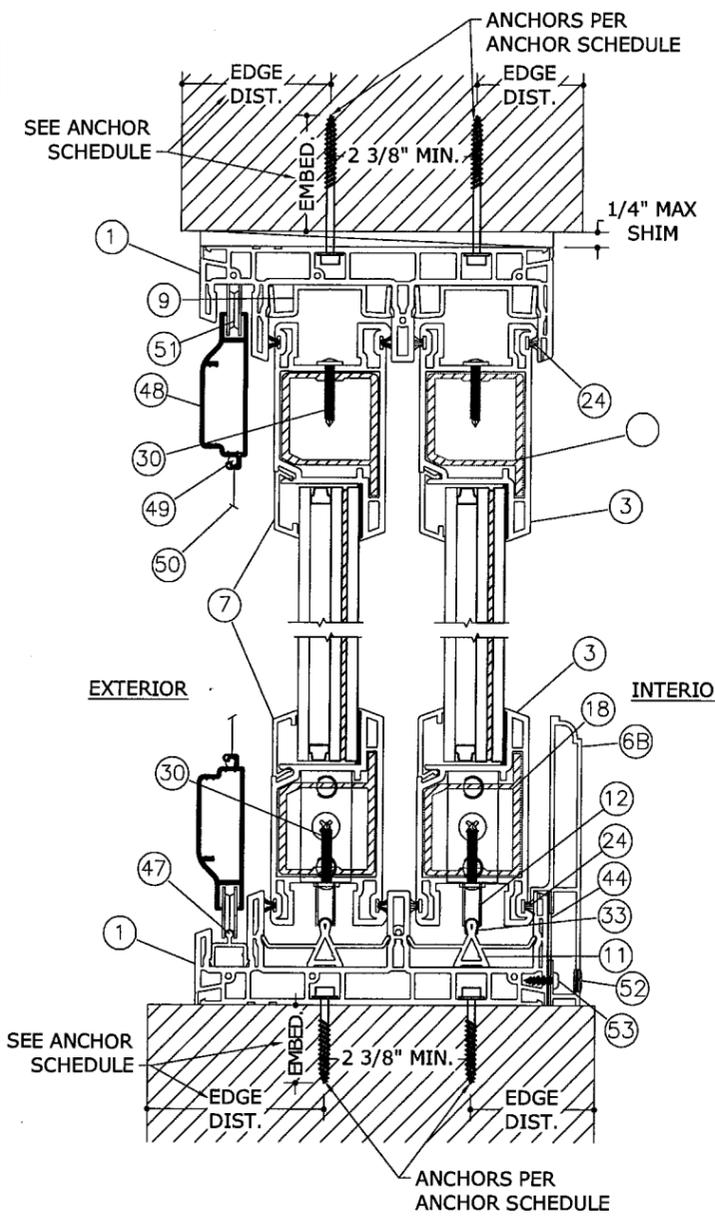


**2 WELDED FRAME SILL DETAIL**  
13 4" = 1'-0" VERT SECTION

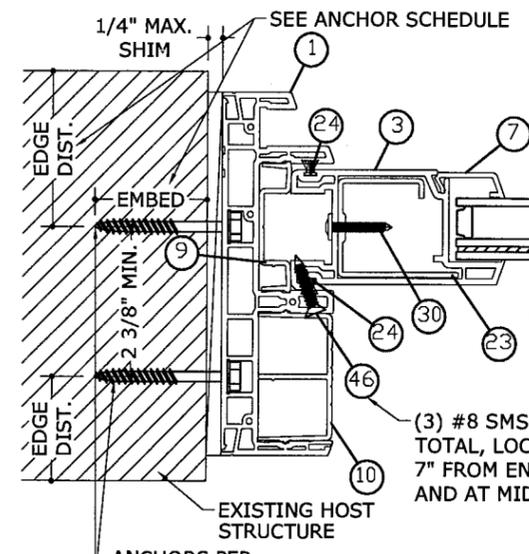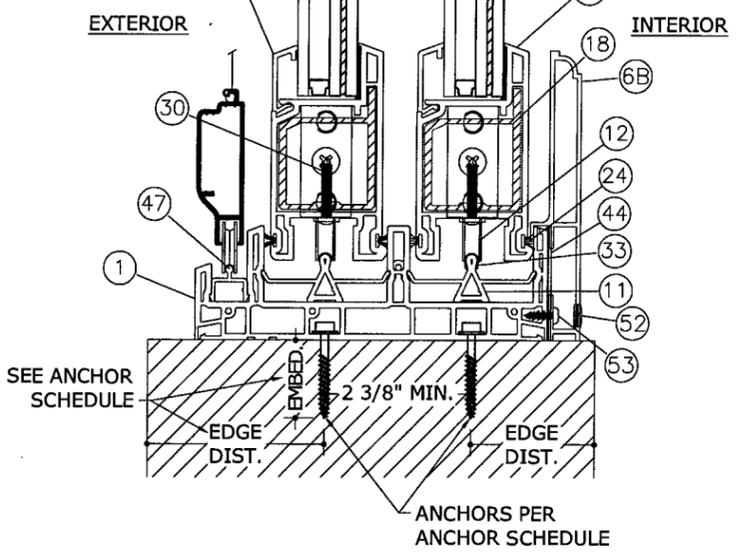


**3 FIXED LOCK STILE**  
13 4" = 1'-0" HORIZ SECTION

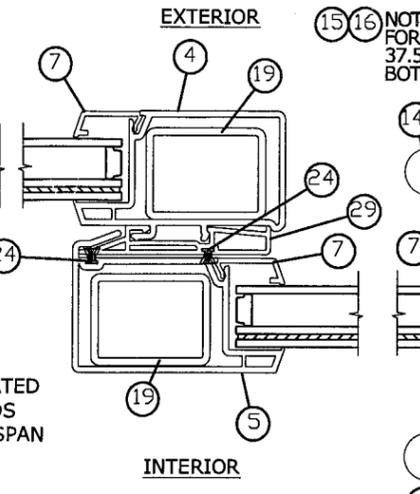

**4 INTERLOCK**  
13 4" = 1'-0" HORIZ SECTION

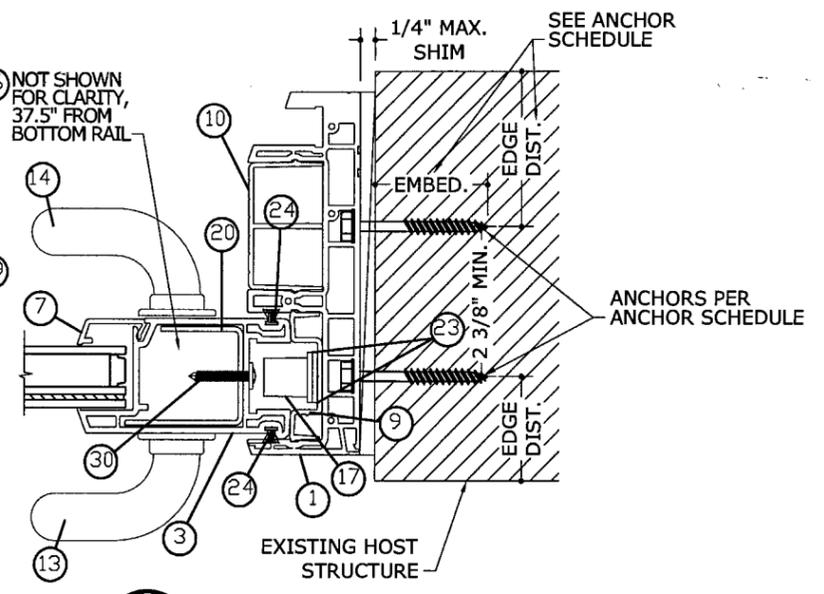


**5 ACTIVE LOCK STILE**  
13 4" = 1'-0" HORIZ SECTION

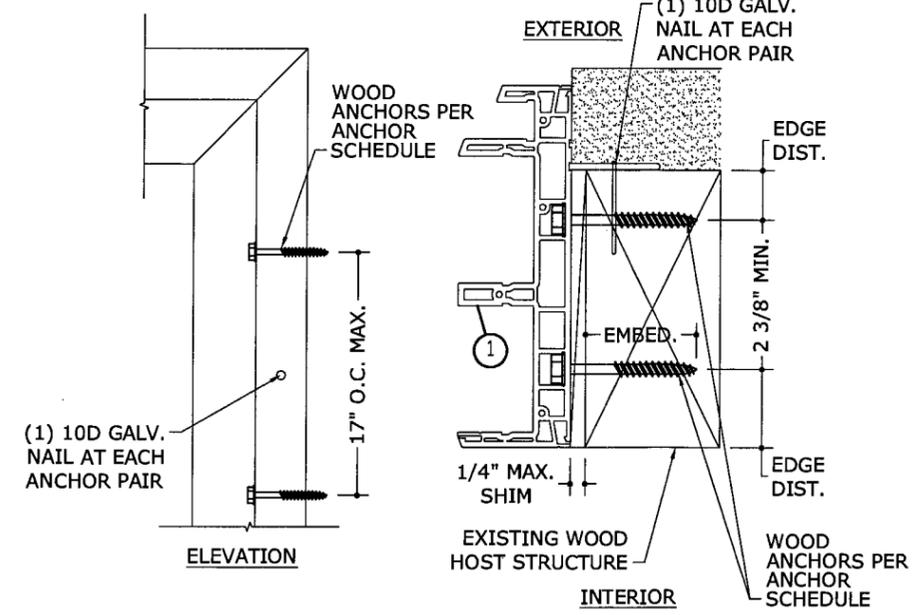

**6 ALTERNATE ANCHORAGE WITH OPTIONAL NAIL FIN**  
13 4" = 1'-0" ELEV & HORIZ SECTION

NAIL FIN OPTION MAY BE USED WITH HEAD, SILL, OR JAMBS. JAMBS SHOWN HERE.

NOTE: NAIL FIN MOUNT IS IN ADDITION TO THE INSTALLATION SCREWS

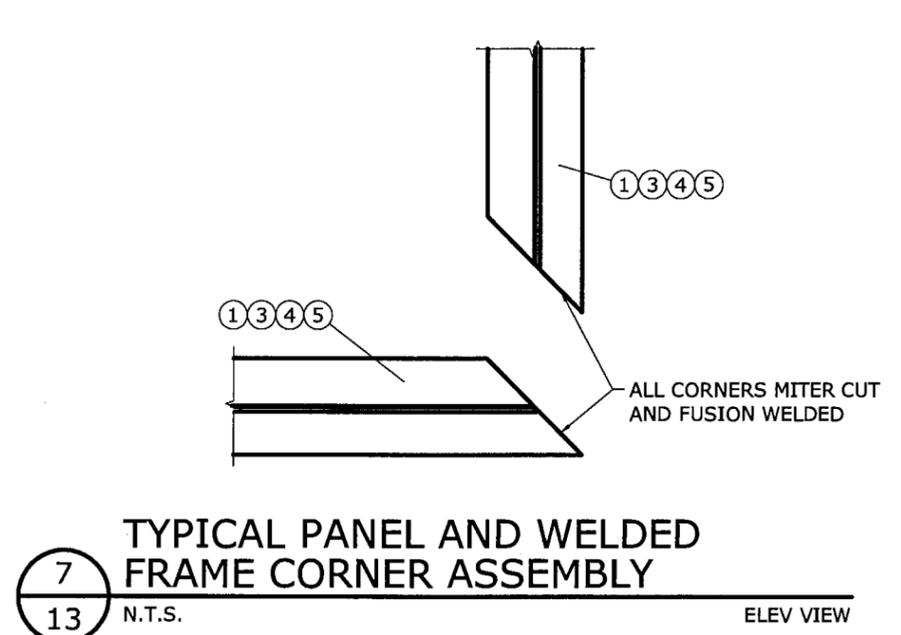


**7 TYPICAL PANEL AND WELDED FRAME CORNER ASSEMBLY**  
13 N.T.S. ELEV VIEW


Approved as complying with the Florida Building Code  
Date AUGUST 4, 2010  
NOA# 10-0308-04  
Miami Dade Product Control Division  
By Iskag L. Chaudhry

F:\01 Project Files\Jeld-Wen (JWN)\200909-JWN-0004 Premium Atlantic Vinyl 3800 SGD LMI (NOA)\09-JWN-0004\_01c Premium Atlantic Vinyl 3800 SGD LMI (NOA).dwg  
06/07/2010 - 4:11pm keithl


06/07/2010 - 4:11pm keith F:\01 Project Files\Jeld-Wen (JWN)\2009\09-JWN-0004 Premium Atlantic Vinyl 3800 SGD LMI (NOA)\09-JWN-0004 01c Premium Atlantic Vinyl 3800 SGD LMI (NOA).dwg

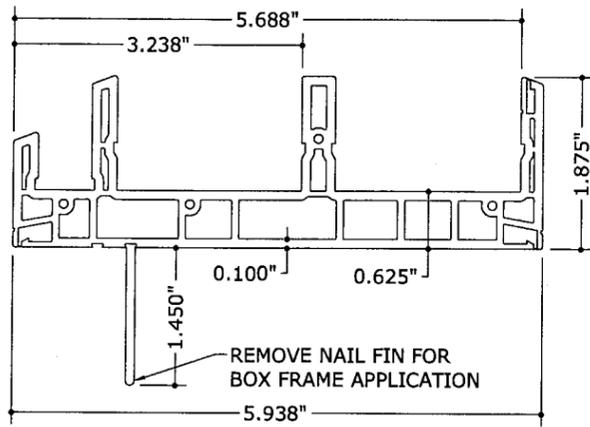


**1 MAIN FRAME**  
6" = 1'-0" PVC

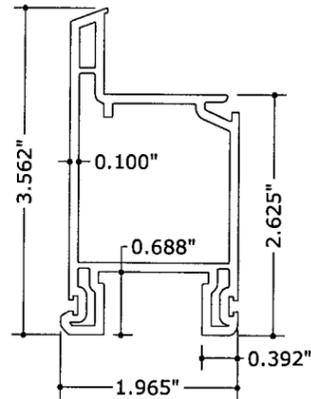


**3 PANEL STILE/RAIL**  
6" = 1'-0" PVC

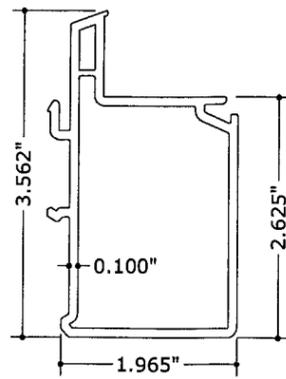


**4 FIXED PANEL INTERLOCK**  
6" = 1'-0" PVC

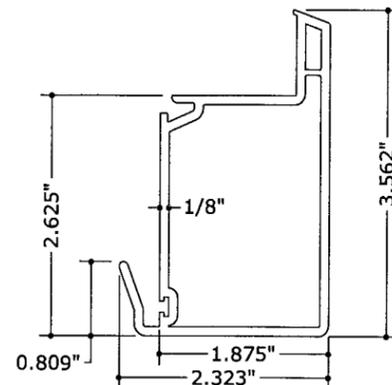


**5 PANEL INTERLOCK**  
6" = 1'-0" PVC

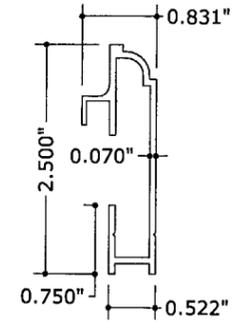


**6A SILL RISER**  
6" = 1'-0" 6063-T6 ALUM.

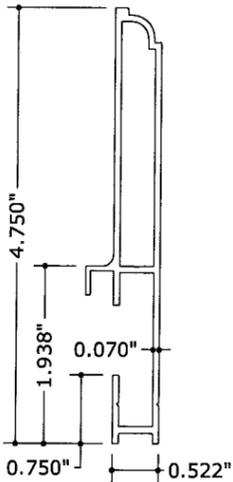


**6B SILL RISER**  
6" = 1'-0" 6063-T6 ALUM.

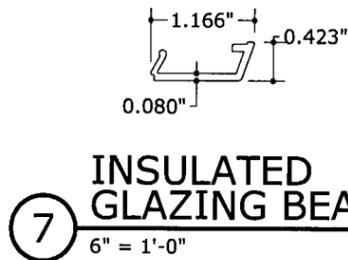


**7 INSULATED GLAZING BEAD**  
6" = 1'-0" PVC

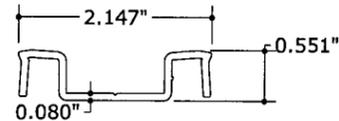


**9 ANTI-LIFT BLOCK**  
6" = 1'-0" PVC

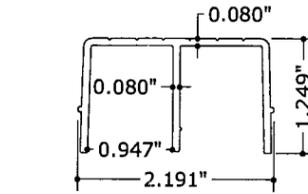


**10 FILLER STRIP**  
6" = 1'-0" PVC

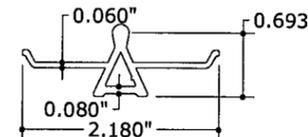


**11 ROLLER TRACK**  
6" = 1'-0" PVC




**18 RAIL REINFORCEMENT**  
6" = 1'-0" 6063-T6 ALUM.




**19 INTERLOCK REINFORCEMENT**  
6" = 1'-0" GALV. STEEL




**20 LOCK STILE REINFORCEMENT**  
6" = 1'-0" GALV. STEEL




**23 FIXED STILE REINFORCEMENT**  
6" = 1'-0" 6063-T6 ALUM.

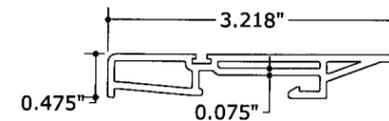


**29 INTERLOCK FILLER**  
6" = 1'-0" PVC

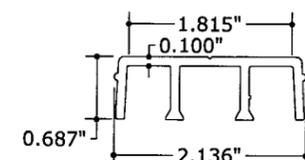


**38 RISER BLOCK**  
6" = 1'-0" PVC

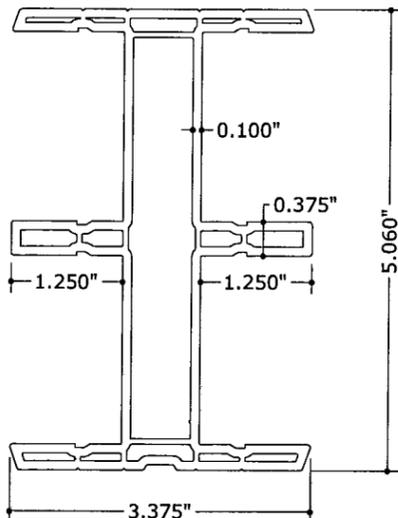

**40 ASTRAGAL**  
6" = 1'-0" PVC

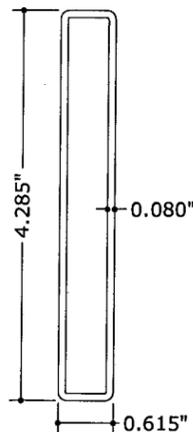


**41 ASTRAGAL REINFORCEMENT**  
6" = 1'-0" 6063-T5 ALUM.

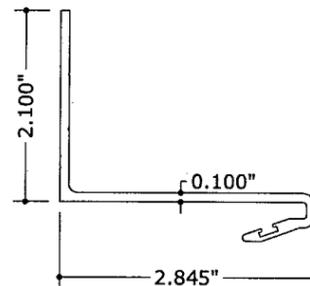


**45 HOOK STRIP**  
6" = 1'-0" 6063-T6 ALUM.


Approved as complying with the Florida Building Code  
Date AUGUST 4, 2010  
NOA# 10-0308-04  
Miami Dade Product Control Division  
By Frank L. Bennardo

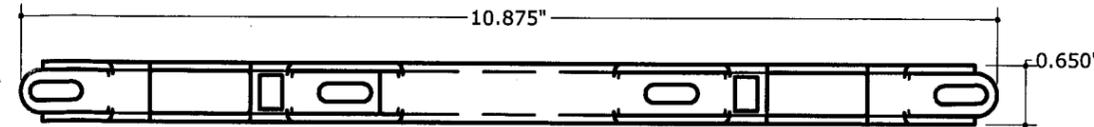

**17 KEEPER**  
6" = 1'-0" STAINLESS STEEL



**47 SCREEN TRACK**  
6" = 1'-0" PVC

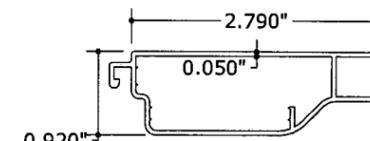

**48 SCREEN FRAME**  
6" = 1'-0" 6063-T6 ALUM.

FRANK L. BENNARDO, P.E.  
#PE0046549

06/07/2010

**JELD-WEN**  
ENGINEERING EXPRESS®

160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
Ph: (954) 354-0660 Fax: (954) 354-0443  
WWW.ENGEXP.COM  
CERT OF AUTH #6885  
A FRANK L. BENNARDO, P.E., INC. INNOVATION

**JELD-WEN**  
355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497 - 1984

PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE	DRWN	CHKD
INIT ISSUE	01/10/10	KL	FLB
BCCO COMMENTS	06/03/10	KL	FLB

09-JWN-0004

SCALE: 01

PAGE DESCRIPTION:

F:\01 Project Files\Jeld-Wen (JWN)\2009-09-JWN-0004 Premium Atlantic Vinyl 3800 SGD LMI (NOA)\09-JWN-0004\_01c-Premium Atlantic Vinyl 3800 SGD LMI (NOA).dwg

keithl

06/07/2010 - 4:11pm

### BILL OF MATERIALS

NO.	PART NO.	DESCRIPTION	VENDOR
1	01882	MAIN FRAME (8594/8591)	WHITE PVC MIKRON
2	01011	WELD SUPPORT (8738)	WHITE PVC MIKRON
3	01867	PANEL STILE/ RAIL (7701)	WHITE PVC MIKRON
4	01868	FIXED INTERLOCK STILE (7702)	WHITE PVC MIKRON
5	01869	PANEL INTERLOCK STILE (7703)	WHITE PVC MIKRON
6A	03621	2.50" SILL RISER 6063-T6 (11080)	EXTRUDERS
6B	02448	4.75" SILL RISER 6063-T6 (GAH-49113)	INDALEX
7	01872	1" INSULATING GLAZING BEAD (7706)	WHITE PVC MIKRON
8	01372	1.00" x 2.50" x 0.75" DUST PAD	ULTRA FAB
9	01874	ANTI LIFT BLOCK / SPACER (7708)	WHITE PVC MIKRON
10	01895	THRESHOLD FILLER STRIP (7709)	WHITE PVC MIKRON
11	01871	ROLLER TRACK (7705)	WHITE PVC MIKRON
12	03465	ROLLER HOUSING ASSEMBLY	AMSBURY
13	04769	INSIDE HANDLE	AMSBURY
14	04769	OUTSIDE HANDLE	AMSBURY
15	04769	THUMB TURN MORTISE LOCK	AMSBURY
16	02499	DUAL POINT LOCK	AMSBURY
17	02501	KEEPER / STRIKE	AMSBURY
18	00656	TOP & BOTTOM RAIL REINFORCEMENT 6063-T5 (7701.1.1)	EXTRUDERS
19	02009	ACTIVE & FIXED INTERLOCK REINFORCING STEEL (7703.2.1)	ALRO
20	02012	LOCK STILE REINFORCING GALV STEEL (7701.2.1)	ALRO
21	02009	FIXED LOCK STILE REINFORCING GALV STEEL (7701.1)	ALRO
22	00234	#8 x 1.00" WH STS (REINFORCEMENT) SCREW	MERCHANTS
23	00655	LOCK STILE REINFORCING 6063-T6 (7701.2.1)	EXTRUDERS
24	01093	BRUSH TYPE WEATHERSTRIPPING	ULTRA FAB
25		STAINLESS STEEL (CARDINAL) SPACER	CARDINAL
26		EDGE TECH SUPERSPACER	EDGE TECH
27	03307	MAIN FRAME OPEN CELL FOAM GASKET (38GASK)	FRANK LOWE
28	00095	DOW CORNING 995 SEALANT	DOW
29	01870	INTERLOCK (7704)	WHITE PVC MIKRON
30	01929	#8 X 1" WASHER HEAD STS FASTENER	MERCHANTS
31		#14 WOOD SCREW W/MIN 1-1/2" THREAD PENETRATION	
32		1/4" DIA. ITW TAPCON W/ MIN. 1 1/4" EMBEDMENT	
33	01789	STAINLESS STEEL TRACK COVER	ALL-METAL
33	--	STAINLESS STEEL TRACK COVER	JOHNSON
34	00249	#8 x 3.00" PFH SMS FASTENER	MERCHANTS
35	00242	#8 x 1.375" PFH SMS (KEEPER)	MERCHANTS
36	00233	#14 x .50" PFH UNDERCUT (WHEEL ASSEMBLY)	MERCHANTS
37	01372	1.00"x2.50"x.75" DUST PAD	ULTRA FAB
38		RISER BLOCK	WHITE PVC MIKRON
39	0----	TRIM PLATE (2817-84)	AMSBURY
40	01876	ASTRAGAL (7964)	WHITE PVC MIKRON
41	01831	ASTRAGAL REINFORCEMENT ALUMINUM 6063-T6 (7964.1.1)	EXTRUDERS
42		1" INSUL. GLASS, LAMINATED BY CARDINAL	
43	00893	GLAZING BLOCK	FRANK LOWE
44	04763	SILL RISER GASKET	FRANK LOWE
45	04987	HOOK STRIP - ALUMINUM 6063-T6 (D-13978)	EXTRUDERS
46	00242	#8 x 1.375" PFH SMS CR FASTENER (FIXED PANEL)	MERCHANTS
47	01866	SCREEN TRACK (7556)	WHITE PVC MIKRON
48		SCREEN FRAME	
49		SCREEN SPLINE	
50		SCREEN MESH	
51		SCREEN ROLLER	
52	01975	3/8" HOLE PLUG	RO-MAI
53	02495	#8 x 3/8" PPH S/S	MERCHANTS

**NOTE:** RIGID WHITE PVC BY MIKRON IS UNDER SEPARATE CURRENT MIAMI-DADE NOTICE OF ACCEPTANCE (NOA).  
 WHITE PVC EXTRUSIONS SHALL BE LABELED WITH AAMA EXTRUDER CODE, EXTRUDER NAME, CITY, STATE & "MIAMI-DADE COUNTY APPROVED".

FRANK L. BENNARDO, P.E.  
# PE0046549

06/07/2010

**ENGINEERING EXPRESS**

160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
Ph: (954) 354-0660 Fax: (954) 354-0443  
WWW.ENGEXP.COM

CERT OF AUTH #9885  
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN

355 CENTER COURT  
VENICE, FL 34285  
PHONE: (941) 497 - 1984

PREMIUM ATLANTIC VINYL (3800) SLIDING PATIO DOOR  
LARGE MISSILE IMPACT RESISTANT  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN		CHKD		DATE	
	KL	FLB	KL	FLB	01/10/10	06/03/10
INIT ISSUE						
BCCO COMMENTS						

09-JWN-0004

SCALE: 01

PAGE DESCRIPTION:

15

Approved as complying with the  
Florida Building Code  
Date AUGUST 4, 2010  
NOA# 10-0308.04  
Miami Dade Product Control  
Division  
By Shaq. Chanda