



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1107
MIAMI, FLORIDA 33130-1563
(305) 375-2902 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Eurotech Industries, Inc.
4201 NE 12 Terrace
Fort Lauderdale, FL 33334

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Tradewind w/ Single Hung Window" 8'0" Outswing Glazed Aluminum Entrance Door - L.M.I.

APPROVAL DOCUMENT: Drawing No. **W10-06**, titled "Series Tradewind Alum. Outswing Ent. Door (L.M.I.)", sheets 1 through 6 of 6, dated 02/17/10 with revision "A" dated 05/03/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

REVISION of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.


TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA No. 09-0310.05** and consists of this page 1, evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J-Gascon
5/26/10

NOA No. 10-0322.13
Expiration Date: June 10, 2014
Approval Date: June 16, 2010


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W10-06**, titled "Series Tradewind Alum. Outswing Ent. Door (L.M.I.)", sheets 1 through 6 of 6, dated 02/17/10 with revision "A" dated 05/03/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of aluminum outswing door, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-10-3004, HETI-10-3005, HETI-10-3006, HETI-10-3007** and **HETI-09-2563**, all dated 02/11 and 02/12/10, signed and sealed by Candido F. Font, P. E.
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of aluminum outswing door, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-08-2021, HETI-08-2022, HETI-08-2023** and **HETI-08-2024**, all dated 03/15/08, signed and sealed by Candido F. Font, P. E.
(Submitted under previous NOA No.08 -0507.10)
- 7) Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
7) Tensile Test, per FBC, ASTM E8-01
along with marked-up drawings and installation diagram of aluminum outswing door, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-03-1882, HETI-08-1889, HETI-08-1890, HETI-08-2024** and **HETI-04-T100**, all dated 01/15/04 through 02/09/04, all signed and sealed by Rafael E. Droz-Seda, P. E.
(Submitted under previous NOA No.04 -0428.03)



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 10-0322.13
Expiration Date: June 10, 2014
Approval Date: June 16, 2010

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated 05/05/10, signed and sealed by Javad Ahmad, P. E.
Complies with ASTM E1300-98/ 04

D. QUALITY ASSURANCE

1. Miami-Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **09-0312.03** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/13/09, expiring on 01/14/12.
2. Notice of Acceptance No. **09-0312.02** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite® PVB, Interlayer**" dated 05/13/09, expiring on 12/11/10.
3. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "**Saflex IIIG Clear or colored interlayer**" dated 05/04/06, expiring on 05/21/11.

E. STATEMENTS


1. Statement letter of conformance, no financial interest and compliance with the FBC-2007, dated May 04, 2010, signed and sealed by Javad Ahmad, P. E.
2. Laboratory compliance letter for Test Reports No.'s **HETI-10-3004, HETI-10-3005, HETI-10-3006, HETI-10-3007** and **HETI-09-2563**, issued by Hurricane Engineering & Testing, Inc., all dated February 11 and 12, 2010, signed and sealed by Candido F. Font, P. E.
3. Laboratory compliance letter for Test Reports No.'s **HETI-08-2021, HETI-08-2022, HETI-08-2023** and **HETI-08-2024**, issued by Hurricane Engineering & Testing, Inc., all dated March 15, 2008, signed and sealed by Candido F. Font, P. E.
(Submitted under previous NOA No. 08-0507.10)
4. Laboratory compliance letter for Test Reports No.'s **HETI-03-1882, HETI-08-1889, HETI-08-1890, HETI-08-2024** and **HETI-04-T100**, issued by Hurricane Engineering & Testing, Inc., all dated January 15 through February 09, 2004, signed and sealed by Rafael E. Droz-Seda, P. E.
(Submitted under previous NOA No. 04-0428.03)

F. OTHERS

1. Notice of Acceptance No. **09-0310.05**, issued to Eurotech Industries, Inc. for their Series "Aluminum Outswing Entrance Door - LMI", approved on 06/24/09 and expiring on 06/10/14.



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 10-0322.13
Expiration Date: June 10, 2014
Approval Date: June 16, 2010

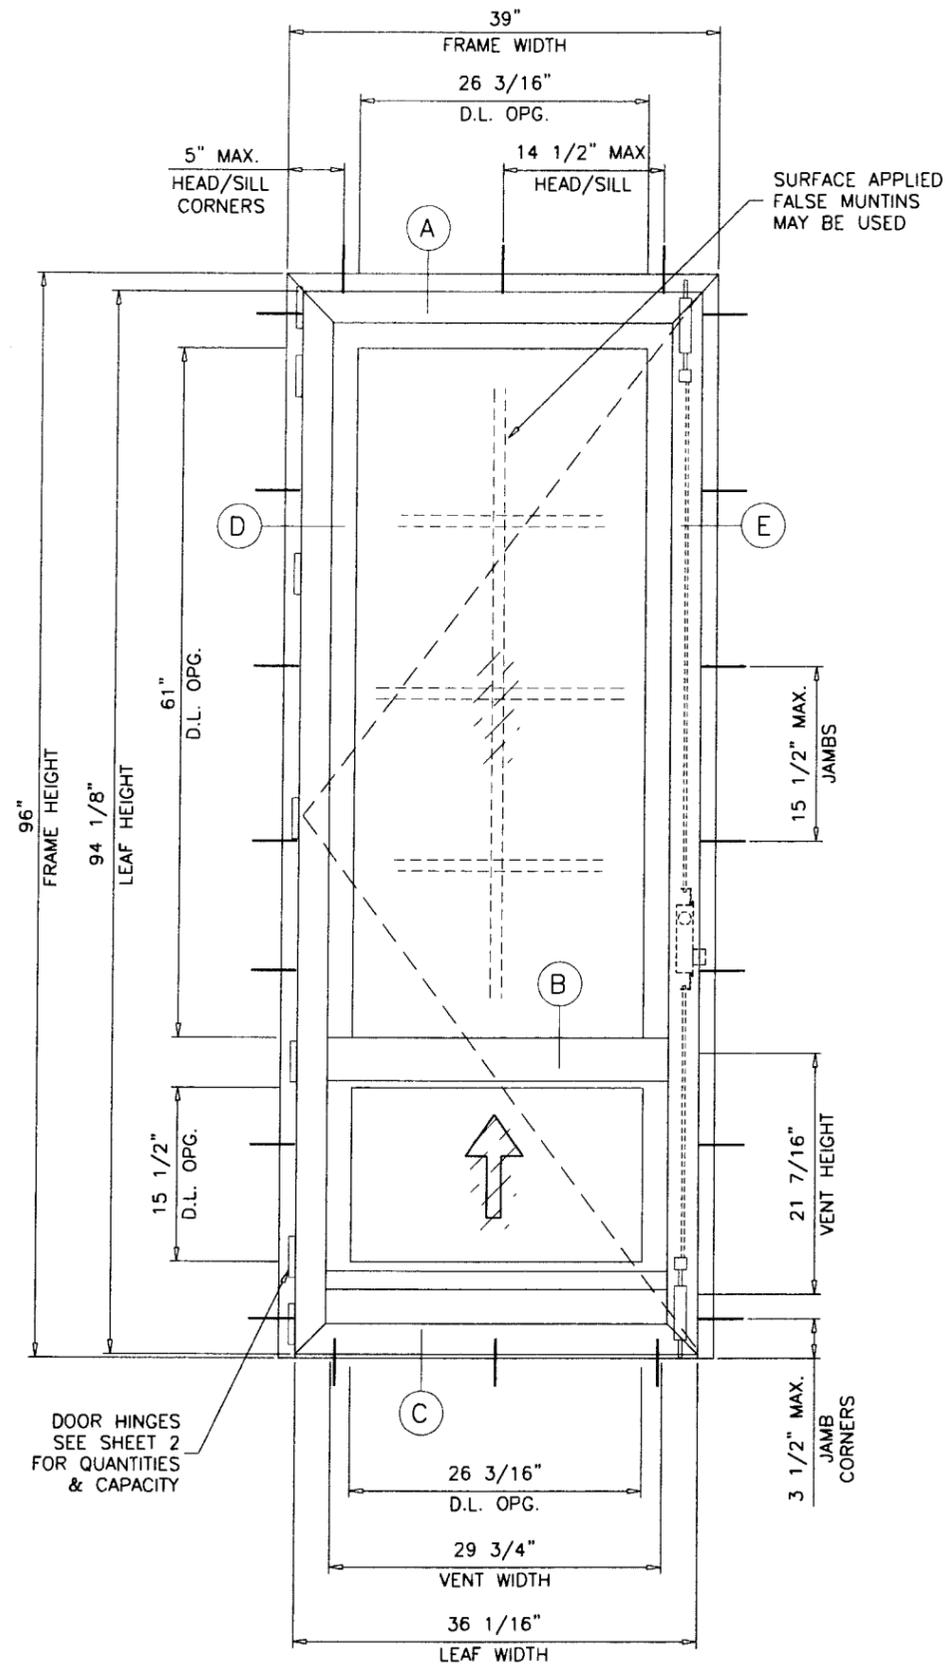

TYPICAL ELEVATION

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

TRADEWIND ALUMINUM OUTSWING ENTRANCE DOOR

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FRENCH DOOR/FRENCH DOOR OR FRENCH DOOR WITH OTHER DOOR TYPES IN MODULES OF TWO OR MORE DOORS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM DOORS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 MAY 05 2010


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 10-0322.13
 Expiration Date 06/13/2014
 By *Javad Ahmad*
 Miami Dade Product Control
 Division

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W10-06EWD

TRADEWIND ALUM OUTSWING ENT. DOOR (L.M.I.)
EUROTECH INDUSTRIES INC.
 4201 N.E. 12TH TERRACE
 FT. LAUDERDALE, FL. 33334
 TEL. (954) 630-9967 FAX. (954) 630-0217

| no | date | by | description |
|----|----------|----|----------------------|
| A | 05.03.10 | | NO CHANGE THIS SHEET |

date: 02-17-10
 scale: 3/4"=1'-0"
 dr. by: HAMID
 chk. by:
 drawing no.
W10-06
 sheet 1 of 6

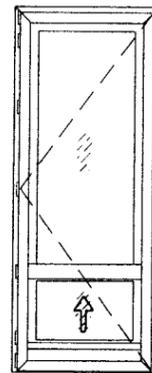

| DESIGN LOAD CAPACITY - PSF | | | |
|----------------------------|--------|----------------------------|----------|
| DOOR SIZE | | GLASS TYPES 'A', 'B' & 'C' | |
| WIDTH | HEIGHT | EXT. (+) | INT. (-) |
| 2/8 | 6/8 | 75.0 | 85.0 |
| 3/0 | | 75.0 | 85.0 |
| 3/3 | | 75.0 | 85.0 |
| 2/8 | 7/0 | 75.0 | 85.0 |
| 3/0 | | 75.0 | 85.0 |
| 3/3 | | 75.0 | 85.0 |
| 2/8 | 8/0 | 75.0 | 85.0 |
| 3/0 | | 75.0 | 85.0 |
| 3/3 | | 75.0 | 85.0 |

DOORS APPROVED FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

| DESIGN LOAD CAPACITY - PSF | | | |
|----------------------------|--------|----------------------------|----------|
| DOOR SIZE | | GLASS TYPES 'A', 'B' & 'C' | |
| WIDTH | HEIGHT | EXT. (+) | INT. (-) |
| 2/8 | 6/8 | 85.0 | 115.0 |
| 3/0 | | 85.0 | 115.0 |
| 3/3 | | 85.0 | 115.0 |
| 2/8 | 7/0 | 85.0 | 115.0 |
| 3/0 | | 85.0 | 115.0 |
| 3/3 | | 85.0 | 115.0 |
| 2/8 | 8/0 | 85.0 | 115.0 |
| 3/0 | | 85.0 | 115.0 |
| 3/3 | | 85.0 | 115.0 |

DOORS APPROVED FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

LOCKS:

3 POINT LOCK SYSTEM AT ACTIVE LOCK STILE 36" FROM BOTTOM, KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR.

STRIKE PLATE
1-1/4" X 1/4" X 16-1/4" LONG
ATTACHED WITH (2) #8 X 3/4" SMS

HINGES:

TWO-HANDED COMB HING
EXTRUDED ALUMINUM BRIDGE 2
BY 'GIESSE'
(5) PER LEAF
AT 6", 12", 35", 63-1/2" AND
92-1/2" FROM TOP OF DOOR

LOCKS:

MANUALLY OPERATED CONCEALED FLUSH BOLTS AT TOP AND BOTTOM OF LEAF PART #02181 ATTACHED WITH (4) #10 X 1-1/2" SMS.


3 POINT LOCK SYSTEM AT LOCK STILE 36" FROM BOTTOM, KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR.

STRIKE PLATE
1-1/4" X 1/4" X 16-1/4" LONG
ATTACHED WITH (2) #8 X 3/4" SMS


HINGES:

TWO-HANDED COMB HING
EXTRUDED ALUMINUM BRIDGE 2
BY 'GIESSE'
(7) PER LEAF AT 7/0 AND 8/0 DOORS
AT 3", 9" AND 26-3/8" FROM
TOP AND BOTTOM, ONE AT MIDSPAN
(6) PER LEAF AT 6/8 DOORS
AT 3", 9" AND 26-3/8" FROM
TOP AND BOTTOM


NOTE: TOP AND BOTTOM FLUSH BOLTS MUST BE ENGAGED DURING PERIODS OF HURRICANE WARNING.

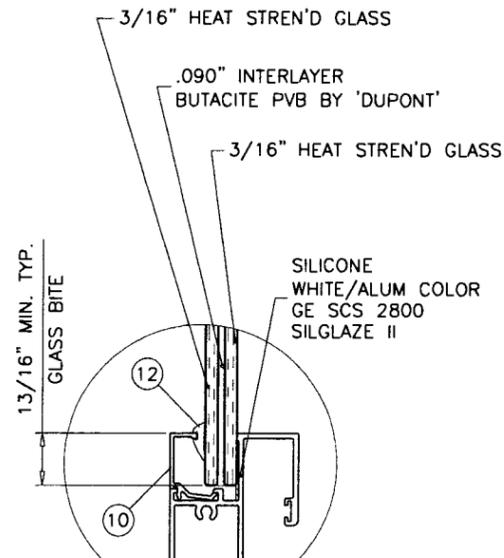

GLASS TYPE 'A'

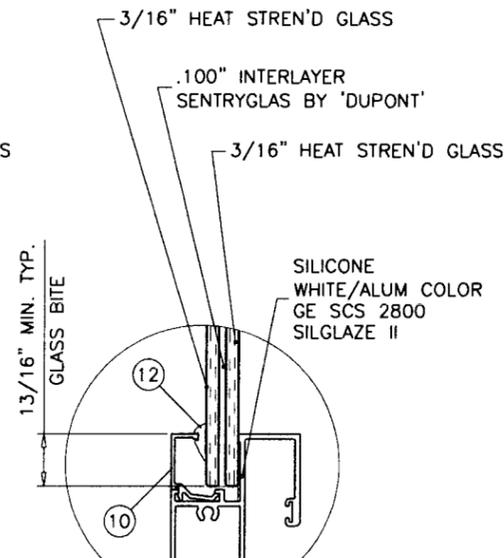

GLASS TYPE 'B'

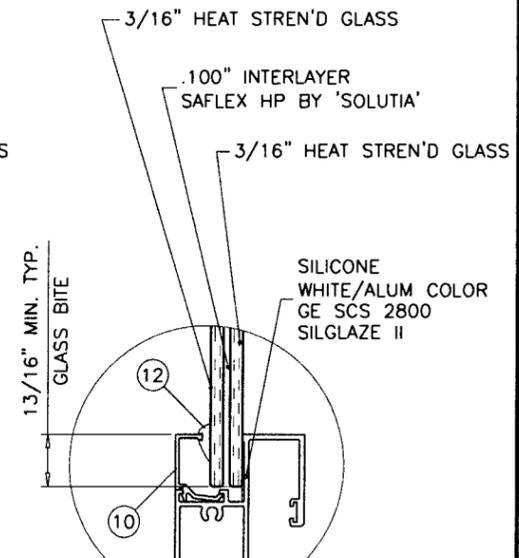

GLASS TYPE 'C'

GLAZING OPTIONS

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

J.A.
MAY 05 2010

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-0322.13
Expiration Date 06/10/2014
By *Javad Ahmad*
Miami Trade Product Control
Division






af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP - ANL W10 - 06EWD

TRADEWIND ALUM OUTSWING ENT. DOOR (L.M.I.)
EUROTECH INDUSTRIES INC.
4201 N.E. 12TH TERRACE
FT. LAUDERDALE, FL. 33334
TEL. (954) 630-9967 FAX. (954) 630-0217

| no | date | description | REV. PER BCCO COMMENTS |
|----|----------|-------------|------------------------|
| A | 05.03.10 | | |

date: 02-17-10
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W10-06
sheet 2 of 6

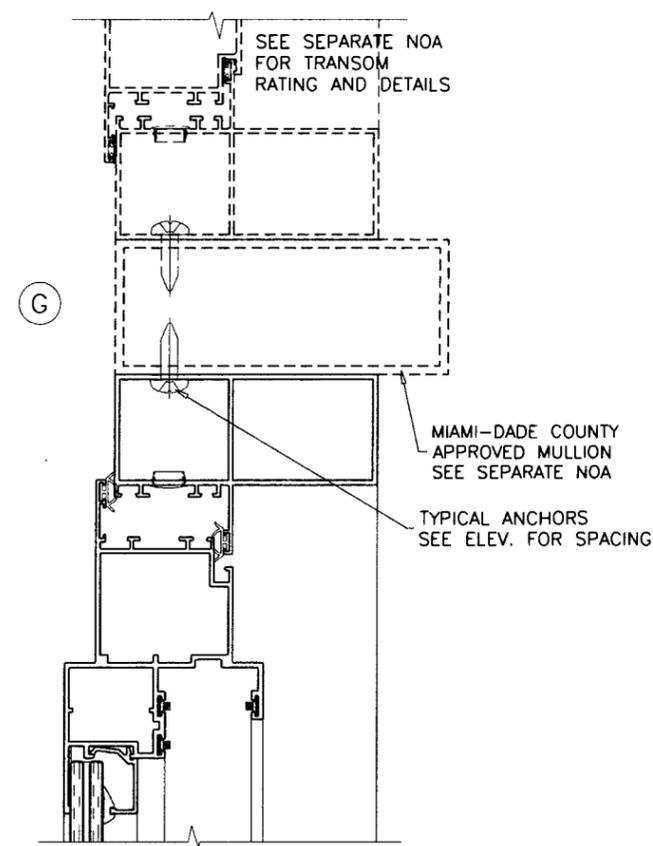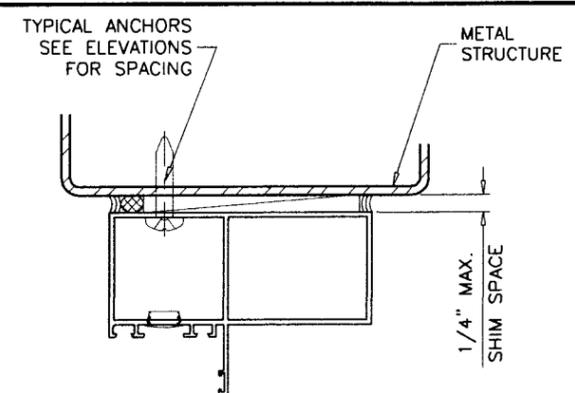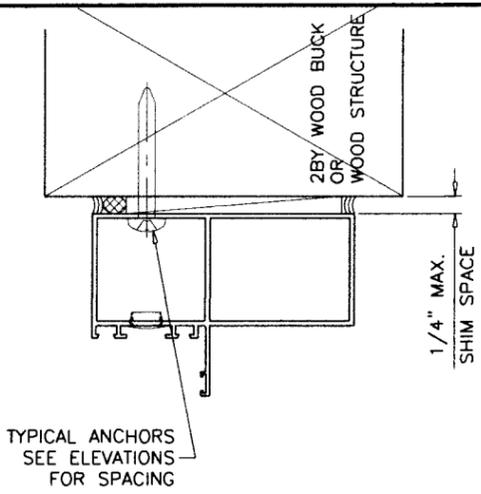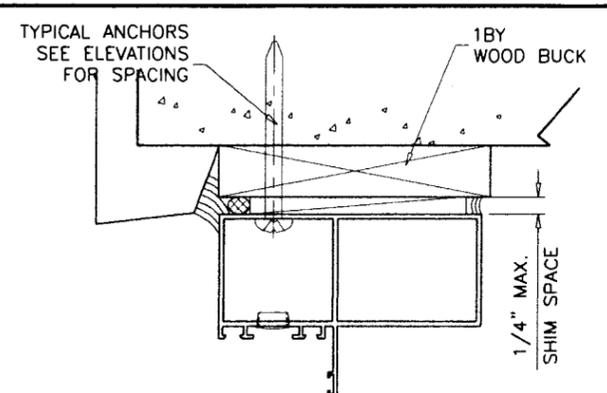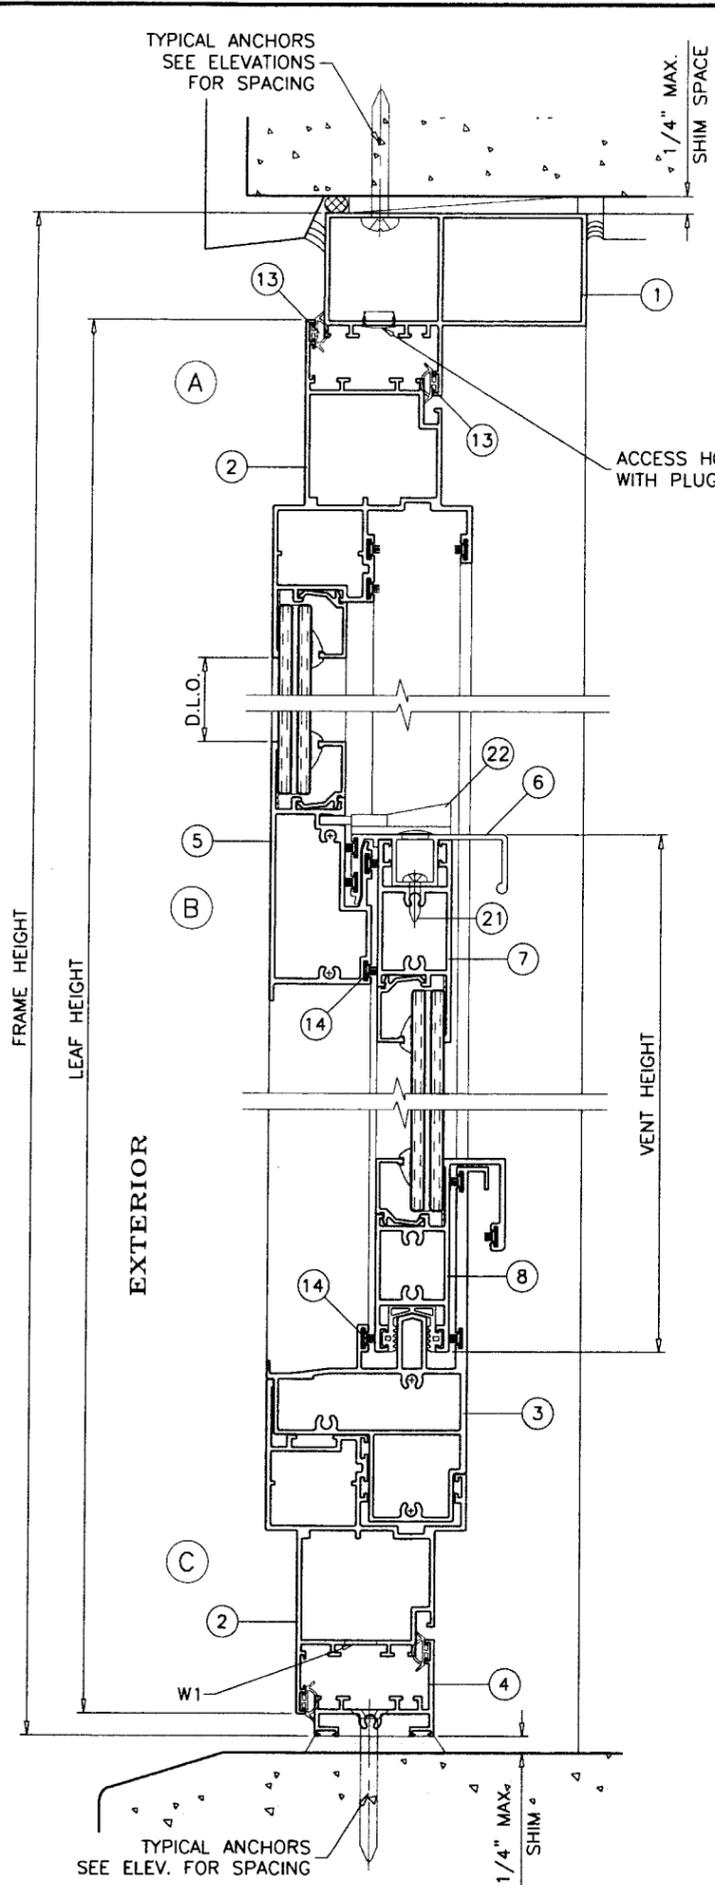

WOOD BUCKS AND METAL STRUCTURE NOT BY EUROTECH MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
1/4" DIA. TEKS/DRIL-FLEX SELF DRILLING SCREWS (GRADE 5 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS
 INTO METAL STRUCTURES
 STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK f'm = 2000 PSI MIN.

SEALANTS:
 ALL FRAME AND LEAF CORNERS AND JOINTS SEALED WITH ADSEL OR TEKNA 50729 SEALANTS.

WEEPHOLES:
 W1 = 3/16" X 1/2" WEEP HOLES AT 7" FROM EACH END
 3/16" X 1" WEEP HOLE AT CENTER

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 MAY 15 2010




PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 10-0322
 Expiration Date 05/10/2014
 By [Signature]
 Miami Dade Product Control
 Division

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP - ANL \ W10 - 06EWD

TRADEWIND ALUM OUTSWING ENT. DOOR (L.M.I.)
EUROTECH INDUSTRIES INC.
 4201 N.E. 12TH TERRACE
 FT. LAUDERDALE, FL. 33334
 TEL. (954) 630-9967 FAX. (954) 630-0217

| revisions: | no | date | by | description |
|------------|----|----------|----|----------------------|
| | A | 05.03.10 | | NO CHANGE THIS SHEET |

date: 02-17-10
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:
 drawing no.
W10-06
 sheet 3 of 6

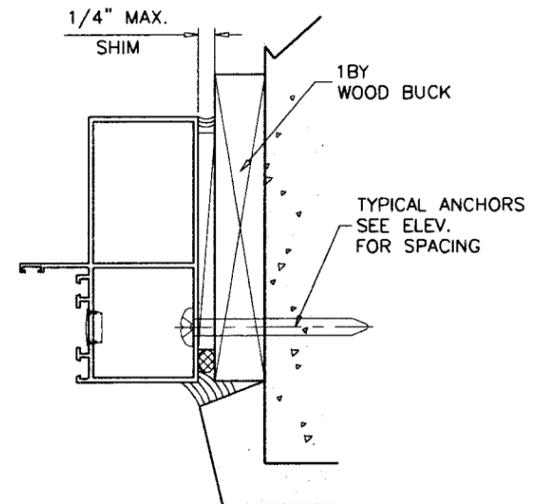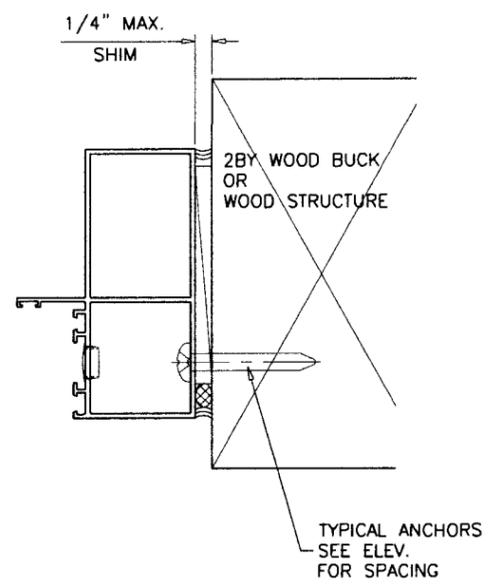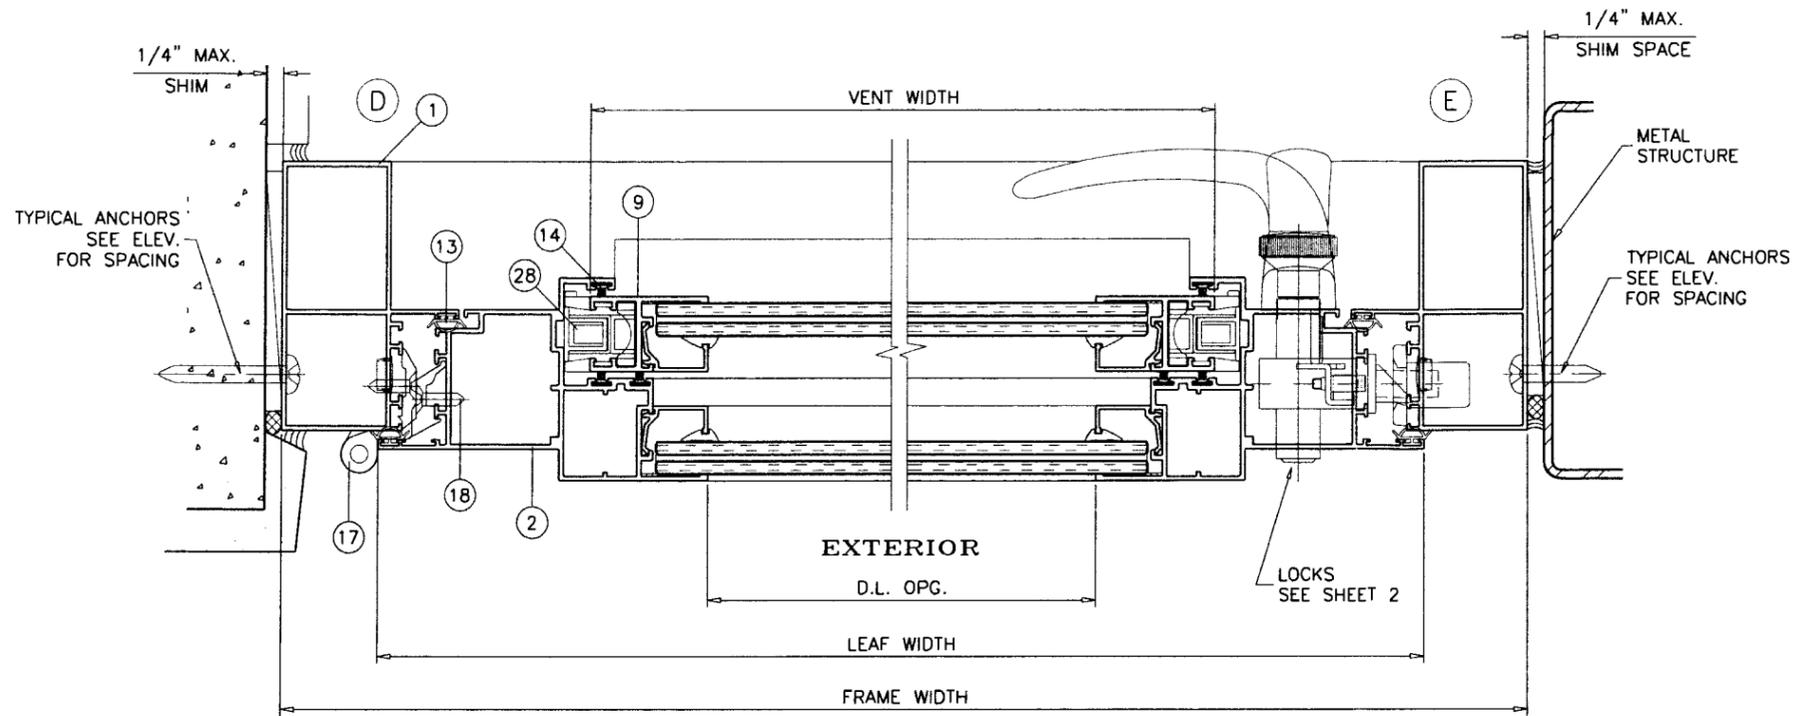

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

J.A.
 MAY 05 2010

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 10-0322.13
 Expiration Date 06/10/2014

By *[Signature]*
 Miami Dade Product Control
 Division

afC

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W10-06EWD


TRADEWIND ALUM OUTSWING ENT. DOOR (L.M.I.)

EUROTECH INDUSTRIES INC.
 4201 N.E. 12TH TERRACE
 FT. LAUDERDALE, FL. 33334
 TEL. (954) 630-9967 FAX. (954) 630-0217


| revisions: | no | date | by | description |
|------------|----|----------|----|----------------------|
| | A | 05.03.10 | | NO CHANGE THIS SHEET |
| | | | | |
| | | | | |

date: 02-17-10
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W10-06
 sheet 4 of 6

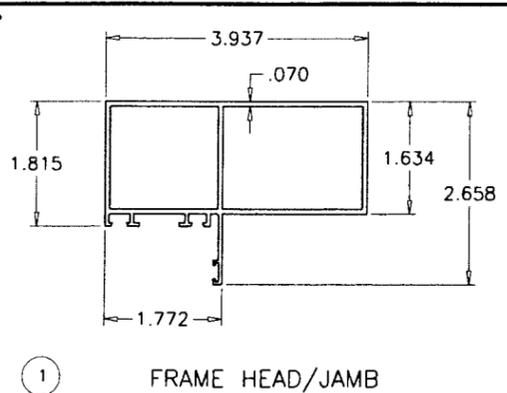


1 FRAME HEAD/JAMB

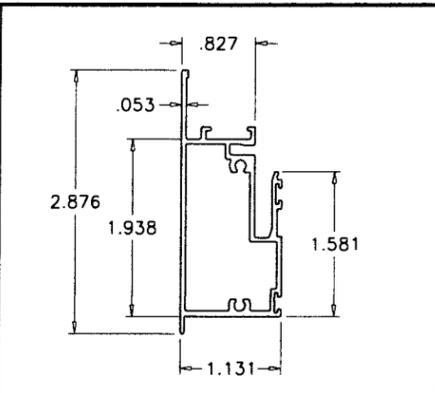


5 FIX. MTG. RAIL

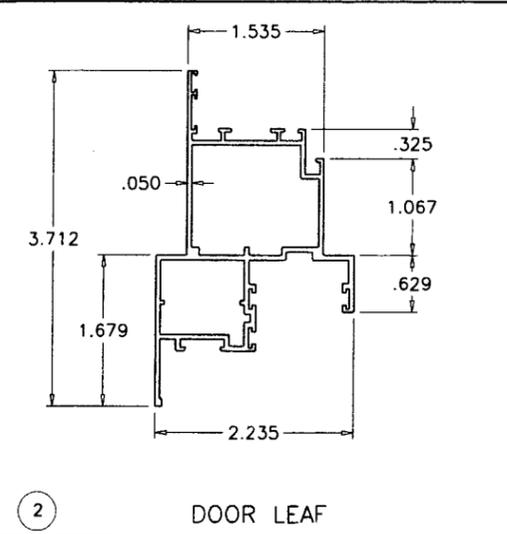


2 DOOR LEAF

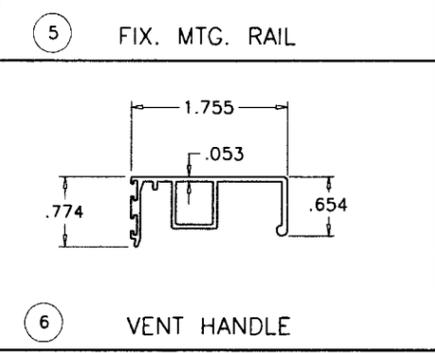


6 VENT HANDLE

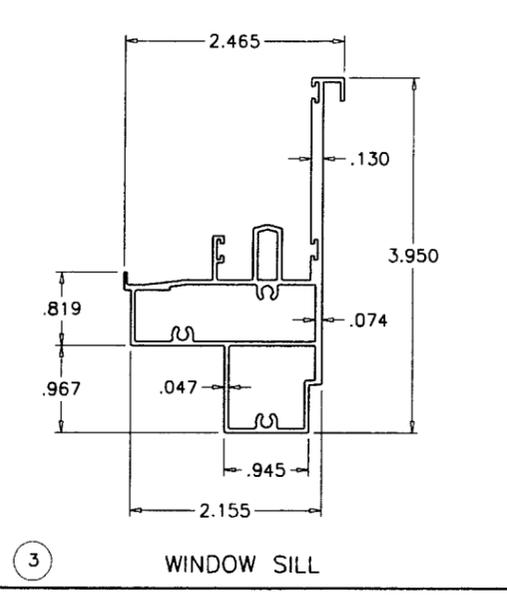


3 WINDOW SILL

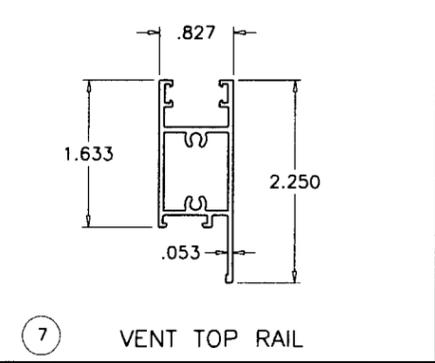


7 VENT TOP RAIL

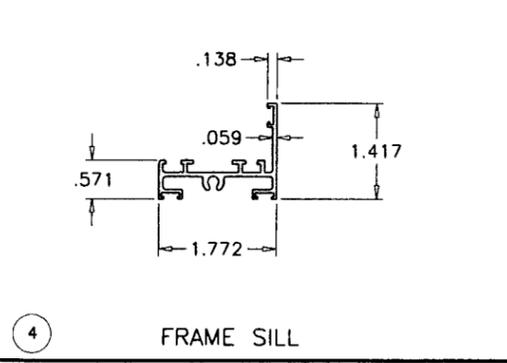


4 FRAME SILL

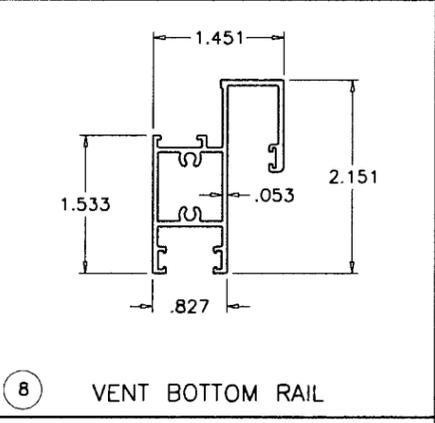

8 VENT BOTTOM RAIL

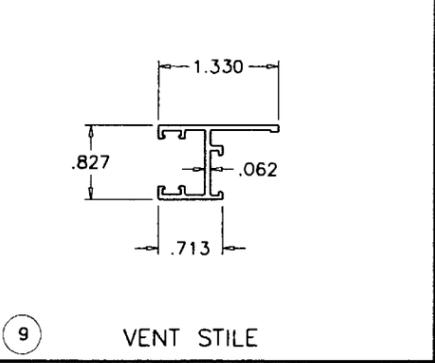

9 VENT STILE

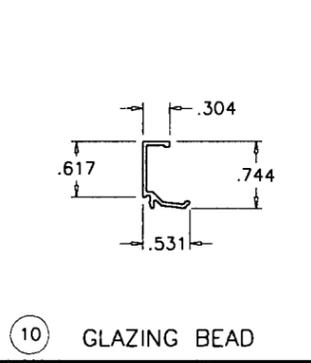

10 GLAZING BEAD

| ITEM # | PART # | REQD. | DESCRIPTION | MATERIAL | MANF./SUPPLIER/REMARKS |
|--------|--------------|------------|---|------------|------------------------|
| 1 | ER 006 | 3 | FRAME HEAD/JAMB | 6063-T6 | - |
| 2 | HW 016 | 3 | DOOR LEAF | 6063-T6 | - |
| 3 | HW 012 | 1 | WINDOW SILL | 6063-T6 | - |
| 4 | VZ 1483 | 1 | FRAME SILL | 6063-T6 | - |
| 5 | HW 009 | 1 | FIXED MEETING RAIL | 6063-T6 | - |
| 6 | HW 008 | 1 | VENT HANDLE | 6063-T6 | - |
| 7 | HW 004 | 1 | VENT TOP RAIL | 6063-T6 | - |
| 8 | HW 007 | 1 | VENT BOTTOM RAIL | 6063-T6 | - |
| 9 | HW 005 | 2 | VENT STILE | 6063-T6 | - |
| 10 | HW 010 | 4/ LITE | GLAZING BEAD | 6063-T6 | - |
| 11 | - | - | - | - | - |
| 12 | COM 2800 | 4/ LITE | GLAZING GASKET (DUROMETER 75 SHORE A) | EPDM | - |
| 13 | 58120 | AS REQD. | BULB W'STRIPPING (DUROMETER 64 SHORE A) | SANTOPRENE | COMPLASTEX |
| 14 | W21225 | AS REQD. | WOOL PILE WITH FIN | - | ULTRAFAB |
| 15 | - | - | - | - | - |
| 16 | 1001/50 | 1/ CORNER | CORNER KEY | ALUMINUM | MONTICELLO |
| 17 | 00600X | 4/ LEAF | HINGES | ALUMINUM | GIESSE |
| 18 | #10 X 3/8" | 4/ HINGE | HINGE INSTALLATION SCREWS | - | PH MACHINE SCREWS |
| 19 | #10 x 2" | AS REQD. | ASSEMBLY SCREWS | - | HH SELF DRILLING |
| 20 | #12 X 1-1/4" | - | FRAME ASSEMBLY SCREWS | - | SMS |
| 21 | #10 X 1-1/4" | 2/ VENT | VENT HANDLE INSTALLATION SCREWS | - | PH SMS |
| 22 | - | 1/ VENT | SWEEP LATCH | STEEL | - |
| 23 | #8 X 1" | 2/ LATCH | SWEEP LATCH INSTALLATION SCREWS | - | FH SMS |
| 24 | F210 | 2/ VENT | BALANCES | - | SUPERBOOST |
| 25 | #8 X 1" | 1/ BALANCE | BALANCE INSTALLTION SCREWS | - | FH SMS |

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 MAY 05 2010


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 10-0322.13
 Expiration Date 06/10/2014
 By *[Signature]*
 Miami Dade Product Control
 Division

afC
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W10-06EWD


TRADEWIND ALUM OUTSWING ENT. DOOR (L.M.I.)
EUROTECH INDUSTRIES INC.
 4201 N.E. 12TH TERRACE
 FT. LAUDERDALE, FL. 33334
 TEL. (954) 630-9967 FAX. (954) 630-0217

| revisions: | no | date | by | description |
|------------|----------|------|----|------------------------|
| A | 05.03.10 | | | REV. PER BCCO COMMENTS |


date: 02-17-10
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:
 drawing no.
W10-06
 sheet 5 of 6

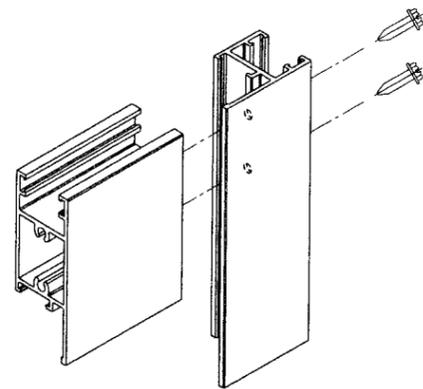


VENT TOP CORNER

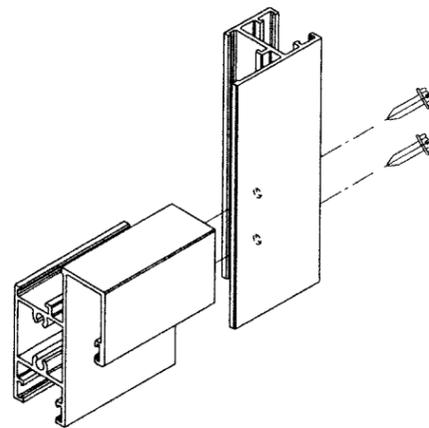


VENT BOTTOM CORNER

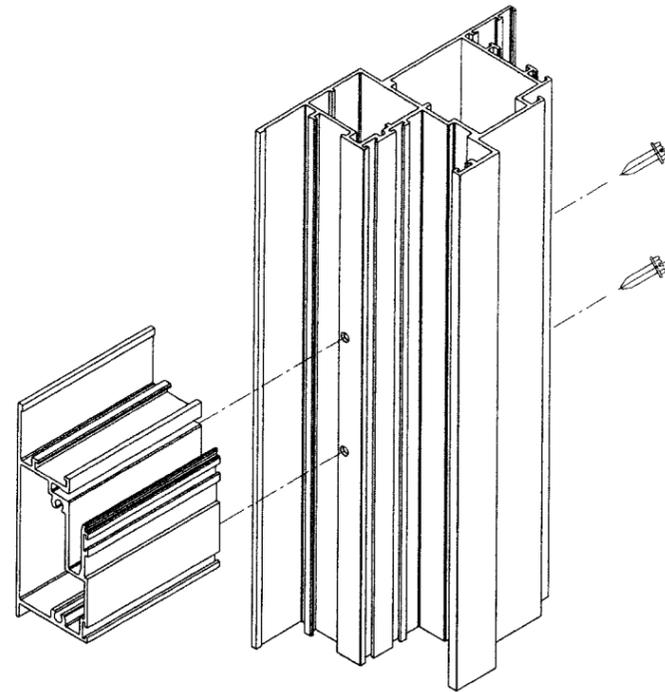


FIX. RAIL CORNER

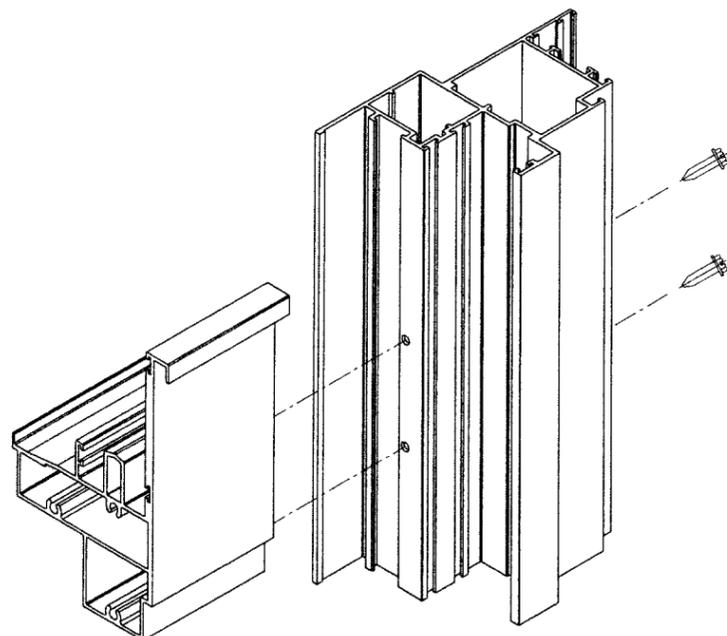


WINDOW SILL CORNER

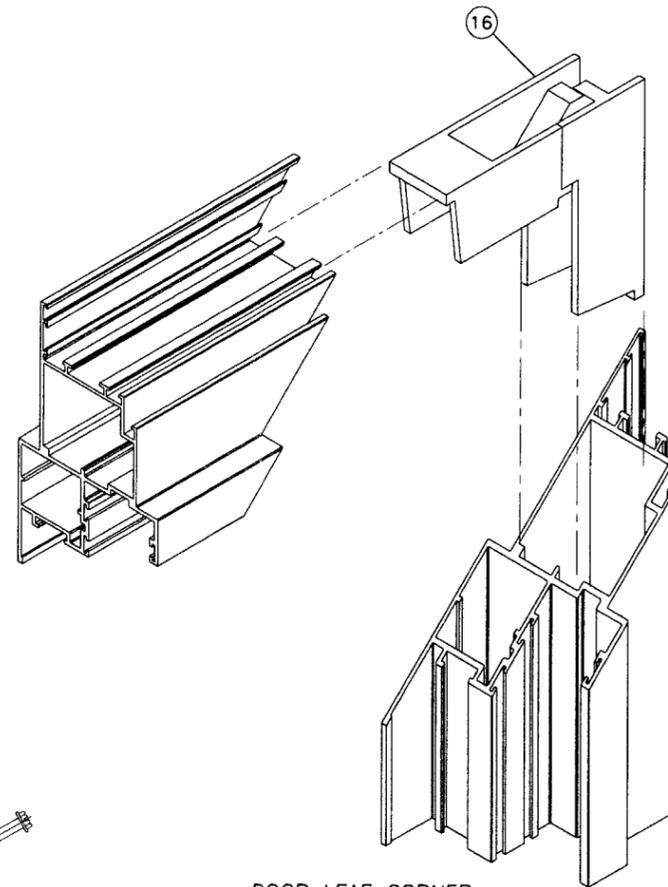

DOOR LEAF CORNER

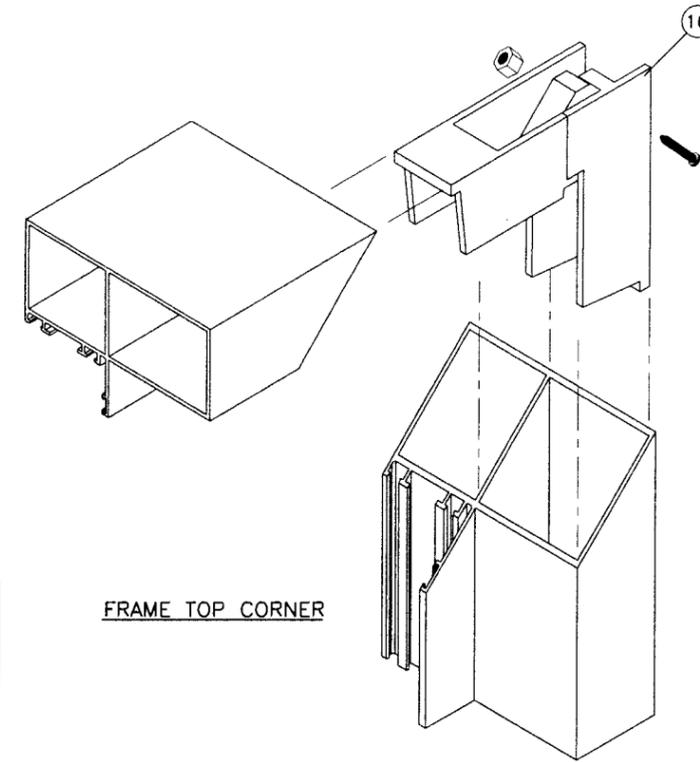

FRAME TOP CORNER

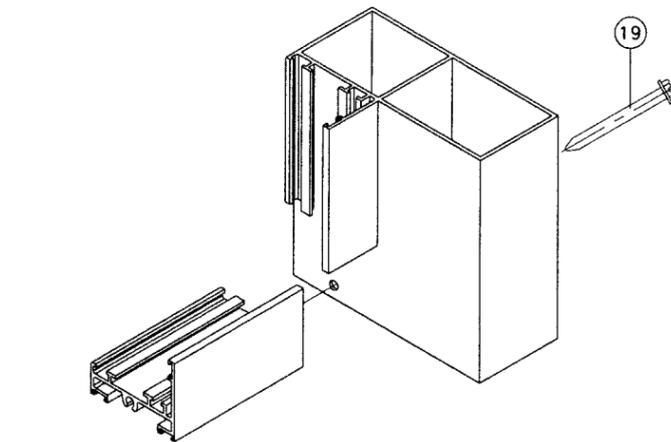

FRAME BOTTOM CORNER

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 MAY 05 2010

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 10-0322.13
 Expiration Date 06/10/2014
 By *[Signature]*
 Miami Dade Product Control
 Division

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP - ANL \ W10 - 06EWD

TRADEWIND ALUM OUTSWING ENT. DOOR (L.M.I.)
EUROTECH INDUSTRIES INC.
 4201 N.E. 12TH TERRACE
 FT. LAUDERDALE, FL. 33334
 TEL. (954) 630-9967 FAX. (954) 630-0217

| revisions: | no | date | by | description |
|------------|----|----------|----|----------------------|
| | A | 05.03.10 | | NO CHANGE THIS SHEET |

date: 02-17-10
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W10-06
 sheet 6 of 6