



MIAMI-DADE COUNTY, FLORIDA
 METRO-DADE FLAGLER BUILDING
 140 WEST FLAGLER STREET, SUITE 1107
 MIAMI, FLORIDA 33130-1563
 (305) 375-2902 FAX (305) 372-6339

BUILDING CODE COMPLIANCE OFFICE (BCCO)
 PRODUCT CONTROL DIVISION
NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

R. C. Aluminum Industries, Inc.
 2805 NW 75th Avenue
 Miami, FL 33122

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "HC200" Outswing Aluminum Casement Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W05-13**, titled "Series HC 200 Aluminum Casement Wdw. (L.M.I.)", sheets 1 through 6 of 6, dated 03/15/05, with revision "C" dated 06/23/09, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E, bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

REVISION of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

An original signed and sealed company letter from R. C. Aluminum Industries, Inc. is required, providing that the outswing aluminum casement window was purchased from them to order this NOA to be valid on any job. This NOA **renews NOA No. 09-0722.11** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
 6/1/10

NOA No. 10-0426.04
 Expiration Date: June 30, 2015
 Approval Date: June 23, 2010
 Page 1

R. C. Aluminum Industries, Inc.


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W05-13**, titled "Series HC 200 Aluminum Casement Wdw. (L.M.I.)", sheets 1 through 6 of 6, dated 03/15/05, with revision "C" dated 06/23/09, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Small Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
along with marked-up drawings and installation diagram of aluminum outswing casement window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4889**, dated 04/04/07, witnessed by Michael Wenzel, P. E.
(Submitted under previous NOA No.07-1019.03)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Small Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
along with marked-up drawings and installation diagram of aluminum outswing casement window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4897**, dated 07/18/06, witnessed by Edmundo Largaespada, P. E.
(Submitted under previous NOA No.07-1019.03)
3. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum outswing casement window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4887**, dated 12/18/06, signed and sealed by Michael Wenzel, P. E.
(Submitted under previous NOA No.07-1019.03)
4. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of aluminum outswing casement window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4896**, dated 10/02/06, signed and sealed by Edmundo Largaespada, P. E.
(Submitted under previous NOA No.07-1019.03)



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 10-0426.04
Expiration Date: June 30, 2015
Approval Date: June 23, 2010

R. C. Aluminum Industries, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (Continued)

5. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

Along with marked-up drawings and installation diagram of an aluminum Outswing casement window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4417, FTL-4416, FTL-4371**, all dated 12/09/04 and 02/09/05, witnessed, signed and sealed by Edmundo Largaespada, P. E.

(Submitted under NOA No. 05-0427.02)

6. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of aluminum outswing casement window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4504 and FTL-4570**, all dated 02/02/05 and 03/18/05, signed and sealed by Edmundo Largaespada, P. E.

(Submitted under NOA No. 05-0427.02)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated 06/10/09, signed and sealed by Arshad Viqar, P. E.

Complies with ASTM E1300-02/04

(Submitted under NOA No. 09-0722.11)

D. QUALITY ASSURANCE

1. Miami-Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **09-0312.03** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/13/09, expiring on 01/14/12.
2. Notice of Acceptance No. **09-0312.02** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite® PVB, Interlayer**" dated 05/13/09, expiring on 12/11/10.

F. STATEMENTS

1. Statement letter of conformance, no financial interest and complying with FBC-2007, dated 02/22/10, signed and sealed by Javad Ahmad, P. E.



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 10-0426.04
Expiration Date: June 30, 2015
Approval Date: June 23, 2010

R. C. Aluminum Industries, Inc.


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

2. Statement letter of no financial interest and complying with FBC-2007, dated 06/19/09, signed and sealed by Arshad Viqar, P. E.
(Submitted under NOA No. 09-0722.11)
3. Statement letter of conformance, dated 06/25/09, signed and sealed by Arshad Viqar, P. E.
(Submitted under NOA No. 09-0722.11)
4. Laboratory compliance letter for Test Reports No.'s **FTL-4889** and **FTL-4887**, issued by Fenestration Testing Laboratory, Inc., dated 04/04/07 and 12/18/06, all signed and sealed by Michael Wenzel, P. E.
(Submitted under previous NOA No. 07-1019.03)
5. Laboratory compliance letter for Test Reports No.'s, **FTL-4897**, **FTL-4896**, **FTL-4417**, **FTL-4416**, **FTL-4371**, **FTL-4504** and **FTL-4570**, issued by Fenestration Testing Laboratory, Inc., dated 12/09/04, 02/09/05, 02/02/05, 03/18/05, 07/18/06 and 10/02/06, all signed and sealed by Edmundo Largaespada, P. E.
(Submitted under previous NOA's No's. 07-1019.03 and 05-0427.02)




G. OTHERS

1. Notice of Acceptance No. **09-0722.11**, issued to R. C. Aluminum Industries Inc. for their Series "HC200 Aluminum Casement Window-L.M.I.", approved on 10/14/09 and expiring on 06/30/10.



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 10-0426.04
Expiration Date: June 30, 2015
Approval Date: June 23, 2010

EXTERIOR

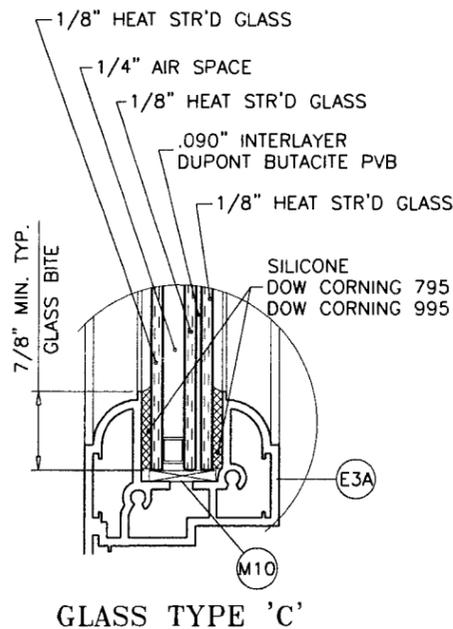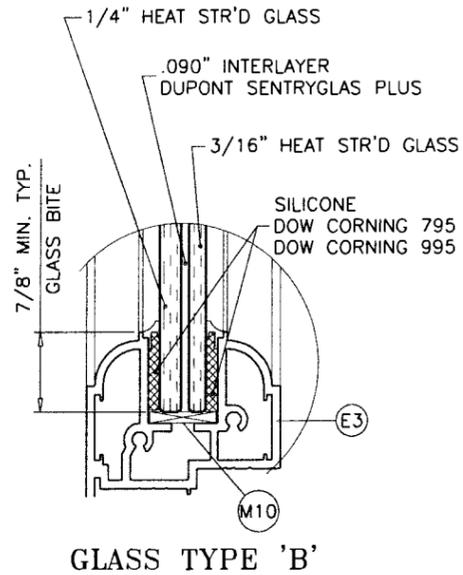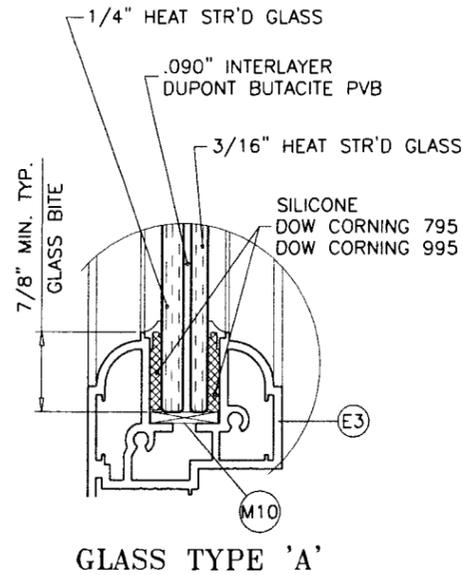

GLAZING OPTIONS

SERIES HC200 ALUMINUM CASEMENT WINDOW

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF CASEMENT/CASEMENT OR CASEMENT WITH OTHER MIAMI-DADE COUNTY APPR'D WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

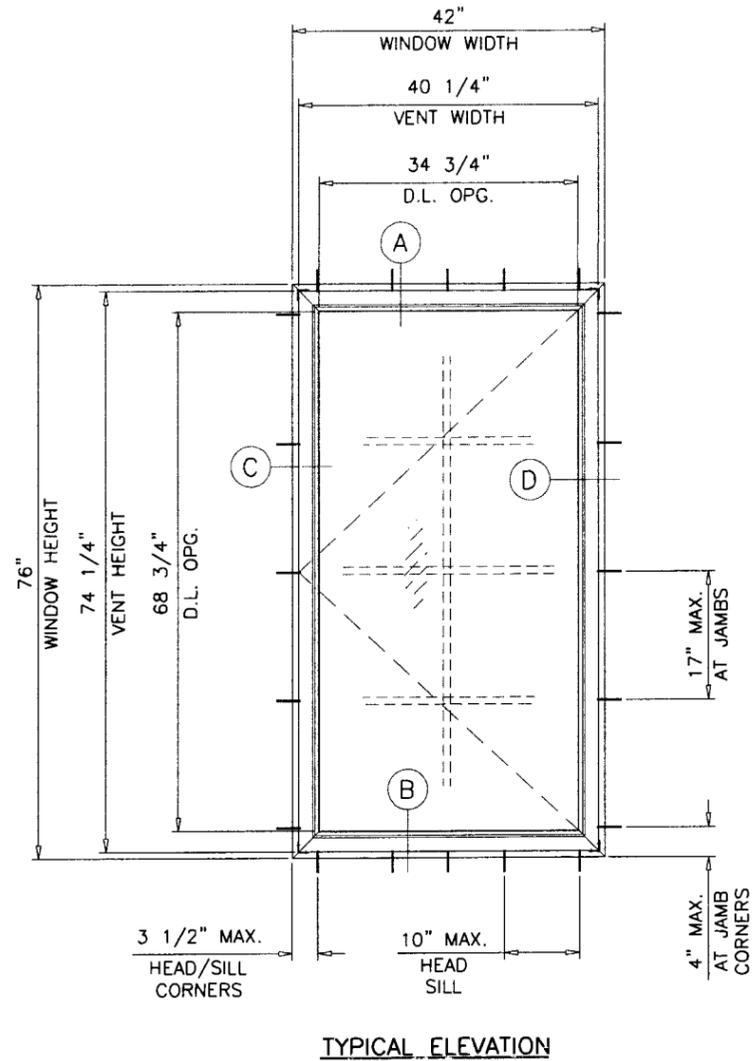

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
FEB 22 2010

PRODUCT RENEWED
complying with the Florida
Building Code
Acceptance No. 10-042604
Expiration Date 06/30/2015
By: *[Signature]*
Miami Dade Product Control

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL \ W05-13RC

SERIES HC200 ALUMINUM CASEMENT WDW. (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
2805 N.W. 75 TH AVE.
MIAMI, FL. 33122
TEL. (305) 592-1515 FAX. (305) 592-2184

no	date	by	description
A	06.15.07		UPDATED FOR 2004 FBC
B	01.24.08		REV. PER BCCO COMMENTS
C	06.23.09		UPDATED FOR 2007 FBC

date: 03-15-05
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:

drawing no.
W05-13
sheet 1 of 6

DESIGN LOAD CAPACITY - PSF FOR (X) SIZES							
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
20"	36"	130.0	180.0	150.0	210.0	100.0	100.0
24"		130.0	180.0	150.0	210.0	100.0	100.0
28"		130.0	180.0	150.0	210.0	100.0	100.0
32"		130.0	165.0	130.0	150.0	100.0	100.0
36"		130.0	165.0	130.0	150.0	100.0	100.0
40"		130.0	165.0	130.0	150.0	100.0	100.0
42"		130.0	165.0	130.0	150.0	100.0	100.0
42"		130.0	165.0	130.0	150.0	100.0	100.0
20"	42"	130.0	180.0	150.0	210.0	100.0	100.0
24"		130.0	180.0	150.0	210.0	100.0	100.0
28"		130.0	165.0	130.0	150.0	100.0	100.0
32"		130.0	165.0	130.0	150.0	100.0	100.0
36"		130.0	165.0	130.0	150.0	100.0	100.0
40"		130.0	165.0	130.0	150.0	100.0	100.0
42"		130.0	165.0	130.0	150.0	100.0	100.0
42"		130.0	165.0	130.0	150.0	100.0	100.0
20"	48"	130.0	180.0	150.0	210.0	100.0	100.0
24"		130.0	165.0	130.0	150.0	100.0	100.0
28"		130.0	165.0	130.0	150.0	100.0	100.0
32"		130.0	165.0	130.0	150.0	100.0	100.0
36"		130.0	165.0	130.0	150.0	100.0	100.0
40"		130.0	165.0	130.0	150.0	100.0	100.0
42"		130.0	165.0	130.0	150.0	100.0	100.0
42"		130.0	165.0	130.0	150.0	100.0	100.0
20"	54"	130.0	165.0	130.0	150.0	100.0	100.0
24"		130.0	165.0	130.0	150.0	100.0	100.0
28"		130.0	165.0	130.0	150.0	100.0	100.0
32"		130.0	165.0	130.0	150.0	100.0	100.0
36"		130.0	165.0	130.0	150.0	100.0	100.0
40"		130.0	165.0	130.0	150.0	100.0	100.0
42"		130.0	165.0	130.0	150.0	100.0	100.0
42"		130.0	165.0	130.0	150.0	100.0	100.0
20"	60"	130.0	165.0	130.0	150.0	100.0	100.0
24"		130.0	165.0	130.0	150.0	100.0	100.0
28"		130.0	165.0	130.0	150.0	100.0	100.0
32"		130.0	165.0	130.0	150.0	100.0	100.0
36"		130.0	165.0	130.0	150.0	100.0	100.0
40"		130.0	130.0	130.0	150.0	-	-
42"		130.0	130.0	130.0	150.0	-	-
42"		130.0	130.0	130.0	150.0	-	-
20"	66"	130.0	165.0	130.0	150.0	100.0	100.0
24"		130.0	165.0	130.0	150.0	100.0	100.0
28"		130.0	165.0	130.0	150.0	100.0	100.0
32"		130.0	165.0	130.0	150.0	100.0	100.0
36"		130.0	130.0	130.0	150.0	-	-
40"		130.0	130.0	130.0	150.0	-	-
42"		130.0	130.0	130.0	150.0	-	-
42"		130.0	130.0	130.0	150.0	-	-
20"	72"	130.0	165.0	130.0	150.0	100.0	100.0
24"		130.0	165.0	130.0	150.0	100.0	100.0
28"		130.0	165.0	130.0	150.0	100.0	100.0
32"		130.0	165.0	130.0	150.0	100.0	100.0
36"		130.0	130.0	130.0	150.0	-	-
40"		130.0	130.0	130.0	150.0	-	-
42"		130.0	130.0	130.0	150.0	-	-
42"		130.0	130.0	130.0	150.0	-	-

DESIGN LOAD CAPACITY - PSF FOR (X) SIZES							
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
20"	78"	130.0	165.0	130.0	150.0	100.0	100.0
24"		130.0	165.0	130.0	150.0	100.0	100.0
28"		130.0	165.0	130.0	150.0	100.0	100.0
32"		130.0	130.0	130.0	150.0	-	-
36"		130.0	130.0	130.0	150.0	-	-
40"		124.0	130.0	124.0	143.0	-	-
40"		124.0	130.0	124.0	143.0	-	-
42"		124.0	130.0	124.0	143.0	-	-
20"	84"	130.0	165.0	130.0	150.0	100.0	100.0
24"		130.0	165.0	130.0	150.0	100.0	100.0
28"		130.0	130.0	130.0	150.0	-	-
32"		118.0	130.0	118.0	136.2	-	-
36"		106.6	123.0	106.6	123.0	-	-
36"		106.6	123.0	106.6	123.0	-	-
40"		106.6	123.0	106.6	123.0	-	-
42"		106.6	123.0	106.6	123.0	-	-

DESIGN LOAD CAPACITY - PSF FOR (X) SIZES							
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26"	130.0	180.0	130.0	210.0	100.0	100.0
26-1/2"		130.0	180.0	130.0	210.0	100.0	100.0
37"		130.0	180.0	130.0	210.0	100.0	100.0
42"		130.0	165.0	130.0	150.0	100.0	100.0
19-1/8"	38-3/8"	130.0	180.0	130.0	210.0	100.0	100.0
26-1/2"		130.0	180.0	130.0	210.0	100.0	100.0
37"		130.0	165.0	130.0	150.0	100.0	100.0
42"		130.0	165.0	130.0	150.0	100.0	100.0
19-1/8"	50-5/8"	130.0	180.0	130.0	210.0	100.0	100.0
26-1/2"		130.0	165.0	130.0	150.0	100.0	100.0
37"		130.0	165.0	130.0	150.0	100.0	100.0
42"		130.0	165.0	130.0	150.0	100.0	100.0
19-1/8"	63"	130.0	165.0	130.0	150.0	100.0	100.0
26-1/2"		130.0	165.0	130.0	150.0	100.0	100.0
37"		130.0	165.0	130.0	150.0	100.0	100.0
42"		130.0	130.0	130.0	150.0	-	-
19-1/8"	76"	130.0	165.0	130.0	150.0	100.0	100.0
26-1/2"		130.0	165.0	130.0	150.0	100.0	100.0
37"		130.0	130.0	130.0	150.0	-	-
42"		130.0	130.0	130.0	150.0	-	-

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

J.A.
FEB 22 2010

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 10-0426-04
Expiration Date 06/30/2015

By *Javad Ahmad*
Miami Dade Product Control
Commission








af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W05-13RC

SERIES HC200 ALUMINUM CASEMENT WDW. (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
2805 N.W. 75 TH AVE.
MIAMI, FL. 33122
TEL. (305) 592-1515 FAX. (305) 592-2184

no	date	description
A	06.15.07	UPDATED FOR 2004 FBC
B	01.24.08	NO CHANGE THIS SHEET
C	06.23.09	UPDATED FOR 2007 FBC

date: 03-15-05
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W05-13
sheet 2 of 6

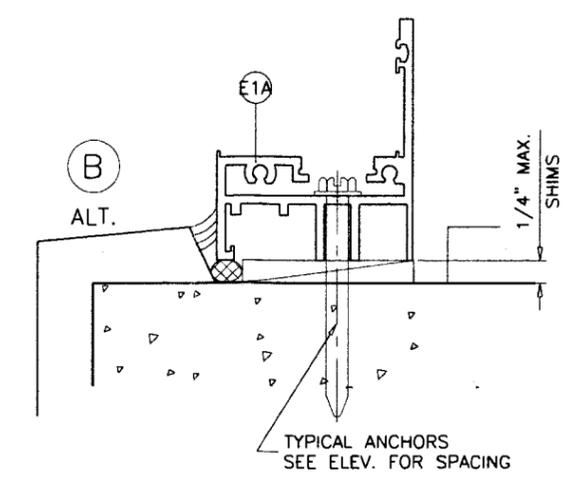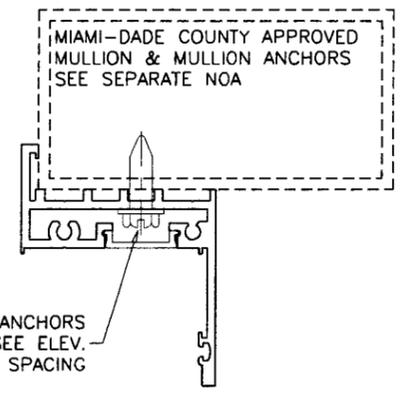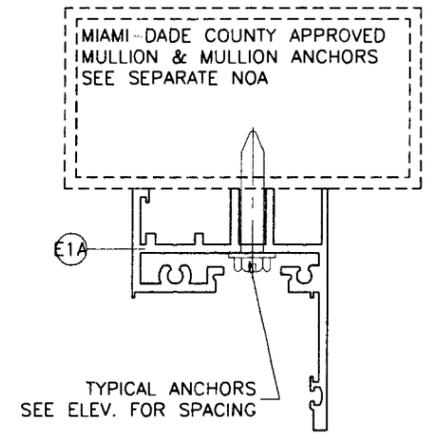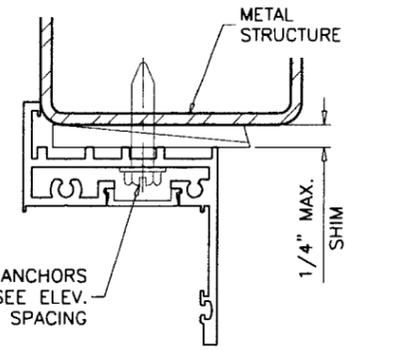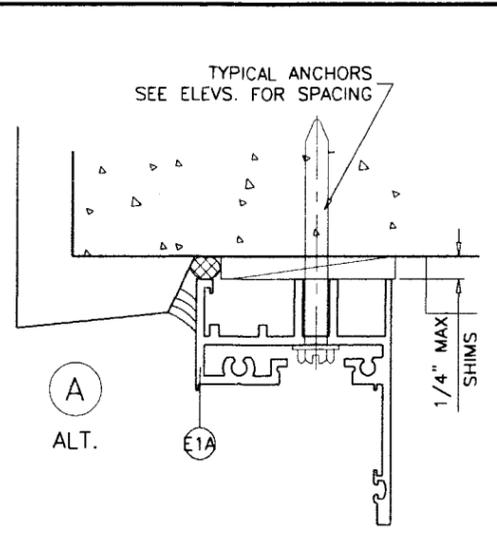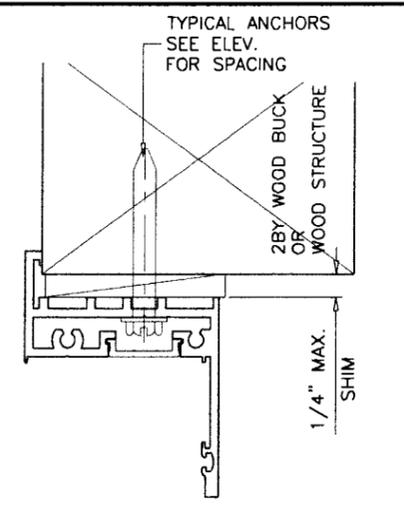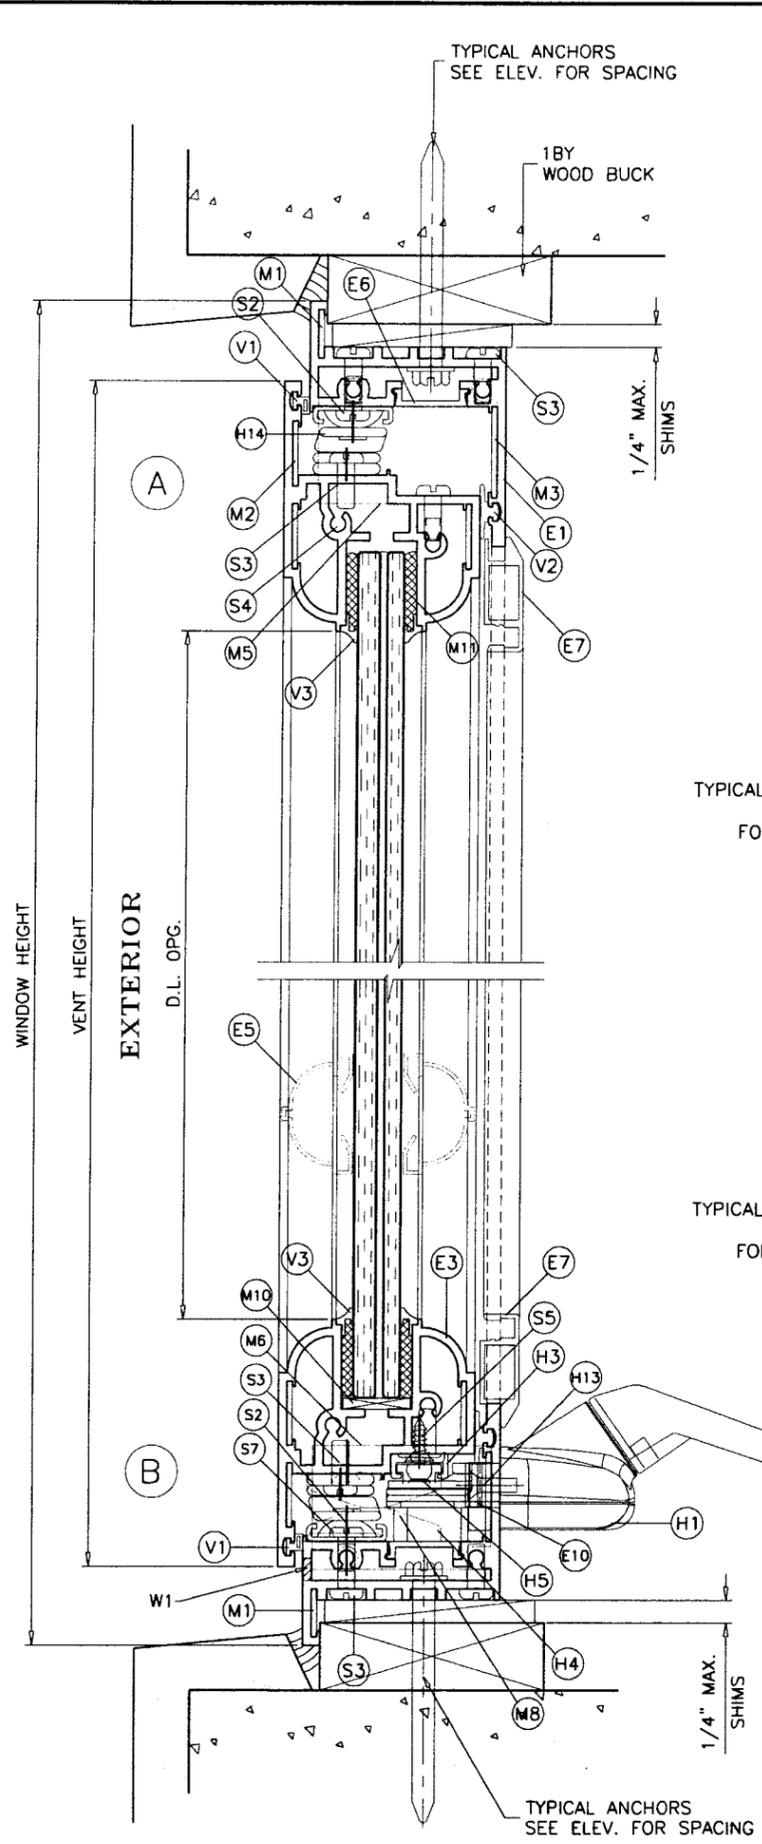

WOOD BUCKS AND METAL STRUCTURE NOT BY RC ALUMINUM MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" HILTI KWIK-CON II (Fu=163 KSI, Fy=157 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO METAL STRUCTURES

STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 (NO SHIM SPACE)

ANCHOR EDGE DISTANCES
 INTO CONCRETE AND MASONRY = 2-3/4" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK f'm = 2000 PSI MIN.

SEALANTS:
 ALL FRAME AND VENT CORNERS SEALED WITH SILICONE.

WEEP HOLES:
 W1 = 1/4" X 1/2" WEEP SLOT AT 4" FROM EACH END

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

J.A.

FEB 22 2010

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 10-0426.04
 Expiration Date 06/30/2015

By *[Signature]*
 Miami Dade Product Control
 Division


afC
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W05-13RC

SERIES HC200 ALUMINUM CASEMENT WDW. (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
 2805 N.W. 75 TH AVE.
 MIAMI, FL. 33122
 TEL. (305) 592-1515 FAX. (305) 592-2184

revisions:	no	date	by	description
	A	06.15.07		UPDATED FOR 2004 FBC
	B	01.24.08		REV. PER BCCO COMMENTS
	C	06.23.09		UPDATED FOR 2007 FBC





date: 03-15-05
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W05-13
 sheet 3 of 6

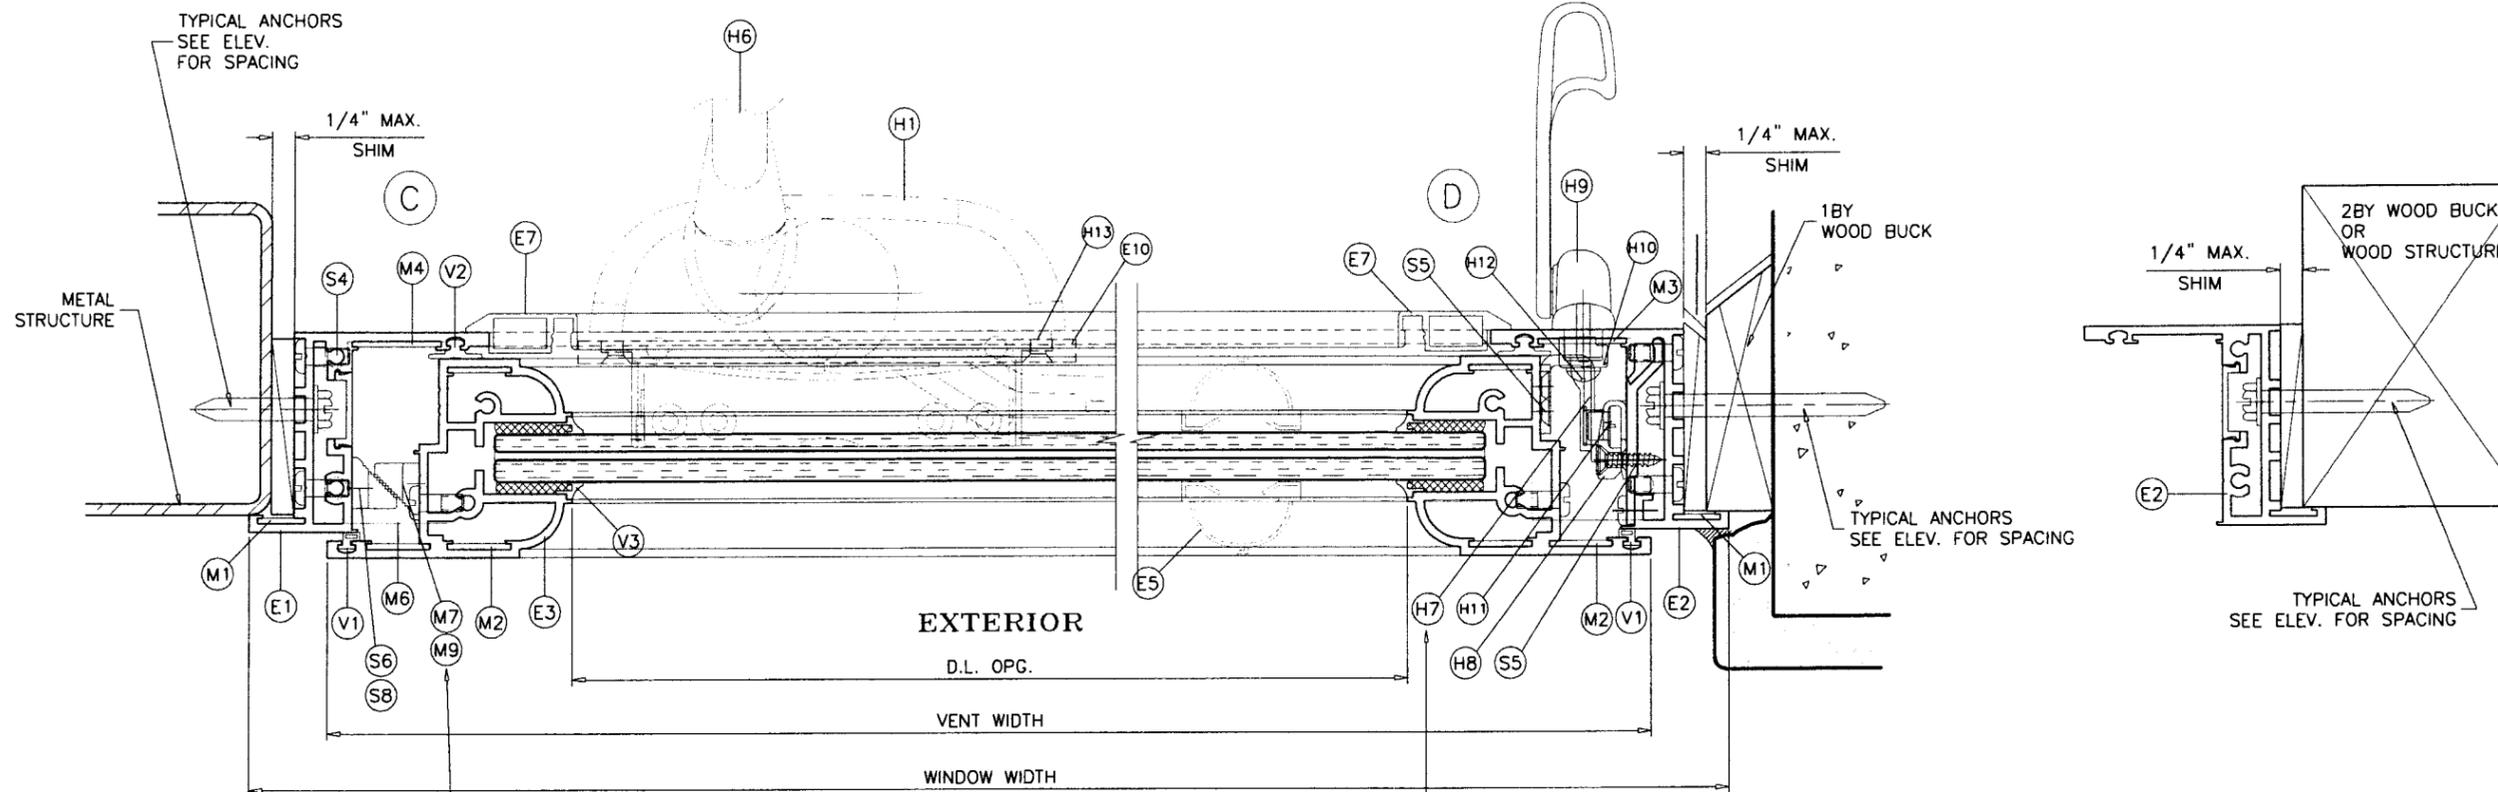

SNUBBERS
 3 PLASTIC SNUBBERS UP TO 38-3/8" WDW. HTS.
 2 ALUM + 2 PLASTIC SNUBBERS UP TO 60" WDW. HTS.
 3 ALUM + 2 PLASTIC SNUBBERS OVER 60" WDW. HTS.

LATCH KEEPER
 3 PER JAMB UP TO 38-3/8" WDW. HTS.
 4 PER JAMB UP TO 63" WDW. HTS.
 5 PER JAMB OVER 63" WDW. HTS.

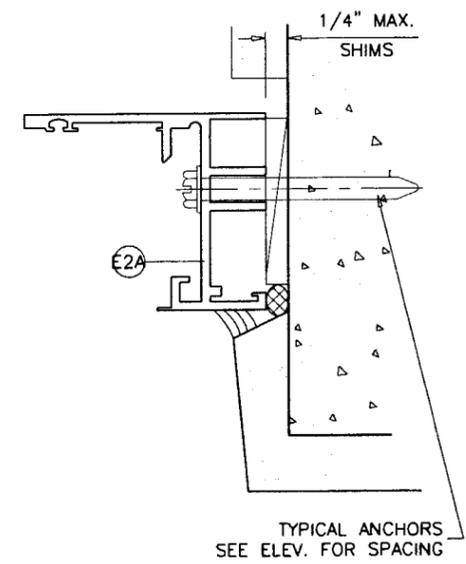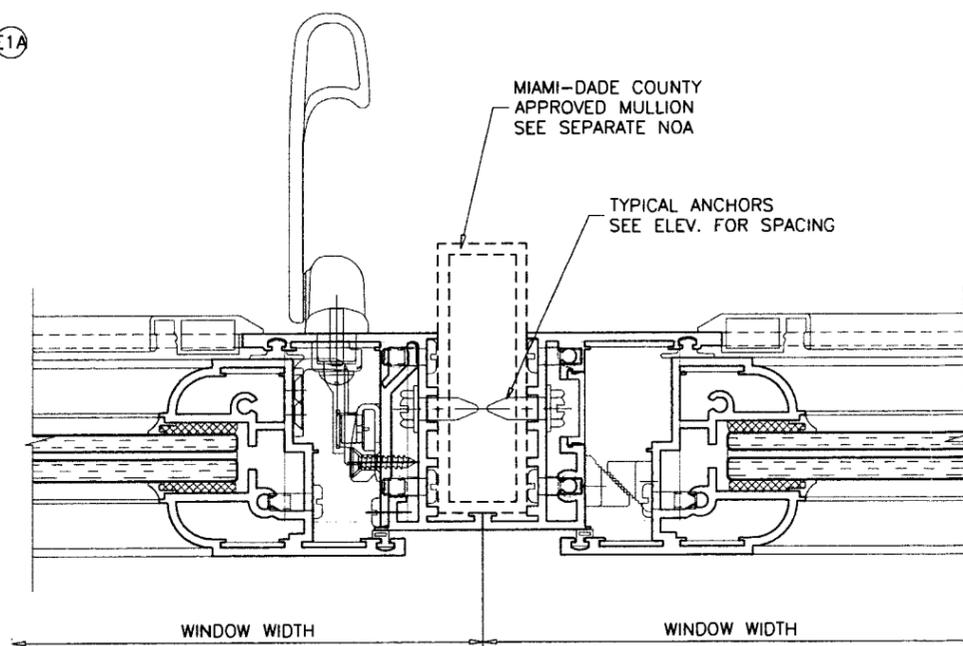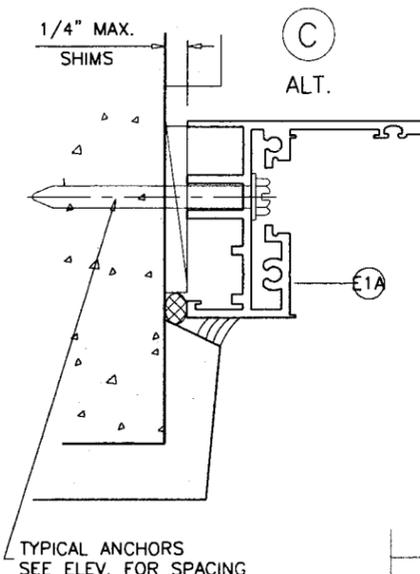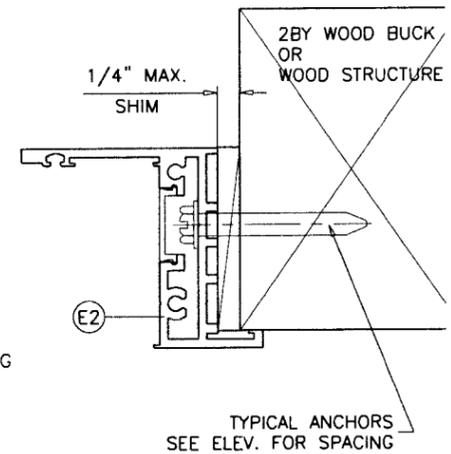

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

JA
 FEB 22 2010

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. **10-0426-04**
 Expiration Date **02/30/2015**

By *[Signature]*
 Miami Dade Product Control
 Division


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W05-13RC

SERIES HC200 ALUMINUM CASEMENT WDW. (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
 2805 N.W. 75 TH AVE.
 MIAMI, FL. 33122
 TEL. (305) 592-1515 FAX. (305) 592-2184


no	date	by	description
A	06.15.07		UPDATED FOR 2004 FBC
B	01.24.08		REV. PER BCCO COMMENTS
C	06.23.09		UPDATED FOR 2007 FBC

date: 03-15-05
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W05-13
 sheet 4 of 6

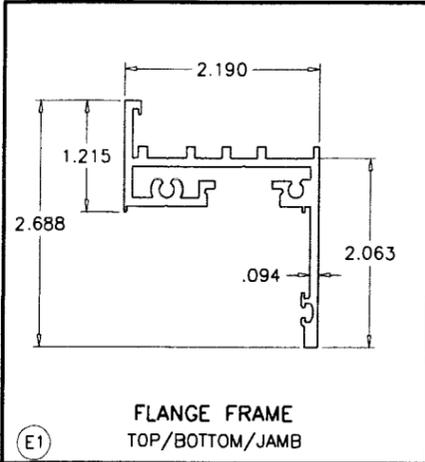


E1 FLANGE FRAME TOP/BOTTOM/JAMB

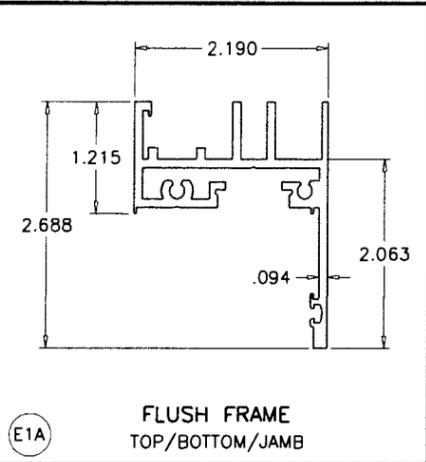


E1A FLUSH FRAME TOP/BOTTOM/JAMB

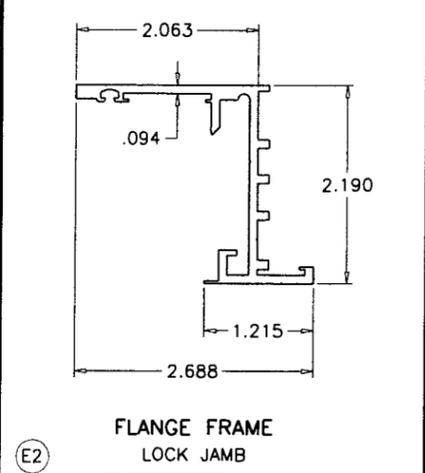


E2 FLANGE FRAME LOCK JAMB

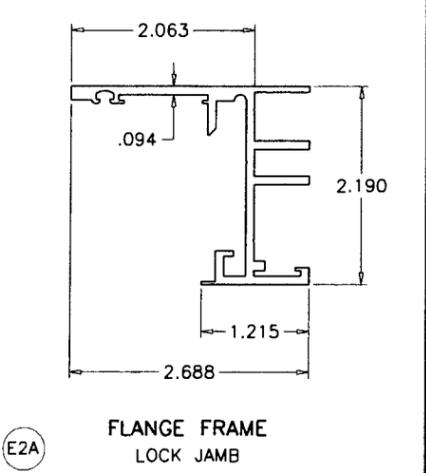


E2A FLANGE FRAME LOCK JAMB

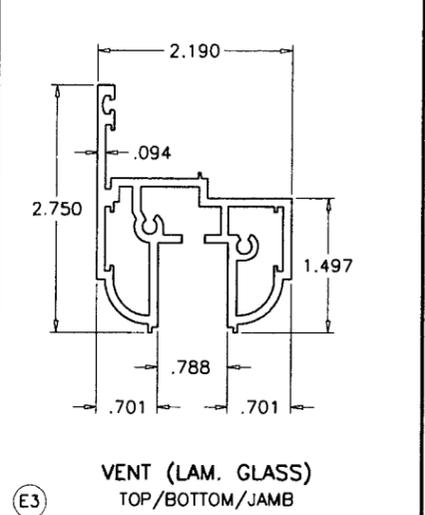


E3 VENT (LAM. GLASS) TOP/BOTTOM/JAMB

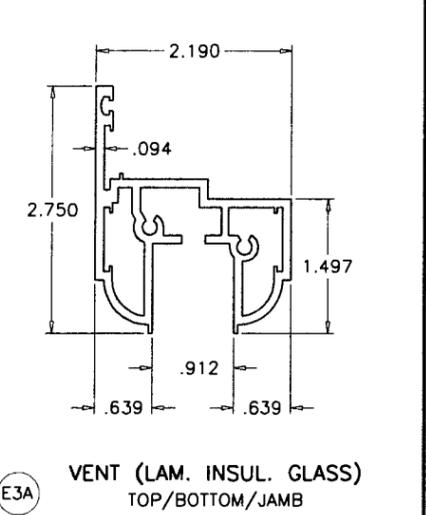

E3A VENT (LAM. INSUL. GLASS) TOP/BOTTOM/JAMB

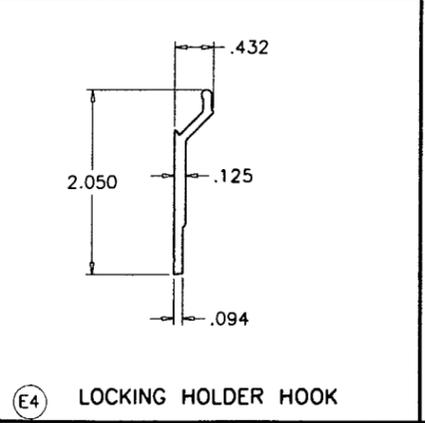

E4 LOCKING HOLDER HOOK

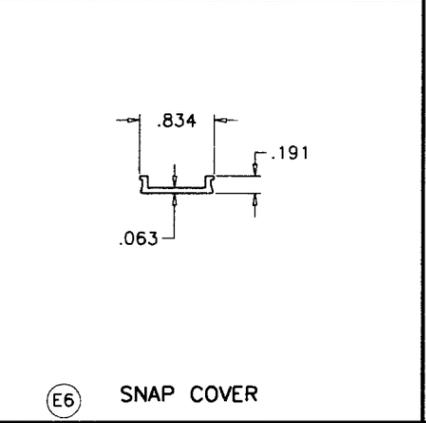

E6 SNAP COVER

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
E1	HC200-001	3/ WDW.	FLANGE FRAME TOP , BOTTOM & JAMB (NON LOCK)	6063-T6	-
E1A	HC200-008	3/ WDW.	FLUSH FRAME TOP , BOTTOM & JAMB (NON LOCK)	6063-T6	-
E2	HC200-002	1/ WDW.	FLANGE FRAME LOCK JAMB	6063-T6	-
E2A	HC200-009	1/ WDW.	FLUSH FRAME LOCK JAMB	6063-T6	-
E3	HC200-003	4/ WDW.	VENT TOP , BOTTOM & JAMBS (LAM. GLASS)	6063-T6	-
E3A	HC200-006	4/ WDW.	VENT TOP , BOTTOM & JAMBS (LAM. INSUL. GLASS)	6063-T6	-
E4	HC200-004	1/ WDW.	LOCKING HOLDER HOOK	6063-T6	-
E5	HC200-005	AS REQD.	OPTIONAL MUNTIN	ALUMINUM	-
E6	BD4500-015	4/ WDW.	SNAP COVER (OPTIONAL)	ALUMINUM	-
E7	1/ WDW.	-	SCREEN (OPTIONAL)	ALUMINUM	-
E10	CM100-022	-	ANCHOR ARM FOR ROTO OPERATOR	-	-
V1	V-059	AS REQD.	EXTERIOR W/STP. VINYL	PVC	-
V2	V-033A	AS REQD.	TR-5804N COMPRESSION GASKET (INSIDE)	NEOPRENE	TREMCO
V3	P-021 (OPTIONAL)	AS REQD.	COSMETIC COVER SEAL MELTPPOINT	-	-
M1	HC200-M01	1/ CORNER	FRAME SMALL CORNER LOCK	ST. STEEL	16 GA.
M2	HC200-M02	3/ CORNER	VENT CORNER LOCK	ST. STEEL	16 GA.
M3	HC200-M03	1/ CORNER	FRAME LARGE CORNER LOCK	ST. STEEL	16 GA.
M4	HC200-M04	1	FRAME LARGE CORNER LOCK (AT ROTO OPERATOR ONLY)	ST. STEEL	16 GA.
M5	HC200-M05	1/ CORNER	LEFT HAND FRAME CORNER LOCK	6063-T6	-
M6	HC200-M06	1/ CORNER	RIGHT HAND FRAME CORNER LOCK	6063-T6	-
M7	HC200-M07	-	ALUMINUM SNUBBER	-	-
M8	P-030	-	NYLON CAM	-	-
M9	P#12206	-	NYLON SNUBBERS	-	-
M10		AS REQD.	1/8"x3/4" SETTING BLOCK	NEOPRENE	-
M12	HC200-M08	-	GUIDE HOUSING	ALUMINUM	-
M13	P-031	-	SHIM ANTI FRICTION	PLASTIC	-
H1	CD25	-	9.5" SINGLE ARM OPERATOR	ST/ST	ROTO HARDWARE
H3	CB304	1/ WDW.	SURFACE MOUNT OPERATOR	-	ROTO HARDWARE
H4	CB253	1	8.5 MM. OPERATOR BOTTOM SPACER	-	ROTO HARDWARE
H5	CB201	1	OPERATOR TOP SPACER	-	ROTO HARDWARE
H7	L1305-2111	3	KEEPERS	ST/ST	ROTO HARDWARE
H8	GT553	-	GUIDE HOUSING	-	ROTO HARDWARE
H9	LH088-7510	-	WHITE HANDLE	-	ROTO HARDWARE
H10	G2-HND-LPLT-02	-	HANDLE FASTENER PLATE	-	ROTO HARDWARE
H11	LB06	1	LOCK POINT STAINLESS STEEL	-	ROTO HARDWARE
H12	GT990	-	#10-32X 3/8" LG. PH. MACHINE SCREW (LOCKING HANDLE)	ST/ST	-
H13	M1000	-	#8-32X 3/4" LG. PHL. FH. THREAD CUTTING (ANCHOR ARM)	ST/ST	-
H14		2	4 BAR HINGE	-	TRUTH OR BRONZE CRAFT
S2		-	#10 X 3/8" LG. PH. PHL. SMS. (ARM-FRAME)	ST/ST	-
S3		-	#10 X 1/2" LG. PH. PHL. SMS. (ARM-VENT)	ST/ST	-
S4		-	#10 X 1-1/2" LG. PH. PHL. SMS. (ASSEMBLY)	ST/ST	-
S5		-	#8-32 X 1/2" LG. FH. PHL. (GUIDES-SURFACE MOUNT)	ST/ST	-
S6		-	#6 X 1/2" LG. FH. PHL. SMS. (SNUBBERS)	ST/ST	-
S7		-	#10 X 1/2" LG. PHL. FH. SMS.	ST/ST	-
S8		-	#6 X 1/2" LG. PH. SMS. ST/ST AT ALUM. SNUBBER	-	-

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

J.A.

FEB 22 2010

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 10-0426.04
 Expiration Date 06/30/2015

By *J. Ahmad*
 Miami Dade Product Control
 Division

afC
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W05-13RC


SERIES HC200 ALUMINUM CASEMENT WDW. (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
 2805 N.W. 75 TH AVE.
 MIAMI, FL. 33122
 TEL. (305) 592-1515 FAX. (305) 592-2184

no	date	description
A	06.15.07	UPDATED FOR 2004 FBC
B	01.24.08	REV. PER BCCO COMMENTS
C	06.23.09	UPDATED FOR 2007 FBC


date: 03-15-05
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W05-13

sheet 5 of 6

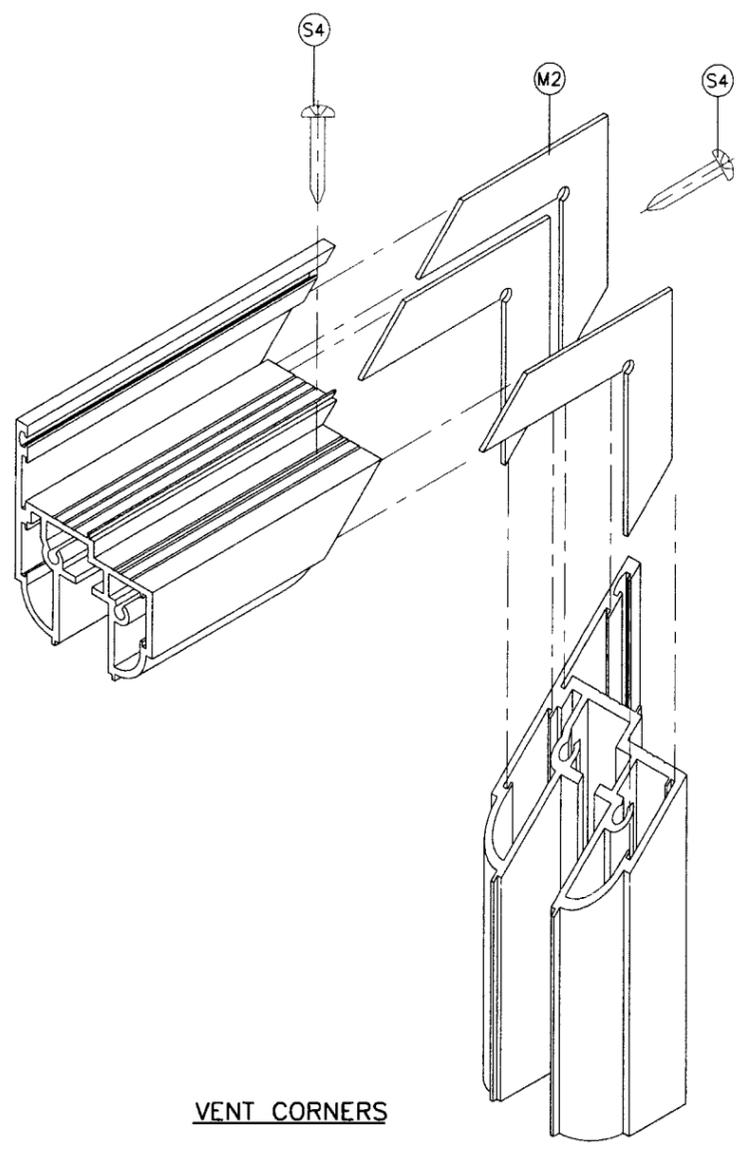

VENT CORNERS

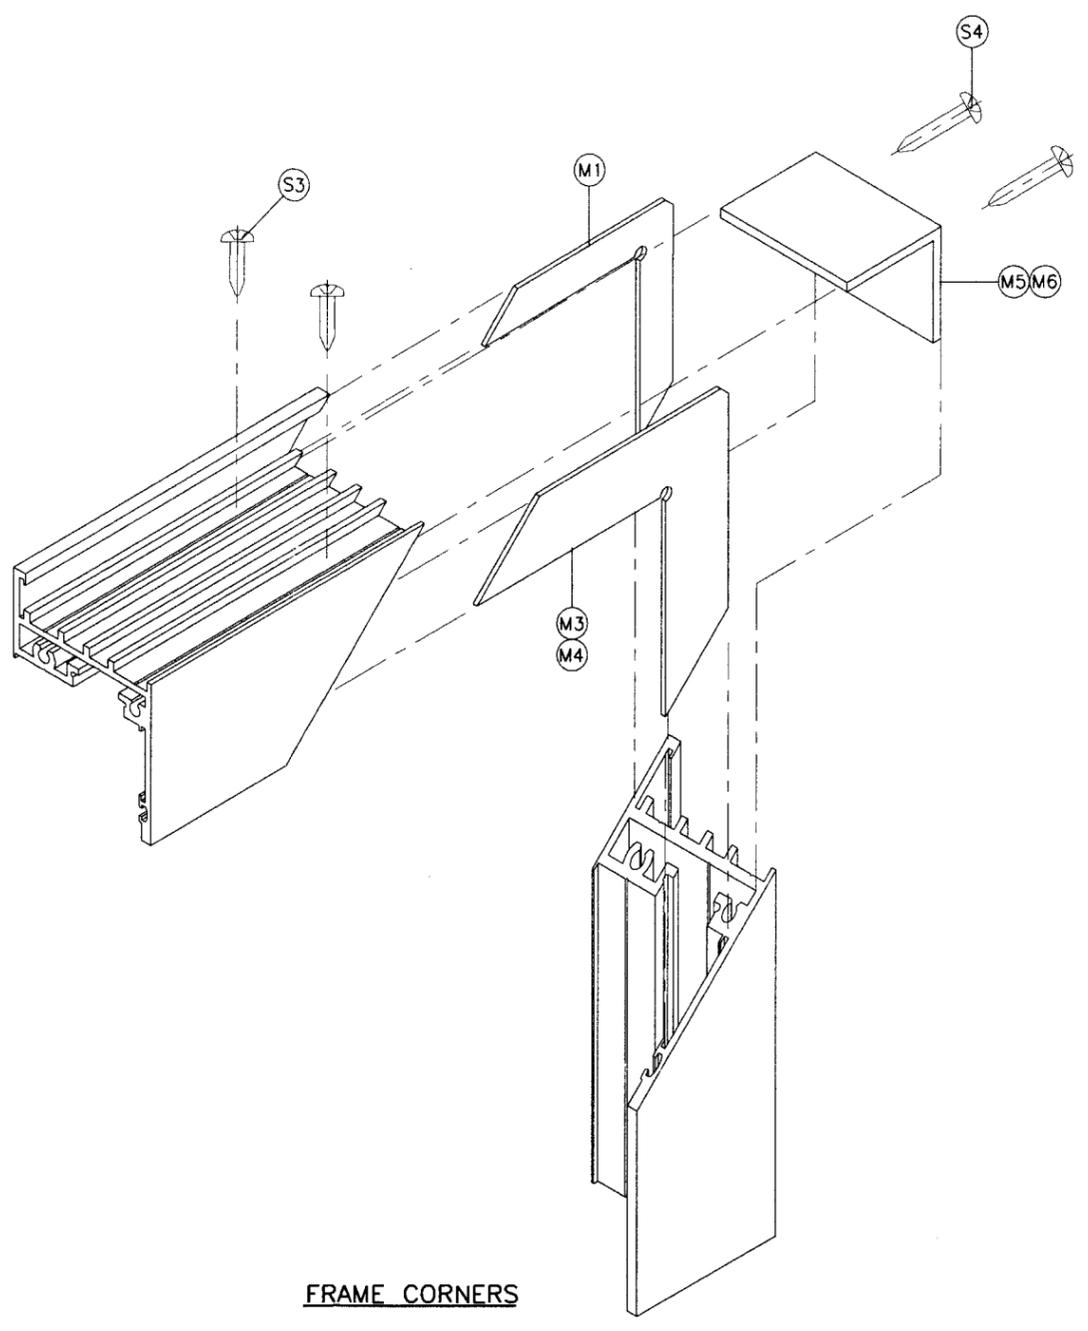

FRAME CORNERS

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

J.A.
 FEB 22 2010

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No 10-042604
 Expiration Date 06/30/2015

By *Javad Ahmad*
 Miami Dade Product Control
 Division

date:	03-15-05
scale:	1/2" = 1"
dr. by:	HAMID
chk. by:	
drawing no.	W05-13
sheet	6 of 6

no	date	by	description
A	06.15.07		UPDATED FOR 2004 FBC
B	01.24.08		NO CHANGE THIS SHEET
C	06.23.09		UPDATED FOR 2007 FBC

SERIES HC200 ALUMINUM CASEMENT WDW. (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
 2805 N.W. 75 TH AVE.
 MIAMI, FL. 33122
 TEL. (305) 592-1515 FAX. (305) 592-2184

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W05-13RC