



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1107  
MIAMI, FLORIDA 33130-1563  
(305) 375-2902 FAX (305) 372-6339**

**NOTICE OF ACCEPTANCE (NOA)**

**www.miamidade.gov/buildingcode**

**F.P.G. Wholesale, Inc.  
7190 Coral Way  
Miami, FL 33155**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION:**

**Series "Condoor Impact" 8'0" Outswing Glazed Wood French Door w/ wo Sidelites – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **W09-29**, titled "Series Out-Swing Wood Patio Door (L.M.I.)", sheets 1 through 8 of 8, dated 05/11/09 with revision "A" dated 06/30/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and Approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1, evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



*J. Gascon  
8/5/10*

**NOA No. 10-0503.02  
Expiration Date: August 25, 2015  
Approval Date: August 25, 2010**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **W09-29**, titled "Series Out-Swing Wood Patio Door (L.M.I.)", sheets 1 through 8 of 8, dated 05/11/09 with revision "A" dated 06/30/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.

**B. TESTS**

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94  
along with marked-up drawings and installation diagram of OS French door, prepared by Hurricane Engineering and Testing, Inc., Test Reports No.'s **HETI-09-2501**, **HETI-08-2119A**, **HETI-08-2119B** and **HETI-08-2172**, dated November 23, 2009 revised dated July 15, 2010, all signed and sealed by Candido F. Font, P. E.

**C. CALCULATIONS**

1. Anchor calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated 12/14/09, signed and sealed by Javad Ahmad, P. E.  
**Complies with ASTM E1300-04**

**D. QUALITY ASSURANCE**

1. Miami-Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **08-0709.04** issued to Glasslam N.G.I., Inc. for their "**Safety-Plus II Laminated Glass**" dated 09/11/08, expiring on 08/07/13.

**E. STATEMENTS**



1. Statement letter of no financial interest, conformance and compliance with the FBC-2007, dated December 10, 2009, signed and sealed by Javad Ahmad, P. E.
2. Laboratory compliance letter for Test Reports No.'s **HETI-09-2501**, **HETI-08-2119A**, **HETI-08-2119B** and **HETI-08-2172**, issued by Hurricane Engineering and Testing, Inc., dated November 23, 2009 revised dated July 15, 2010, all signed and sealed by Candido F. Font, P. E.

**F. OTHERS**

1. None.



Jaime D. Gascon, P.E.  
Chief, Product Control Division  
NOA No. 10-0503.02  
Expiration Date: August 25, 2015  
Approval Date: August 25, 2010

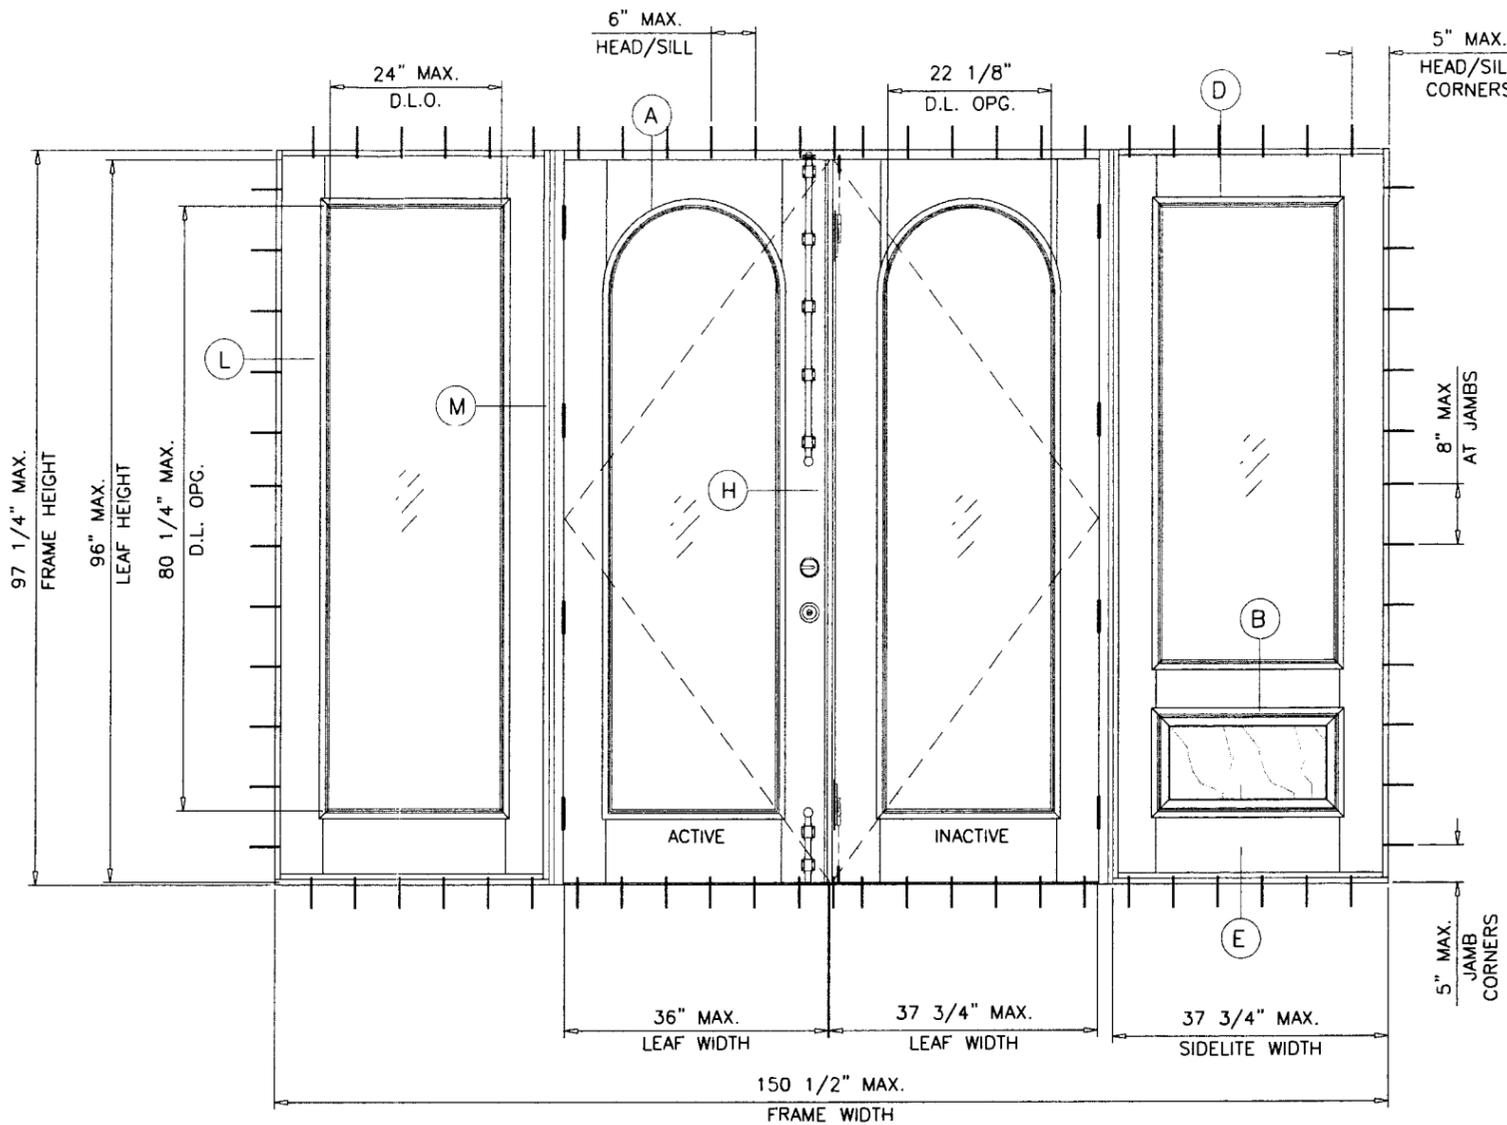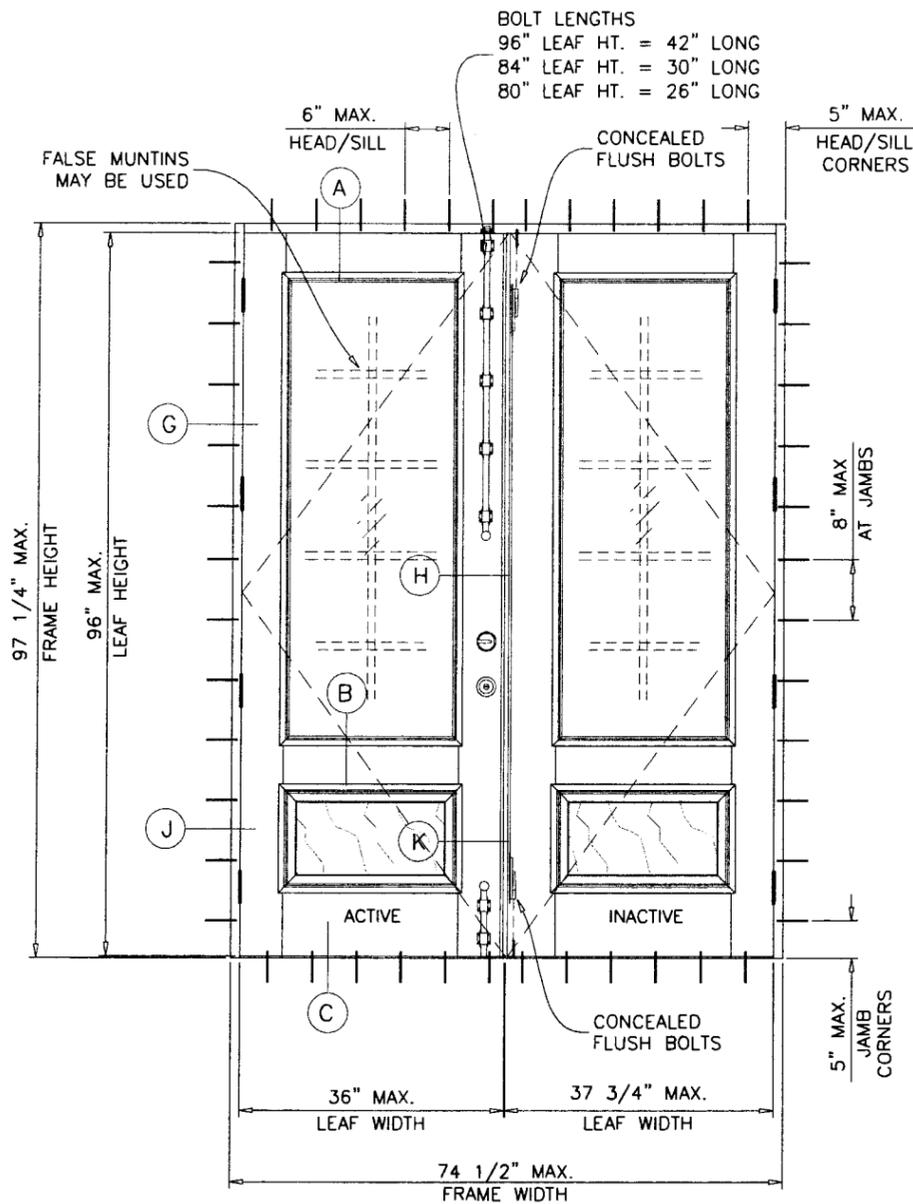

TYPICAL ELEVATIONS

**OUT-SWING WOOD PATIO DOOR**

APPROVAL APPLIES TO SINGLE (X) AND DOUBLE (XX) LEAF DOORS WITH OR WITHOUT SIDELITES. SIDE LITES CAN BE ON ONE SIDE OR BOTH SIDES OF DOOR. SEE SHEET 2 FOR DESIGN LOAD CAPACITY.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

LAM. INSUL. GLASS  
SOLID WOOD INSERTS  
LARGE MISSILE IMPACT

THESE DOORS/SIDELITES ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

THE APPROVED PRODUCTS NOTED HEREIN ARE EXEMPT FROM PRESERVATIVE TREATMENT PER 2326.2.1 OF THE FLORIDA BUILDING CODE WHICH EXEMPTS WOOD SPECIES LISTED AS 'DURABLE'. THE SPECIFIC PRODUCTS HEREIN ARE EXEMPTED WOOD SPECIES BASED ON USDA LISTING AND MUST HAVE A SPECIFIC GRAVITY EQUAL TO OR HIGHER THAN THE REFERENCED SPECIES.

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 070592  
C.C. # 3538  
2010

Approved as complying with the  
Florida Building Code  
Date: 08/25/2010  
NOA# 10-0503.02  
Miami-Dade Product Control  
Division  
By: *[Signature]*

**af c**

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W09-29FFPG

OUT-SWING WOOD PATIO DOOR (L.M.I.)

**F.P.G. WHOLESALE INC.**  
7190 CORAL WAY  
MIAMI, FLORIDA 33155  
TEL. (305) 266-2296 FAX (305) 261-6540


no	date	description
A	08.30.10	REV. PER BCCO COMMENTS

revisions:


date: 05-11-09  
scale: 1/2"=1'-0"  
dr. by: HAMID  
chk. by:

drawing no.  
**W09-29**  
sheet 1 of 8

SINGLE LEAF (X) OR DOUBLE LEAF (XX) DOORS			
DESIGN LOAD CAPACITY - PSF			
LEAF WIDTH FT./IN.	LEAF HEIGHT FT./IN.	GLAZING TYPES 'A', 'B', 'C' OR 'D'	
		EXT. (+)	INT. (-)
2/0	8/0	60.0	60.0
2/6		60.0	60.0
3/0		60.0	60.0

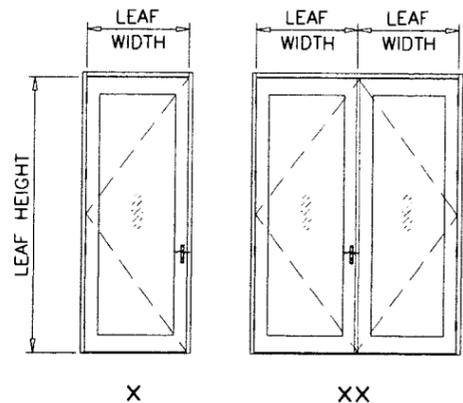


STATIONARY PANEL (O) OR DOORS WITH SIDELITES			
DESIGN LOAD CAPACITY - PSF			
WIDTH (W) FT./IN.	LEAF HEIGHT FT./IN.	GLAZING TYPES 'A', 'B', 'C' OR 'D'	
		EXT. (+)	INT. (-)
2/0	8/0	60.0	60.0
2/6		60.0	60.0
3/0		60.0	60.0

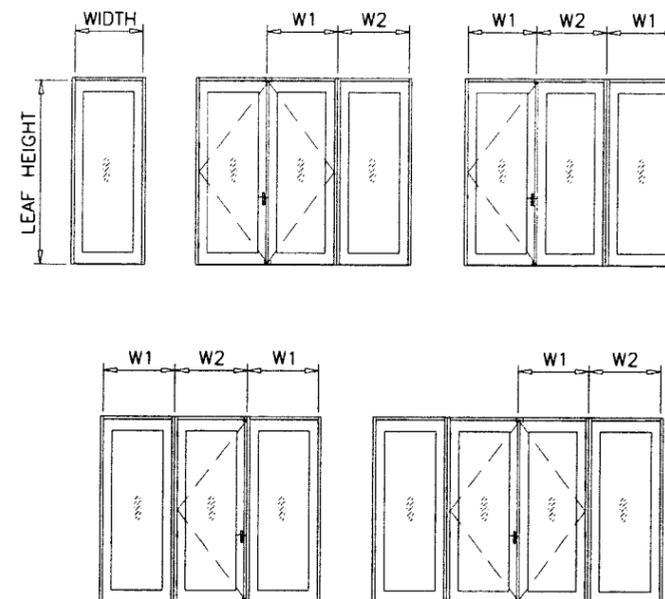


NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE  
BASED ON ASTM E1300-04 (3 SEC. GUSTS)  
AND FLORIDA BUILDING COMMISSION  
DECLARATORY STATEMENT DCA05-DEC-219

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$


(FOR DOORS WITH SIDELITES)

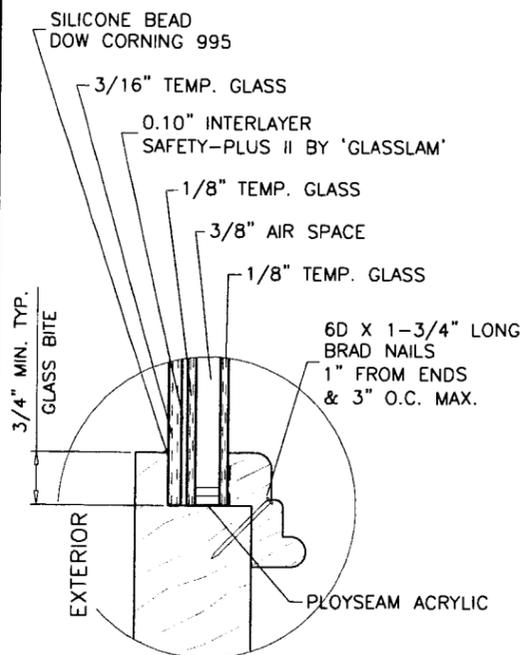


**GLAZING TYPE 'A'**  
1" OVERALL THICKNESS

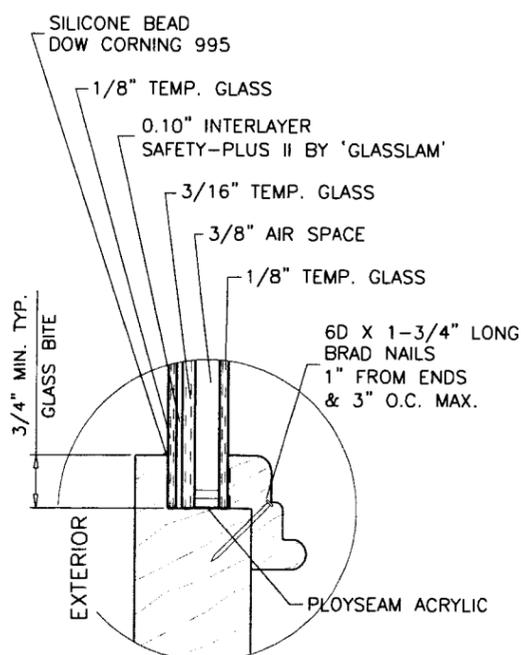


**GLAZING TYPE 'B'**  
1" OVERALL THICKNESS

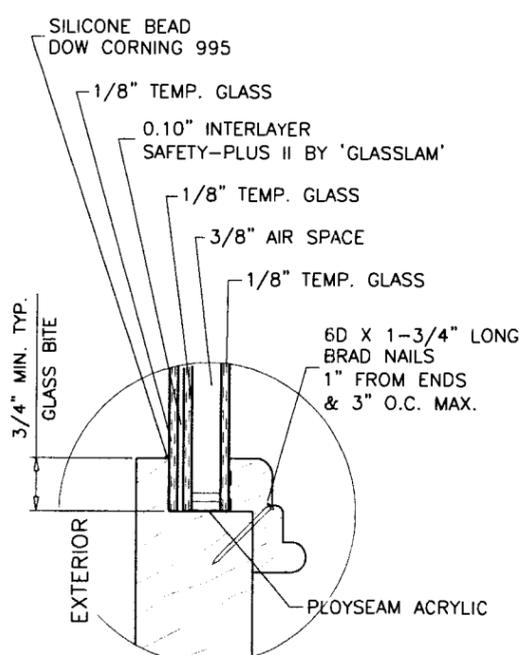

**GLAZING TYPE 'C'**  
1" OVERALL THICKNESS

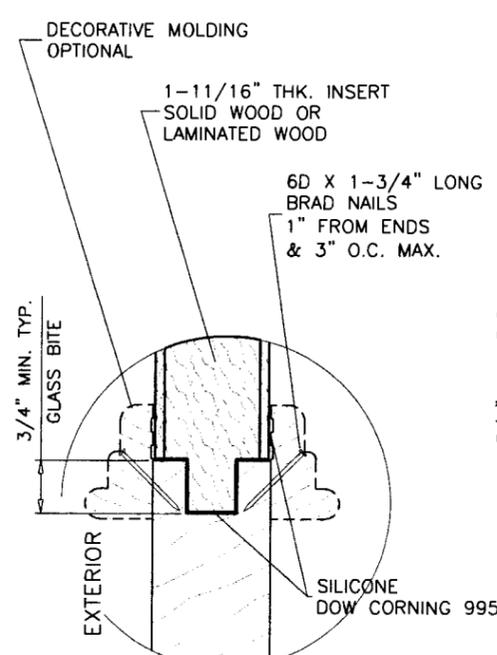

**GLAZING TYPE 'D'**  
WOOD INSET OPTION

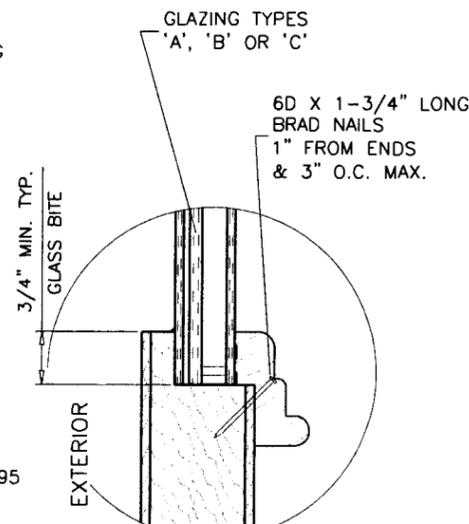

**GLASS WITHIN WOOD INSET OPTION**

**GLAZING OPTIONS**

MAX. AREA OF GLASS TYPES 'A' OR 'B'.....13.0 SQ. FT.  
MAX. AREA OF GLASS TYPE 'C'.....10.4 SQ. FT.  
MAX. AREA OF WOOD INSET.....13.0 SQ. FT.

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 35780  
JUL 28 2010

Approved as complying with the  
Florida Building Code  
Date 08/25/2010  
NOA# 10-0503.02  
Miami Dade Product Control  
Division  
By [Signature]

**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP - ANL \ W09 - 29FPG

OUT-SWING WOOD PATIO DOOR (L.M.I.)  
**F.P.G. WHOLESALE INC.**  
7190 CORAL WAY  
MIAMI, FLORIDA 33155  
TEL. (305) 266-2296 FAX (305) 261-6540


no.	date	description
A	06.30.10	REV. PER BCCO COMMENTS

revisions:

date: 05-11-09  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W09-29**

sheet 2 of 8

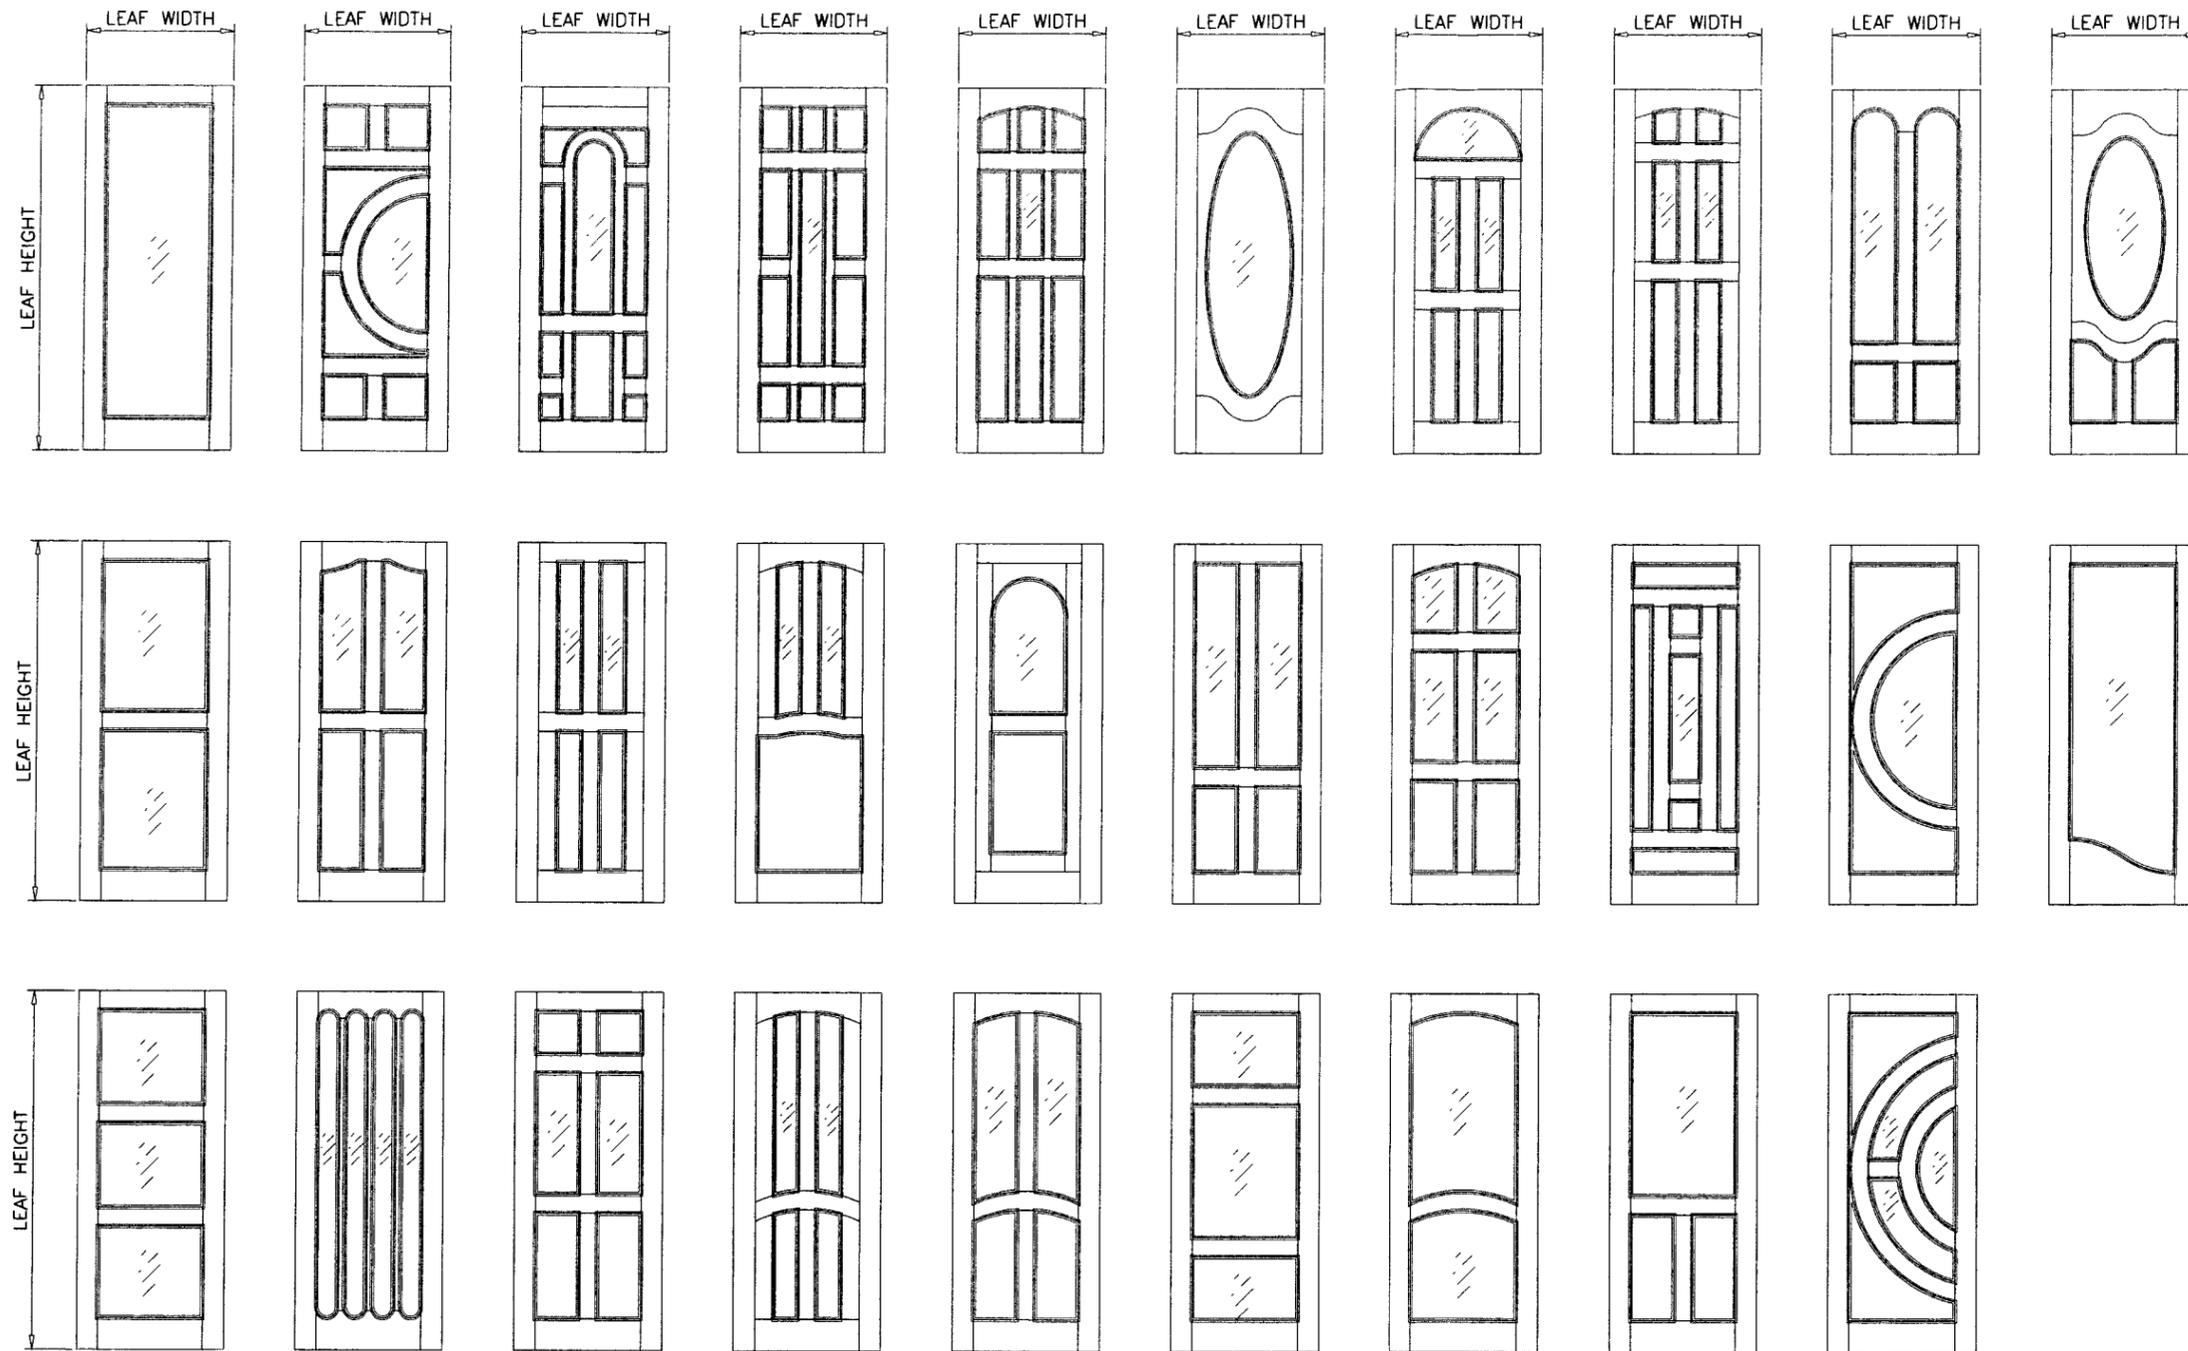

LEAF PATTERNS AS SHOWN ABOVE OR SIMILAR WITH VARIOUS FINISHES AND DECORATIVE MOULDINGS GLAZED WITH GLASS OR SOLID WOOD INSERTS ARE ALSO ALLOWED.

MINIMUM DIMENSIONS:  
 TOP AND BOTTOM RAILS.....5-1/2"  
 LOCK AND HINGE STILES.....5-1/2"  
 INTERMEDIATE STILES.....5-1/2"

SEE SHEET 2 FOR MAX. AREA OF GLASS, WOOD INSERTS AND DESIGN LOAD CAPACITY.

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538

*J.A. Ahmad*  
 2010

Approved as complying with the  
 Florida Building Code  
 Date **08/25/2010**  
 NOA# **10-0503.02**  
 Miami Dade Product Control  
 Division  
 By *Javad Ahmad*


**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W09-29FFG

OUT-SWING WOOD PATIO DOOR (L.M.I.)  
**F.P.G. WHOLESALE INC.**  
 7190 CORAL WAY  
 MIAMI, FLORIDA 33155  
 TEL. (305) 266-2296 FAX (305) 261-6540


no	date	description
A	06.30.10	NO CHANGE THIS SHEET

date: 05-11-09  
 scale: -  
 dr. by: HAMID  
 chk. by:


drawing no.  
**W09-29**  
 sheet 3 of 8

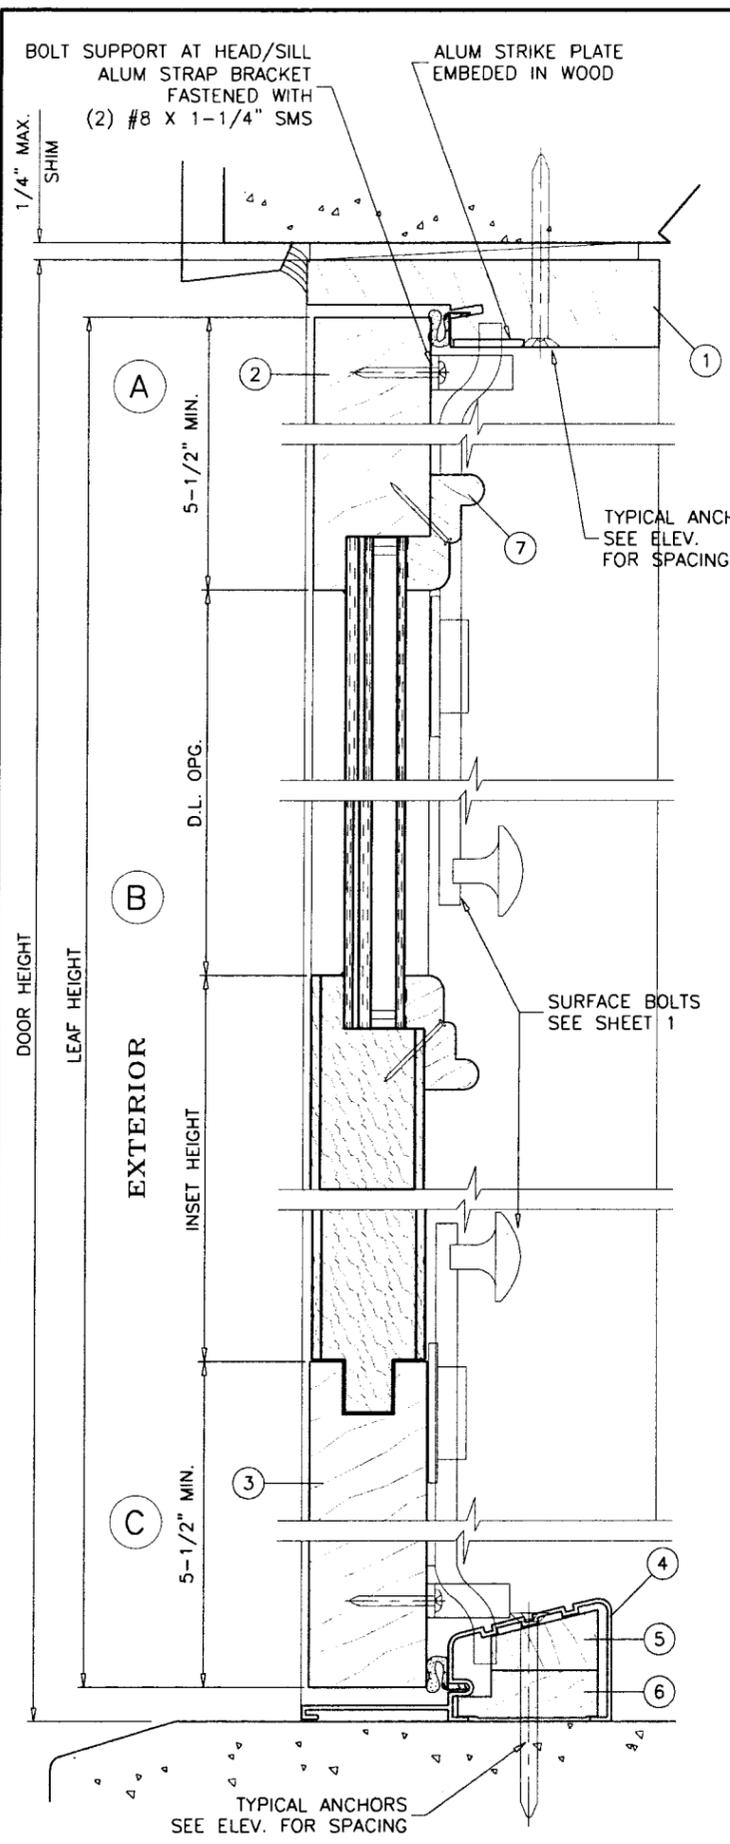

**DOOR UNITS**

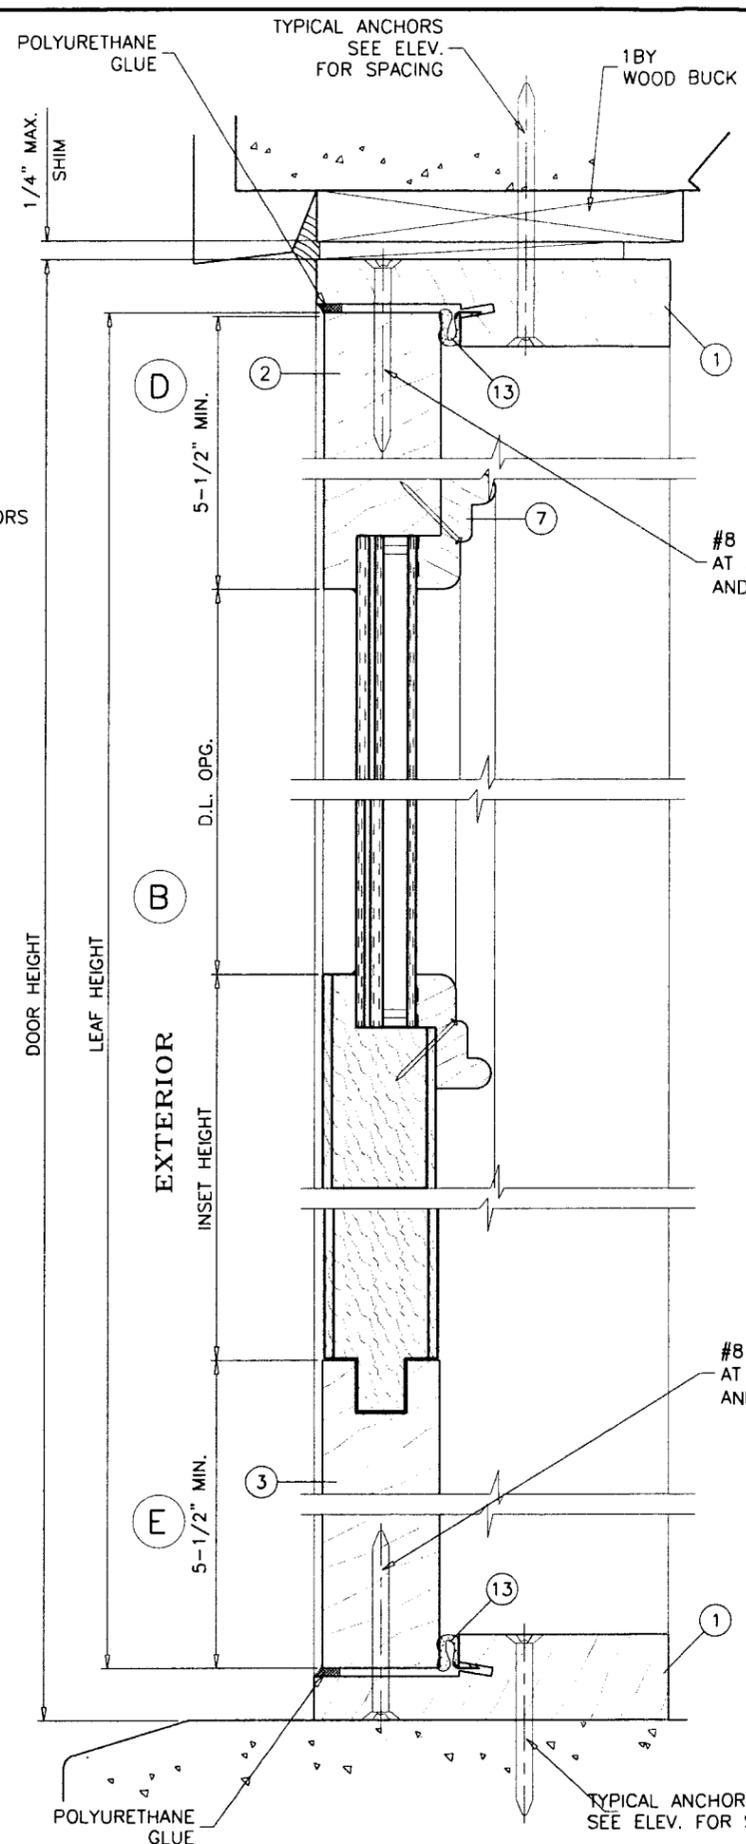

**SIDELITE UNITS**

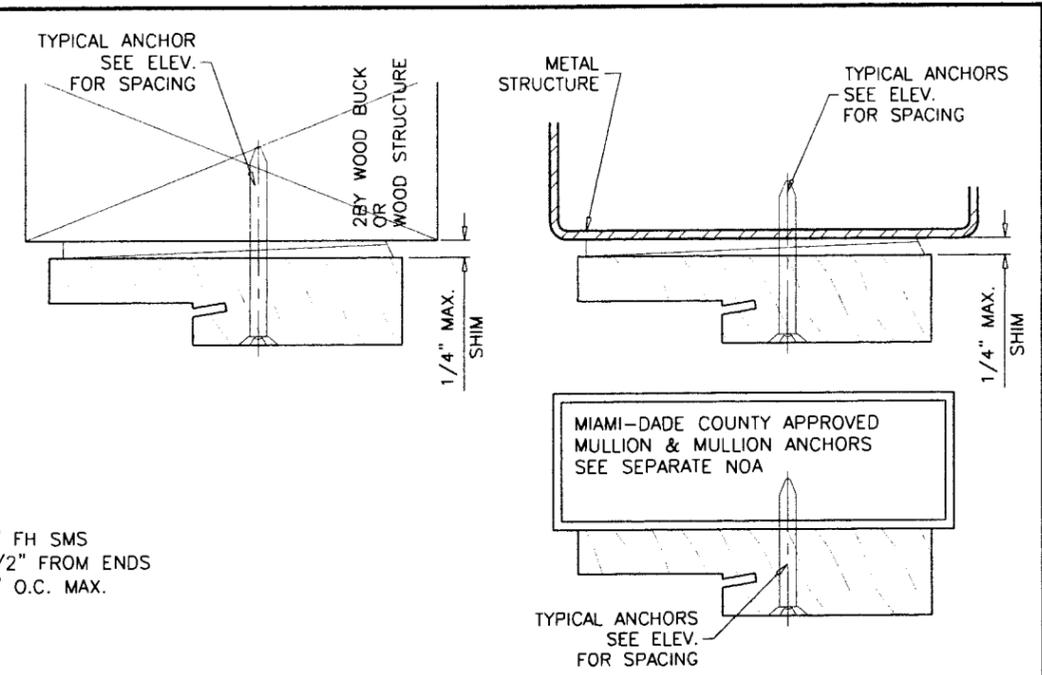

WOOD BUCKS AND METAL STRUCTURE NOT BY F.P.G. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING  
 1/4" DIA. TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)  
 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES  
 1-3/8" MIN. PENETRATION INTO WOOD  
 THRU 1BY BUCKS INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
 DIRECTLY INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
**#14 SMS OR SELF DRILLING SCREWS** (GRADE 2 CRS)  
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")  
 INTO METAL STRUCTURES  
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)  
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)  
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

**TYPICAL EDGE DISTANCE**  
 INTO CONCRETE AND MASONRY = 2" MIN.  
 INTO WOOD STRUCTURE = 1" MIN.  
 INTO METAL STRUCTURE = 3/4" MIN.  
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.  
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. # 3538

Approved as complying with the  
 Florida Building Code  
 Date 08/25/2010  
 NOA# 10-0503.02  
 Miami Dade Product Control  
 Division

By: *[Signature]*



date: 05-11-09  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chg. by:

drawing no.  
**W09-29**  
 sheet 4 of 8

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W09-29PFG

OUT-SWING WOOD PATIO DOOR (L.M.I.)  
**F.P.G. WHOLESALE INC.**  
 7190 CORAL WAY  
 MIAMI, FLORIDA 33155  
 TEL. (305) 266-2296 FAX (305) 261-6540

no	date	by	description
A	06.30.10		REV. PER BCCO COMMENTS

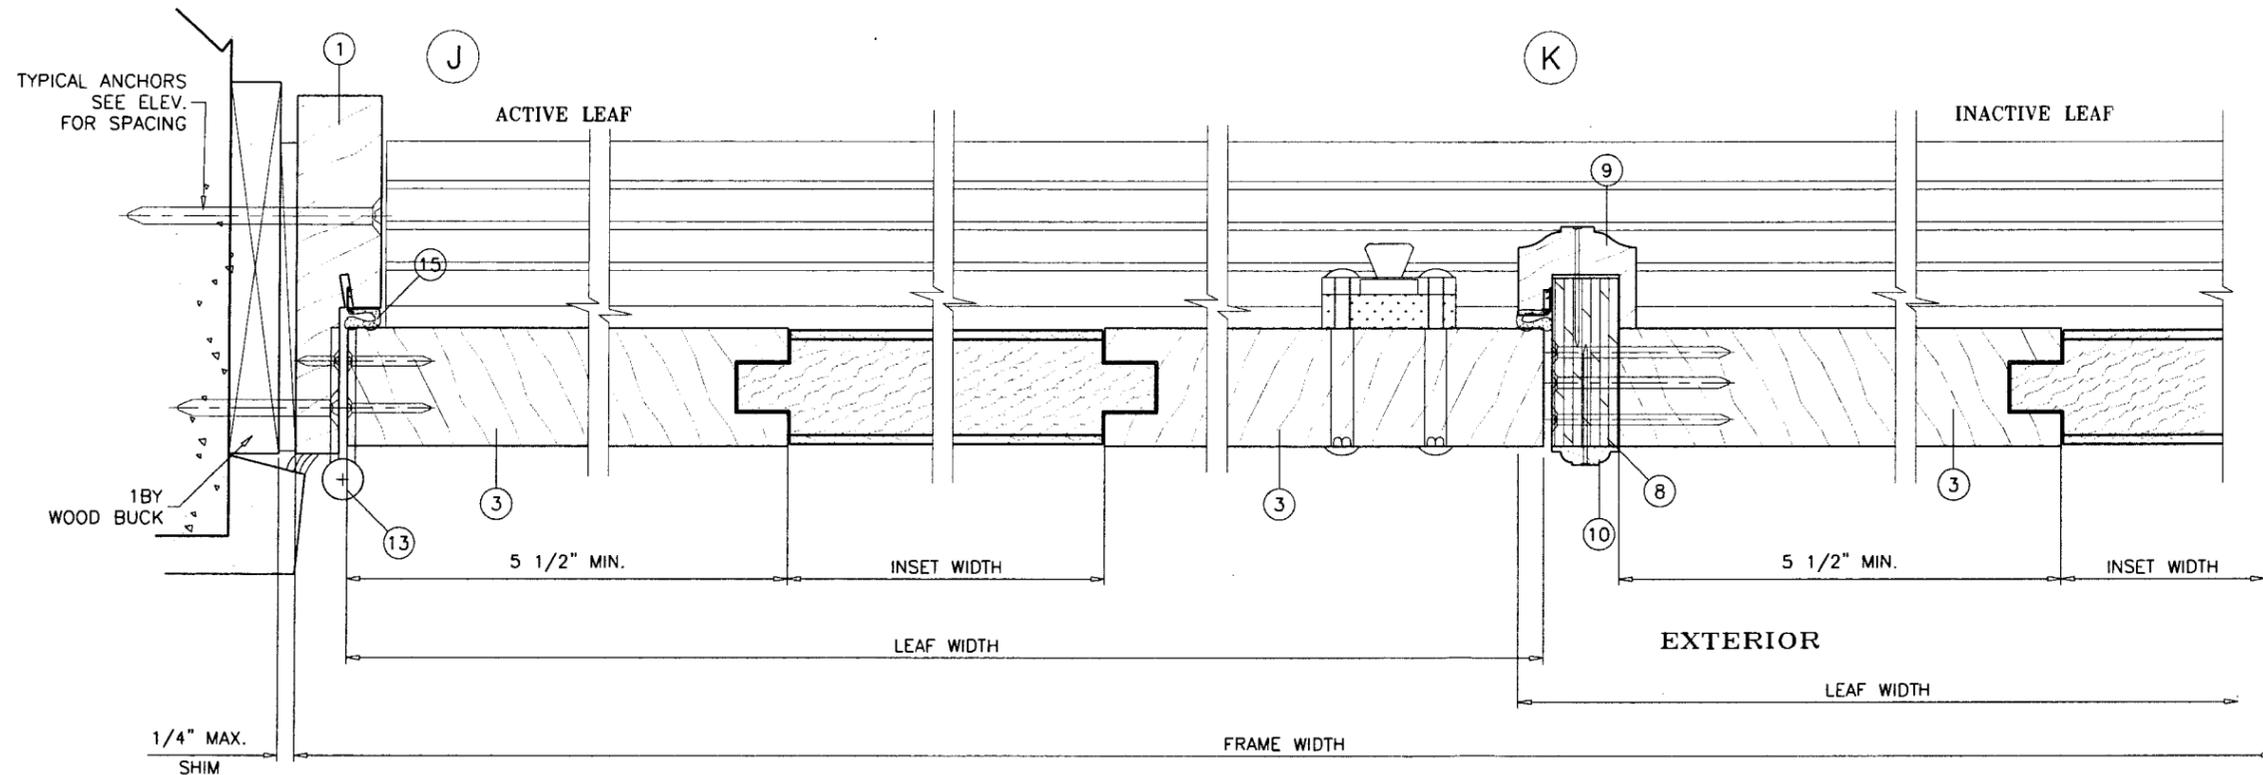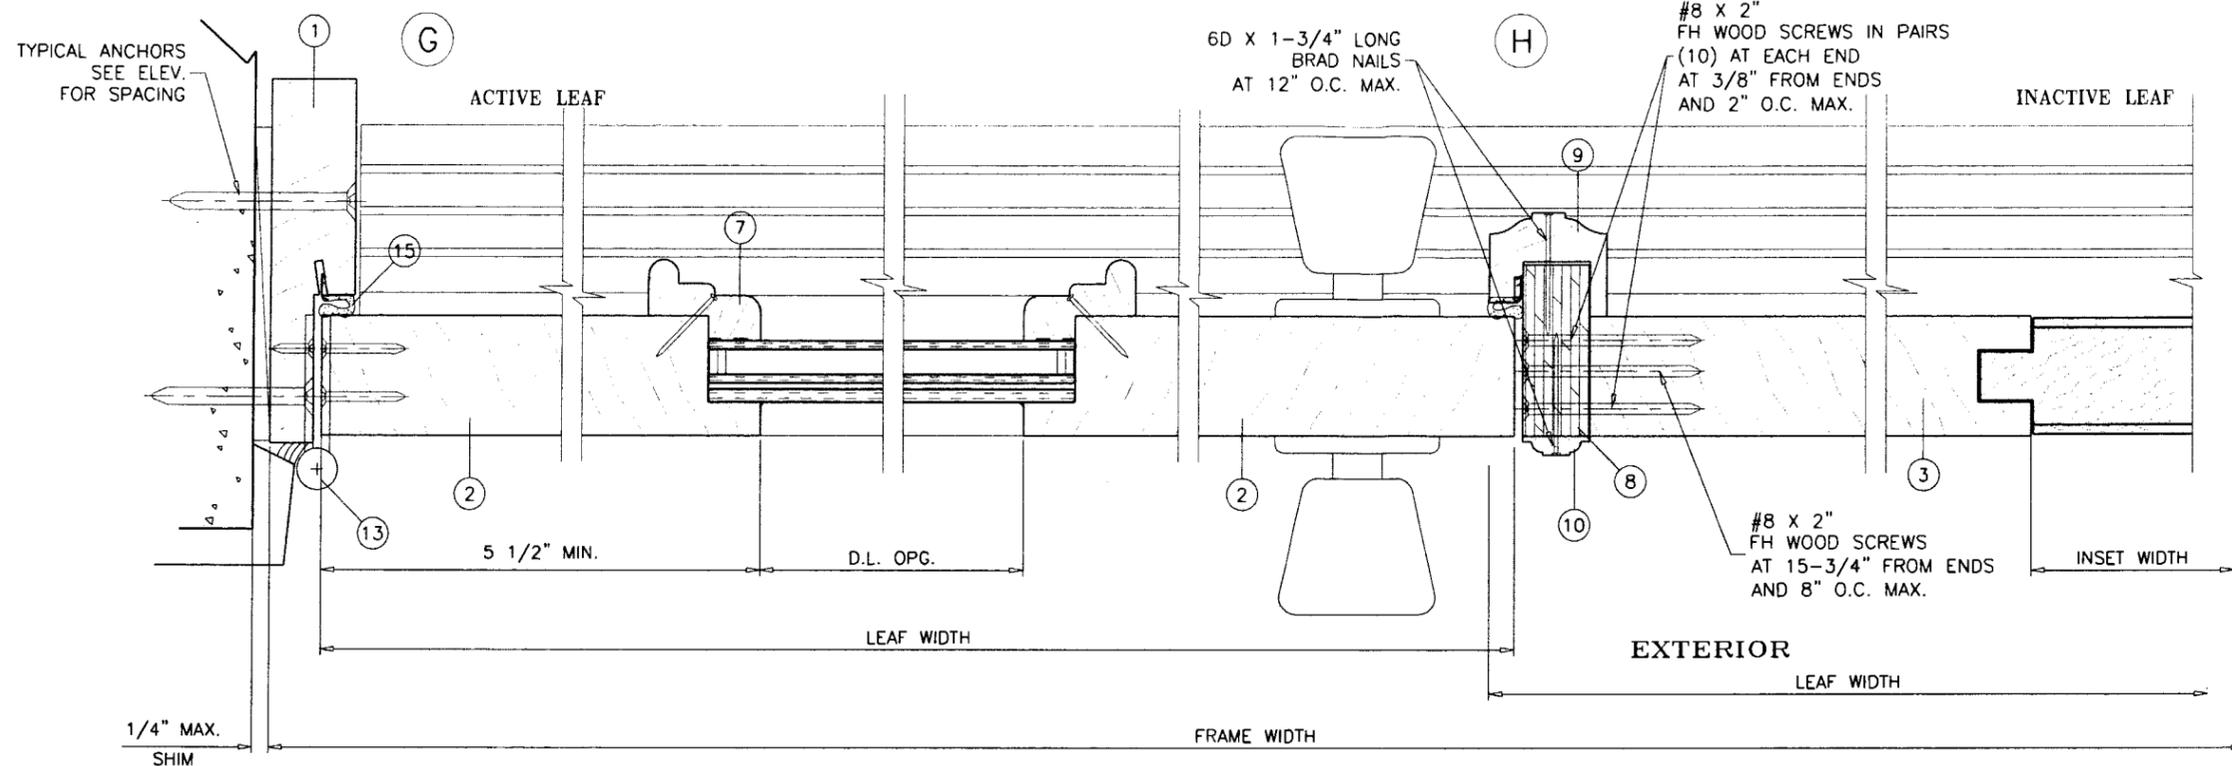

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. REG. NO. 70592  
 3538

Approved as complying with the  
 Florida Building Code  
 Date 08/25/2010  
 NOA# 10-0503.02  
 Miami Dade Product Control  
 Division  
 By [Signature]


**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W09-29FFG

OUT-SWING WOOD PATIO DOOR (L.M.I.)  
**F.P.G. WHOLESALE INC.**  
 7190 CORAL WAY  
 MIAMI, FLORIDA 33155  
 TEL. (305) 266-2296 FAX (305) 261-6540

revisions:	no	date	by	description
	A	06.30.10		REV. PER BCCO COMMENTS

date: 05-11-09  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W09-29**  
 sheet 5 of 8

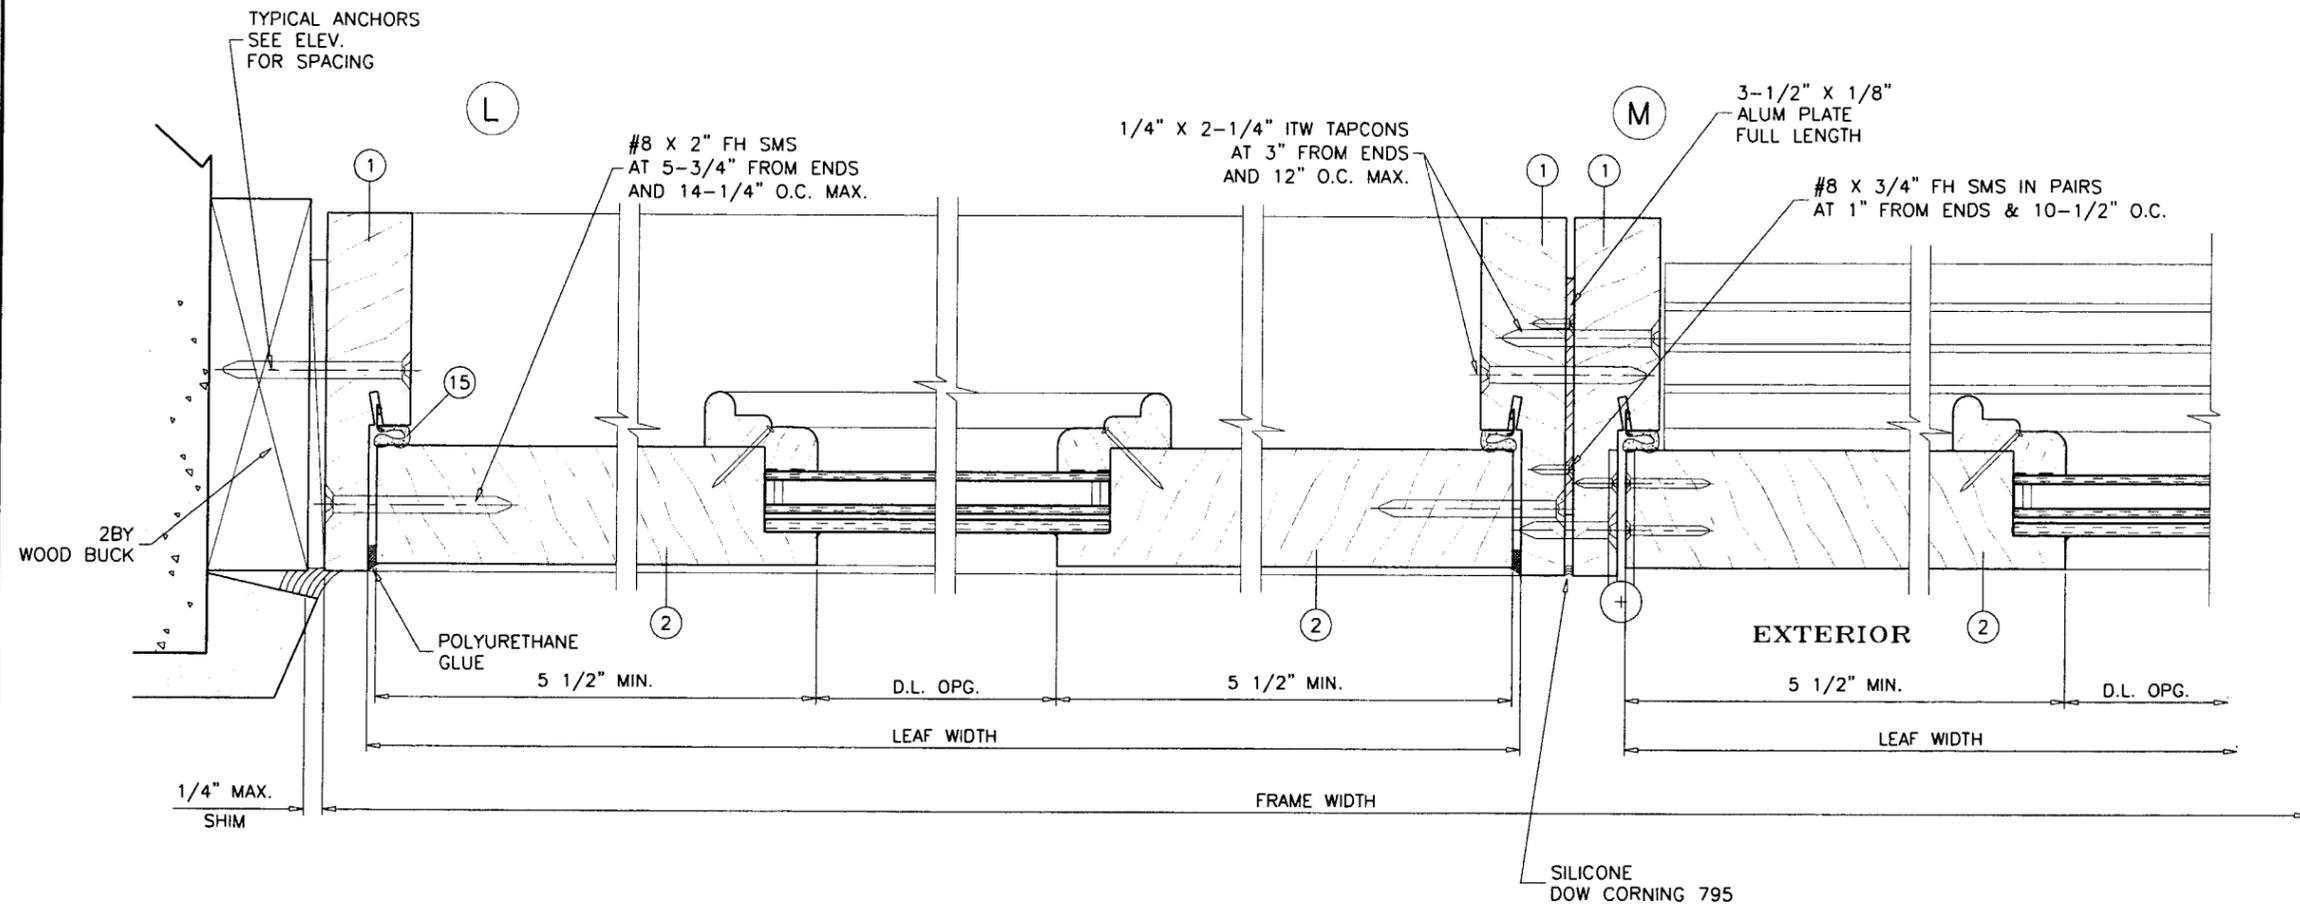

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP - ANL \ W09 - 29FPG













**OUT-SWING WOOD PATIO DOOR (L.M.I.)**  
**F.P.G. WHOLESALE INC.**  
 7190 CORAL WAY  
 MIAMI, FLORIDA 33155  
 TEL. (305) 266-2296 FAX (305) 261-6540

no	date	description
A	06.30.10	REV. PER BCCO COMMENTS

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538  
 JUL 28 2010

Approved as complying with the  
 Florida Building Code  
 Date 08/25/2010  
 NOA# 10-0503.02  
 Miami Dade Product Control  
 Division  
 By *[Signature]*

date: 05-11-09  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chk. by:  
 drawing no.  
**W09-29**  
 sheet 6 of 8

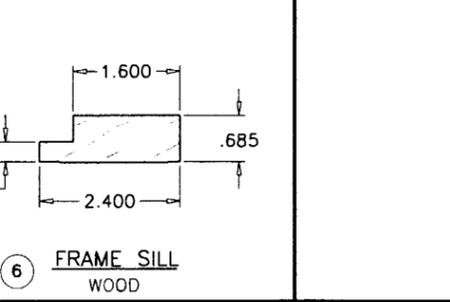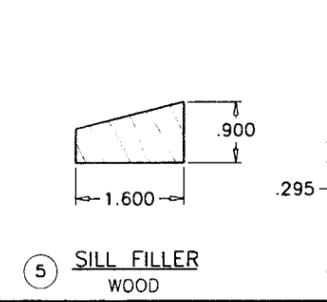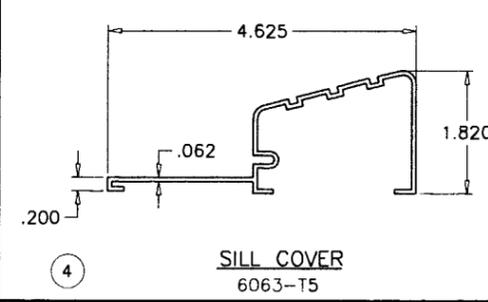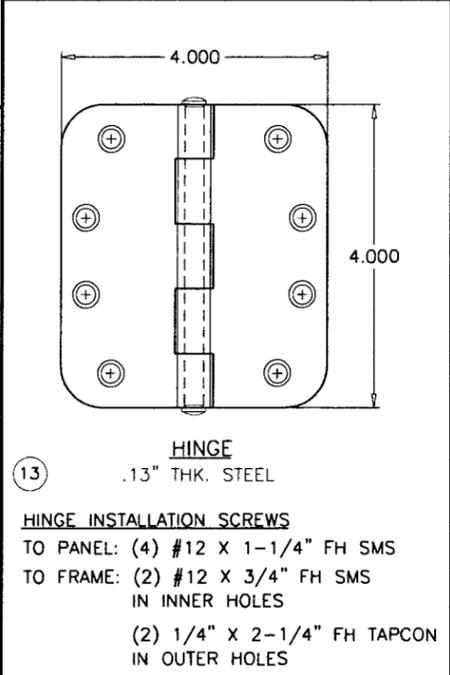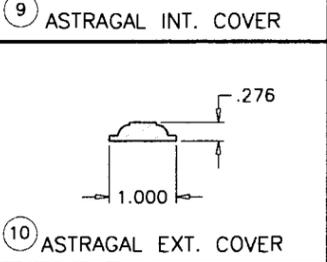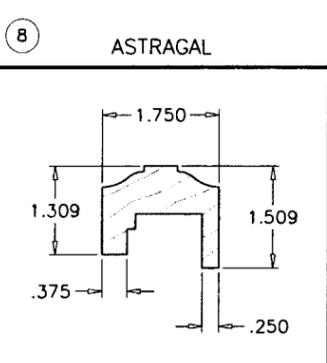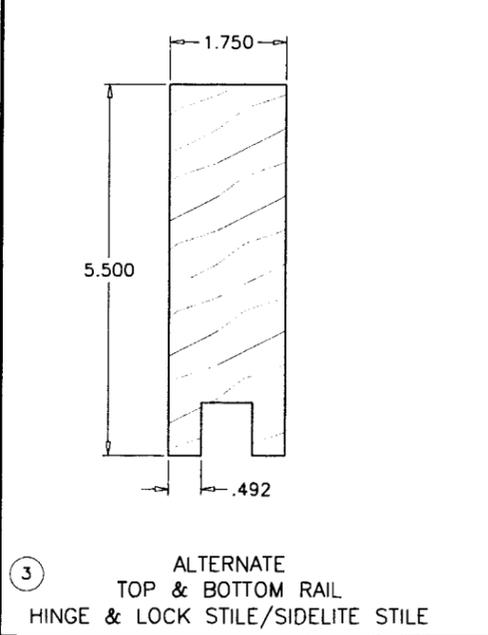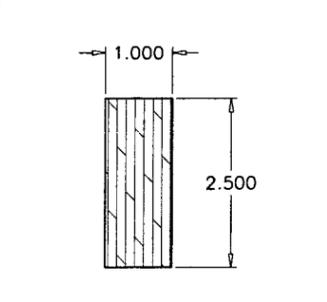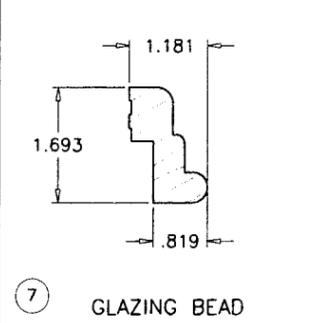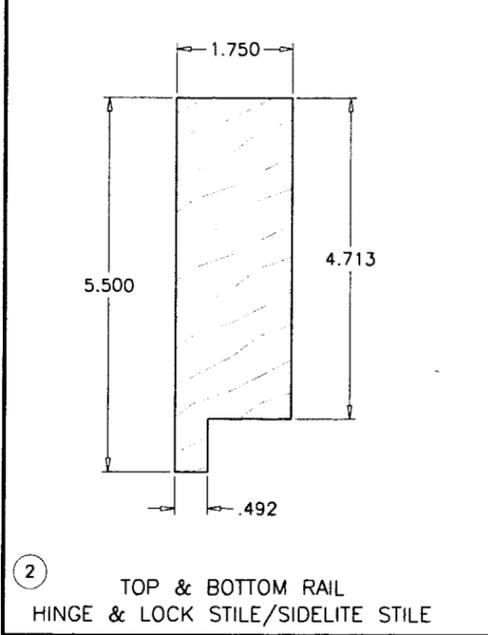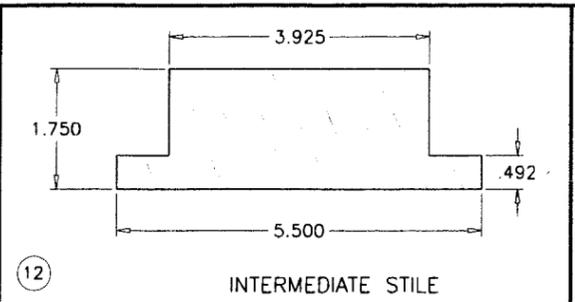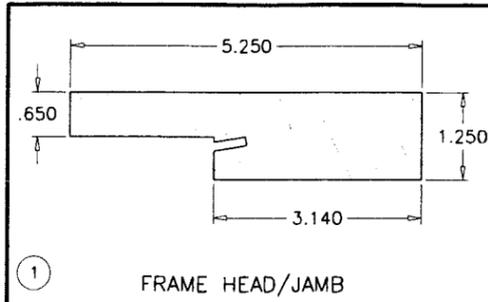

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	-	3/	DOOR FRAME HEAD/JAMB	WOOD	-
2	-	AS REQD.	TOP & BOTTOM RAIL/HINGE & LOCK STILE/SIDELITE STILE	WOOD	-
3	-	AS REQD.	ALTERNATE TOP & BOTTOM RAIL/HINGE & LOCK STILE/SIDELITE STILE	WOOD	-
4	-	1	SILL COVER	ALUMINUM	-
5	-	1	SILL FILLER	WOOD	-
6	-	1	FRAME SILL	WOOD	-
7	-	AS REQD.	GLAZING BEAD	WOOD	-
8	-	1	ASTRAGAL	PLYWOOD	AB MARINE GRADE 13 PLY
9	-	1	ASTRAGAL INTERIOR COVER	WOOD	-
10	-	-	ASTRAGAL EXTERIOR COVER	WOOD	-
12	-	AS REQD.	INTERMEDIATE STILE	WOOD	-
13	S44	4/	LEAF HINGE	STEEL OR ST/ST	DELTANA
14	#10 X 3"	3/	CORNER FRAME ASSEMBLY SCREWS FLAT HEAD	-	-
15	QEBD650	AS REQD.	FRAME WEATHERSTRIPPING Q-LON	PVC	SCHLEGEL

**WOOD OPTIONS**  
 1- SOUTHERN CHERRY  
 2- ANDEAN WALNUT  
 3- TROPICAL WALNUT  
 4- WHITE OAK  
 5- YESQUERO

SPECIFIC GRAVITY = 0.50 MIN. (E=1,400,000)  
 GRADE = 2 MIN.  
 MOISTURE CONTENT = 12% MAX.

**SEALANT:**  
 FRAME & PANEL CORNERS SEALED WITH DUROLOK CM902 SEALANT.  
 FRAME AND PANEL CLADDING GLUED WITH TECHNOBOND L560S.

**HINGES:** 4" X 4" X .130" THK. HINGE  
 4 PER LEAF AT 9-3/4" FROM EACH END  
 AND 25-1/2" O.C. MAX.

**LOCKS:**  
 CONVENTIONAL LOCKSET WITH DEAD BOLT AT ACTIVE LEAF LOCK STILE  
 KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR  
 PASSAGE LOCK AT 36" FROM BOTTOM,  
 DEAD BOLT AT 42" FROM BOTTOM

OPTION 1 = EMTEK CORTINA KEYED ENTRY DOOR LEVERSET  
 OPTION 2 = KWIKSET POLO KEYED ENTRY DOOR KNOBSET  
 OPTION 3 = BALDWIN KEYED ENTRY DOOR LEVERSET

MANUALLY OPERATED SURFACE BOLTS BY 'DELTANA' AT TOP AND  
 BOTTOM OF ACTIVE LEAF.  
 (MUST BE ENGAGED DURING PERIODS OF HURRICANE WARNING)

MANUALLY OPERATED CONCEALED FLUSH BOLTS 283D BY HAGER OR FPG  
 WITH 5/8" THROW AT TOP & BOTTOM OF INACTIVE LEAF.

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538

JUL 28 2010

Approved as complying with the  
 Florida Building Code  
 Date: 08/25/2010  
 NOA# 10-0503.02  
 Miami Dade Product Control  
 Division  
 By: *[Signature]*

**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W09-29FPG


OUT-SWING WOOD PATIO DOOR (L.M.I.)  
**F.P.G. WHOLESALE INC.**  
 7190 CORAL WAY  
 MIAMI, FLORIDA 33155  
 TEL. (305) 266-2296 FAX (305) 261-6540

revisions:	no	date	by	description
	A	06.30.10		REV. PER BOCO COMMENTS


date: 05-11-09  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chg. by:

drawing no.  
**W09-29**

sheet 7 of 8

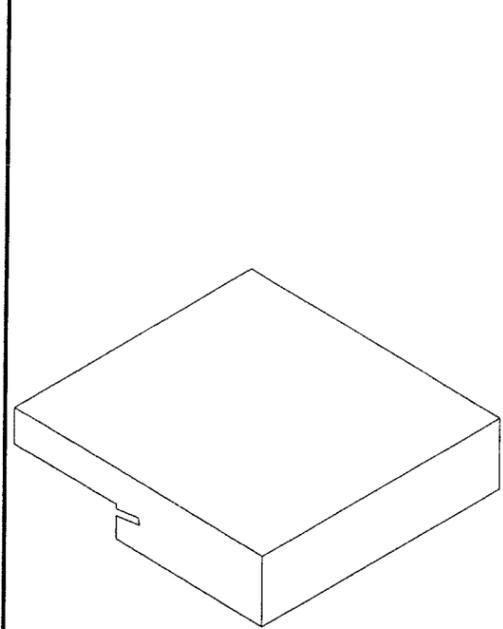


FRAME TOP CORNER

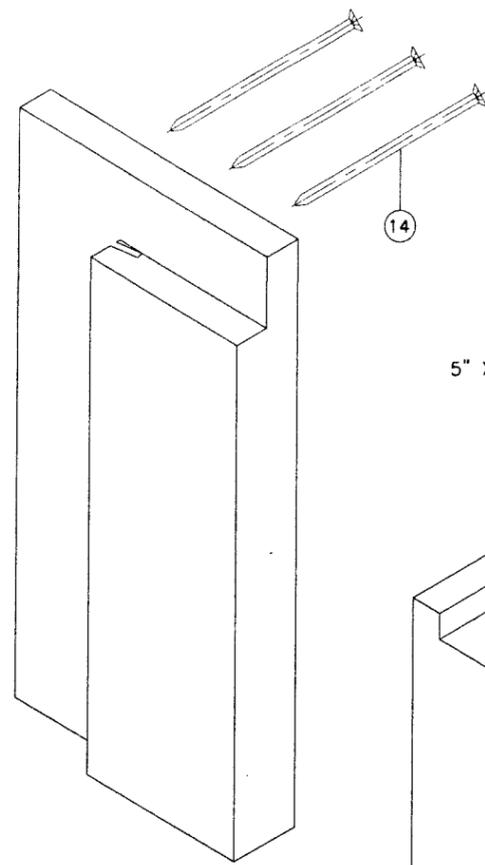


5" X 5/8" WOOD DOWEL

14

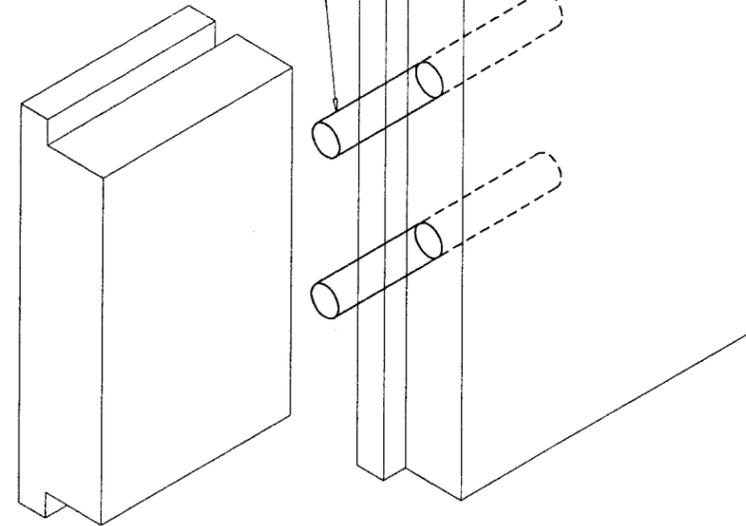


INTERMEDIATE CORNER

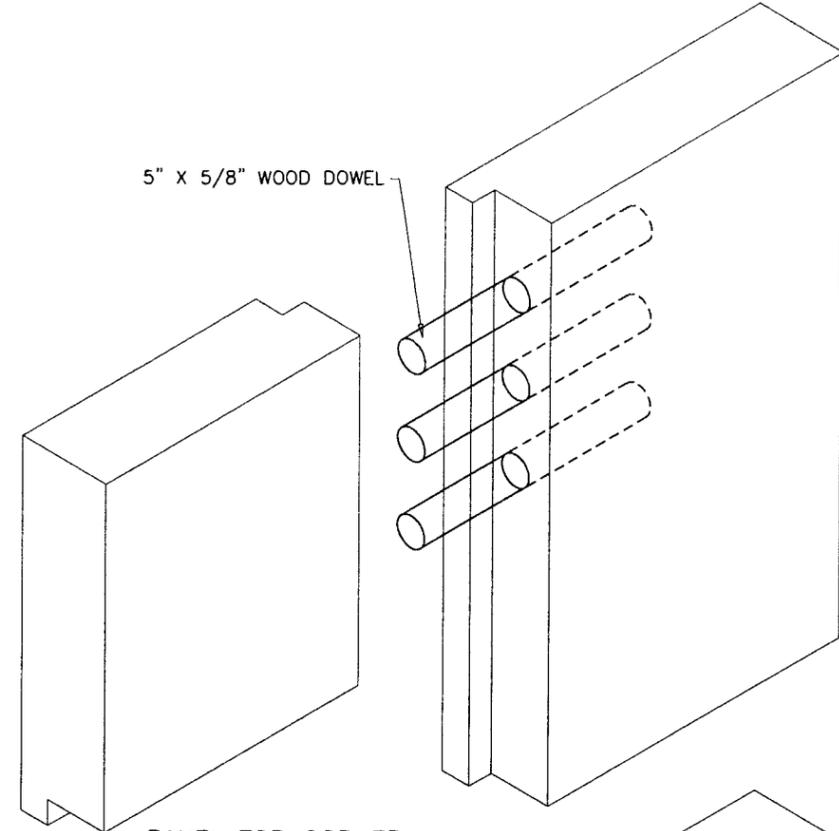


5" X 5/8" WOOD DOWEL


PANEL TOP CORNER

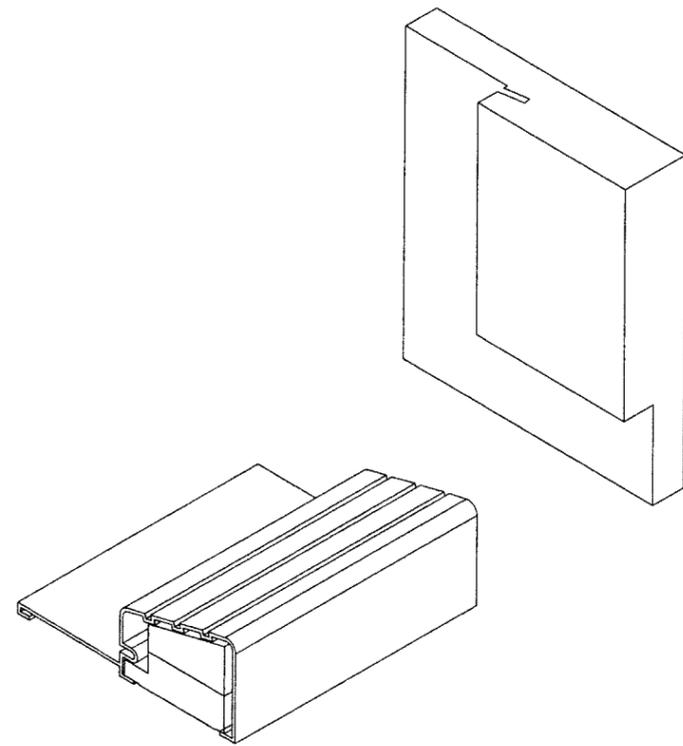

FRAME BOTTOM CORNER



14

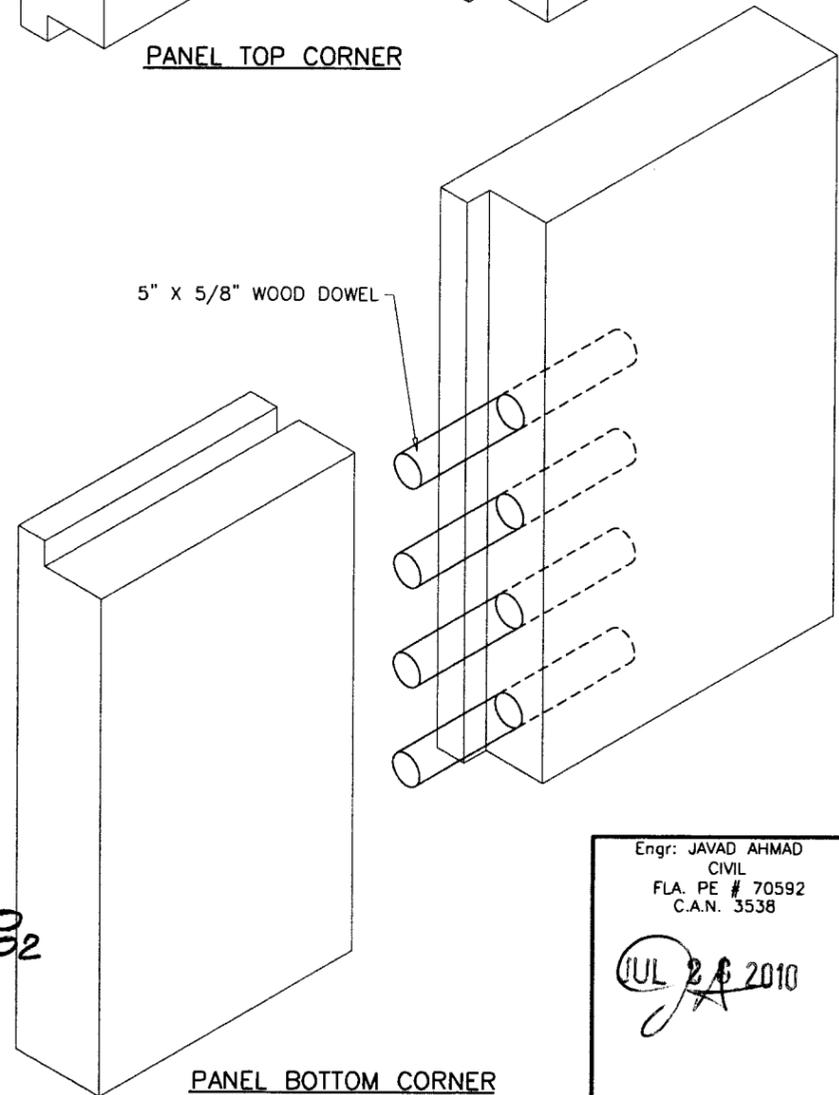

5" X 5/8" WOOD DOWEL

PANEL BOTTOM CORNER

Approved as complying with the  
 Florida Building Code  
 Date: 08/25/2010  
 NOA#: 10-0503.02  
 Miami Dade Product Control  
 Division  
 By: *[Signature]*

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538  
 JUL 26 2010

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP - ANL \ W09 - 29FPG

OUT-SWING WOOD PATIO DOOR (L.M.I.)  
**F.P.G. WHOLESALE INC.**  
 7190 CORAL WAY  
 MIAMI, FLORIDA 33155  
 TEL. (305) 266-2296 FAX (305) 261-6540

revisions:

no	date	by	description
A	06.30.10		REV. PER BCCO COMMENTS

date: 05-11-09  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W09-29**  
 sheet 8 of 8