



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339**

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

**Arch Windows, LLC dba AWP
8130 NW 74th Avenue
Medley, FL 33166**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "1500" Outswing Aluminum Projected Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W10-16**, titled "Series-1500 Aluminum Projected Wdw. (L.M.I.)" Sheets 1 through 6 of 6, dated 03/23/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1, and Evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Manuel Perez, P.E.**







**NOA No. 10-0506.01
Expiration Date: September 08, 2015
Approval Date: September 08, 2010
Page 1**


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- A. DRAWINGS**
1. Manufacturer's die drawings and sections.
 2. Drawing No. **W10-16**, titled "Series-1500 Aluminum Projected Wdw. (L.M.I.)" Sheets 1 through 6 of 6, dated 03/23/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
- B. TESTS**
1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94along with marked-up drawings and installation diagram of Series 1500 outswing aluminum projected window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-6116**, dated 02/04/10, signed and sealed by Jorge A. Causo, P.E.
- C. CALCULATIONS**
1. Anchor verification calculations and structural analysis, complying with FBC-2007, dated 04/07/10, prepared, signed and sealed by Javad Ahmad, P.E.
Complies with ASTM E1300-04
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. None.
- F. STATEMENTS**
1. Statement letter of conformance and no financial interest, dated March 19, 2010, signed and sealed by Javad Ahmad, P.E.
 2. Proposal issued by BCCO, dated 09/30/09, signed by Manuel Perez, P. E.
- G. OTHERS**
1. None.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 10-0506.01
Expiration Date: September 08, 2015
Approval Date: September 08, 2010

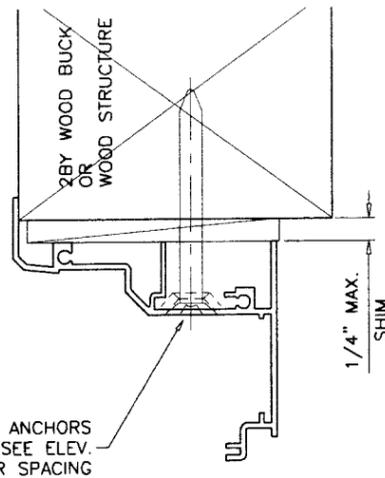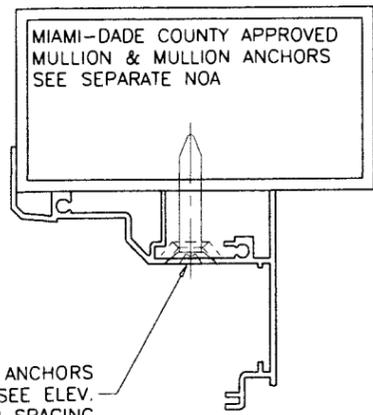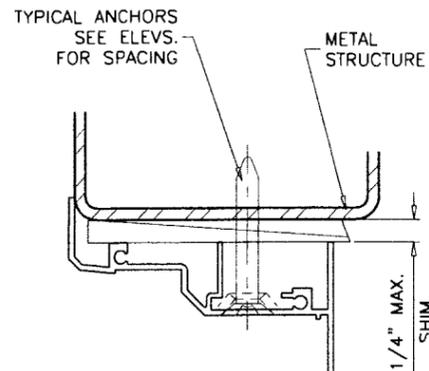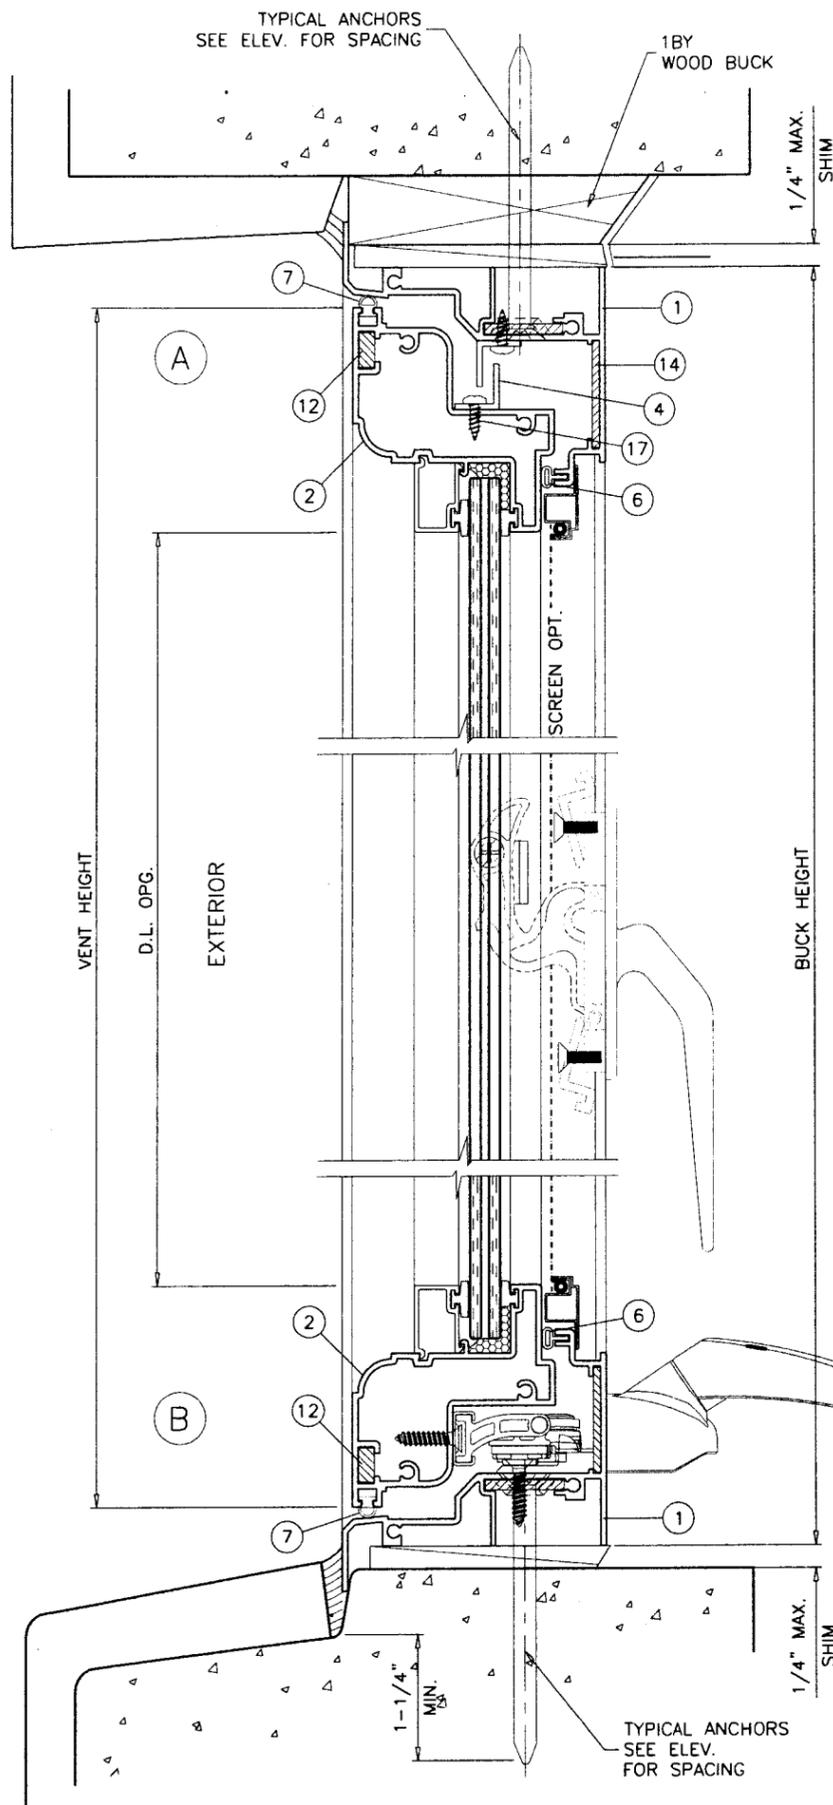

WOOD BUCKS AND METAL STRUCTURE NOT BY AWP WDW. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

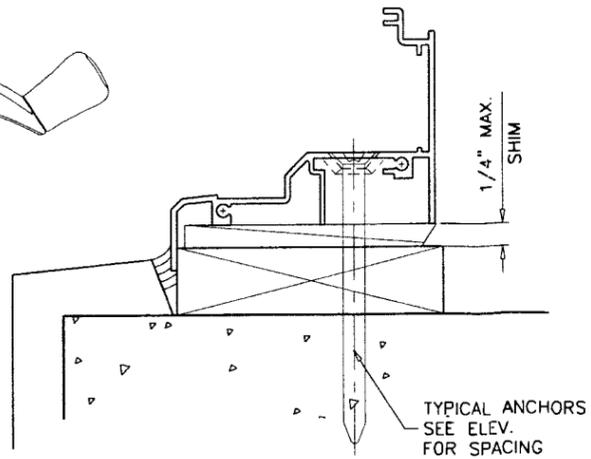

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)
1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

SEALANTS:
 ALL JOINTS AND FRAME CONNECTIONS SEALED WITH SILICONE OR ACRYLIC SEALANT.

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

APR 23 2010

Approved as complying with the
 Florida Building Code
 Date **SEPT. 8, 2010**
 NOA# **10-0506.01**
 Miami Dade Product Control
 Division
 By *Mauro Perez*

af c

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W10-16AWP



SERIES-1500 ALUMINUM PROJECTED WDW. (L.M.I.)
 ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

revisions:	no	date	by	description

date: w03-23-10
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W10-16

sheet 3 of 6

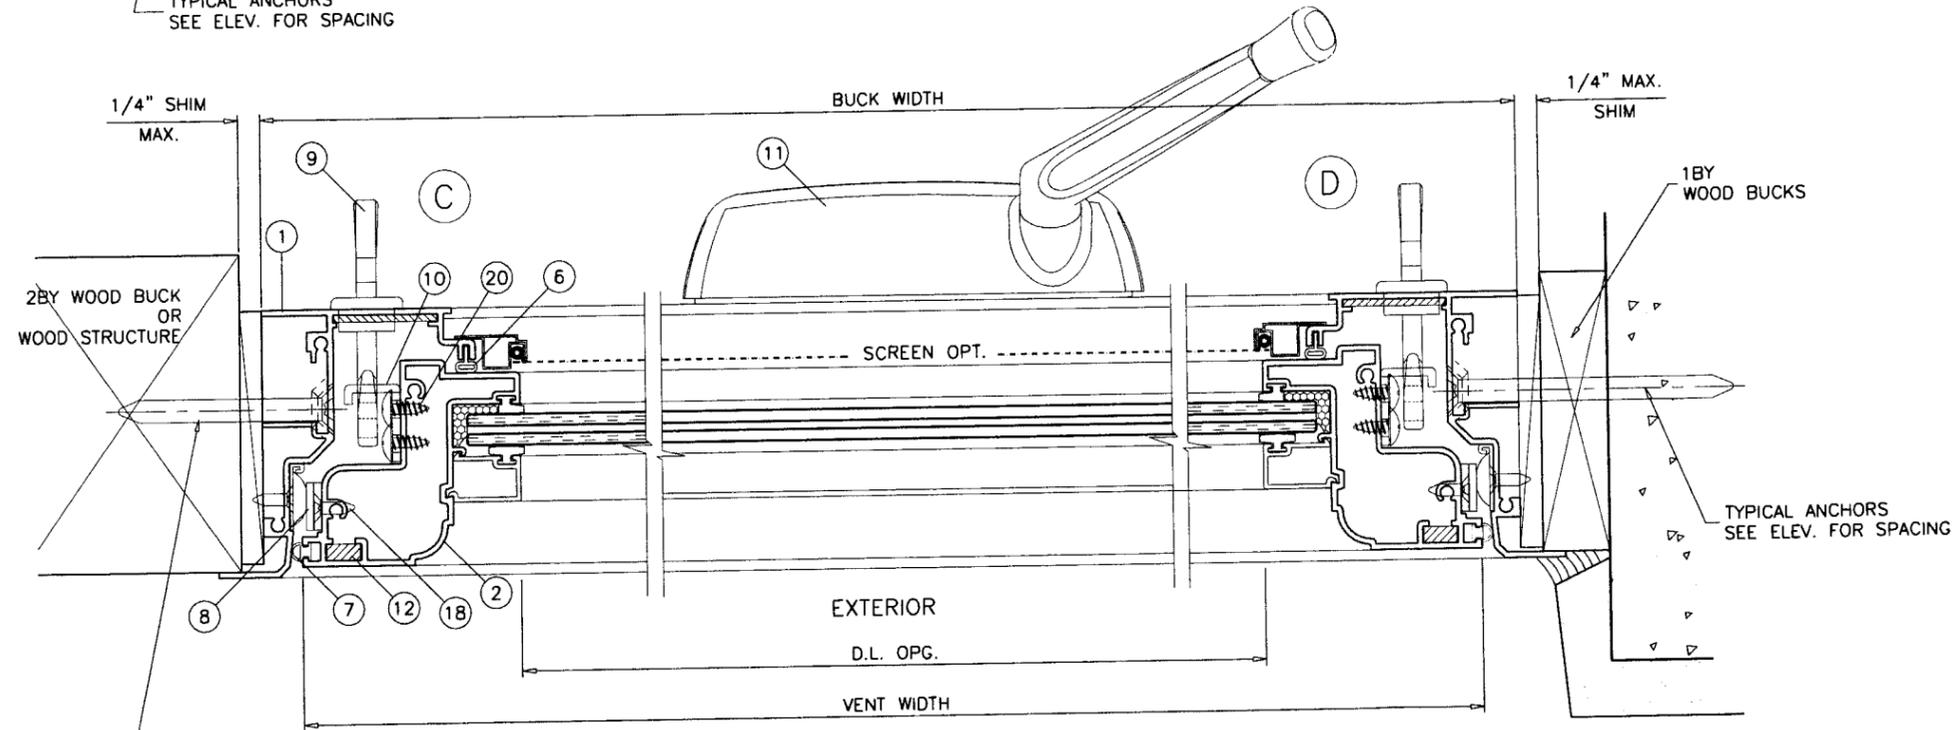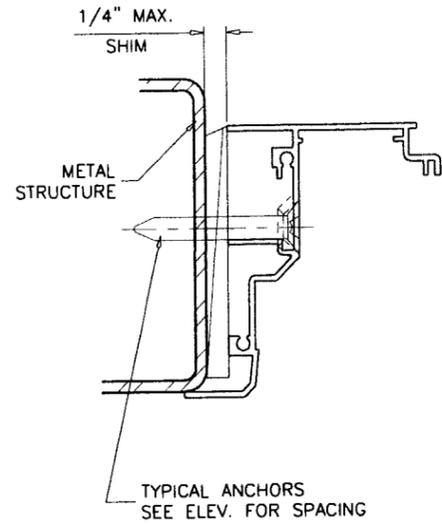

TYPICAL ANCHORS
SEE ELEV. FOR SPACING

MIAMI-DADE COUNTY
APPR'D MULLION
SEE SEPARATE NOA

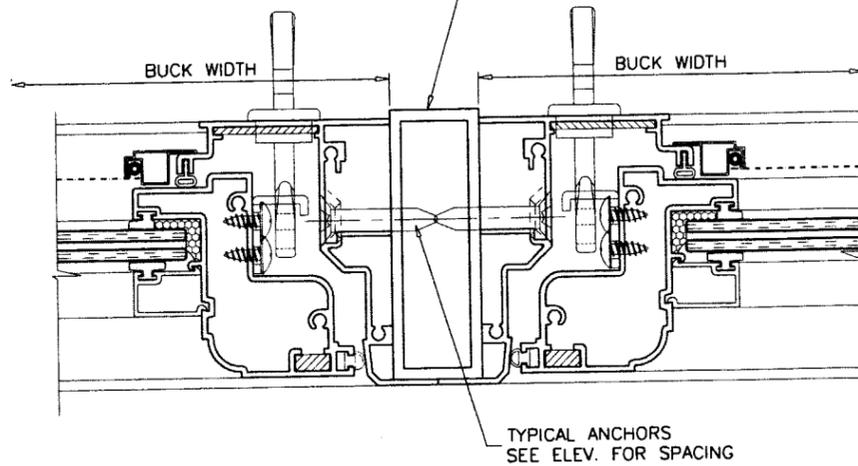

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

JA
APR 23 2010

Approved as complying with the
Florida Building Code
Date **SEPT. 8 2010**
NOA# **10-0506.01**
Miami Dade Product Control
By *Manuel P...*









afc
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W10-16AWP

SERIES-1500 ALUMINUM PROJECTED WDW. (L.M.I.)
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

revisions:	
no.	date by description

date: W03-23-10
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W10-16
sheet 4 of 6

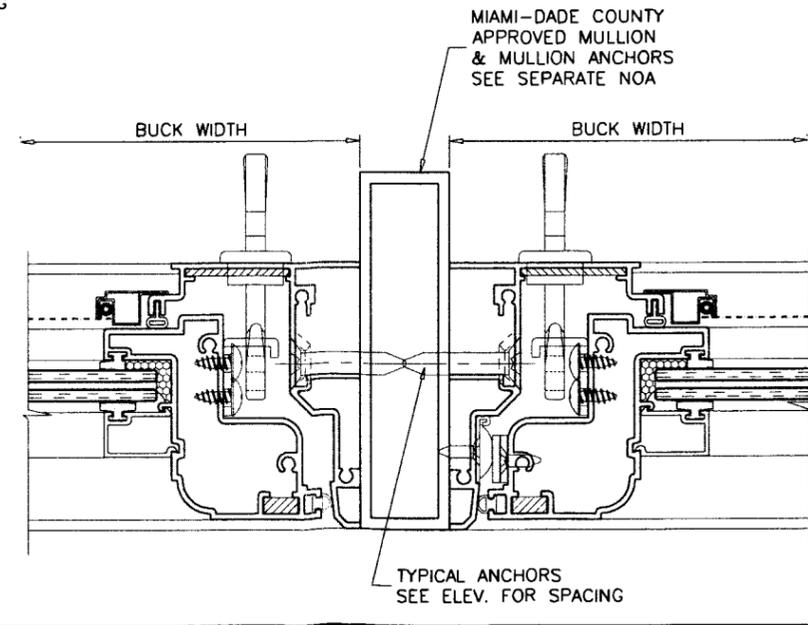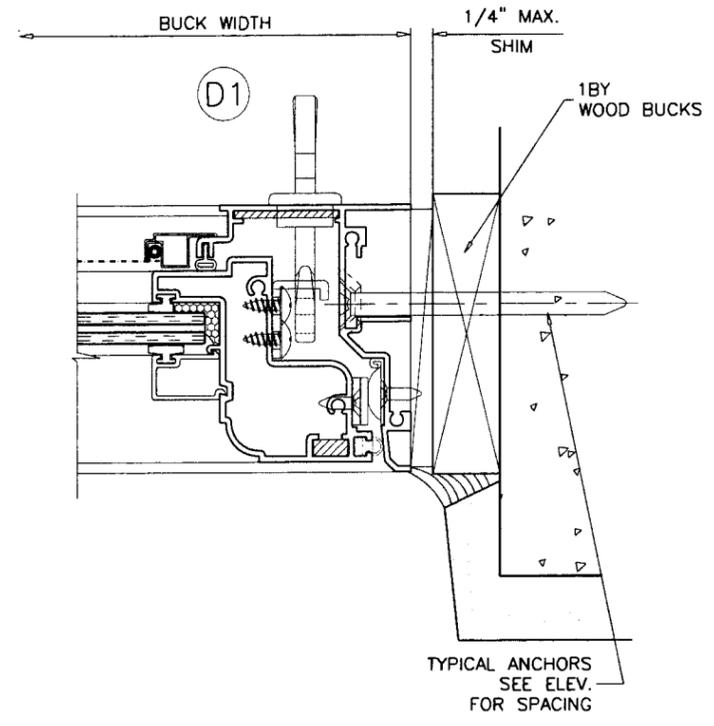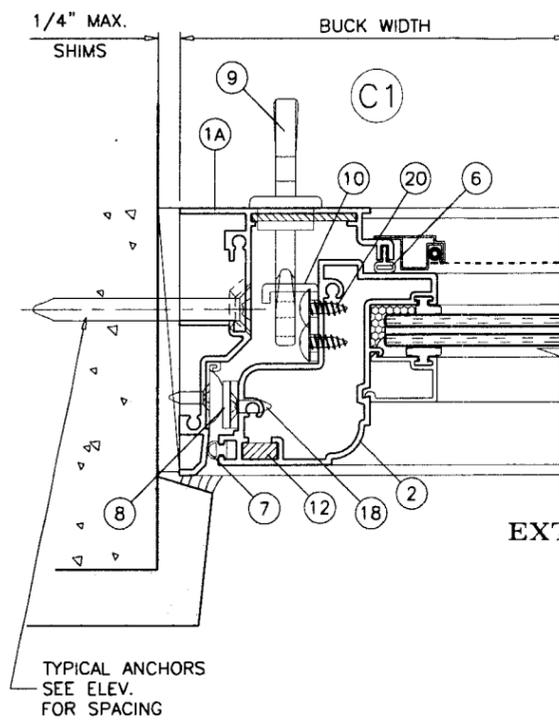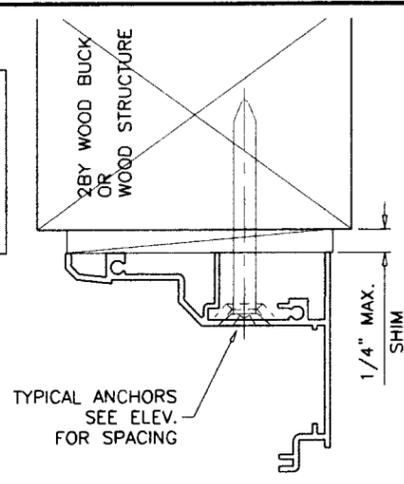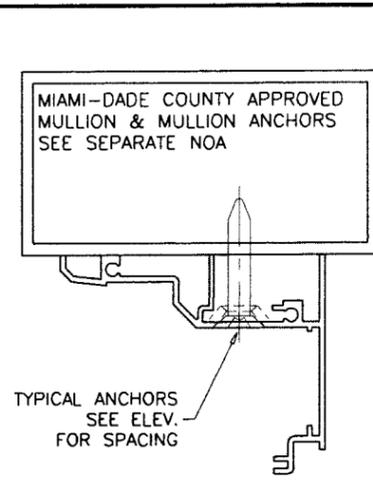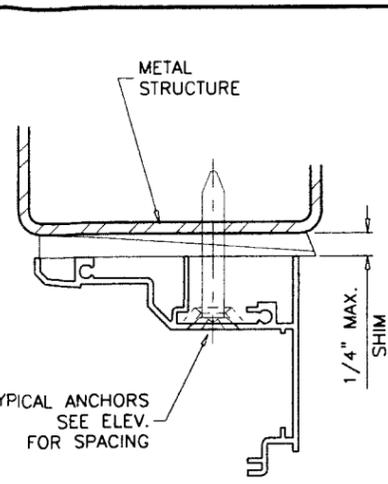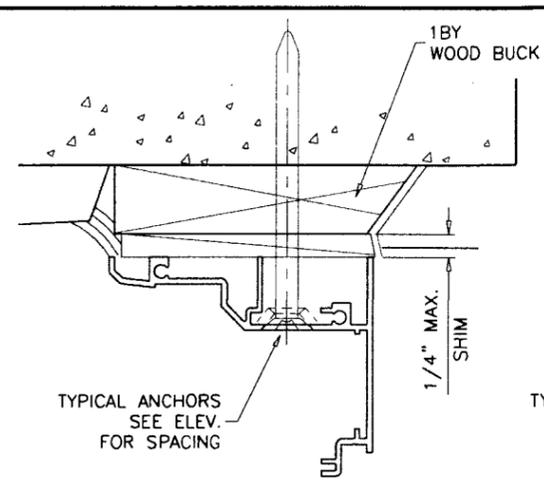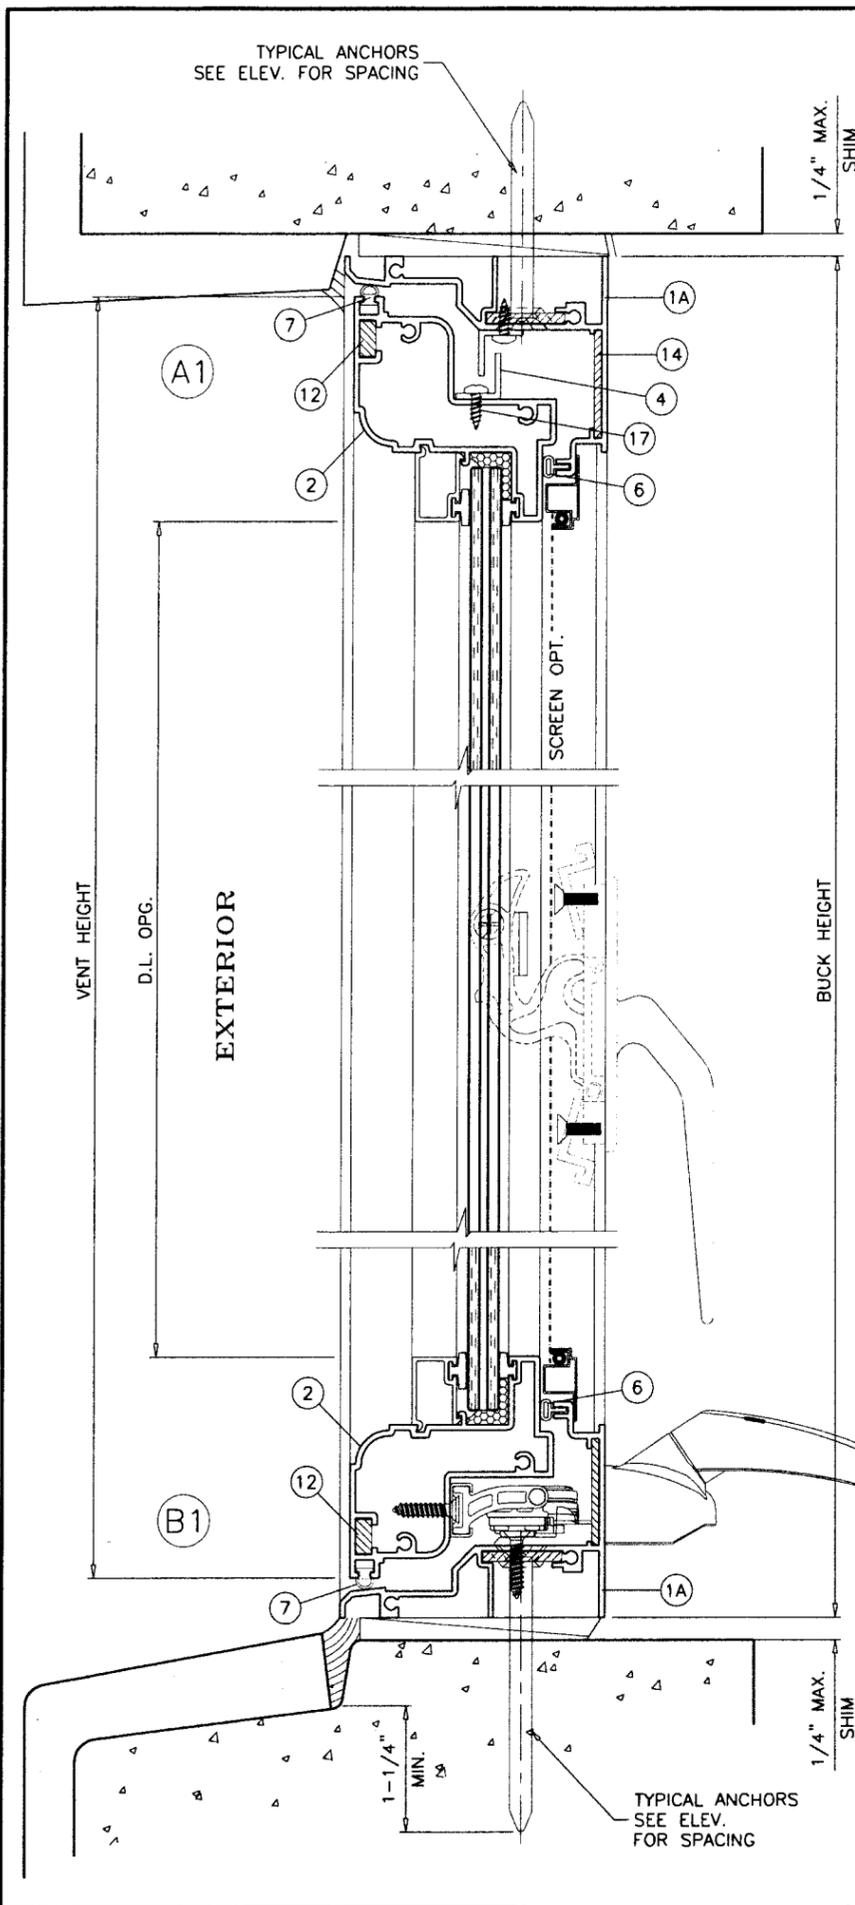

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

JAH
 APR 23 2010

Approved as complying with the
 Florida Building Code
 Date: **SEPT. 8, 2010**
 NOA# **10-0506.01**
 Miami Dade Product Control
 By: *Manuel Perez*

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W10-16AWP


SERIES-1500 ALUMINUM PROJECTED WDW. (L.M.I.)
ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

revisions:	no	date	by	description


date: W03-23-10
 scale: 1/2" = 1"
 dr. by: HAMID
 chg. by:

drawing no.
W10-16


sheet 5 of 6

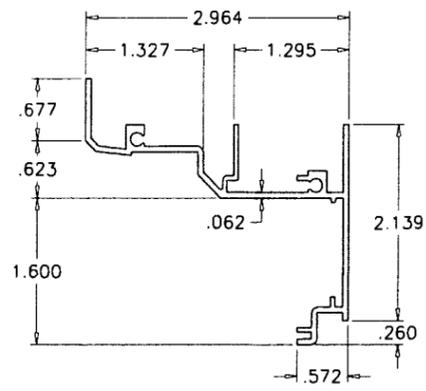


① FLANGE FRAME

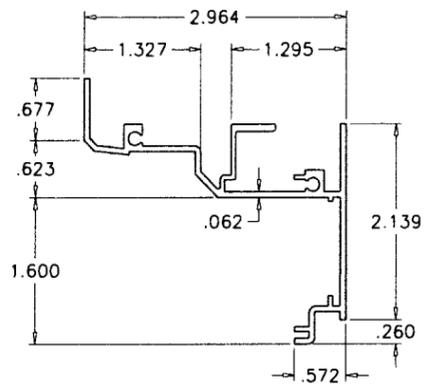


①.1 ALT. FLANGE FRAME

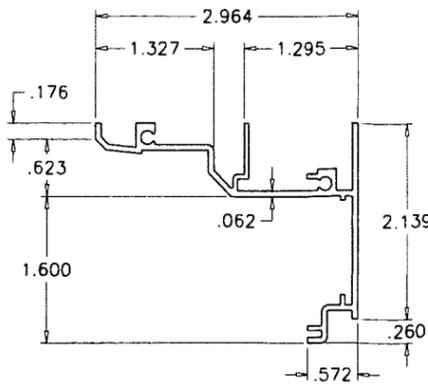

①A FLUSH FRAME

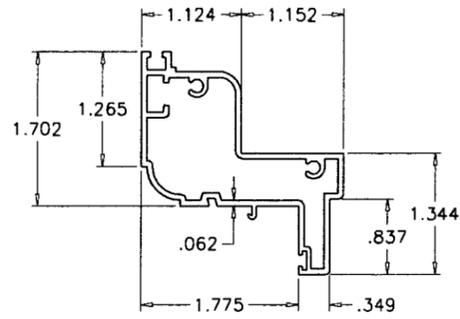


② VENT

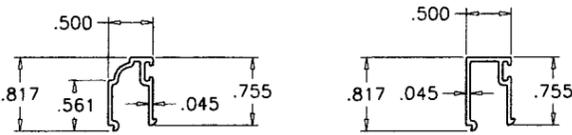


③ GLAZING BEADS

③A

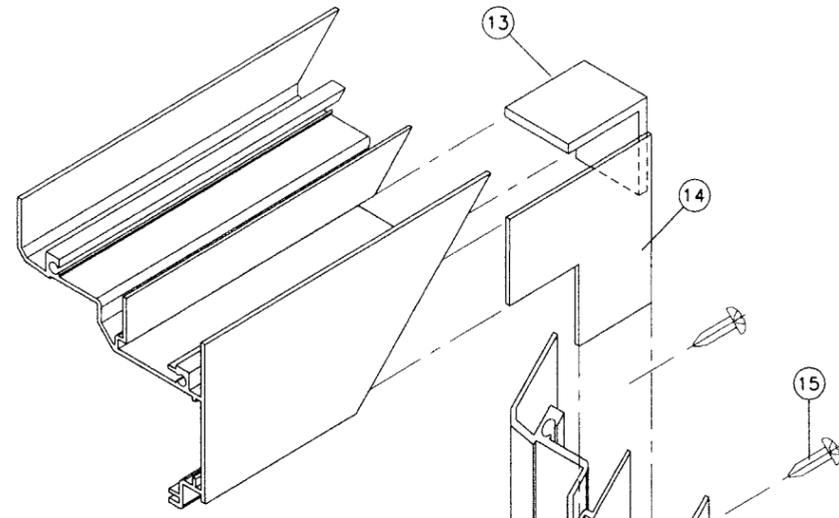

FRAME CORNER

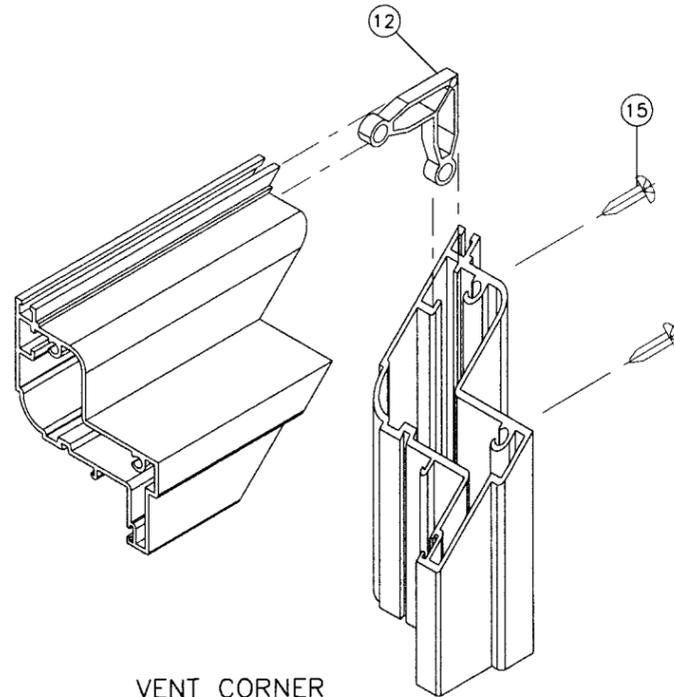

VENT CORNER

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL \ W10-16AWP

SERIES-1500 ALUMINUM PROJECTED WDW. (L.M.I.)
 ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

revisions:	no	date	by	description

date: W03-23-10
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W10-16
 sheet 6 of 6

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

 APR 23 2010

Approved as complying with the
 Florida Building Code
 Date SEPT. 8, 2010
 NCAP 10-0506.01
 Miami Dade Product Control
 Division
 By