



MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING

BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.buildingcodeonline.com

Entegra Roof Tile, Inc.
1289 NE 9th Ave.
Okeechobee, FL. 34972

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Valencia Spanish "S" Concrete Roof Tile

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This replaces NOA # 09-0512.11 and consists of pages 1 through 6
The submitted documentation was reviewed by Alex Tigera.



NOA No. 10-0518.02
Expiration Date: 06/07/11
Approval Date: 06/16/10
Page 1 of 6

ROOFING ASSEMBLY APPROVAL

Category: Roofing
Sub Category: Roofing Tiles
Material: Concrete

1. SCOPE

This revises a roofing system using Entegra Valencia Spanish "S" Concrete Roof Tile, as manufactured by Entegra Roof Tile Inc. in Medley, FL as described in Section 2 of this Notice of Acceptance, designed to comply with the Florida Building Code, for High Velocity Hurricane Zone. For the locations where the pressure requirements, as determined by applicable Building Code, does not exceed the design pressure values obtain by calculations in compliance with RAS 127 using the values listed in section 4 herein. The attachment calculations shall be done as a moment based system.

2. PRODUCT DESCRIPTION

| <u>Manufactured by Applicant</u> | <u>Dimensions</u> | <u>Test Specifications</u> | <u>Product Description</u> |
|----------------------------------|---|----------------------------|---|
| Valencia Spanish "S" | l = 18" w = 10 1/4" | TAS 112 | High profile, interlocking, one-piece, "S" shaped, concrete roof tile equipped with two nail holes. For direct deck nail-on, mortar set or adhesive set applications. |
| Trim Pieces | l = varies w = varies varying thickness | TAS 112 | Accessory trim, concrete roof pieces for use at hips, rakes, ridges and valley terminations. Manufactured for each tile profile. |

2.1 SUBMITTED EVIDENCE:

| <u>Test Agency</u> | <u>Test Identifier</u> | <u>Test Name/Report</u> | <u>Date</u> |
|--|-------------------------|---|-------------|
| Redland Technologies | 7161-03 Appendix III | Static Uplift Testing PA 102 & PA 102(A) | Dec. 1991 |
| Redland Technologies | 7161-03 Appendix II | Wind Tunnel Testing PA 108 (Nail-On) | Dec. 1991 |
| Redland Technologies | P0647-01 | Wind Tunnel Testing PA 108 (Mortar Set) | Aug. 1994 |
| Redland Technologies | P0402 | Withdrawal Resistance Testing of screw vs. smooth shank nails | Sept. 1993 |
| The Center for Applied Engineering, Inc. | 94-084 | Static Uplift Testing PA 101 (Mortar Set) | May 1994 |
| The Center for Applied Engineering, Inc. | 94-083 | Static Uplift Testing PA 101 (Adhesive Set) | April 1994 |
| The Center for Applied Engineering, Inc. | 25-7183-4 | Static Uplift Testing PA 102 (2 Quik-Drive Screws, Direct Deck) | Feb. 1995 |



NOA No. 10-0518.02
 Expiration Date: 06/07/11
 Approval Date: 06/16/10
 Page 2 of 6

| <u>Test Agency</u> | <u>Test Identifier</u> | <u>Test Name/Report</u> | <u>Date</u> |
|--|------------------------------------|--|-------------------------|
| The Center for Applied Engineering, Inc. | 25-7214-3 | Static Uplift Testing PA 102 (1 Quik-Drive Screw, Direct Deck) | March, 1995 |
| Redland Technologies | Letter Dated Aug. 1, 1994 | Wind Tunnel Testing PA 108 (Nail-On) | Aug. 1994 |
| The Center for Applied Engineering, Inc. | Project No. 307025 Test #MDC-78 | Wind Driven Rain PA 100 | Oct. 1994 |
| Nutting Engineering | 13343.1 | Physical Properties TAS 112 | June 2007 |
| Celotex Corporation Testing Service | 520111-3 520191-2-1 | Static Uplift Testing PA 101 | Dec. 1998 March 1999 |
| Walker Engineering, Inc. | Calculations | Aerodynamic Multiplier | Oct 2007 |
| Walker Engineering, Inc. | Evaluation Calculations | 25-7094 | February 1996 |
| Walker Engineering, Inc. | Evaluation Calculations | 25-7496 | April 1996 |
| Walker Engineering, Inc. | Evaluation Calculations | 25-7584 25-7804b-8 25-7804-4 & 5 25-7848-6 | December 1996 |
| Walker Engineering, Inc. | Evaluation Calculations | 25-7183 | March 1995 |
| Walker Engineering, Inc. | Evaluation Calculations | Restoring Moment Due to Gravity | August 2007 |
| Walker Engineering, Inc. | Calculations | Two Patty Adhesive Set System | April 1999 |
| Nutting Engineering | 13343.1 | Physical Properties TAS 112 | March 2009 |

3. LIMITATIONS

- 3.1 Fire classification is not part of this acceptance.
- 3.2 For mortar or adhesive set tile applications, a static field uplift test shall be performed in accordance with TAS 106.
- 3.3 Applicant shall retain the services of a Miami-Dade County Certified Laboratory to perform quarterly test in accordance with TAS 112, appendix 'A'. Such testing shall be submitted to the Building Code Compliance Office for review.
- 3.4 Minimum underlayments shall be in compliance with the applicable Roofing Applications Standards listed section 4.1 herein.
- 3.5 30/90 hot mopped underlayment applications may be installed perpendicular to the roof slope unless stated otherwise by the underlayment material manufacturers published literature.
- 3.6 This acceptance is for wood deck applications. Minimum deck requirements shall be in compliance with applicable Building Code.



4. INSTALLATION

4.1.1 Entegra Valencia Spanish "S" Concrete Roof Tile and its components shall be installed in strict compliance with Miami Dade County Roofing Application Standard RAS 118, RAS 119, and RAS 120.

4.2 Data For Attachment Calculations

| Table 1: Average Weight (W) and Dimensions (l x w) | | | |
|--|----------------|---------------|--------------|
| Tile Profile | Weight-W (lbf) | Length-l (ft) | Width-w (ft) |
| Valencia Spanish "S" Tile | 11.1 | 1.5 | .854 |

| Table 2: Aerodynamic Multipliers - λ (ft ³) | | |
|---|--|---|
| Tile Profile | λ (ft ³) Batten Application | λ (ft ³) Direct Deck Application |
| Valencia Spanish "S" Tile | 0.232 | 0.252 |

| Table 3: Restoring Moments due to Gravity - M_g (ft-lbf) | | | | | | | | | | |
|--|---------|-------------|---------|-------------|---------|-------------|---------|-------------|-------------------|-------------|
| Tile Profile | 3":12" | | 4":12" | | 5":12" | | 6":12" | | 7":12" or greater | |
| | Battens | Direct Deck | Battens | Direct Deck |
| Valencia Spanish "S" Tile | 6.70 | 7.10 | 6.60 | 7.00 | 6.46 | 6.84 | 6.30 | 6.67 | 4.08 | 6.48 |

| Table 4: Attachment Resistance Expressed as a Moment - M_r (ft-lbf) for Nail-On Systems | | | | |
|--|--|-------------------------------------|--------------------------------------|---------|
| Tile Profile | Fastener Type | Direct Deck (min 15/32" plywood) | Direct Deck (min. 19/32" plywood) | Battens |
| Valencia Spanish "S" Tile | 2-10d Ring Shank Nails | 28.6 | 41.2 | 19.4 |
| | 1-10d Smooth or Screw Shank Nail ² | 5.1 | 6.8 | 2.8 |
| | 2-10d Smooth or Screw Shank Nails | 6.9 | 9.2 | 7.3 |
| | 1 #8 Screw ² | 20.7 | 20.7 | 18.1 |
| | 2 #8 Screw | 43.2 | 43.2 | 29.8 |
| | 1-10d Smooth or Screw Shank Nail (Field Clip) ² | 23.1 | 23.1 | 19.0 |
| | 1-10d Smooth or Screw Shank Nail (Eave Clip) ² | 29.3 | 29.3 | 24.0 |
| | 2-10d Smooth or Screw Shank Nails (Field Clip) | 27.6 | 27.6 | 38.6 |
| | 2-10d Smooth or Screw Shank Nails (Eave Clip) | 38.1 | 38.1 | 41.8 |
| | 2-10d Ring Shank Nails ¹ | 33.1 | 48.1 | |

¹ Installation with a 4" tile headlap and fasteners are located a min. of 2½" from head of tile.

² When using only one fastener use the hole that is approximately 4-3/4" away from interlocking edge.




| Table 5: Attachment Resistance Expressed as a Moment M_f (ft-lbf) for Two Patty Adhesive Set Systems | | |
|---|------------------|-------------------------------|
| Tile Profile | Tile Application | Minimum Attachment Resistance |
| Valencia Spanish "S" Tile | Adhesive | 29.3 ⁴ |
| 3 See manufactures component approval for installation requirements. | | |
| 4 Flexible Products Company TileBond Average weight per patty 13.9 grams. Polyfoam Product, Inc. Average weight per patty 8 grams. | | |

| Table 5A: Attachment Resistance Expressed as a Moment - M_f (ft-lbf) for Single Patty Adhesive Set Systems | | |
|---|-------------------|-------------------------------|
| Tile Profile | Tile Application | Minimum Attachment Resistance |
| Valencia Spanish "S" Tile | Polyfoam PolyPro™ | 66.5 ⁵ |
| | Polyfoam PolyPro™ | 38.7 ⁶ |
| 5 Large paddy placement of 45 grams of PolyPro™. | | |
| 6 Medium paddy placement of 24 grams of PolyPro™. | | |

| Table 5B: Attachment Resistance Expressed as a Moment - M_f (ft-lbf) for Mortar or Adhesive Set Systems | | |
|--|------------------|-------------------------------|
| Tile Profile | Tile Application | Minimum Attachment Resistance |
| Valencia Spanish "S" Tile | Mortar Set | 24.5 |

5. LABELING

All tiles shall bear the imprint or identifiable marking of the manufacturer's name or logo (See **Detail Below**), or following statement: "Miami-Dade County Product Control Approved".



ENTEGRA VALENCIA SPANISH 'S' TILE LABEL (LOCATED ON UNDERSIDE OF TILE)

6. BUILDING PERMIT REQUIREMENTS


6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance.

6.1.2 Any other documents required by the Building Official or applicable Building Code in order to properly evaluate the installation of this system.



PROFILE DRAWING

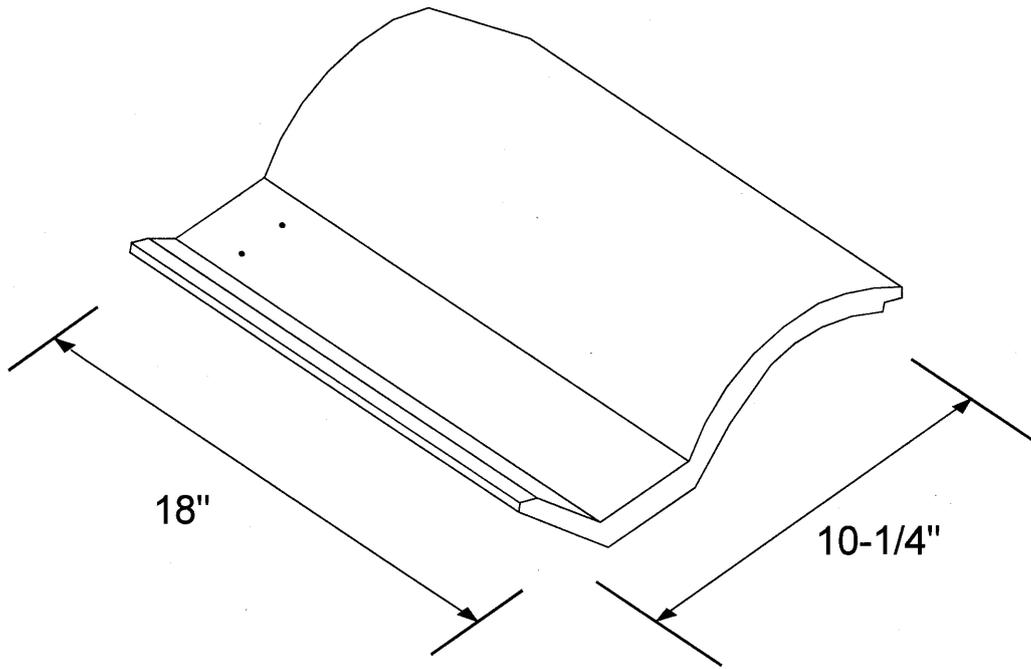

ENTEGRA VALENCIA SPANISH "S" CONCRETE ROOF TILE

END OF THIS ACCEPTANCE



NOA No. 10-0518.02
Expiration Date: 06/07/11
Approval Date: 06/16/10
Page 6 of 6