



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

O'Hagin's Inc.
210 Classic Court
Rohnert Park, CA 94928

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: O'Hagins Standard Universal Direct Deck Attic Vent

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 4.
The submitted documentation was reviewed by Alex Tigera.



NOA No 10-0518.18
Expiration Date: 09/15/15
Approval Date: 09/15/10
Page 1 of 4

ROOFING ASSEMBLY APPROVAL

Category: Roofing
Sub-Category: Static Roof Vent
Materials: 26 ga. Steel
Minimum Slope: 2:12

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT

<u>Product</u>	<u>Dimensions</u>	<u>Test Specification</u>	<u>Product Description</u>
O'Hagin's Universal Direct Deck Attic Vent	32" x 31-1/2" x 6"	TAS 100(A)	Pre-finished or Galvanized Steel 26ga. Steel roof vent for High Profile, Low Profile, or Flat Roof Tiles.

MANUFACTURING LOCATION

1. Lakeland, FL.
2. CA

EVIDENCE SUBMITTED

<u>Test Agency/Identifier</u>	<u>Name</u>	<u>Report</u>	<u>Date</u>
PRI Construction Materials Technologies	TAS 100(A)	OHI-033-02-01	12/17/09



NOA No 10-0518.18
Expiration Date: 09/15/15
Approval Date: 09/15/10
Page 2 of 4

APPROVED APPLICATIONS

Deck Type: Wood

System Type A: Mechanical attachment of vent for tile roof systems

Slot: Mark a 14" x 14" opening centered between trusses. Set blade to thickness of sheathing and cut opening. Brush away sawdust and debris.

Installation: Center the vent opening over the deck opening. Secure with 12ga. 1-1/4" galvanized ring shank roofing nails at 4" o.c. around the perimeter of the vent approximately 1" away from the flashing end. Seal the vent to the underlayment with an approved ASTM D 4586 asphalt roofing cement.

Ventilation Calculations: See manufacturer's published literature for net free area

GENERAL LIMITATIONS:


1. Refer to applicable building code for required ventilation.
2. The installation shall be applied in compliance with the manufacturer's current published application instruction and the requirements set forth in applicable building code.
3. O'Hagin's Universal Direct Deck Attic Vent is approved to be installed over High Profile, Low Profile, or Flat Roof Tiles.
4. O'Hagin's Universal Direct Deck Attic Vent shall not be installed on roof mean heights greater than 33 feet.
5. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 9B-72 of the Florida Administrative Code.
6. All approved products listed herein shall be labeled and shall bear the imprint or identifiable marking of the manufacturer's name or logo and following statement: "Miami-Dade County Product Control Approved" or the Miami-Dade County Product Control Seal as shown below

MIAMI-DADE COUNTY
APPROVED


MIAMI-DADE COUNTY
APPROVED

NOA No 10-0518.18
Expiration Date: 09/15/15
Approval Date: 09/15/10
Page 3 of 4


DETAIL A

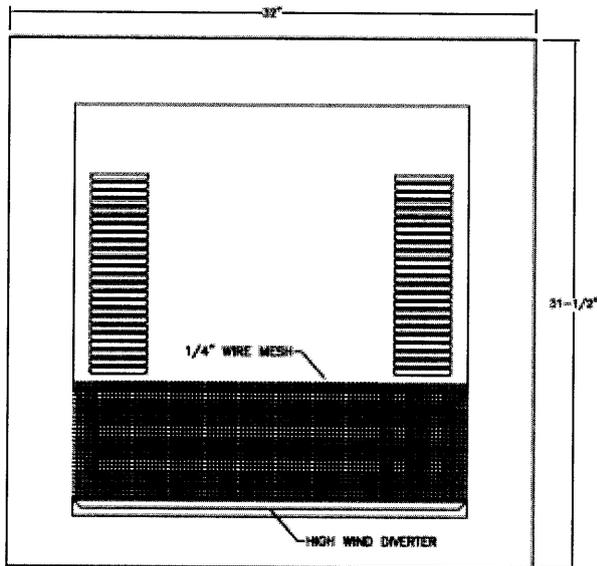


TOP

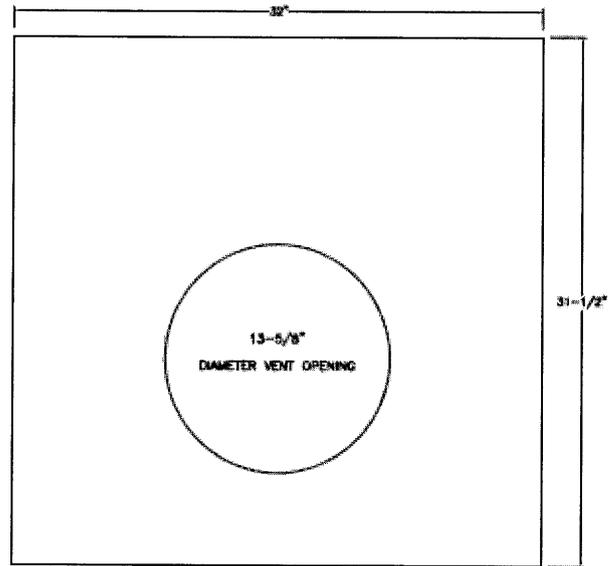


BOTTOM

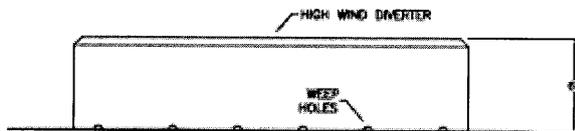


FRONT

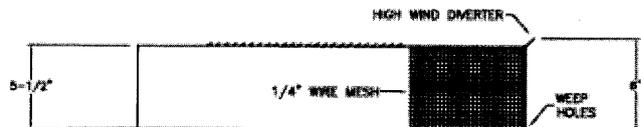

LEFT

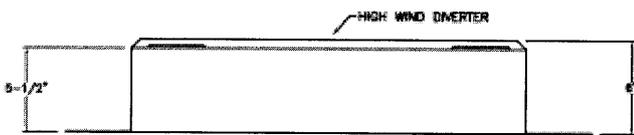

BACK

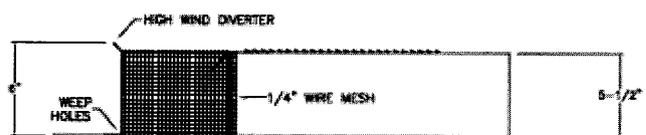

RIGHT

END OF THIS ACCEPTANCE

