



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1107
MIAMI, FLORIDA 33130-1563
(305) 375-2902 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Continental Glass Systems, Inc.
325 West 74 Place
Hialeah, FL 33014

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "2000" Aluminum Sliding Glass Door - L.M.I.

APPROVAL DOCUMENT: Drawing No. CGS009, titled "Series 2000 Sliding Glass Door (Large Missile Impact Rated)", sheets 1 through 7 of 7, dated 02/15/10, prepared by CertWorks, LLC, signed, sealed and dated 08/24/10 by Kristina S. Daugherty, P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and Approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1, evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
 8/31/10

NOA No. 10-0520.05
Expiration Date: September 22, 2015
Approval Date: September 22, 2010

Continental Glass Systems, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **CGS009**, titled "Series 2000 Sliding Glass Door (Large Missile Impact Rated)", sheets 1 through 7 of 7, dated 02/15/10, prepared by CertWorks, LLC, signed, sealed and dated 08/24/10 by Kristina S. Daugherty, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of sliding glass door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-6122**, dated 01/06/10, signed and sealed by Michael R. Wenzel, P. E.

C. CALCULATIONS

1. Anchor calculations and structural analysis, complying with FBC-2007, dated 05/18/10, prepared by CertWorks, LLC, signed, sealed and dated 08/03/10 by Kristina S. Daugherty, P. E.
Complies with ASTM E1300-04

D. QUALITY ASSURANCE

1. Miami-Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **09-0312.03** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/13/09, expiring on 01/14/12.

E. STATEMENTS

1. Statement letter of no financial interest, conformance and compliance with the FBC 2007, dated May 18, 2010, signed and sealed by Kristina S. Daugherty, P. E.
2. Laboratory compliance letter for Test Report No. **FTL-6122**, issued by Fenestration Testing Laboratory, Inc., dated January 06, 2010, signed and sealed by Michael R. Wenzel, P. E.

F. OTHERS

1. None.



Jaime D. Gascón, P. E.

Chief, Product Control Division

NOA No. 10-0520.05

Expiration Date: September 22, 2015

Approval Date: September 22, 2010

CONTINENTAL GLASS SYSTEMS

SERIES 2000 SLIDING GLASS DOOR (LARGE MISSILE IMPACT RATED)



325 W. 74TH PLACE
HIALEAH, FL 33014
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2000 SGD - LMI
INSTALLATION &
GENERAL NOTES
PREPARED BY: CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

INSTALLATION NOTES:

- TWO (2) INSTALLATION ANCHORS ON HEAD AND ONE (1) INSTALLATION ANCHOR ON SILL FOR EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR INSTALLATION DIRECTLY INTO CONCRETE/MASONRY, USE 5/16 INCH DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
- FOR INSTALLATION DIRECTLY INTO WOOD FRAME, USE #14 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT.
- FOR INSTALLATION DIRECTLY INTO STEEL FRAME, USE 1/4" DIAMETER TEK SCREWS OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS ENGAGEMENT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 2700 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
 - STEEL - MINIMUM TENSILE YIELD STRENGTH OF 33 KSI.

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2007 FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: ALUMINUM 6005-T5
- GLASS MEETS THE REQUIREMENTS OF ASTM E 1300-04 GLASS CHARTS. SEE SHEET 4 FOR GLAZING DETAIL.

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	-	INSTALLATION & GENERAL NOTES
2	-	ELEVATIONS & ANCHOR LAYOUTS
3	-	VERTICAL SECTIONS
4	-	HORIZONTAL SECTIONS & GLAZING DETAIL
5	-	COMPONENTS & BILL OF MATERIALS
6	-	COMPONENTS
7	-	CORNER ASSEMBLY

DESIGN PRESSURE RATING	
DESIGN PRESSURE - ALL SIZES	MISSILE IMPACT RATING
+/-140.0 PSF	LARGE MISSILE IMPACT RATED

REVISIONS

NO.	DESCRIPTION	BY	DATE

Kristina S. Dalpherty
8-24-10
KIRSTINA S. DALPHERTY
FLORIDA P. E. NO. 094035
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
FBPE CERT. OF AUTHORIZATION NO. 28550

Approved as complying with the Florida Building Code
Date: 09/22/2010
NOA# 10-0520-05
Miami Dade Product Control
By: *[Signature]*

DATE: 02.15.10
DWN BY: JLA
CHK BY: KSD
SCALE: NTS

DWG #: CGS009
SHEET: 1 OF 7

P:\projects\continental_glass_systems\mtd-p-09-1209-1_series_2000_sgd_lmi\dwg\vg009 - 2000 series sgd lmi 2010-04-19 final.dwg 8/24/2010 8:17 AM

TITLE: SERIES 2000 SGD - LMI
ELEVATIONS &
ANCHOR LAYOUTS

PREPARED BY:
CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

REVISIONS



NO.	DESCRIPTION	BY	DATE

[Signature]
8-24-10
KRISTINA S. DALGHERTY
FLORIDA P. E. NO. 69485
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
FPE CERT. OF AUTHORIZATION NO. 28820


Approved as complying with the
Florida Building Code
Date 09/22/2010
NOA# 10-0520.05
Miami Code Product Control
Division
By *[Signature]*

DATE:	02.15.10
DWN BY:	JLA
CHK BY:	KSD
SCALE:	NTS
DWG #:	CGS009
SHEET:	2 OF 7


ELEVATIONS

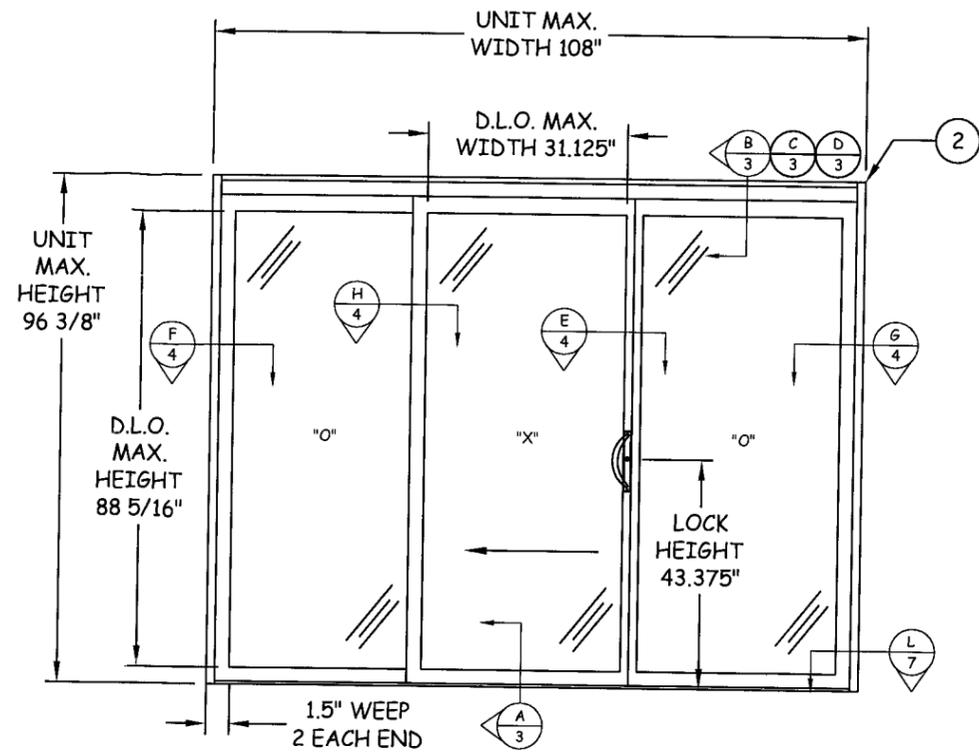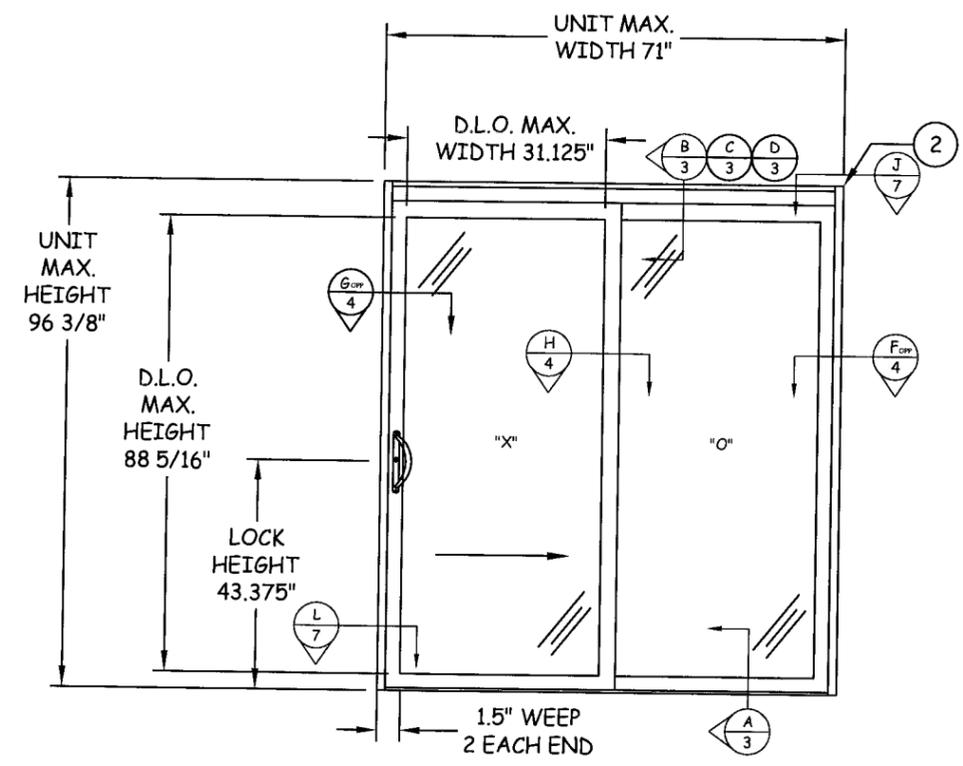


HEAD RECEPTOR:

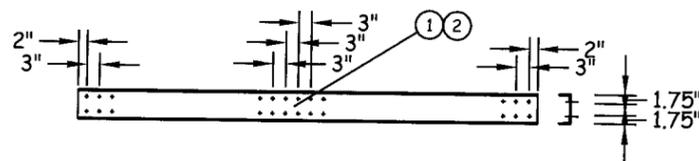


HEAD RECEPTOR:

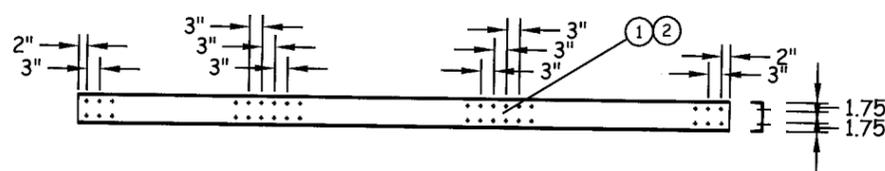

STANDARD FRAME:

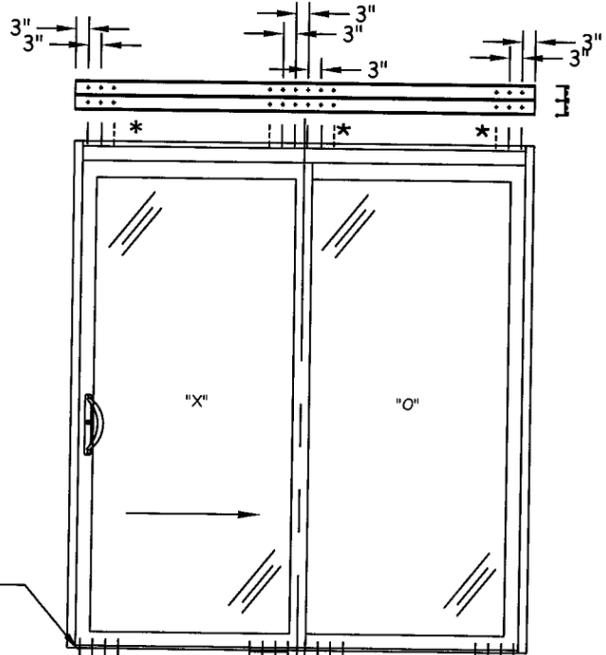



STANDARD FRAME:

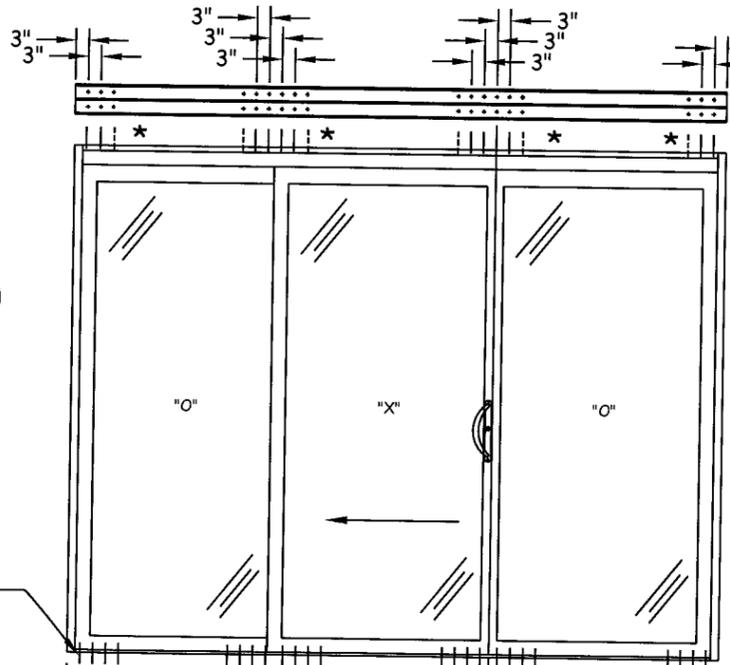

NOTE:
TWO (2) INSTALLATION ANCHORS ON
HEAD AND ONE (1) INSTALLATION
ANCHOR ON SILL FOR EACH ANCHOR
LOCATION SHOWN.


* NOTE:
FOR WOOD & STEEL HEAD
SUBSTRATE USE SIX (6)
ANCHORS AT CORNERS &
TWELVE (12) AT INTERLOCKS.

ANCHOR LAYOUTS

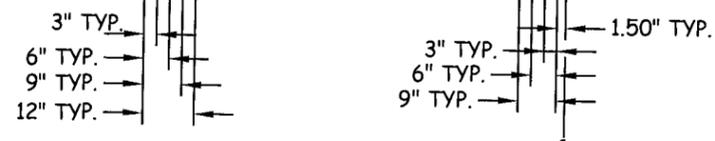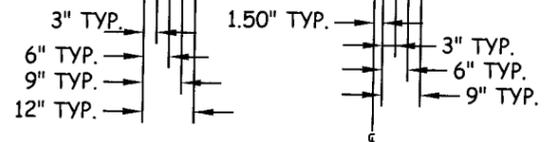


P:\Projects\continental glass systems\mfg-09-1209-1-series 2000 sgd lmi\dwgs\sgd lmi 2010-04-19 final.dwg 8/24/2010 8:17 AM


TITLE: SERIES 2000 SGD - LMI VERTICAL SECTIONS
PREPARED BY: CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

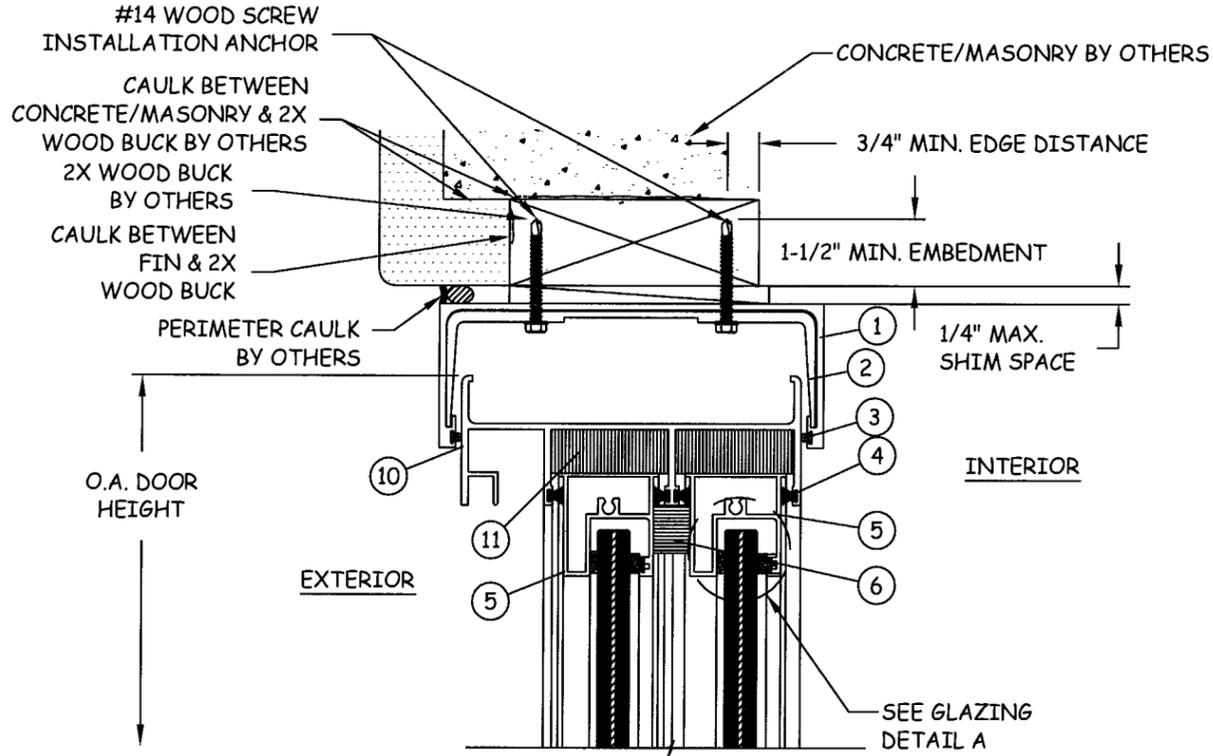


B
3 VERTICAL SECTION
REINFORCED HEAD RECEPTOR
2X WOOD FRAME (SIMILAR ALL SIDES)

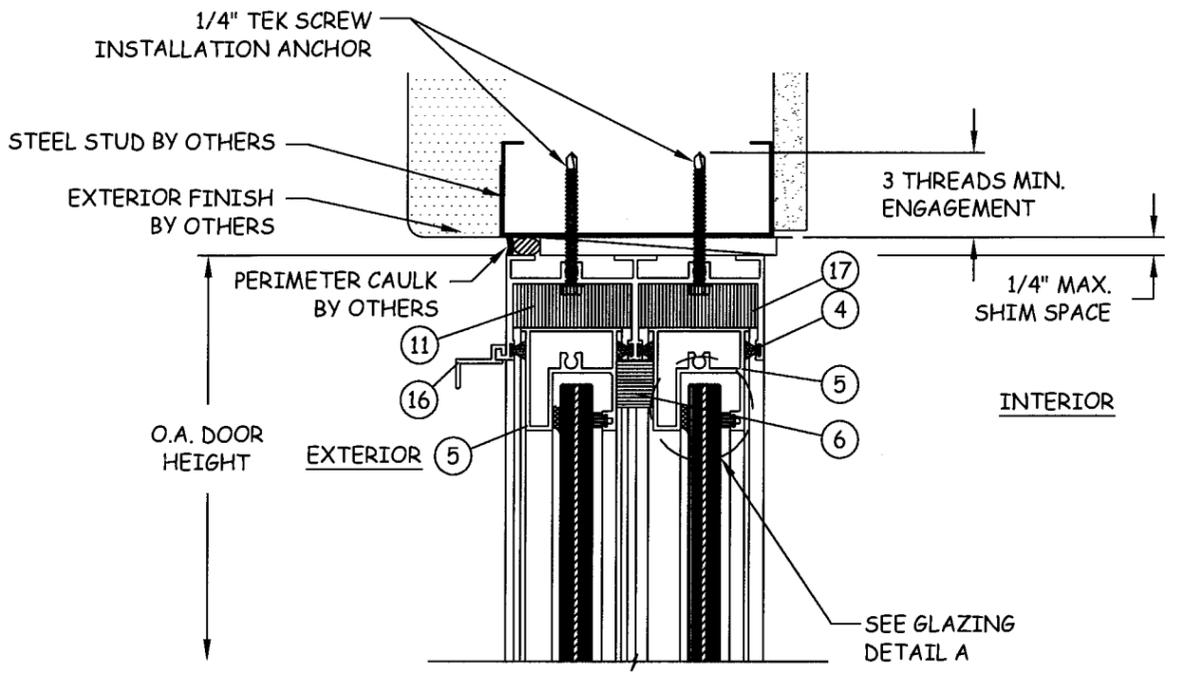

C
3 VERTICAL SECTION
STANDARD HEAD
STEEL STUD (SIMILAR ALL SIDES)

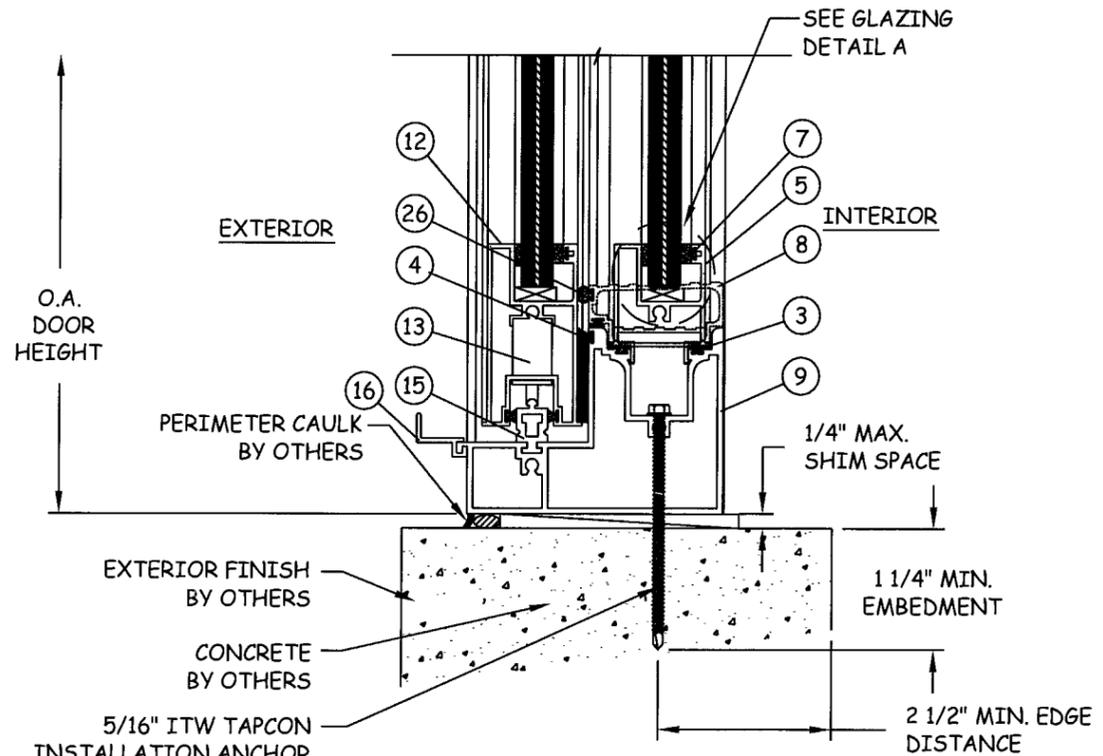

A
3 VERTICAL SECTION
SILL
MASONRY/CONCRETE (SIMILAR ALL SIDES)

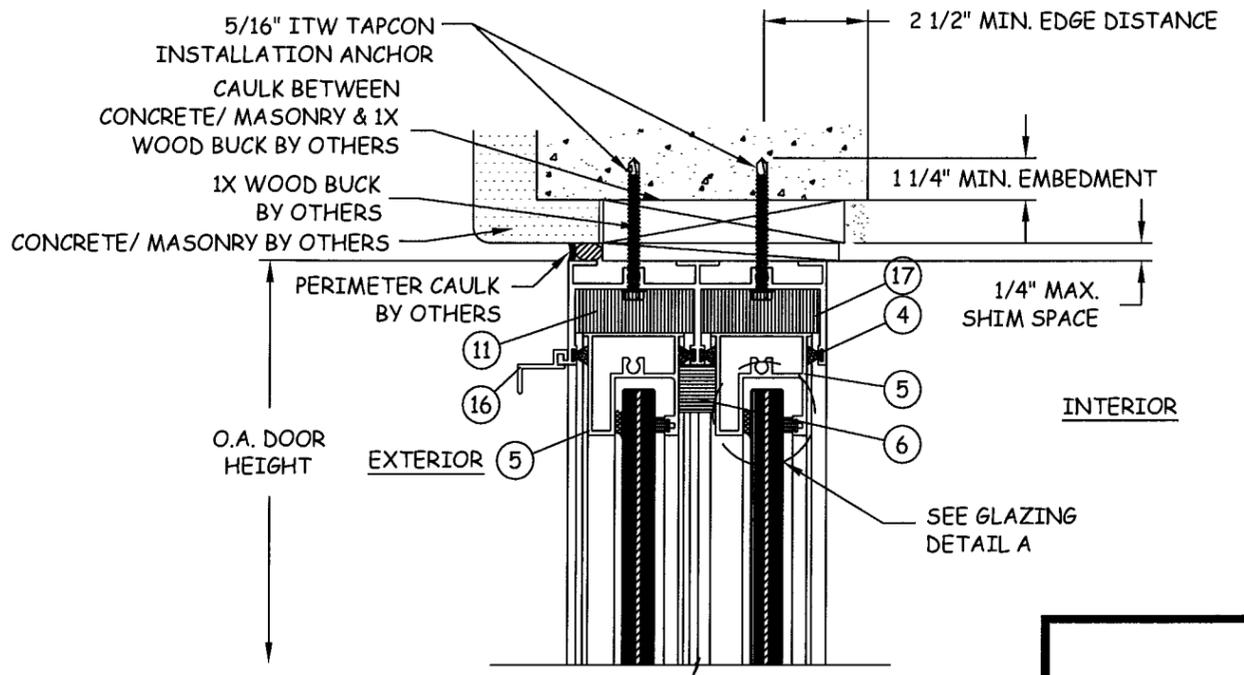

D
3 VERTICAL SECTION
STANDARD HEAD
CONCRETE/MASONRY (SIMILAR ALL SIDES)

REVISIONS	NO.	DESCRIPTION	BY	DATE


[Handwritten Signature]
8-24-10
EXISTING S. PALMER
127 W. FAIRBANKS AVE. STE. 438
WINTER PARK, FL 32789
FBPC CERT. OF AUTHORIZATION NO. 28820

Approved as complying with the
Florida Building Code
Date 09/22/2010
NOA# 10-0520-05
Miami-Dade Product Control
Division
By *[Signature]*


DATE: 02.15.10
DWN BY: JLA
CHK BY: KSD
SCALE: NTS
DWG #: CGS009
SHEET: 3 OF 7

8/24/2010 8:17 AM


P:\projects\continental_glass_systems\m-d-p-09-1209-1-series 2000 sgd lmi\lwg\sgd009 - 2000 series sgd lmi 2010-04-19 final.dwg

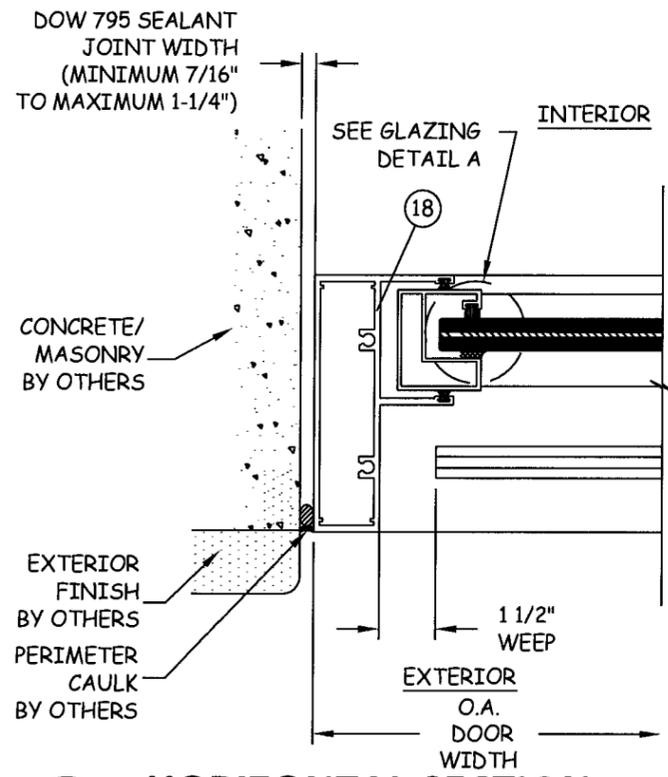


F
4 HORIZONTAL SECTION
JAMB - CONCRETE/MASONRY

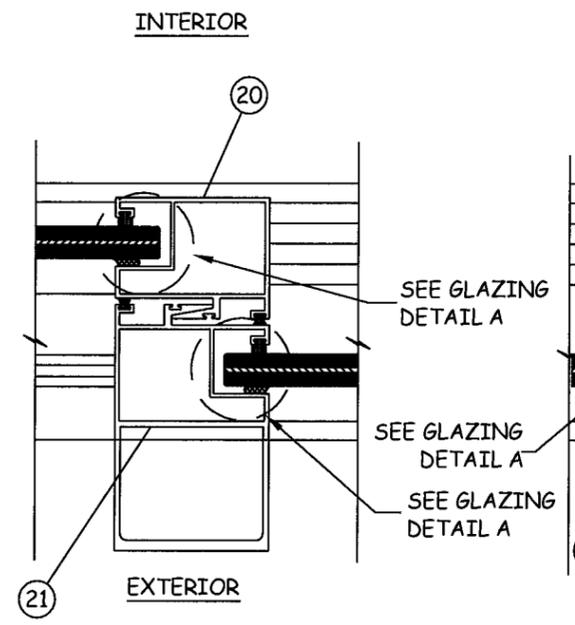

H
4 HORIZONTAL SECTION
INTERLOCK

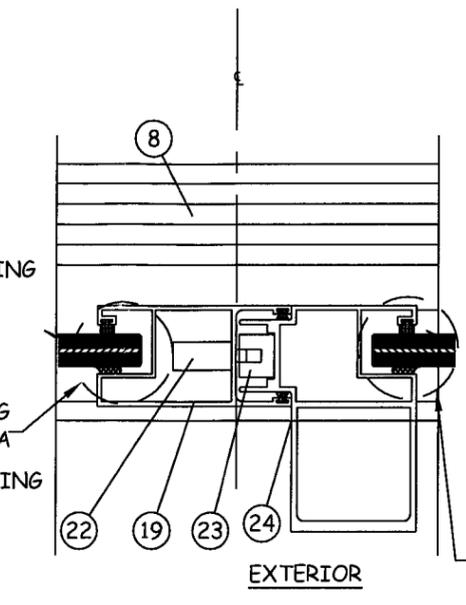


E
4 HORIZONTAL SECTION
BUTTSTILE

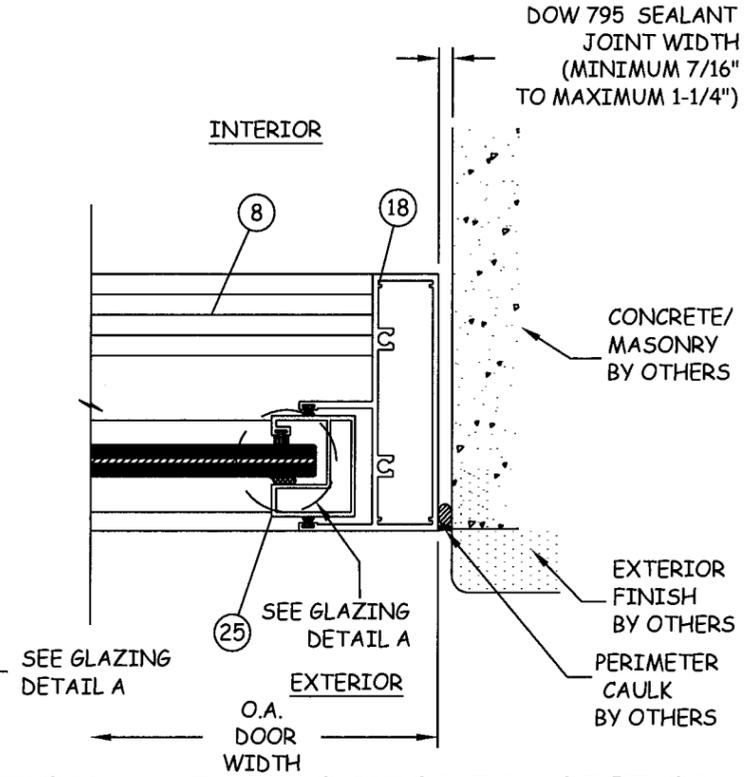

G
4 HORIZONTAL SECTION
JAMB - CONCRETE/MASONRY

- NOTES:
1. BACKER ROD DIAMETER EQUALS SEAL WIDTH X 120%
 2. SEALANT DEPTH IS 5/8" (-0", +1/16") FOR SEALANT WIDTH UP TO 1-1/4"

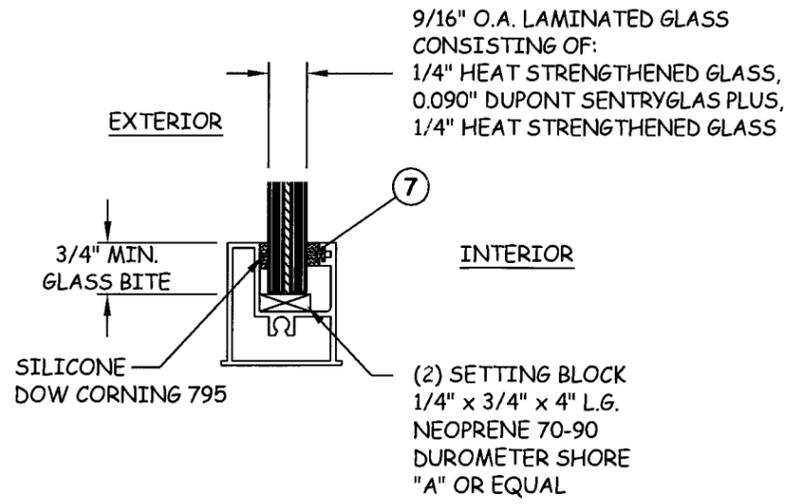

GLAZING DETAIL A

REVISIONS	
NO.	DESCRIPTION

Kristina S. Caluskey
01-24-10
KRYSTINA S. CALUSKEY
FLORIDA PROFESSIONAL ENGINEER
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
FBPE CERT. OF AUTHORIZATION NO. 28590

Approved as complying with the
Florida Building Code
Date 09/22/2010
NOA# 10-0520.05
Miami Code Product Control
Division
By *[Signature]*

DATE: 02.15.10
DWN BY: JLA
CHK BY: KSD
SCALE: NTS
DWG #: CGS009
SHEET: 4 OF 7

8/24/2010 8:17 AM


p:\projects\continental glass systems\ind-p-09-1209.1 series 2000 sgd lmi\dwgs\cgs009 - 2000 series sgd lmi 2010-04-19 final.dwg

8/24/2010 8:17 AM

P:\projects\continental_glass_systems\md-p-09-1209-1 series 2000 sgd lmi\dwgs\lcpa009 - 2000 series sgd lmi 2010-04-19 final.dwg

BILL OF MATERIALS

ITEM NO.	DESCRIPTION	PARTS NUMBERS	MATERIAL	MANUFACTURER
1	HEAD RECEPTOR	2000-07	ALUMINUM 6005-T5	CGS
2	REINFORCING	2000-16	ALUMINUM 6005-T5	CGS
3	VINYL BULB	FP-448-V	PLASTIC	
4	FIN-SEAL .370 X .187		ULTRAFAB	ULTRAFAB
5	TOP & BOTTOM PANEL STILE	2000-08	ALUMINUM 6005-T5	CGS
6	INTERLOCK PAD	P 7509 AFK	ULTRAFAB	ULTRAFAB
7	GLASS SPACING		PLASTIC	
8	THRESHOLD	2000-24	ALUMINUM 6063-T6	CGS
9	SILL	2000-03	ALUMINUM 6005-T5	CGS
10	HEAD	2000-01	ALUMINUM 6005-T5	CGS
11	HEAD PAD	P 10009 AFK	ULTRAFAB	ULTRAFAB
12	BOTTOM MOVING PANEL STILE	2000-09	ALUMINUM 6005-T5	CGS
13	WHEEL	AR-50A		
14	FIN-SEAL .250 X .187		ULTRAFAB	ULTRAFAB
15	SILL TRACK	2000-05	ALUMINUM 6005-T5	CGS
16	SCREEN TRACK	2000-15	ALUMINUM 6005-T5	CGS
17	STANDARD HEAD	2000-02	ALUMINUM 6005-T5	CGS
18	JAMB	2000-04	ALUMINUM 6063-T6	CGS
19	LOCK STILE	2000-10	ALUMINUM 6005-T5	CGS
20	INTERLOCK	2000-11	ALUMINUM 6005-T5	CGS
21	LEFT INTERLOCK	2000-17	ALUMINUM 6005-T5	CGS
22	LOCK	D-60 C		
23	KEEPER	KP-50		
24	HEAVY ASTRAGAL	2000-14	ALUMINUM 6005-T5	CGS
25	FIXED STILE	2000-13	ALUMINUM 6005-T5	CGS
26	Q-LON	U4332		

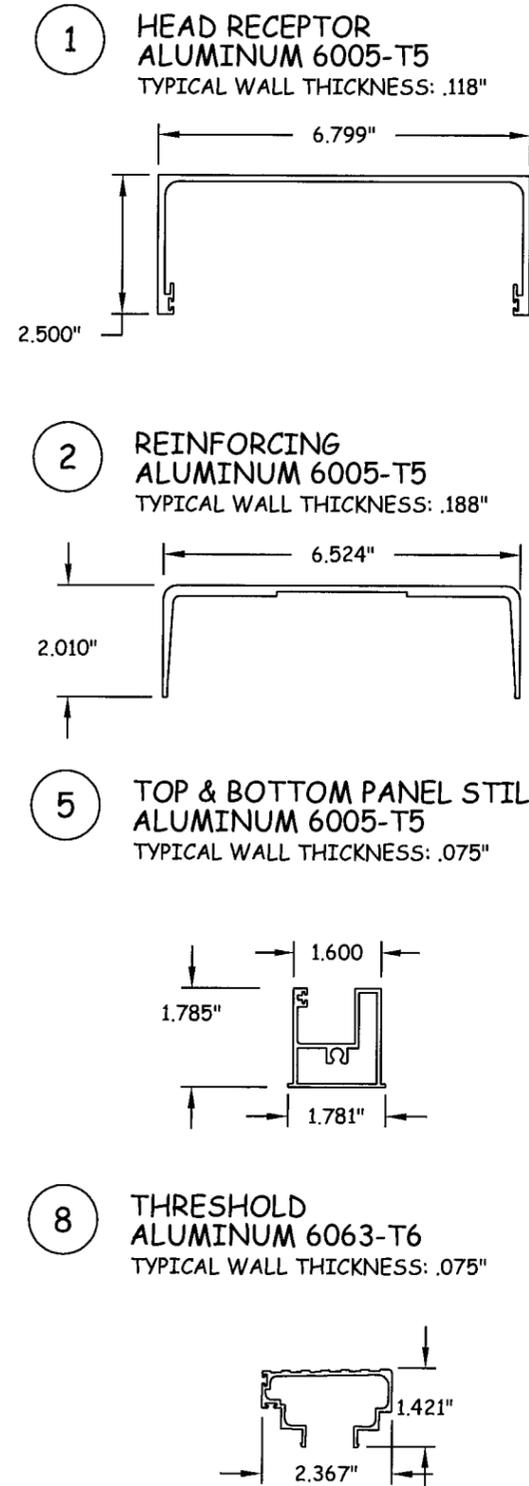

325 W. 74TH PLACE
HIALEAH, FL 33014
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2000 SGD - LMI
COMPONENTS &
BILL OF MATERIALS

PREPARED BY:
CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

NO.	DESCRIPTION	REVISIONS	
		BY	DATE

[Signature]
8-24-10

KRISTINA S. DAUGHERTY
FLORIDA P.E. NO. 06465
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
FEBR CERT. OF AUTHORIZATION NO. 289520

Approved as complying with the
Florida Building Code
Date 09/22/2010
NOA# 10-0520-05
Miami Dade Product Control
Division
By *[Signature]*

DATE: 02.15.10
DWN BY: JLA
CHK BY: KSD
SCALE: NTS


DWG #: **CGS009**

SHEET: **5 OF 7**


8/24/2010 8:17 AM

p:\projects\continental_glass_systems\lmd-p-09-1209-1 series 2000.sgd\lmd\series\sgd\lmi\2010-04-19 final.dwg


9 SILL ALUMINUM 6005-T5
TYPICAL WALL THICKNESS: .100"

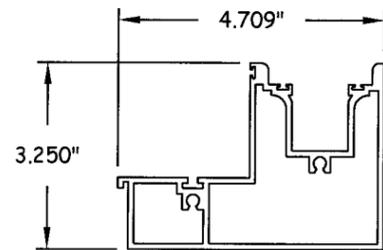


16 SCREEN TRACK ALUMINUM 6005-T5
TYPICAL WALL THICKNESS: .075"

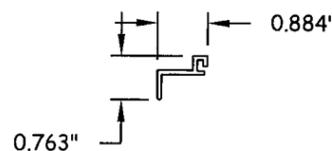


20 INTERLOCK ALUMINUM 6005-T5
TYPICAL WALL THICKNESS: .078"

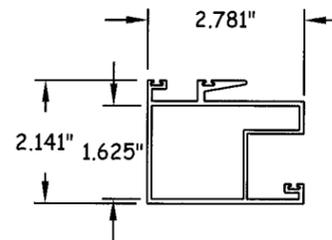


10 HEAD ALUMINUM 6005-T5
TYPICAL WALL THICKNESS: .100"

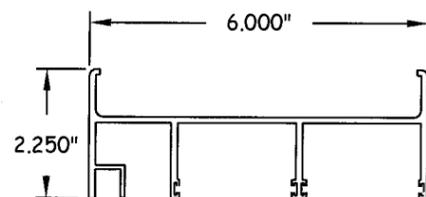


17 STANDARD HEAD ALUMINUM 6005-T5
TYPICAL WALL THICKNESS: .100"

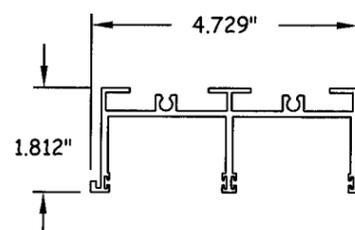


21 LEFT INTERLOCK ALUMINUM 6005-T5
TYPICAL WALL THICKNESS: .078"

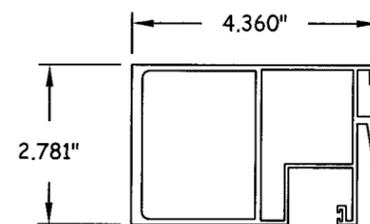


12 BOTTOM MOVING PANEL STILE ALUMINUM 6005-T5
TYPICAL WALL THICKNESS: .075"




18 JAMB ALUMINUM 6063-T6
TYPICAL WALL THICKNESS: .075"

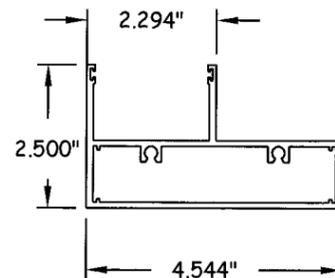


24 ASTRAGAL ALUMINUM 6005-T5
TYPICAL WALL THICKNESS: .078"

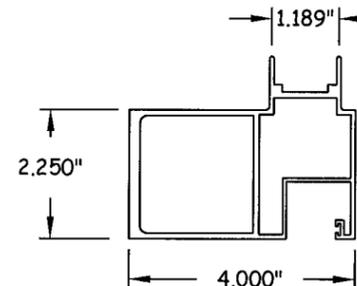


15 SILLTRACK ALUMINUM 6005-T5
TYPICAL WALL THICKNESS: .110"



19 LOCK STILE ALUMINUM 6005-T5
TYPICAL WALL THICKNESS: .078"

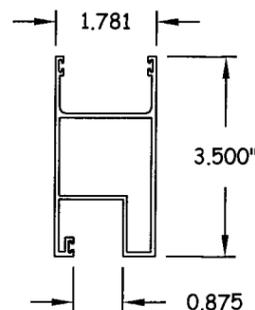

25 FIXED STILE ALUMINUM 6005-T5
TYPICAL WALL THICKNESS: .62"



325 W. 74TH PLACE
HIALEAH, FL 33014
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2000 SGD - LMI
COMPONENTS
PREPARED BY: CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366


NO.	DESCRIPTION	REVISIONS	
		BY	DATE

[Signature]
8-24-10
KURTINA S. DAUGHERTY
FLORIAN S. DAUGHERTY
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
FIBRE CERT. OF AUTHORIZATION NO. 28550


Approved as complying with the Florida Building Code
Date 09/22/2010
NOA# 10-0520-05
Miami Dade Product Control
By *[Signature]*

DATE: 02.15.10
DWN BY: JLA
CHK BY: KSD
SCALE: NTS
DWG #: CGS009
SHEET: 6 OF 7


TITLE: SERIES 2000 SGD - LMI
CORNER ASSEMBLIES
PREPARED BY:
CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

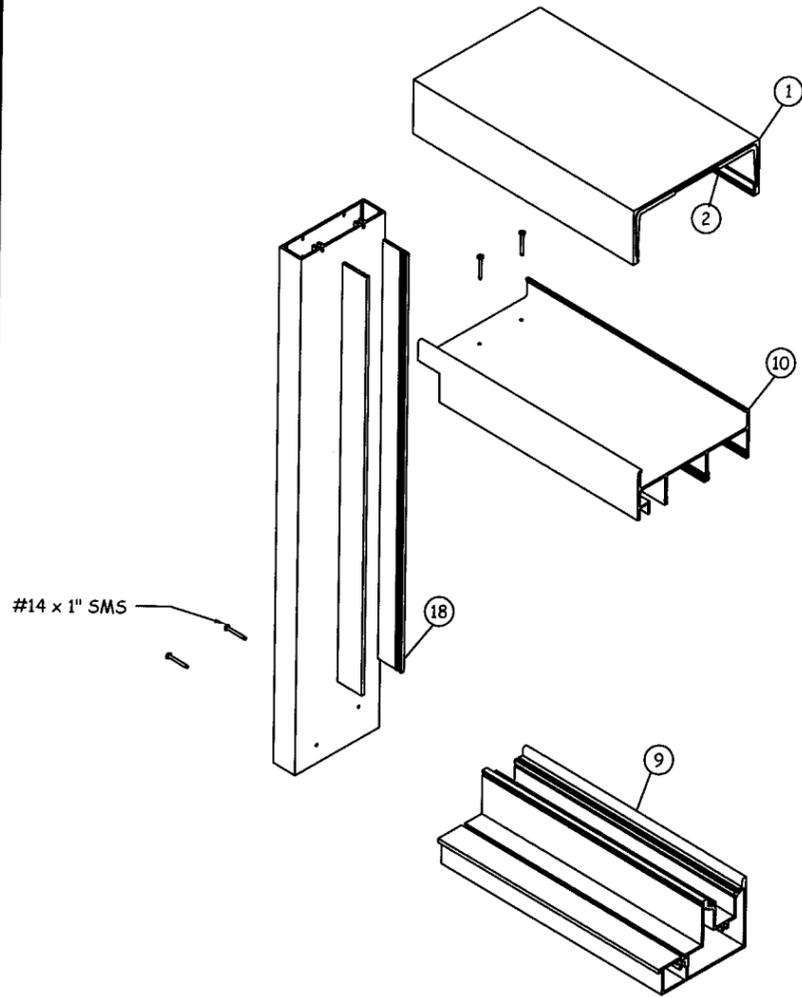

J
7
HEAD RECEPTOR
HEAD ASSEMBLY
FRAME CONSTRUCTION

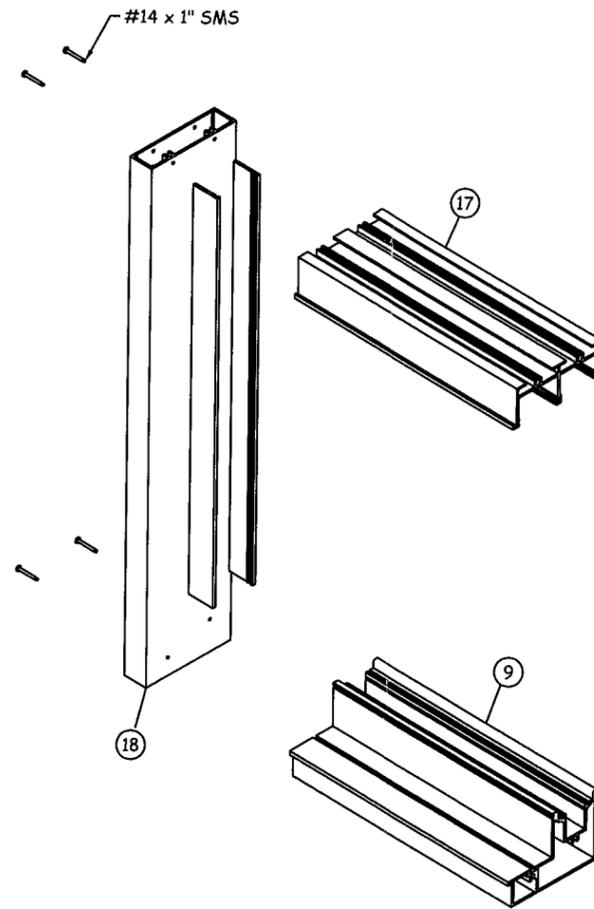

K
7
STANDARD FRAME
HEAD & SILL ASSEMBLY
FRAME CONSTRUCTION

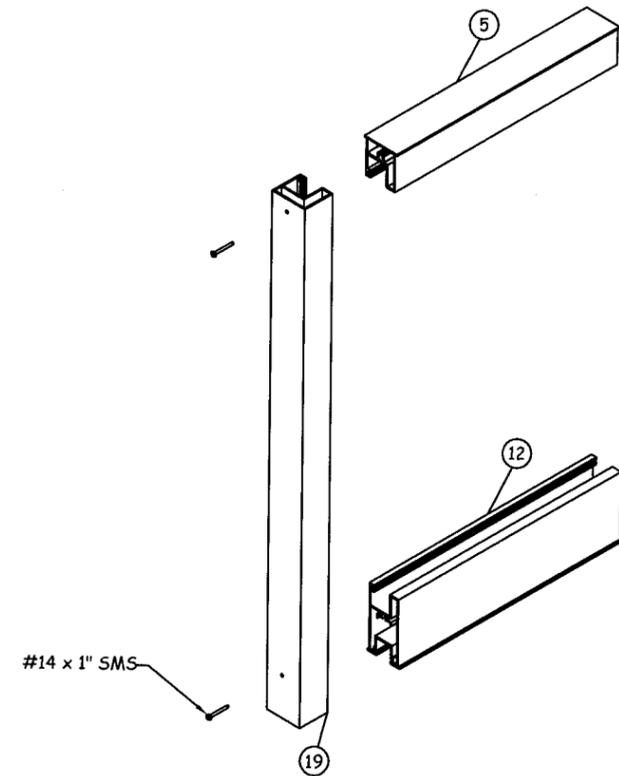

L
7
DOOR PANEL
TOP & BOTTOM CORNERS
PANEL CONSTRUCTION

REVISIONS

NO.	DESCRIPTION	BY	DATE

[Signature]
8-24-10
KRISTINA S. DALGHERTY
FLORIDA P.E. NO. 66485
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
FBPE CERT. OF AUTHORIZATION NO. 28520

Approved as complying with the
Florida Building Code
Date 09/22/2010
NOA# 10-0520-05
Miami Dade Product Control
Division
By *[Signature]*

DATE: 02.15.10
DWN BY: JLA
CHK BY: KSD
SCALE: NTS
DWG #: **CGS009**
SHEET: **7 OF 7**