



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buldingcode

Curv-A-Tech Corporation
930 West 23rd Street
Hialeah, FL 33010

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "PW-6200" Aluminum Fixed Window

APPROVAL DOCUMENT: Drawing No. **W02-65**, titled "PW-6200 Aluminum Fixed Window", sheets 1 through 5 of 5, dated 07/15/02, with revision C dated 05/26/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises** NOA # **08-0118.13** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



[Handwritten Signature]
07/12/10

NOA No 10-0610.05
Expiration Date: February 13, 2013
Approval Date: August 04, 2010
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W02-65**, titled "PW-6200 Aluminum Fixed Window", sheets 1 through 5 of 5, dated 07/15/02, with revision C dated 05/26/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

B. TESTS "Submitted under NOA # 02-0906.03"

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a Series PW-6200 Aluminum Fixed Windows, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **3498, 3499, 3500, 3501** and **3502**, all dated July 15, 2002 and signed and sealed by James G. Worth, P.E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated 05/21/10, signed and sealed by Javad Ahmad, P.E.
Complies with ASTM E1300-04

D. QUALITY ASSURANCE


1. Miami Dade Building Code Compliance Office (BCCO)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance to 2007 FBC and no financial interest, dated 05/21/10, signed and sealed by Javad Ahmad, P.E.



07/12/10




Carlos M. Utrera, P.E.

Product Control Examiner

NOA No 10-0610.05







Expiration Date: February 13, 2013

Approval Date: August 04, 2010

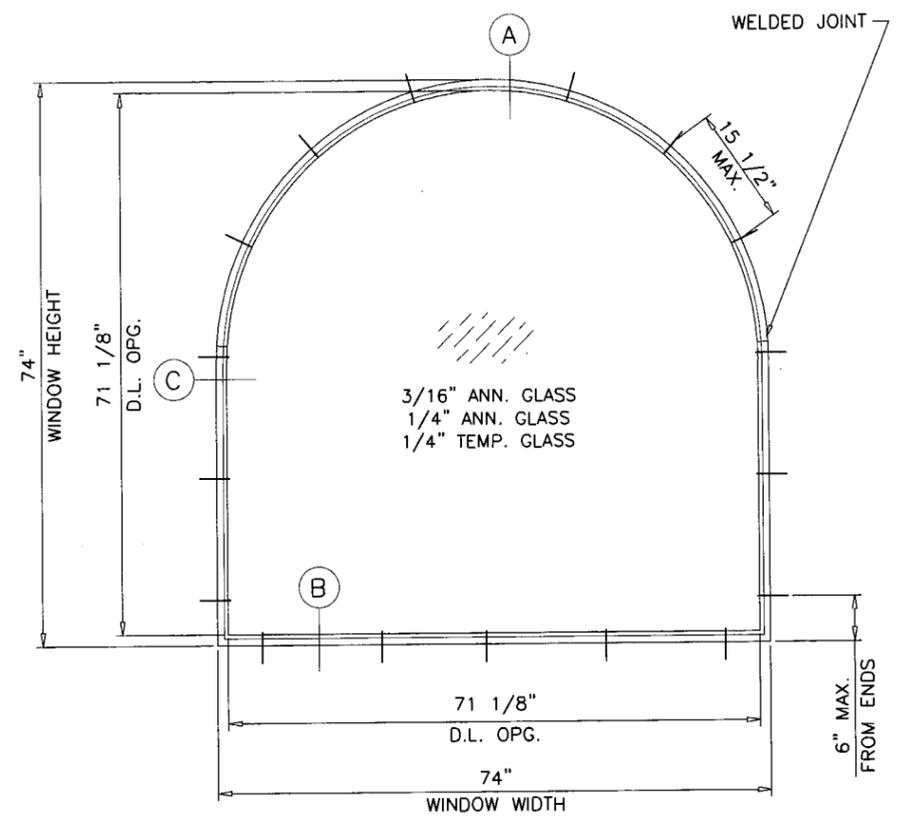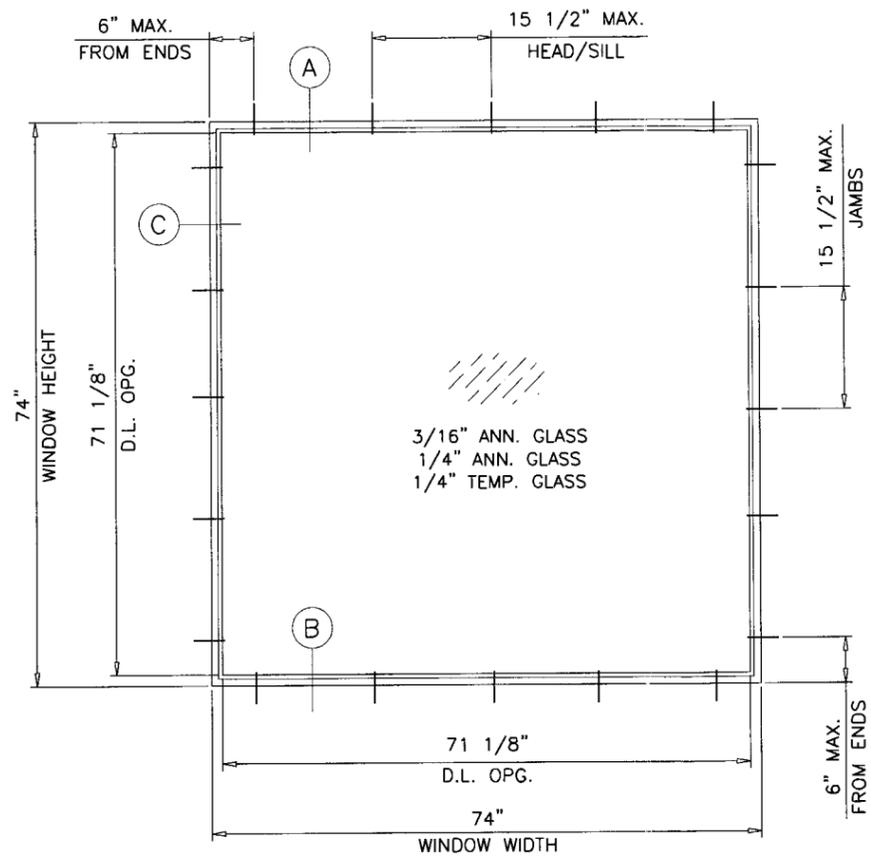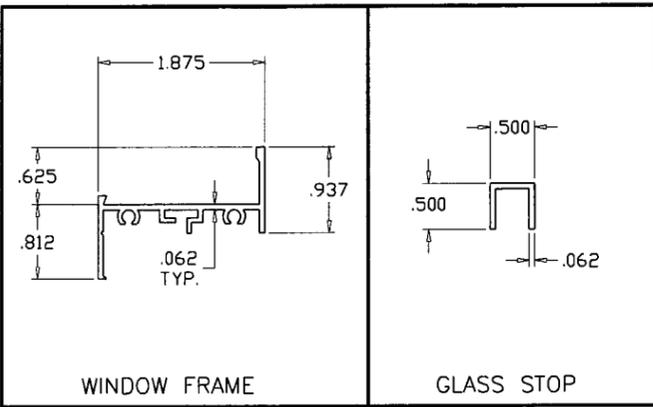

TYPICAL ELEVATIONS
TESTED UNITS

D.L. OPG. = WINDOW HEIGHT - 2.625"
WINDOW WIDTH - 2.625"

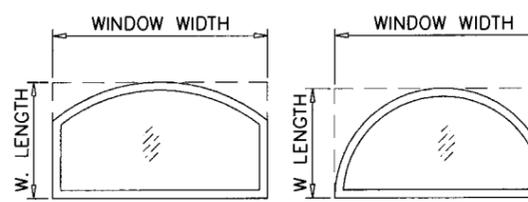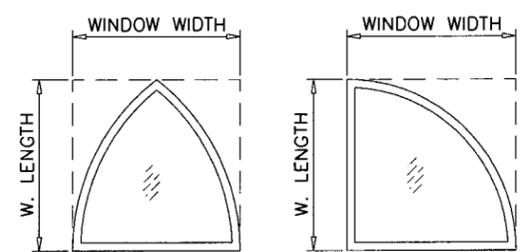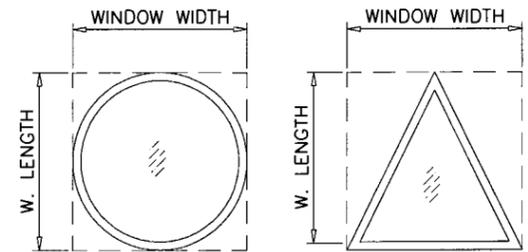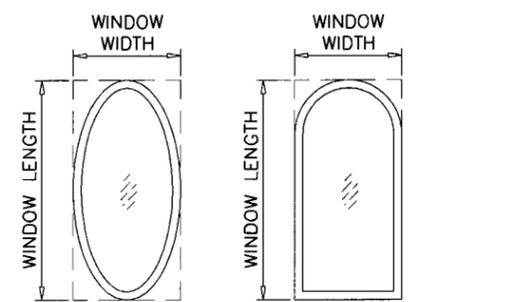

ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN SQUARE OR RECTANGLE AS SHOWN IN DOTTED LINES AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES.

PW-6200 ALUMINUM FIXED WINDOW

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIXED/FIXED OR FIXED WITH OTHER MIAMI-DADE COUNTY APPR'D WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEETS 2 & 3.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

WINDOWS NOT RATED FOR IMPACT.
INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES COMPLYING WITH HVHZ REQUIREMENTS.
INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

THIS NOA IS NOT VALID WITHOUT CORPORATE SEAL OF CURV-A-TECH CORPORATION AND A LABEL AFFIXED.

Engr: JAVAID AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

JUN 02 2010

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-0610.05
Expiration Date 02/13/2013
By: [Signature]
Miami Dade Product Control
Division

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W02-65CT


PW-6200 ALUMINUM FIXED WINDOW
CURV-A-TECH CORPORATION
930 W. 23rd STREET
HIALEAH, FL 33010
TEL. (305) 888-9631 FAX. (305) 888-9969

no	date	by	description
A	01.15.03	REV. PER BCCO COMMENTS	
B	01.14.08	UPDATED FOR 2004 FBC	
C	05.26.10	UPDATED FOR 2007 FBC	

revisions:
no date by description
date: 07-15-02
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:


drawing no.
W02-65
sheet 1 of 5

DESIGN LOAD CAPACITY - PSF							
WINDOW DIMS.		3/16" ANN. GLASS		1/4" ANN. GLASS		1/4" TEMP. GLASS	
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26"	66.7	109.2	66.7	124.1	100.0	210.0
26-1/2"		66.7	99.7	66.7	113.2	100.0	210.0
37"		66.7	78.3	66.7	88.9	100.0	175.5
48"		66.7	69.6	66.7	79.1	100.0	156.1
53-1/8"		66.7	67.2	66.7	76.4	100.0	150.2
74"		55.8	55.8	66.7	70.0	100.0	123.5
19-1/8"	38-3/8"	66.7	91.9	66.7	104.5	100.0	206.1
26-1/2"		66.7	76.1	66.7	86.5	100.0	170.6
37"		66.7	68.9	66.7	78.3	100.0	154.5
48"		57.3	57.3	65.1	65.1	100.0	128.5
53-1/8"		53.8	53.8	61.2	61.2	100.0	120.3
74"		-	-	46.3	46.3	93.1	93.1
19-1/8"	50-5/8"	66.7	85.1	66.7	96.7	100.0	190.8
26-1/2"		66.7	67.5	66.7	76.7	100.0	151.3
37"		56.2	56.2	63.9	63.9	100.0	126.1
48"		-	-	59.4	59.4	100.0	117.3
53-1/8"		-	-	56.6	56.6	100.0	111.3
74"		-	-	-	-	79.5	79.5
19-1/8"	58"	66.7	82.6	66.7	93.9	100.0	169.1
26-1/2"		63.4	63.4	66.7	73.4	100.0	132.1
37"		50.7	50.7	59.5	59.5	100.0	107.2
48"		-	-	53.3	53.3	96.0	96.0
53-1/8"		-	-	51.3	51.3	93.8	93.8
74"		-	-	-	-	75.0	75.0
19-1/8"	63"	66.7	81.4	66.7	92.5	100.0	182.5
26-1/2"		59.0	59.0	66.7	71.7	100.0	141.4
37"		-	-	57.4	57.4	100.0	113.3
48"		-	-	50.5	50.5	99.6	99.6
53-1/8"		-	-	48.1	48.1	96.3	96.3
74"		-	-	-	-	73.1	73.1
19-1/8"	74-1/4"	66.7	79.2	66.7	90.0	100.0	177.7
26-1/2"		53.6	53.6	66.7	68.9	100.0	136.0
37"		-	-	47.4	47.4	100.0	106.5
48"		-	-	42.2	42.2	91.1	91.1
53-1/8"		-	-	-	-	86.8	86.8

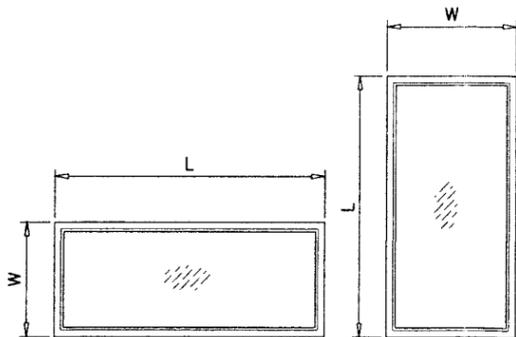

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-04 (3 SEC. GUSTS).

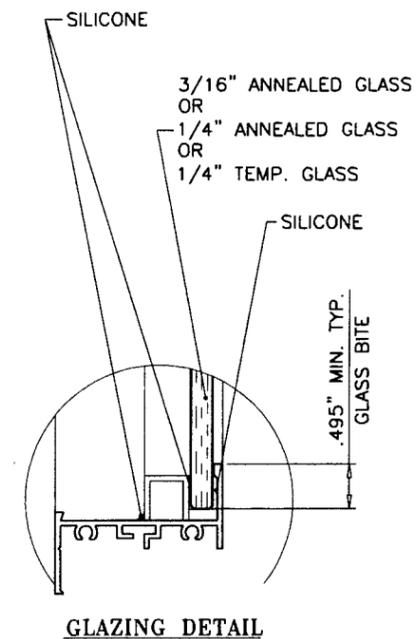

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

JA
JUN 02 2010

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-0610.05
Expiration Date 02/13/2013

By *[Signature]*
Miami Dade Product Control
Division

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL \ W02 - 65CT

PW-6200 ALUMINUM FIXED WINDOW
CURV-A-TECH CORPORATION
930 W. 23rd STREET
HIALEAH, FL 33010
TEL. (305) 888-9631 FAX. (305) 888-9969

no	date	description
A	01.15.03	REV. PER BCCO COMMENTS
B	01.14.08	UPDATED FOR 2004 FBC
C	05.26.10	UPDATED FOR 2007 FBC

date: 07-15-02
scale: -
dr. by: HAMID
chk. by:


drawing no.
W02-65
sheet 2 of 5

DESIGN LOAD CAPACITY - PSF							
WINDOW DIMS.		3/16" ANN. GLASS		1/4" ANN. GLASS		1/4" TEMP. GLASS	
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
18"	36"	66.7	97.8	66.7	111.1	100.0	210.0
24"		66.7	82.5	66.7	93.8	100.0	185.0
30"		66.7	75.4	66.7	85.7	100.0	169.1
36"		66.7	73.3	66.7	83.3	100.0	164.4
42"		64.2	64.2	66.7	72.9	100.0	136.0
48"		58.7	58.7	66.7	66.7	100.0	131.6
54"		55.0	55.0	62.5	62.5	100.0	120.9
60"		48.9	48.9	59.5	59.5	100.0	117.5
66"		-	-	56.1	56.1	100.0	113.1
72"		-	-	50.2	50.2	100.0	100.7
74"	-	-	48.6	48.6	97.1	97.1	
18"	42"	66.7	93.3	66.7	106.1	100.0	197.8
24"		66.7	77.0	66.7	87.5	100.0	163.2
30"		66.7	68.4	66.7	77.8	100.0	145.1
36"		64.2	64.2	66.7	72.9	100.0	136.0
42"		62.9	62.9	66.7	71.4	100.0	133.2
48"		55.9	55.9	63.5	63.5	100.0	125.3
54"		51.4	51.4	58.4	58.4	100.0	113.0
60"		-	-	54.9	54.9	100.0	108.4
66"		-	-	51.7	51.7	100.0	103.4
72"		-	-	46.0	46.0	91.4	91.4
74"	-	-	44.3	44.3	88.0	88.0	
18"	48"	66.7	90.3	66.7	102.6	100.0	202.4
24"		66.7	73.3	66.7	83.3	100.0	164.4
30"		64.0	64.0	66.7	72.7	100.0	143.5
36"		58.7	58.7	66.7	66.7	100.0	131.6
42"		55.9	55.9	63.5	63.5	100.0	125.3
48"		51.2	51.2	62.5	62.5	100.0	123.3
54"		-	-	56.3	56.3	100.0	108.8
60"		-	-	52.1	52.1	100.0	102.8
66"		-	-	48.9	48.9	96.9	96.9
72"		-	-	44.0	44.0	85.0	85.0
74"	-	-	42.5	42.5	81.6	81.6	
18"	54"	66.7	88.0	66.7	100.0	100.0	193.4
24"		66.7	70.7	66.7	80.4	100.0	155.4
30"		60.9	60.9	66.7	69.2	100.0	133.9
36"		55.0	55.0	62.5	62.5	100.0	120.9
42"		51.4	51.4	58.4	58.4	100.0	113.0
48"		-	-	56.3	56.3	100.0	108.8
54"		-	-	52.6	52.6	100.0	107.5
60"		-	-	49.4	49.4	99.7	99.7
66"		-	-	45.7	45.7	92.8	92.8
72"		-	-	-	-	80.6	80.6
74"	-	-	-	-	77.2	77.2	
18"	60"	66.7	86.3	66.7	98.0	100.0	193.5
24"		66.7	68.8	66.7	78.1	100.0	154.2
30"		53.6	53.6	66.7	66.7	100.0	131.6
36"		48.9	48.9	59.5	59.5	100.0	117.5
42"		-	-	54.9	54.9	100.0	108.4
48"		-	-	52.1	52.1	100.0	102.8
54"		-	-	49.4	49.4	99.7	99.7
60"		-	-	44.5	44.5	98.7	98.7
66"		-	-	-	-	90.4	90.4
72"		-	-	-	-	77.7	77.7
74"	-	-	-	-	74.2	74.2	

DESIGN LOAD CAPACITY - PSF							
WINDOW DIMS.		3/16" ANN. GLASS		1/4" ANN. GLASS		1/4" TEMP. GLASS	
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
18"	66"	66.7	84.9	66.7	96.5	100.0	190.4
24"		66.7	67.2	66.7	76.4	100.0	150.7
30"		48.1	48.1	64.7	64.7	100.0	127.7
36"		-	-	56.1	56.1	100.0	113.1
42"		-	-	51.7	51.7	100.0	103.4
48"		-	-	48.9	48.9	96.9	96.9
54"		-	-	45.7	45.7	92.8	92.8
60"		-	-	-	-	90.4	90.4
66"		-	-	-	-	89.7	89.7
72"		-	-	-	-	76.1	76.1
74"	-	-	-	-	72.4	72.4	
18"	72"	66.7	83.8	66.7	95.2	100.0	172.7
24"		66.0	66.0	66.7	75.0	100.0	136.0
30"		44.4	44.4	62.8	62.8	100.0	114.5
36"		-	-	50.2	50.2	100.0	100.7
42"		-	-	46.0	46.0	91.4	91.4
48"		-	-	44.0	44.0	85.0	85.0
54"		-	-	-	-	80.6	80.6
60"		-	-	-	-	77.7	77.7
66"		-	-	-	-	76.1	76.1
72"		-	-	-	-	75.6	75.6
74"	-	-	-	-	71.6	71.6	
18"	74"	66.7	83.5	66.7	94.9	100.0	167.4
24"		65.6	65.6	66.7	74.6	100.0	131.6
30"		43.4	43.4	61.7	61.7	100.0	110.6
36"		-	-	48.6	48.6	97.1	97.1
42"		-	-	44.3	44.3	88.0	88.0
48"		-	-	42.5	42.5	81.6	81.6
54"		-	-	-	-	77.2	77.2
60"		-	-	-	-	74.2	74.2
66"		-	-	-	-	72.4	72.4
72"		-	-	-	-	71.6	71.6
74"	-	-	-	-	71.5	71.5	
18"	78"	66.7	82.9	66.7	94.2	100.0	185.9
24"		65.0	65.0	66.7	73.9	100.0	145.8
30"		-	-	59.8	59.8	100.0	122.2
36"		-	-	45.8	45.8	100.0	106.9
42"		-	-	41.2	41.2	96.4	96.4
48"		-	-	-	-	89.1	89.1
54"		-	-	-	-	83.8	83.8
60"		-	-	-	-	80.2	80.2
66"		-	-	-	-	77.7	77.7
18"		84"	66.7	82.1	66.7	93.3	100.0
24"	63.7		63.7	66.7	72.9	100.0	136.0
30"	-		-	57.6	57.6	100.0	113.5
36"	-		-	42.6	42.6	98.9	98.9
42"	-		-	37.4	37.4	88.8	88.8
48"	-		-	-	-	81.6	81.6
54"	-		-	-	-	76.4	76.4
60"	-		-	-	-	72.5	72.5

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS).

DESIGN LOAD CAPACITY - PSF								
WINDOW DIMS.		3/16" ANN. GLASS		1/4" ANN. GLASS		1/4" TEMP. GLASS		
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	
18"	90"	66.7	81.5	66.7	92.6	100.0	182.7	
24"		62.1	62.1	66.7	72.1	100.0	142.3	
30"		-	-	56.2	56.2	100.0	118.4	
36"		-	-	40.3	40.3	100.0	102.8	
42"		-	-	-	-	91.9	91.9	
48"		-	-	-	-	84.1	84.1	
54"		-	-	-	-	78.3	78.3	
60"		-	-	-	-	74.0	74.0	
18"		96"	66.7	75.0	66.7	92.0	100.0	175.1
24"			60.3	60.3	66.7	71.4	100.0	136.0
30"	-		-	55.2	55.2	100.0	112.8	
36"	-		-	38.7	38.7	97.6	97.6	
42"	-		-	-	-	87.0	87.0	
18"	102"	65.3	65.3	66.7	91.4	100.0	163.8	
24"		-	-	66.7	70.8	100.0	126.9	
30"		-	-	54.3	54.3	100.0	105.0	
36"		-	-	-	-	90.7	90.7	
42"		-	-	-	-	80.6	80.6	
18"	108"	57.3	57.3	66.7	83.7	100.0	175.8	
24"		-	-	66.7	70.3	100.0	136.0	
30"		-	-	53.2	53.2	100.0	112.3	
36"		-	-	-	-	96.7	96.7	
42"		-	-	-	-	85.8	85.8	
18"	114"	50.7	50.7	66.7	74.0	100.0	165.8	
24"		-	-	66.7	69.9	100.0	128.0	
30"		-	-	52.1	52.1	100.0	105.5	
36"		-	-	-	-	90.7	90.7	
42"		-	-	-	-	80.2	80.2	
18"	120"	45.2	45.2	65.8	65.8	100.0	156.8	
24"		-	-	65.8	65.8	100.0	120.9	
30"		-	-	50.9	50.9	99.5	99.5	
36"		-	-	-	-	85.3	85.3	
42"		-	-	-	-	75.4	75.4	

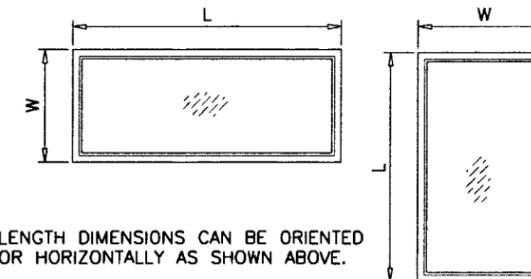

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

JA

JUN 02 2010

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-0610.05
Expiration Date 02/13/2013

By *[Signature]*
Miami Trade Product Control
Division

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL \W02 - 65CT

PW-6200 ALUMINUM FIXED WINDOW






CURV-A-TECH CORPORATION
930 W. 23rd STREET
HIALEAH, FL 33010
TEL. (305) 888-9631 FAX. (305) 888-9969

no	date	description
A	01.15.03	REV. PER BCCO COMMENTS
B	01.14.08	UPDATED FOR 2004 FBC
C	05.26.10	UPDATED FOR 2007 FBC

date: 07-15-02	scale: -	dr. by: HAMID	chk. by:
----------------	----------	---------------	----------

drawing no.
W02-65

sheet 3 of 5

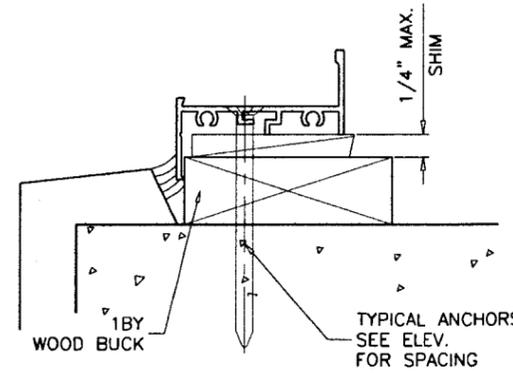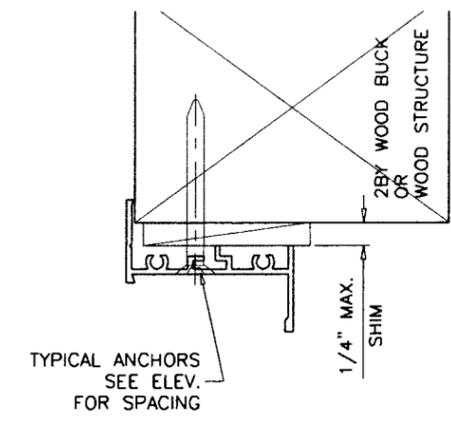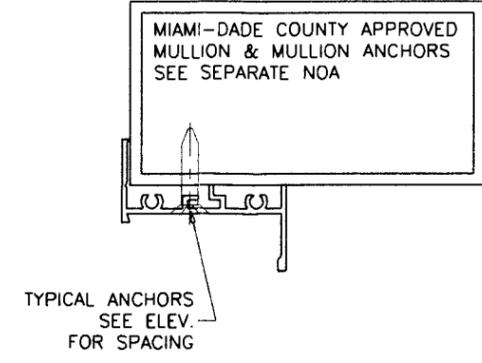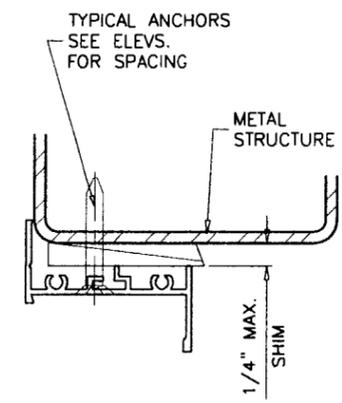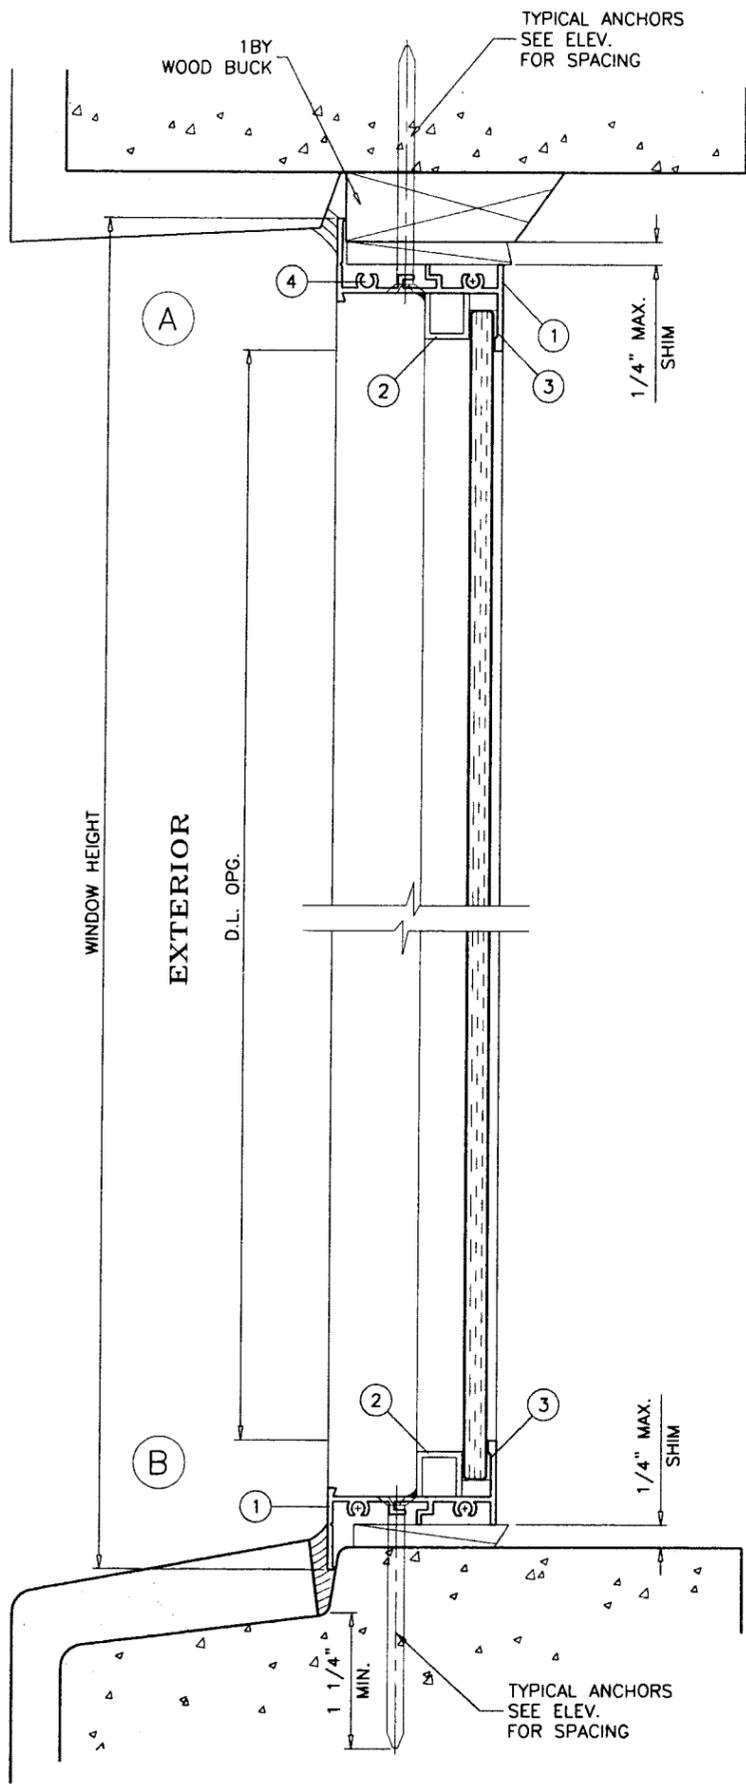

WOOD BUCKS AND METAL STRUCTURE NOT BY CURV-A-TECH MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)
1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD.
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 3/4" MIN.
 INTO METAL STRUCTURE = 1/2" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

SEALANTS:
 INSTALLATION SCREWS, FRAME CORNERS AND GLAZING BEAD TO FRAME SEALED WITH WHITE COLORED SILICONE.

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

JA
 JUN 02 2010

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No *10-0610.05*
 Expiration Date *02/13/2013*

By *[Signature]*
 Miami Dade Product Control
 Division

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 12335 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL \ W02-65CT

PW-6200 ALUMINUM FIXED WINDOW
CURV-A-TECH CORPORATION
 930 W. 23rd STREET
 HIALEAH, FL 33010
 TEL. (305) 888-9631 FAX. (305) 888-9969






no	date	by	description
A	01.15.03		REV. PER BCCO COMMENTS
B	01.14.08		UPDATED FOR 2004 FBC
C	05.26.10		UPDATED FOR 2007 FBC

date: 07-15-02
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W02-65

sheet 4 of 5

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	FS-00691	4	WINDOW FRAME	6063-T5	-
2	AF-2354	1/ SIDE	GLASS STOP	6063-T5	-
3	-	-	GLAZING COMPOUND	SILICONE	051/OCI
4	#8 X 1" PH P	2/ CORNER	ASSEMBLY SCREWS	-	-

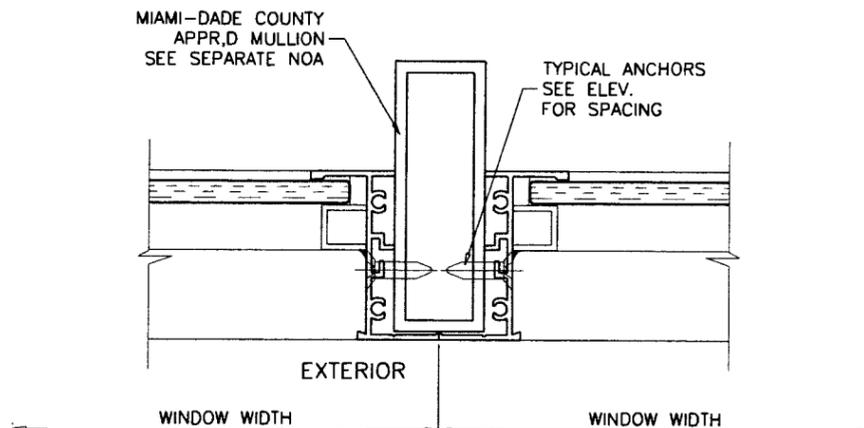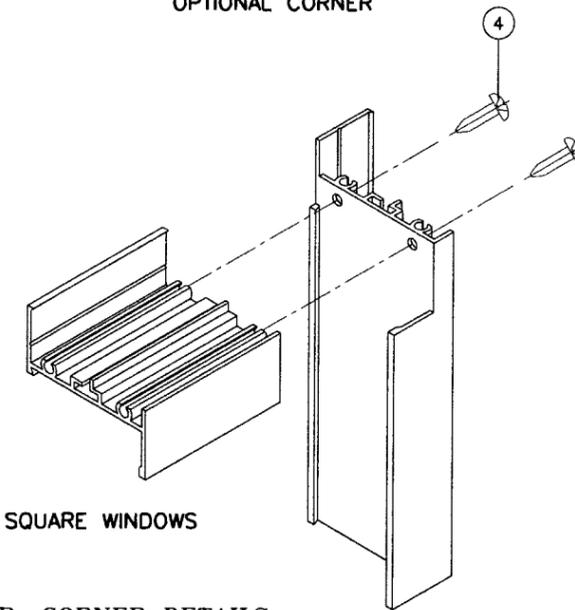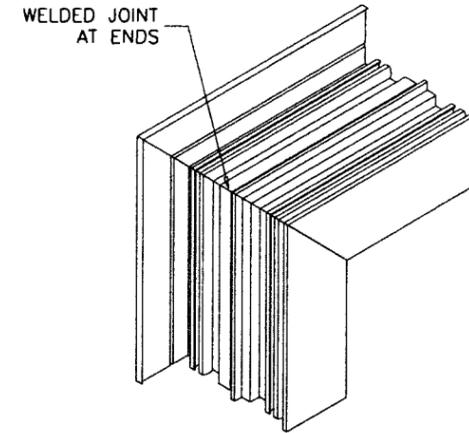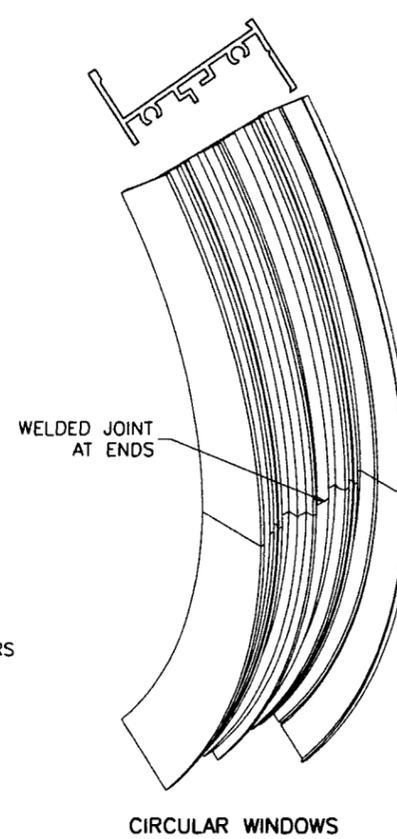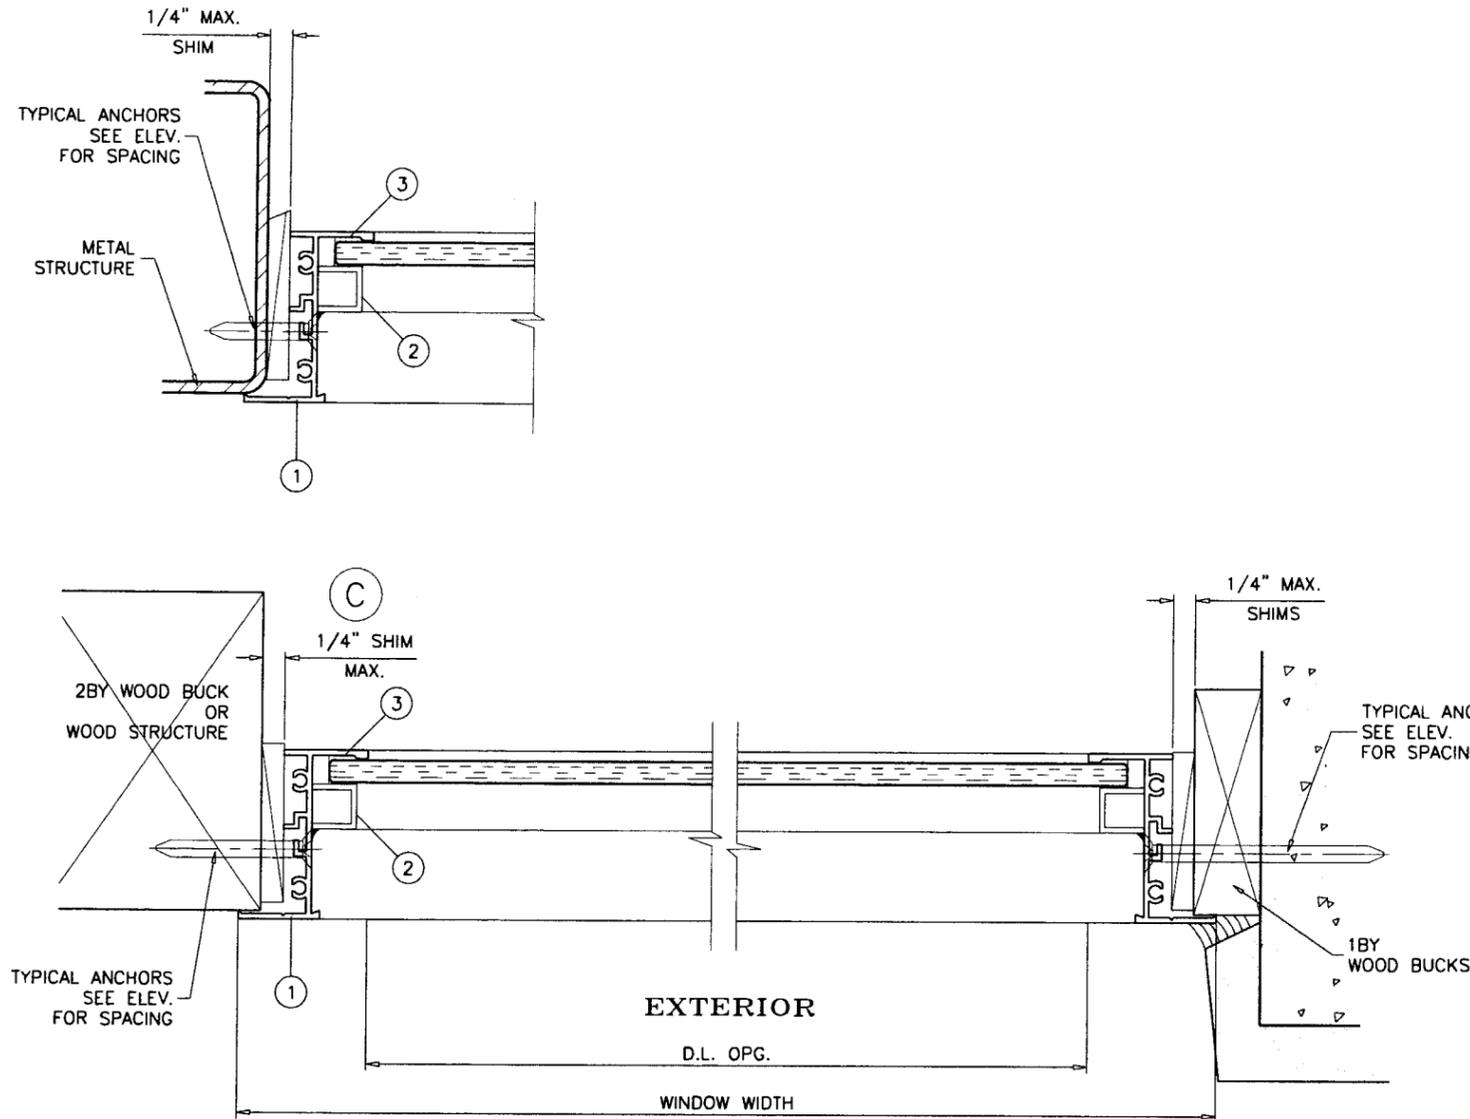

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

JA
 JUN 02 2010

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 10-0610.05
 Expiration Date 02/13/2013

By *Hamid*
 Miami Dade Product Control
 Division

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP - ANL \W02 - 65CT

PW-6200 ALUMINUM FIXED WINDOW
CURV-A-TECH CORPORATION
 930 W. 23rd STREET
 HIALEAH, FL 33010
 TEL. (305) 888-9631 FAX. (305) 888-9969

no	date	by	description
A	01.15.03	REV. PER BCCO COMMENTS	
B	01.14.08	UPDATED FOR 2004 FBC	
C	05.26.10	UPDATED FOR 2007 FBC	

revisions:

date: 07-15-02
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W02-65

sheet 5 of 5