



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/buildingcode

Quality Engineered Products, Co., Inc.
4506 Quality Lane
Tampa, FL 33622

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series 16 ga Outswing Double Flush Steel Doors-Impact

APPROVAL DOCUMENT: Drawing titled "8'-0" X 8'0" Double/Single Flush Door (outswing)", sheets 1 through 9 of 9, dated 10/01/2010, prepared by manufacturer, signed and sealed by David M. Schonacher, P. E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

- Limitation:**
1. Doors are 16 ga (.063" thk. Min.) w/ Tensile yield strength of min. 46.5 ksi.
 2. Doors w/ Pemko 2001AV threshold (item 5A) are not rated for water infiltration.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page, evidence sheet E-1, as well as, approval document mentioned above. The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



10/5/10

NOA No 10-0629.03
Expiration Date: October 13, 2015
Approval Date: October 13, 2010
Page 1

Quality Engineered Products, Co., Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing titled "8'-0" X 8'0" Double/Single Flush Door (outswing)", sheets 1 through 9 of 9, dated 10/01/2010, signed and sealed by David M. Schonacher, P. E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202.
 - 3) Water Resistance Test per FBC TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC and TAS 202-94

Along with marked-up drawings and installation diagram of double Outswing Flush Steel Doors, prepared by Certified Testing Lab Inc., Test Report No. **CTLA-1998W**, dated 04/07/10, signed and sealed by Ramesh Patel, P. E.

C. CALCULATIONS

1. Anchor verification calculations, dated 09/21/2010, prepared by The Avanti Group, Inc., signed and sealed by David M. Schonacher, P.E.

D. QUALITY ASSURANCE BY:

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Tensile test report prepared by prepared by Certified Testing Lab Inc., Test Report No. **CTLA-1998W**, tested per ASTM E8/A370, dated 08/19/10 signed and sealed by Ramesh Patel, P. E.
2. Notice of Acceptance No. **06-0823.09** issued to Dow Corning for "Fold Form Insulation", expiring on 05/31/2012.
3. Underwriter test report file # R3576 (Proj #09NK13240) dated Nov 16, 2009 for Surface Burning Characteristics for Fiberglass Batts & Blanket per ANSI/UL-723 & ASTM E-84, issued to Owens Corning, Toledo, OH.

F. STATEMENTS

1. Statesman letter of conformance to FBC 2007 and "No financial interest", dated 09/21/10, signed and sealed by David M. Schonacher, P. E.
2. Statement letter of compliance, as a part of the above referenced test report, issued by Certified Testing Lab., Inc.

G. OTHER

1. None

Ishaq I. Chanda

Ishaq I. Chanda, P.E.

Product Control Examiner

NOA No 10-0629.03

Expiration Date: October 13, 2015

Approval Date: October 13, 2010

INSTALLATION NOTES:

- ONE (1) ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- SHIM AS REQUIRED AT EACH ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR INSTALLATION INTO WOOD FRAMING USE 1/2 INCH DIAMETER WOOD LAG SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 2 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE. WOOD LAG SCREWS TO BE USED IN 3/4 INCH EMT PIPE SLEEVE.
- FOR INSTALLATION THROUGH 1x BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 3/8 INCH DIAMETER DYNABOLT SLEEVE ANCHOR BY ITW/REDHEAD OF SUFFICIENT LENGTH TO ACHIEVE 1 7/8 INCH MINIMUM EMBEDMENT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS. ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2007 FLORIDA BUILDING CODE (FBC) w/ 2009 SUPPLEMENTS, INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94/TAS 202-94 (STRUCTURAL ONLY)/TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT.
- (2) 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT. ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT FOR NON-HVHZ. ONE TIME APPROVAL IS REQUIRED FROM MIAMI-DADE COUNTY.
- THIS PRODUCT IS LARGE AND SMALL MISSILE IMPACT RESISTANT APPROVED. IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- DOOR FRAME MATERIAL: 16 GA. OR 14 GA. STEEL

QUALITY ENGINEERED PRODUCTS

8'-0" x 8'-0" DOUBLE/SINGLE FLUSH DOOR (OUTSWING)

Approved as complying with the Florida Building Code
 Date OCT 13, 2010
 NOA# 10-0629-03
 Miami Dade Product Control
 Division
 By Shag1. Chanda

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	-	INSTALLATION NOTES, GENERAL NOTES, & BILL OF MATERIALS
2	-	ELEVATIONS
3	-	INTERNAL ELEVATIONS & DETAILS
4	-	VERTICAL SECTIONS
5	-	HORIZONTAL SECTIONS
6	-	ANCHOR LOCATIONS
7	-	ANCHOR LOCATIONS
8	-	DETAILS
9	-	DETAILS

BILL OF MATERIALS		
MARK	QUANTITY	DESCRIPTION
1	1	16 GA. (.063") MIN. (14 GA. MAX.) STEEL HOLLOW METAL FRAME
2	1 OR 2	16 GA. (.063") MIN. (14 GA. MAX.) STEEL HOLLOW METAL DOORS Fy MIN. = 46,500 PSI
3	8	HAGER HINGES BB1279 4-1/2" x 4-1/2" x .134" THICK
4	10	1/2" DIA. DYNABOLT ITW/REDHEAD SLEEVE ANCHOR (3/8" DIA. BOLT) X 4-1/2" SLEEVE ANCHOR W/ 3/4" DIA. WELDED PIPE SLEEVE W/ 1-7/8" MIN. EMBEDMENT & 3" MIN. EDGE DISTANCE
4A	10	1-3/4" x 5-3/4" x 12" T-ANCHORS (SEE SHEET 7)
4B	10	1/2" x 5-1/2" WOOD LAG SCREWS (2-1/2" MIN. EMBEDMENT) W/ 3/4" EMT PIPE SLEEVE
4C	10	0.187" DIA. WIRE ANCHOR
5	1	HAGER 434V THRESHOLD W/ 1/4" x 2" ITW TAPCONS (Fu = 125 KSI, Fy = 100 KSI) @ 12" O/C W/ 1-1/2" MIN. EMBEDMENT INTO CONC. (SEE ELEV. PER SHEET 6)
5A	1	PEMKO 2001AV THRESHOLD W/ 1/4" x 2" ITW TAPCONS (Fu = 125 KSI, Fy = 100 KSI) @ 12" O/C W/ 1-1/2" MIN. EMBEDMENT INTO CONC. (NOT RATED FOR WATER INFILTRATION)
6	AS REQ.	NATIONAL GUARD WEATHERSTRIP 160VA W/ #6 x 5/8" SCREWS @ 6" O/C
7	1	PEMKO 347A TOP DRIP W/ #6 x 5/8" SCREWS @ 6" O/C (ONLY REQUIRED IF WATER RESISTANCE IS NEEDED)
8	1	PEMKO 68A TOP WEATHERSTRIP W/ #6 x 5/8" SCREWS @ 6" O/C (ONLY REQUIRED IF WATER RESISTANCE IS NEEDED)
9	2	PEMKO 375CR ASTRAGAL (EXTERIOR ONLY IF WATER RESISTANCE IS NEEDED)
10	8	7 GA. STEEL FRAME HINGE REINFORCEMENT (1-1/4" x 10")
11	8	7 GA. STEEL DOOR HINGE REINFORCEMENT (1-1/4" x 10")
12	2 OR 4	16 GA. TOP & BOTTOM CHANNEL, SPOT WELD 4" O/C
13	AS REQ.	20 GA. STEEL HAT STIFFENER, SPOT WELD 5" O/C
14	AS REQ.	OWENS CORNING FIBERGLASS INSULATION
16	2	12 GA. STEEL 1-1/2" x 4-1/2" FULL HEIGHT LOCK REINFORCEMENT
17	2	ROCKWOOD 585 SURFACE BOLTS (DOUBLE DOOR INACTIVE PANEL ONLY)
18	2	18 GA. STEEL TOP CAP, TACK WELD & CAULK (3/4" x 1-1/2")
19	AS REQ.	16 GA. (.063") MIN. HINGE CHANNEL REINFORCEMENT 3/8" x 5/8" x 1-1/4"
20	1	MARKS 195 SERIES W/ DEADBOLT OR BEST 93K W/ 83T DEADBOLT (CYLINDRICAL)
21	1	BEST 45H SERIES OR MARKS 5 SERIES MORTISE LOCKSET
22	1	1-1/4" x .375" CELL FOAM (WHERE WATER RESISTANCE IS NEEDED)


DESIGN PRESSURE RATING		
	WHERE WATER FILTRATION REQUIREMENT IS NEEDED (HAGER 434V THRESHOLD)	WHERE WATER FILTRATION REQUIREMENT IS NOT NEEDED (PEMKO 2001AV THRESHOLD)
POSITIVE	+80.0 PSF	+80.0 PSF
NEGATIVE	-80.0 PSF	-80.0 PSF

Quality Engineered Products Co., Inc.

4506 QUALITY LN.
 TAMPA, FL. 33634
 PH: (813) 885-1693 FX: (813) 884-2673


TITLE: 8'-0" x 8'-0" DOUBLE/SINGLE FLUSH DOOR
 INSTALLATION & GENERAL NOTES, & BILL OF MATERIALS

REVISIONS	NO.	DESCRIPTION	BY	DATE

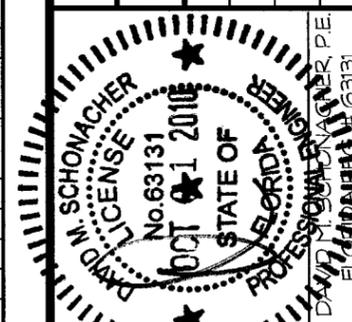


DATE: 09.15.10
 DWN BY: KRM
 CHK BY: DMS
 SCALE: NTS


SHEET: 1 OF 9

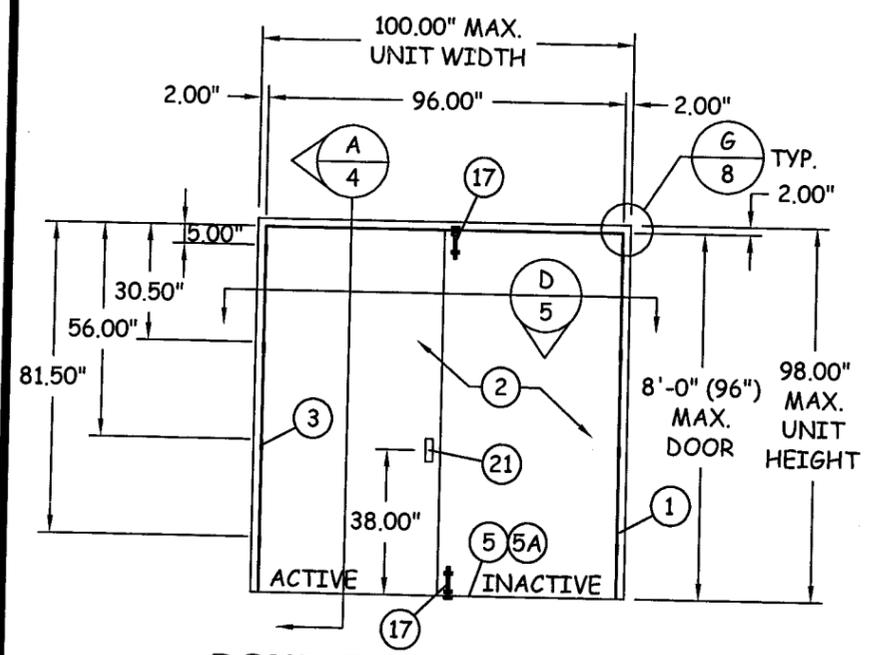

**DOUBLE OUTSWING DOOR
(INTERIOR VIEW)**

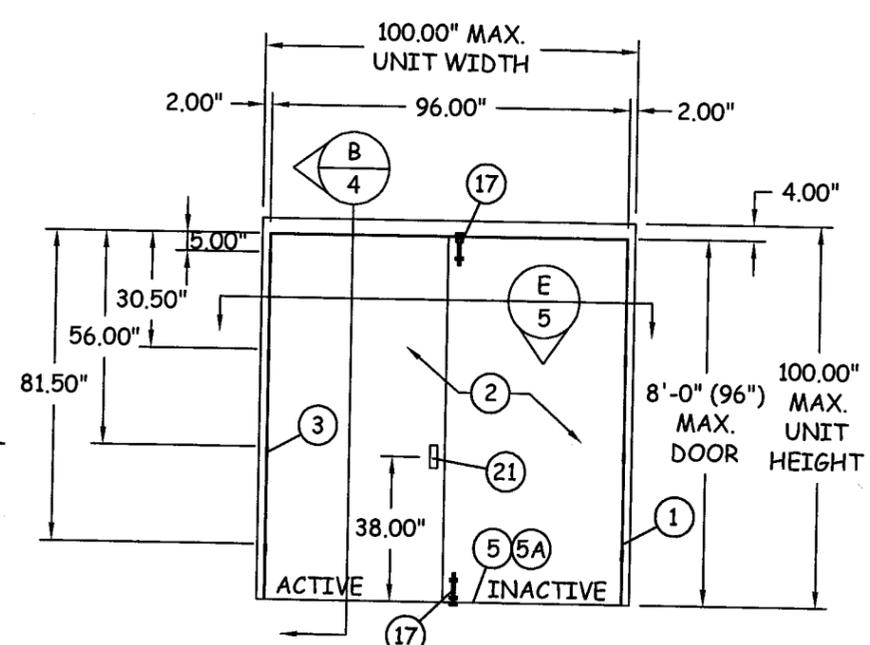


**DOUBLE OUTSWING DOOR
(INTERIOR VIEW)**

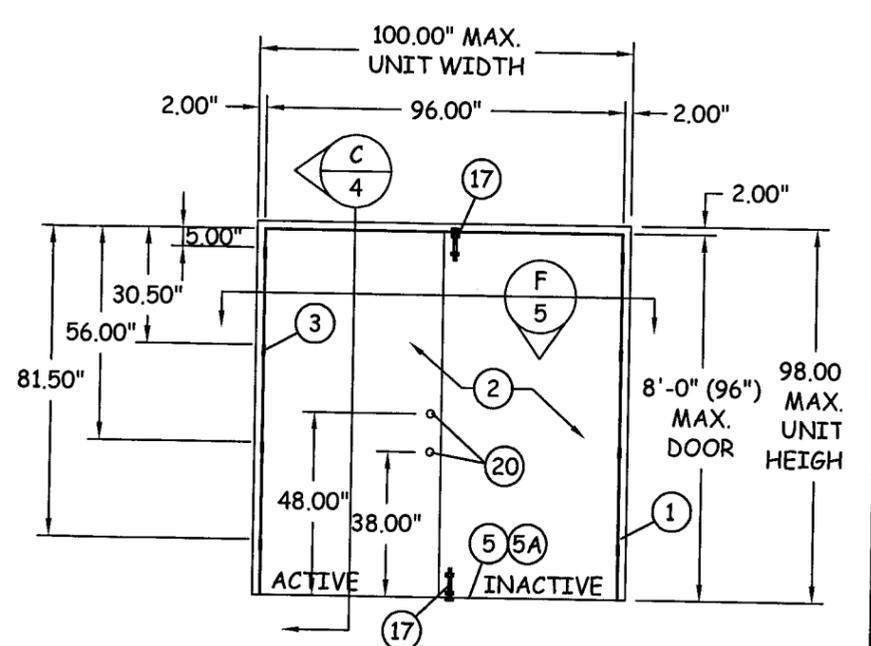


**DOUBLE OUTSWING DOOR
(INTERIOR VIEW)**


Approved as complying with the
Florida Building Code
Date OCT 13, 2010
NOA# 10-0629-03
Miami Dade Product Control
Division
By Isaac L. Chan

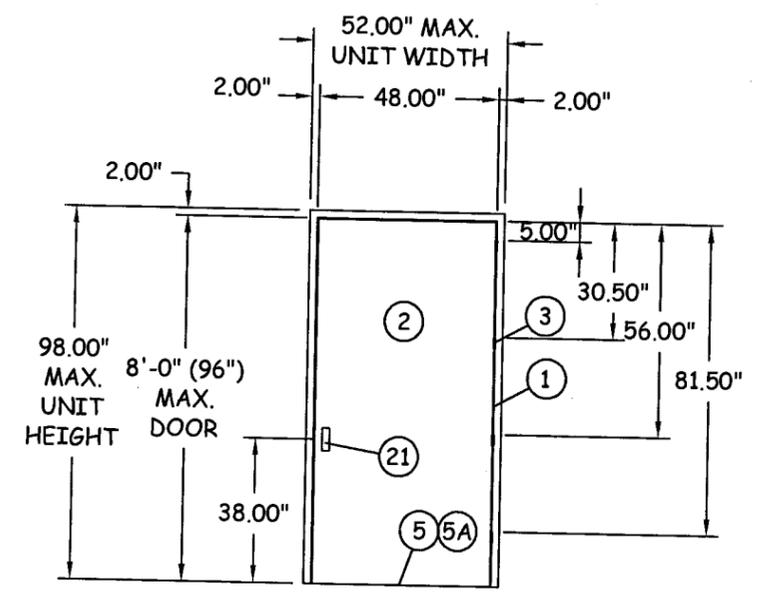

**SINGLE OUTSWING DOOR
(INTERIOR VIEW)**

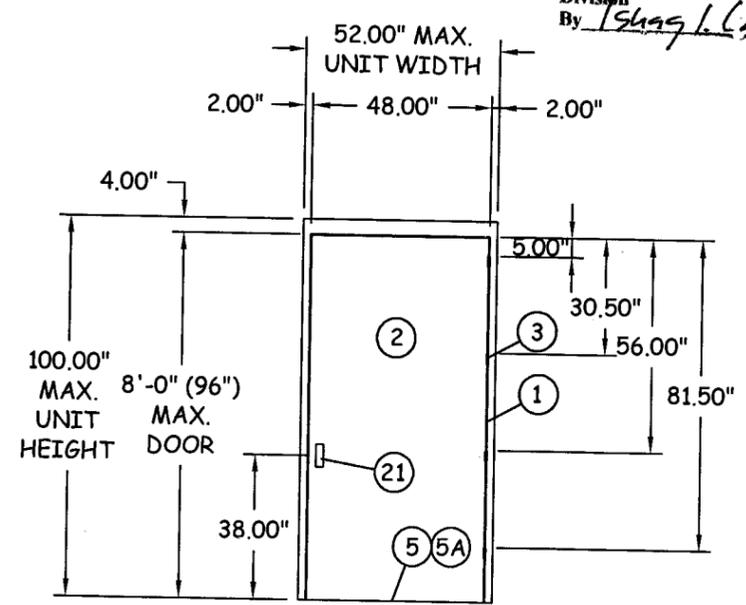


**SINGLE OUTSWING DOOR
(INTERIOR VIEW)**

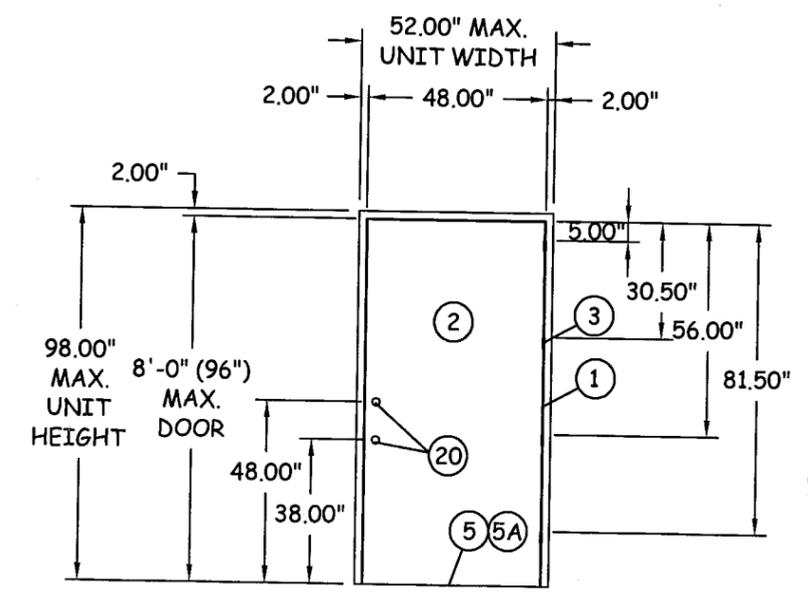

**SINGLE OUTSWING DOOR
(INTERIOR VIEW)**

TITLE:
8'-0" x 8'-0"
DOUBLE / SINGLE
FLUSH DOOR
ELEVATIONS

NO.	DESCRIPTION	REVISIONS	
		BY	DATE

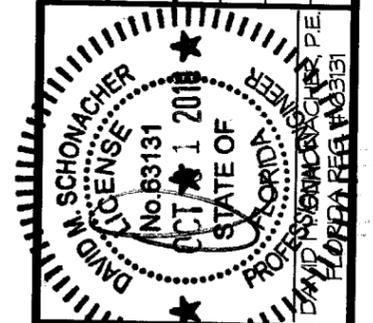


DATE: 09.15.10
DWN BY: KRM
CHK BY: DMS
SCALE: NTS

SHEET:


TITLE:
8'-0" x 8'-0"
DOUBLE/SINGLE
FLUSH DOOR
INTERNAL ELEVATIONS
& DETAILS

REVISIONS


NO.	DESCRIPTION	BY	DATE

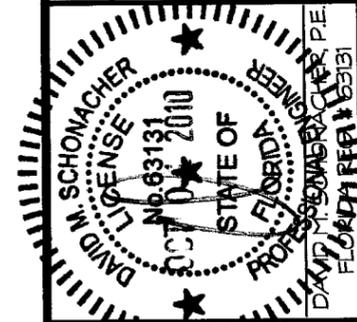


DATE: 09.15.10	DWN BY: KRM	CHK BY: DMS	SCALE: NTS
-------------------	----------------	----------------	---------------

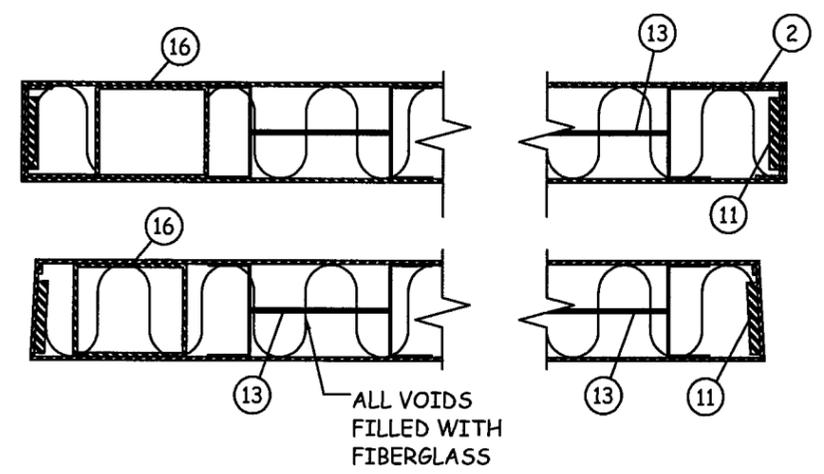


H
3 SEAMLESS EDGE DOOR

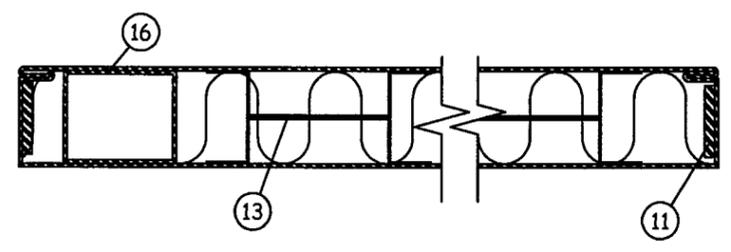

I
3 EDGE SEAM DOOR

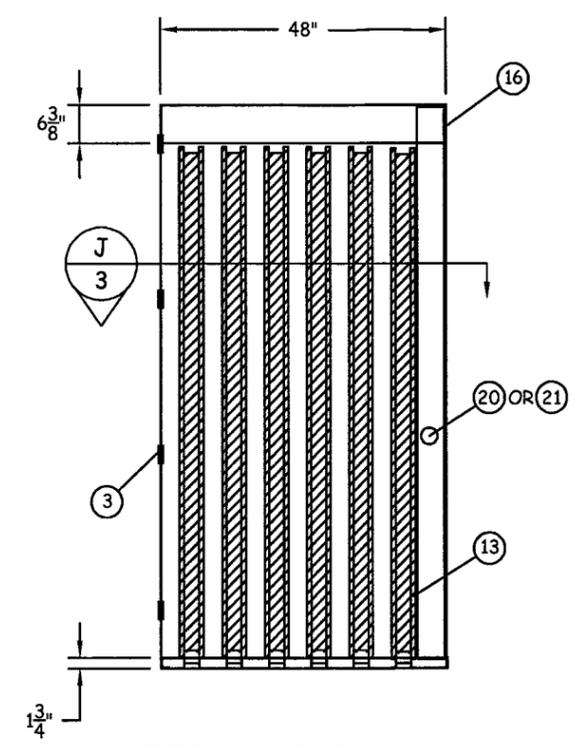


J
3 INTERNAL ELEVATION
HAT CHANNEL REINFORCED
DOOR PANEL ILLUSTRATION

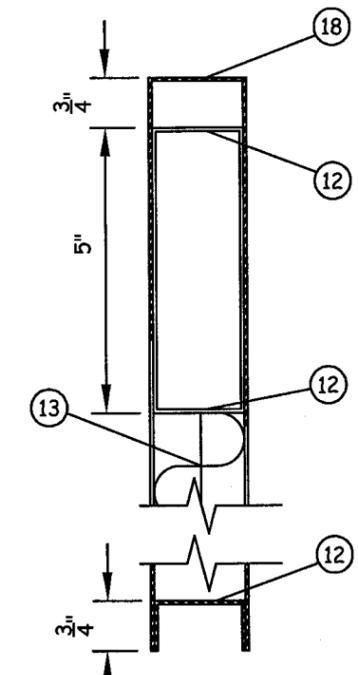

K
3 VERTICAL DOOR SECTION

Approved as complying with the
Florida Building Code
Date: OCT 13, 2010
NOA# 10-0229-03
Miami Dade Product Control
Division
By: 154971.Chant

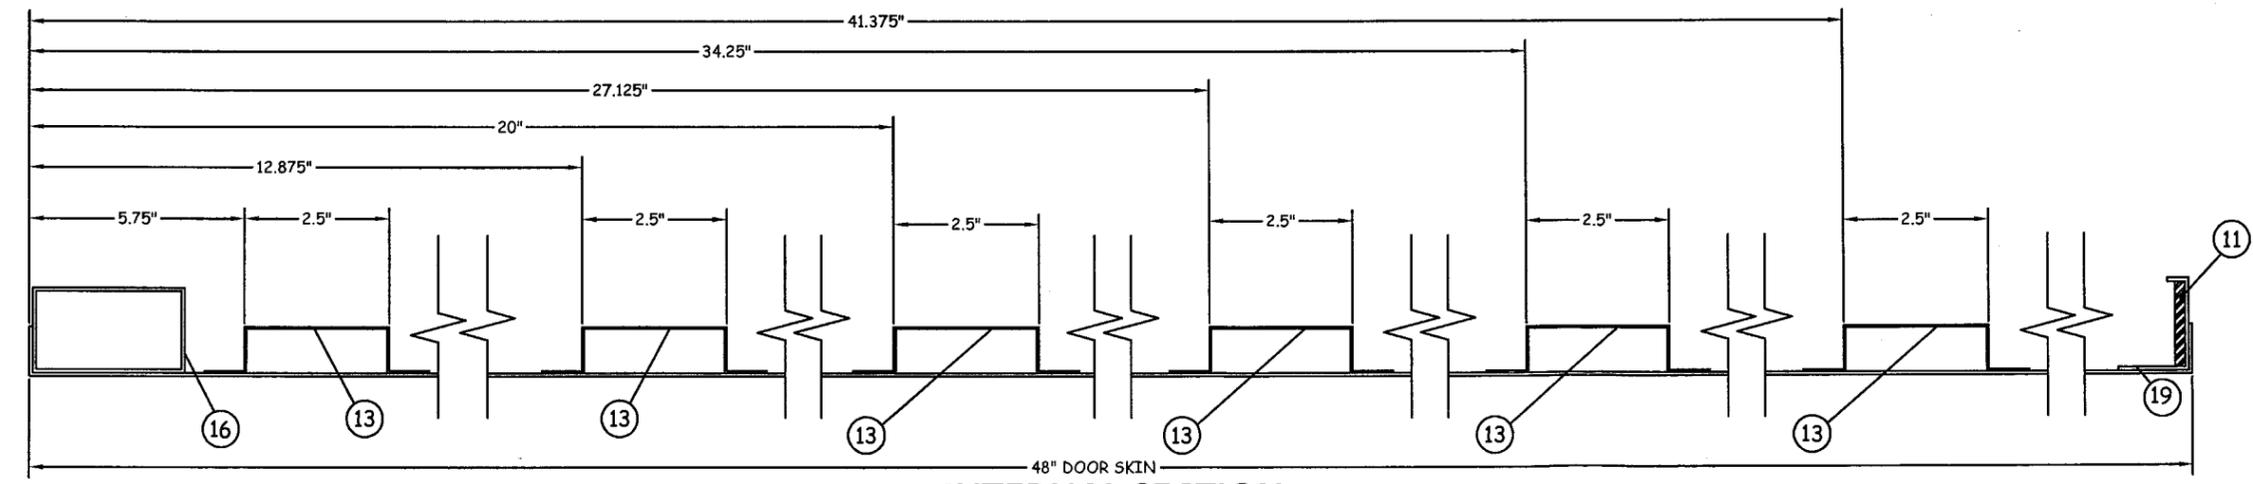


J
3 INTERNAL SECTION
REINFORCEMENT SPACING

TITLE:
8'-0" x 8'-0"
DOUBLE/ SINGLE
FLUSH DOOR
VERTICAL SECTIONS




REVISIONS

NO.	DESCRIPTION	BY	DATE

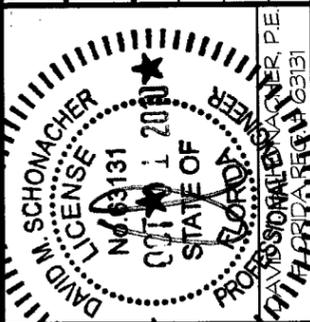

DATE: 09.15.10
DWN BY: DWN
CHK BY: KRA
SCALE: 1/8" = 1'-0"
NTS

SHEET:
4 OF 9

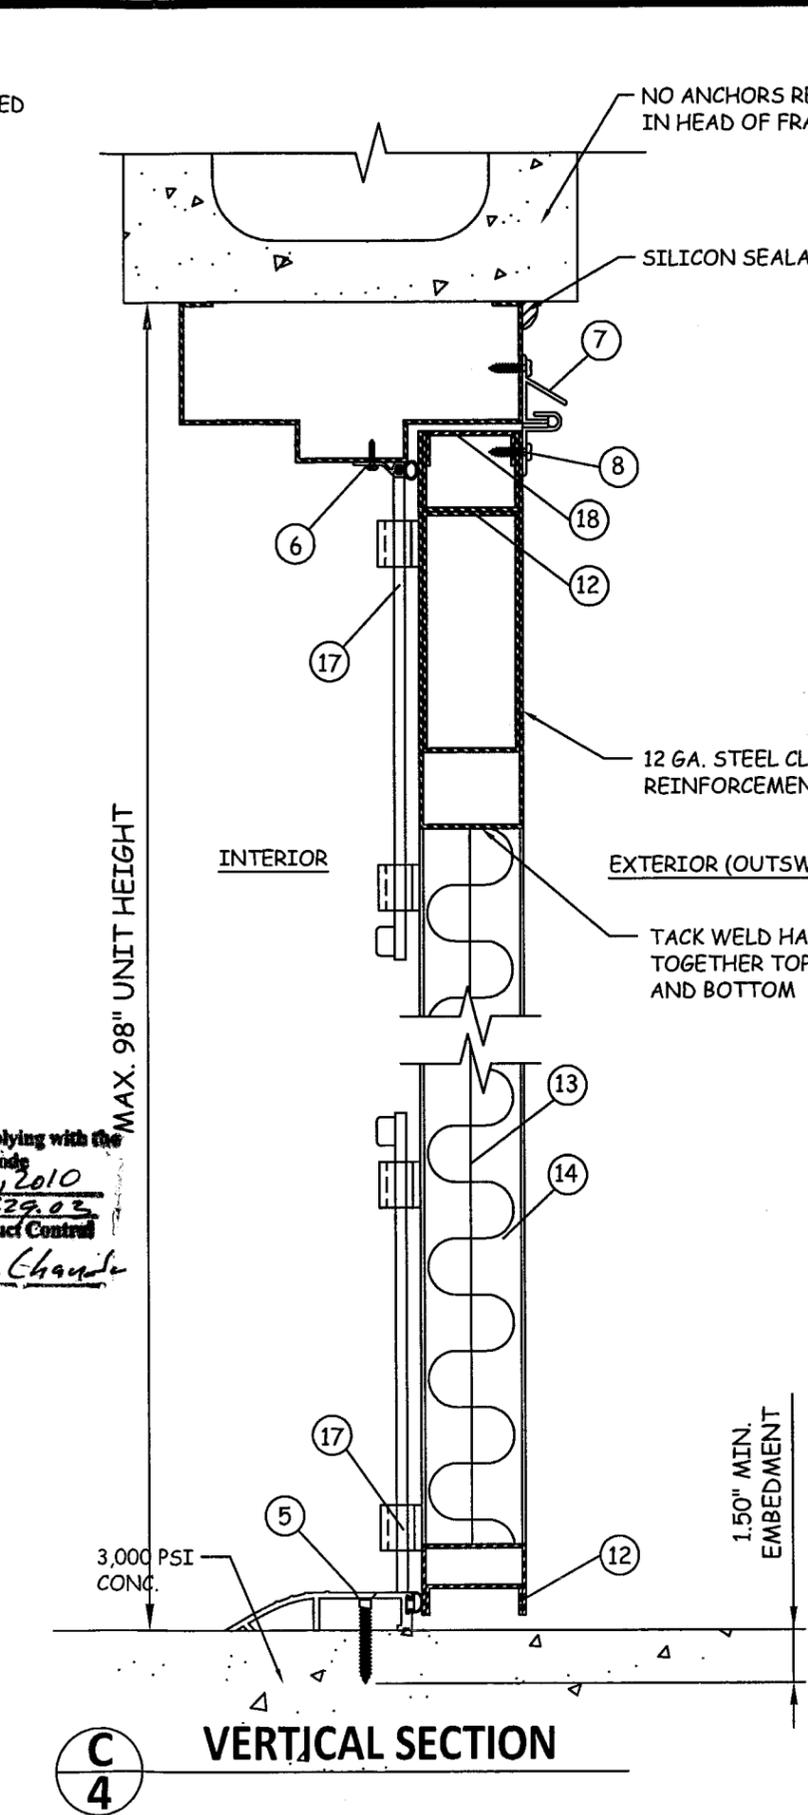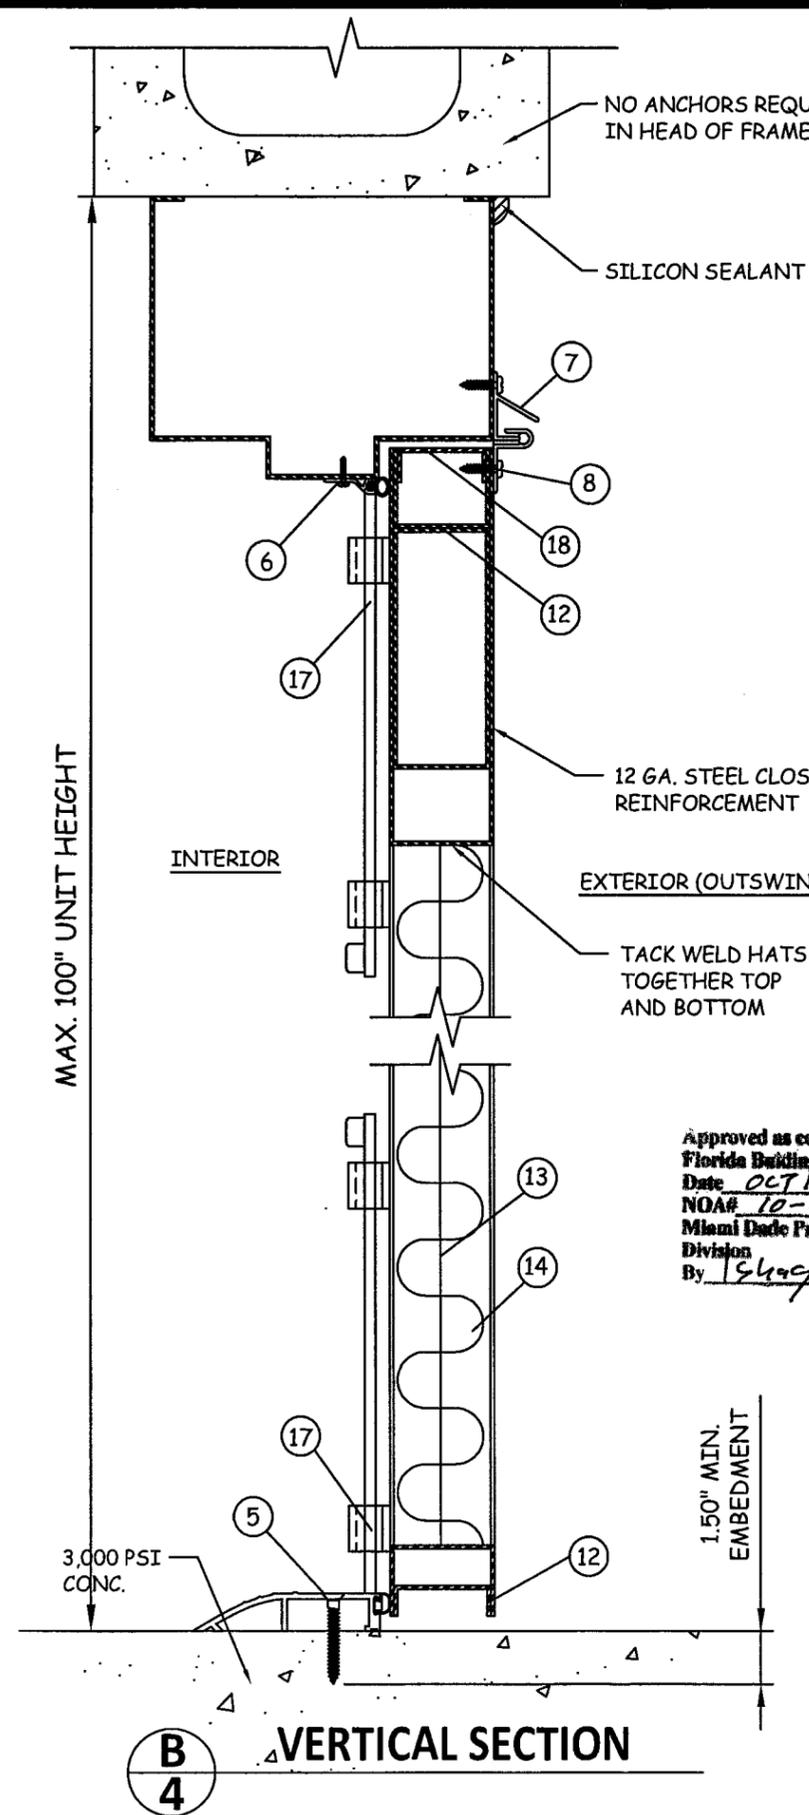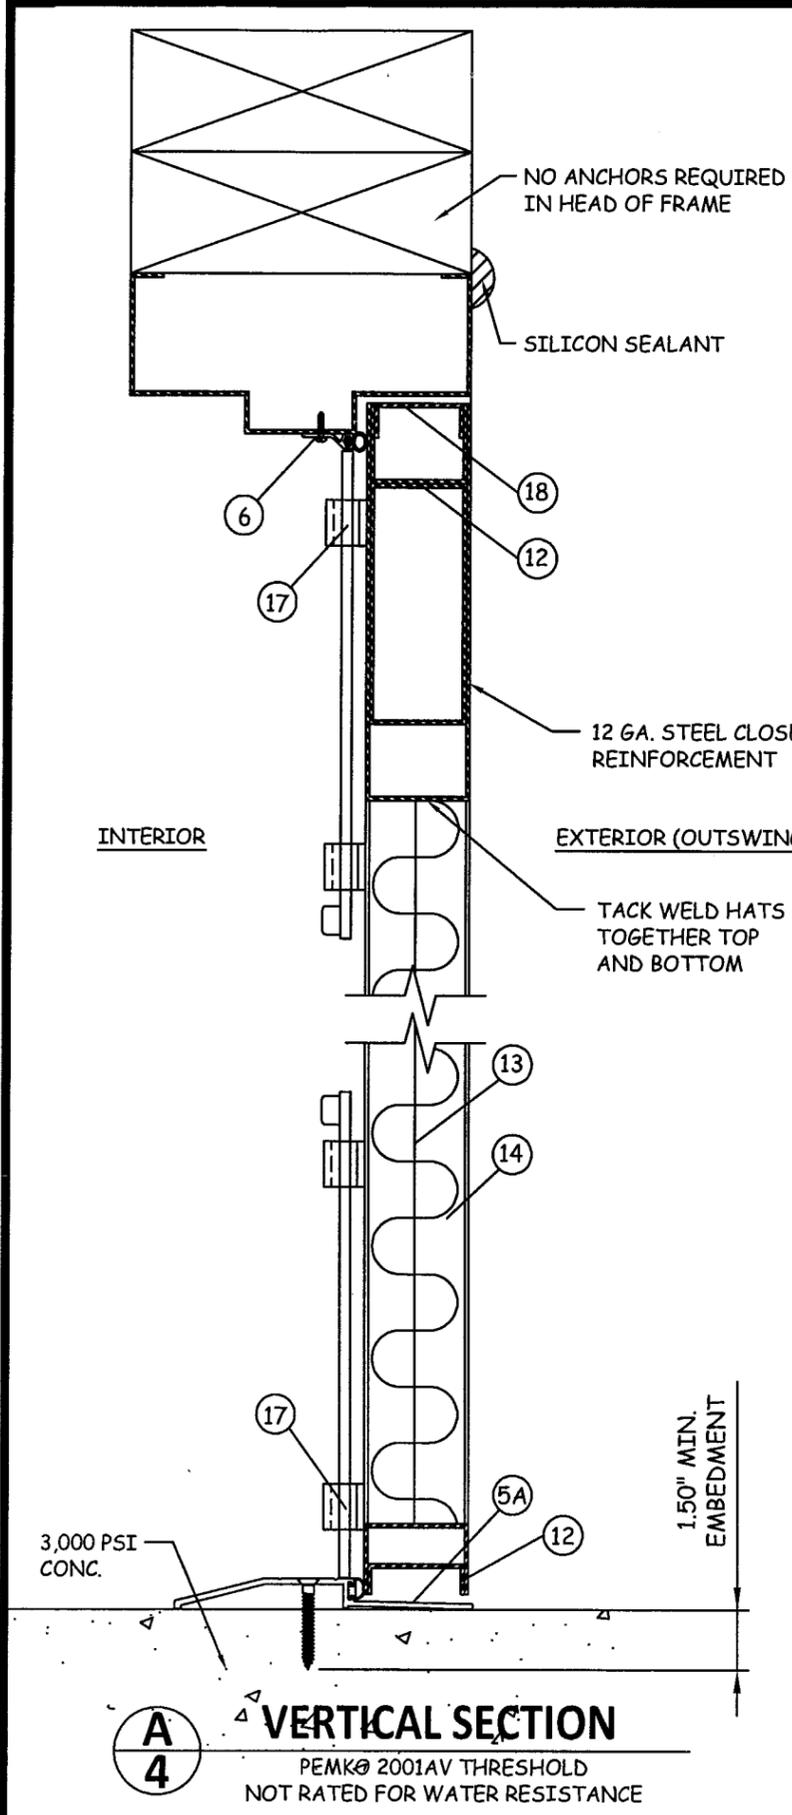


Approved as complying with the
Florida Building Code
Date OCT 13, 2010
NOA# 10-0629.02
Miami Dade Product Control
Division
By Shag J. Chaudhry

TITLE:
8'-0" x 8'-0"
DOUBLE/ SINGLE
FLUSH DOOR
HORIZONTAL SECTIONS


REVISIONS

NO.	DESCRIPTION	BY	DATE

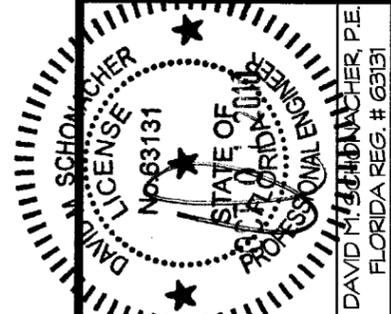


DATE: 09.15.10
DWN BY: KRM
CHK BY: DMS
SCALE: NTS

SHEET:
5 OF 9

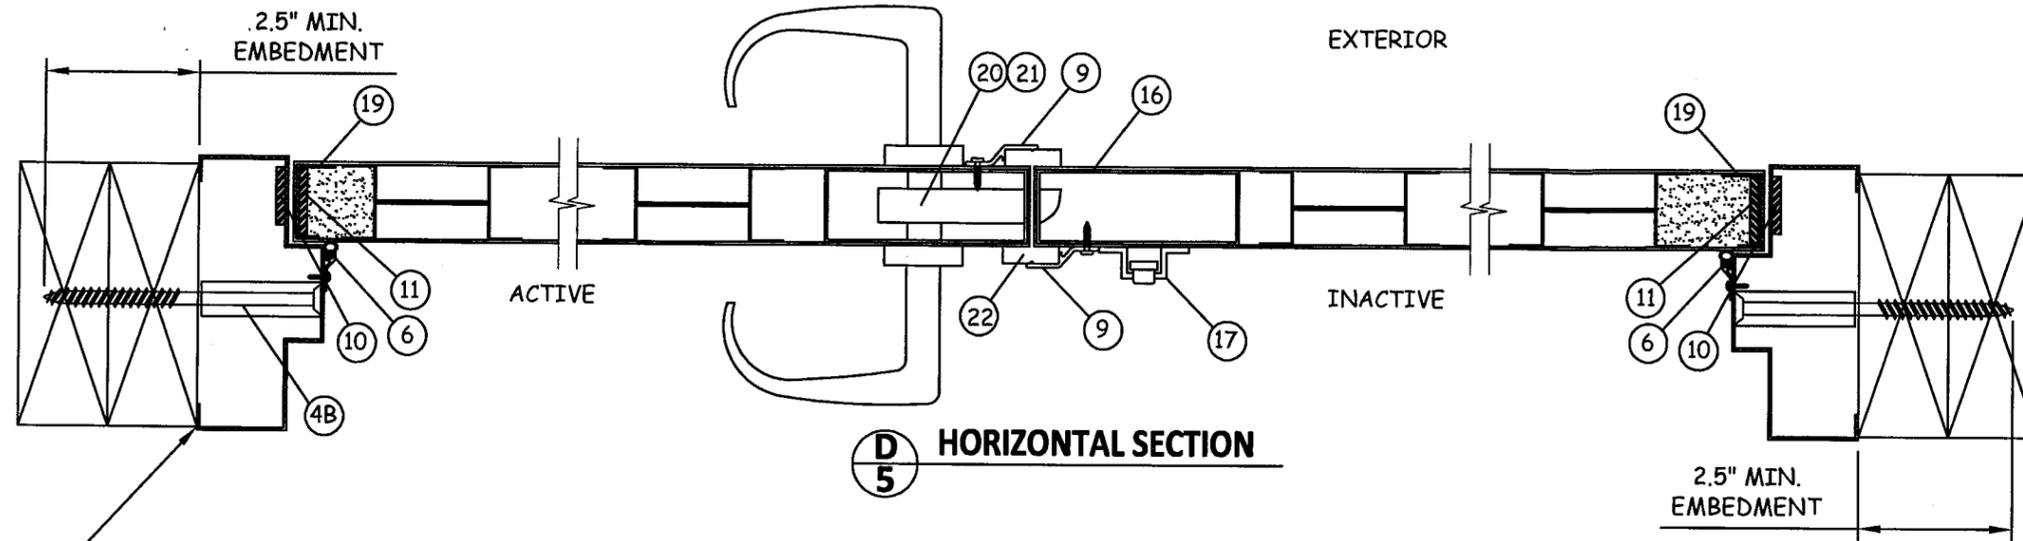


D
5 HORIZONTAL SECTION

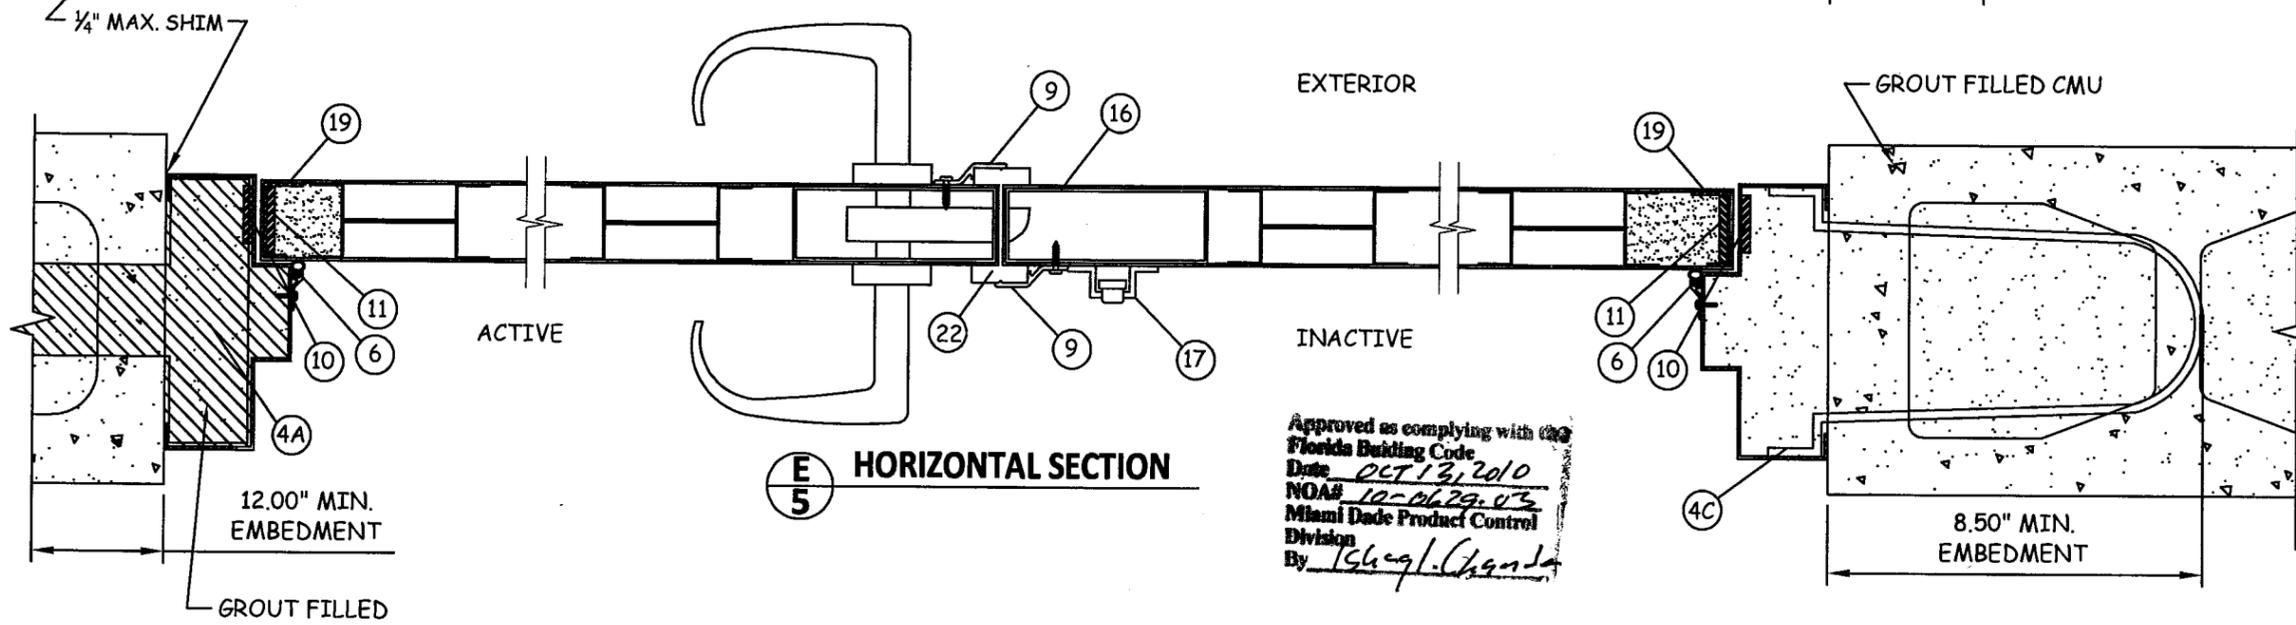


E
5 HORIZONTAL SECTION

Approved as complying with the
Florida Building Code
Date 02/13/2010
NOA# 10-0429-03
Miami Dade Product Control
Division
By 15691/Chanda

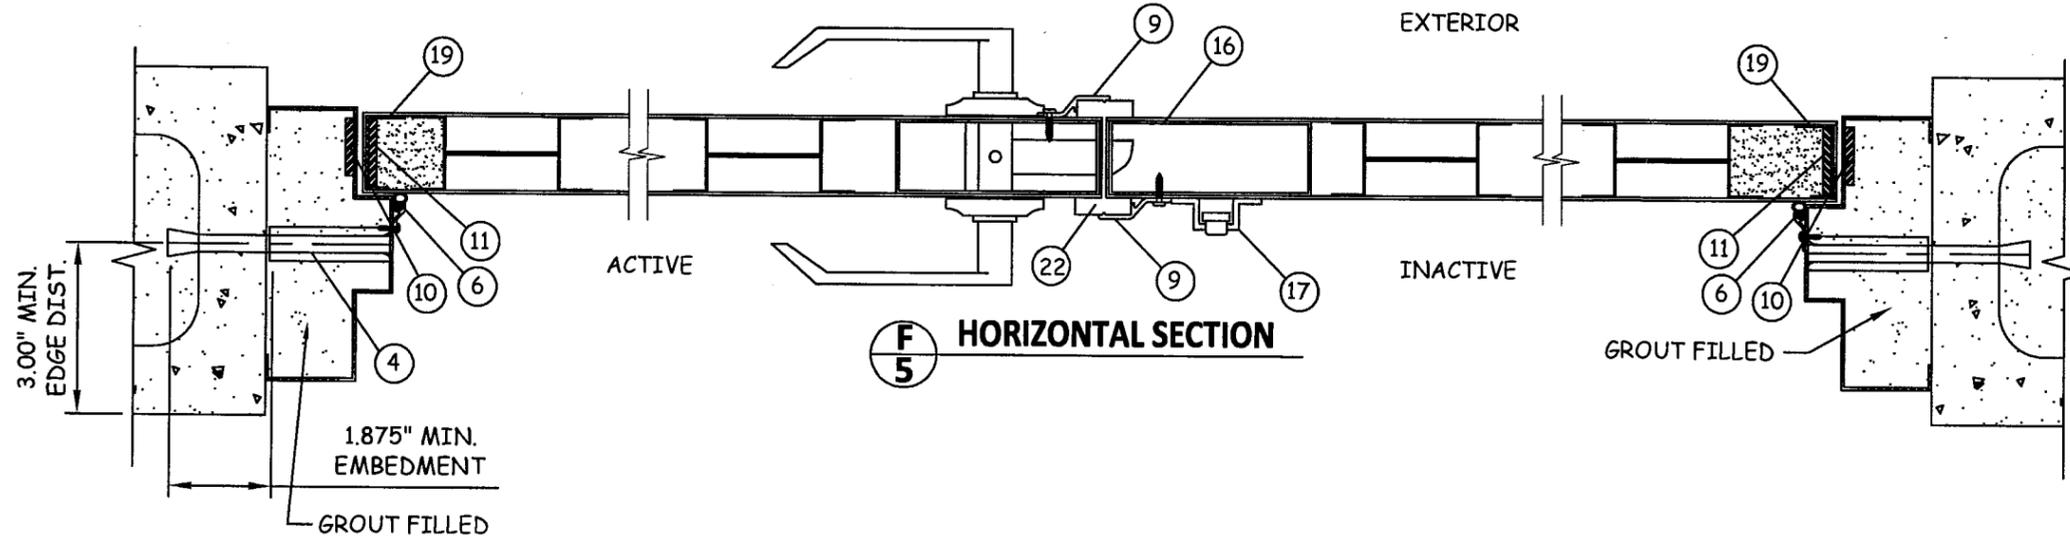


F
5 HORIZONTAL SECTION

TITLE:
8'-0" x 8'-0"
DOUBLE/ SINGLE
FLUSH DOOR
ANCHOR LOCATIONS

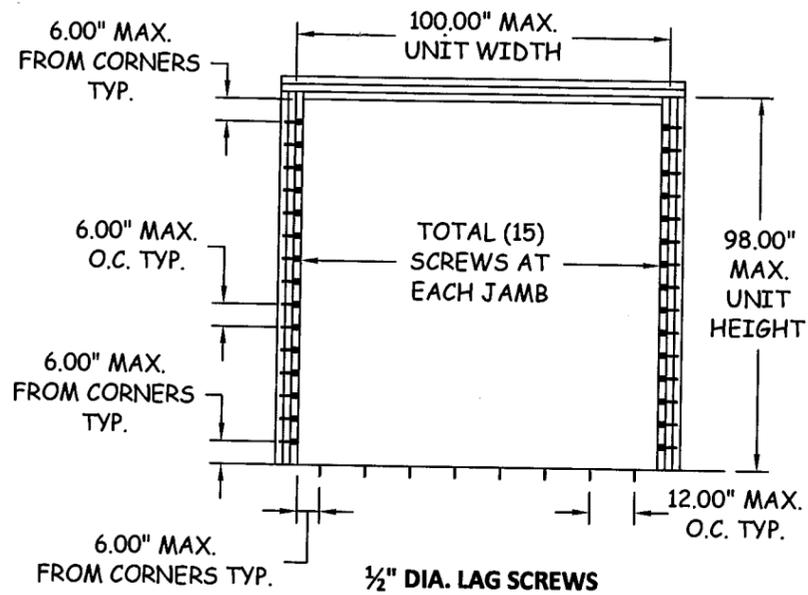


ANCHOR LOCATION

INSTALLATION INTO WOOD STRUCTURE

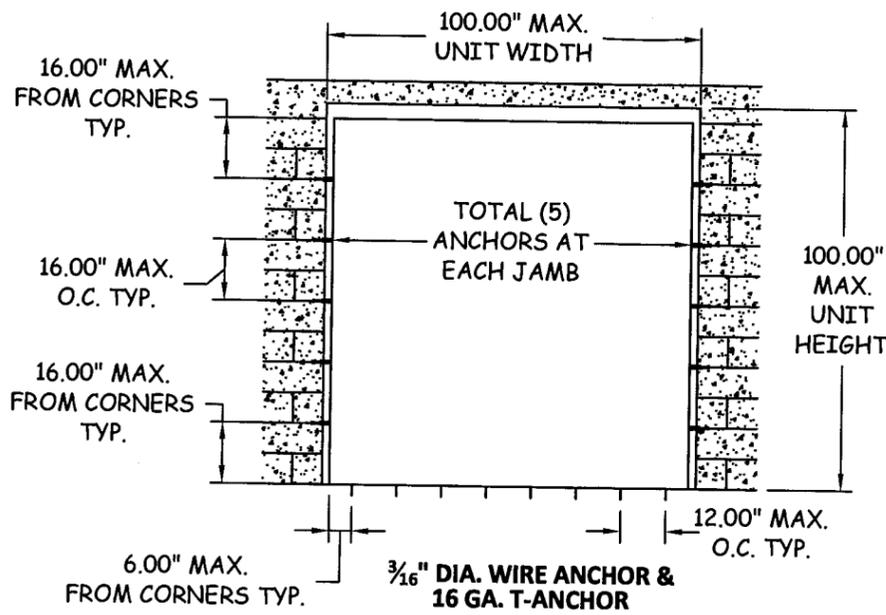


ANCHOR LOCATION

INSTALLATION INTO NEW MASONRY
(GROUT FILLED BLOCKS)

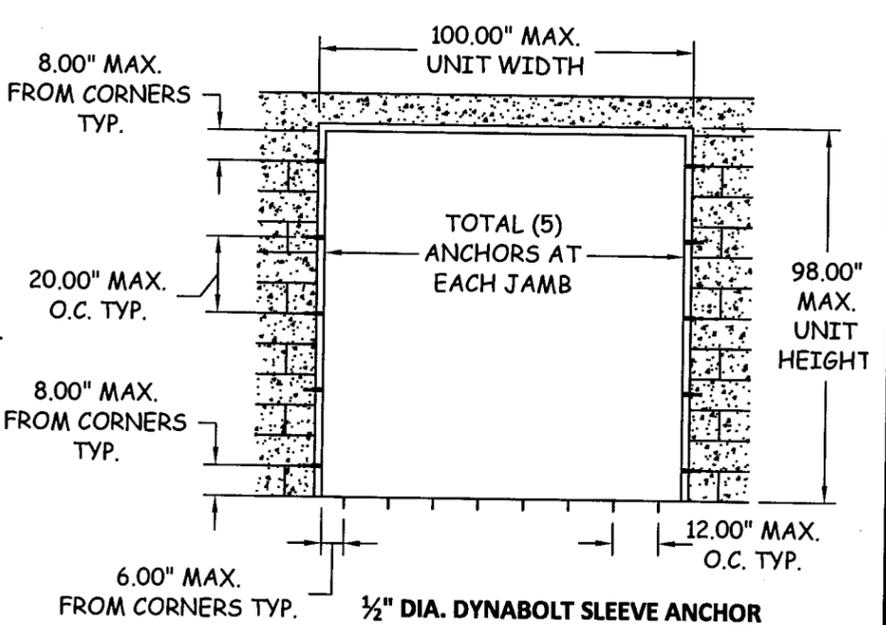


ANCHOR LOCATION

INSTALLATION INTO EXIST. MASONRY
(GROUT FILLED BLOCKS)

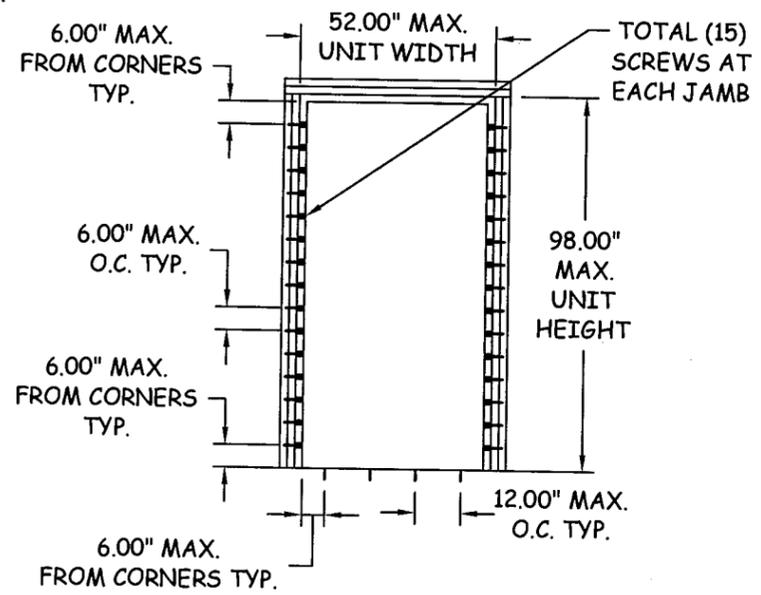


ANCHOR LOCATION

INSTALLATION INTO WOOD STRUCTURE

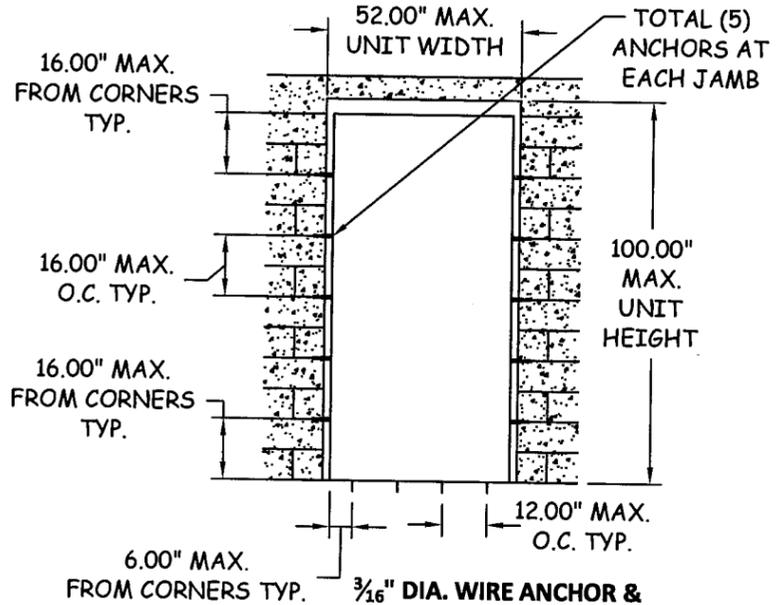

ANCHOR LOCATION

INSTALLATION INTO NEW MASONRY
(GROUT FILLED BLOCKS)

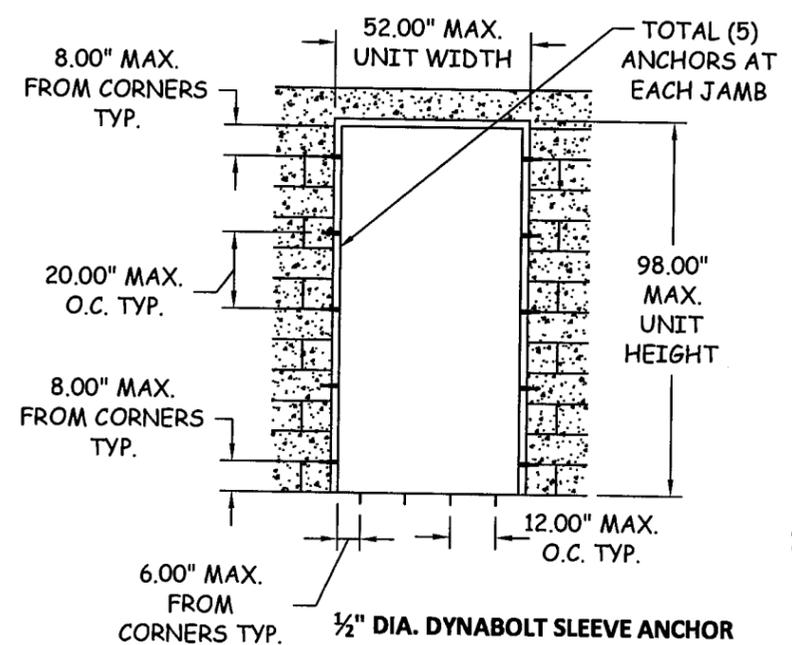


ANCHOR LOCATION

INSTALLATION INTO EXIST. MASONRY
(GROUT FILLED BLOCKS)

Approved as complying with the
Florida Building Code
Date OCT 13, 2010
NOA# 10-0629-03
Miami Dade Product Control
Division
By Chag I. Chant


NO.	DESCRIPTION	BY	DATE	
				REVISIONS

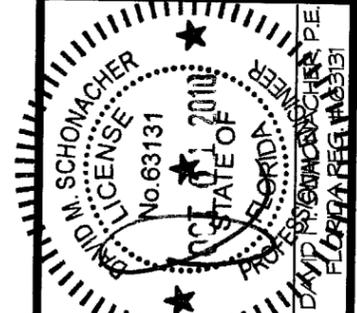

DATE: 09.15.10	DWN BY: KRM	CHK BY: DMS	SCALE: NTS
-------------------	----------------	----------------	---------------


SHEET:

TITLE:
8'-0" x 8'-0"
DOUBLE/ SINGLE
FLUSH DOOR
ANCHOR LOCATIONS

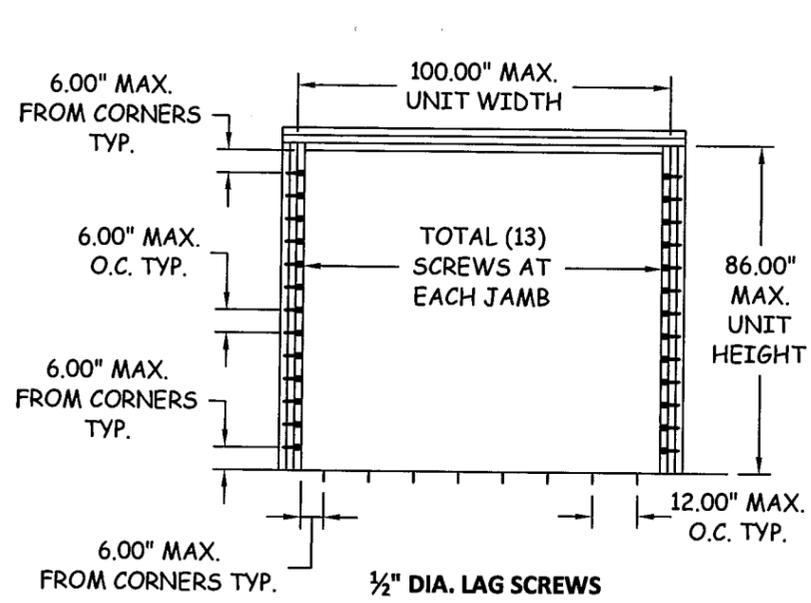


ANCHOR LOCATION

INSTALLATION INTO WOOD STRUCTURE

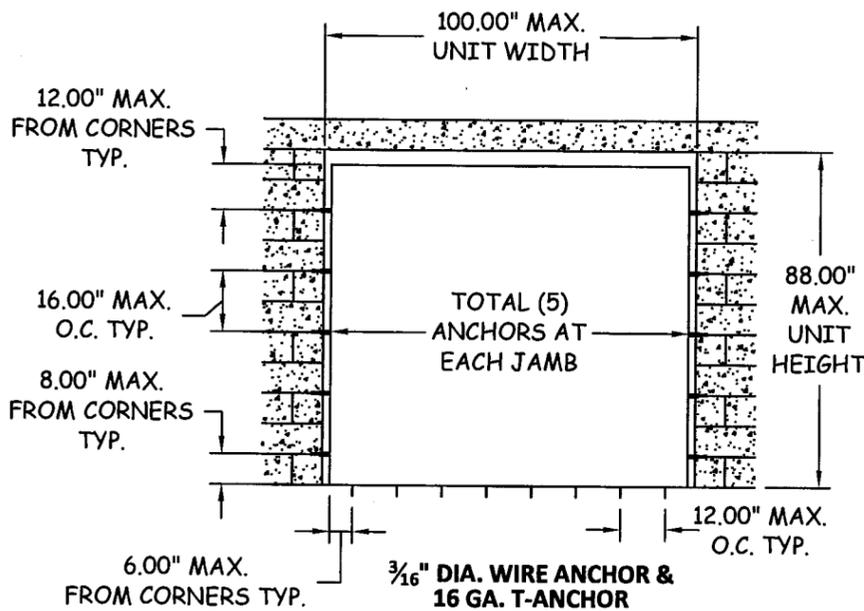


ANCHOR LOCATION

INSTALLATION INTO NEW MASONRY
(GROUT FILLED BLOCKS)

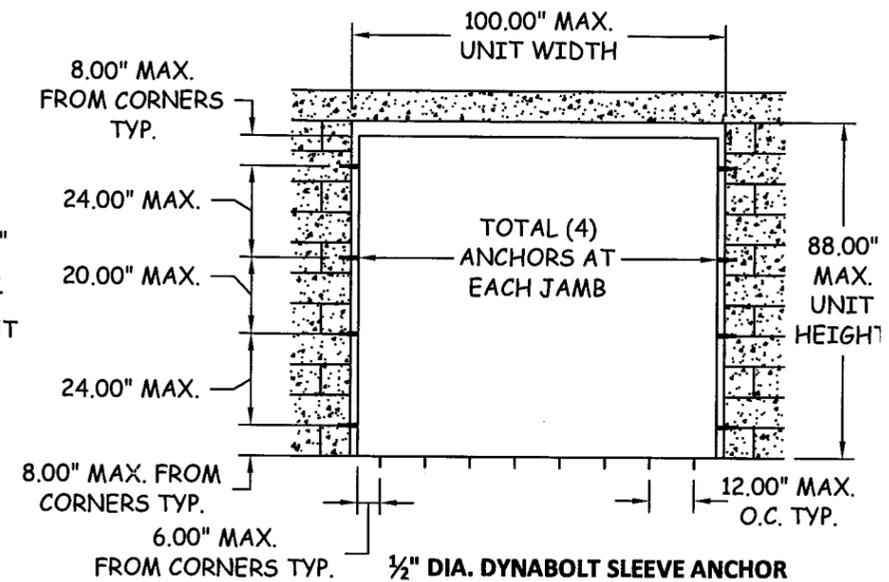


ANCHOR LOCATION

INSTALLATION INTO EXIST. MASONRY
(GROUT FILLED BLOCKS)

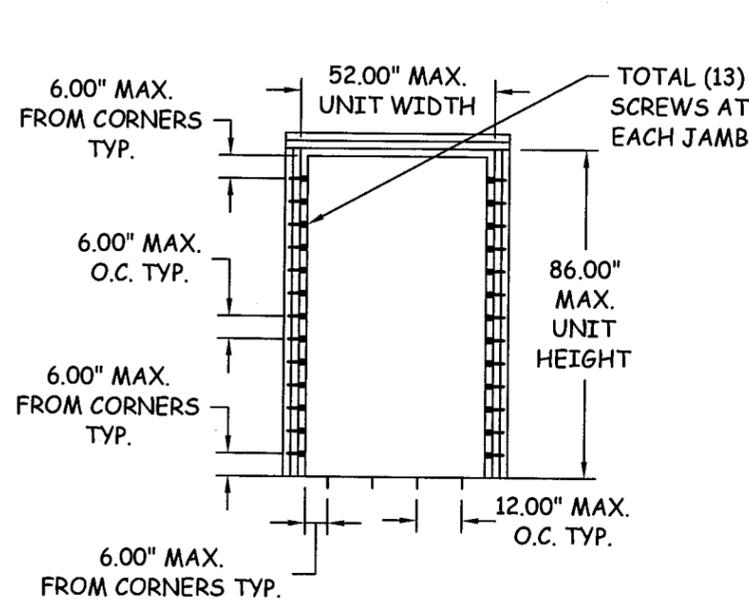


ANCHOR LOCATION

INSTALLATION INTO WOOD STRUCTURE

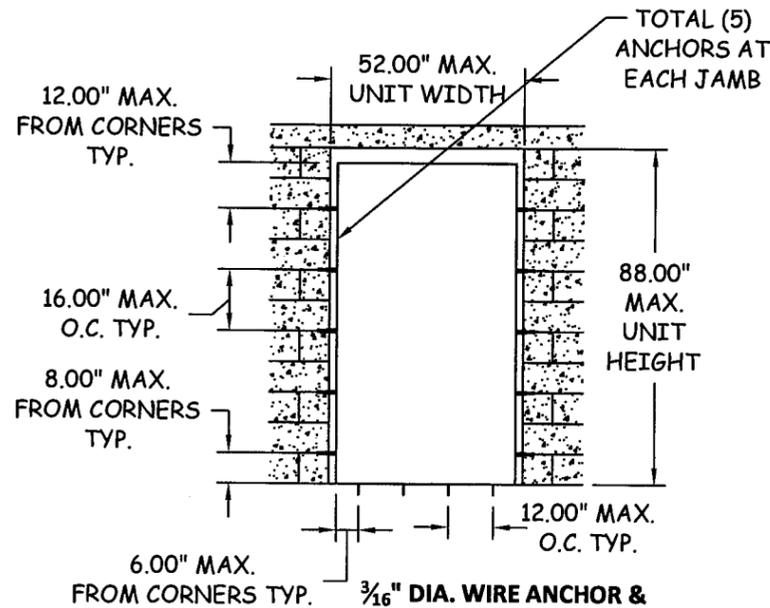

ANCHOR LOCATION

INSTALLATION INTO NEW MASONRY
(GROUT FILLED BLOCKS)

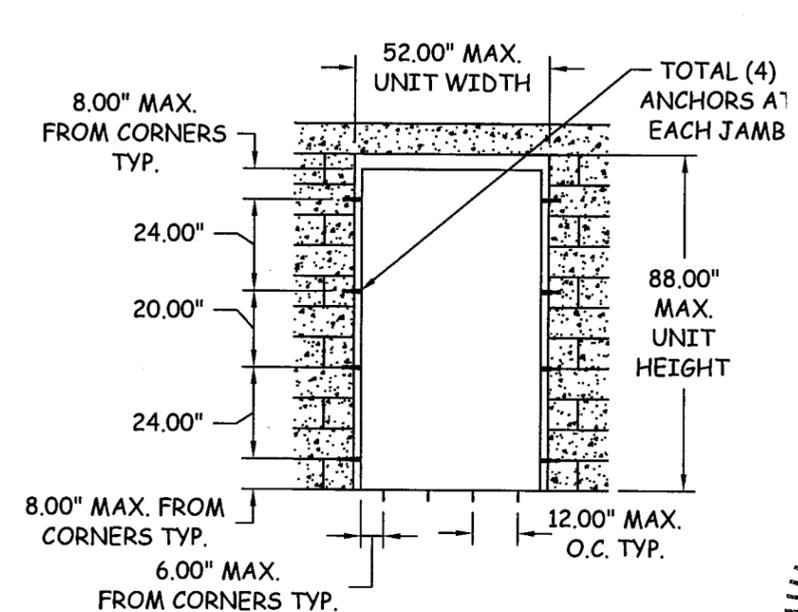


ANCHOR LOCATION

INSTALLATION INTO EXIST. MASONRY
(GROUT FILLED BLOCKS)

Approved as complying with the
Florida Building Code
Date OCT 13, 2010
NOA# 10-0629-03
Miami Dade Product Control
Division
By Shag J. Chan


REVISIONS

NO.	DESCRIPTION	BY	DATE

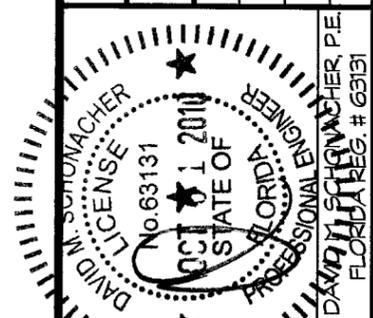


DATE: 09.15.10
DWN BY: KRM
CHK BY: DMS
SCALE: NTS

SHEET:

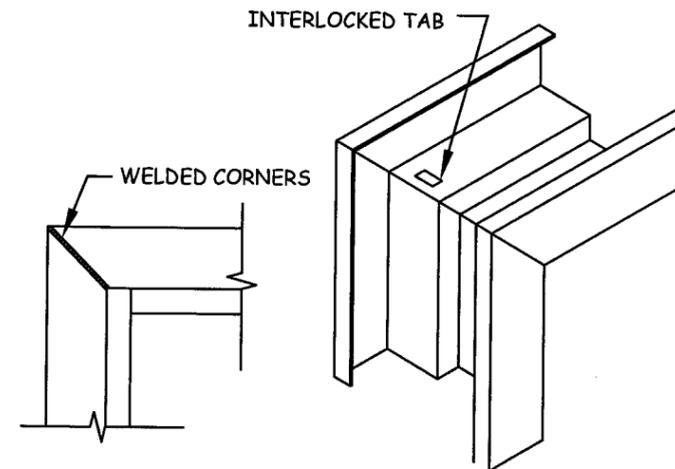


G
8 TYP. CORNER DETAIL

TITLE:
8'-0" x 8'-0"
DOUBLE/ SINGLE
FLUSH DOOR
DETAILS

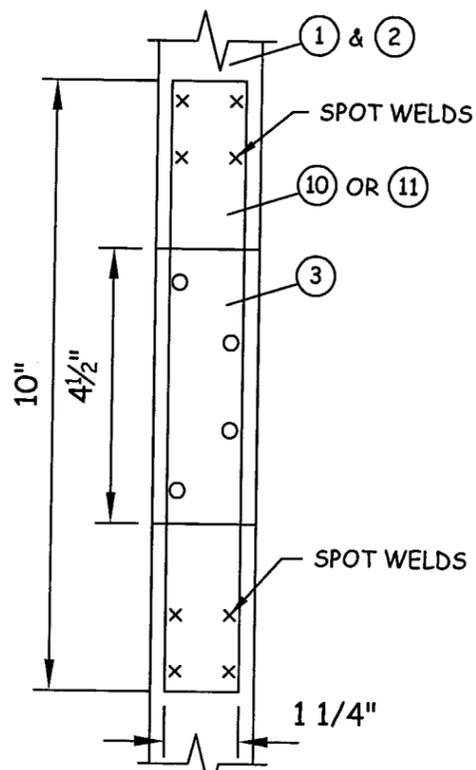


**DOOR/HINGE
STEEL HINGE
PLATE REINF.**


7 GAUGE X 1-1/4" X 10"

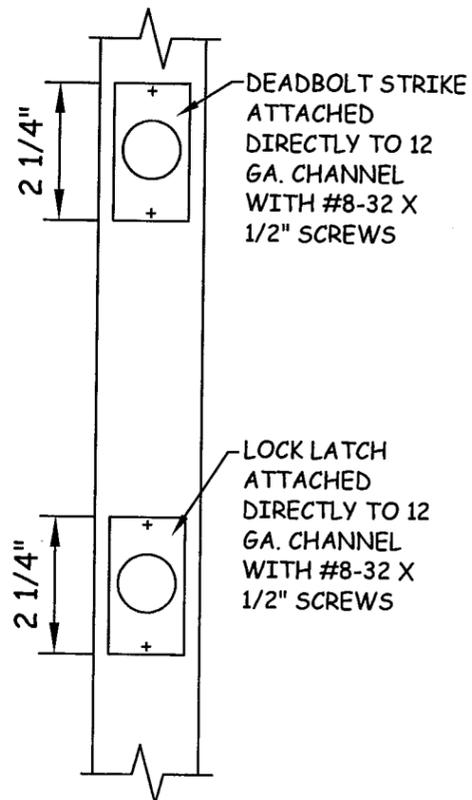


**ACTIVE DOOR
LOCK/DEAD BOLT REINFORCEMENT**

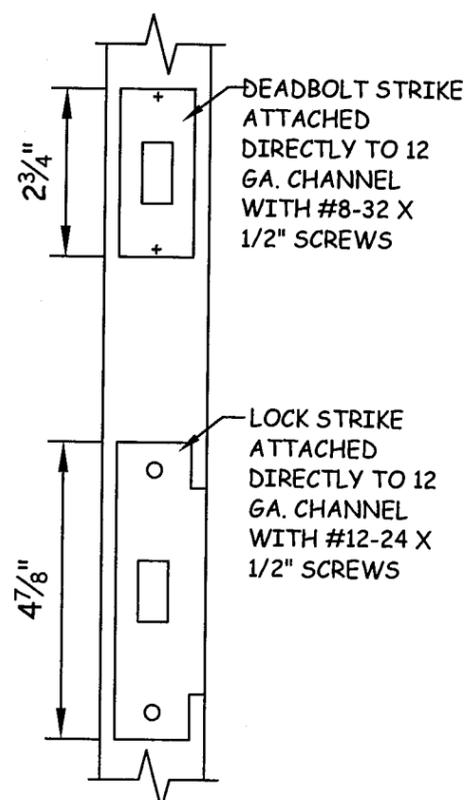

**INACTIVE DOOR
LOCK/DEAD BOLT STRIKE PLATE
REINFORCEMENT**

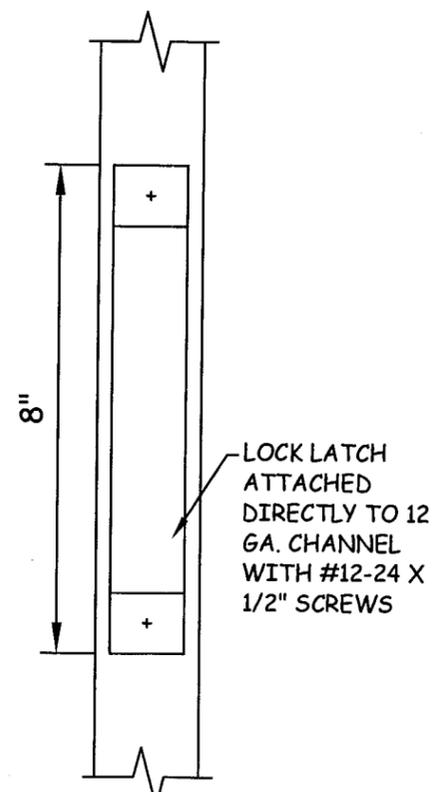

**ACTIVE DOOR
MORTISE LOCK REINFORCEMENT**

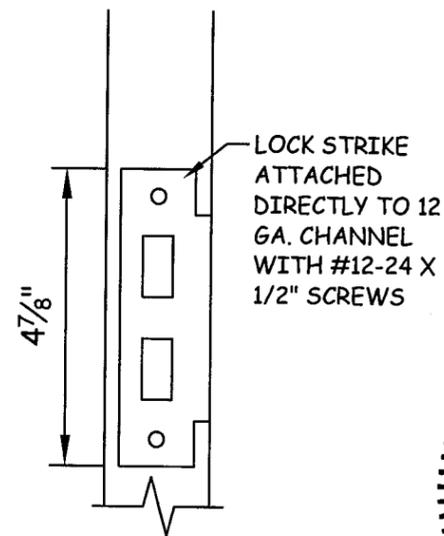


**INACTIVE DOOR
MORTISE LOCK STRIKE PLATE
REINFORCEMENT**

Approved as complying with the
Florida Building Code
Date Oct 13, 2010
NOA# 10-0129-03
Miami Dade Product Control
Division
By Iskay J. Chanda





REVISIONS

NO.	DESCRIPTION	BY	DATE


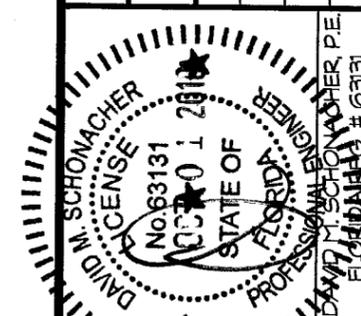


DATE: 09.15.10
DWN BY: KRM
CHK BY: DMS
SCALE: NTS

SHEET:

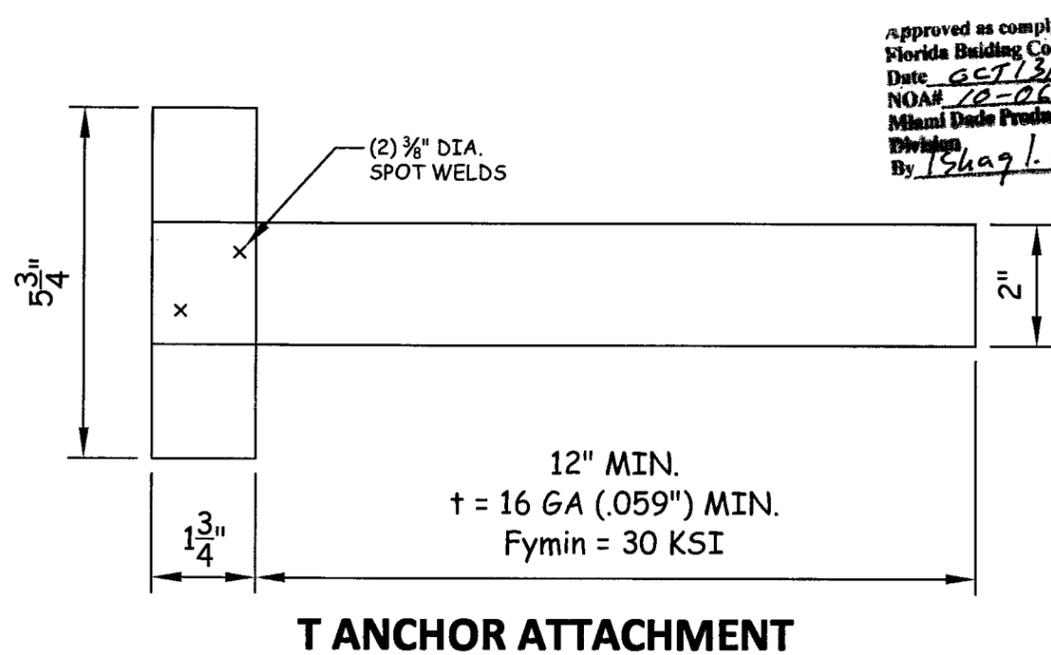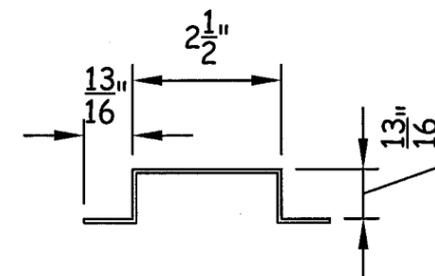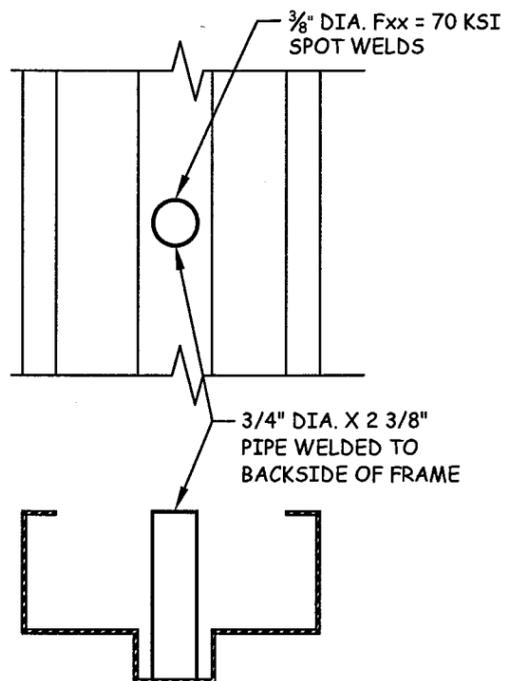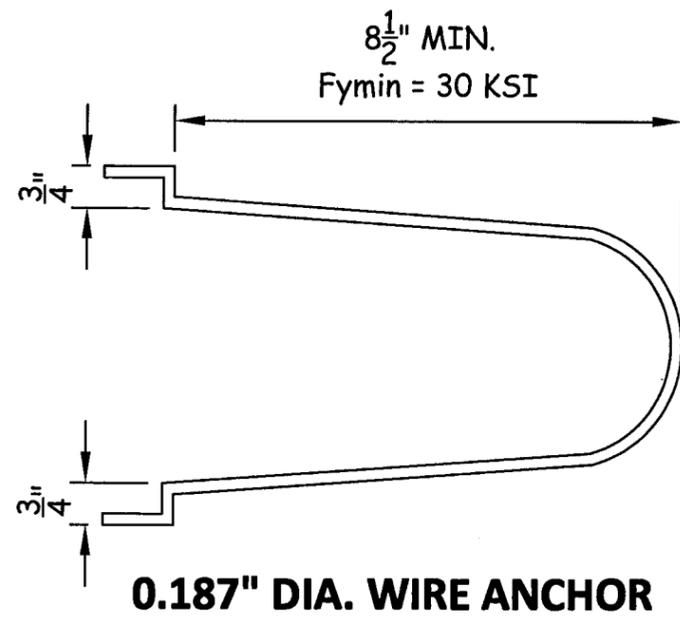


Approved as complying with the
Florida Building Code
Date 06/13/2010
NOA# 10-0629-03
Miami Dade Product Control
Division
By Ishag I. Cherrif

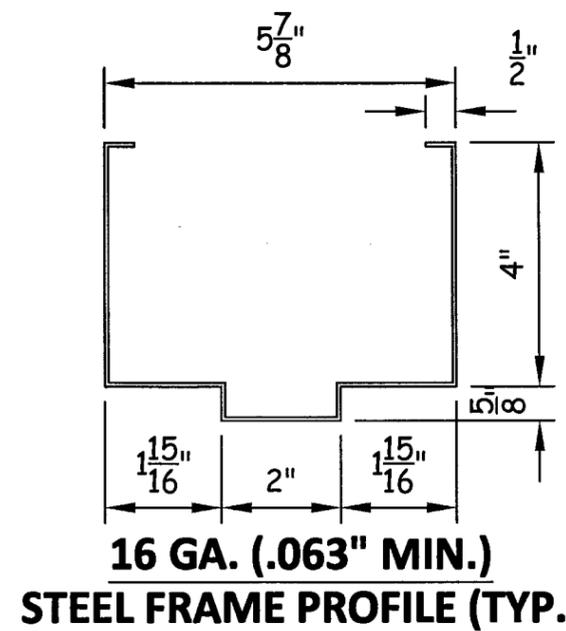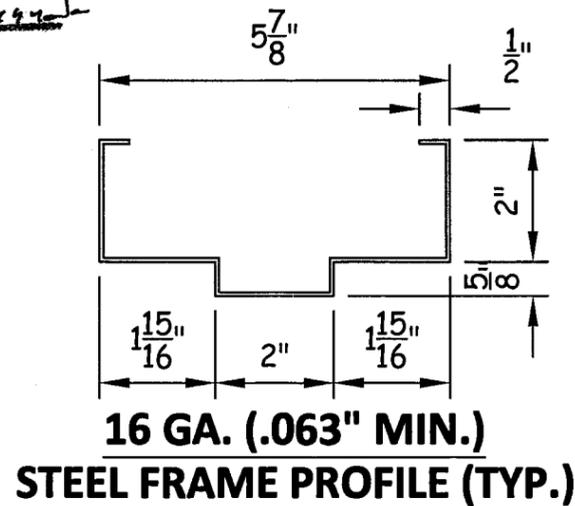

TITLE:
8'-0" x 8'-0"
DOUBLE/ SINGLE
FLUSH DOOR
DETAILS

REVISIONS

NO.	DESCRIPTION	BY	DATE

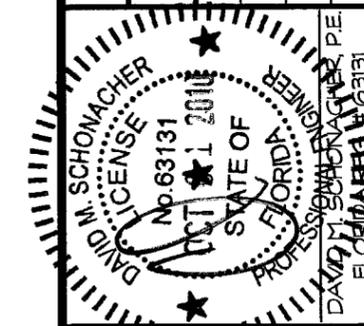

DATE: 09.15.10
DWN BY: KRM
CHK BY: DMS
SCALE: NTS

SHEET: