



MIAMI-DADE COUNTY
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2902 FAX (305) 372-6339

www.miamidade.gov/buildingcode

NOTICE OF ACCEPTANCE (NOA)

SIW Impact Windows, LLC
975 S. Congress Ave., Suite # 102
Delray Beach, FL 33445

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "300 Stormsafe" Aluminum Fixed Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W07-49**, series titled "S-300 Stormsafe Alum. Fixed Wdw. (L.M.I.)", sheets 1 through 6 of 6, dated 05/18/07 with revision "**D**" dated 10/19/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises **NOA No. 09-1021.13** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
 11/3/10

NOA No. 10-0715.03
Expiration Date: August 29, 2012
Approval Date: November 25, 2010
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W07-49**, series titled "S-300 Stormsafe Alum. Fixed Wdw. (L.M.I.)", sheets 1 through 6 of 6, dated 05/18/07 with revision "**D**" dated 10/19/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram, prepared by American Test Lab of South Florida, Inc., Test Report No. **ATLSF-0525.01-10**, dated June 09, 2010, signed and sealed by Julio E. Gonzalez, P. E.
2. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram, prepared by Hurricane Engineering Testing Laboratory, Inc., Test Report No. **HETI-07-4115**, dated April 09, 2007, signed and sealed by Rafael E. Droz-Seda, P. E.
(Submitted under previous NOA No. 07-0604.05)
3. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram, prepared by Hurricane Engineering Testing Laboratory, Inc., Test Report No. **HETI-07-4111**, dated January 25, 2007, signed and sealed by Rafael E. Droz-Seda, P. E.
(Submitted under previous NOA No. 07-0604.05)
4. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram, prepared by Hurricane Engineering Testing Laboratory, Inc., Test Report No. **HETI-07-4112**, dated April 09, 2007, signed and sealed by Rafael E. Droz-Seda, P. E.
(Submitted under previous NOA No. 07-0604.05)
5. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram, prepared by Hurricane Engineering Testing Laboratory, Inc., Test Report No. **HETI-07-4113**, dated April 09, 2007, signed and sealed by Rafael E. Droz-Seda, P. E.
(Submitted under previous NOA No. 07-0604.05)



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 10-0715.03

Expiration Date: August 29, 2012
Approval Date: November 25, 2010

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (CONTINUED)

6. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram, prepared by Hurricane Engineering Testing Laboratory, Inc., Test Report No. **HETI-07-4114**, dated April 09, 2007, signed and sealed by Rafael E. Droz-Seda, P. E.
(Submitted under previous NOA No. 07-0604.05)
7. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram, prepared by Hurricane Engineering Testing Laboratory, Inc., Test Report No. **HETI-07-4110**, dated January 15, 2007, signed and sealed by Rafael E. Droz-Seda, P. E.
(Submitted under previous NOA No. 07-0604.05)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated 06/11/10, signed and sealed by Javad Ahmad, P. E.
Complies with ASTM E1300-02/04

D. QUALITY ASSURANCE

1. Miami-Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **09-0312.03** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/13/09, expiring on 01/14/12.
2. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "**Saflex III G Clear or colored interlayer**" dated 05/04/06, expiring on 05/21/11.

F. STATEMENTS

1. Statement letter of conformance, no financial interest and complying with FBC-2007, dated June 16, 2010, signed and sealed by Javad Ahmad, P. E.
2. Laboratory compliance letter for Test Report No. **ATLSF-0525.01-10**, issued by American Test Lab of South Florida, Inc., dated June 09, 2010, signed and sealed by Julio E. Gonzalez, P. E.



Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 10-0715.03
Expiration Date: August 29, 2012
Approval Date: November 25, 2010

SIW Impact Windows, LLC


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (CONTINUED)


3. Laboratory addendum letter for Test Report No. **ATLSF-0525.01-10**, issued by American Test Lab of South Florida, Inc., dated September 30, 2010, signed and sealed by Julio E. Gonzalez, P. E.
4. Laboratory compliances letters for Test Reports No.'s **HETI-07-4115**, **HETI-07-4111**, **HETI-07-4112**, **HETI-07-4113**, **HETI-07-4114** and **HETI-07-4110**, issued by Hurricane Engineering Testing Laboratory, Inc., dated January 15/25 and April 09, 2007, all signed and sealed by Rafael E. Droz-Seda, P. E.
(Submitted under previous NOA No. 07-0604.05)

G. OTHERS


1. Notice of Acceptance No. **09-1021.13**, issued to SIW Impact Windows, LLC for their Series "300 Stormsafe Aluminum Fixed Window-L.M.I.", approved on 02/10/10 and expiring on 08/29/12.






Jaime D. Gascon, P. E.
Chief, Product Control Division
NOA No. 10-0715.03
Expiration Date: August 29, 2012
Approval Date: November 25, 2010

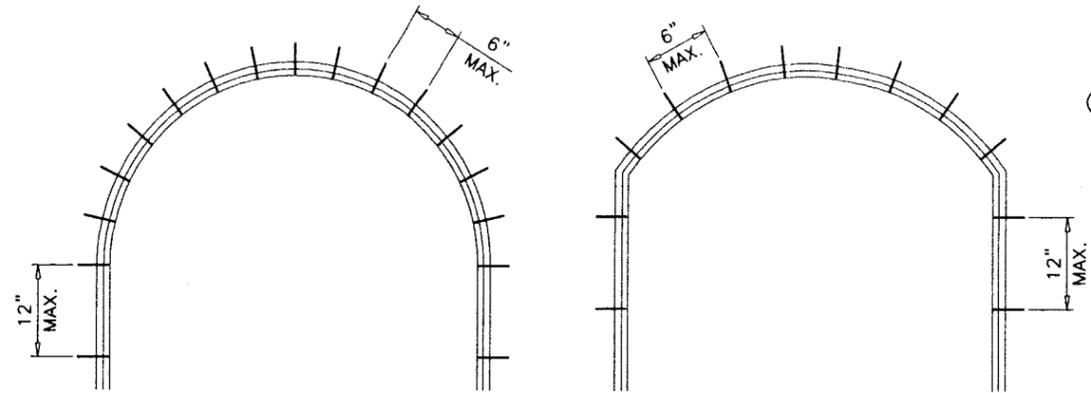

6" MAX. ANCHOR SPACING AT CURVED FRAMES
12" MAX. ANCHOR SPACING AT STRAIGHT FRAMES

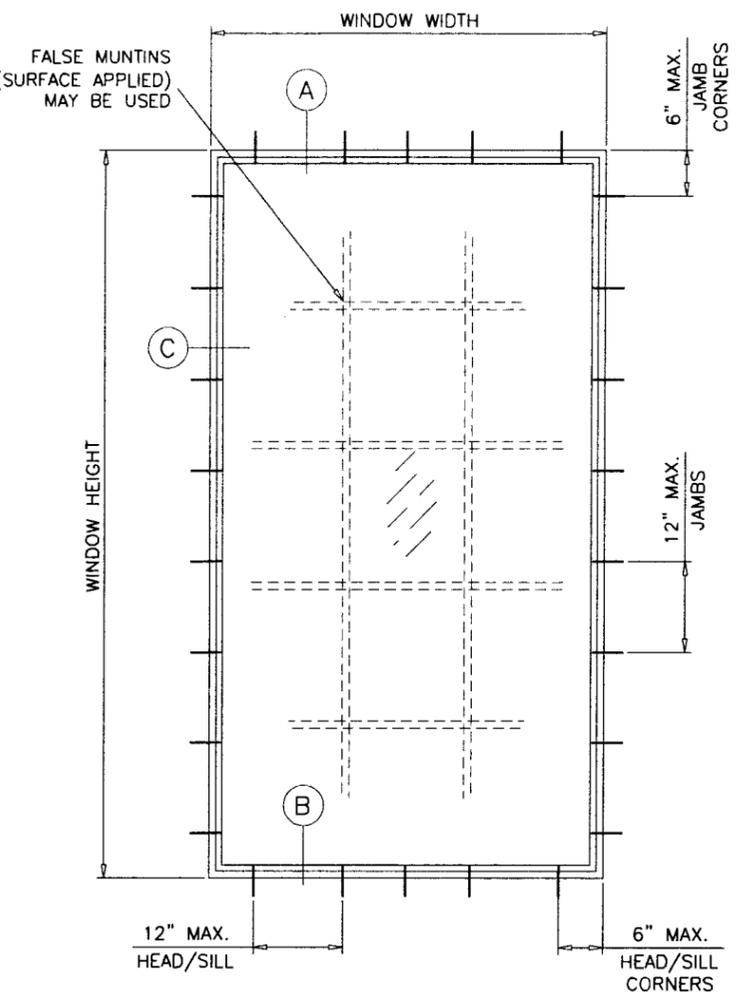

TYPICAL ELEVATION

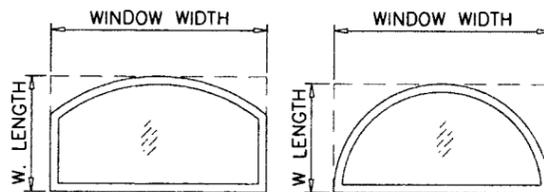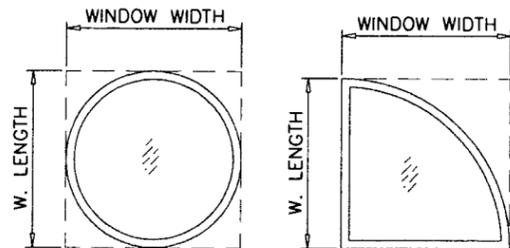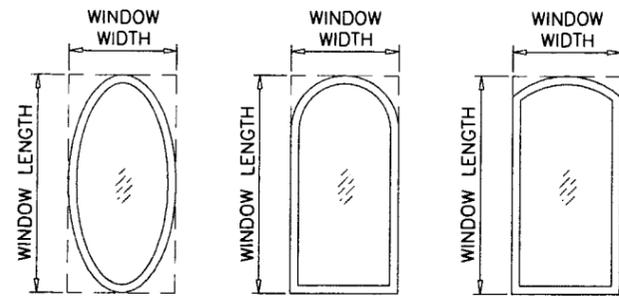

ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN SQUARE OR RECTANGLE AS SHOWN IN DOTTED LINES AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES.

**SERIES 300 STORMSAFE
ALUMINUM FIXED WINDOW**

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIXED/FIXED OR FIXED WITH OTHER MIAMI-DADE COUNTY APPR'D WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEETS 2 AND 3.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

OCT 25 2010

PRODUCT REVIEWED
as complying with the Florida
Building Code
Approval No. 10-0715.03
Registration Date 08/29/2012
By: [Signature]
Miami Dade Product Control
Division

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL \ W07 - 49SIW

S-300 STORMSAFE ALUM FIXED WDW. (L.M.I.)

SIW IMPACT WINDOWS, LLC.
975 S. CONGRESS AVE. #102
DELRAY BEACH, FL. 33445
TEL. (561) 274-9392 FAX. (561) 274-9262

no	date	by	description
A	07.13.07	REV. PER BCCO COMMENTS	
B	07.24.09	UPDATED FOR 2007 FBC	
C	06.14.10	NO CHANGE THIS SHEET	
D	10.19.10	REV. PER BCCO COMMENTS	

revisions:





date: 05-18-07
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:

drawing no.
W07-49


sheet 1 of 6

DESIGN LOAD CAPACITY - PSF									
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'	
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
26-1/2"	26"	60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
32"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
37"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
42"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
48"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
53-1/8"	38-3/8"	60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
26-1/2"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
32"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
37"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
42"		57.9	57.9	70.0	70.0	90.0	130.0	60.0	60.0
48"	57.9	57.9	70.0	70.0	90.0	130.0	60.0	60.0	
53-1/8"	50-5/8"	57.9	57.9	70.0	70.0	90.0	130.0	60.0	60.0
26-1/2"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
32"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
37"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
42"		52.9	52.9	70.0	70.0	90.0	130.0	60.0	60.0
48"	-	-	70.0	70.0	90.0	130.0	60.0	60.0	
53-1/8"	63"	-	-	70.0	70.0	90.0	130.0	59.4	59.4
26-1/2"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
32"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
37"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
42"		-	-	70.0	70.0	90.0	130.0	60.0	60.0
48"	-	-	70.0	70.0	90.0	130.0	60.0	60.0	
53-1/8"	74-1/4"	-	-	-	-	90.0	130.0	-	-
26-1/2"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
32"		-	-	70.0	70.0	90.0	130.0	60.0	60.0
37"		-	-	70.0	70.0	90.0	130.0	60.0	60.0
42"		-	-	70.0	70.0	90.0	130.0	-	-
48"	-	-	-	-	90.0	130.0	-	-	
53-1/8"	78"	-	-	-	-	90.0	130.0	-	-
26-1/2"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
32"		-	-	70.0	70.0	90.0	130.0	60.0	60.0
37"		-	-	70.0	70.0	90.0	130.0	60.0	60.0
42"		-	-	-	-	90.0	130.0	-	-
48"	-	-	-	-	90.0	130.0	-	-	
53-1/8"	84"	-	-	-	-	90.0	130.0	-	-
26-1/2"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0
32"		-	-	70.0	70.0	90.0	130.0	60.0	60.0
37"		-	-	70.0	70.0	90.0	130.0	60.0	60.0
42"		-	-	-	-	90.0	130.0	-	-
48"	-	-	-	-	90.0	130.0	-	-	
53-1/8"	96"	-	-	-	-	90.0	129.4	-	-
26-1/2"		-	-	70.0	70.0	90.0	130.0	60.0	60.0
32"		-	-	70.0	70.0	90.0	130.0	60.0	60.0
37"		-	-	-	-	90.0	130.0	-	-
42"		-	-	-	-	90.0	128.6	-	-
48"	-	-	-	-	90.0	119.5	-	-	
53-1/8"	108"	-	-	-	-	90.0	111.8	-	-
26-1/2"		-	-	-	-	90.0	130.0	-	-
32"		-	-	-	-	90.0	130.0	-	-
37"		-	-	-	-	90.0	130.0	-	-
42"	120"	-	-	-	-	90.0	122.5	-	-
26-1/2"		-	-	-	-	90.0	130.0	-	-
32"		-	-	-	-	90.0	130.0	-	-
37"	126"	-	-	-	-	90.0	112.4	-	-
26-1/2"		-	-	-	-	90.0	130.0	-	-
32"	-	-	-	-	90.0	130.0	-	-	
37"	-	-	-	-	90.0	130.0	-	-	

FOR LOADS LESS THAN OR EQUAL TO 70 PSF
MIN. GLASS BITE CAN BE 5/8".
GLASS TYPES A, B & D.

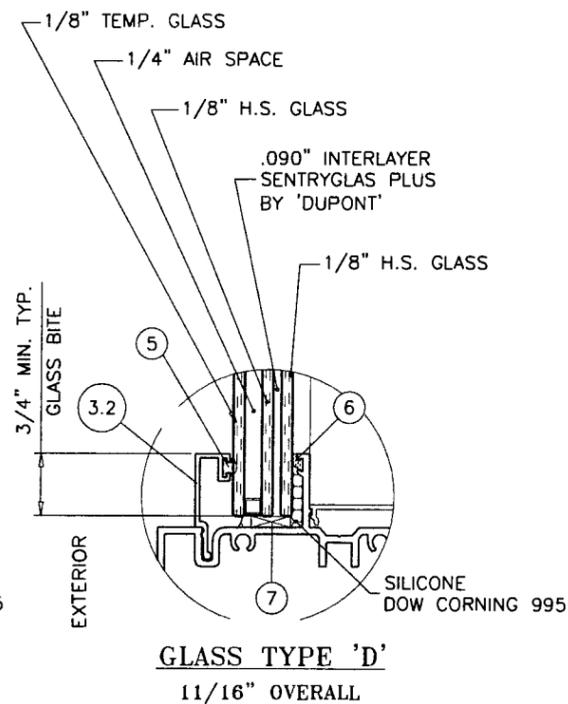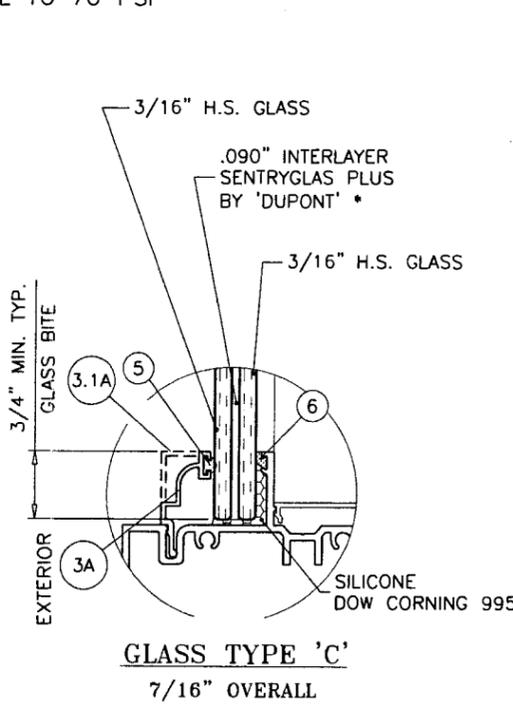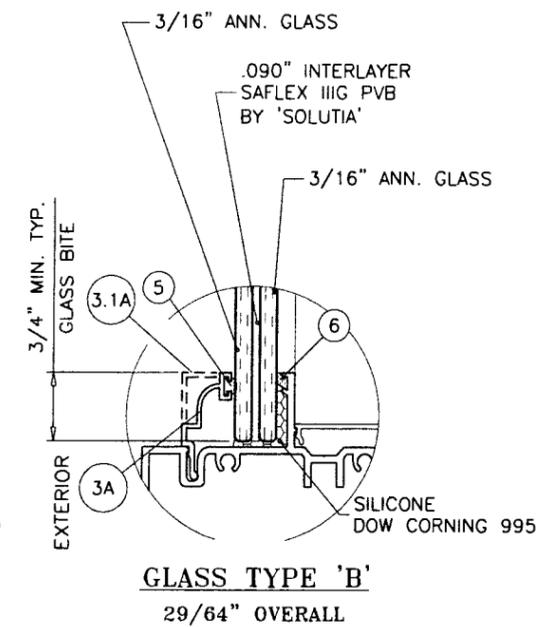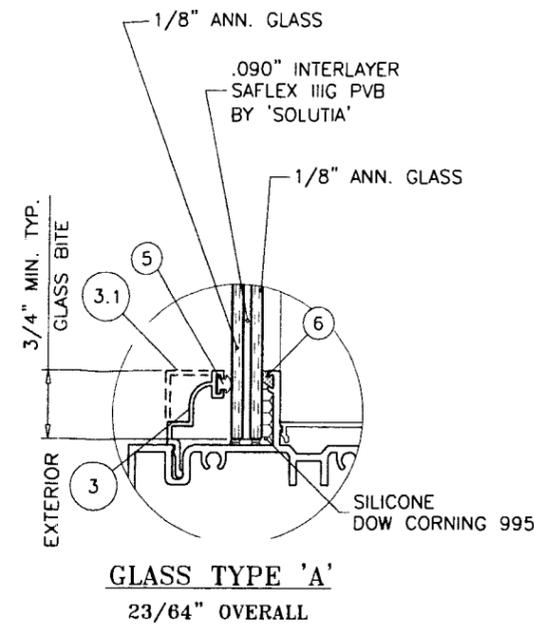

* E.I. DUPONT DE NEMOURS & CO. INC.

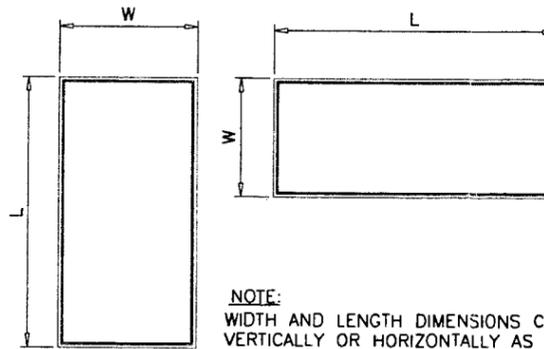

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS).

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

10-07-15-03
10/29/2012

PRODUCT REVISED
as complying with the Florida
Building Code
Approval No. 10-0715-03
Expiration Date 08/29/2012

By: *Javad Ahmad*
Miami Dade Product Control
Division

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W07-49SIW

S-300 STORMSAFE ALUM FIXED WDW. (L.M.I.)
SIW IMPACT WINDOWS, LLC.
975 S. CONGRESS AVE. #102
DELRAY BEACH, FL. 33445
TEL. (561) 274-9392 FAX. (561) 274-9262

no	date	description	REV. PER	BCCO COMMENTS
A	07.13.07			REVISED FOR 2007 FBC
B	07.24.09			INSUL. LAM. GLASS ADD.
C	06.14.10			
D	10.19.10			

revisions:


date: 05-18-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W07-49

sheet 2 of 6

DESIGN LOAD CAPACITY - PSF										
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'		
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	
24"	36"	60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
30"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
36"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
42"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
48"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
54"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
60"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
66"		-	-	-	-	-	70.0	70.0	60.0	60.0
72"		-	-	-	-	-	70.0	70.0	60.0	60.0
78"		-	-	-	-	-	70.0	70.0	60.0	60.0
84"	-	-	-	-	-	70.0	70.0	60.0	60.0	
88"	-	-	-	-	-	70.0	70.0	-	-	
24"	48"	60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
30"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
36"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
42"		52.9	52.9	70.0	70.0	90.0	130.0	60.0	60.0	
48"		46.3	46.3	70.0	70.0	90.0	130.0	60.0	60.0	
54"		-	-	70.0	70.0	90.0	130.0	60.0	60.0	
60"		-	-	70.0	70.0	90.0	130.0	60.0	60.0	
66"		-	-	-	-	70.0	70.0	-	-	
72"		-	-	-	-	70.0	70.0	-	-	
78"		-	-	-	-	70.0	70.0	-	-	
84"	-	-	-	-	70.0	70.0	-	-		
88"	-	-	-	-	70.0	70.0	-	-		
24"	60"	60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
30"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
36"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
42"		-	-	70.0	70.0	90.0	130.0	60.0	60.0	
48"		-	-	70.0	70.0	90.0	130.0	60.0	60.0	
54"		-	-	-	-	88.5	127.9	-	-	
60"		-	-	-	-	79.7	115.1	-	-	
66"		-	-	-	-	70.0	70.0	-	-	
72"		-	-	-	-	70.0	70.0	-	-	
78"		-	-	-	-	70.0	70.0	-	-	
84"	-	-	-	-	70.0	70.0	-	-		
88"	-	-	-	-	70.0	70.0	-	-		
24"	72"	60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
30"		60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
36"		-	-	70.0	70.0	90.0	130.0	60.0	60.0	
42"		-	-	70.0	70.0	90.0	130.0	60.0	60.0	
48"		-	-	-	-	90.0	130.0	-	-	
54"		-	-	-	-	88.5	127.9	-	-	
60"		-	-	-	-	79.7	115.1	-	-	
66"		-	-	-	-	70.0	70.0	-	-	
72"		-	-	-	-	70.0	70.0	-	-	
78"		-	-	-	-	70.0	70.0	-	-	
84"	-	-	-	-	70.0	70.0	-	-		
88"	-	-	-	-	70.0	70.0	-	-		
24"	84"	60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
30"		-	-	70.0	70.0	90.0	130.0	60.0	60.0	
36"		-	-	70.0	70.0	90.0	130.0	60.0	60.0	
42"		-	-	-	-	90.0	130.0	-	-	
48"		-	-	-	-	90.0	130.0	-	-	
54"		-	-	-	-	88.5	127.9	-	-	
60"		-	-	-	-	79.7	115.1	-	-	
66"		-	-	-	-	70.0	70.0	-	-	
72"		-	-	-	-	70.0	70.0	-	-	
78"		-	-	-	-	69.6	69.6	-	-	
84"	-	-	-	-	64.6	64.6	-	-		
88"	-	-	-	-	64.6	64.6	-	-		

DESIGN LOAD CAPACITY - PSF										
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'		
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	
24"	96"	60.0	60.0	70.0	70.0	90.0	130.0	60.0	60.0	
30"		-	-	70.0	70.0	90.0	130.0	60.0	60.0	
36"		-	-	-	-	90.0	130.0	-	-	
42"		-	-	-	-	90.0	128.6	-	-	
48"		-	-	-	-	90.0	119.5	-	-	
54"		-	-	-	-	70.0	70.0	-	-	
60"		-	-	-	-	70.0	70.0	-	-	
66"		-	-	-	-	70.0	70.0	-	-	
72"		-	-	-	-	70.0	70.0	-	-	
78"		-	-	-	-	69.6	69.6	-	-	
24"	108"	-	-	70.0	70.0	90.0	130.0	60.0	60.0	
30"		-	-	-	-	90.0	130.0	-	-	
36"		-	-	-	-	90.0	130.0	-	-	
42"		-	-	-	-	90.0	122.5	-	-	
48"		-	-	-	-	70.0	70.0	-	-	
54"		-	-	-	-	70.0	70.0	-	-	
60"		-	-	-	-	70.0	70.0	-	-	
66"		-	-	-	-	70.0	70.0	-	-	
72"		-	-	-	-	69.8	69.8	-	-	
24"		120"	-	-	70.0	70.0	90.0	130.0	60.0	60.0
30"	-		-	-	-	90.0	130.0	-	-	
36"	-		-	-	-	90.0	130.0	-	-	
42"	-		-	-	-	90.0	112.4	-	-	
48"	-		-	-	-	70.0	70.0	-	-	
54"	-		-	-	-	70.0	70.0	-	-	
60"	-		-	-	-	70.0	70.0	-	-	
24"	126"		-	-	-	-	90.0	130.0	60.0	60.0
30"			-	-	-	-	90.0	130.0	-	-
36"			-	-	-	-	90.0	130.0	-	-
42"		-	-	-	-	70.0	70.0	-	-	
48"		-	-	-	-	70.0	70.0	-	-	
54"		-	-	-	-	70.0	70.0	-	-	
60"		-	-	-	-	70.0	70.0	-	-	
24"		132"	-	-	-	-	70.0	70.0	-	-
30"			-	-	-	-	70.0	70.0	-	-
36"			-	-	-	-	70.0	70.0	-	-
42"	-		-	-	-	70.0	70.0	-	-	
48"	-		-	-	-	70.0	70.0	-	-	
54"	-		-	-	-	70.0	70.0	-	-	
24"	138"		-	-	-	-	70.0	70.0	-	-
30"			-	-	-	-	70.0	70.0	-	-
36"			-	-	-	-	70.0	70.0	-	-
42"			-	-	-	-	70.0	70.0	-	-
48"		-	-	-	-	70.0	70.0	-	-	
54"		-	-	-	-	70.0	70.0	-	-	
24"		144"	-	-	-	-	70.0	70.0	-	-
30"			-	-	-	-	70.0	70.0	-	-
36"			-	-	-	-	70.0	70.0	-	-
42"			-	-	-	-	70.0	70.0	-	-
48"	-		-	-	-	70.0	70.0	-	-	
54"	-		-	-	-	70.0	70.0	-	-	
24"	150"		-	-	-	-	70.0	70.0	-	-
30"			-	-	-	-	70.0	70.0	-	-
36"			-	-	-	-	70.0	70.0	-	-
42"			-	-	-	-	70.0	70.0	-	-
48"		-	-	-	-	70.0	70.0	-	-	

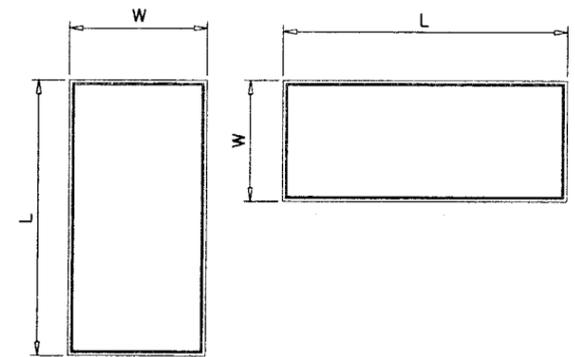

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

FOR LOADS LESS THAN OR EQUAL TO 70 PSF MIN. GLASS BITE CAN BE 5/8".
GLASS TYPES A, B & D.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-04 (3 SEC. GUSTS).

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

J. Ahmad
OCT 25 2010

PRODUCT REVISED
As complying with the Florida Building Code
Acceptance No. 10-0715-03
Expiration Date 03/29/2012

By: *J. Ahmad*
Miami Glass Product Control Division

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W07-49SIW

S-300 STORMSAFE ALUM FIXED WDW. (L.M.I.)






SIW IMPACT WINDOWS, LLC.
975 S. CONGRESS AVE. #102
DELRAY BEACH, FL. 33445
TEL. (561) 274-9392 FAX. (561) 274-9262

no	date	description
A	07.13.07	REV. PER BCCO COMMENTS
B	07.24.09	UPDATED FOR 2007 FBC
C	06.14.10	CHART REV.
D	10.19.10	REV. PER BCCO COMMENTS

revisions:

date: 05-18-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no. **W07-49**
sheet 3 of 6

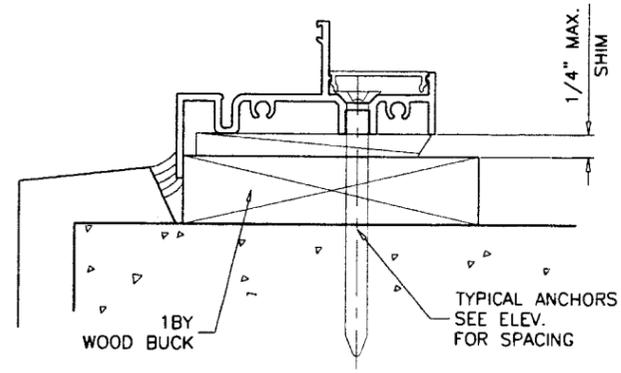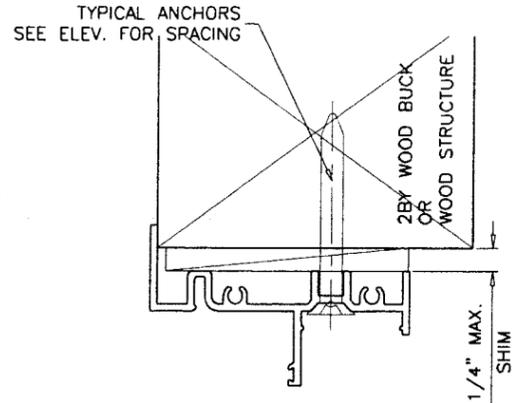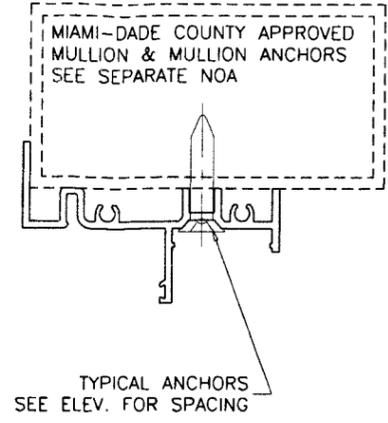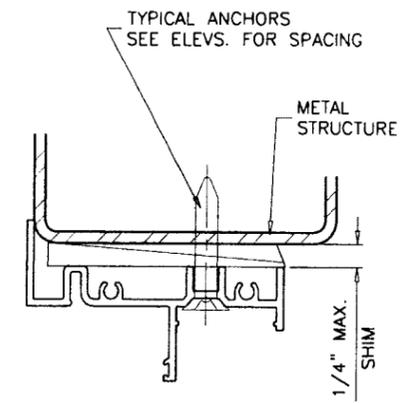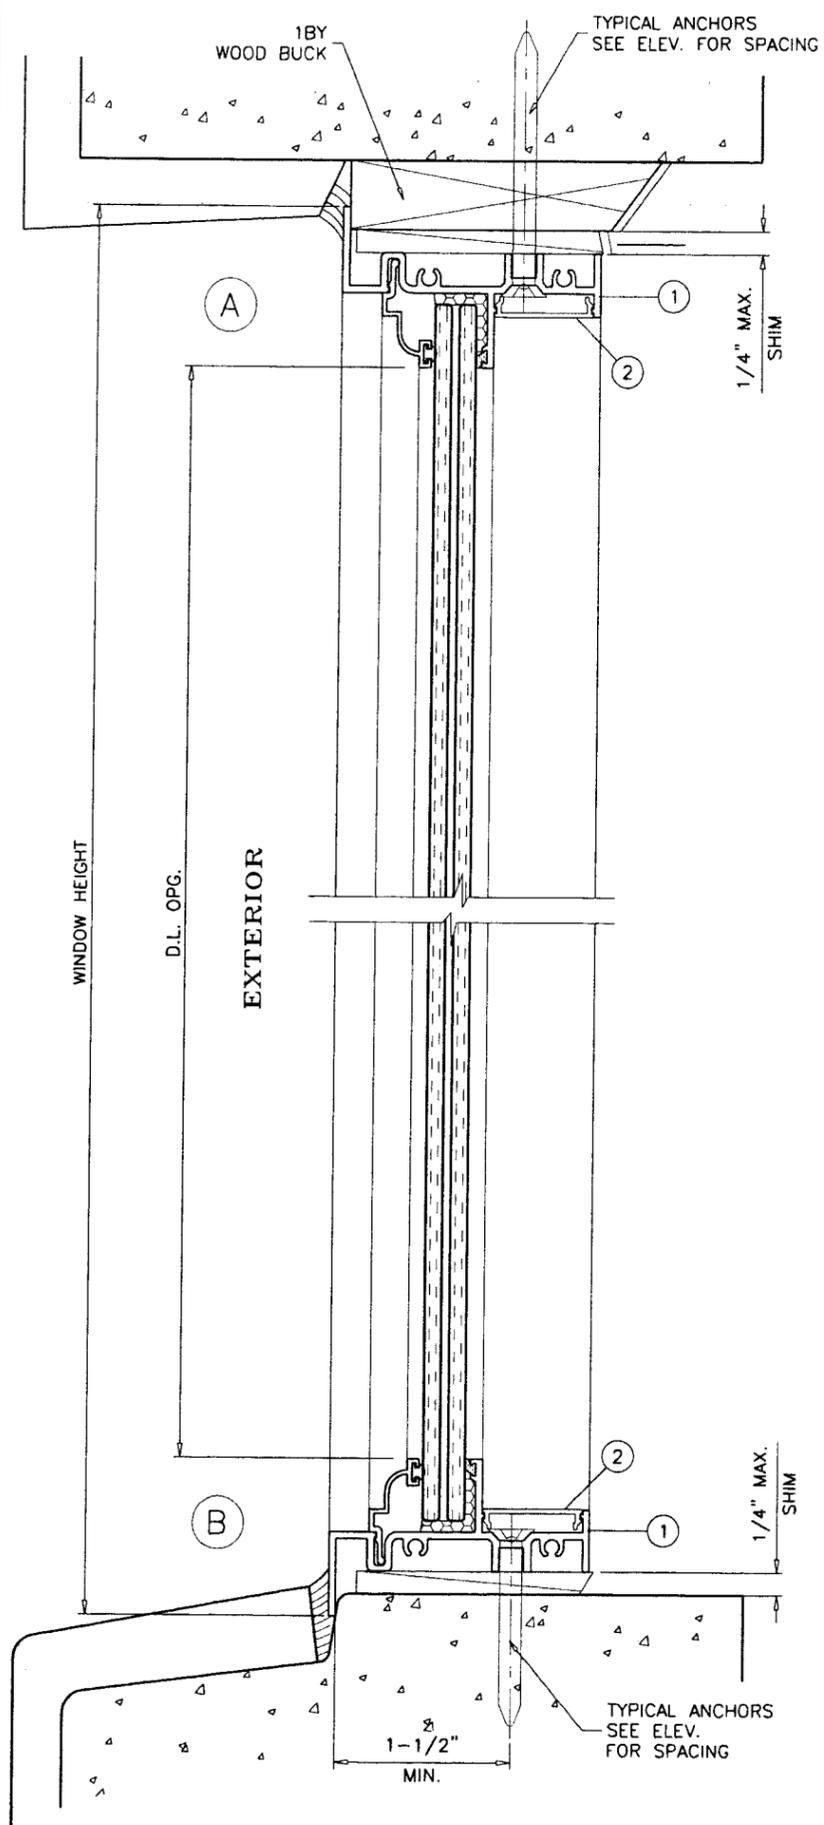

WOOD BUCKS AND METAL STRUCTURE NOT BY S.I.W. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO METAL STRUCTURES
 STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#12 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 (NO SHIM SPACE)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 1-1/2" MIN.
 INTO WOOD STRUCTURE = 3/4" MIN.
 INTO METAL STRUCTURE = 1/2" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

SEALANTS:
 ALL JOINTS AND FRAME CONNECTIONS SEALED WITH CRL SMALL JOINT SEALER.

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

J.A.
OCT 25 2010




PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. **10-0715.03**
 Expiration Date **08/29/2012**
 By *Javad Ahmad*
 Miami Dade Product Control
 Division

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W07-49SIW

S-300 STORMSAFE ALUM FIXED WDW. (L.M.I.)
SIW IMPACT WINDOWS, LLC.
 975 S. CONGRESS AVE. #102
 DELRAY BEACH, FL. 33445
 TEL. (561) 274-9392 FAX. (561) 274-9262

no	date	by	description
A	07.13.07		NO CHANGE THIS SHEET
B	07.24.09		UPDATED FOR 2007 FBC
C	06.14.10		NO CHANGE THIS SHEET
D	10.19.10		REV. PER BCCO COMMENTS

revisions:
 date: 05-18-07
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:
 drawing no. **W07-49**
 sheet 4 of 6

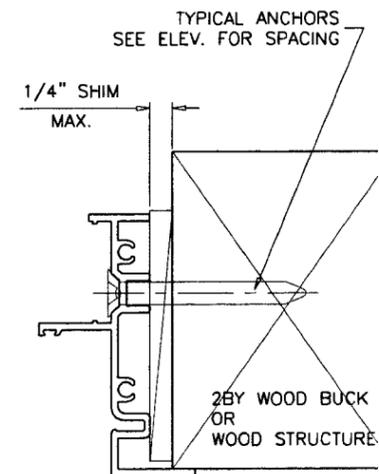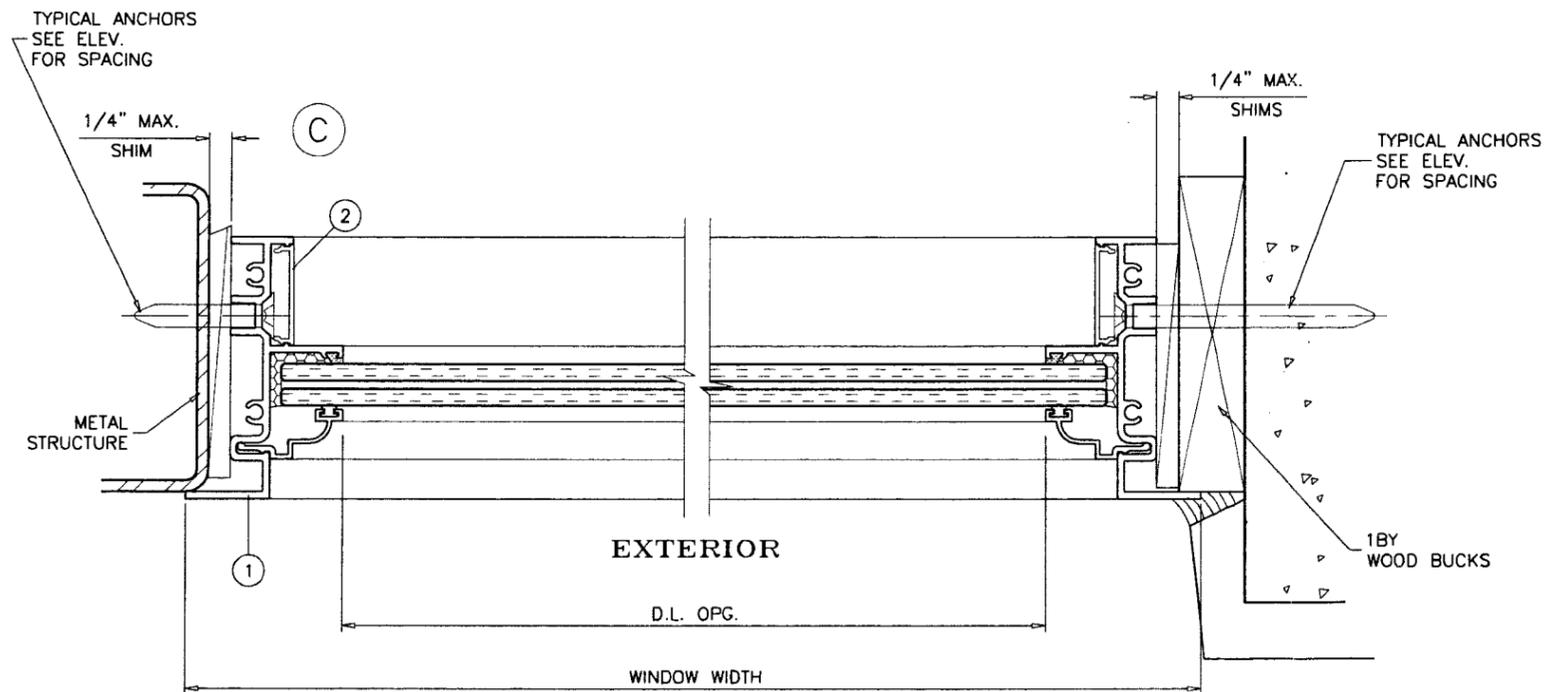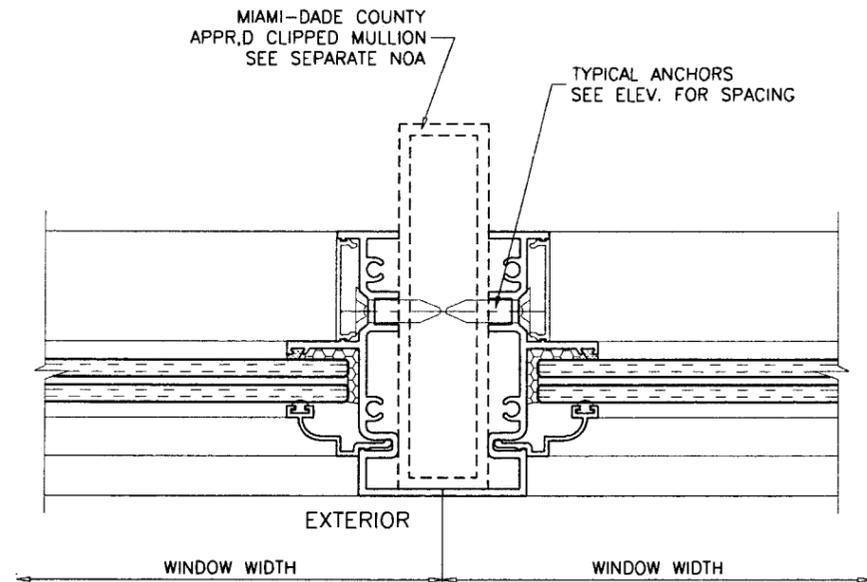

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

J.A.
OCT 25 2010

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 10-0715-03
Expiration Date 08/29/2012
By *Javad Ahmad*
Miami Dade Product Control
Division


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W07-49SIW

S-300 STORMSAFE ALUM FIXED WDW. (L.M.I.)
SIW IMPACT WINDOWS, LLC.
975 S. CONGRESS AVE. #102
DELRAY BEACH, FL. 33445
TEL. (561) 274-9392 FAX. (561) 274-9262


no	date	by	description
A	07.13.07		NO CHANGE THIS SHEET
B	07.24.09		UPDATED FOR 2007 FBC
C	06.14.10		NO CHANGE THIS SHEET
D	10.19.10		REV. PER BCCO COMMENTS

date: 05-18-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W07-49
sheet 5 of 6

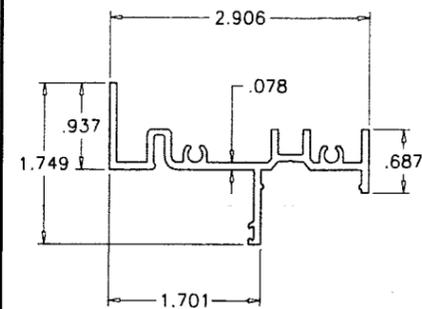


① FRAME




② FRAME COVER (OPTIONAL)

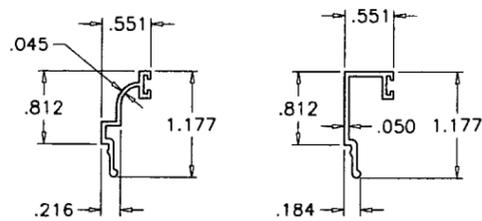


③ GLAZING BEADS (7/16" GLASS)

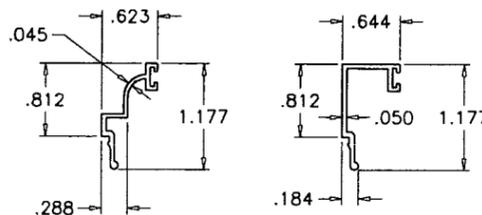

③A GLAZING BEADS (5/16" GLASS)




③.2 GLAZING BEAD (INSUL. LAM. GLASS)



⑥ GLAZING LEG SPACER
SCALE 1:1

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	SIW301	4	WINDOW FRAME	6063-T6	-
2	SIW303	4	FRAME COVER (OPTIONAL)	6063-T6	-
3	SIW108	4	GLAZING BEAD (7/16" GLASS)	6063-T6	-
3.1	SIW127	4	ALT. GLAZING BEAD (7/16" GLASS)	6063-T6	-
3A	SIW112	4	GLAZING BEAD (5/16" GLASS)	6063-T6	-
3.1A	SIW128	4	ALT. GLAZING BEAD (5/16" GLASS)	6063-T6	-
3.2	SIW116	4	GLAZING BEAD (INSUL. LAM. GLASS)	6063-T6	-
4	#10 X 1-1/2"	2/ CORNER	ASSEMBLY SCREWS	CRS	PH SMS
5	938W	AS REQD.	EXTERIOR GLAZING GASKET (DUROMETER ±65)	SANTOPRENE	CENTRAL PLASTICS
6	SIW113	AS REQD.	GLAZING LEG SPACER (DUROMETER ±65)	SANTOPRENE	CENTRAL PLASTICS
7	-	2/ LITE	SETTING BLOCK (DUROMETER ±67)	EPDM	-

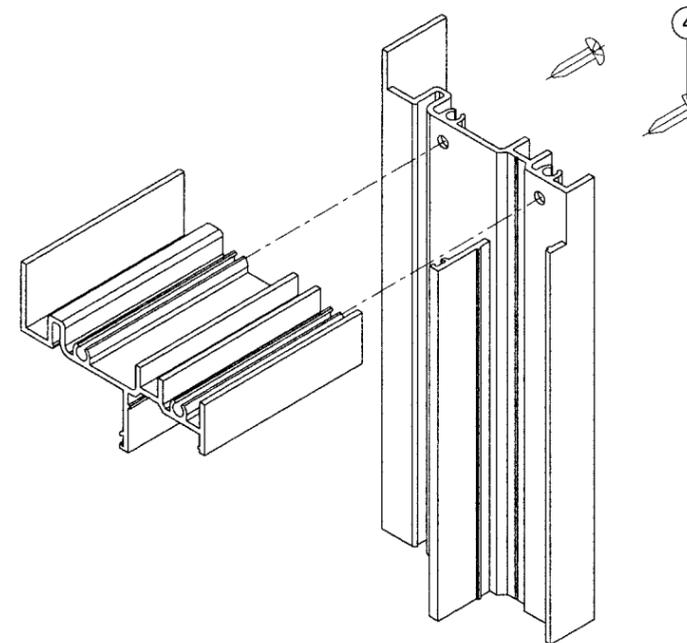

TYP. CORNER DETAIL

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

OCT 25 2010

PRODUCT REVISED
in compliance with the Florida
Building Code
Acceptance No 10-9715.03
Expiration Date 08/29/2012
By *[Signature]*
Miami Blue Product Control
Division

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W07-49SIW

S-300 STORMSAFE ALUM FIXED WDW. (L.M.I.)
SIW IMPACT WINDOWS, LLC.
975 S. CONGRESS AVE. #102
DELRAY BEACH, FL. 33445
TEL. (561) 274-9392 FAX. (561) 274-9262

no	date	by	description
A	07.13.07		REV. PER BCCO COMMENTS
B	07.24.09		UPDATED FOR 2007 FBC
C	06.14.10		INSUL. LAM. GLASS ADD.
D	10.19.10		REV. PER BCCO COMMENTS

date: 05-18-07
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W07-49
sheet 6 of 6