



**BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION**

**MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION**
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/building/home/asp

**BP Glass Garage Doors & Entry Systems (div of BPC)
9412 Gidley Street
Tempe City, CA 91780**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Section and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Models BP-350/BP-450 HD Aluminum and Glass Sectional Garage Door

APPROVAL DOCUMENT: Drawing No. **BPC003**, titled "Glass Garage Door" sheets 1 through 6 of 6, dated 06/01/09, prepared by CertWorks, LLC, signed and sealed by Kristina S. Daugherty, P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



[Handwritten Signature]
12/20/10

NOA No. 10-0802.02
Expiration Date: January 13, 2016
Approval Date: January 13, 2011
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **BPC003**, titled "Glass Garage Door" sheets 1 through 6 of 6, dated 06/01/09, prepared by CertWorks, LLC, signed and sealed by Kristina S. Daugherty, P.E.

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with installation diagram on three Series/Model BP-350/ BP-450 HD Hurricane Line, glazed sectional garage doors, prepared by Architectural Testing, Inc, Test Report No. **97392.03-301-18**, dated 06/04/10, with Revision 2 dated 11/03/10, signed and sealed by Joseph A. Reed, P.E.

C. CALCULATIONS:

1. Product evaluation report, complying with FBC-2007, prepared by CertWorks, LLC, dated 07/22/10, signed and sealed by Kristina S. Daugherty, P.E.

D. QUALITY ASSURANCE


1. Miami-Dade Building and Neighborhood Compliance Department (BNC)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance with FBC 2007 and no financial interest, issued by CertWorks, LLC, dated 07/26/10, signed and sealed by Kristina S. Daugherty, P.E.
2. Laboratory compliance letter for Test Report No. **97392.03-301-18**, issued by Architectural Testing, Inc., dated 06/07/10, signed and sealed by Joseph A. Reed, P.E.



12/20/10

Carlos M. Utrera, P.E.

Product Control Examiner

NOA No. 10-0802.02

Expiration Date: January 13, 2016

Approval Date: January 13, 2011

BP - GLASS GARAGE DOORS & ENTRY SYSTEMS

A DIVISION OF

BRYCE PARKER COMPANY, INC.

BP-350/450 HD HURRICANE LINE

GLASS GARAGE DOOR

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR INSTALLATION INTO WOOD FRAMING USE 3/8 INCH LAG SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 3 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- FOR INSTALLATION DIRECTLY INTO CONCRETE/MASONRY, USE 3/8 INCH DIAMETER CONCRETE FASTENERS OF SUFFICIENT LENGTH TO ACHIEVE 2 1/2 INCH MINIMUM EMBEDMENT.
- FOR INSTALLATION THROUGH STEEL STUD, USE 3/8 INCH DIAMETER STEEL BOLTS OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS ENGAGEMENT OF EMBEDMENT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 2700 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 118 MILS (11 GAUGE)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2007 FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 4X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 4X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- DOOR FRAME MATERIAL: ALUMINUM 6063-T5
- GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 3 FOR GLAZING DETAIL.
- EPDM GLAZING GASKET HAS BEEN TESTED IN ACCORDANCE WITH FBC 2411.3.4.

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1		INSTALLATION & GENERAL NOTES
2		ELEVATION, ANCHOR LAYOUT, & DETAILS
3		VERTICAL, HORIZONTAL SECTIONS & GLAZING DETAILS
4		HORIZONTAL SECTIONS
4		BILL OF MATERIALS & COMPONENTS
4		COMPONENTS

DESIGN PRESSURE RATING	
DESIGN PRESSURE - ALL SIZES	MISSILE IMPACT RATING
+65.0 / -65.0 PSF*	SMALL AND LARGE MISSILE IMPACT RATED

*REMOVABLE REINFORCEMENT REQUIRED (NOT RATED FOR WATER)

Approved as complying with the Florida Building Code
 Date: 01/13/2011
 NOAH 10-0802.02
 Miami Dade Product Control
 Division
 By: *[Signature]*



BP-GLASS GARAGE DOORS & ENTRY SYSTEMS
 BRYCE PARKER COMPANY, INC.
 9412 GIDLEY STREET
 TEMPLE CITY, CA 91780
 PH: (626) 442-1716 FX: (626) 579-5320

TITLE: GLASS GARAGE DOOR INSTALLATION & GENERAL NOTES
 PREPARED BY: CERTWORKS, LLC
 127 W. FAIRBANKS AVE., STE. 438
 WINTER PARK, FL 32789
 PH: (407) 644-6957 FX: (407) 644-2366

REVISIONS	DESCRIPTION	BY	DATE
		NO.	

[Handwritten Signature]
 12-2-10
 KRISTINA S. CALIGHERY
 FLORIDA P.E. NO. 18945
 127 W. FAIRBANKS AVE. STE. 438
 WINTER PARK, FL 32789
 FBC CERT. OF AUTHORIZATION NO. 03862

DATE: 06.01.09
 DWN BY: JLR
 CHK BY: HN
 SCALE: NTS
 DWG #: BPC003
 SHEET: 1 OF 6




BP-GLASS GARAGE DOORS & ENTRY SYSTEMS
 BRYCE PARKER COMPANY, INC.
 9412 GIDLEY STREET
 TEMPLE CITY, CA 91780
 PH: (626) 442-1716 FX: (626) 579-5320

TITLE:
 GLASS GARAGE DOOR
 ELEVATION, ANCHOR LAYOUT,
 & DETAILS

PREPARED BY:
 CERTWORKS, LLC
 127 W. FAIRBANKS AVE., STE. 438
 WINTER PARK, FL 32789
 PH: (407) 644-6957 FX: (407) 644-2366


NO.	DESCRIPTION	BY	DATE

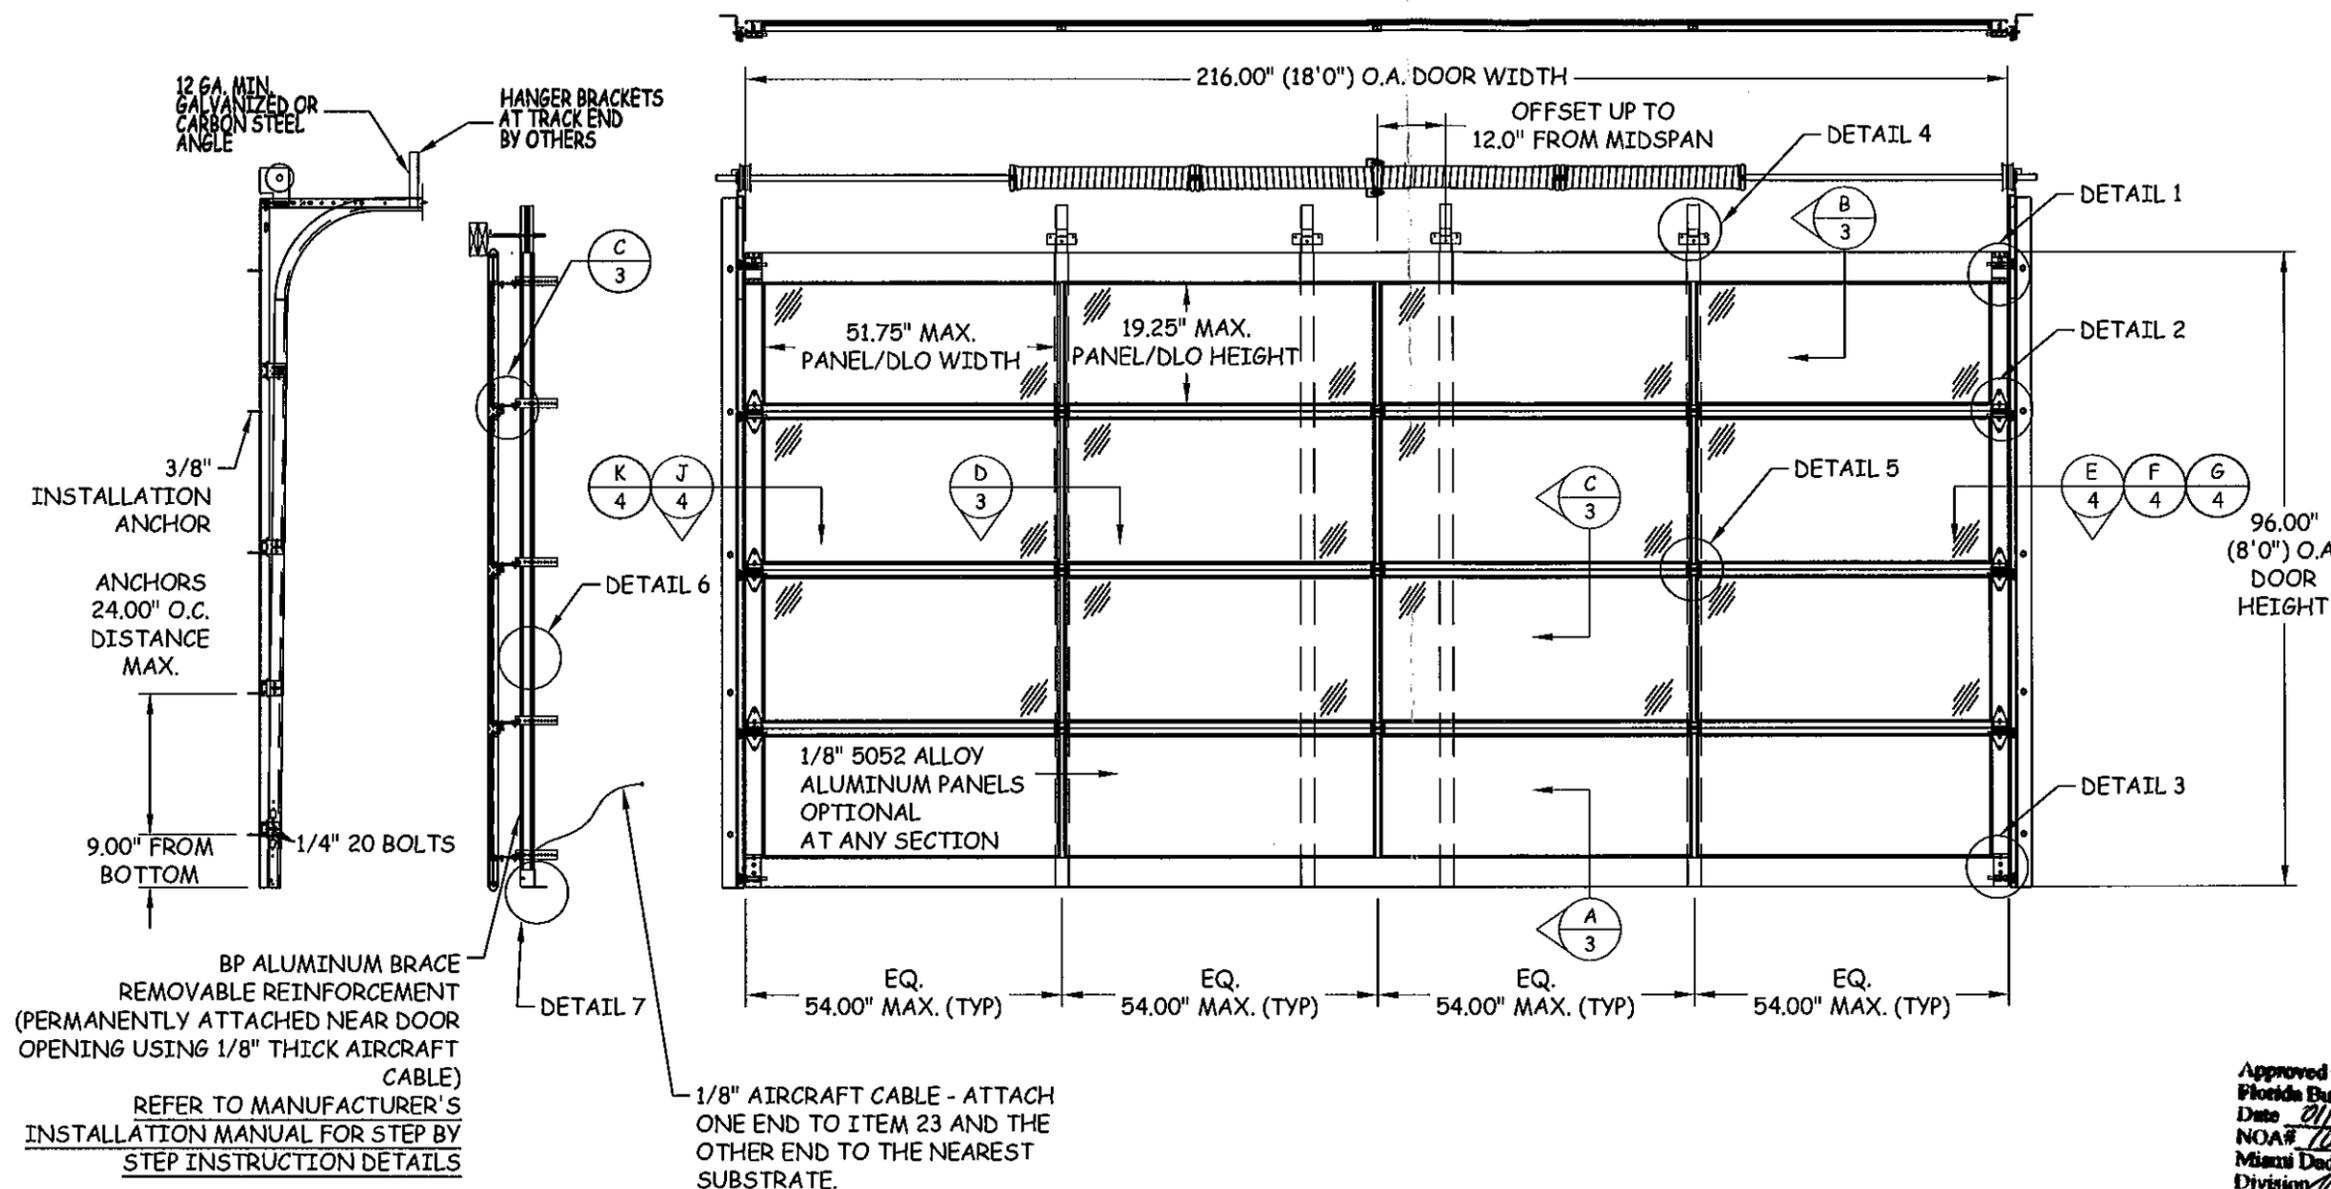

Approved as complying with the
 Florida Building Code
 Date: 01/13/2011
 NOA# 10-1802-02
 Miami Dade Product Control
 Division
 By: *[Signature]*

ANCHOR LAYOUT

INTERIOR ELEVATION

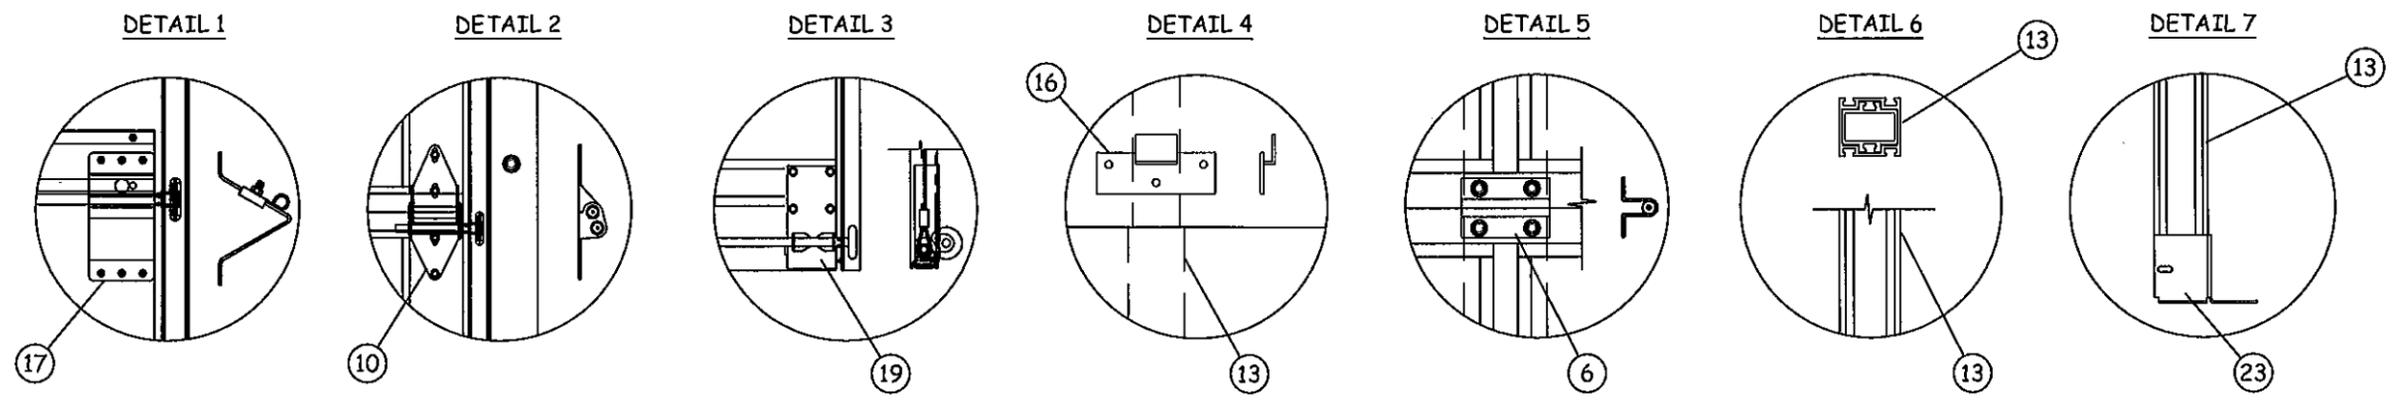

[Handwritten Signature]
 12-22-10
 KRISTINA'S DESIGNERY
 FLORIDA, E. NO. 58455
 127 W. FAIRBANKS AVE., STE. 438
 WINTER PARK, FL 32789
 FBPE CERT. OF AUTHORIZATION NO. 28920


DATE:	06.01.09
DWN BY:	JLR
CHK BY:	HN
SCALE:	NTS
DWG #:	BPC003
SHEET:	2 OF 6



BP GLASS GARAGE DOORS & ENTRY SYSTEMS
 BRYCE PARKER COMPANY, INC.
 9412 GIDLEY STREET
 TEMPLE CITY, CA 91780
 PH: (626) 442-1716 FX: (626) 579-5320

TITLE:
 GLASS GARAGE DOOR
 VERTICAL, HORIZONTAL
 SECTIONS & GLAZING DETAILS

PREPARED BY:
 CERTWORKS, LLC
 127 W. FAIRBANKS AVE., STE. 438
 WINTER PARK, FL 32789
 PH: (407) 644-6957 FX: (407) 644-2366

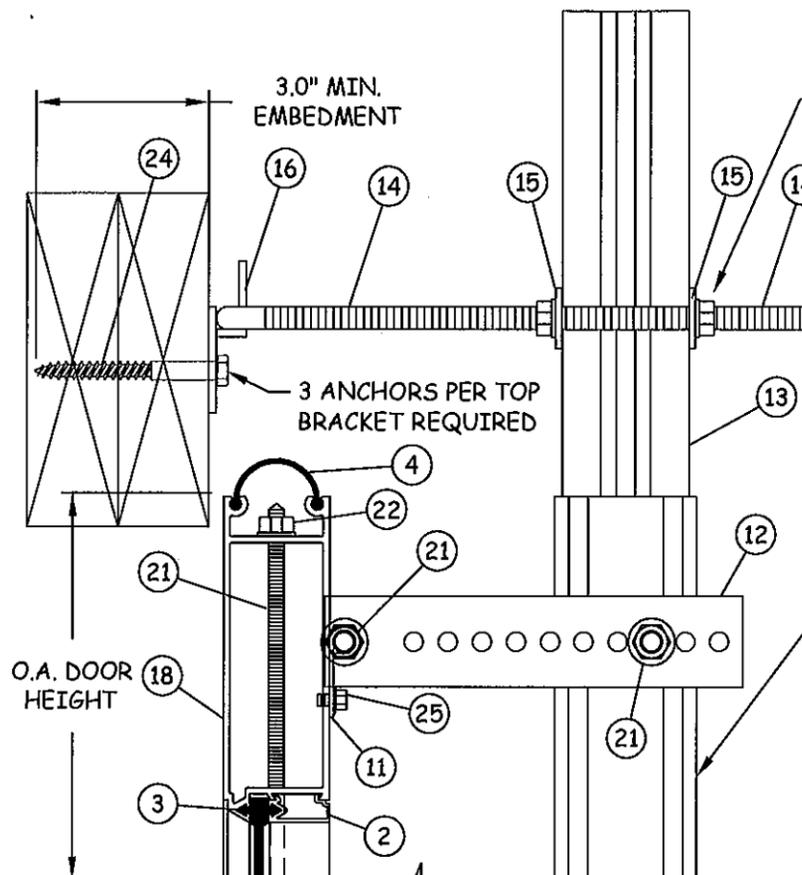


ITEM 14 AND 15 ARE ADJUSTED IN PLACE DURING FIRST INSTALLMENT, THEN REMAIN PERMANENTLY ATTACHED TO ITEM 13 THEREAFTER

ITEM 21 - THROUGH BOLT WITH WING NUT (SCREW IN FINGER TIGHT AND KEEP ATTACHED TO ITEM 12 DEFLECTION BRACKETS WHEN REMOVABLE REINFORCEMENT IS NOT IN USE)


REFER TO MANUFACTURER'S INSTALLATION MANUAL FOR STEP BY STEP INSTRUCTION DETAILS ON REMOVABLE REINFORCEMENT

1/8" AIRCRAFT CABLE - ATTACH ONE END TO ITEM 21 AND THE OTHER END TO THE NEAREST SUBSTRATE.


5/16" O.A. LAMINATED GLASS CONSISTING OF:
 1/8" ANNEALED GLASS
 0.100' PVB INTERLAYER
 3/32" ANNEALED GLASS

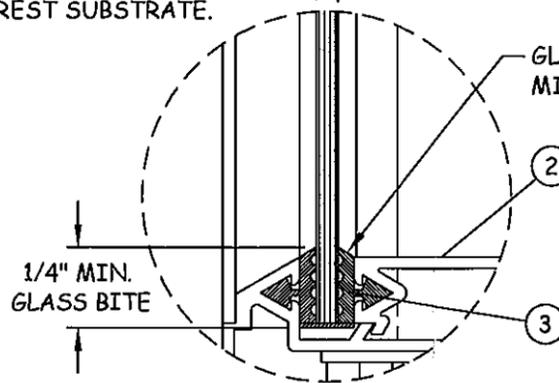


GLAZING DETAIL

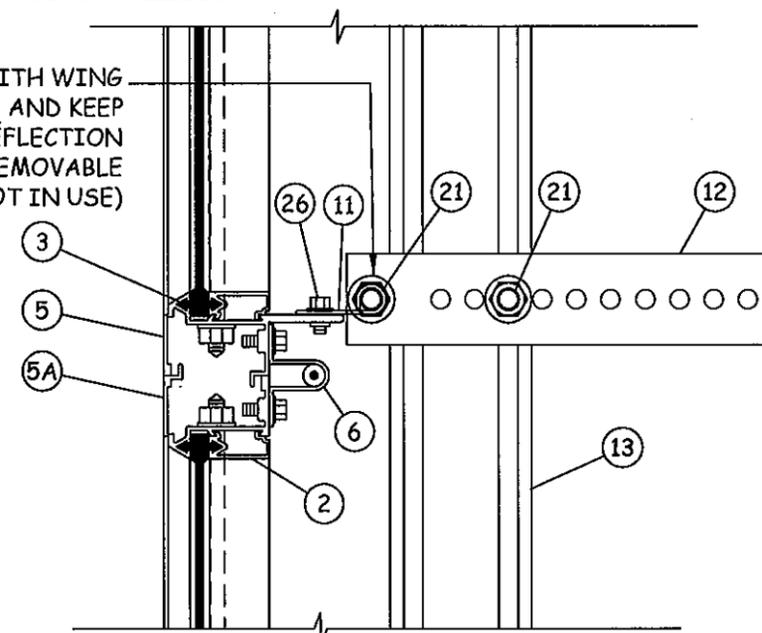

C
3
VERTICAL SECTION
INTERMEDIATE RAIL

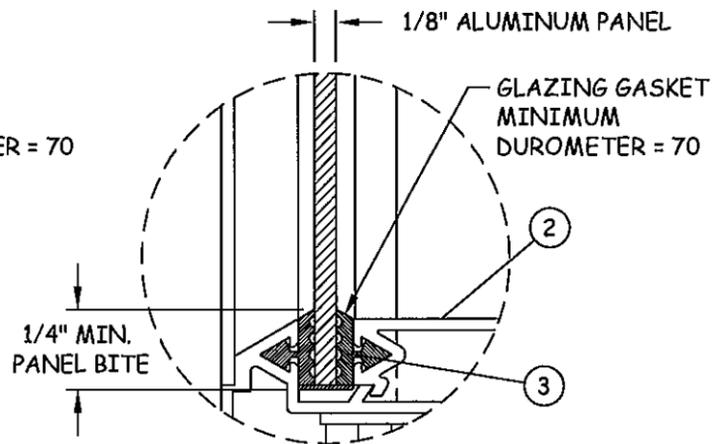

PANEL DETAIL

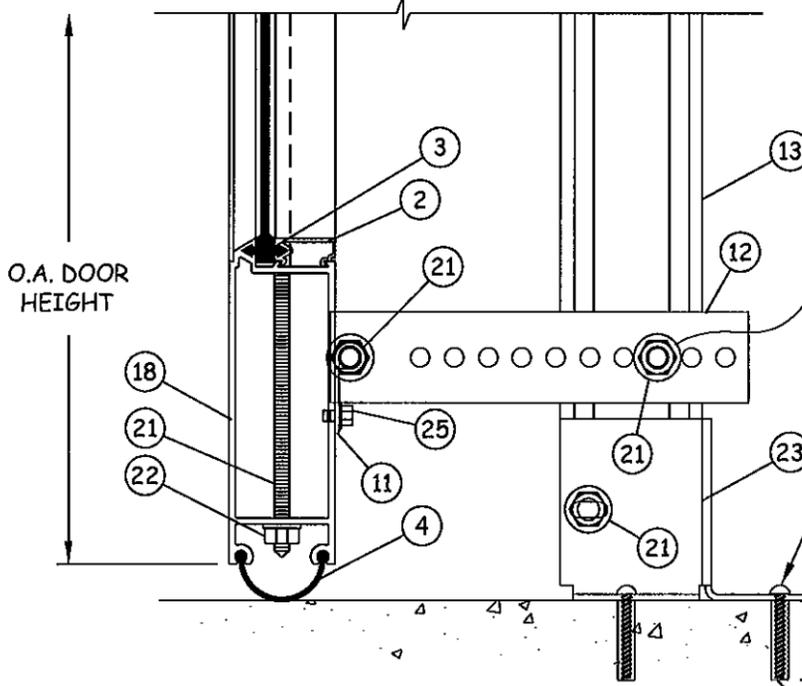


3 ANCHORS PER BOTTOM BRACKET REQUIRED (SCREW IN FINGER TIGHT AND KEEP IN PLACE WHEN REMOVABLE REINFORCEMENT IS NOT IN USE TO KEEP HOLES FREE FROM DIRT AND DEBRIS)

Approved as complying with the Florida Building Code
 Date: 01/13/2011
 NOA# 10-0802-02
 Miami Dade Product Control Division
 By: [Signature]

1 5/8" MIN. EMBEDMENT

A
3
VERTICAL SECTION
BOTTOM RAIL

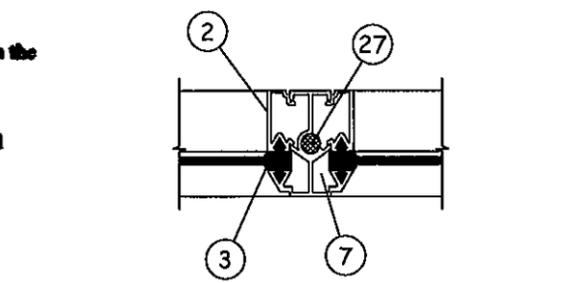

D
3
HORIZONTAL SECTION
VERTICAL MULLION

REVISIONS

NO.	DESCRIPTION	BY	DATE


[Signature]
 12-2-10
 KRISTINA S. DAUGHERTY
 FLORIDA P.E. NO. 88585
 127 W. FAIRBANKS AVE. STE. 438
 WINTER PARK, FL 32789
 FEPE CERT. OF AUTHORIZATION NO. 88580

DATE: 06.01.09
 DWN BY: JLR
 CHK BY: HN
 SCALE: NTS


DWG #: BPC003
 SHEET: 3 OF 6




BP-GLASS GARAGE DOORS & ENTRY SYSTEMS
 BRYCE PARKER COMPANY, INC.
 9412 GIDLEY STREET
 TEMPLE CITY, CA 91780
 PH: (626) 442-1716 FX: (626) 579-5320

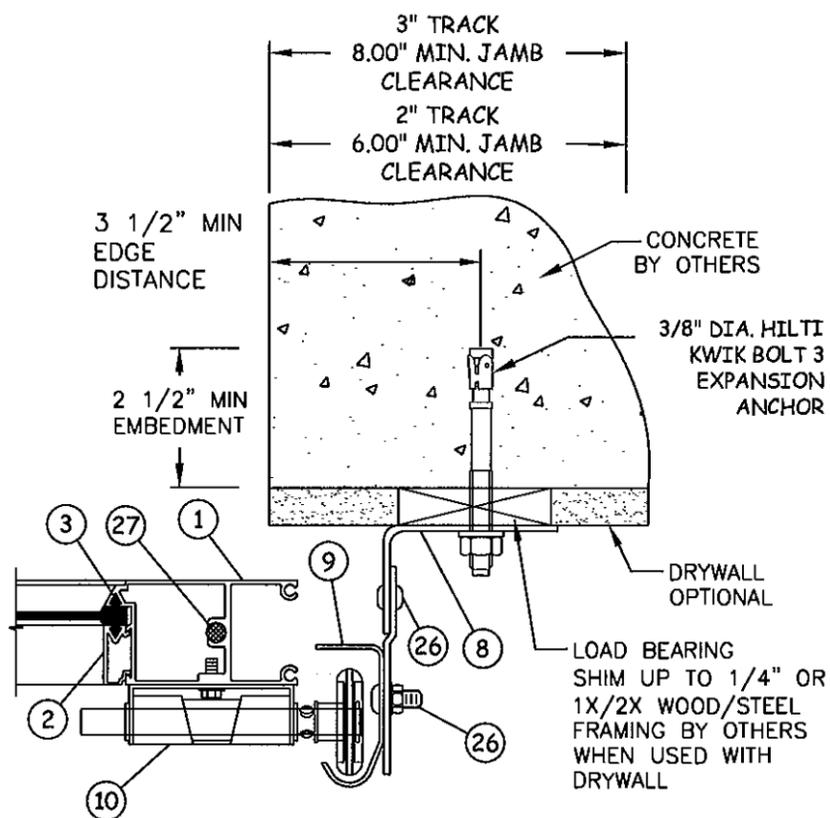


E HORIZONTAL SECTION
4 JAMBS - DRYWALL OVER CONCRETE
 ANGLE MOUNTED

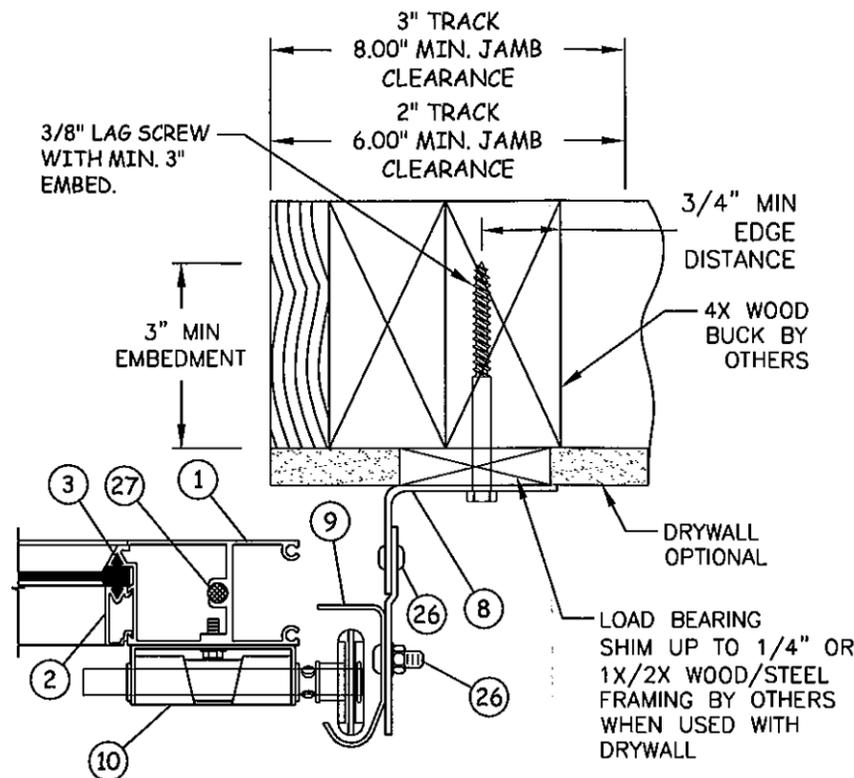


F HORIZONTAL SECTION
4 JAMBS - DRYWALL OVER 4X WOOD FRAME
 ANGLE MOUNTED

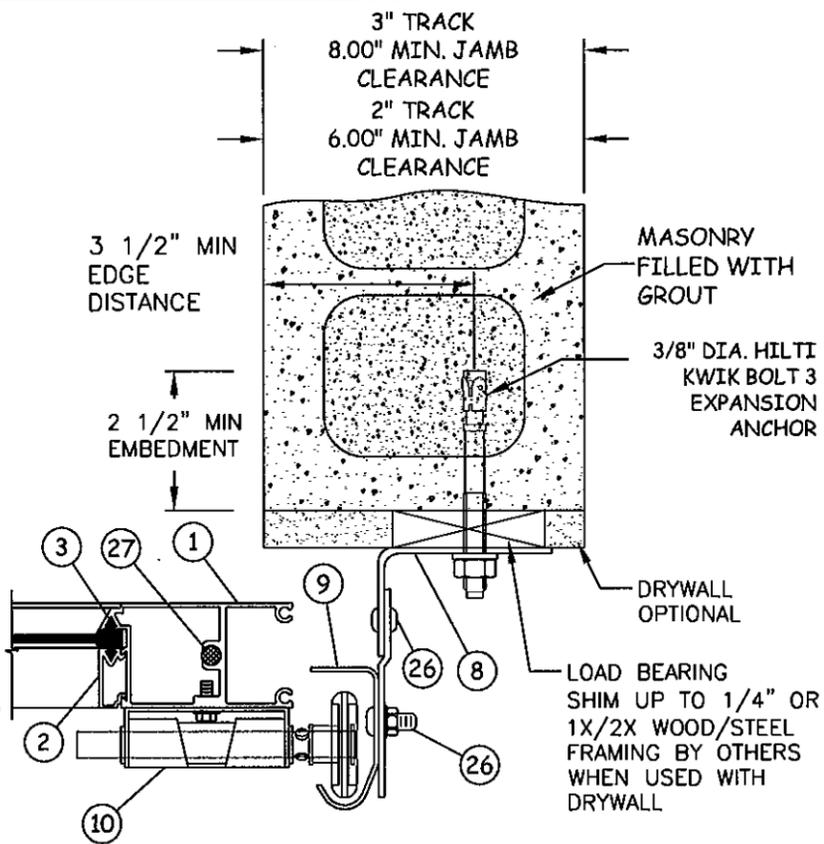

G HORIZONTAL SECTION
4 JAMBS - DRYWALL OVER CMU
 ANGLE MOUNTED

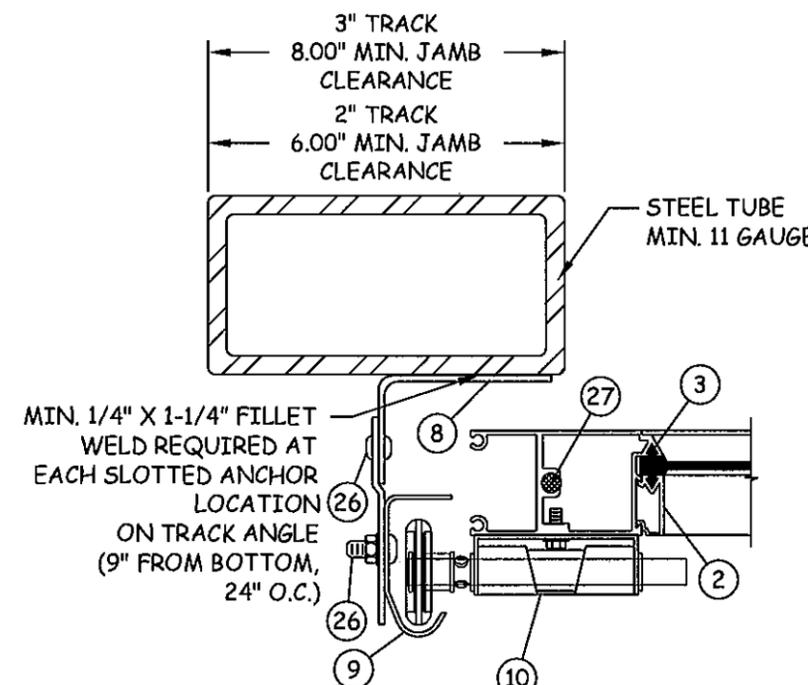

J HORIZONTAL SECTION
4 JAMBS - STEEL
 REVERSE ANGLE MOUNTED

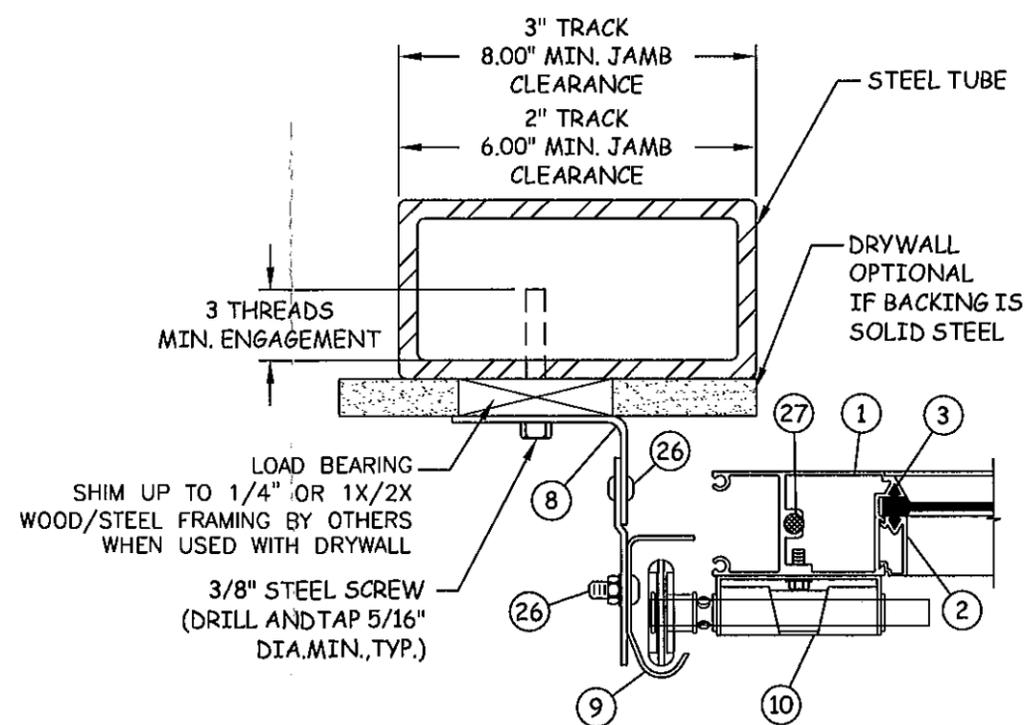

K HORIZONTAL SECTION
4 JAMBS - STEEL W/ DRYWALL
 ANGLE MOUNTED

Approved as complying with the
 Florida Building Code
 Date 01/13/2011
 NOA# 12-0802-02
 Miami Dade Product Control
 Division
 By *[Signature]*

TITLE: GLASS GARAGE DOOR
 HORIZONTAL SECTIONS
 & BILL OF MATERIALS







PREPARED BY:
 CERTWORKS, LLC
 127 W. FAIRBANKS AVE., STE. 438
 WINTER PARK, FL 32789
 PH: (407) 644-6957 FX: (407) 644-2366

NO.	REVISIONS	DESCRIPTION	BY	DATE

[Signature]
 12-2-10
 KRISTINA S. DAUGHERTY
 FLORIDA P.E. NO. 68485
 127 WINTER PARK BLVD., STE. 438
 WINTER PARK, FL 32789
 FEPE CERT. OF AUTHORIZATION NO. 089830

DATE: 06.01.09
 DWN BY: JLR
 CHK BY: HN
 SCALE: NTS
 DWG #: BPC003
 SHEET: 4 OF 6

BILL OF MATERIALS			
ITEM NO.	DESCRIPTION	MATERIAL	MANUFACTURER
1	350 SIDE PANEL FRAME	ALUMINUM	BP GLASS DOORS
2	GLASS STOP	ALUMINUM	BP GLASS DOORS
3	GLAZING GASKET	EPDM	GLS
4	WEATHERSTRIPPING	EPDM	GLS
5	INTERMEDIATE RAIL (TOP)	ALUMINUM	BP GLASS DOORS
5A	INTERMEDIATE RAIL (BOTTOM)	ALUMINUM	BP GLASS DOORS
6	INTERMEDIATE HINGE	14 GA. STAINLESS STEEL	BP GLASS DOORS
7	VERTICAL MULLION	ALUMINUM	BP GLASS DOORS
8	ANGLE	14 GA. STEEL	BP GLASS DOORS
9	TRACK 2"	15 GA. STEEL	BP GLASS DOORS
10	UNIVERSAL HINGES #1-#9	12 GA. STAINLESS STEEL	BP GLASS DOORS
11	HF-PIN BRACKET	12 GA. STAINLESS STEEL	BP GLASS DOORS
12	DEFLECTION BRACKET	11 GA. GALV. STEEL	BP GLASS DOORS
13	REMOVABLE REINFORCEMENT	ALUMINUM	BP GLASS DOORS
14	3/8" U-BOLT & LOCK NUTS	STEEL	BP GLASS DOORS
15	U-BOLT PLATES	12 GA. GALV. STEEL	BP GLASS DOORS
16	TOP BRACKET	1/4" STEEL	BP GLASS DOORS
17	TOP FIXTURE	12 GA. STAINLESS STEEL	BP GLASS DOORS
18	450 TOP AND BOTTOM PANEL	ALUMINUM	BP GLASS DOORS
19	BOTTOM FIXTURE	12 GA. STAINLESS STEEL	BP GLASS DOORS
20	3/8" DROP IN CONCRETE ANCHOR	STEEL	BP GLASS DOORS
21	1/4" - 20 HEX BOLT & NUTS	STEEL	BP GLASS DOORS
22	1/4" NUT	STEEL	BP GLASS DOORS
23	FLOOR FLANGE	12 GA. GALV. STEEL	BP GLASS DOORS
24	3/8" X 3" LAG BOLT	STEEL	BP GLASS DOORS
25	1/4" X 1/2" SELF THREADING SCREW	STEEL	BP GLASS DOORS
26	1/4" X 1/2" CARRIAGE BOLT	STEEL	BP GLASS DOORS
27	1/4" X 20 GALV. THRU BOLT W/ NUT	STEEL	BP GLASS DOORS

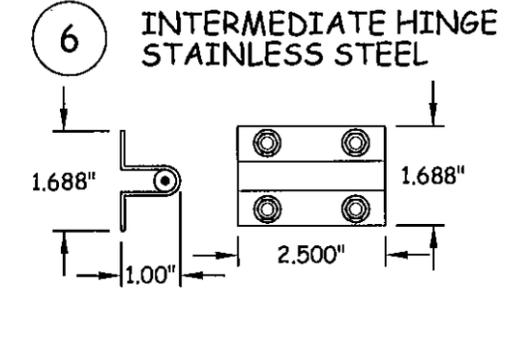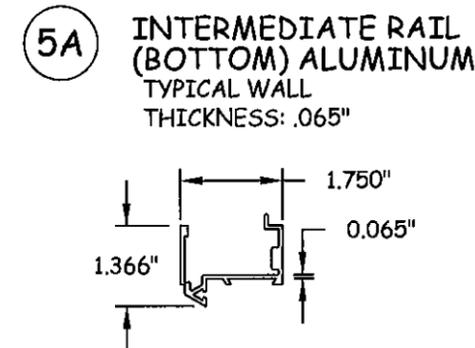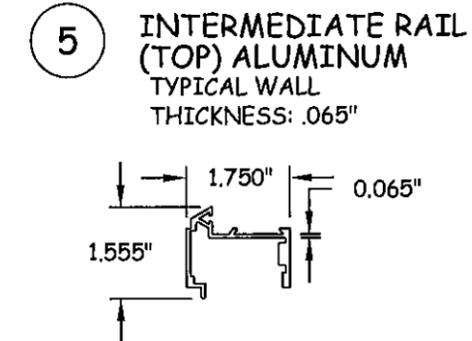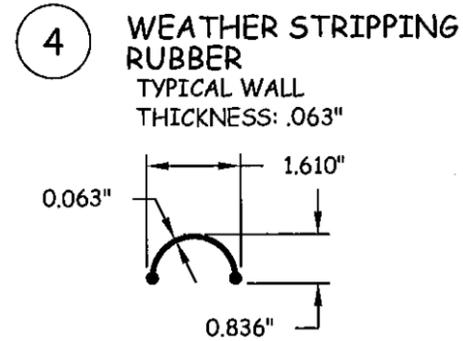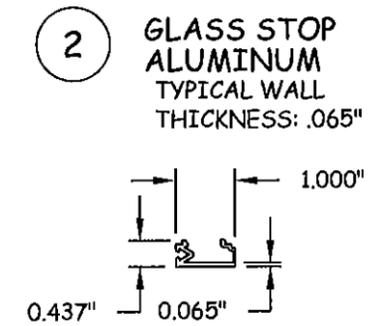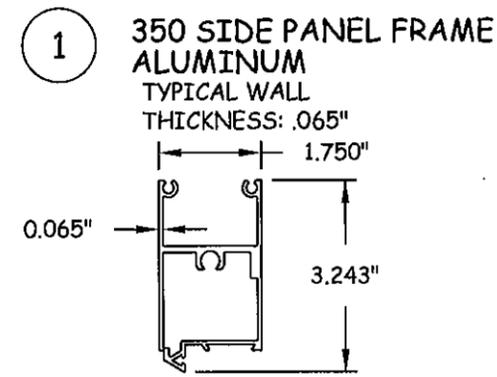

BP-GLASS GARAGE DOORS & ENTRY SYSTEMS
BRYCE PARKER COMPANY, INC.
9412 GIDLEY STREET
TEMPLE CITY, CA 91780
PH: (626) 442-1716 FX: (626) 579-5320

TITLE: GLASS GARAGE DOOR
BILL OF MATERIALS &
COMPONENTS

PREPARED BY:
CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

NO.	DESCRIPTION	BY	DATE


[Handwritten Signature]
12-2-10

KRISTINA S. DALGHERTY
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PREP. CERT. OF AUTHORIZATION NO. 28520


Approved as complying with the
Florida Building Code
Date 01/13/2011
NOAH 10-0802.02
Miami Dade Product Control
Division
By *[Signature]*

DATE: 06.01.09	DWN BY: JLR	CHK BY: HN	SCALE: NTS
DWG #: BPC003			
SHEET: 5 OF 6			


7 VERTICAL MULLION ALUMINUM
TYPICAL WALL THICKNESS: .065"

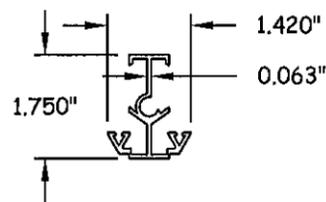


8 ANGLE STEEL
TYPICAL WALL THICKNESS: .100"

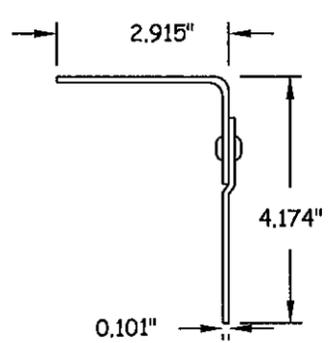


9 TRACK STEEL
TYPICAL WALL THICKNESS: .125"




10 UNIVERSAL HINGES #1-#9 STAINLESS STEEL

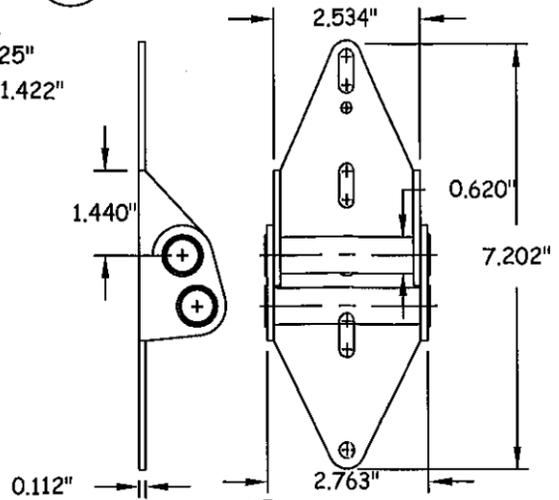


11 HF PIN BRACKET STAINLESS STEEL




12 DEFLECTION BRACKET STEEL

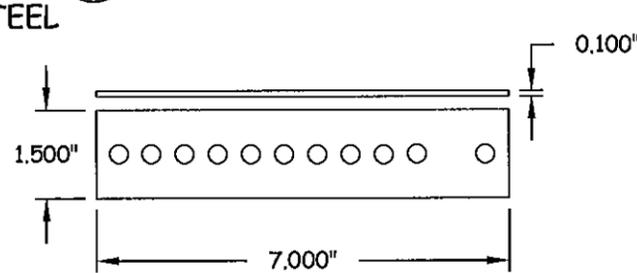


13 REMOVABLE REINFORCEMENT ALUMINUM




14 U-BOLT STEEL

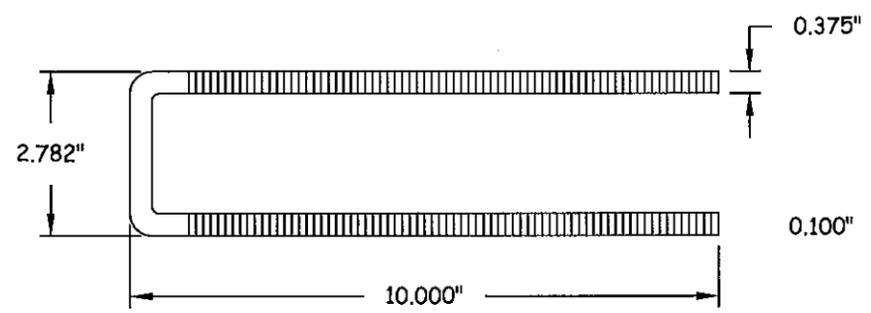


15 U-BOLT PLATES STEEL

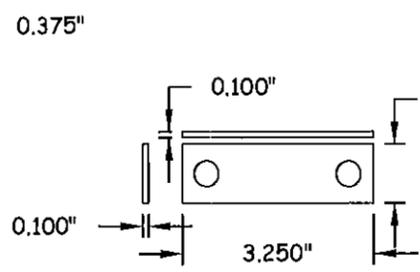


16 TOP BRACKET STEEL

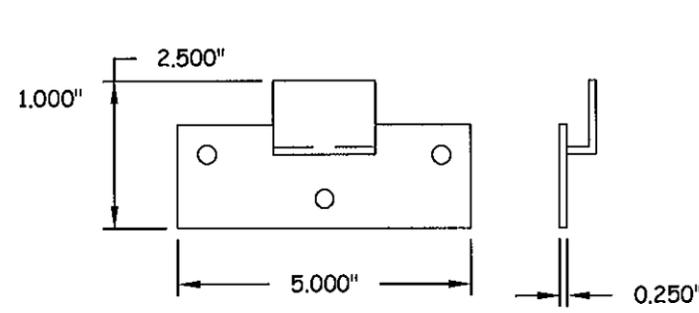


17 TOP FIXTURE STAINLESS STEEL

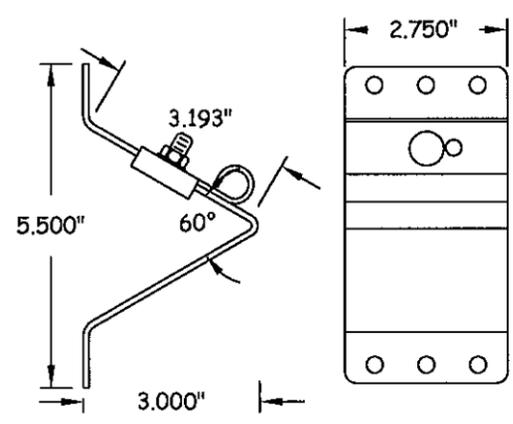



18 450 TOP AND BOTTOM PANEL ALUMINUM

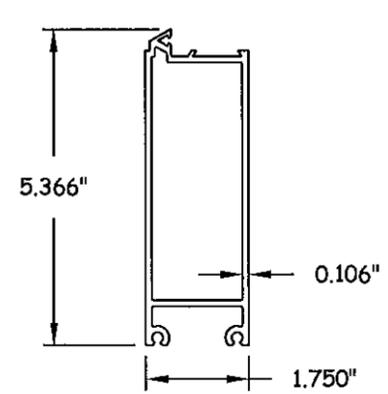

19 BOTTOM FIXTURE STAINLESS STEEL

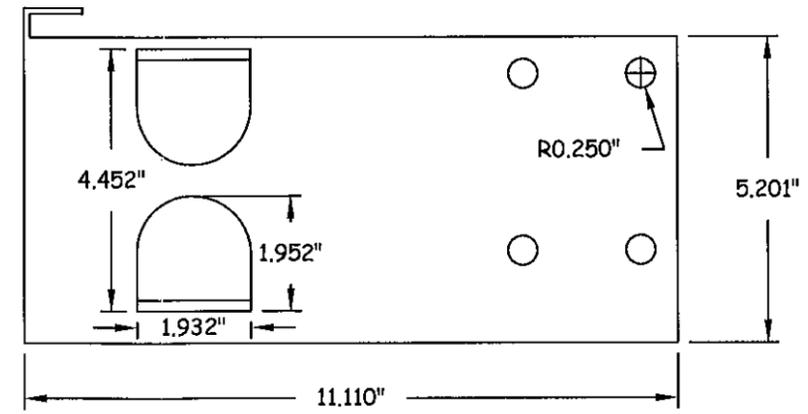

23 FLOOR FLANGE STEEL

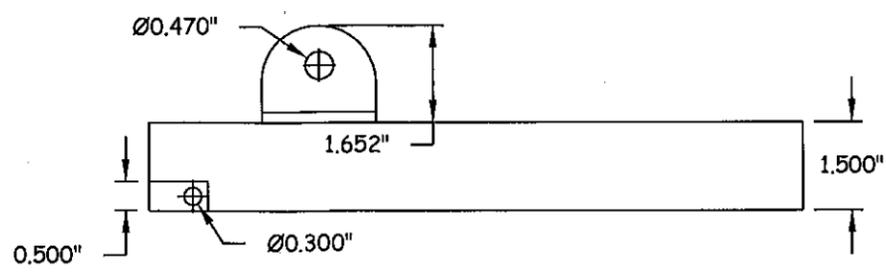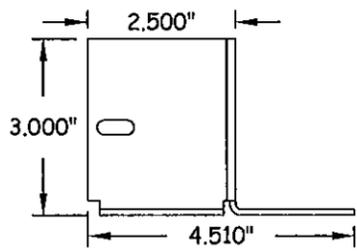

BP GLASS GARAGE DOORS & ENTRY SYSTEMS
BRYCE PARKER COMPANY, INC.
9412 GIDLEY STREET
TEMPLE CITY, CA 91780
PH: (626) 442-1716 FX: (626) 579-5320

TITLE: GLASS GARAGE DOOR COMPONENTS

PREPARED BY: CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

NO.	REVISIONS DESCRIPTION	BY	DATE

Kristina S. Daugherty
12-2-10
KRISTINA S. DAUGHERTY
FLORIDA P.E. NO. 08456
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
FLOOR PLAN AUTHORIZATION NO. 26520

Approved as complying with the Florida Building Code
Date 01/13/2011
NOA# 10-0802.02
Miami Dade Product Control
Division
By *[Signature]*

DATE: 06.01.09	DWN BY: JLR	CHK BY: HN	SCALE: NTS
DWG #: BPC003			
SHEET: 6 OF 6			