



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 372-6339

NOTICE OF ACCEPTANCE (NOA)

www.miamidadc.gov/buildingcode

Arch Windows, LLC dba AWP
8130 NW 74th Avenue
Medley, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Impact View" Aluminum Fixed Window - L.M.I.

APPROVAL DOCUMENT: Drawing No. **W03-39**, titled "Impact View Alum. Fixed Wdw. (L.M.I.)", sheets 1 through 6 of 6, prepared by Al-Farooq Corporation, dated 06/10/03, with revision "E", dated 05/27/10, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises and supersedes NOA # 09-0107.09** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 10-0804.06
Expiration Date: March 04, 2014
Approval Date: November 24, 2010
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W03-39**, titled "Impact View Alum. Fixed Wdw. (L.M.I.)", sheets 1 through 6 of 6, prepared by Al-Farooq Corporation, dated 06/10/03, with revision "E", dated 05/27/10, signed and sealed by Javad Ahmad, P.E.

B. TESTS

- I. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of aluminum fixed windows, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3467**, dated March 31, 2003, signed and sealed by Joseph C. Chan, P.E.

(Submitted under NOA# 03-0710.01)

2. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of aluminum fixed windows, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3553**, dated March 31, 2003, signed and sealed by Joseph C. Chan, P.E.

(Submitted under NOA# 03-0710.01)

C. CALCULATIONS

- I. Anchor verification calculations and structural analysis, complying with FBC-2004 and 2007, prepared by Al-Farooq Corporation, dated 5/23/06 and revised on 12/02/08, signed and sealed by Humayoun Farooq, P.E.
Complies with ASTM E1300-02/04

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).


Manuel Perez, P.E.
Product Control Examiner
NOA No. 10-0804.06

Expiration Date: March 04, 2014
Approval Date: November 24, 2010

Arch Windows, LLC dba AWP

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their “**Saflex III G Clear or colored interlayer**” dated 05/04/06, expiring on 05/21/11.

F. STATEMENTS

1. Statement letter of conformance and no financial interest, dated May 28, 2010, signed and sealed by Javad Ahmad, P.E.
2. Statement letter of compliance, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL- 3467**, dated 04/11/03, signed and sealed by Joseph C. Chan, P.E.


G. OTHER

1. Notice of Acceptance No. **09-0107.09**, issued to AWP, LLC for their **Series “Impact View” Aluminum Fixed Window – L.M.I.**, approved on 03/25/09 and expiring on 03/04/14.




Manuel Perez, P.E.
Product Control Examiner
NOA No. 10-0804.06

Expiration Date: March 04, 2014
Approval Date: November 24, 2010

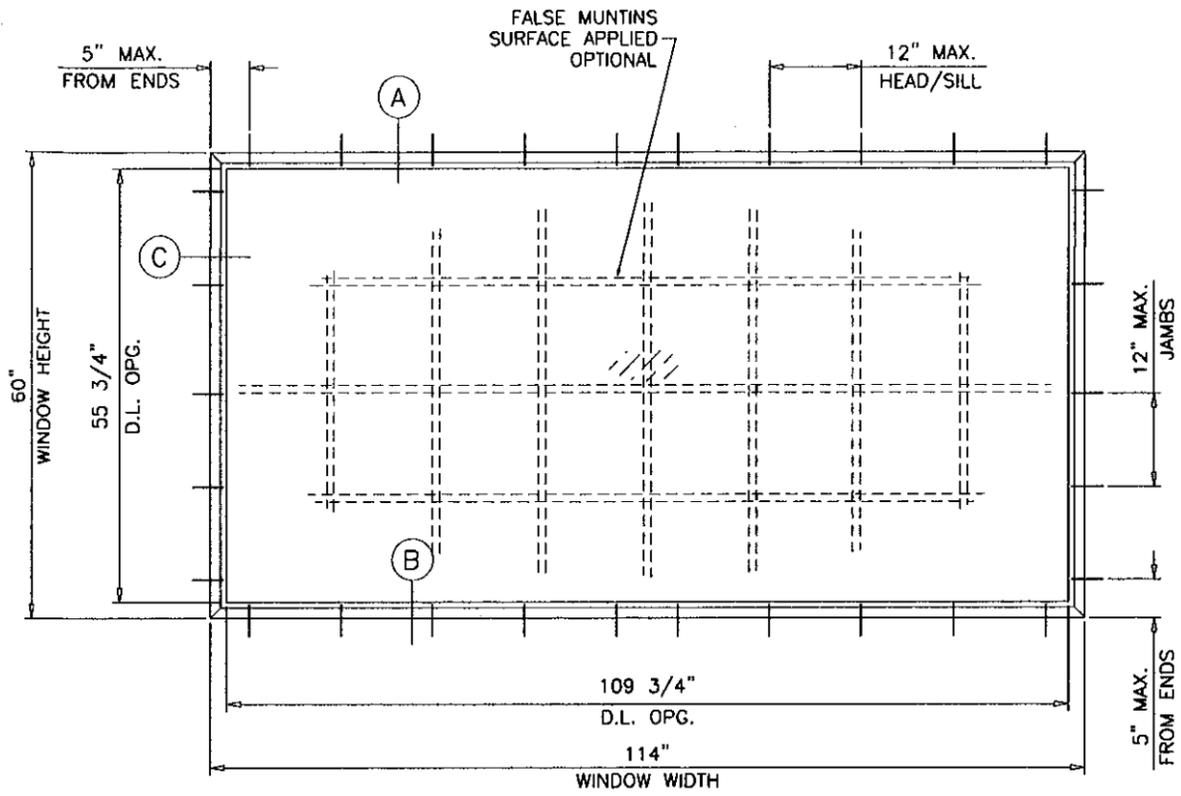

TYPICAL ELEVATION
TESTED UNIT

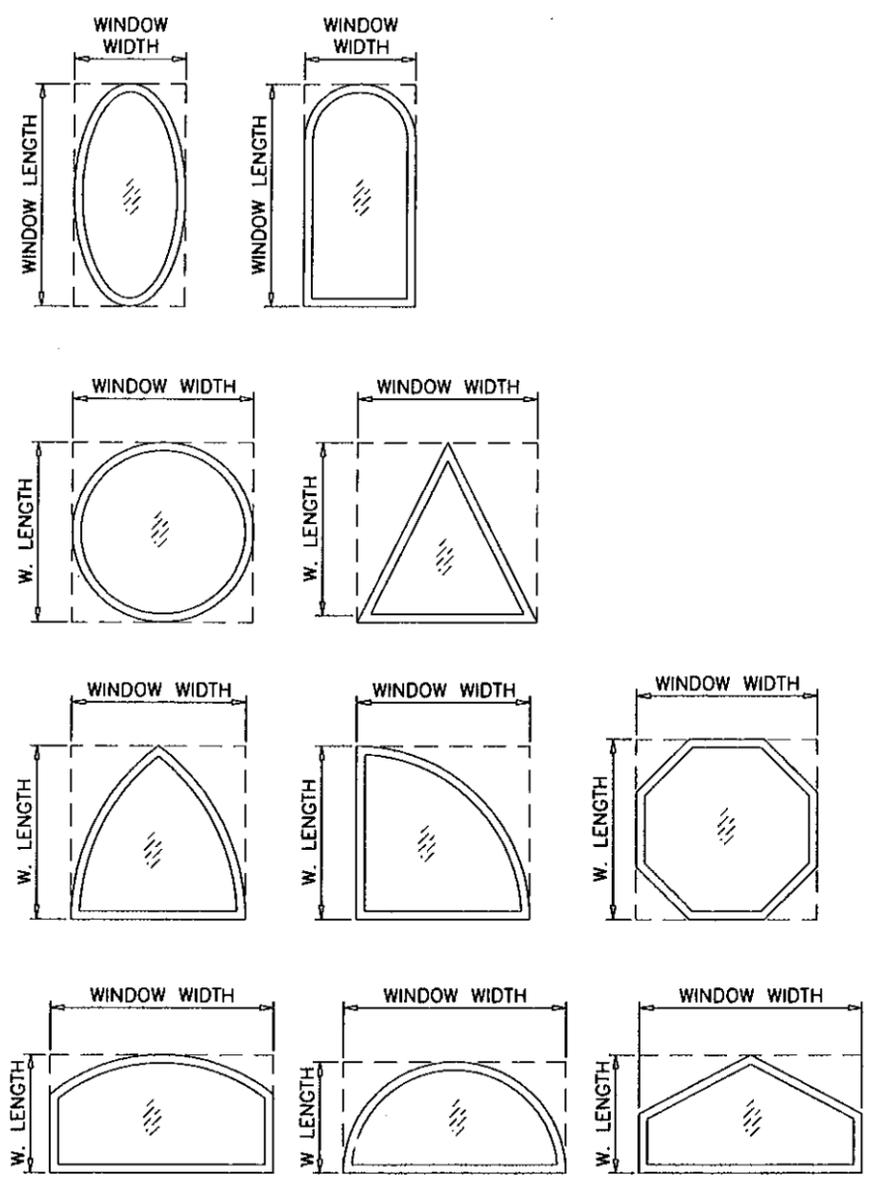

ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN SQUARE OR RECTANGLE AS SHOWN IN DOTTED LINES AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES.

IMPACT VIEW ALUMINUM FIXED WINDOW

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIXED/FIXED OR FIXED WITH OTHER MIAMI-DADE COUNTY APPR'D WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEETS 2 & 3.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Eng: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

10 JUN 2013

PRODUCT REVISION
Complying with the Florida Building Code
Acceptance No. 10-0804.05
Expiration Date MARCH 4, 2014

By: *Manuel...*
Miami-Dade Product Control

revisions:

no	date	description
A	11.06.03	NO CHANGE THIS SHEET
B	01.23.04	NOTES REV.
C	07.12.07	UPDATED FOR 2004 FBC, NAME REV.
D	11.24.08	UPDATED FOR 2007 FBC
E	05.27.10	MANUF. NAME REVISED

date: 06-10-03
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:

drawing no.
W03-39


sheet 1 of 6

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309


COMP-ANL\W03-39YO

DESIGN LOAD CAPACITY - PSF									
WINDOW DIMS.		GLASS TYPE 'B'				GLASS TYPE 'C'			
		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'	
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
53-1/8"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
19-1/8"	38-3/8"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		64.9	64.9	64.9	64.9	80.0	80.0	80.0	80.0
53-1/8"		62.5	62.5	62.5	62.5	79.6	79.6	80.0	80.0
19-1/8"	50-5/8"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		64.9	64.9	64.9	64.9	80.0	80.0	80.0	80.0
53-1/8"		47.4	47.4	47.4	47.4	73.6	73.6	80.0	80.0
19-1/8"	63"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		64.9	64.9	64.9	64.9	75.6	75.6	80.0	80.0
53-1/8"		45.2	45.2	45.2	45.2	64.3	64.3	80.0	80.0
19-1/8"	74-1/4"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
26-1/2"		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0
37"		64.9	64.9	64.9	64.9	70.4	70.4	80.0	80.0
53-1/8"		45.2	45.2	45.2	45.2	57.3	57.3	80.0	80.0

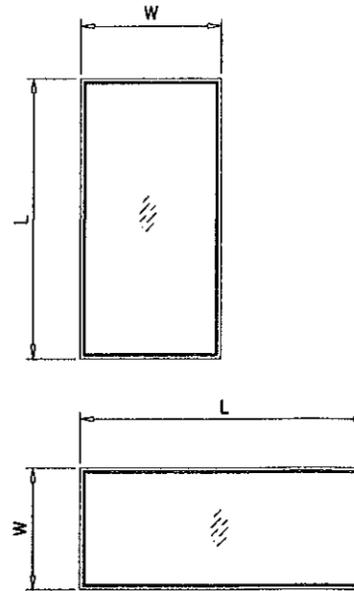

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS).

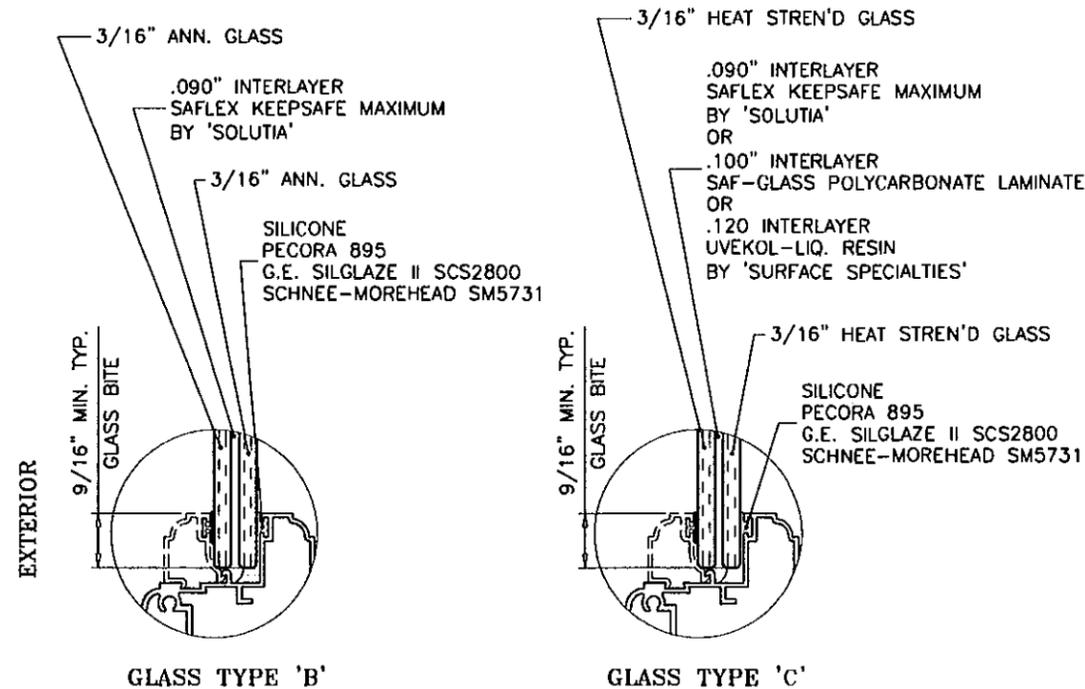

GLAZING DETAILS

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70392
C.A.N. 8380

J.A.

PRODUCT REVISE:
as complying with the Florida
Building Code
Acceptance No. 10-0804-06
Expiration Date: MARCH 4, 2014

M. Ahmed
Product Control
Division

no	date	description
A	11.06.03	NO CHANGE THIS SHEET
B	01.23.04	LOAD CHART REV.
C	07.12.07	UPDATED FOR 2004 FBC, NAME REV.
D	11.24.08	NOTE REV.
E	05.27.10	MANUF. NAME REVISED

date: 06-10-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-39


sheet 2 of 6

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-39YO

DESIGN LOAD CAPACITY - PSF									
WINDOW DIMS.		GLASS TYPE 'B'				GLASS TYPE 'C'			
		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'	
WIDTH	LENGTH	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
36"	48"	66.7	66.7	66.7	66.7	76.8	76.8	80.0	80.0
42"		57.1	57.1	50.0	50.0	73.1	73.1	80.0	80.0
48"		50.0	50.0	50.0	50.0	72.0	72.0	80.0	80.0
54"		50.0	50.0	50.0	50.0	72.0	72.0	80.0	80.0
60"		50.0	50.0	50.0	50.0	60.0	60.0	80.0	80.0
66"		50.0	50.0	50.0	50.0	61.7	61.7	80.0	80.0
72"		50.0	50.0	50.0	50.0	54.0	54.0	80.0	80.0
36"	60"	66.7	66.7	66.7	66.7	68.6	68.6	80.0	80.0
42"		57.1	57.1	50.0	50.0	63.3	63.3	80.0	80.0
48"		50.0	50.0	50.0	50.0	60.0	60.0	80.0	80.0
54"		44.4	44.4	44.4	44.4	58.2	58.2	80.0	80.0
60"		40.0	40.0	40.0	40.0	57.6	57.6	80.0	80.0
66"		40.0	40.0	40.0	40.0	57.6	57.6	80.0	80.0
72"		40.0	40.0	40.0	40.0	49.4	49.4	80.0	80.0
36"	72"	64.0	64.0	66.7	66.7	64.0	64.0	80.0	80.0
42"		57.1	57.1	50.0	50.0	58.1	58.1	80.0	80.0
48"		50.0	50.0	50.0	50.0	54.0	54.0	80.0	80.0
54"		44.4	44.4	44.4	44.4	51.2	51.2	80.0	80.0
60"		40.0	40.0	40.0	40.0	49.4	49.4	80.0	80.0
66"		36.4	36.4	36.4	36.4	48.3	48.3	72.7	72.7
72"		33.3	33.3	33.3	33.3	48.0	48.0	66.7	66.7
36"	84"	61.1	61.1	66.7	66.7	61.1	61.1	80.0	80.0
42"		54.9	54.9	50.0	50.0	54.9	54.9	80.0	80.0
48"		50.0	50.0	50.0	50.0	50.4	50.4	80.0	80.0
54"		44.4	44.4	44.4	44.4	47.2	47.2	80.0	80.0
60"		40.0	40.0	40.0	40.0	44.8	44.8	80.0	80.0
66"		-	-	-	-	43.1	43.1	72.7	72.7
72"		-	-	-	-	42.0	42.0	66.7	66.7
36"	96"	59.1	59.1	64.8	64.8	59.1	59.1	80.0	80.0
42"		52.7	52.7	50.0	50.0	52.7	52.7	80.0	80.0
48"		48.0	48.0	50.0	50.0	48.0	48.0	80.0	80.0
54"		44.4	44.4	44.4	44.4	44.5	44.5	80.0	80.0
60"		-	-	-	-	41.9	41.9	80.0	80.0
66"		-	-	-	-	39.9	39.9	72.7	72.7
36"	108"	57.6	57.6	63.2	63.2	57.6	57.6	80.0	80.0
42"		51.1	51.1	50.0	50.0	51.1	51.1	80.0	80.0
48"		46.3	46.3	50.0	50.0	46.3	46.3	80.0	80.0
54"		-	-	-	-	42.7	42.7	80.0	80.0
60"		-	-	-	-	39.9	39.9	80.0	80.0
36"	114"	60.0	60.0	62.5	62.5	60.0	60.0	80.0	80.0
42"		53.1	53.1	50.0	50.0	53.1	53.1	80.0	80.0
48"		48.0	48.0	50.0	50.0	48.0	48.0	80.0	80.0
54"		-	-	-	-	44.1	44.1	80.0	80.0
60"		-	-	-	-	41.1	41.1	80.0	80.0
36"	120"	56.5	56.5	61.9	61.9	56.5	56.5	80.0	80.0
42"		49.9	49.9	-	-	49.9	49.9	80.0	80.0
48"		-	-	-	-	45.0	45.0	80.0	80.0
54"		-	-	-	-	41.3	41.3	80.0	80.0
36"	132"	55.6	55.6	60.9	60.9	55.6	55.6	80.0	80.0
42"		-	-	-	-	48.9	48.9	80.0	80.0
48"		-	-	-	-	44.0	44.0	80.0	80.0
36"	144"	54.9	54.9	60.2	60.2	54.9	54.9	80.0	80.0
42"		-	-	-	-	48.2	48.2	80.0	80.0

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS).

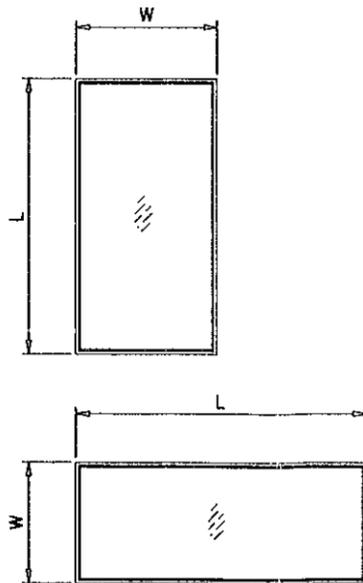

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
JUN 03 2011

PRODUCT REVISION:
Complying with the Florida
Building Code
Acceptance No. 10-0804-06
Expiration Date: MARCH 4, 2014
Maurice Perry
Manufacture Product Control

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309





no	date	by	description
A	11.06.03		NO CHANGE THIS SHEET
B	01.23.04		LOAD CHART REV.
C	07.12.07		UPDATED FOR 2004 FBC, NAME REV.
D	11.24.08		NOTE REV.
E	05.27.10		MANUF. NAME REVISED

date: 06-10-03
scale: -
dr. by: HAMID
chk. by:

drawing no.
W03-39

sheet 3 of 6

COMP-ANL W03-39YO

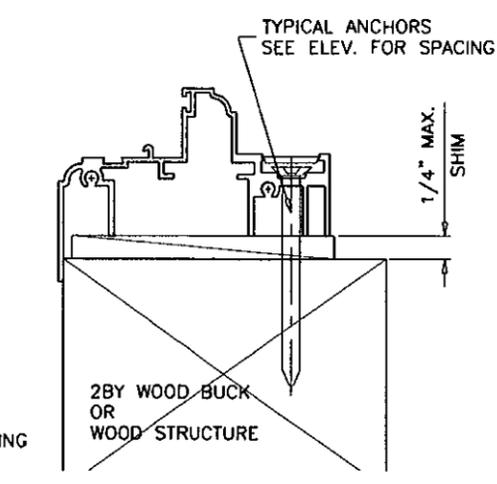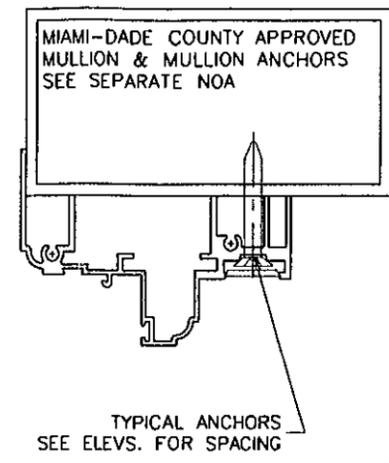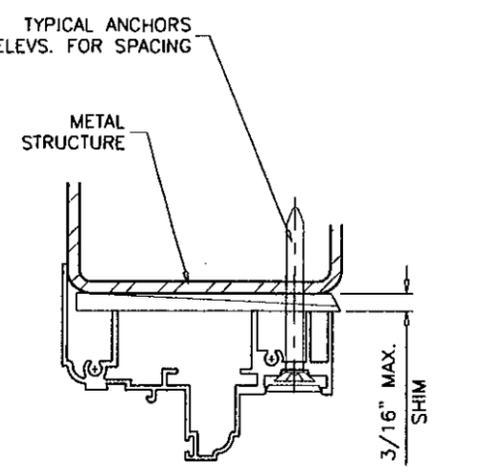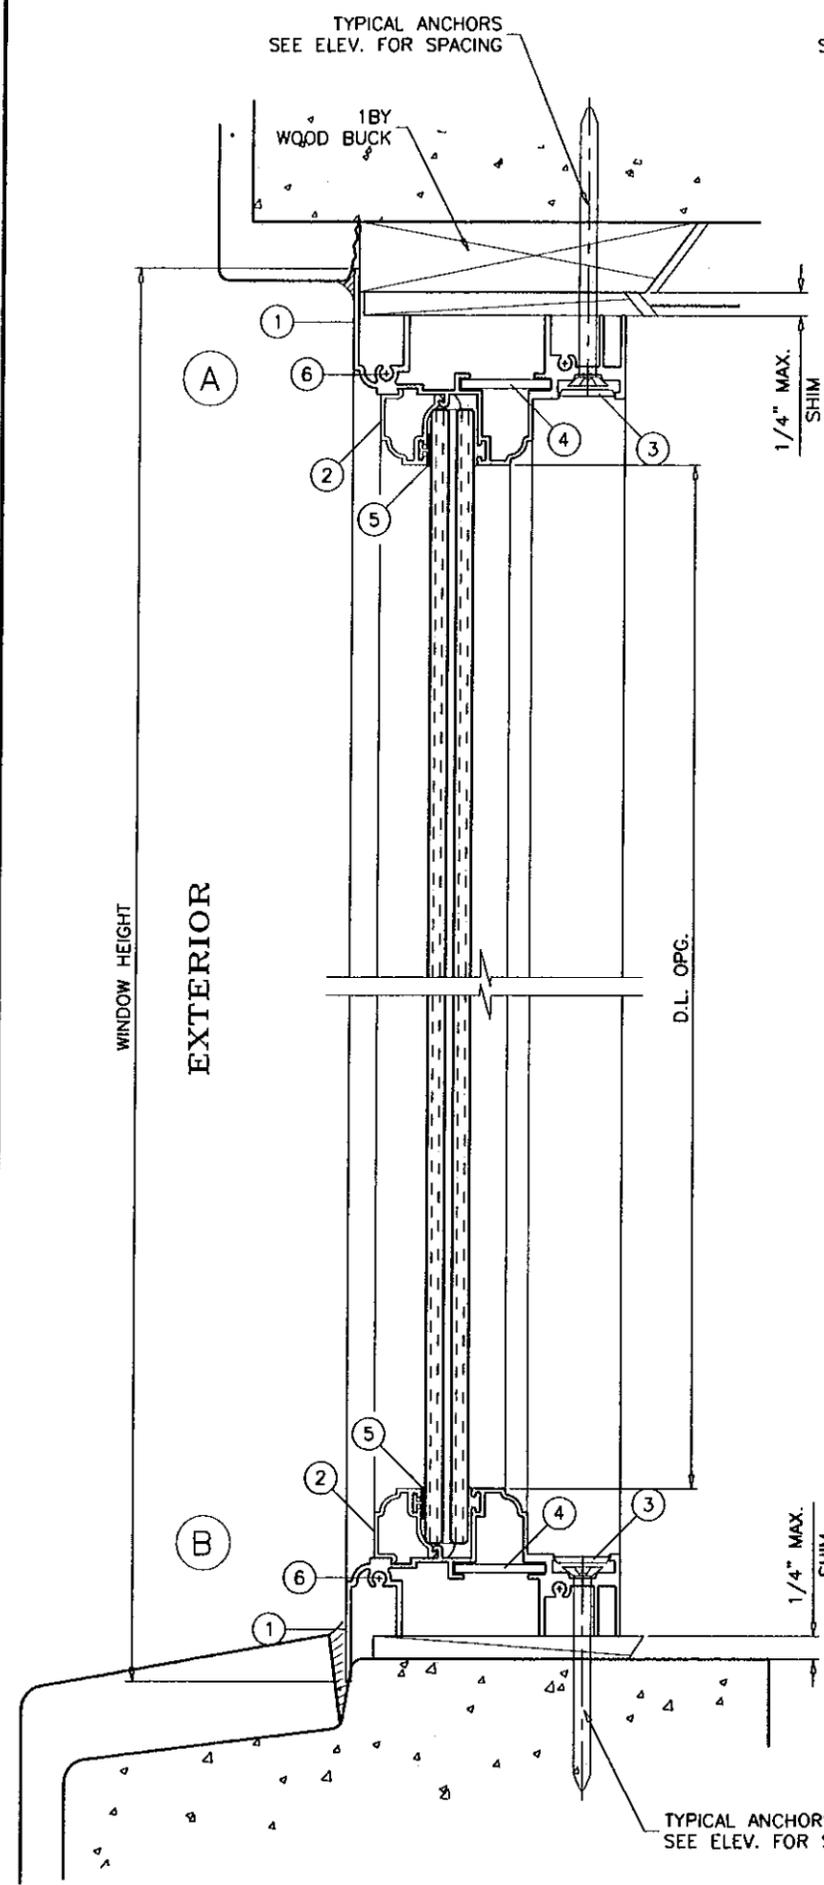

WOOD BUCKS AND METAL STRUCTURE NOT BY AWP WDW. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A'- 3/16" TAPCONS BY 'ITW'
3/16" ULTRACONS BY 'ELCO'
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

TYPE 'B'- 1/4" TAPCONS BY 'ITW'
1/4" ULTRACONS BY 'ELCO'
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

3/16" TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#10 SMS OR SELF DRILLING SCREWS
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS
 (NO SHIM SPACE)

ANCHOR EDGE DISTANCES
 INTO CONCRETE AND MASONRY = 1-1/4" MIN.
 INTO WOOD STRUCTURE = 3/4" MIN.
 INTO METAL STRUCTURE = 1/2" MIN.

SEALANTS:
 FRAME CORNERS AND INSTALLATION SCREWS SEALED WITH GE SILICONE SEALANT.

Engr: JAVAD AHMAD
 CIVIL
 FLA: PE # 70392
 C.A.N. 0808

PRODUCT REVISION:
 as complying with the Florida
 Building Code
 Acceptance No. 10-0804-05
 Expiration Date: MAR 4, 2014




Manuel Ferrer
 Miami-Dade Product Control
 Division

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL: (305) 264-8100 FAX: (305) 262-6978
 COMP-ANL\W03-39YO

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)
ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL: (305) 887-2646 FAX: (305) 883-1309

no	date	description
A	11.06.03	NO CHANGE THIS SHEET
B	01.23.04	ANCHORS REV.
C	07.12.07	UPDATED FOR 2004 FBC. NAME REV.
D	11.24.08	ANCHORS REV.
E	05.27.10	MANUF. NAME REVISED

date: 06-10-03
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:
 drawing no.
W03-39
 sheet 4 of 6

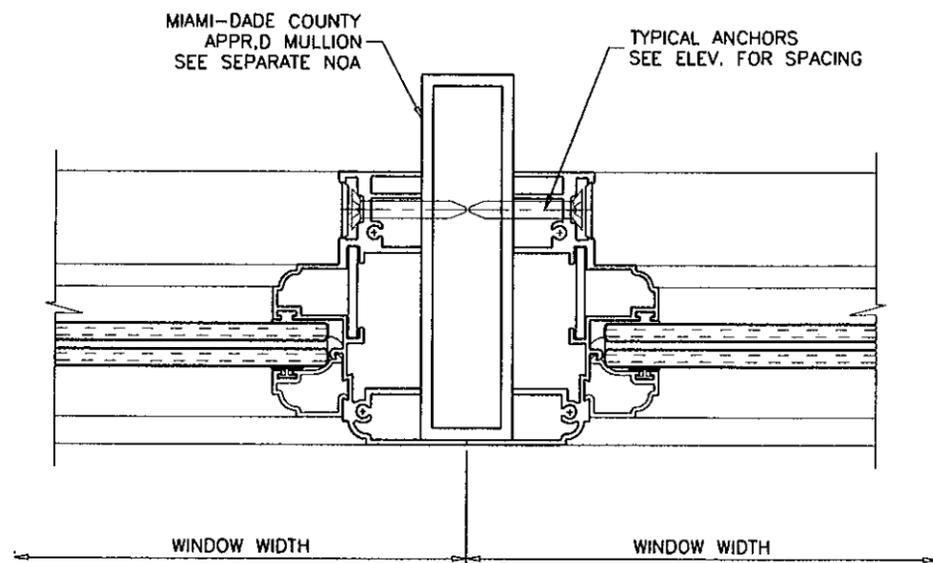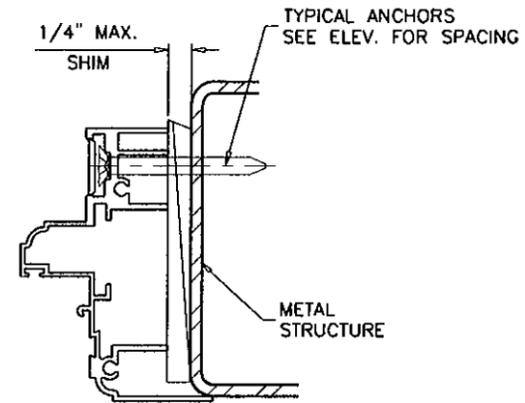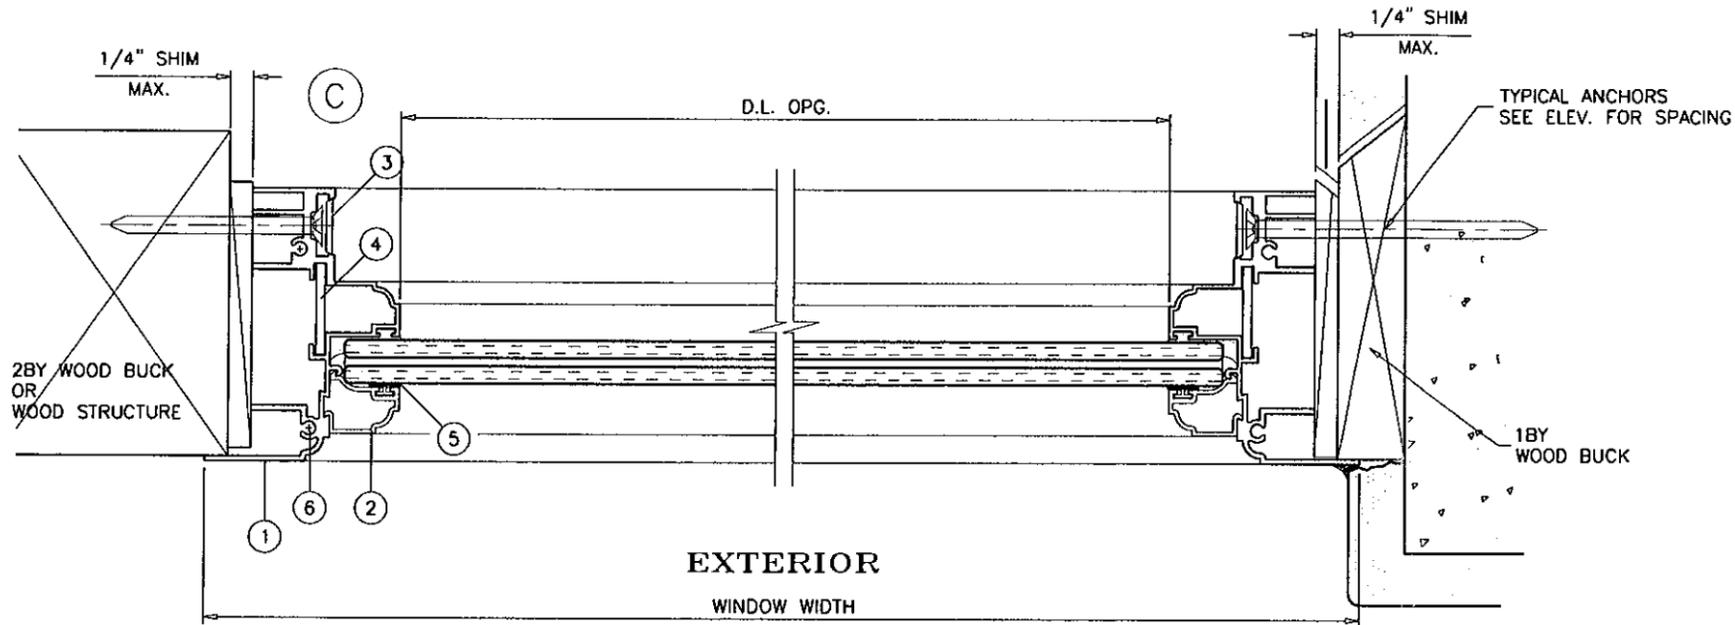

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. # 1536
 JUN 03 2010
 JA

PRODUCT REVISION
 as complying with the Florida
 Building Code
 Acceptance No. 10-0804-06
 Registration Date MARCH 4, 2014
 dr. by: HAMID
 S. Hamid
 Miami Dade Product Control
 Division

afc


AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W03-39YO

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)
 ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL 33166
 TEL (305) 887-2646 FAX (305) 883-1309


no.	date	by	description
A	11.06.03		NO CHANGE THIS SHEET
B	01.23.04		ANCHORS REV.
C	07.12.07		UPDATED FOR 2004 FBC, NAME REV.
D	11.24.08		NO CHANGE THIS SHEET
E	05.27.10		MANUF. NAME REVISED

date: 06-10-03
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W03-39
 sheet 5 of 6

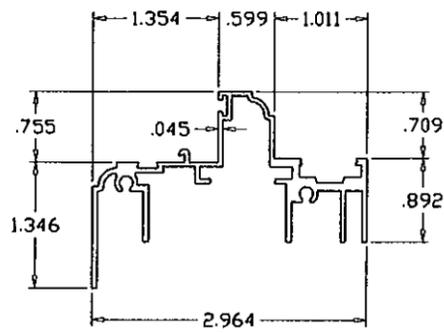


WINDOW FRAME

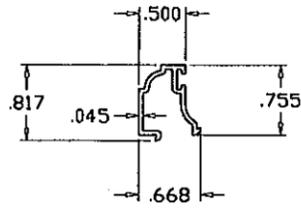


GLAZING BEAD

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	YE-68	4	WINDOW FRAME	6063-T5	-
2	YE-1405	AS REQD.	GLAZING STOP (OPTIONAL)	6063-T5	-
3	YE-816	4	COVER PLATE	6063-T5	-
4	YH-1465	4	FRAME CORNER KEY	6063-T5	-
5	YH-622	AS REQD.	GLAZING VINYL	VINYL	SULLIVAN
6	YF-10	2/ CORNER	FRAME ASSEMBLY SCREWS	-	#8 X 1" PH SMS

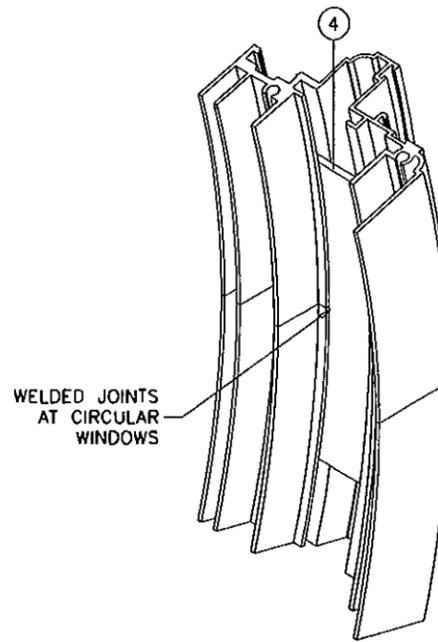

CIRCULAR WINDOWS

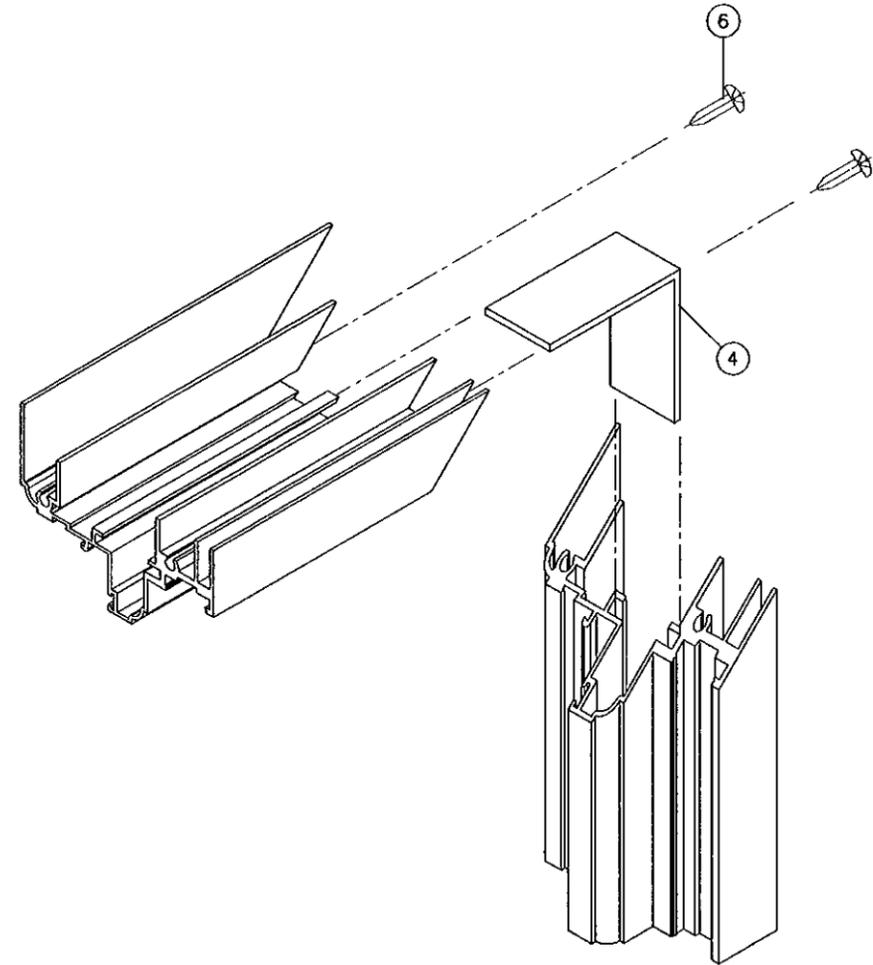

RECT. OR SQUARE WINDOWS

TYP. CORNER DETAILS

Engr. JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 JUN 03 2010

PRODUCT REVIEW
 as complying with the Florida
 Building Code
 Acceptance No. 10-0204-06
 Expiration Date MARCH 4, 2014
 by *Manuel Perez*
 Miami Dade Product Control
 Division

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL \ W03-39YO

IMPACT VIEW ALUM FIXED WDW. (L.M.I.)
 ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
A	11.06.03		FRAME ALLOY REV.
B	01.23.04		NO CHANGE THIS SHEET
C	07.12.07		UPDATED FOR 2004 FBC. NAME REV.
D	11.24.08		NO CHANGE THIS SHEET
E	05.27.10		MANUF. NAME REVISED

date: 06-10-03
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W03-39
 sheet 6 of 6