



**BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION**
11805 SW 26th Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/building

Epsilon Concept, Inc.
2880 NE 7th Avenue
Pompano Beach, FL 33064

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Section and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Epsilon WW20" Window Wall System – L.M.I.

APPROVAL DOCUMENT: Drawing No. T-001, titled "Series WW20 Series Window Wall Small Missile Impact", sheets 1 through 11 of 11, dated 04/15/09 with revision "R2" dated 09/23/10, prepared by Structural Design, Inc., signed and sealed by Farrokh Rasekhi, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LIMITATIONS: The Maximum Design Pressure Rating shall be ± 110.00 psf.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, Quebec, Canada and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA No. 09-1209.08 and consists of this page 1, evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
2/24/11

NOA No. 10-0812.01
Expiration Date: September 01, 2015
Approval Date: February 24, 2011
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **T-001**, titled "Series WW20 Series Window Wall Small Missile Impact", sheets 1 through 11 of 11, dated 04/15/09 with revision "**R2**" dated 09/23/10, prepared by Structural Design, Inc., signed and sealed by Farrokh Rasekhi, P. E.

B. TESTS


1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of Aluminum Window Wall System, prepared by Fenestration testing Laboratory, Inc., Test Report No. **FTL-6037**, dated 11/11/09, signed and sealed by Julio E. Gonzalez, P. E.
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Small Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of Aluminum Window Wall System, prepared by Fenestration testing Laboratory, Inc., Test Report No. **FTL-6038**, dated 05/17/10, signed and sealed by Jorge A. Causo, P. E.
(Submitted under previous NOA No.09-1209.08)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Structural Design, Inc., dated 08/05/10, signed and sealed by Farrokh Rasekhi, P. E.
Complies with ASTM E1300-04

D. QUALITY ASSURANCE

1. Miami-Dade Building and Neighborhood Compliance Department (BNC).



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 10-0812.01
Expiration Date: September 01, 2015
Approval Date: February 24, 2011

Epsylon Concept, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **10-0413.04** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/26/2010, expiring on 01/14/12.
2. TREMCO Part No. **TR-14271E** EPDM exterior glazing setting block complying with ASTM D412 1800 to 1900 PSI, ASTM D395B 22 HRS 100°F 26 to 30%, ASTM D2240 Shore "A" Hardness 82 to 85 Durometer, ASTM D624 Tear Strength 125 to 158 lb/ in, ASTM D746 Brittleness Temperature at -40°F Passed and ASTM C1166 Flame Propagation, Option II with No Limits.

E. STATEMENTS

1. Statement letter of no financial interest, dated November 23, 2009, signed and sealed by Farrokh Rasekhi, P. E.
(Submitted under previous NOA No.09-1209.08)
2. Statement letter of conformance and compliance with the FBC-2007, dated November 23, 2009, signed and sealed by Farrokh Rasekhi, P. E.
(Submitted under previous NOA No.09-1209.08)
3. Laboratory compliance letter for Test Report No. **FTL-6037**, issued by Fenestration testing Laboratory, Inc., dated November 11, 2009, signed and sealed Julio E. Gonzalez, P. E.
4. Laboratory compliance letter for Test Report No. **FTL-6038**, issued by Fenestration testing Laboratory, Inc., dated June 07, 2010, signed and sealed by Jorge A. Causo, P. E.
(Submitted under previous NOA No.09-1209.08)
5. Distributor Agreement between Epsylon Concept, Inc., Quebec, Canada and Global Performance Window, Inc., Pompano Beach, Florida, U.S.A., dated 06/30/10, signed by Alain LeFrancois and Jean LeFrancois, respectively.
(Submitted under previous NOA No.09-1209.08)
6. Asset agreement, dated July 09, 2008, signed by Mr. Alain LeFrancois and Mr. Jean LeFrancois, respectively.
(Submitted under previous NOA No.09-1209.08)
7. Proposal No. **09-01308** issued by BCCO, dated October 15, 2009, signed by Renzo Narciso.
(Submitted under previous NOA No.09-1209.08)


F. OTHERS

1. Notice of Acceptance No. **09-1209.08**, issued to Epsylon Concept, Inc. for their Series "**Epsylon WW20**" Window Wall System - S.M.I.", approved on 09/01/10 and expiring on 09/01/15.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 10-0812.01
Expiration Date: September 01, 2015
Approval Date: February 24, 2011

REVISIONS:	BY:
R1 07/28/2010	O.S.
R2 09/23/2010	O.S.

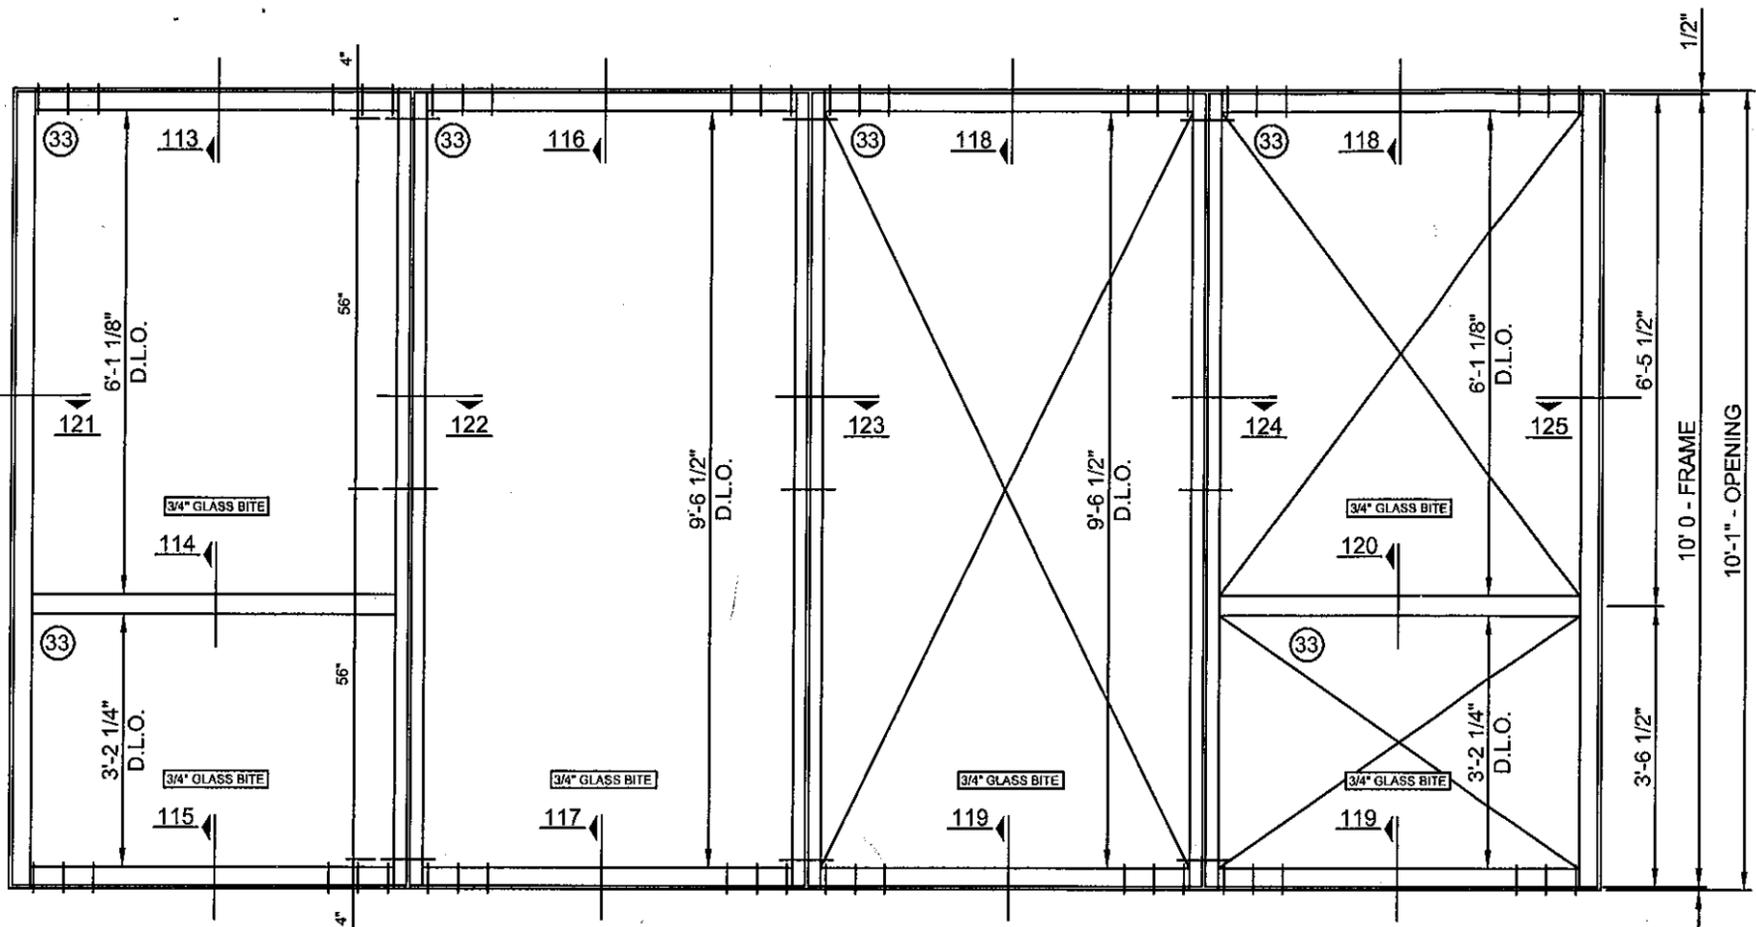

EPSYLON - WINDOW WALL SYSTEM (L.M.I.)

THIS SYSTEM IS RATED FOR LARGE MISSILE IMPACT.
 MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS NOT REQUIRED.

GENERAL NOTES :

9/16" LAMINATED GLASS: 1/4" CLEAR HEAT STRENGTHENED GLASS
 0.090" SENTRY GLASS PLUS (DUPONT)
 1/4" CLEAR HEAT STRENGTHENED GLASS
 LAMINATED BY VIRACON

ALL ALUMINUM IS 6063-T6

MAXIMUM GLASS DIMENSION : 57 11/16" x 115 15/16"

GLAZING PENETRATION (GLASS BITE) INDICATED ON ELEVATION

1/2" MAXIMUM SHIM SPACE

CONCRETE APPLICATION : 3000 PSI

SEE TEST REPORT FOR EXACT LOCATIONS OF SEALANT


REFER TO BILL OF MATERIAL FOR COMPLETE DESCRIPTION FOR ALL PRODUCTS

THE MINIMUM EDGE DISTANCE TO USE FULL CAPACITY OF 3/8" WEDGE BOLT IS 4 1/2"

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

SEALANT USED IN MOCK-UPS:

- MOCK-UP # 1 : TREMCO - PROGLAZE 2 - A2 & A3
- MOCK-UP # 2 : TREMCO - PROGLAZE 2 - A2 & A3
- MOCK-UP # 3 : G.E. - SSG 4700 - A1

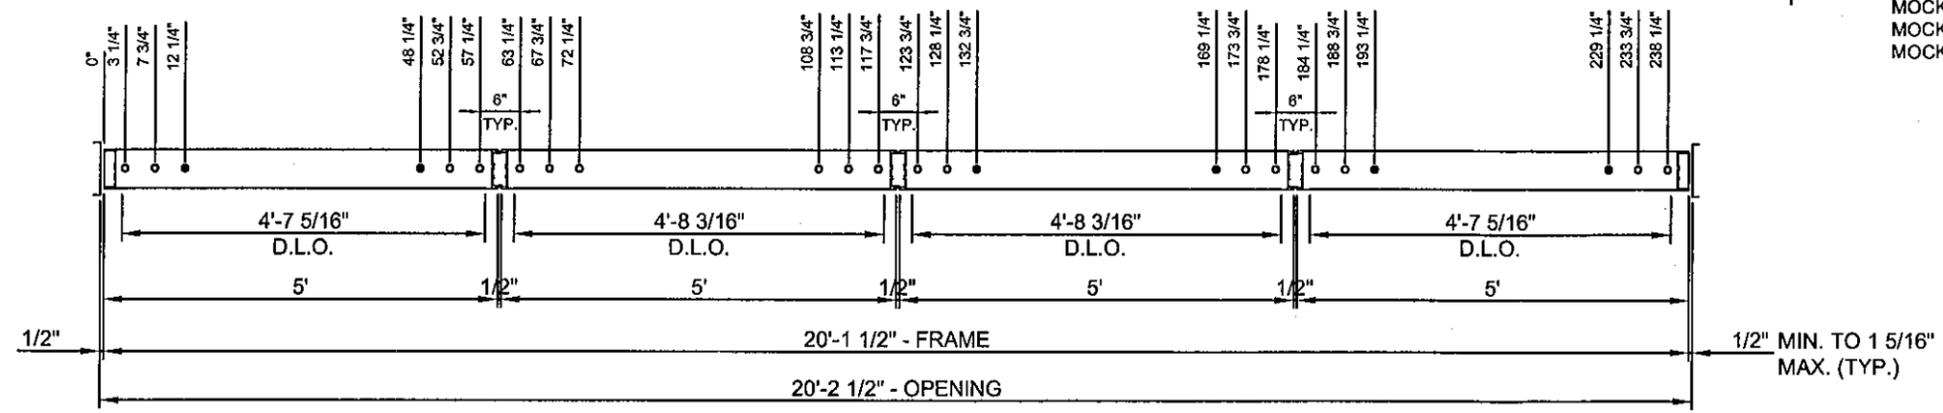

● ADD THESE ANCHORS ONLY FOR 1/2" GAP

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 10-08/2.01
 Expiration Date 09/01/2015
 By [Signature]
 Miami Dade Product Control


STRUCTURAL DESIGN INC.
 CONSULTING STRUCTURAL ENGINEERS
 9595 N. KENDALL DR. SUITE NO. 200
 MIAMI, FLORIDA 33176 CERTIFICATE # 8803
 10/10/10
 TEL: (305) 595-8965 FAX: (305) 595-8966
 FARROKH RASEKHI, P.E. FL. REG. #38001




TITLE:
 SERIES WW20
 WINDOW WALL
 ELEVATION
 LARGE MISSILE IMPACT
 +110 / -110 PSF

SCALE: 1/2" = 1'-0"	DRAWN BY: D. LABBÉ	
DATE: 2009-04-15	DWG NO. T-001	PAGE 01

REVISIONS:	BY:
R1 07/28/2010	O.S.
R2 09/23/2010	O.S.

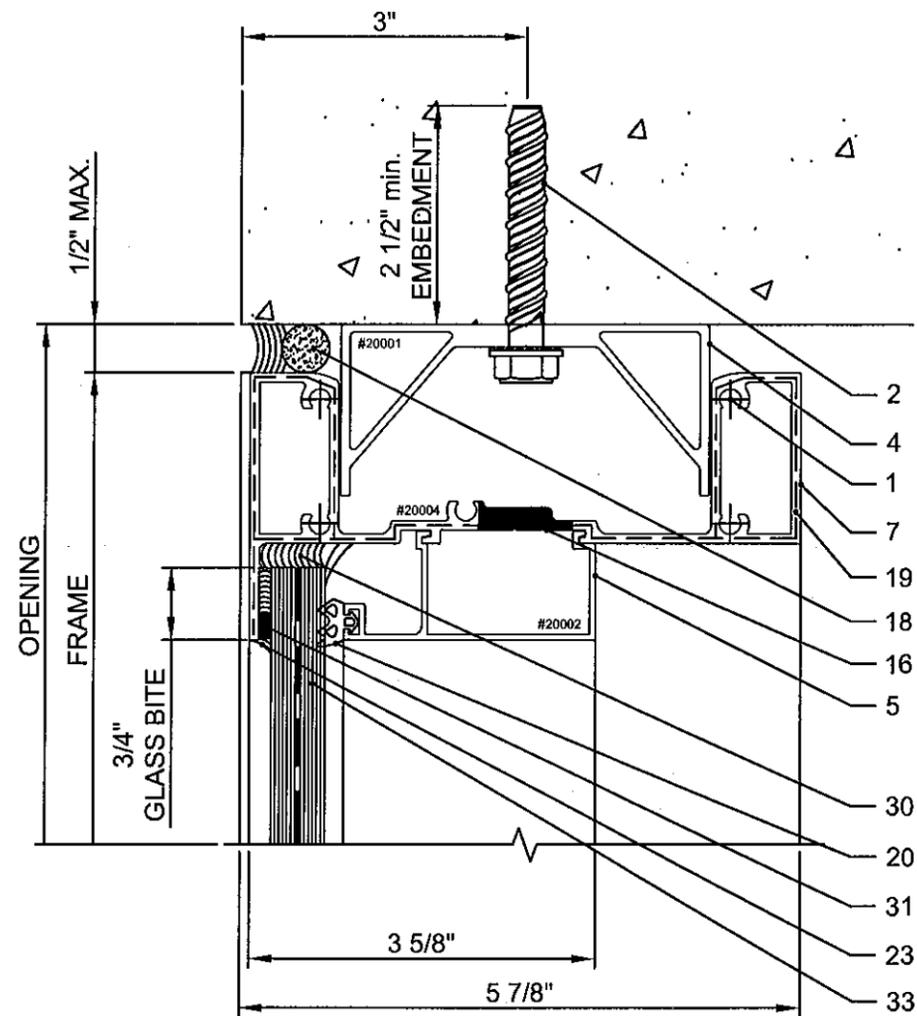

detail 113

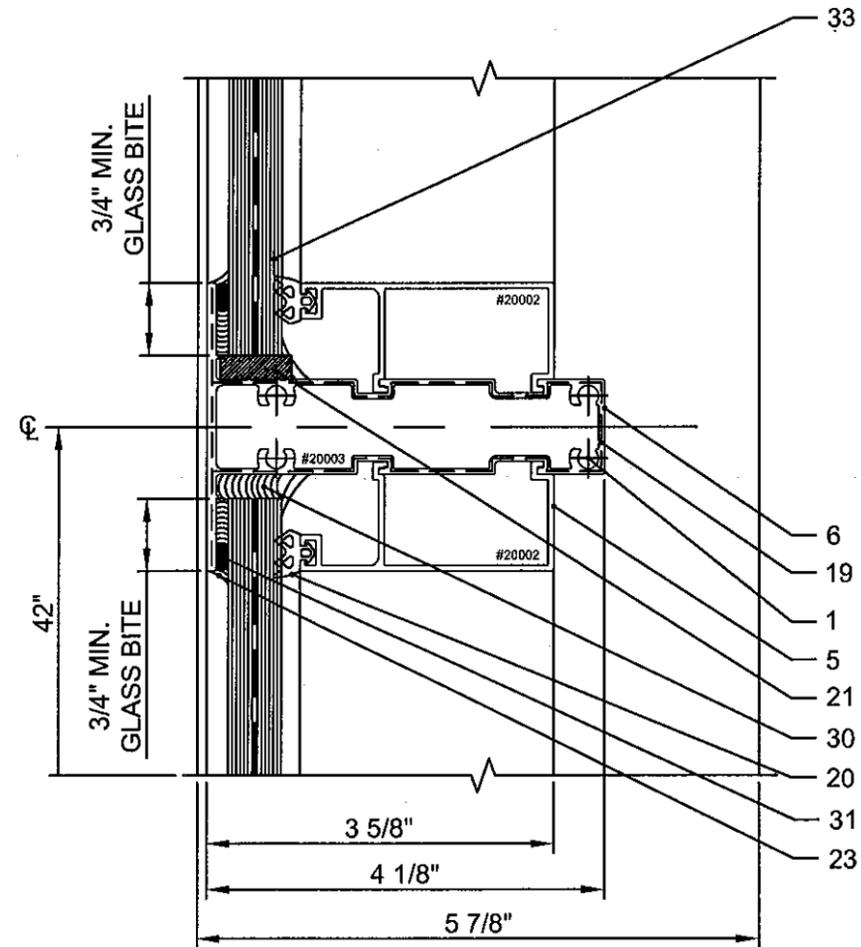

detail 114


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 18-98/2.01
Expiration Date 8/18/2015
By *[Signature]*
Miami Dade Product Control

STRUCTURAL DESIGN INC.
CONSULTING STRUCTURAL ENGINEERS
959 N. KENDALL DR. SUITE NO. 209
MIAMI, FLORIDA 33176 CERTIFICATE # 8803
[Signature]
10/10/10
TEL: (305) 595-8985. FARROKH RASEKHI, P.E.
FAX: (305) 595-8968. FL. REG. #38001




TITLE:
**SERIES WW20
WINDOW WALL
DETAILS #113 & 114
LARGE IMPACT**

SCALE: 6" = 1'-0"	DRAWN BY: D. LABBÉ	
DATE: 2009-04-15	DWG NO. T-001	PAGE 02

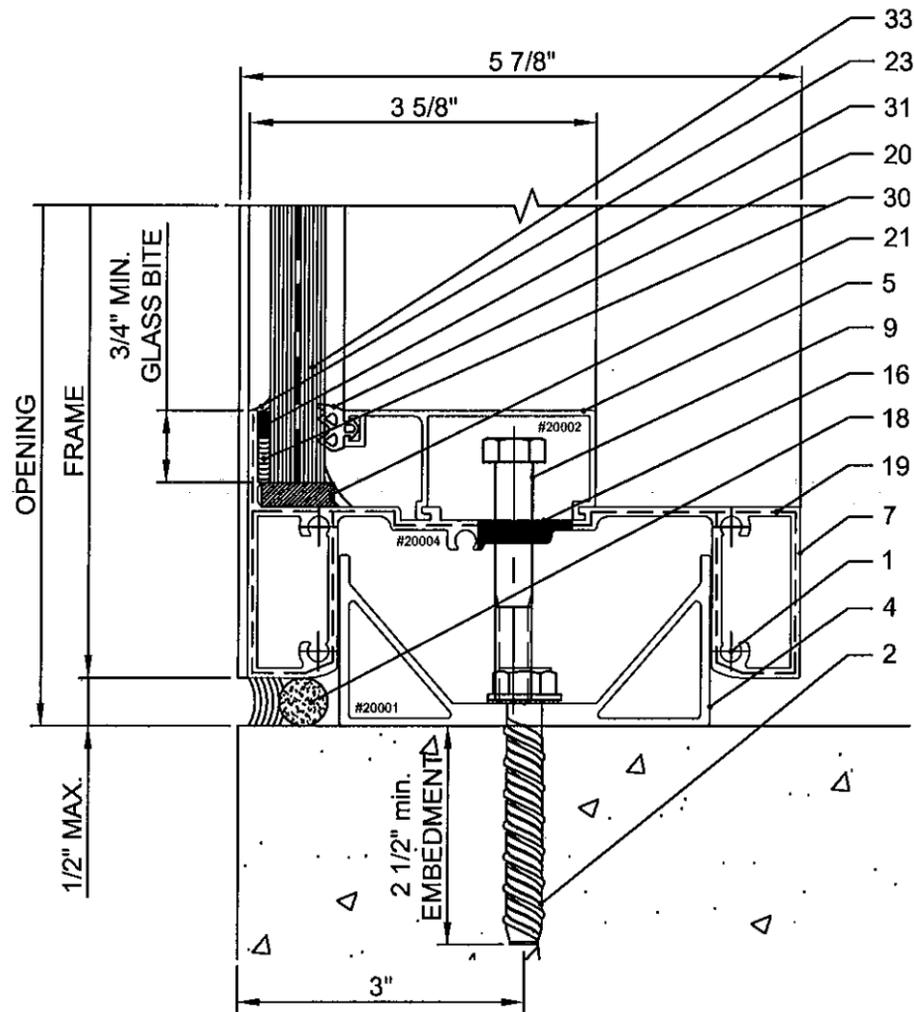

detail 115

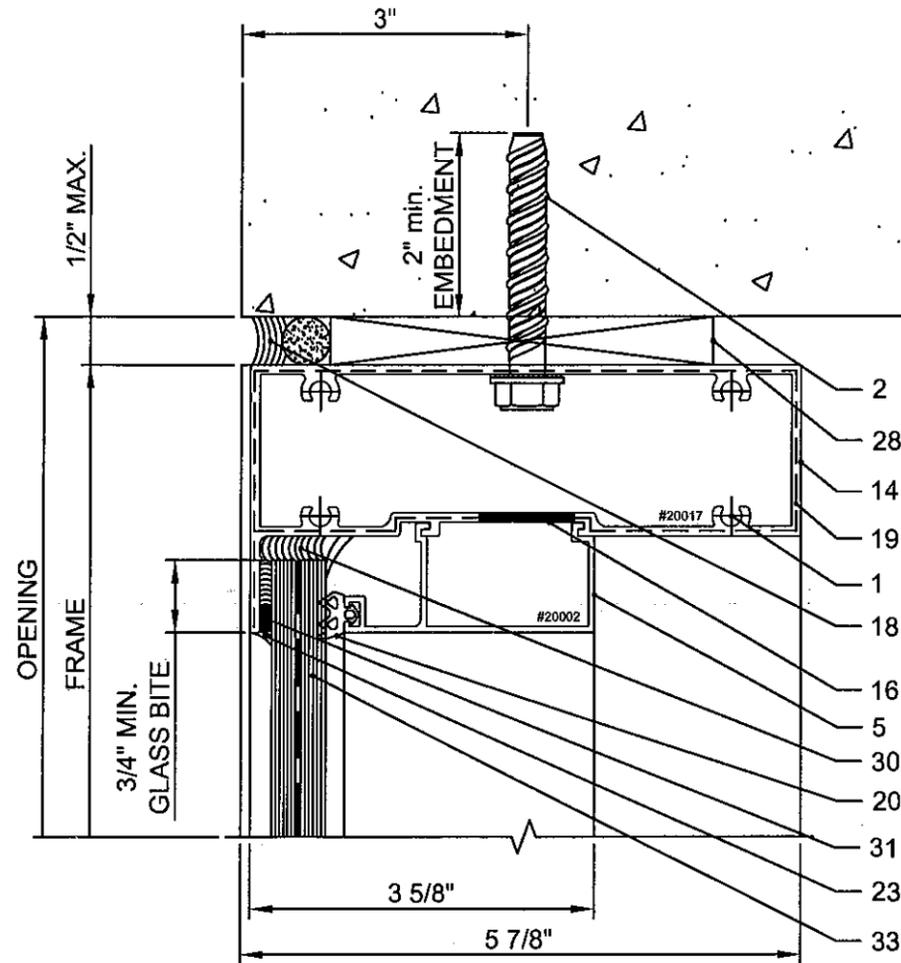

detail 116

REVISIONS:	BY:
R1 07/28/2010	O.S.
R2 09/23/2010	O.S.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 10-0812.01
 Expiration Date 09/01/2015
 By: *[Signature]*
 Miami Code Product Control


STRUCTURAL DESIGN INC.
 CONSULTING STRUCTURAL ENGINEERS
 9595 N. KENDALL DR. SUITE NO. 209
 MIAMI, FLORIDA 33176 CERTIFICATE # 8803
[Signature]
 10/10/10
 TEL: (305) 695-8965 FARROKH RASEKHI, P.E.
 FAX: (305) 695-8966 FL. REG. #38001




TITLE:
 SERIES WW20
 WINDOW WALL
 DETAILS #115 & 116
 LARGE IMPACT

SCALE: 6" = 1'-0"	DRAWN BY: D. LABBÉ	
DATE: 2009-04-15	DWG NO. T-001	PAGE 03

REVISIONS:	BY:
R1 07/28/2010	O.S.

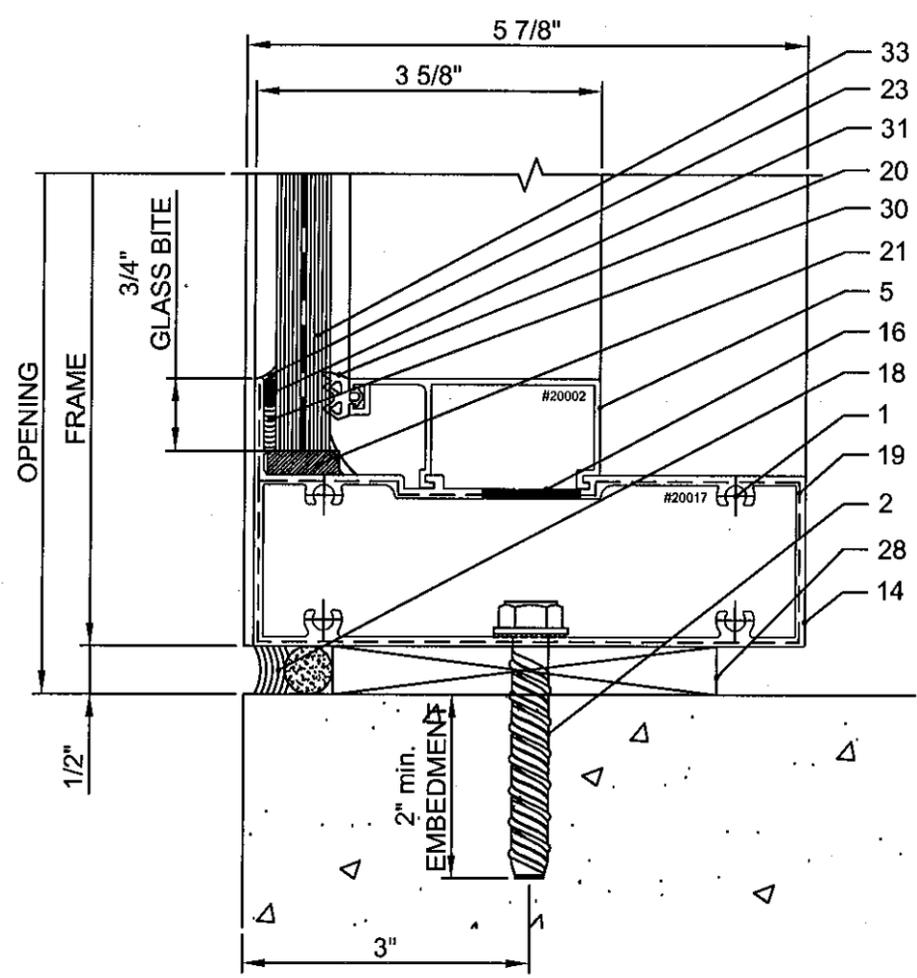

detail 117

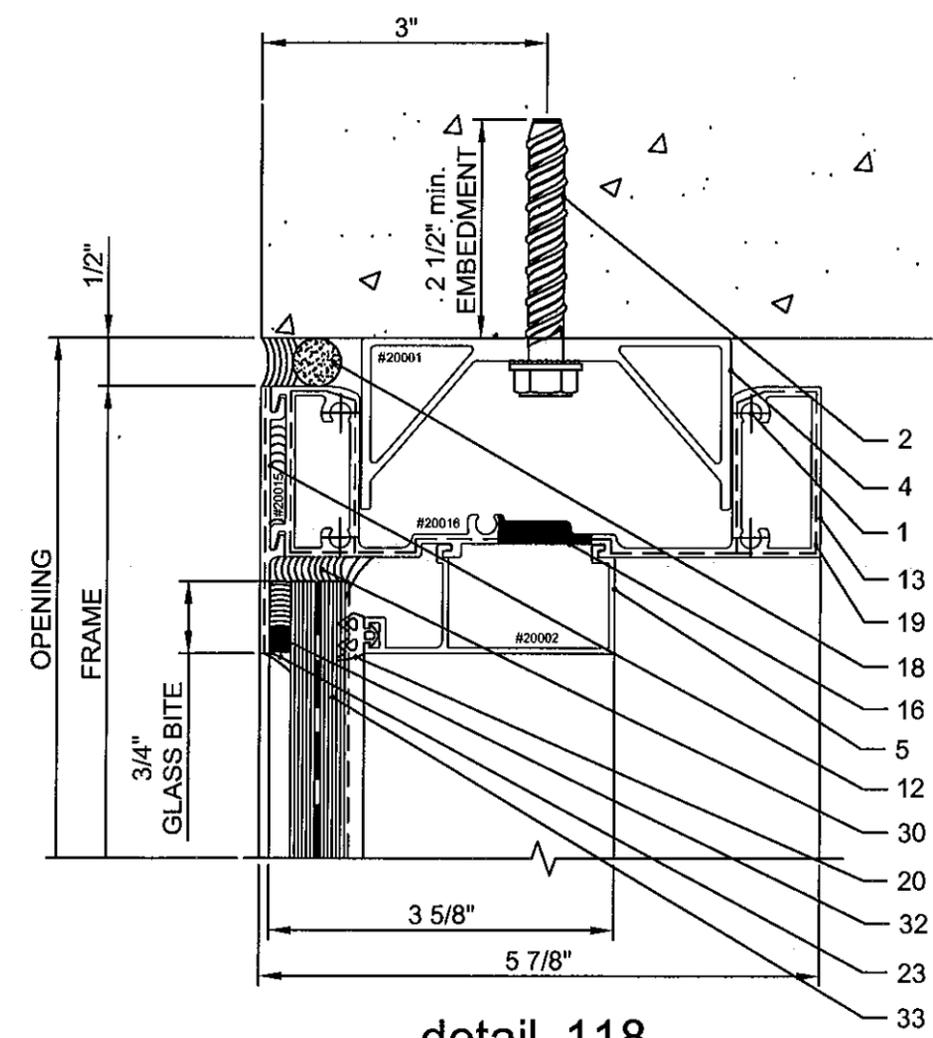

detail 118

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 10-08/2.01
Expiration Date 09/01/2015
By [Signature]
Miami Dade Product Control


STRUCTURAL DESIGN INC.
CONSULTING STRUCTURAL ENGINEERS
9595 N. KENDALL DR., SUITE NO. 209
MIAMI, FLORIDA 33176 CERTIFICATE #: 8803
[Signature]
10/10/10
TEL: (305) 595-8965 FARROKH RASEKHI, P.E.
FAX: (305) 595-8966 FL. REG. #38001




TITLE:
**SERIES WW20
WINDOW WALL
DETAILS #117 & 118
LARGE IMPACT**

SCALE: 6" = 1'-0"	DRAWN BY: D. LABBÉ	
DATE: 2009-04-15	DWG NO. T-001	PAGE 04

REVISIONS:	BY:
R1 07/28/2010	O.S.

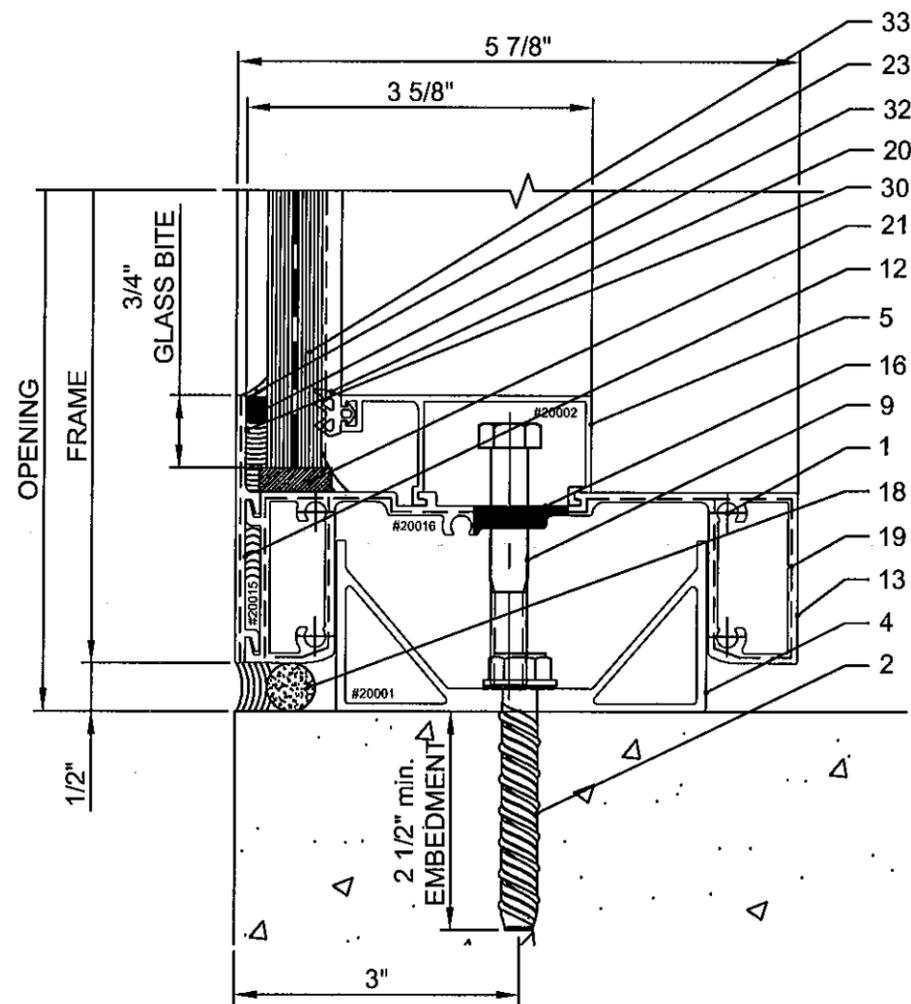

detail 119

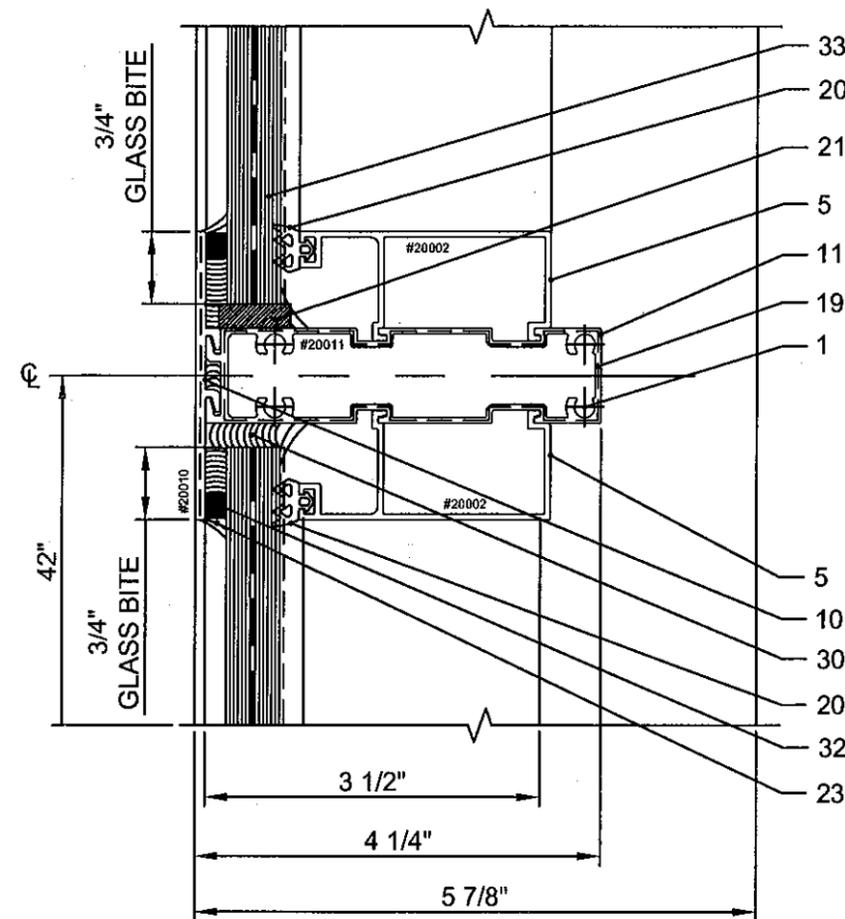

detail 120


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 18-0812-01
Expiration Date 8/7/2015
By [Signature]
Miami Dade Product Control

STRUCTURAL DESIGN INC.
CONSULTING STRUCTURAL ENGINEERS
9595 N. KENDALL DR. SUITE NO. 203
MIAMI, FLORIDA 33178 CERTIFICATE #: 8803
[Signature]
10/10/10
TEL: (305) 595-8966 FARROKH RASEKHI, P.E.
FAX: (305) 595-8966 FL. REG. #38001




TITLE:
**SERIES WW20
WINDOW WALL
DETAILS #119 & 120
LARGE IMPACT**

SCALE: 6" = 1'-0"	DRAWN BY: D. LABBÉ	
DATE: 2009-04-15	DWG NO. T-001	PAGE 05

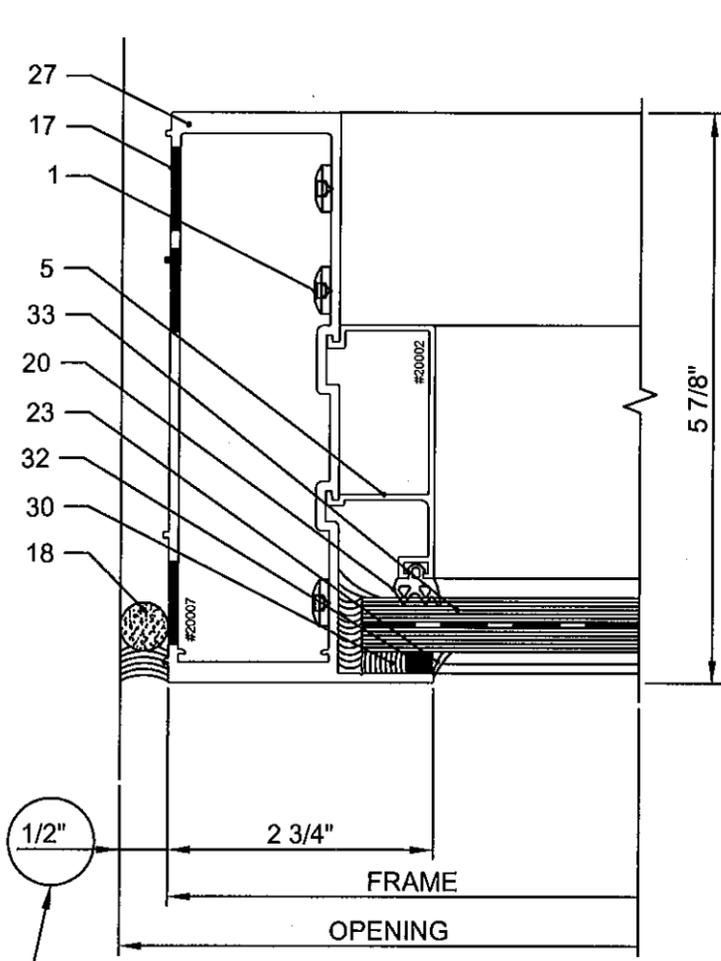

detail 121

SEE ELEV. FOR
MAX. GAP

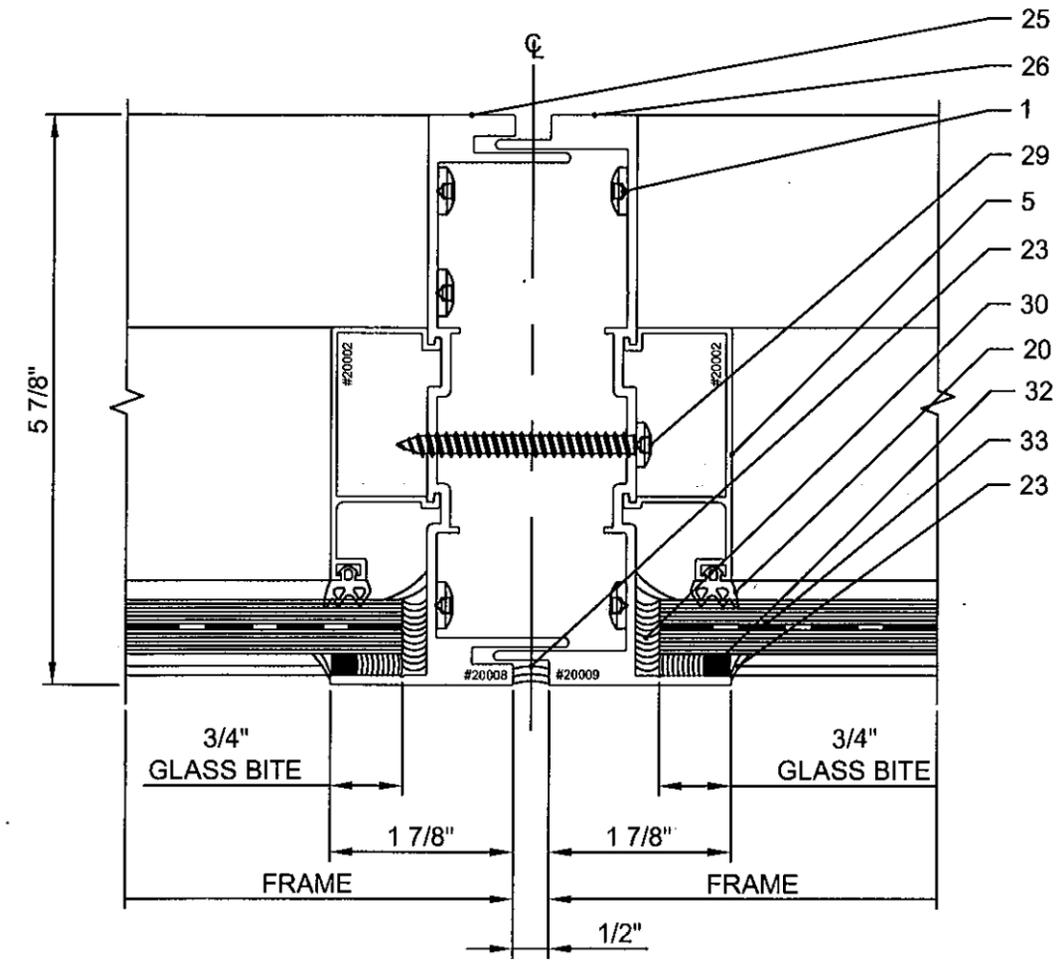

detail 122

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 10-08/2.01
Expiration Date 09/01/2015
By *[Signature]*
Miami Dade Product Control

STRUCTURAL DESIGN INC.
CONSULTING STRUCTURAL ENGINEERS
9595 N. KENDALL DR. SUITE NO. 209
MIAMI, FLORIDA 33176 CERTIFICATE #: 8803
[Signature]
10/10/10
TEL: (305) 595-8965 FARROKH RASEKHI, P.E.
FAX: (305) 595-8966 FL. REG. #38001




TITLE:


SERIES WW20
WINDOW WALL
DETAILS #121 & 122
LARGE IMPACT

SCALE: 6" = 1'-0"	DRAWN BY: D. LABBÉ	
DATE: 2009-04-15	DWG NO. T-001	PAGE 06

REVISIONS:	BY:
R1 07/28/2010	O.S.

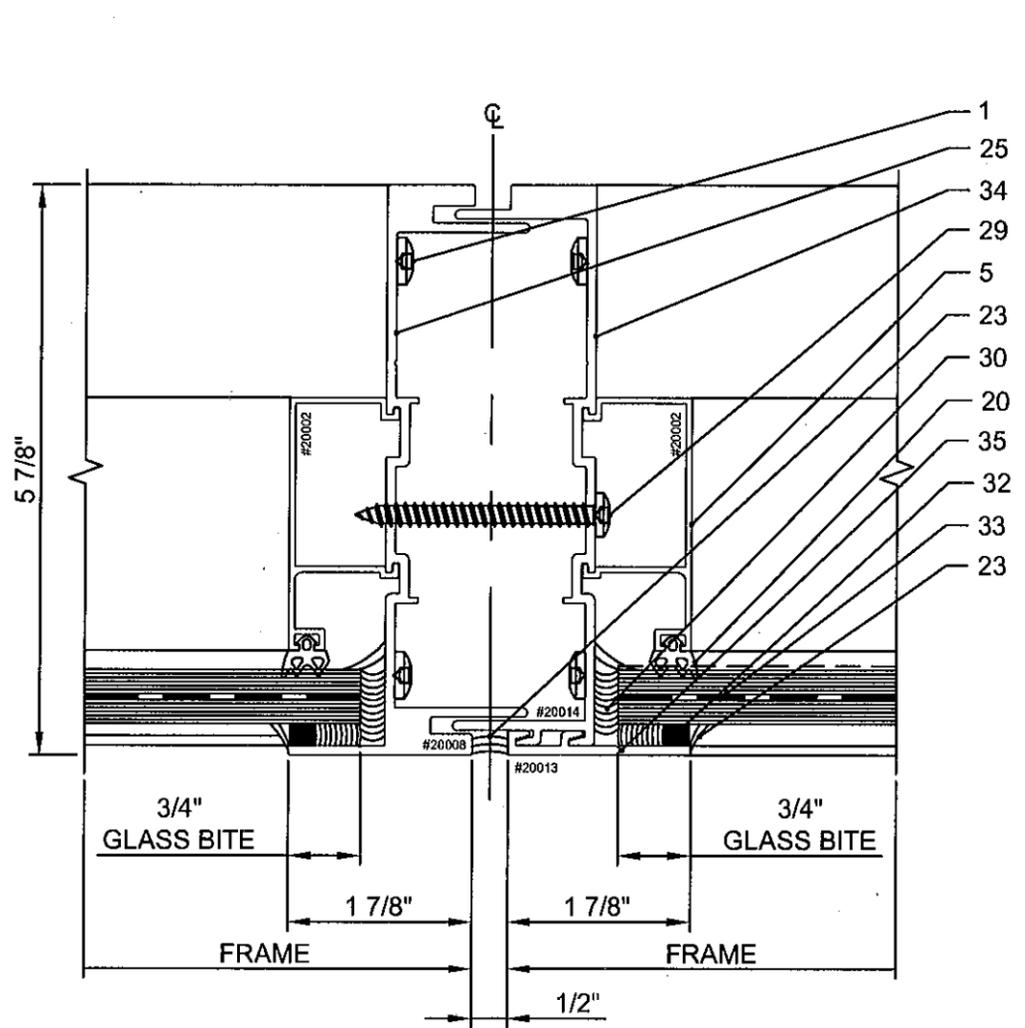

detail 123

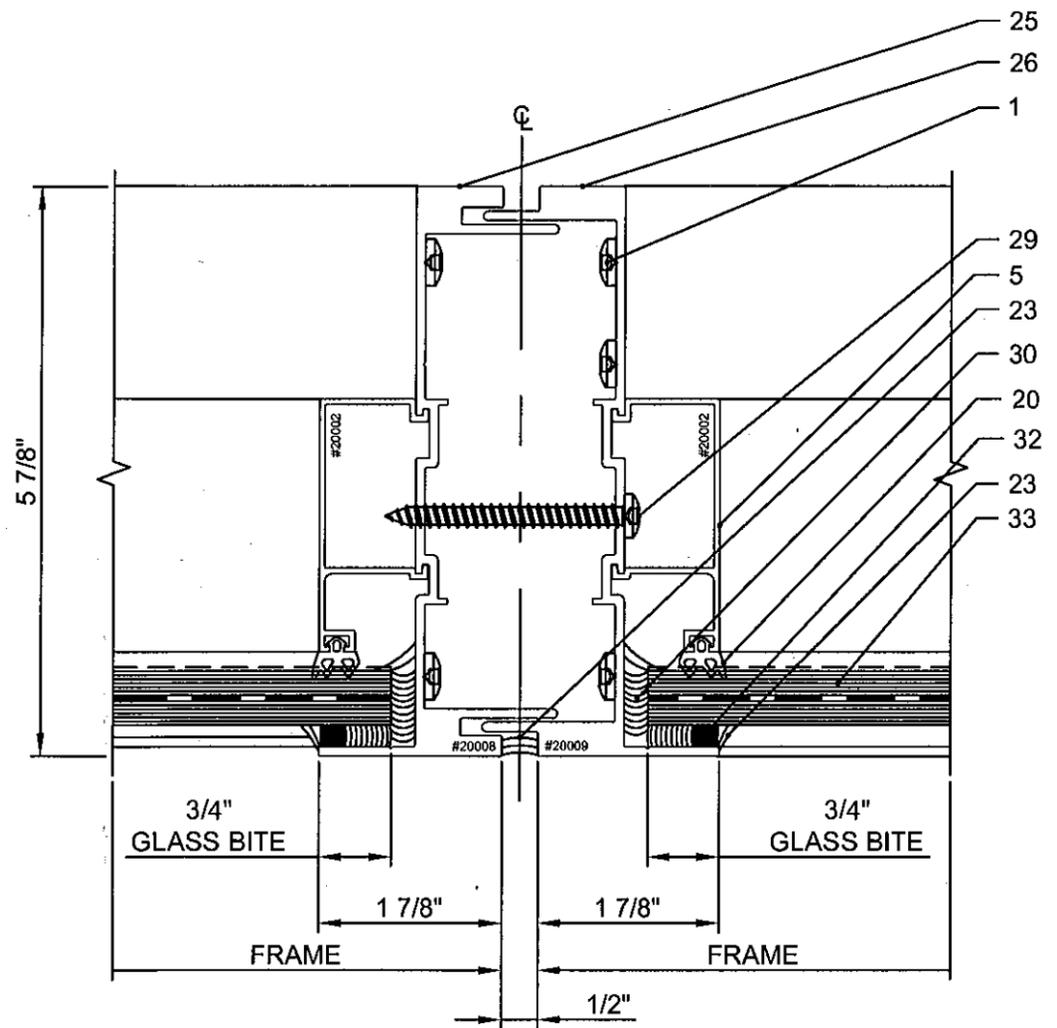

detail 124

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 10-0812.01
Expiration Date 09/01/2015
By: *[Signature]*
Miami Dade Product Control


STRUCTURAL DESIGN INC.
CONSULTING STRUCTURAL ENGINEERS
9595 N. KENDALL DR. SUITE NO. 209
MIAMI, FLORIDA 33176 CERTIFICATE # 8803
[Signature]
10/10/10
TEL: (305) 695-8965 FARROKH FASEKHI, P.E.
FAX: (305) 695-8966 FL. REG. #38001



TITLE:
**SERIES WW20
WINDOW WALL
DETAILS #123 & 124
LARGE IMPACT**

SCALE: 6" = 1'-0"	DRAWN BY: D. LABBÉ	
DATE: 2009-04-15	DWG NO. T-001	PAGE 07

REVISIONS:	BY:
R1 07/28/2010	O.S.
R2 09/23/2010	O.S.

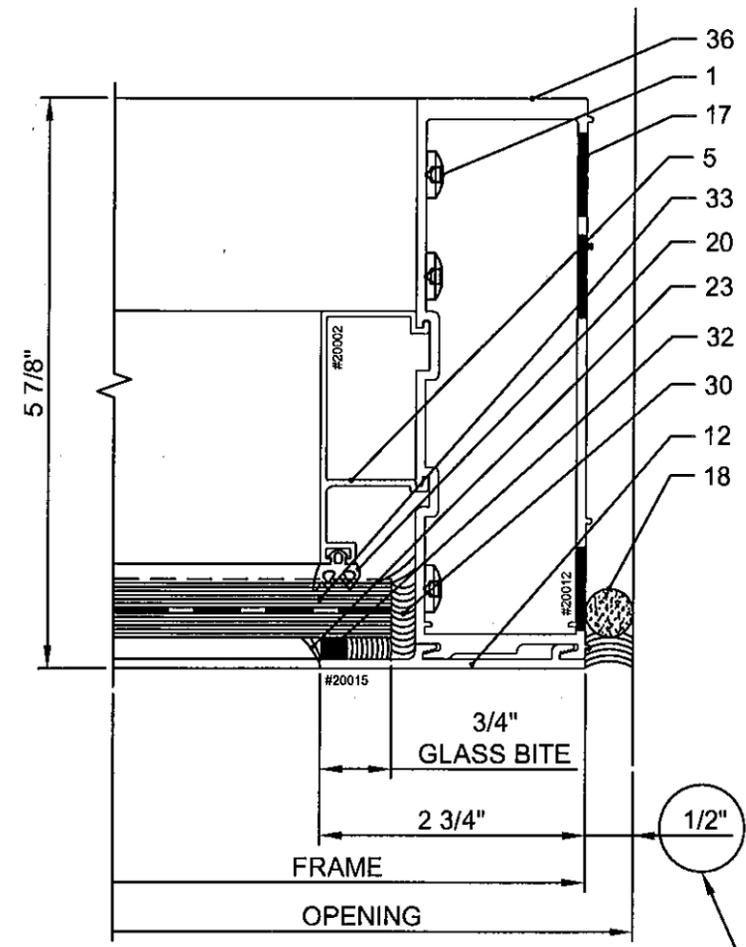

detail 125

SEE ELEV. FOR
MAX. GAP

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **10-0812.01**
Expiration Date **09/31/2015**
By: *[Signature]*
Miami Dade Product Control


S STRUCTURAL DESIGN **I**NC.
CONSULTING STRUCTURAL ENGINEERS
9595 N. KENDALL DR. SUITE NO. 209
MIAMI, FLORIDA 33176 CERTIFICATE # 8803
[Signature]
10/10/10
TEL: (305) 595-8965 FARROKH RASEKHI, P.E.
FAX: (305) 595-8966 FL. REG. #38001




TITLE:

SERIES WW20
WINDOW WALL
DETAIL #125
LARGE IMPACT


SCALE: 6" = 1'-0"	DRAWN BY: D. LABBÉ	
DATE: 2009-04-15	DWG NO. T-001	PAGE 08

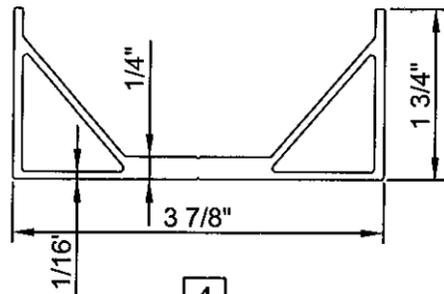


4
20 001
ALUMINUM ANCHOR

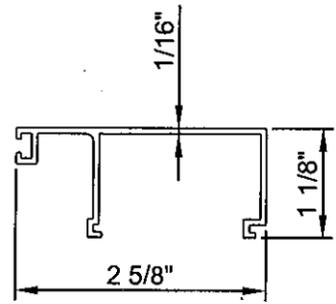


5
20 002
ALUMINUM SNAP-ON CAP

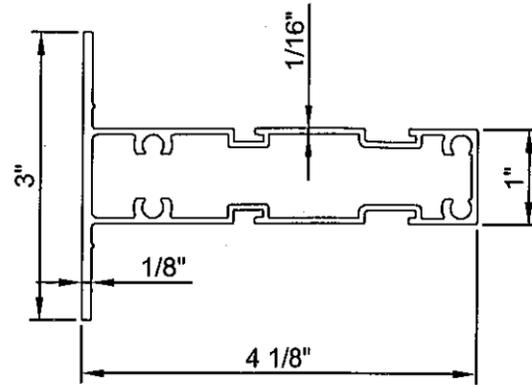


6
20 003
ALUMINUM HORIZONTAL MULLION

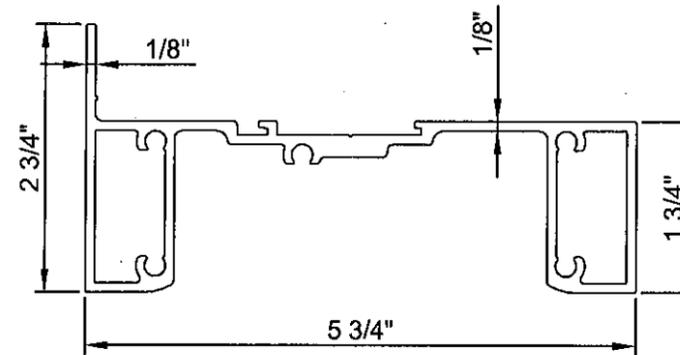


7
20 004
ALUMINUM FRAME HEAD / SILL

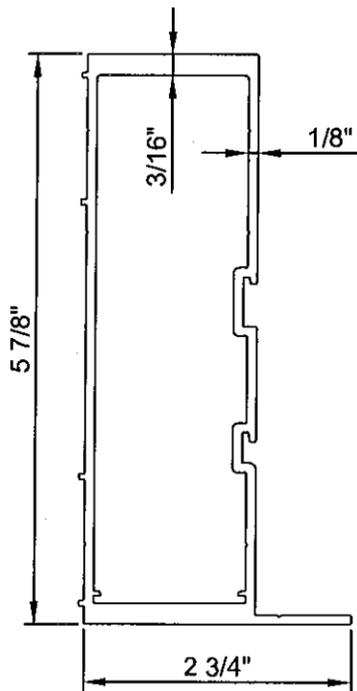


27
20 007
ALUMINUM JAMB

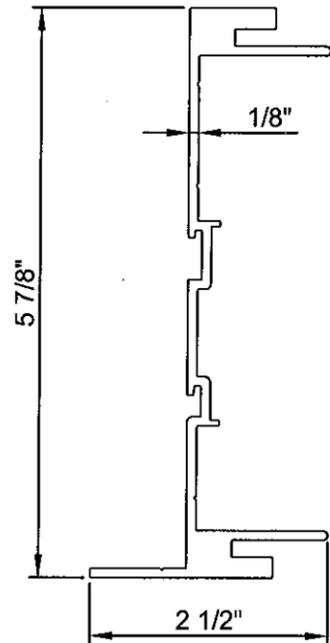


25
20 008
ALUMINUM SPLIT MULLION
(FEMALE)

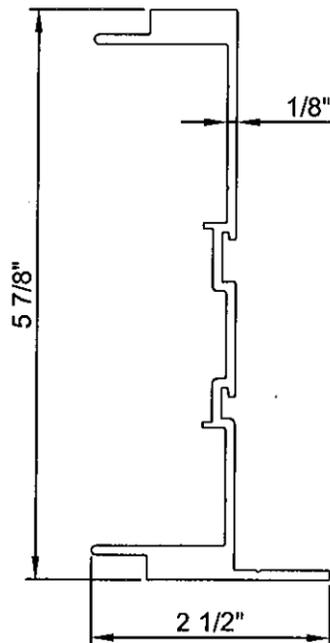


26
20 009
ALUMINUM SPLIT MULLION
(MALE)

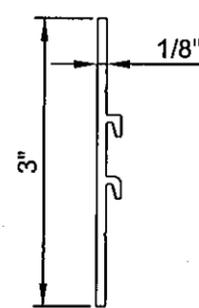


10
20 010
ALUMINUM HORIZONTAL
MULLION SPANDREL CAP

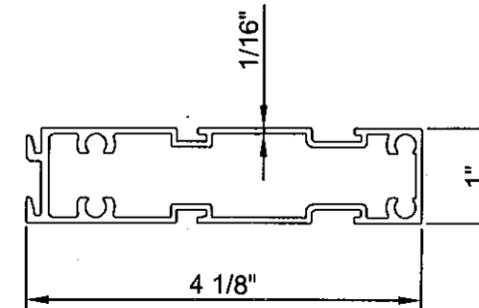

11
20 011
ALUMINUM HORIZONTAL
MULLION (SPANDREL)



12
20 015
ALUMINUM FRAME
SPANDREL CAP

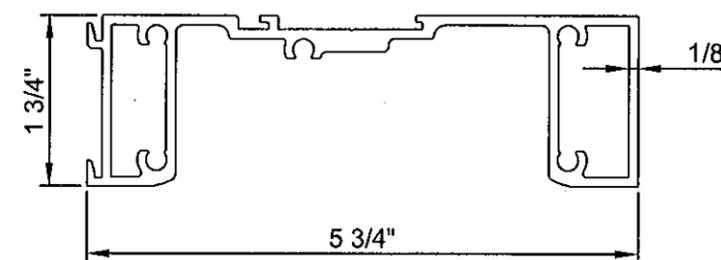


13
20 016
ALUMINUM FRAME HEAD / SILL
(SPANDREL)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **10-0812.01**
Expiration Date **09/01/2016**
By *[Signature]*
Miami Dade Product Control


STRUCTURAL DESIGN INC.
CONSULTING STRUCTURAL ENGINEERS
9595 N. KENDALL DR. SUITE NO. 209
MIAMI, FLORIDA 33178 CERTIFICATE #: 8803
[Signature]
10/10/10
TEL: (305) 595-8966 FARROKH RASEKHI, P.E.
FAX: (305) 595-8966 FL. REG. #38001




TITLE:
**SERIES WW20
WINDOW WALL
LIST OF EXTRUSIONS
(PART 1)**




20
90 500
EPDM GASKET




35
20 013
ALUMINUM SPLIT MULLION
SPANDREL CAP

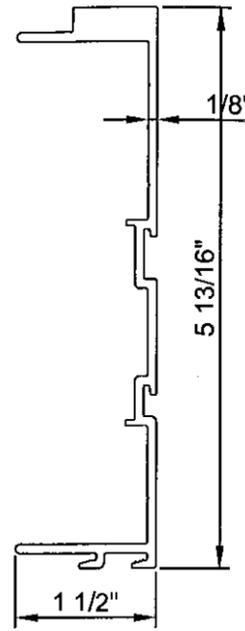

34
20 014
ALUMINUM SPLIT MULLION
(SPANDREL)

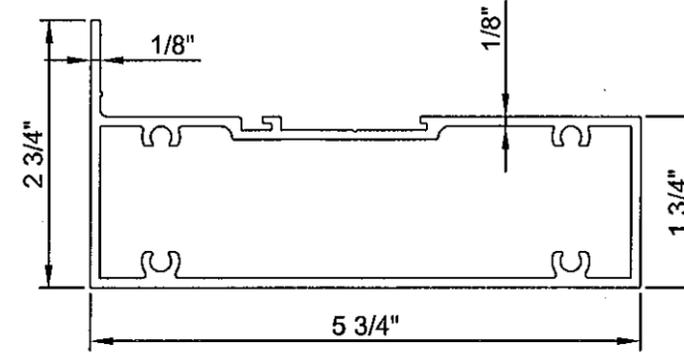

14
20 017
ALUMINUM FRAME HEAD / SILL
(OPTIONAL)

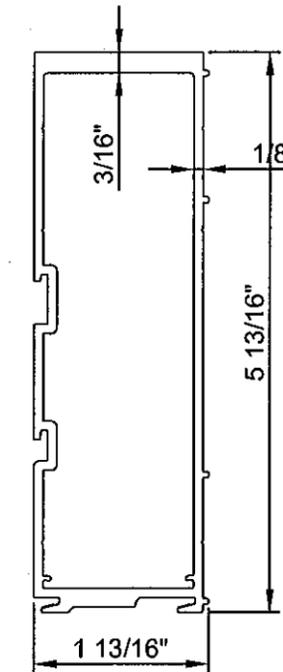

36
20 012
ALUMINUM FRAME JAMB
(SPANDREL)


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **18-08/2015**
Expiration Date **08/21/2016**
By *[Signature]*
Miami Dade Product Control

S STRUCTURAL **D** DESIGN **I** INC.
CONSULTING STRUCTURAL ENGINEERS
9595 N. KENDALL DR. SUITE NO. 209
MIAMI, FLORIDA 33176 CERTIFICATE #: 8803
[Signature]
10/10/10
TEL: (305) 695-8965 FARROKH RASEKHI, P.E.
FAX: (305) 695-8966 FL. REG. #38001



TITLE:
**SERIES WW20
WINDOW WALL
LIST OF EXTRUSIONS
(PART 2)**

SCALE: 6" = 1'-0"	DRAWN BY: D. LABBÉ	
DATE: 2009-04-15	DWG NO. T-001	PAGE 10

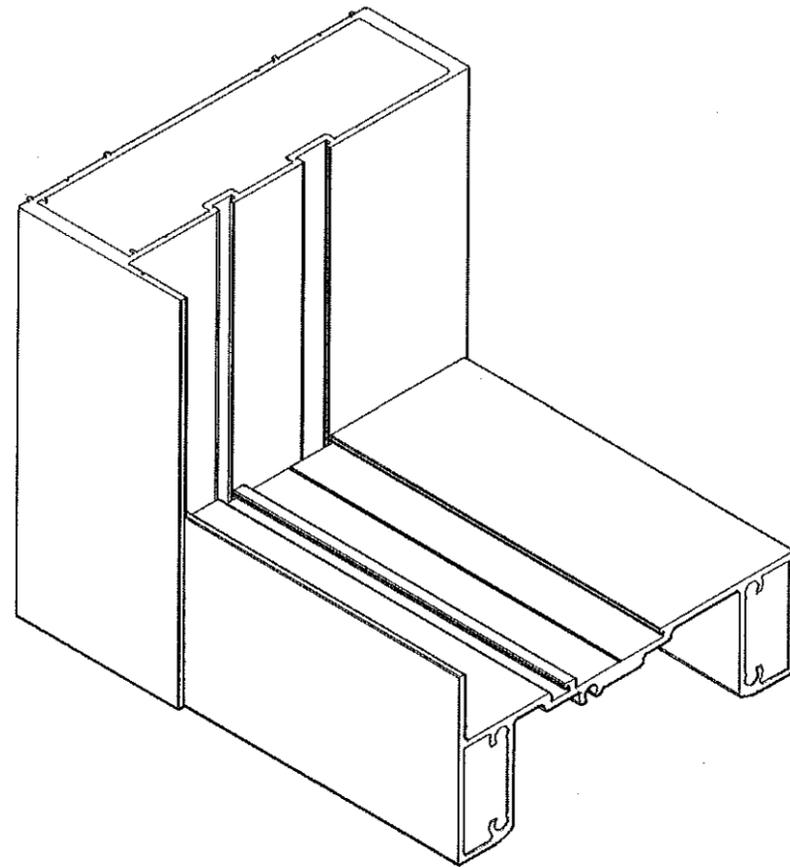

CORNER ISOMETRIC VIEW

ITEM	PART #	DESCRIPTION
1	---	#14 HH SS ASSEMBLY SCREW - 1 1/2" LONG
2	---	Ø3/8" WEDGE BOLT MFR. BY POWERS, 2 1/2" min. EMBD., 3" EDGE DIST.
3	---	#8 RH SS SCREW - 1 1/2" LONG
4	20 001	ALUMINUM ANCHOR
5	20 002	ALUMINUM SNAP-ON CAP
6	20 003	ALUMINUM HORIZONTAL MULLION
7	20 004	ALUMINUM FRAME SILL / HEAD
8	---	SEALANT SPECTREM 2 or SILPRUF SCS 2000 - 6" LONG AT EACH GLASS CORNERS
9	---	Ø3/8"-24 x 2 1/2" S.M.S.
10	20 010	ALUM. HOR. MULL. SPANDREL CAP- GLUED W/ SPECTREM 2 or SILPRUF SCS 2000 BY TREMCO
11	20 011	ALUMINUM HORIZONTAL MULLION (SPANDREL)
12	20 015	ALUM. FRAME SPANDREL CAP- GLUED W/ SPECTREM 2 or SILPRUF SCS 2000 BY TREMCO
13	20 016	ALUMINUM FRAME HEAD / SILL (SPANDREL)
14	20 017	ALUMINUM FRAME HEAD / SILL (OPTIONAL)
15	---	3/16" CLEAR TEMPERED GLASS 0.060" PVB - SAFLEX III G MANUFACTURE BY SOLUTIA INC. 3/16" CLEAR TEMPERED GLASS
16	---	ACCESS HOLE Ø1"
17	---	ACCESS HOLE Ø7/8"
18	---	BACKER ROD & SEALANT SPECTREM 2 or SILPRUF SCS 2000 BY TREMCO
19	---	ALUMINUM SEAMS SEALED WITH SPECTREM 2 or SILPRUF SCS 2000 BY TREMCO
20	91 500	EPDM GASKET - TREMCO - DURO 70
21	---	NEOPRENE SITTING BLOCK
22	---	POLYSHIM 1/8" THICK
23	---	SEALANT SPECTREM 2 or SILPRUF SCS 2000 BY TREMCO
24	---	POLYSHIM 1/4" THICK BY TREMCO
25	20 008	ALUMINUM SPLIT MULLION (FEMALE)
26	20 009	ALUMINUM SPLIT MULLION (MALE)
27	20 007	ALUMINUM FRAME JAMB
28	---	PVC SHIM
29	---	#14 FH SCREW - 3" LONG S.D.S.
30	---	STRUCTURAL SILICONE SSG 4700 (G.E) OR PROGLASE II (TREMCO)
31	---	NORTON TAPE 1/8" x 1/4" BY TREMCO
32	---	NORTON TAPE 1/4" x 1/4" BY TREMCO
33	---	1/4" CLEAR HEAT STRENGTHENED GLASS 0.090" SENTRY GLASS INTERLAYER BY DUPONT 1/4" CLEAR HEAT STRENGTHENED GLASS
34	20 014	ALUMINUM SPLIT MULLION (SPANDREL)
35	20 013	ALUMINUM SPLIT MULLION SPANDREL CAP- GLUED WITH SPECTREM 2 or SILPRUF SCS 2000
36	20 012	ALUMINUM FRAME JAMB (SPANDREL)
37	---	Ø1/4" FH TAPCON SCREW 1" MIN. EMBD., 3 1/8" LONG

REVISIONS:	BY:
R1 07/28/2010	O.S.
R2 09/23/2010	O.S.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-0812.01
Expiration Date 09/21/2015
By *[Signature]*
Miami Dade Product Control

STRUCTURAL DESIGN INC.
CONSULTING STRUCTURAL ENGINEERS
8595 N. KENDALL DR. SUITE NO. 209
MIAMI, FLORIDA 33178 CERTIFICATE #: 8803
[Signature]
10/10/10
TEL: (305) 595-8965 FARROKH RASEKHI, P.E.
FAX: (305) 595-8966 FL. REG. #38001



TITLE:
**SERIES WW20
WINDOW WALL
BILL OF MATERIAL**

SCALE:	DRAWN BY:	
NONE	D. LABBÉ	
DATE:	DWG NO.	PAGE
2009-04-15	T-001	11