



**MIAMI-DADE COUNTY**  
**BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)**  
**BOARD AND CODE ADMINISTRATION DIVISION**

**MIAMI-DADE COUNTY, FLORIDA**  
**PRODUCT CONTROL SECTION**  
 11805 SW 26<sup>th</sup> Street, Room 208  
 MIAMI, FLORIDA 33175-2474  
 T (786) 315-2590 F (786) 315-2599

[www.miamidade.GOV/buildingcode](http://www.miamidade.GOV/buildingcode)

**NOTICE OF ACCEPTANCE (NOA)**

**Labrador & Fundora Corp. dba V & V Windows**  
**2355 W 4th Avenue**  
**Hiialeah, FL 33010-1454**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Section and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "200" Aluminum Horizontal Sliding Window – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **W10-26**, titled "Series 200 Alum. Horiz. Sliding. Wdw. (L.M.I.)", sheets 1 through 6 of 6, dated 04/23/10 with revision "B" dated 12/09/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and Approval date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1, evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



*J. Gascon*  
 12/9/10

**NOA No. 10-0824.05**  
**Expiration Date: December 30, 2015**  
**Approval Date: December 30, 2010**  
 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **W10-26**, titled "Series 200 Alum. Horiz. Sliding. Wdw. (L.M.I.)", sheets 1 through 6 of 6, dated 04/23/10 with revision "**B**" dated 12/09/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.

**B. TESTS**

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of horizontal slider, prepared by American Test Lab of South Florida, Inc., Test Report No. **ATLSF-0126.01-10**, dated 06/08/10, signed by Edmundo J. Largaespada, P. E.

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated 06/24/10, signed and sealed by Javad Ahmad, P. E.  
**Complies with ASTM E1300-04**

**D. QUALITY ASSURANCE**

1. Miami-Dade Building and Neighborhood Compliance Department (BNC).

**E. MATERIAL CERTIFICATIONS**


1. Notice of Acceptance No. **10-0413.04** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/26/2010, expiring on 01/14/12.
2. Notice of Acceptance No. **10-0922.09** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite® PVB, Interlayer**" dated 12/24/10, expiring on 12/11/11.

**F. STATEMENTS**

1. Statement letter of no financial interest, conformance and compliance with the FBC-2007, dated April 30, 2010, signed and sealed by Javad Ahmad, P. E.
2. Laboratory compliance letter for Test Report No. **ATLSF-0126.01-10**, issued by American Test Lab of South Florida, Inc., dated 06/08/10, signed and sealed by Edmundo J. Largaespada, P. E.
3. Proposal No. **09-1140** issued by BCCO, dated August 17, 2009, signed by Renzo Narcisco.



**G. OTHERS**

1. None.



Jaime D. Gascon, P. E.  
Chief, Product Control Section  
NOA No. 10-0824.05

Expiration Date: December 30, 2015  
Approval Date: December 30, 2010

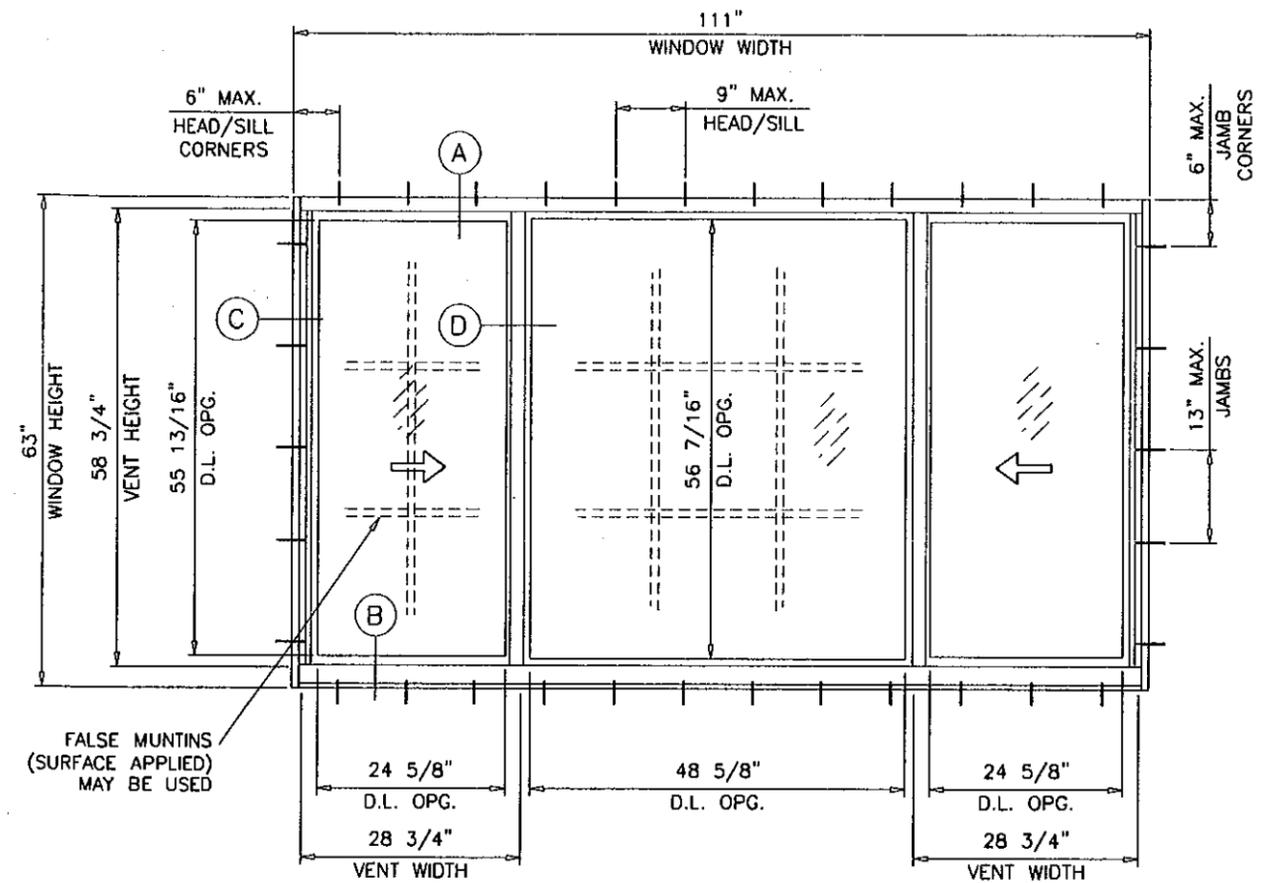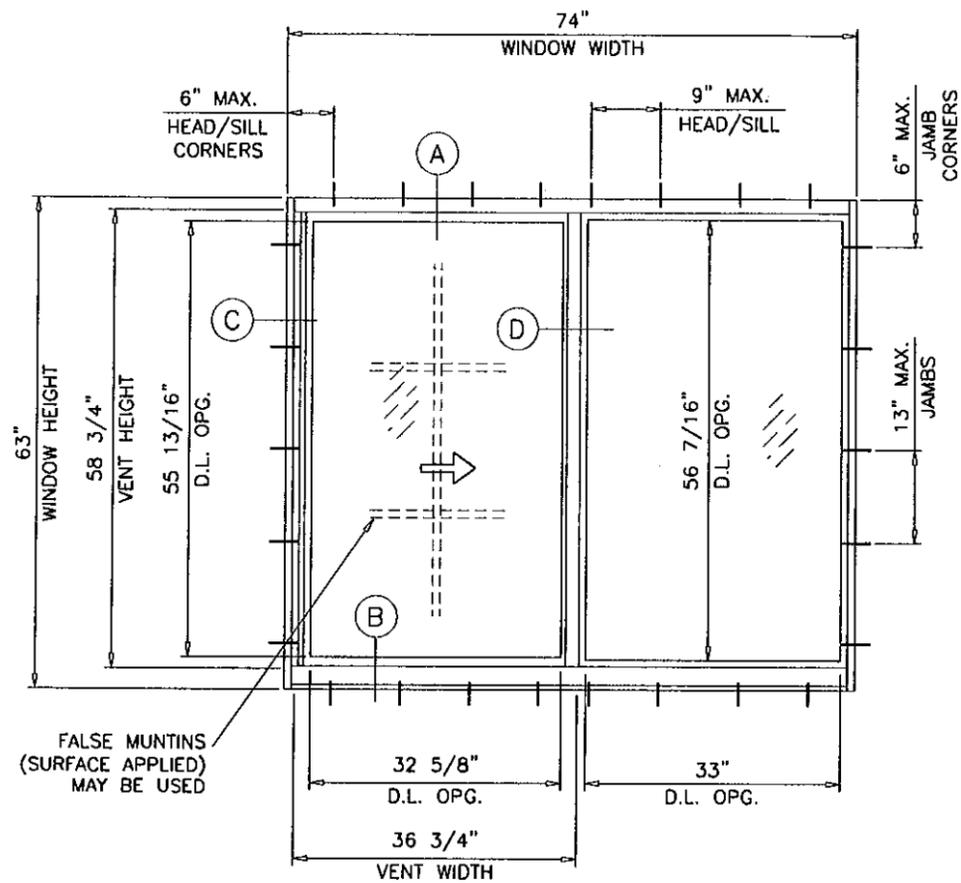

TYPICAL ELEVATIONS

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

**SERIES 200 ALUMINUM HORIZONTAL SLIDING WINDOW**

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF H.R./H.R. OR HORIZONTAL ROLLING WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.


MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

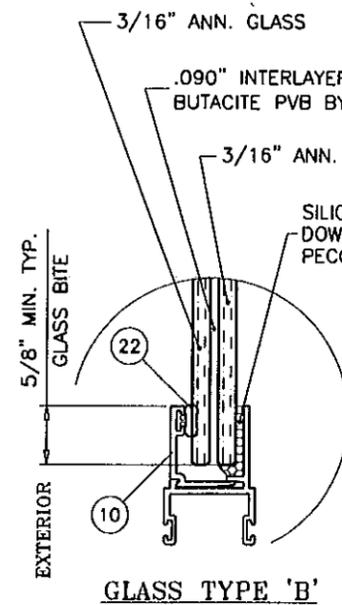

GLASS TYPE 'B'

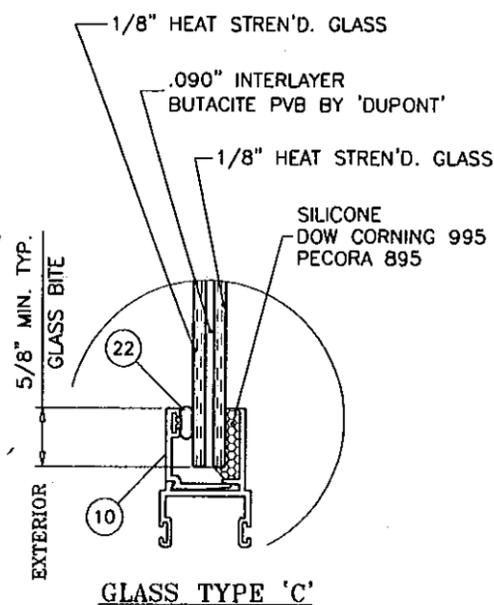

GLASS TYPE 'C'

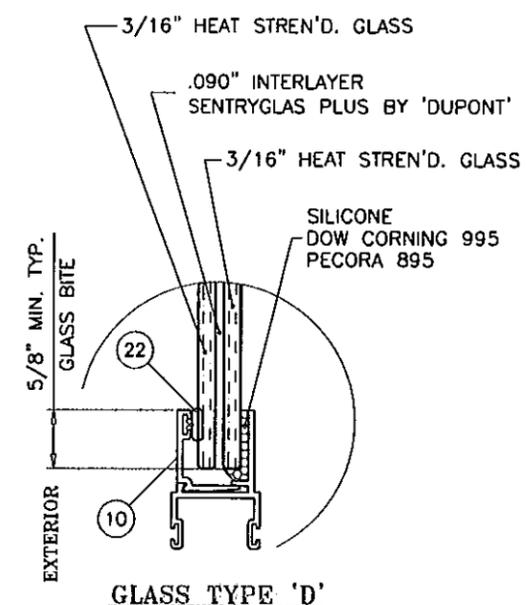


GLASS TYPE 'D'

GLAZING OPTIONS

Engr. JAVAD, AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 3538  
DEC 07 2010

Approved as complying with the Florida Building Code  
Date 12/30/2010  
NOA# 10-0524-05  
Miami Dade Product Control Division  
By *[Signature]*



**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL (305) 264-8100 FAX (305) 262-6978  
COMP-ANL\W10-26W

SERIES 200 ALUM HORIZ. SLIDING WDW. (L.M.I.)  
Lobrador & Fundaro Corp.  
dbo-V & V Windows  
2355 West 4th Ave.  
Hialeah, Fl. 33010  
TEL. (305) 888-4151 FAX. (305) 888-1042


revisions:	no	date	description
	A	11.16.10	NO CHANGE THIS SHEET

date: 04-23-10  
scale: 1/2"=1'-0"  
dr. by: HAMID  
chk. by:

drawing no.  
**W10-26**  
sheet 1 of 6


DESIGN LOAD CAPACITY - PSF (XO OR OX SIZES)						
WINDOW DIMS.		A	GLASS TYPES		GLASS TYPE	
WIDTH	HEIGHT		'B' & 'C'		'D'	
			EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
26-1/2"	26"	3	70.0	70.0	80.0	90.0
37"		4	70.0	70.0	80.0	90.0
53-1/8"		6	70.0	70.0	80.0	90.0
74"		6	70.0	70.0	80.0	90.0
26-1/2"	38-3/8"	3	70.0	70.0	80.0	90.0
37"		4	70.0	70.0	80.0	90.0
53-1/8"		6	70.0	70.0	80.0	90.0
74"		6	70.0	70.0	80.0	90.0
26-1/2"	50-5/8"	3	70.0	70.0	80.0	90.0
37"		4	70.0	70.0	80.0	90.0
53-1/8"		6	70.0	70.0	80.0	90.0
74"		6	70.0	70.0	80.0	90.0
26-1/2"	63"	3	70.0	70.0	80.0	90.0
37"		4	70.0	70.0	80.0	90.0
53-1/8"		6	70.0	70.0	80.0	90.0
74"		6	70.0	70.0	80.0	89.0
24"	24"	3	70.0	70.0	80.0	90.0
36"		4	70.0	70.0	80.0	90.0
48"		5	70.0	70.0	80.0	90.0
60"		7	70.0	70.0	80.0	90.0
72"		8	70.0	70.0	80.0	90.0
24"	36"	3	70.0	70.0	80.0	90.0
36"		4	70.0	70.0	80.0	90.0
48"		5	70.0	70.0	80.0	90.0
60"		7	70.0	70.0	80.0	90.0
72"		8	70.0	70.0	80.0	90.0
24"	48"	3	70.0	70.0	80.0	90.0
36"		4	70.0	70.0	80.0	90.0
48"		5	70.0	70.0	80.0	90.0
60"		7	70.0	70.0	80.0	90.0
72"		8	70.0	70.0	80.0	90.0
24"	60"	3	70.0	70.0	80.0	90.0
36"		4	70.0	70.0	80.0	90.0
48"		5	70.0	70.0	80.0	90.0
60"		7	70.0	70.0	80.0	90.0
72"		8	70.0	70.0	80.0	90.0
24"	63"	3	70.0	70.0	80.0	90.0
36"		4	70.0	70.0	80.0	90.0
48"		5	70.0	70.0	80.0	90.0
60"		7	70.0	70.0	80.0	90.0
72"		8	70.0	70.0	80.0	90.0

A = NO. OF ANCHORS PER HEAD & SILL



OPERATING VENTS TO BE 1/2 OF THE WINDOW WIDTH

'XO OR OX'

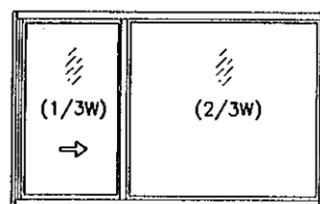


OPERATING VENTS TO BE 1/3 OF THE WINDOW WIDTH

'XO OR OX'


DESIGN LOAD CAPACITY - PSF (XOX SIZES)						
WINDOW DIMS.		A	GLASS TYPES		GLASS TYPE	
WIDTH	HEIGHT		'B' & 'C'		'D'	
			EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
74"	26"	8	70.0	70.0	80.0	90.0
106-1/4"		12	70.0	70.0	80.0	90.0
111"		12	70.0	70.0	80.0	90.0
74"	38-3/8"	8	70.0	70.0	80.0	90.0
106-1/4"		12	70.0	70.0	80.0	90.0
111"		12	70.0	70.0	80.0	90.0
74"	50-5/8"	8	70.0	70.0	80.0	90.0
106-1/4"		12	70.0	70.0	80.0	90.0
111"		12	70.0	70.0	80.0	90.0
74"	63"	8	70.0	70.0	80.0	90.0
106-1/4"		12	70.0	70.0	80.0	90.0
111"		12	70.0	70.0	80.0	89.0
72"	36"	8	70.0	70.0	80.0	90.0
84"		9	70.0	70.0	80.0	90.0
96"		11	70.0	70.0	80.0	90.0
108"		12	70.0	70.0	80.0	90.0
72"	48"	8	70.0	70.0	80.0	90.0
84"		9	70.0	70.0	80.0	90.0
96"		11	70.0	70.0	80.0	90.0
108"		12	70.0	70.0	80.0	90.0
72"	60"	8	70.0	70.0	80.0	90.0
84"		9	70.0	70.0	80.0	90.0
96"		11	70.0	70.0	80.0	90.0
108"		12	70.0	70.0	80.0	90.0
72"	63"	8	70.0	70.0	80.0	90.0
84"		9	70.0	70.0	80.0	90.0
96"		11	70.0	70.0	80.0	90.0
108"		12	70.0	70.0	80.0	90.0

A = NO. OF ANCHORS PER HEAD & SILL

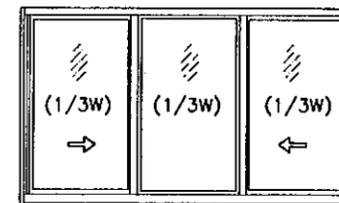

OPERATING VENTS TO BE 1/3 OF THE WINDOW WIDTH

'XOX'

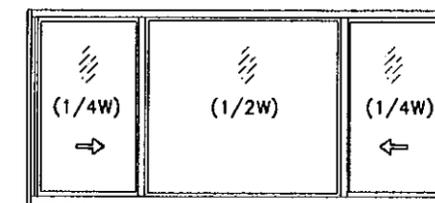

OPERATING VENTS TO BE 1/4 OF THE WINDOW WIDTH

'XOX'

NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE  
BASED ON ASTM E1300-02/04 (3 SEC. GUSTS)  
AND FLORIDA BUILDING COMMISSION  
DECLARATORY STATEMENT DCA05-DEC-219

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 3538





DEC 07 2010

Approved as complying with the  
Florida Building Code  
Date 12/30/2010  
NOA# 10-0824.05  
Miami Dade Product Control  
Division

**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W10-26V

SERIES 200 ALUM HORIZ. SLIDING WDW. (L.M.I.)  
Lobrador & Fundora Corp.  
dba-V & V Windows  
2355 West 4th Ave.  
Hialeah, Fl. 33010  
TEL. (305) 888-4151 FAX. (305) 888-1042

revisions:	no date	by description	NO CHANGE THIS SHEET
	A 11.16.10		
date:	04-23-10	scale:	1/2"=1'-0"
dr. by:	HAMID	chk. by:	
drawing no.	W10-26	sheet	2 of 6

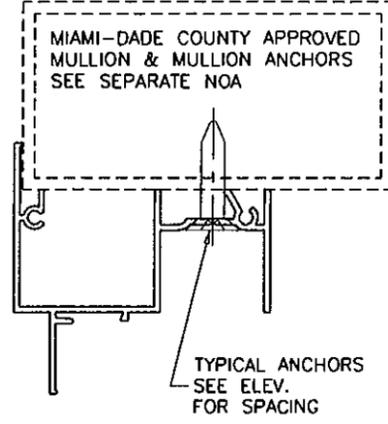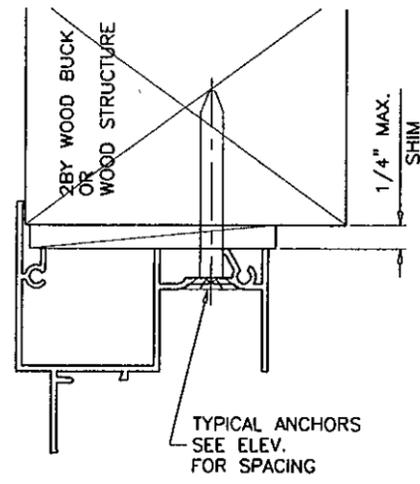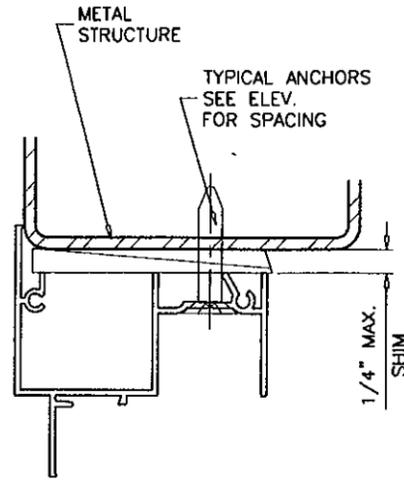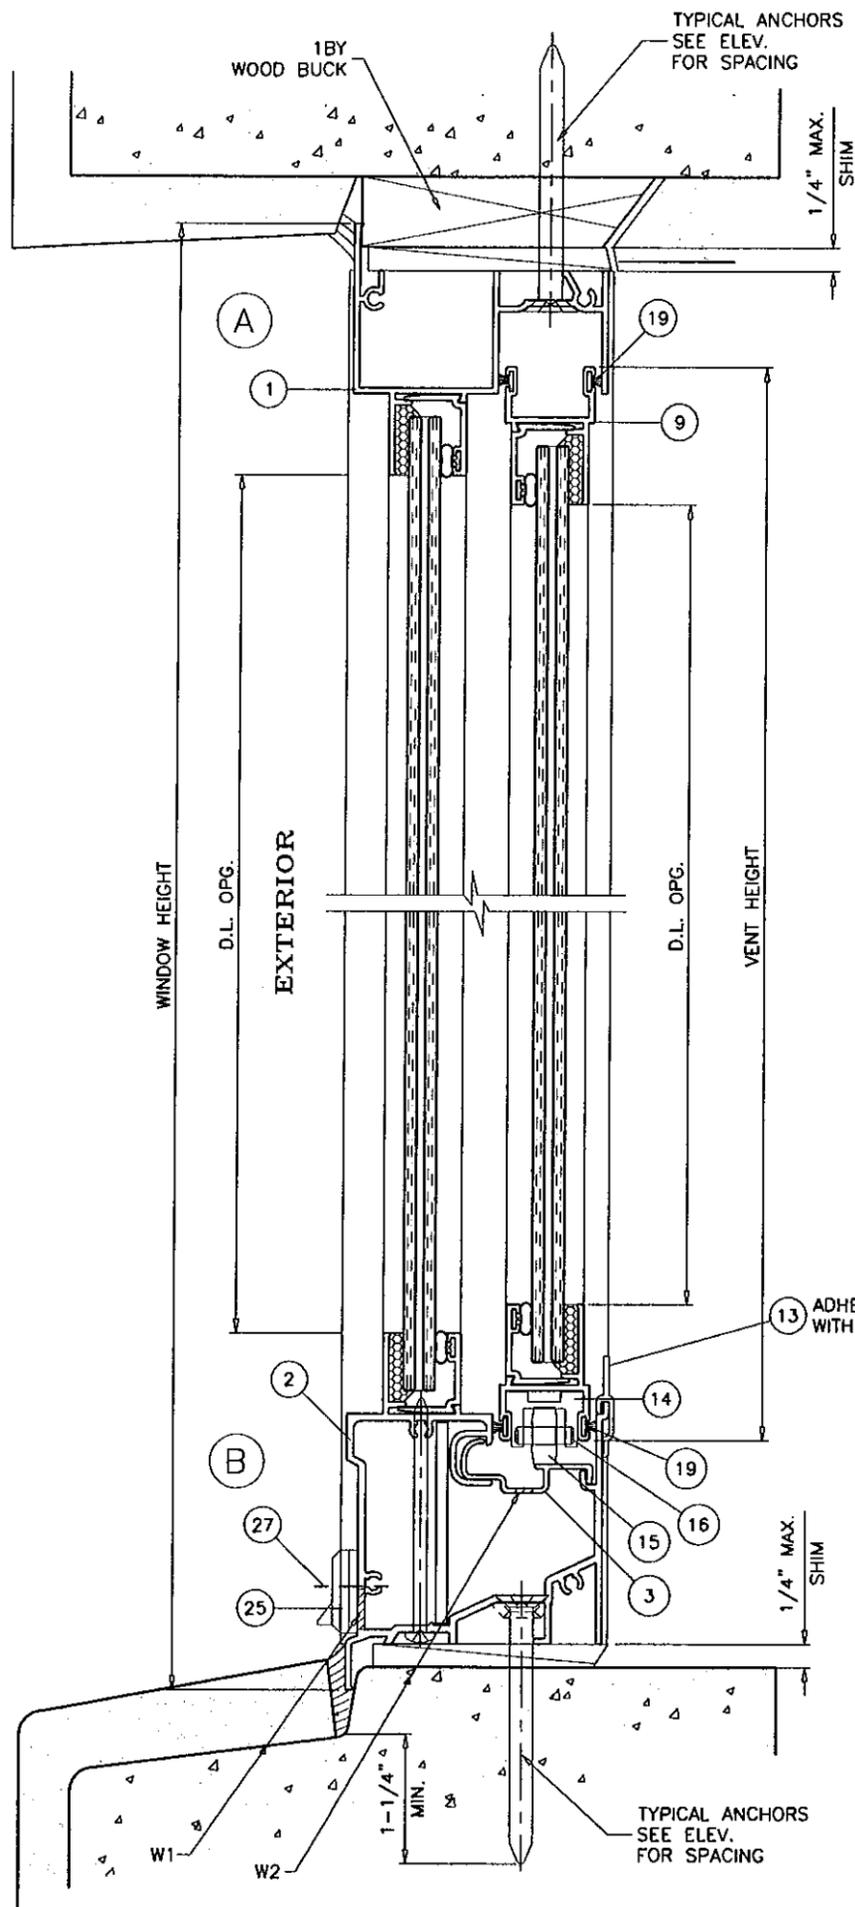

WOOD BUCKS AND METAL STRUCTURE NOT BY V & V WDW. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

**WEEPHOLES:**

- W1 = 3/4" X 1-1/8" WEEP SLOT AT 2" FROM EACH END WITH PLASTIC BAFFLE.
- W2 = 3/16" X 1-1/2" WEEP SLOT AT 2" FROM EACH END
- W3 = 1/8" X 1-3/4" WEEP SLOT AT MID WIDTH OF VENT.

**SEALANT:**

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH PECORA 1215 SEAM SEALER.

**TYPICAL ANCHORS:**


SEE ELEV. FOR SPACING  
 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES  
 1-3/8" MIN. PENETRATION INTO WOOD  
 THRU 1BY BUCKS INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
 DIRECTLY INTO CONC. OR MASONRY  
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY  
**#14 SMS OR SELF DRILLING SCREWS** (GRADE 2 CRS)  
 INTO METAL STRUCTURES  
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)  
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)  
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

**#12 SMS OR SELF DRILLING SCREWS** (GRADE 2 CRS)  
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")  
 (NO SHIM SPACE)

**TYPICAL EDGE DISTANCE**

INTO CONCRETE AND MASONRY = 2-1/2" MIN.  
 INTO WOOD STRUCTURE = 1" MIN.  
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.  
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

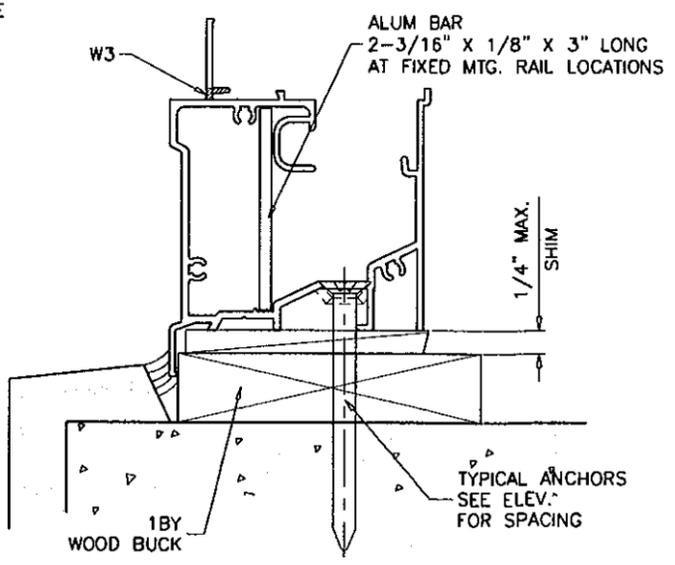

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538  
 GA  
 DEC 09 2010

Approved as complying with the  
 Florida Building Code  
 Date 12/30/2010  
 NOA# 16-0824.05  
 Miami Dade Product Control  
 Division  
 By [Signature]

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8400 FAX. (305) 262-6978  
 COMP-ANL\W10-26W


LABORATORY & FUNDORA CORP.  
 dba-V & V Windows  
 2355 West 4th Ave.  
 Hialeah, FL 33010  
 TEL. (305) 888-4151 FAX. (305) 888-1042

Series 200 ALUM HORIZ. SLIDING WDW. (L.M.I.)


no.	date	by	description	REV. PER BCCO COMMENTS
A	11.16.10			

date: 04-23-10  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:


drawing no. **W10-26**  
 sheet 3 of 6

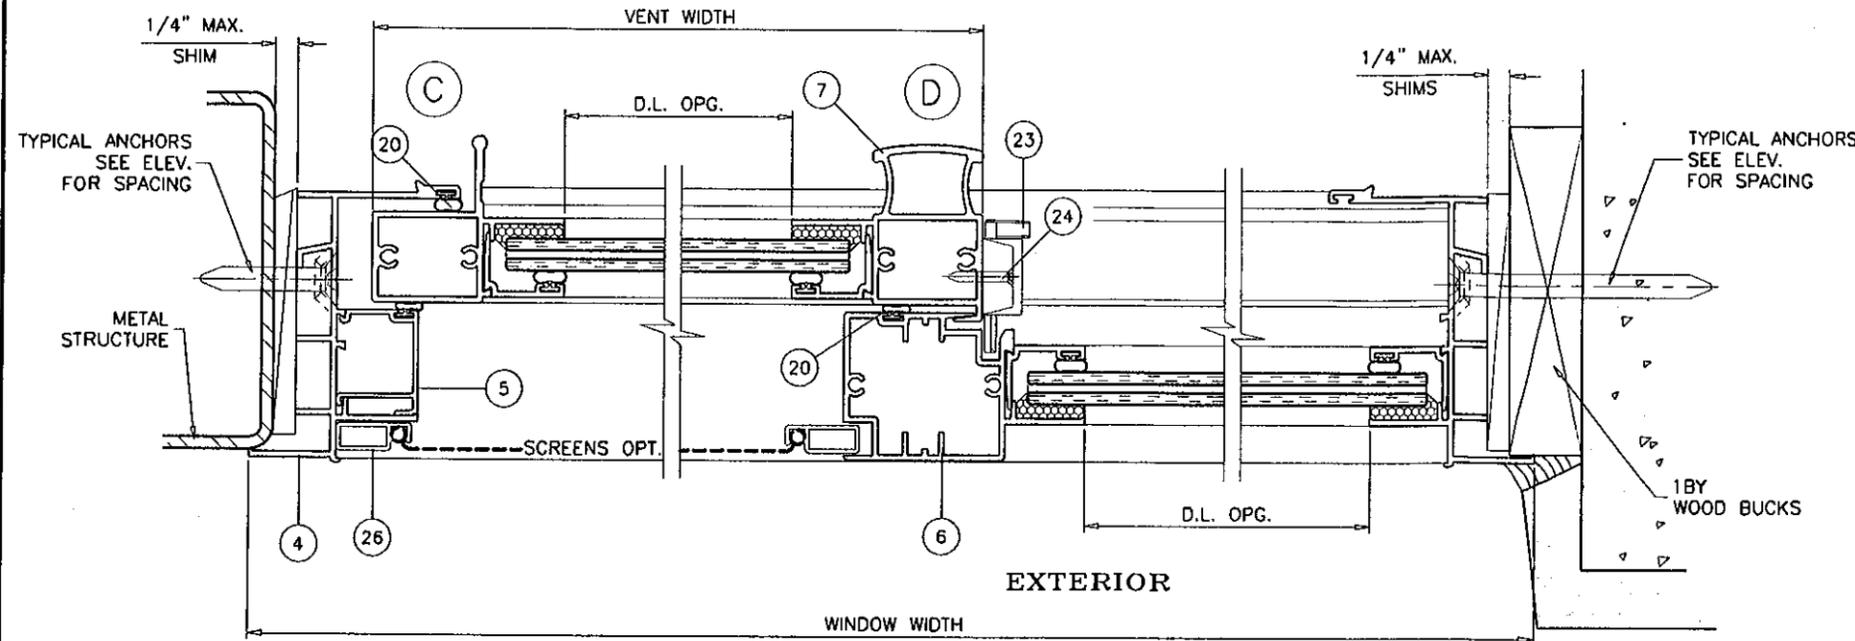

XO LAYOUT

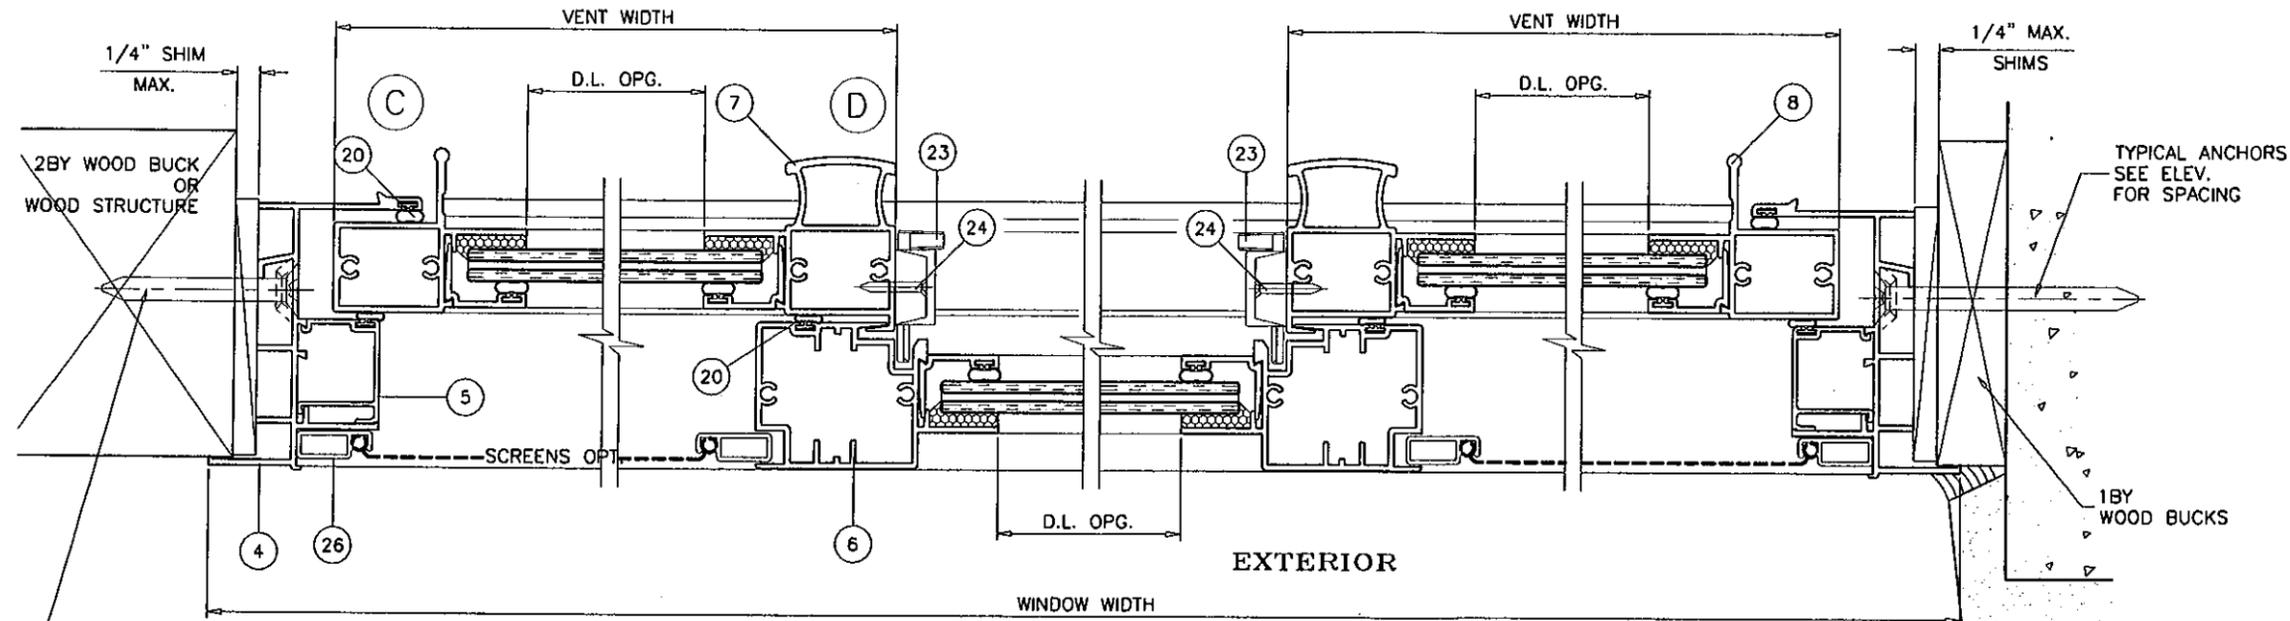

XOX LAYOUT

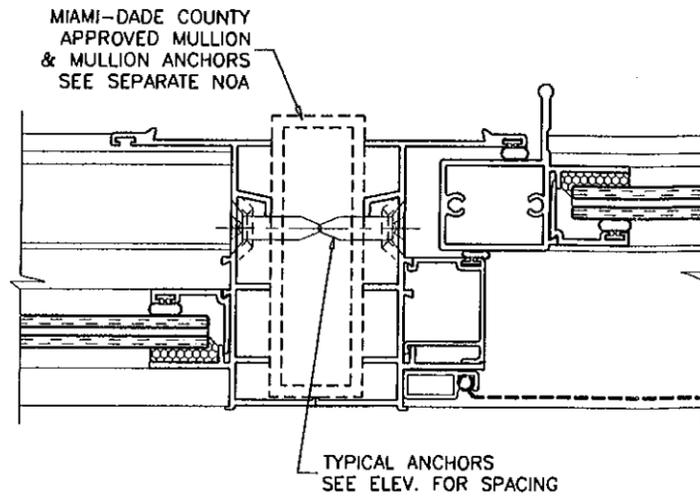

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538

*J.A.*

DEC 07 2010

Approved as complying with the  
 Florida Building Code  
 Date 12/30/2010  
 NOA# 10-0824-05  
 Miami Dade Product Control  
 Division  
 By *[Signature]*


**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL (305) 264-8100 FAX (305) 262-6978  
 COMP-ANL\W10-26W

SERIES 200 ALUM HORIZ. SLIDING WDW. (L.M.I.)  
 Labrador & Fundora Corp.  
 dba-V & V Windows  
 2355 West 4th Ave.  
 Hialeah, Fl. 33010  
 TEL. (305) 888-4151 FAX. (305) 888-1042


no	date	by	description
A	11.16.10		REV. PER BCCO COMMENTS

date: 04-23-10  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:


drawing no.  
**W10-26**  
 sheet 4 of 6

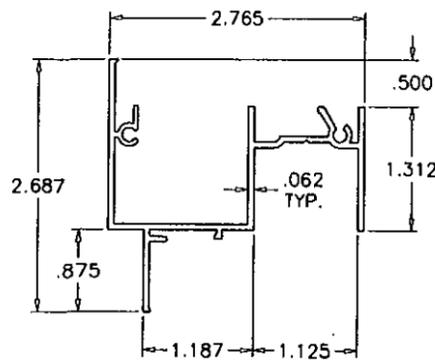


① FRAME HEAD

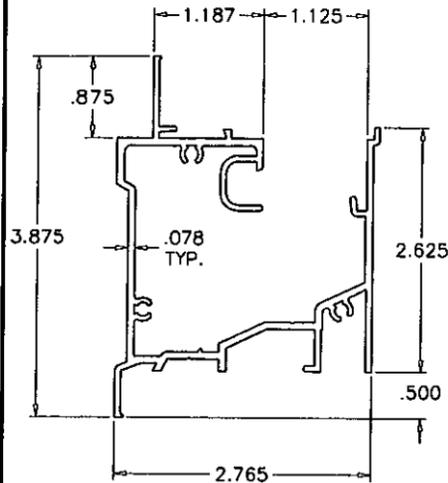


② FRAME SILL

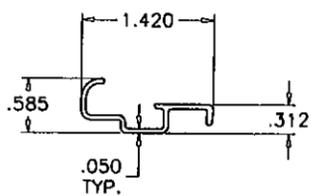


③ SILL TRACK

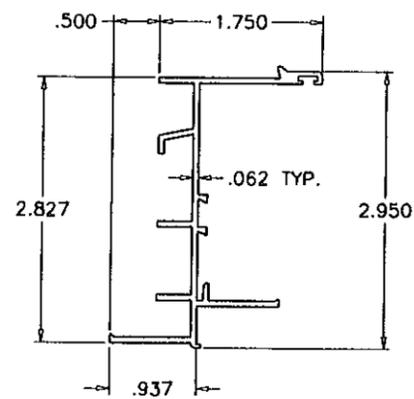


④ FRAME JAMB

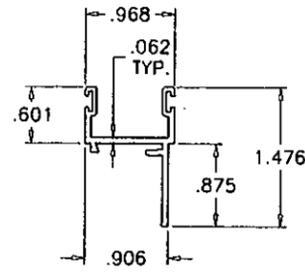


⑨ VENT TOP/BOTTOM RAIL

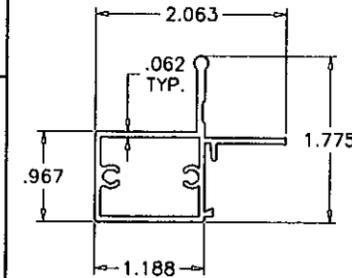


⑤ JAMB ADAPTER

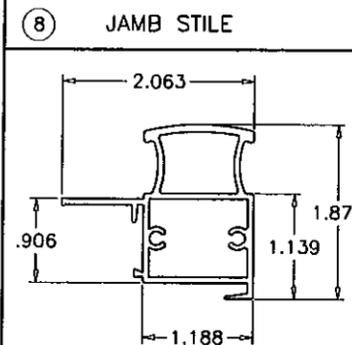


⑧ JAMB STILE

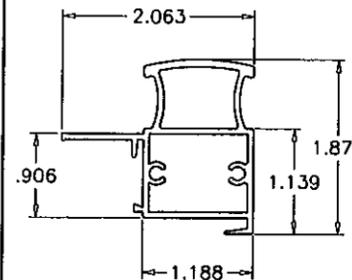


⑦ MEETING RAIL

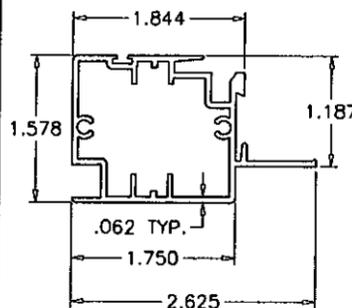


⑥ FIXED MTG. RAIL

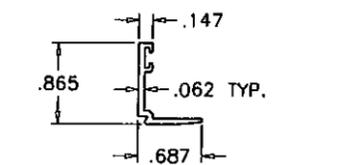

⑩ GLAZING BEAD



⑬ SILL RISER



ALUMINUM BAR

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	V103	1	FRAME HEAD	6063-T6	-
2	V202	1	FRAME SILL	6063-T6	-
3	V203	1	SILL TRACK	6063-T6	-
4	V201	2	FRAME JAMB	6063-T6	-
5	V205	AS REQD.	FRAME JAMB ADAPTER	6063-T6	-
6	V104	1/ VENT	FIXED MTG. RAIL	6063-T6	-
7	V204	1/ VENT	VENT INTERLOCK	6063-T6	-
8	V209	1/ VENT	JAMB STILE	6063-T6	-
9	V107	2/ VENT	TOP AND BOTTOM RAIL	6063-T6	-
10	V108	AS REQD.	GLAZING BEAD	6063-T6	-
13	-	AS REQD.	ADD-ON SILL RISER	6063-T6	USE AS REQD.
14	-	4/ VENT	ROLLER HOUSING & GUIDE	CELCON	-
15	V208	2/ VENT	ROLLER	BRASS	-
16	V207	2/ VENT	ROLLER PIN	ST. STEEL	-
17	#8 X 1-1/4"	AS REQD.	FRAME/VENT ASSEMBLY SCREWS	CRS	P.H. SMS
18	#8 X 3"	2/ VENT	FIX. RAIL SILL SCREWS (SILL END)	CRS	P.H. SMS
19	-	AS REQD.	FIN SEAL W'STRIPPING	-	ULTRAFAB
20	9146QU	AS REQD.	BULB SEAL (DUAL DUROMETER, T-SLOT=50, BULB=73)	NEOPRENE	ULTRAFAB
22	9146QU	AS REQD.	GLAZING BEAD BULB (DUAL DUROMETER, T-SLOT=50, BULB=73)	NEOPRENE	ULTRAFAB
23	-	2/ VENT	SWEEP LATCH	-	AT 6-1/2" FROM EACH END
24	#8 X 3/4"	2/ LATCH	LATCH INST. SCREW	ST. STEEL	PH SMS
25	-	2/ WDW.	WEEP VALVE	-	-
26	-	1/ VENT	5/16" BOX SCREEN	-	OPTIONAL
27	#6 X 1/2"	2	BAFFLE INSTALLATION SCREWS	-	PH TEKS

af c

**AL-FAROQQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W10-26W

SERIES 200 ALUM. HORIZ. SLIDING WDW. (L.M.I.)

Labrador & Fundora Corp.  
 dba - V & V Windows  
 2355 West 4th Ave.  
 Hialeah, FL 33010  
 TEL. (305) 888-4151 FAX. (305) 888-1042


revisions:	no	date	by	description	REV. PER BCCO COMMENTS
A	1	11.16.10			

date:	04-23-10
scale:	1/2" = 1"
dr. by:	HAMID
chk. by:	


drawing no.  
**W10-26**  
 sheet 5 of 6

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538  
  
 DEC 07 2010


Approved as complying with the  
 Florida Building Code  
 Date 12/30/2010  
 NOA# 10-0524.06  
 Miami Dade Product Control  
 Division  
 By

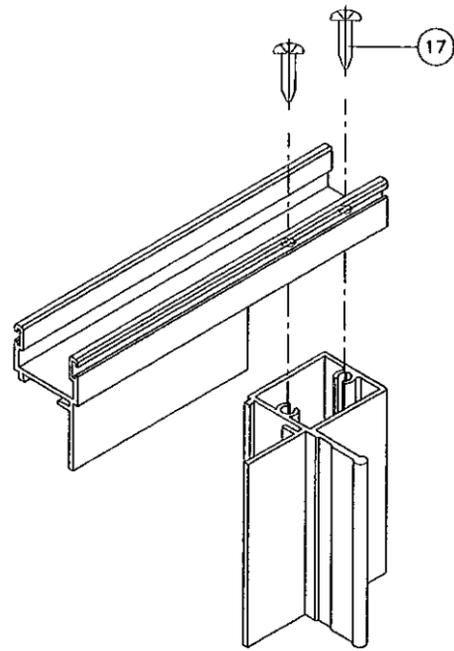


VENT TOP/BOTTOM CORNERS

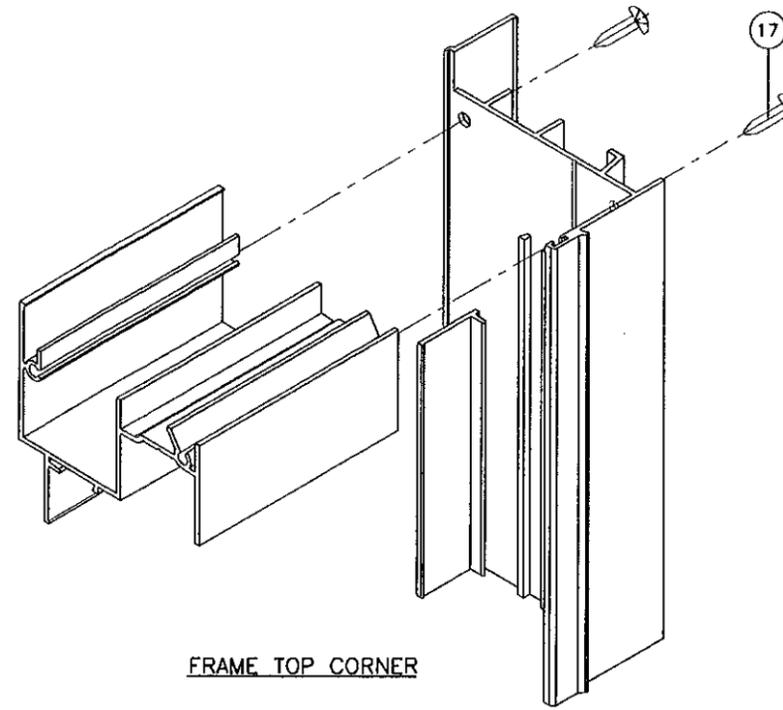

FRAME TOP CORNER

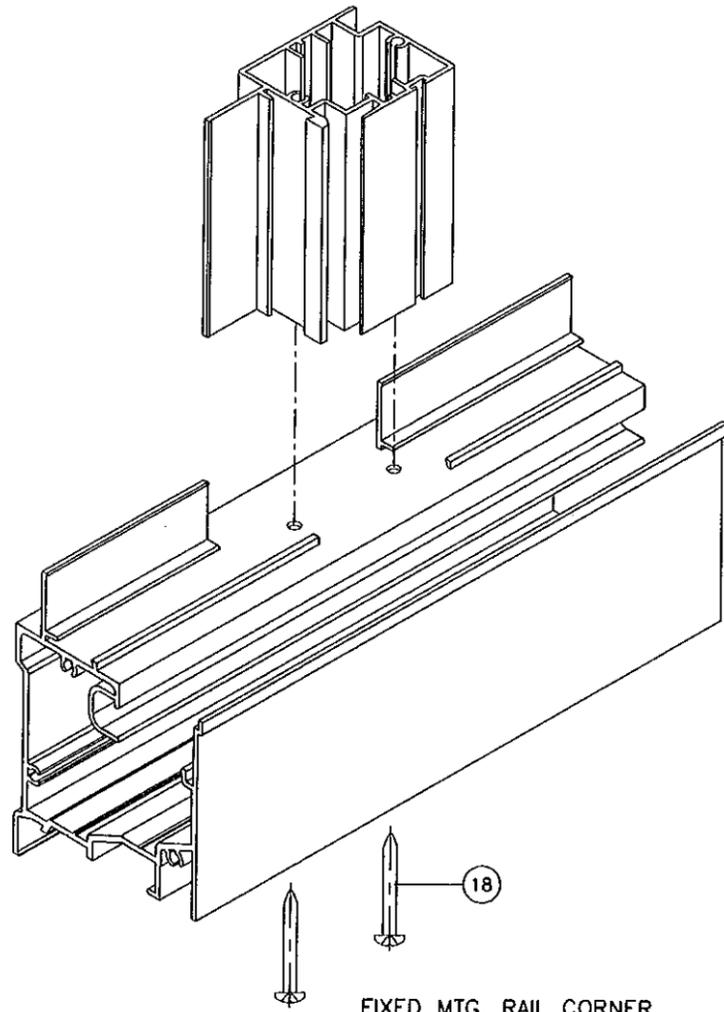

FIXED MTG. RAIL CORNER

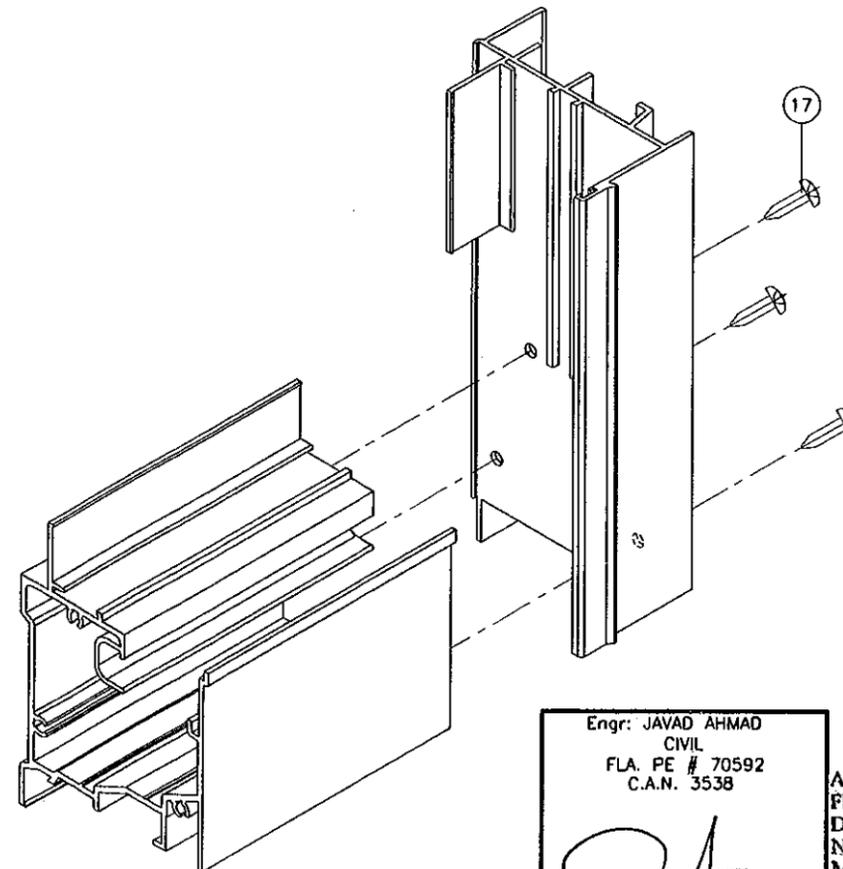

FRAME BOTTOM CORNER

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538

DEC 07 2010

Approved as complying with the  
 Florida Building Code  
 Date 12/30/2010  
 NOA# 10-0824.05  
 Miami Dade Product Control  
 Division  
 By *[Signature]*

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL (305) 264-8100 FAX (305) 262-6978  
 COMP-ANL\W10-26W

SERIES 200 ALUM HORIZ. SLIDING WDW. (L.M.I.)  
 Labrador & Fundora Corp.  
 dba - V & V Windows  
 2355 West 4th Ave.  
 Hialeah, Fl. 33010  
 TEL. (305) 888-4151 FAX. (305) 888-1042

revisions:	no	date	by	description
	A	11.16.10		NO CHANGE THIS SHEET

date: 04-23-10  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W10-26**  
 sheet 6 of 6