



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-6339
www.miamidade.gov/building

NOTICE OF ACCEPTANCE (NOA)

YKK AP America Inc.
7680 The Bluffs, Suite 100
Austell, GA 30168

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series YHS-50 FS Flush Glazed Aluminum Storefront System (N.J.) – L.M.I.
(Dry Glazed w/o Jamb Anchors)

APPROVAL DOCUMENT: Drawing No. **W07-40**, titled “Series YHS-50 FS Alum Flush Glaze Storefront System (L.M.) (N.J.)”, sheets 1 through 6 of 6, dated 04/19/06, with revision A dated 02/08/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



Handwritten signature and date: 11/18/10

NOA 10-0902.06
Expiration Date: December 09, 2015
Approval Date: December 09, 2010
Page 1


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturers die drawings and sections.
2. Drawing No. **W07-40**, titled "Series YHS-50 FS Alum Flush Glaze Storefront System (L.M.) (N.J.)", sheets 1 through 6 of 6, dated 04/19/06, with revision A dated 02/08/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of Series YHS-50 FS Alum Flush Glaze Storefront System, prepared by American Test Lab of South Florida, Test Reports No. **ATLSF-1206.01-06**, dated 01/17/07, signed and sealed by William R. Mehner, P.E. and Henry Hattem, P.E.
2. Test reports on
 - 1) Air Infiltration Test, per PA 202-94
 - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
 - 3) Water Resistance Test, per PA 202-94
 - 4) Large Missile Impact Test, SFBC PA 201-94
 - 5) Cyclic Loading Test, per SFBC PA 203-94along with installation diagram of an aluminum storefront system marked-up by National Certified Testing Laboratories, Inc. Test Reports Nos. **NCTL-210-2627-4 (Elevation E)** and **6 (Elevation H)**, dated 12/19/00 and 03/07/01 respectively, signed and sealed by Barry D. Portnoy, P.E. (This test report has been revised per addendum letter dated June 20, 2002 issued by National Certified Testing Laboratories, Inc, signed and sealed by Barry Portnoy, P.E. *(Submitted under NOA #02-0215.17)*)
3. Test reports on
 - 1) Large Missile Impact Test
 - 2) Uniform Static Air Pressure Test, Loading per PA 202-94along with additional supporting evidence of an aluminum storefront system marked-up by Hurricane Test Laboratory, LLC, Test Reports Nos. **HTL-0231-0111-05**, dated 02/10/05, signed and sealed by Vinu Abraham, P.E. *(Submitted under NOA #02-0215.17)*



11/18/10

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No 10-0902.06
Expiration Date: December 09, 2015
Approval Date: December 09, 2010

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC 2007, dated 02/03/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
Complies with ASTM E1300-02/04
2. Anchor verification calculations and structural analysis, complying with FBC-2004, dated 04/20/07, prepared by Al-Farooq Corporation, signed and sealed by Arshad Viqar, P.E.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **06-1205.10** issued to E.I. DuPont DeNemours & Co., Inc. for their “**DuPont SentryGlass @ plus Interlayer**”, dated 02/16/07, expiring on 01/14/08.
2. Notice of Acceptance No. **05-1208.02** issued to E.I. DuPont DeNemours & Co., Inc. for their “**DuPont Butacite PVB Interlayer**”, dated 01/06/06, expiring on 12/11/10.

F. STATEMENTS

1. Statement letter of code compliance with 2007 FBC and no financial interest issued by Al-Farooq Corporation, dated 02/01/10, signed and sealed by Javad Ahmad, P.E.




G. OTHER

1. Notice of Acceptance No. **06-1026.09**, issued to YKK AP America Inc, for their Series YHS-50 FS Flush Glazed Aluminum Storefront System (N.J.) – L.M.I. (w/o Jamb Anchors), approved on 12/28/06, and expiring on 09/19/12.



11/18/10

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No 10-0902.06
Expiration Date: December 09, 2015
Approval Date: December 09, 2010

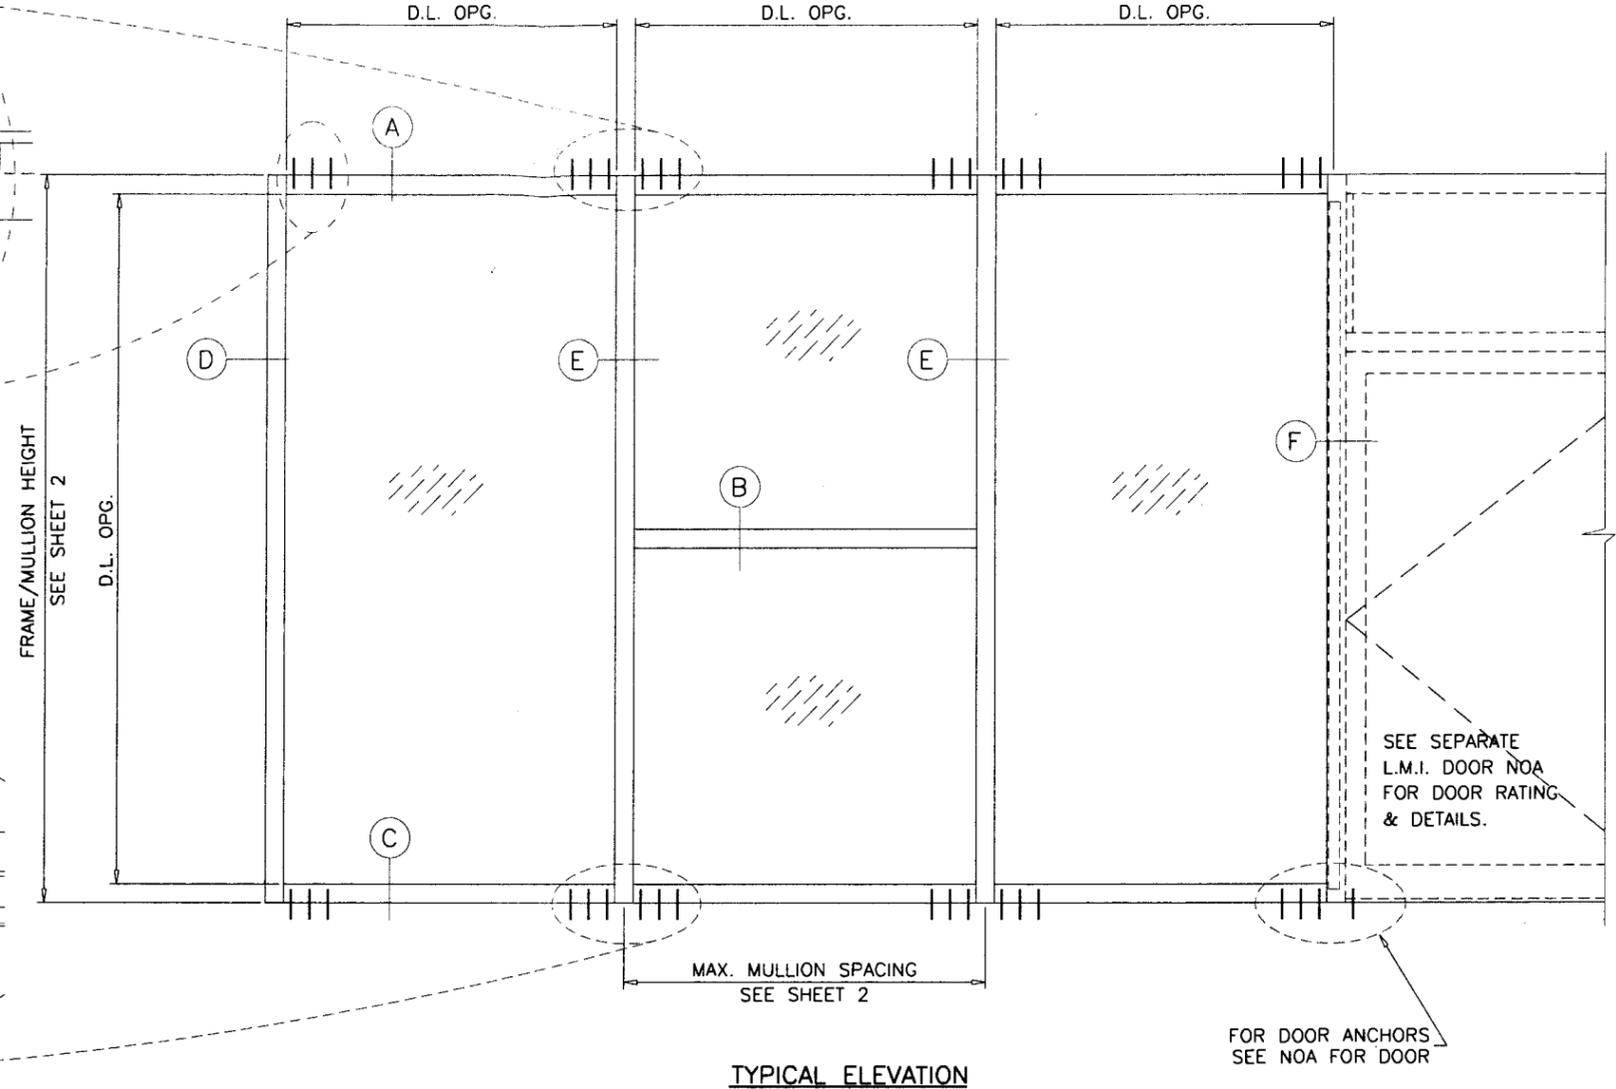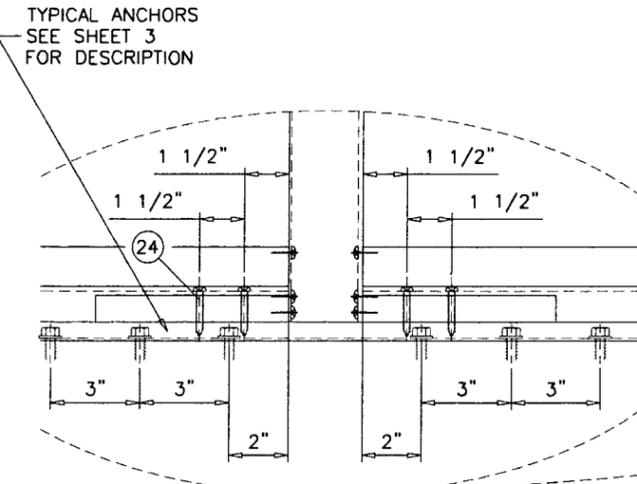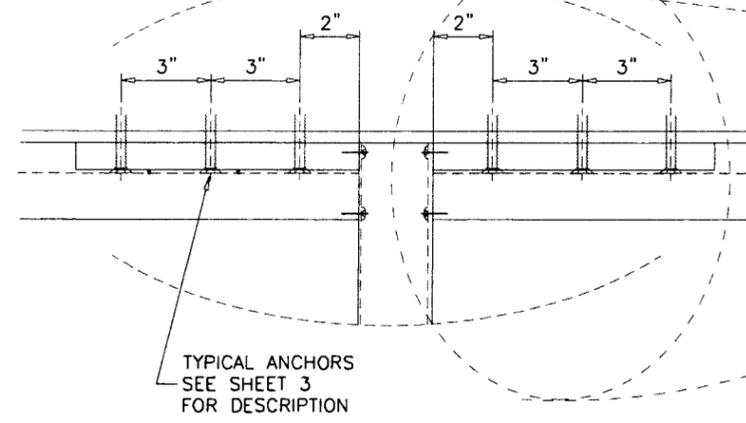

TYPICAL ELEVATION

**SERIES YHS-50 FS STD. DUTY (WITHOUT JAMB ANCHORS)
ALUMINUM DRY GLAZED STOREFRONT SYSTEM**

SEE SEPARATE APPROVAL FOR ADDITIONAL OPTIONS INCLUDING REINFORCEMENTS

THIS SYSTEM MAY BE USED IN CONJUNCTION WITH
OUTSWING ENTRANCE DOORS MODEL 35H.

THIS SYSTEM IS RATED FOR LARGE MISSILE IMPACT.
SHUTTERS NOT REQUIRED.

CODE REQUIREMENTS FOR SAFEGUARDS MUST BE OBSERVED
FOR ANY KIND OF GLASS BEING USED.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING
HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER
LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS
EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS
ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO
CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS
OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

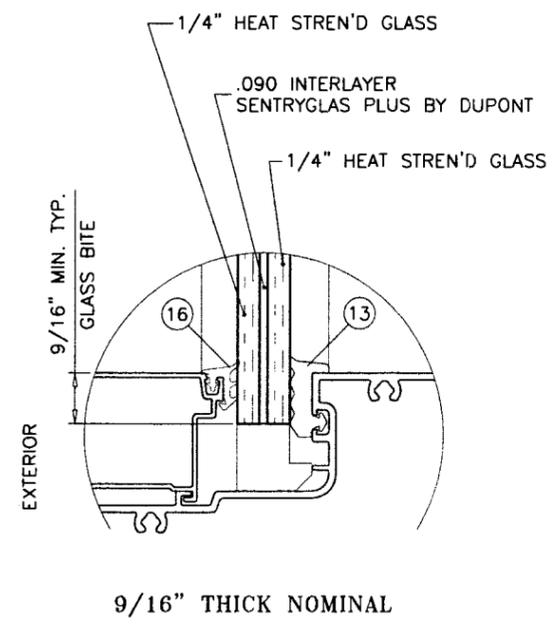

LAMINATED GLASS
LARGE MISSILE IMPACT
DRY GLAZED

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

JA
JUL 09 2010

Approved as complying with the
Florida Building Code
Date 12/09/2010
NOA# 10-0702-06
Miami Dade Product Control
Division
By *[Signature]*

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE W07-40YKK

YKK AP AMERICA INC.
332 FIRETOWER ROAD
DUBLIN, GEORGIA 31021
TEL. (478) 277-1955 FAX (478) 277-1978

YHS-50 FS ALUM FLUSH GLAZE STOREFRONT SYS. (L.M.) (N.I.)

no	date	description	by	REV. PER BCCO COMMENTS
A	02.08.10			

revisions:

date: 04-19-06
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:


drawing no.
W07-40
sheet 1 of 6

NOMINAL DIMS.		DESIGN LOAD CAPACITY-PSF		
WIDTH (W)	FRAME HEIGHT	EXT. (+)	INT. (-)	
36"	72"	65.0	65.0	
39"		65.0	65.0	
42"		65.0	65.0	
45"		65.0	65.0	
48"		65.0	65.0	
51"		65.0	65.0	
54"		65.0	65.0	
57"		65.0	65.0	
60"		65.0	65.0	
63"		65.0	65.0	
66"		65.0	65.0	
69"		65.0	65.0	
72"		65.0	65.0	
36"		78"	65.0	65.0
39"	65.0		65.0	
42"	65.0		65.0	
45"	65.0		65.0	
48"	65.0		65.0	
51"	65.0		65.0	
54"	65.0		65.0	
57"	65.0		65.0	
60"	65.0		65.0	
63"	65.0		65.0	
66"	65.0		65.0	
69"	60.0		60.0	
72"	60.0		60.0	
36"	84"		65.0	65.0
39"		65.0	65.0	
42"		65.0	65.0	
45"		65.0	65.0	
48"		65.0	65.0	
51"		65.0	65.0	
54"		65.0	65.0	
57"		65.0	65.0	
60"		65.0	65.0	
63"		60.0	60.0	
66"		60.0	60.0	
69"		60.0	60.0	
36"		86-1/2"	65.0	65.0
39"			65.0	65.0
42"	65.0		65.0	
45"	65.0		65.0	
48"	65.0		65.0	
51"	65.0		65.0	
54"	65.0		65.0	
57"	65.0		65.0	
60"	65.0		65.0	
63"	60.0		60.0	
66"	60.0		60.0	
69"	60.0		60.0	


NOMINAL DIMS.		DESIGN LOAD CAPACITY-PSF		
WIDTH (W)	FRAME HEIGHT	EXT. (+)	INT. (-)	
36"	90"	65.0	65.0	
39"		65.0	65.0	
42"		65.0	65.0	
45"		65.0	65.0	
48"		65.0	65.0	
51"		65.0	65.0	
54"		64.1	64.1	
57"		60.7	60.7	
60"		60.0	60.0	
63"		60.0	60.0	
66"		60.0	60.0	
36"		96"	65.0	65.0
39"			65.0	65.0
42"			65.0	65.0
45"	63.4		63.4	
48"	60.0		60.0	
51"	60.0		60.0	
54"	60.0		60.0	
57"	60.0		60.0	
60"	60.0		60.0	
36"	102" △		65.0	65.0
39"			61.0	61.0
42"			60.0	60.0
45"			60.0	60.0
48"			60.0	60.0
51"		60.0	60.0	
54"		60.0	60.0	
57"		58.5	58.5	
36"		108" △	60.0	60.0
39"			60.0	60.0
42"			60.0	60.0
45"			60.0	60.0
48"			58.6	58.6
51"			55.1	55.1
54"	52.1		52.1	
36"	114" △		60.0	60.0
39"			60.0	60.0
42"			56.9	56.9
45"			53.1	53.1
48"			49.8	49.8
51"			46.9	46.9
36"			120" △	56.9
39"		52.6		52.6
42"		48.8		48.8
45"		45.5		45.5
48"		42.7		42.7

△ WITH REINF. CHANNEL


NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS).

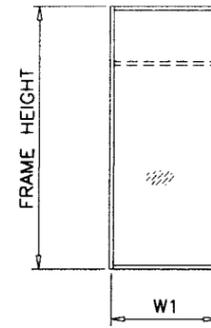


$$\text{WIDTH (W)} = W1 \text{ (JAMB)}$$

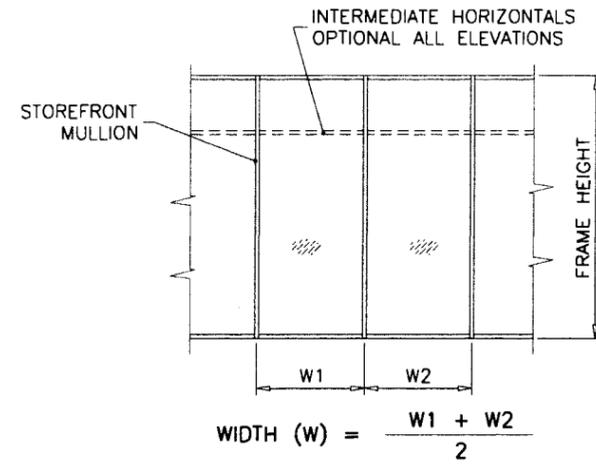


$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

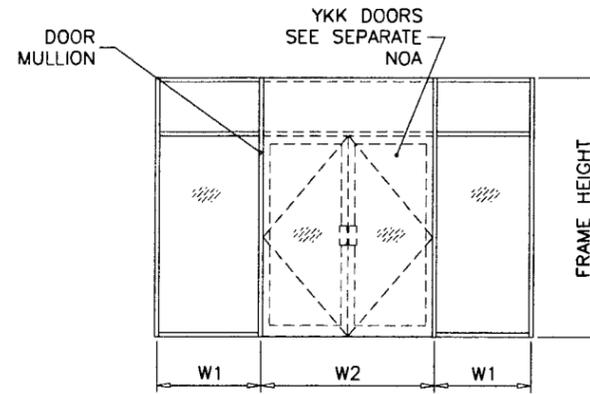


$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

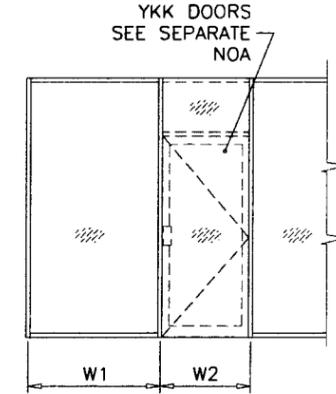

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

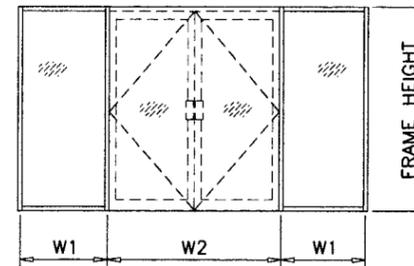

$$\text{WIDTH (W)} = \frac{W1}{2} + \frac{W2}{4}$$

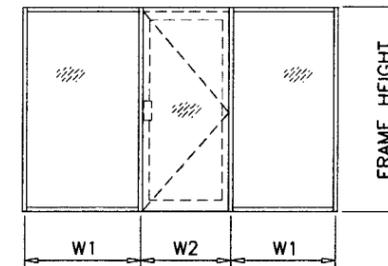

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

JUL 09 2010

Approved as complying with the
Florida Building Code
Date 12/09/2010
NOA# 10-0902.06
Miami Dade Product Control
Division

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE/W07-40YKK






YHS-50 FS ALUM FLUSH GLAZE STOREFRONT SYS. (L.M.) (N.J.)
YKK AP AMERICA INC.
332 FIRETOWER ROAD
DUBLIN, GEORGIA 31021
TEL.(478) 277-1955 FAX(478) 277-1978

no.	date	by	description
A	02.08.10		REV. PER BCCO COMMENTS

date: 04-19-06
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W07-40
sheet 2 of 6

FRAME HEIGHT
EXTERIOR

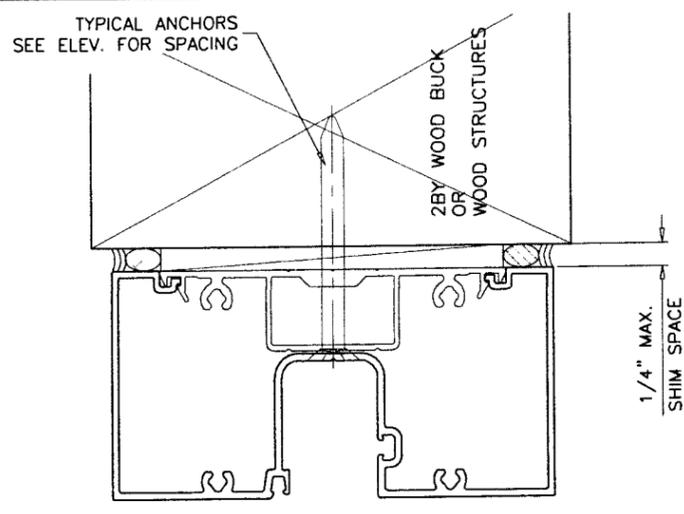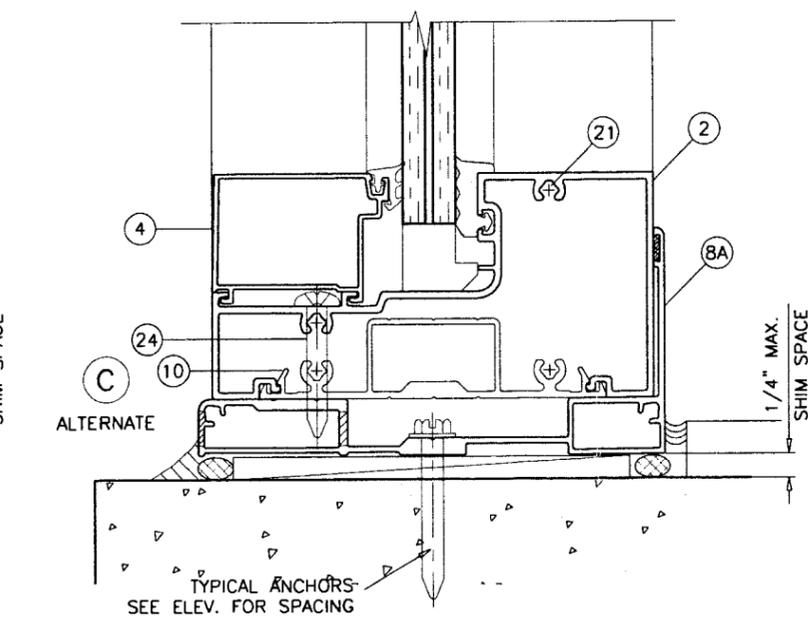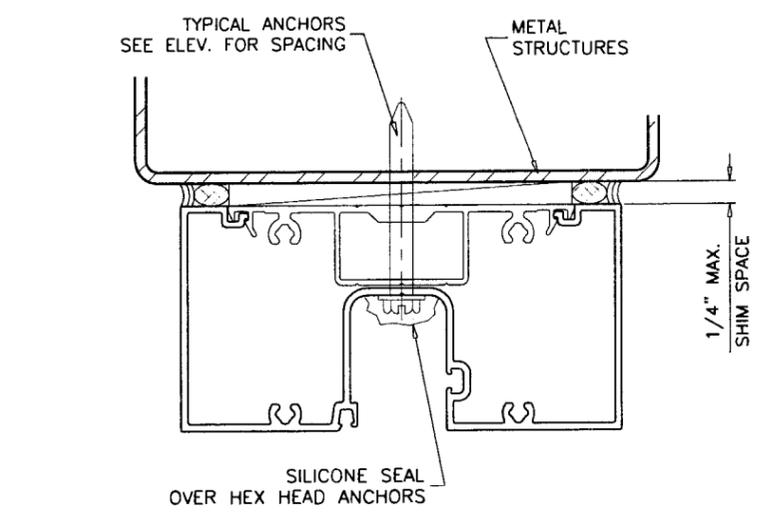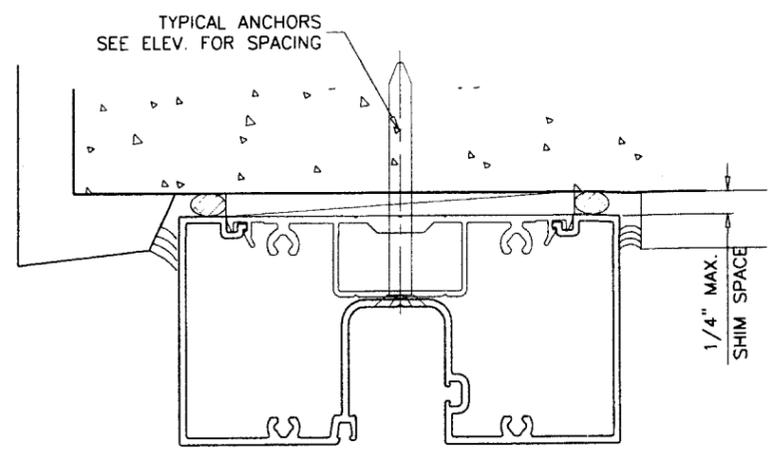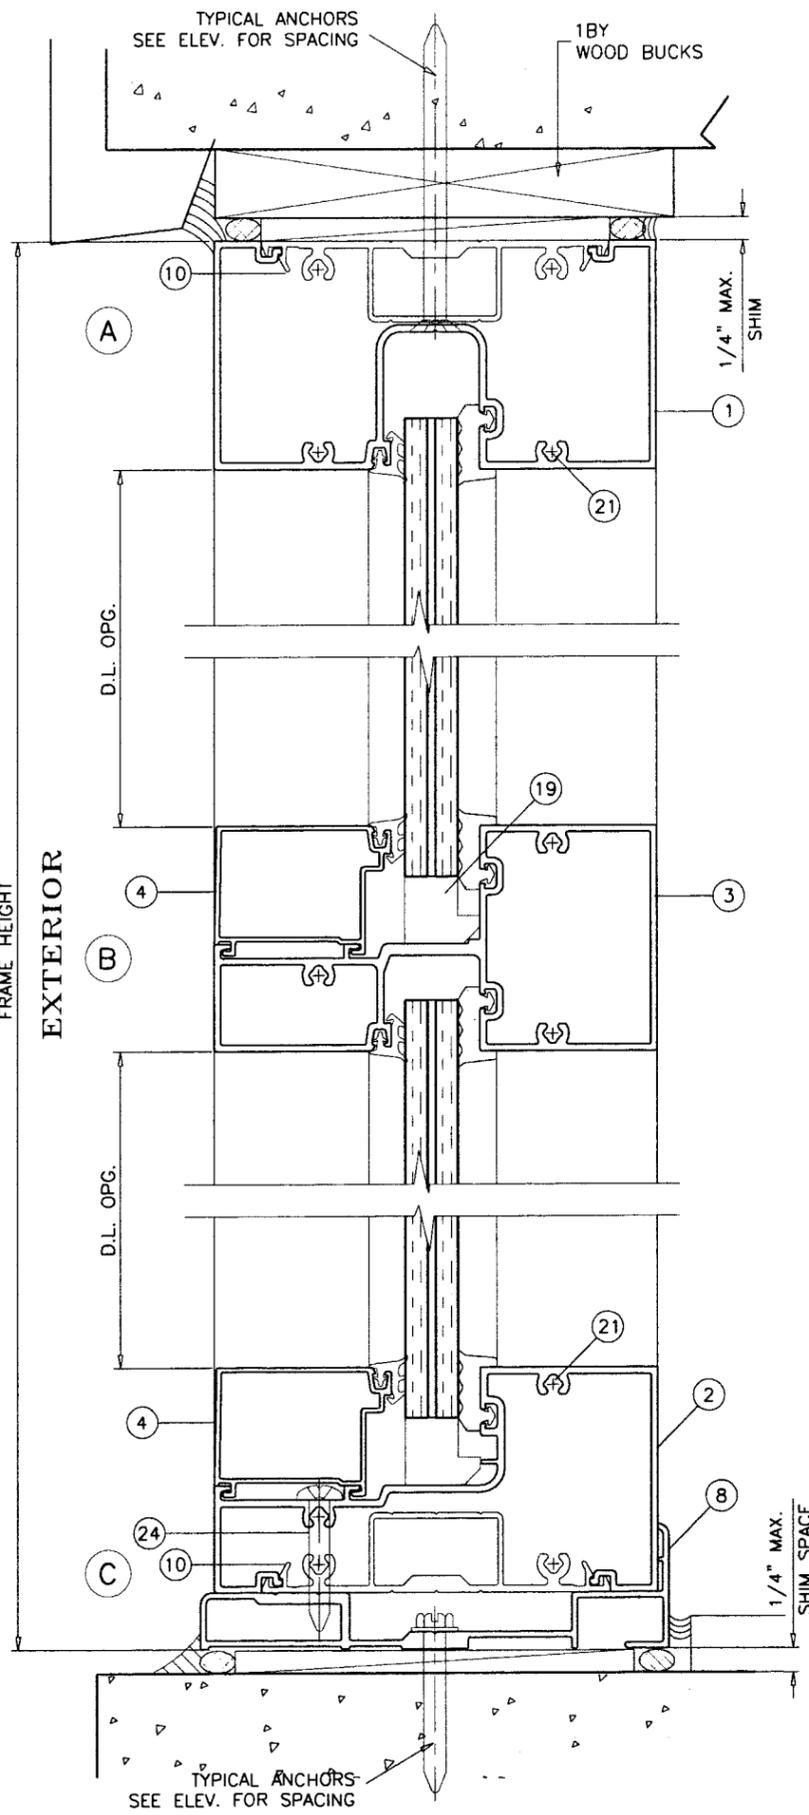

WOOD BUCKS AND METAL STRUCTURES NOT BY YKK AP MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
1/4" DIA. TEKS/SELF DRILLING SCREWS (GRADE 5 CRS)
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

SEALANTS:
 ALL FRAME CORNERS SEALED WITH DOW-795 SILICONE SEALANT.

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 JUL 09 2010

Approved as complying with the
 Florida Building Code
 Date 12/09/2010
 NOA# 10-0902-06
 Miami Dade Product Control
 Division

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 STORE W07-40YKK


YHS-50 FS ALUM FLUSH GLAZE STOREFRONT SYS. (L.M.) (N.U.)

YKK AP AMERICA INC.
 332 FIRETOWER ROAD
 DUBLIN, GEORGIA 31021
 TEL.(478) 277-1955 FAX(478) 277-1978


no	date	by	description
A	02.08.10	REV. PER BCCO COMMENTS	

date: 04-19-06
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W07-40
 sheet 3 of 6

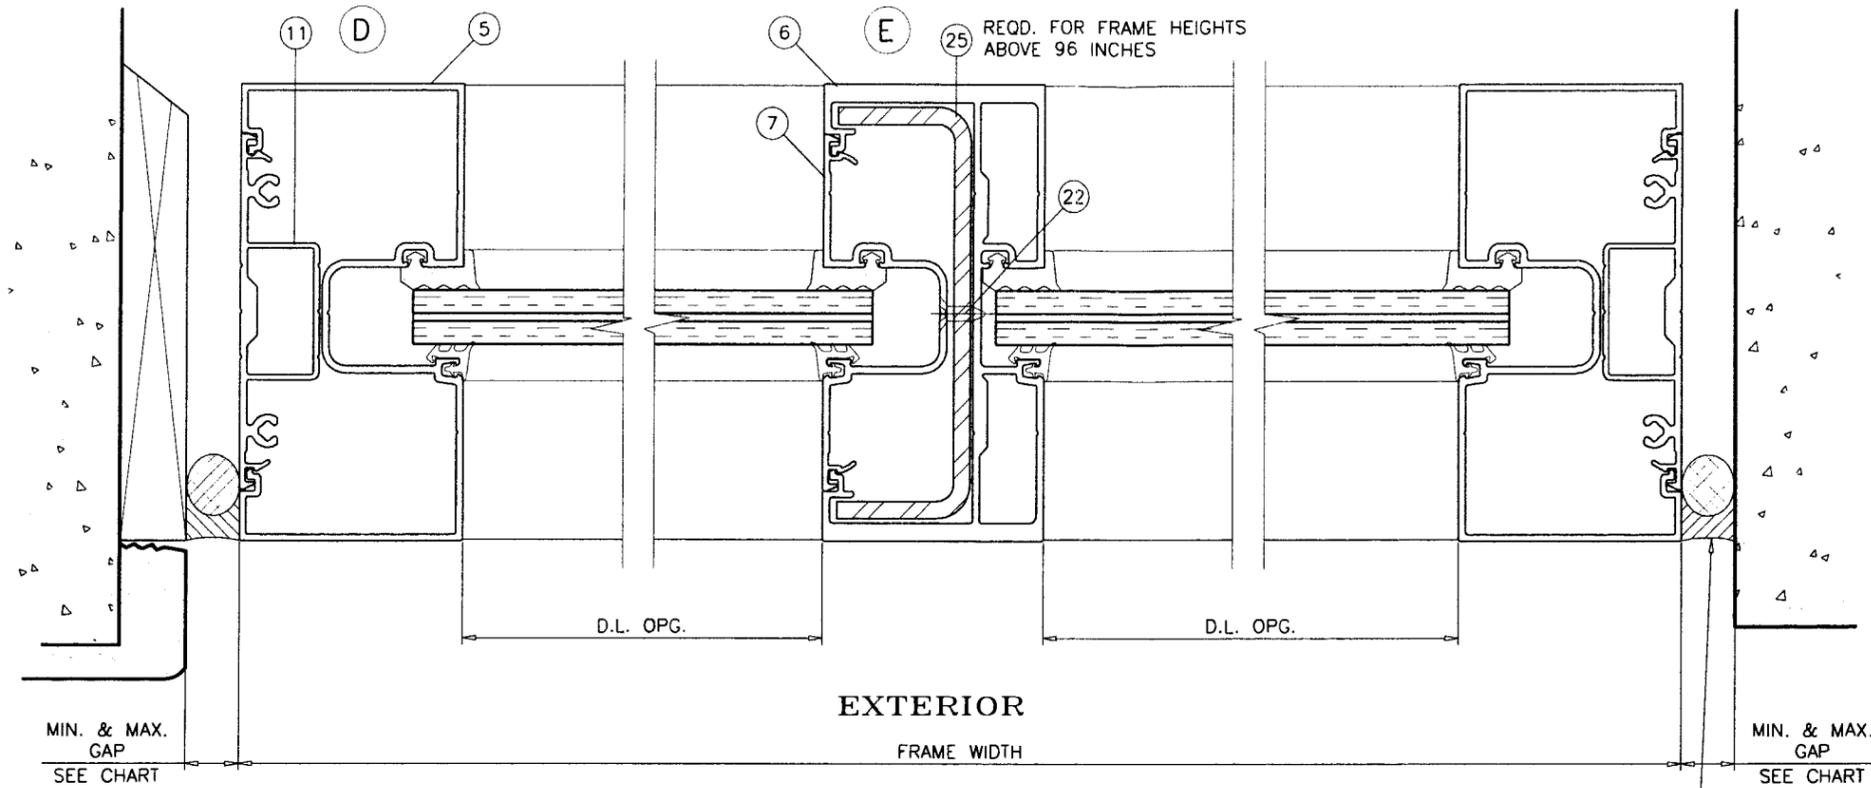

MAX. FRAME HEIGHT	GAP	
	MIN.	MAX.
72"	3/8"	3/4"
84"	7/16"	3/4"
96"	1/2"	3/4"
108"	9/16"	3/4"
120"	5/8"	3/4"

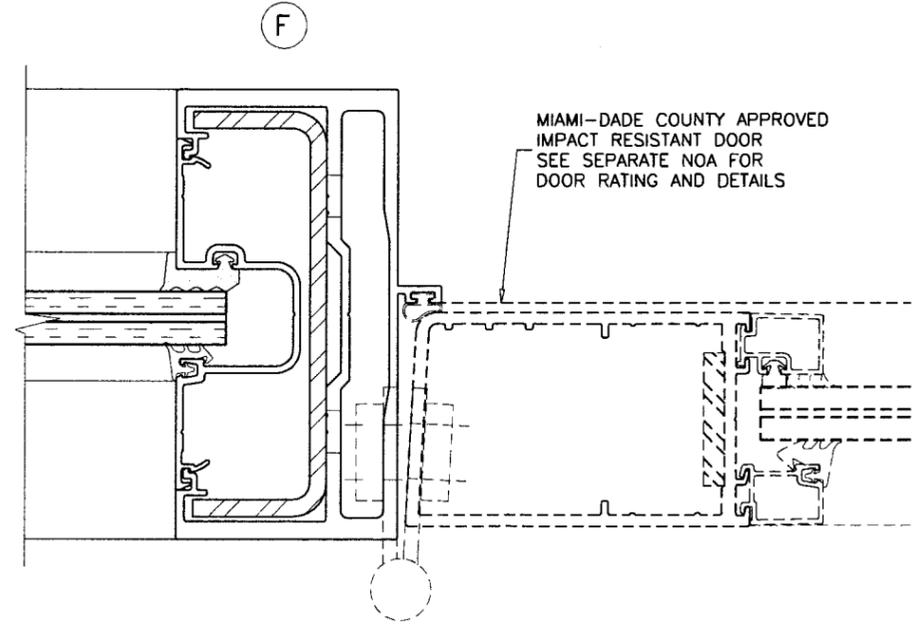

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

JA

JUL 09 2010

Approved as complying with the
 Florida Building Code
 Date: 7/9/2010
 NOA# 10-0902-06
 Miami Dade Product Control
 Division
 By: *[Signature]*

af c

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978

YHS-50 FS ALUM FLUSH GLAZE STOREFRONT SYS. (L.M.) (N.J.)

YKK AP AMERICA INC.
 332 FIRETOWER ROAD
 DUBLIN, GEORGIA 31021
 TEL. (478) 277-1955 FAX (478) 277-1978

YKK AP

revisions:

no	date	by	description
A	02.08.10	REV. PER. BCCO	COMMENTS


date: 04-19-06
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W07-40


sheet 4 of 6

STORE W07-40YKK


ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	E9-0601	AS REQD.	FRAME HEAD	6063-T5	-
2	E9-0615	AS REQD.	FRAME SILL	6063-T5	-
3	E9-0603	AS REQD.	FRAME HORIZONTAL	6063-T5	-
4	E9-0608	AS REQD.	GLAZING STOP	6063-T5	-
5	E9-0604	AS REQD.	FRAME JAMB	6063-T5	-
6	E9-0605	AS REQD.	MULLION	6063-T5	-
7	E9-0606	AS REQD.	POCKET FILLER	6063-T5	-
8	E9-0616	AS REQD.	SILL FLASHING	6063-T5	-
8A	E9-0619	AS REQD.	ALT. SILL FLASHING	6063-T5	-
10	E1-1071	AS REQD.	ANCHOR PLATE, 11" LONG	6063-T5	-
11	E9-0614	AS REQD.	FILLER CONTINUOUS	6063-T5	-
13	E2-0088	AS REQD.	INTERIOR GLAZING GASKET	EPDM SPONGE	-
16	E2-0083	AS REQD.	EXTERIOR GLAZING GASKET	EPDM	DUROMETER 60 ±5
18	E2-0094	AS REQD.	SIDE BLOCK	EPDM	-
19	E2-0080	AS REQD.	SETTING BLOCK	EPDM	-
21	PC-1216	AS REQD.	#12 X 1" SMS	STEEL	FOR SCREW SPLINE
22	FF-1008	AS REQD.	#10 X 1/2" SMS	STEEL	FOR GLAZING POCKET FILLER
23	PC-1408	AS REQD.	#14 X 1/2" SMS	STEEL	FOR THRESHOLD
24	PC-1424	AS REQD.	#14 X 1-1/2" SMS	STEEL	FOR SILL
25	E1-1062	AS REQD.	REINFORCING CHANNEL	STEEL	LENGTH = FRAME HT. - 6 5/8"

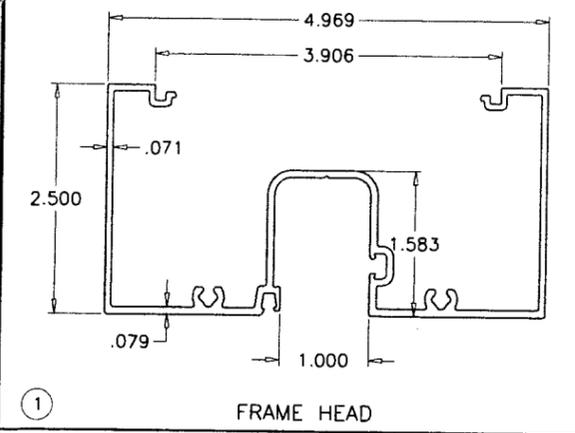


① FRAME HEAD

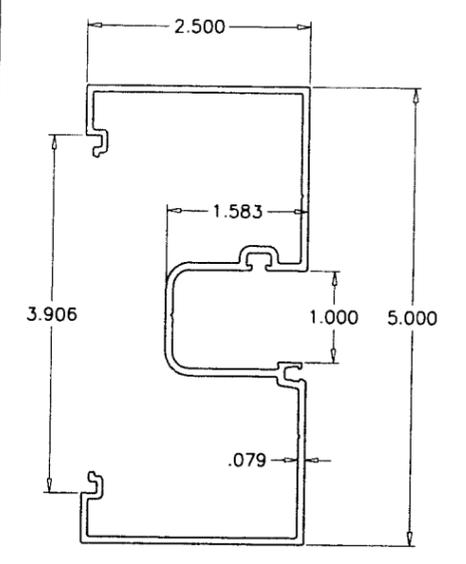


⑤ FRAME JAMB

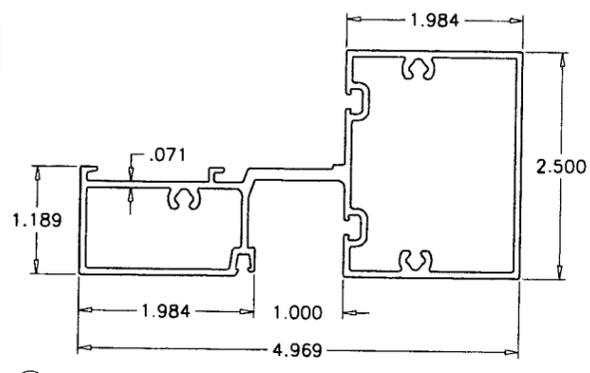


③ FRAME HORIZONTAL

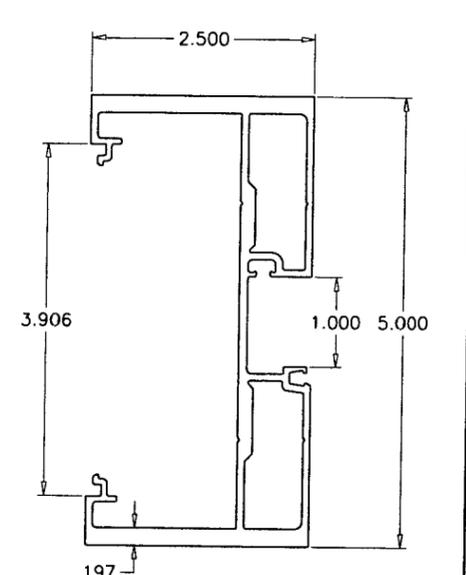


⑥ MULLION

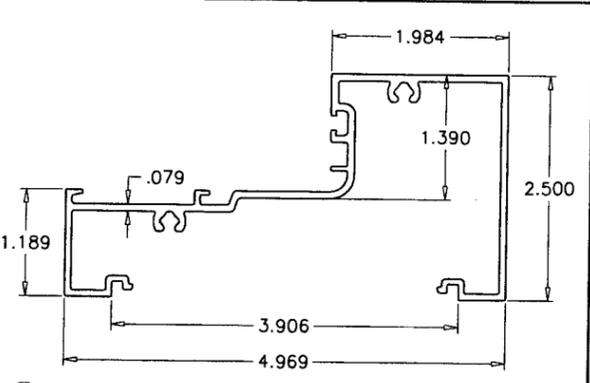


② FRAME SILL

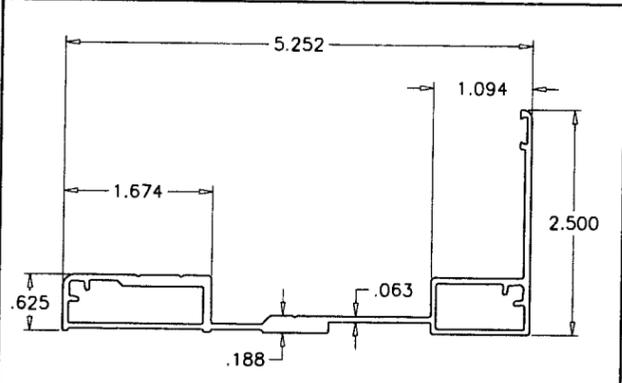


⑧A ALT. SILL FLASHING

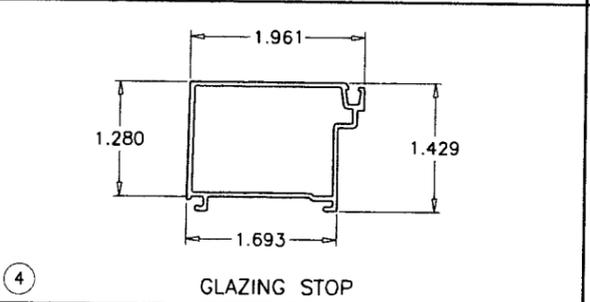


④ GLAZING STOP

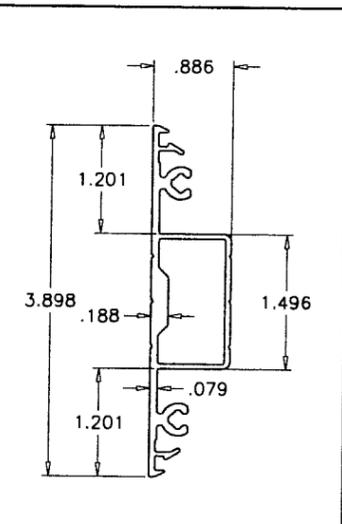


⑩ ANCHOR PLATE/FILLER

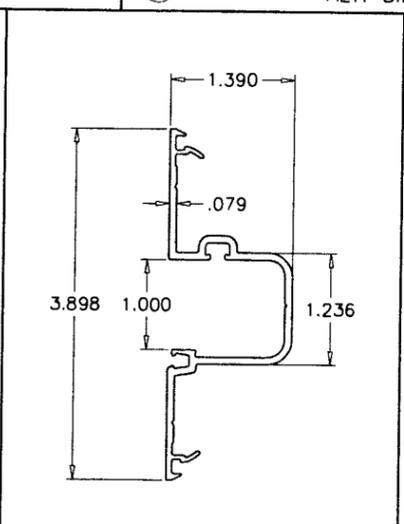

⑦ POCKET FILLER

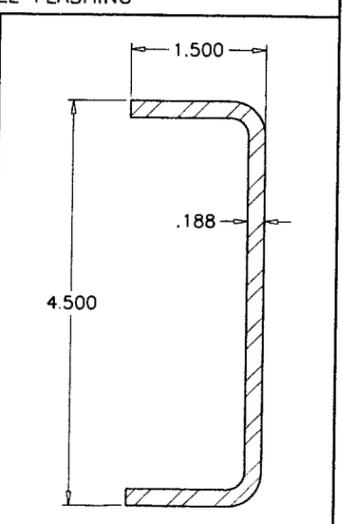

⑫ STEEL REINFORCING 36 KSI MIN.

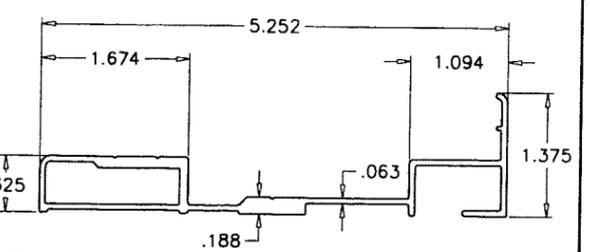

⑧ SILL FLASHING

afC
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 STORE \ W07 - 40YKK

YHS-50 FS ALUM FLUSH GLAZE STOREFRONT SYS. (L.M.) (N.J.)
YKK AP AMERICA INC.
 332 FIRETOWER ROAD
 DUBLIN, GEORGIA 31021
 TEL. (478) 277-1955 FAX (478) 277-1978


no	date	by	description
A	02.08.10		REV. PER BCCO COMMENTS

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538


 JUL 09 2010

Approved as complying with the
 Florida Building Code
 Date 12/09/2010
 NOA# 10-6902.06
 Miami Dade Product Control
 Division
 By

date: 04-19-06
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:
 drawing no.
W07-40
 sheet 5 of 6

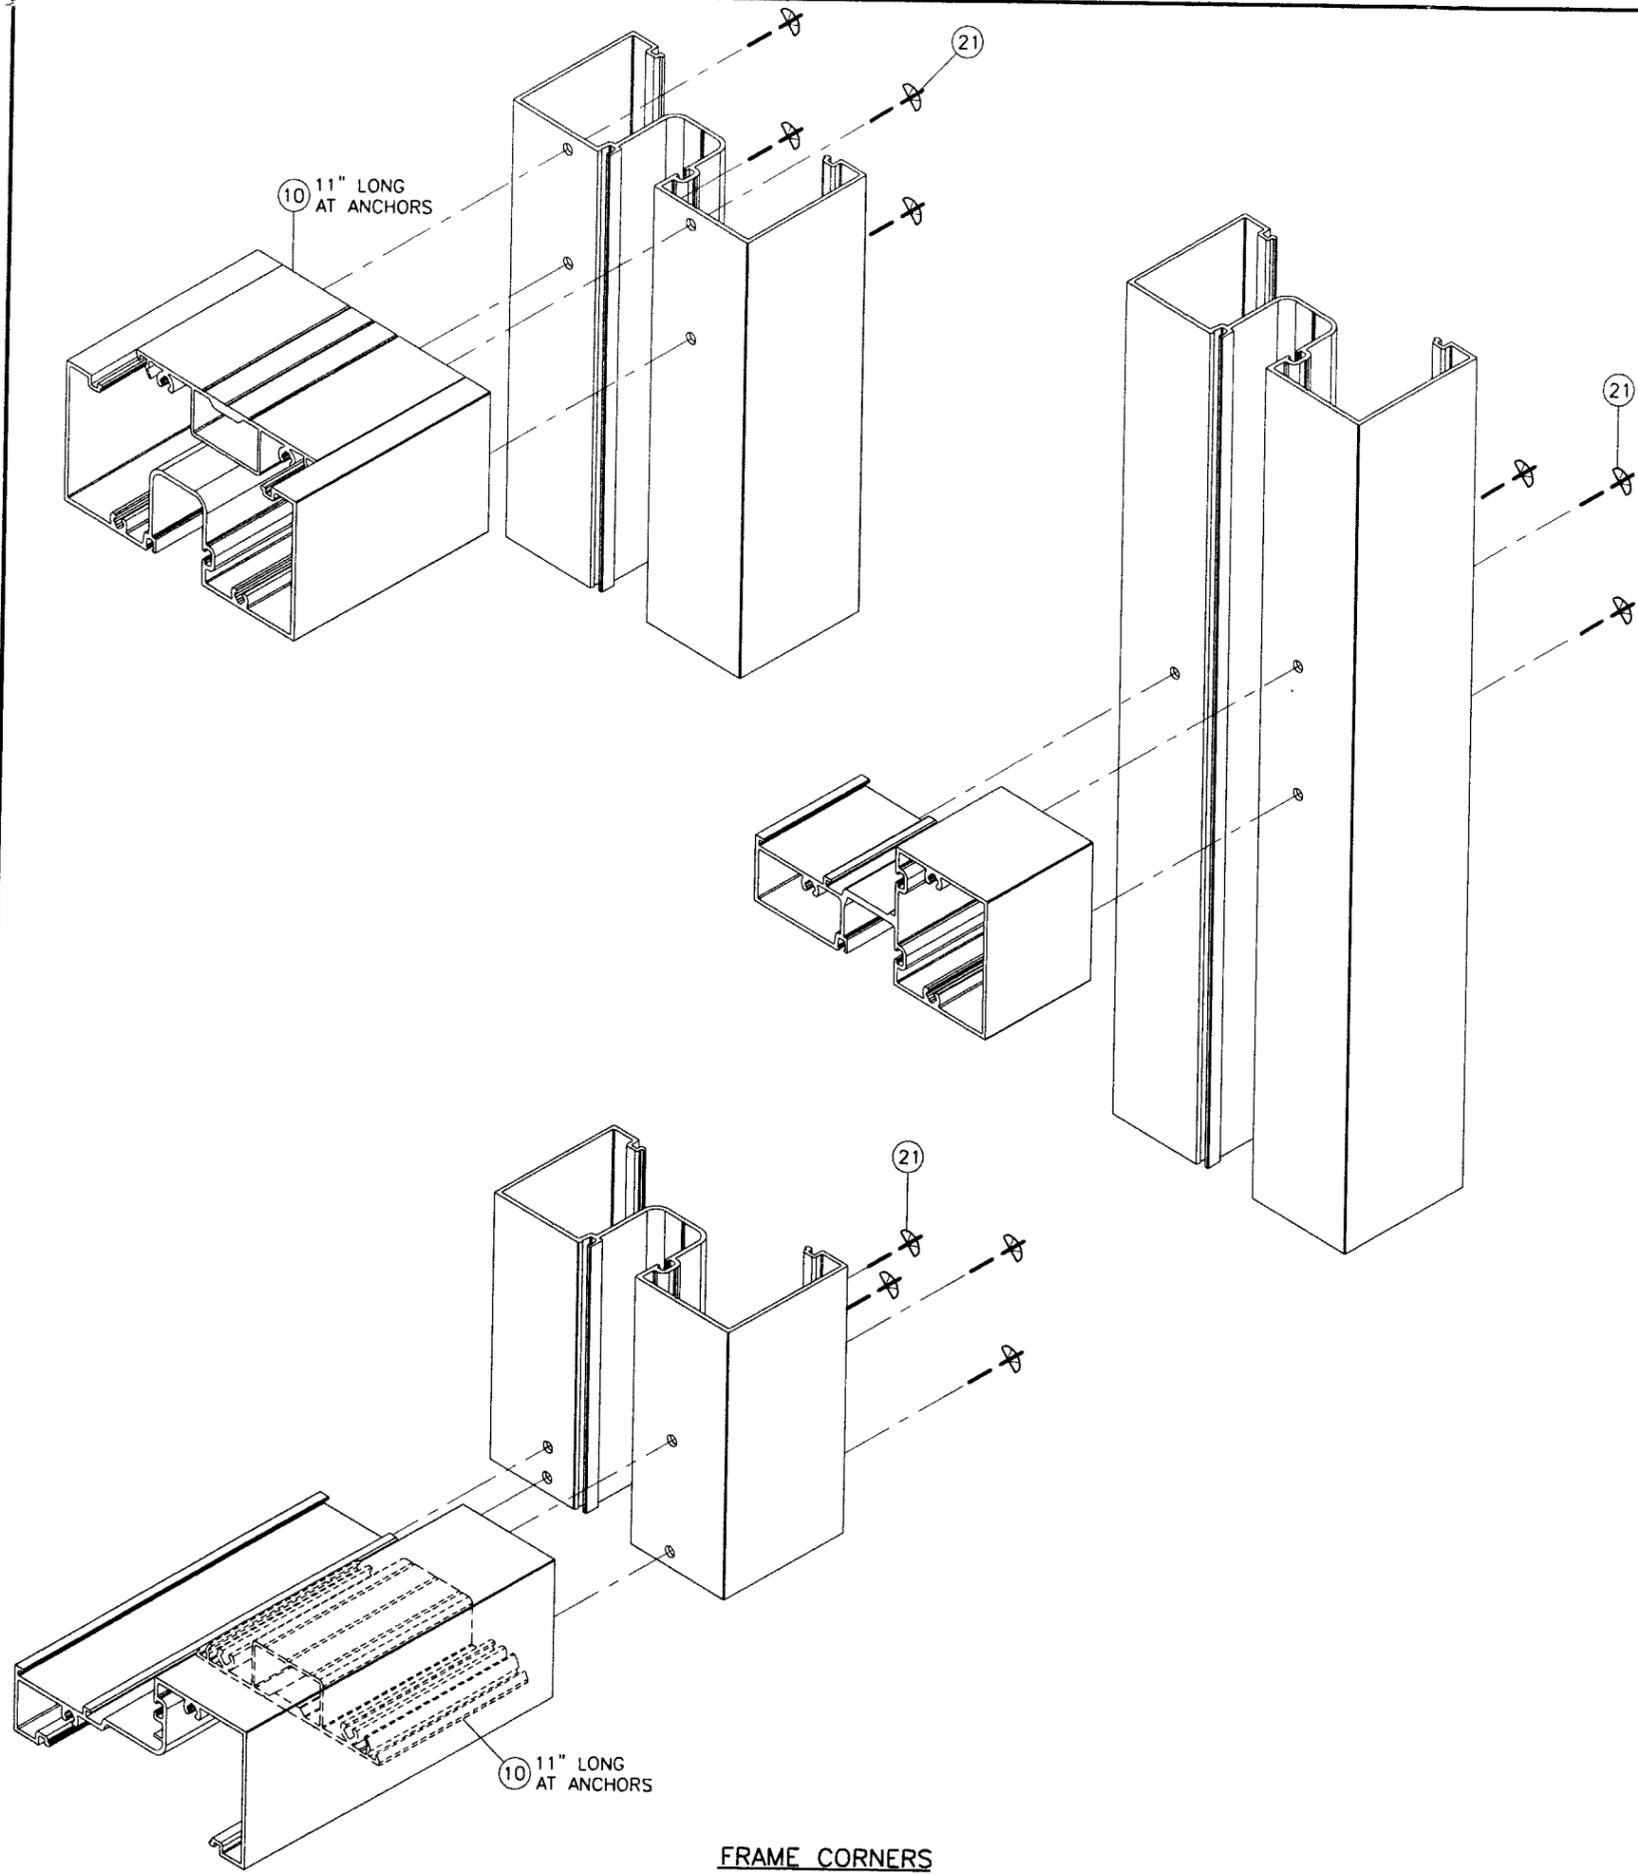

FRAME CORNERS

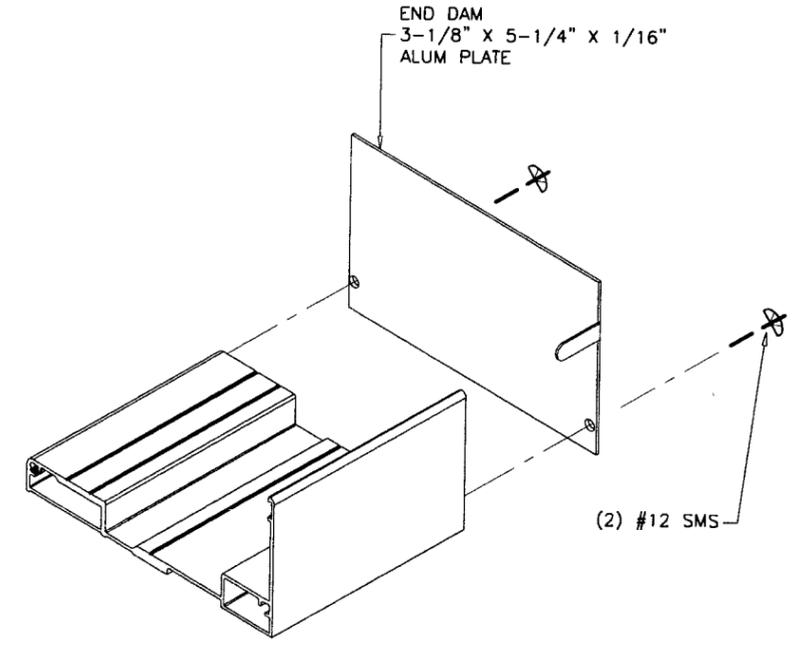

END DAM DETAIL

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

JA

JUL 09 2010

Approved as complying with the
 Florida Building Code
 Date 12/09/2010
 NOA# 10-0902-06
 Miami Dade Product Control
 Division
 By *[Signature]*

a f c

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 STORE \ W07 - 40YKK

YHS-50 FS ALUM FLUSH GLAZE STOREFRONT SYS. (L.M.) (N.J.)

YKK AP AMERICA INC.
 332 FIRETOWER ROAD
 DUBLIN, GEORGIA 31021
 TEL. (478) 277-1955 FAX (478) 277-1978

no.	date	by	description
A	02.08.10		REV. PER BCCO COMMENTS

date:	04-19-06
scale:	3/8" = 1"
dr. by:	HAMID
chk. by:	

drawing no.
W07-40

sheet 6 of 6