

**NOTICE OF ACCEPTANCE (NOA)**[www.miamidade.gov/building/home/asp](http://www.miamidade.gov/building/home/asp)

M. Q. Windows

1855 Griffin Road, Suite A-271

Dania, Fl. 33004

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Section and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: JS Series Inswing Glazed Wood Doors-LMI**

**APPROVAL DOCUMENT:** Drawing No JS-4-IN, titled "JS Inswing Wood Door" Sheets 1 through 13 of 13, dated 01-10-98 and last revised on DEC 06, 2010, prepared by manufacturer, signed and sealed by Scott Wolters, P. E. , bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large & Small Missile Impact Resistant****Limitation:**

1. Raised Wood panels are limited to max. area specified, in combination with Glass.
2. Smaller Door sizes must comply as permitted by FBC requirements.

**LABELING:** Each unit shall bear a permanent label with M.Q. Windows, **Ste-Agathe des Monts, Quebec, Canada** and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises & renews NOA # 06-0208.03 and consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**

**MIAMI-DADE COUNTY  
APPROVED**NOA No 10-0902.10  
Expiration Date: April 20, 2016  
Approval Date: December 30, 2010  
Page 1\*  
2/1/11

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **JS-4-IN**, titled "JS Inswing Wood Door" Sheets 1 through 13 of 13, dated 01-10-98 and last revised on DEC 06, 2010, prepared by manufacturer, signed and sealed by Scott Wolters, P. E.

**B. TESTS (Test reports transferred from file # 06-0208.03)**

1. Test reports on
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94.
  - 3) Water Resistance Test, per FBC, TAS 202-94.
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

Along with the manufacturer's parts drawings, installation diagram and marked-up drawings of an Inswing / outswing wood door prepared by Hurricane Test Laboratory, LLC, Test Report No (s). **HTL-0118-0131.03** (sample #3), **HTL-0118-0507.03**, **HTL-0118-0722.03**, all dated 2/3/03 to 7/30/03, signed and sealed by Vinu J. Abraham, P.E, signed and sealed by Vinu J. Abraham, P.E. &

Also the manufacturer's parts drawings, installation diagram and marked-up drawings of a shaped wood Windows prepared by Hurricane Test Laboratory, LLC, Test Report No **HTL-0118-0204.03**, dated 2/12-13/03, signed and sealed by Vinu J. Abraham, P.E.

2. Additional test reports transferred from file # **99-1228.06**:

2.1 Test Report No. **HTL-0118-1103-98(Sp# 1, 2, 3 & 7)**, **HTL-0118-1006-98 (Sp4 & 7)** **HTL-0118-1218-98 (Sp#1)**, **HTL-0118-0702-99 (Sp#1)**, along with manufacturer's parts and section marked drawings prepared by Hurricane Testing Laboratories, dated 10/15//98 thru 07-06-99, signed and sealed by Timothy S. Marshall, P.E., for the following tests:

- 1) Air Infiltration Test, per PA 202-94
- 2) Uniform Static Air Pressure Test, Loading per PA 202-94
- 3) Water Resistance Test, per PA 202-94.
- 4) Large Missile Impact test, per SFBC and PA201-94
- 5) Cyclic loading test, per SFBC and PA203-94
- 6) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94


2.2. Test report on HTL-0118-0702-99

- 1) Large Missile Impact test, per SFBC and PA201-94
- 2) Cyclic loading test, per SFBC and PA203-94

Along with manufacturer's parts and section drawings marked by Hurricane Testing Laboratory Inc, for specimen #1(MQ-8), signed and sealed by Vinu Abraham, P.E.

2.3. Structural Test reports for HTL-0118-0702-99 (Specimen #1(MQ-8) & Specimen#2(MQ-7) and HTL-0118-1103-98(Specimen #1(MQ1)), along with manufacturer's parts and section marked-up drawings, prepared by Hurricane Testing Laboratory Inc, signed and sealed by Vinu Abraham, P.E

- 1) Air Infiltration Test, per PA 202-94
- 2) Uniform Static Air Pressure Test, Loading per PA 202-94
- 3) Water Resistance Test, per PA 202-94.

  
Ishaq I. Chanda, P.E.

Product Control Examiner

NOA No 10-0902.10

Expiration Date: April 20, 2016

Approval Date: December 30, 2010

**M. Q. Windows**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**C. CALCULATIONS (Transferred from file # 06-0208.03)**

1. Statement letter dated 12-06-10, issued by Wolters Engineering Inc., of Succeeding Engineer adopting the another Engineer's work and engineering responsibilities, signed and sealed by Scott Wolters, P.E.
2. Anchor verification calculations complying w/ FBC-2004, prepared by Tilteco Inc., dated 09/28/05, 03/03/06 and last revised on 03-29-2006, signed and sealed by Walter A. Tillit, Jr., P.E.(transferred from files #06-0208.03& #99-1228.06).
3. Glazing complies w/ ASTM E-1300-02 & -04

**D. QUALITY ASSURANCE**

1. Miami Dade Building and Neighborhood Compliance Department (BNC).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. 06-0216.06, issued to Solutia Inc, for "Saflex III G interlayer", expiring 05/21/2011.

**F. STATEMENTS**

1. Statement letter dated 12-06-10, issued by Wolters Engineering Inc., of Succeeding Engineer adopting another Engineer's work, signed and sealed by Scott Wolters, P.E.
2. Stateman letter of conformance and "no financial interest", dated 12-06-10, signed and sealed by Scott Wolters, P. E.
3. Statement letter, issued by MQ windows, dated July 14, 2010 stating the product has not change and requesting renewal, signed by Sylvain Marcotte.
4. Statement letters of compliance, part of the above test reports.
5. Addendum letter dated 04-27-00 for test reports, HTL-0118-1103-98 (Sp#1),-0118-1006-98(Sp#2) , 0118-0702-99(Sp#1 (MQ-8)) and 0118-0702-99(Sp#2 (MQ-7)), prepared by Hurricane Testing Laboratories, , reviewed, signed and sealed by Vinu Abraham, P.E. (Transferred from file # # 99-1228.06)
6. Distribution agreement MQ Windows, Canada and MQ Windows Inc, Dania, Florida dated Nov 30, 201, signed by Gilles Morin, president.

**G. OTHER**

1. This NOA revises & renews # 06-0208.03, expiring April 20, 2011.
2. Test proposals dated 3/26/02 thru 09/05/02, approved by BCCO.
3. Test proposal 98-0073 dated August 3, 1998& October 14, 1998, approved by BCCO.

*Ishaq I. Chanda*

Ishaq I. Chanda, P.E.  
Product Control Examiner  
NOA No 10-0902.10  
Expiration Date: April 20, 2016  
Approval Date: December 30, 2010

DOORS, INSWING  
ELEVATION VIEWS  
CONFIGURATIONS: x, xx  
WOOD: Mahogany  
VIEWED FROM THE INSIDE

**DESIGN PRESSURE  
APPLYING TO THIS PAGE**  
Acting inward: +60 psf  
Acting outward: -70 psf  
Note: All sizes noted are maximum  
sizes. Sizes smaller in width &  
height are permitted.

**GENERAL NOTES:**

- 1- THIS PRODUCT IS DESIGNED TO COMPLY WITH THE PROVISIONS OF THE HIGH VELOCITY HURRICANE ZONE OF THE 2007 EDITION OF THE FLORIDA BUILDING CODE WITH 2009 SUPPLEMENT.
- 2- THIS PRODUCT IS LARGE MISSILE IMPACT RESISTANT AND HAS BEEN TESTED IN ACCORDANCE WITH THE HIGH VELOCITY HURRICANE ZONE PROTOCOLS TAS201, 202 AND 203. NO SHUTTERS ARE REQUIRED.
- 3- WOOD BUCKS (BY OTHERS) AND OPENINGS MUST BE DESIGNED BY THE PROFESSIONAL OF RECORD TO PROPERLY TRANSFER WIND LOADS TO THE MAIN STRUCTURE.
- 4- SPECIFIED ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
- 5- IN ORDER TO VERIFY THAT ANCHORS FOR THIS PRODUCT WERE NOT OVERSTRESSED AS TESTED, A 33% ALLOWABLE STRESS INCREASE WAS NOT USED IN THEIR ANALYSIS. HOWEVER, A LOAD DURATION FACTOR OF  $C_d = 1.6$  WAS USED TO VERIFY THEIR SPACING IN WOOD SUBSTRATES.

GLAZING TYPE TABLE	
<b>GLASS: SINGLE, LAMINATED</b>	
Option 1: 15/32" (O.T.) Made of 3/16"(AN)-0.090" PVB Interlayer, Saflex IIIIG by Solutia-3/16"(HS)	
Option 2: 15/32" (O.T.) Made of 3/16"(HS)-0.090" PVB Interlayer, Saflex IIIIG by Solutia-3/16"(HS)	
<b>GLASS: DOUBLE, INSULATED</b>	
1" (O.T.) Made of: 3/16" (AN) - 0.090" PVB interlayer, Saflex IIIIG by Solutia - 3/16" (HS) - 7/16" air space - 5/32" full tempered.	
<b>RAISED WOOD PANEL:</b>	
Max. DLO area: -MDF veneer covered: Max. 18.92 sqf. Min. specific gravity $G = 0.75 = 48 \text{ lb/ft}^3 (0.769 \text{ g/cm}^3)$ . -Solid mahogany wood: Max. 7.81 sqf	
<b>NOTE:</b> -Aspect Ratio (D.L.O. Height / D.L.O. Width) must be less than or equal to 5.0 for all door sizes. -See Glazing Details on sheet 9	



1855 GRIFFIN ROAD,  
SUITE A-271  
DANIA, FL 33004

**JS SERIE  
INSWING  
WOOD DOORS  
MIAMI DADE COUNTY**




Drawing no.: JS-4-IN  
Scale: NONE Drawn by: S. Marcotte  
Date drawn: 01/10/98 Date revised: 07/14/10  
File: Page: 1/13

STRUCTURALLY REVIEWED BY:


*Scott Walters*  
SCOTT WALTERS  
FL PE# 62354

WALTERS ENGINEERING, INC.  
(COA# 27194)  
1271 GRANT STREET  
HOLLYWOOD, FL 33019  
DEC 6 2010

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 10-0902-10  
Expiration Date APR 22, 2016  
By *Charles J. Chan*  
Miami Dade Product Control  
Division

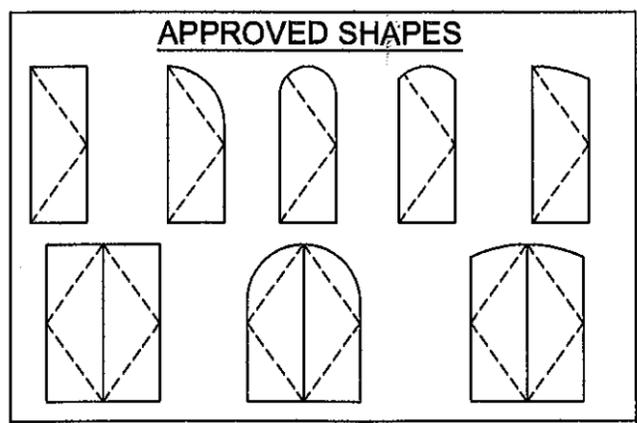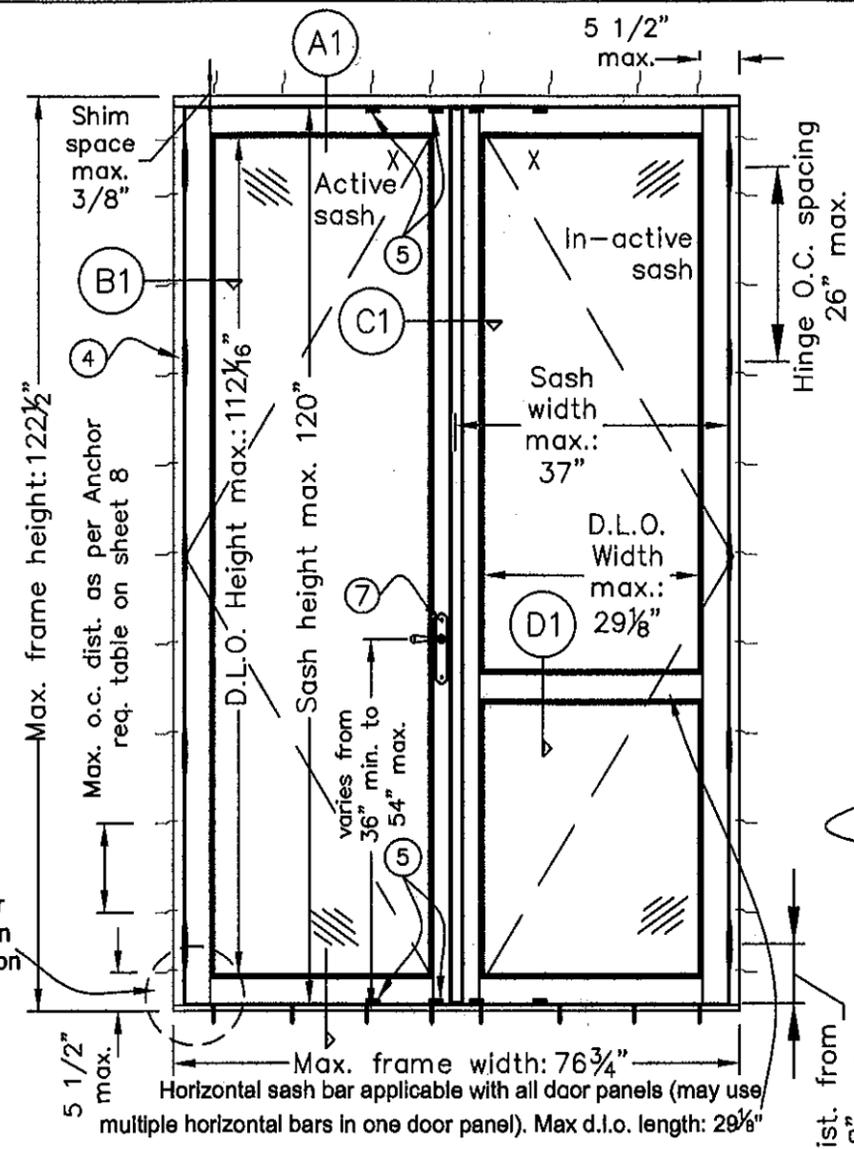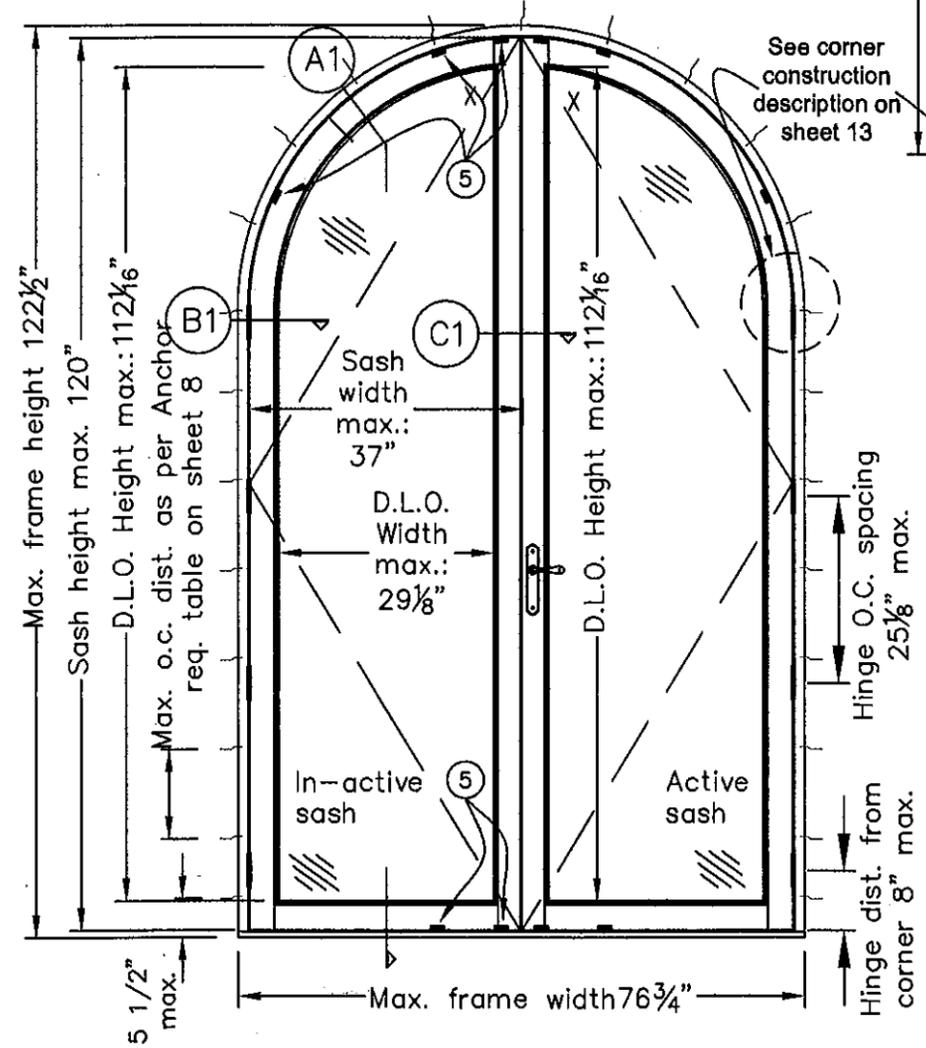


**NOTES:**  
1. Other shapes may apply providing they are similar to those shown & have corner construction as described on sheet 13.  
2. All shaped units must fit inscribed into the allowable rectangular units & be governed by the allowable pressure of the respective rectangular unit.  
3. Approved shaped heads on this sheet conform to cross section A1 on sheet 4.  
4. Keepers qty & location identical to shown arched door. For single panel full arched door, keepers at head evenly distributed.

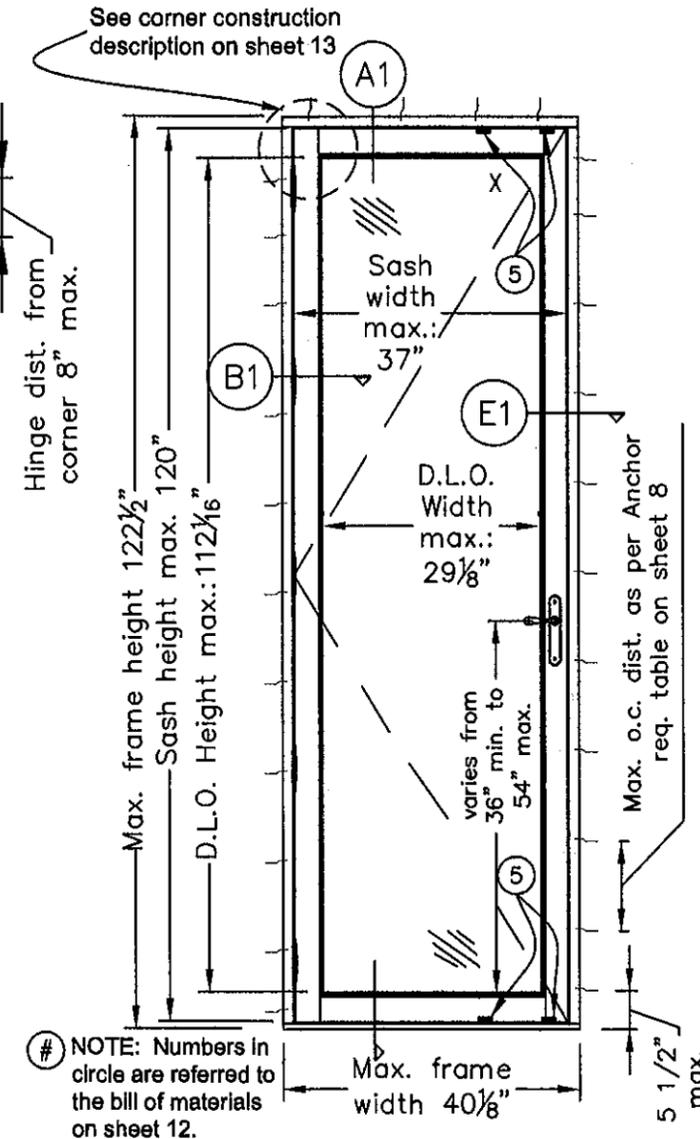


DOORS, INSWING  
NARROW PROFILES  
ELEVATION VIEWS  
CONFIGURATIONS: x, xx  
WOOD: Mahogany  
VIEWED FROM THE INSIDE


**DESIGN PRESSURE APPLYING TO THIS PAGE**  
As indicated on elevations  
Note: All sizes noted are maximum sizes. Sizes smaller in width & height are permitted.  
Shutters are not required.

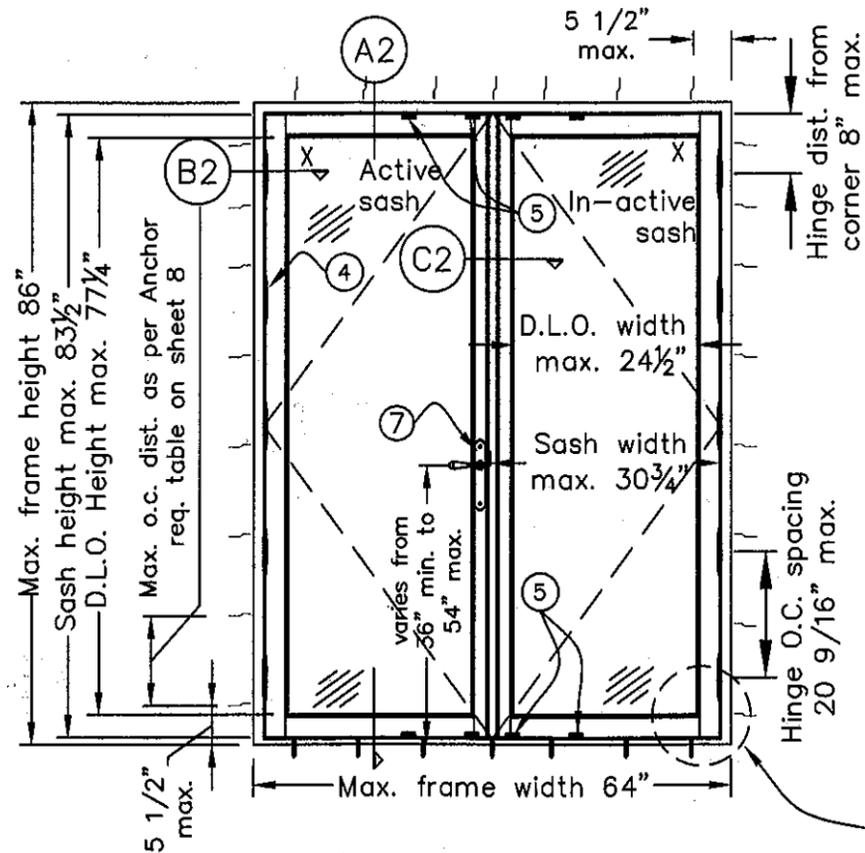

**DESIGN PRESSURE RATING**  
Acting Inward: +60.0 psf  
Acting outward: -68.0 psf

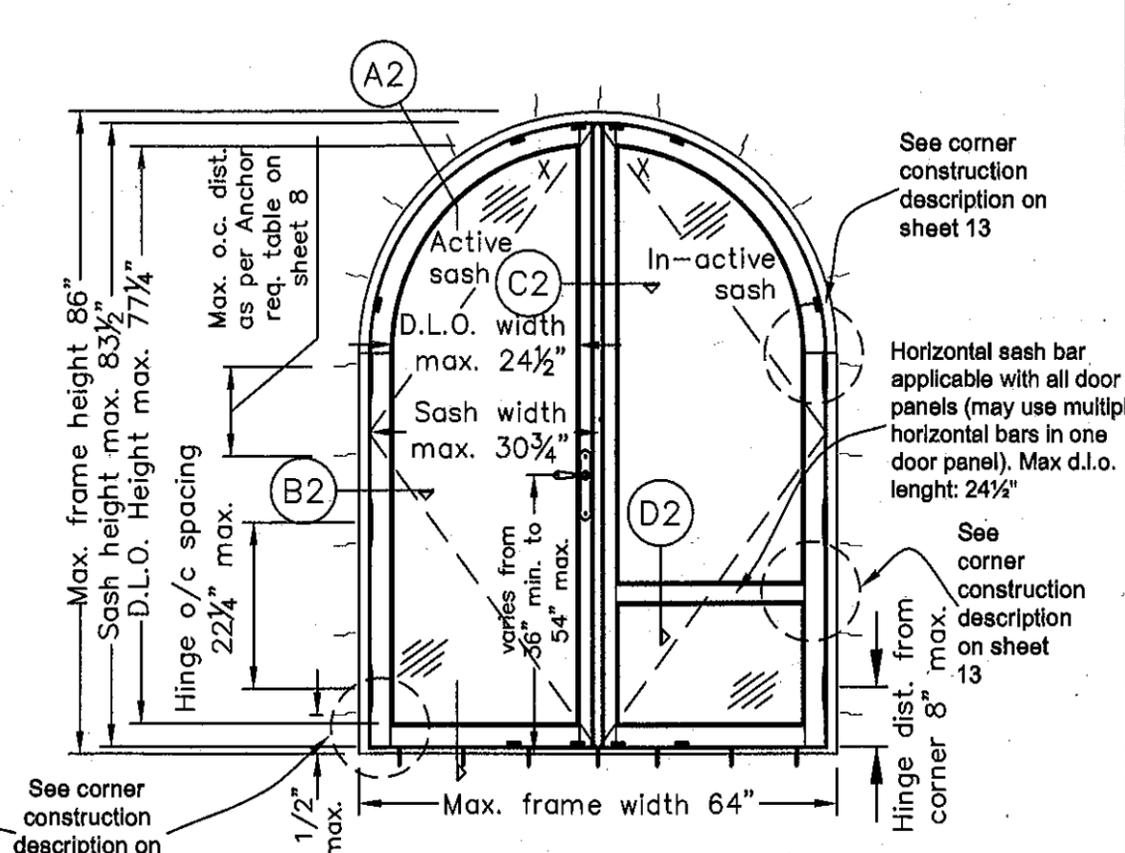


**DESIGN PRESSURE RATING**  
Acting Inward: +60.0 psf  
Acting outward: -70.0 psf

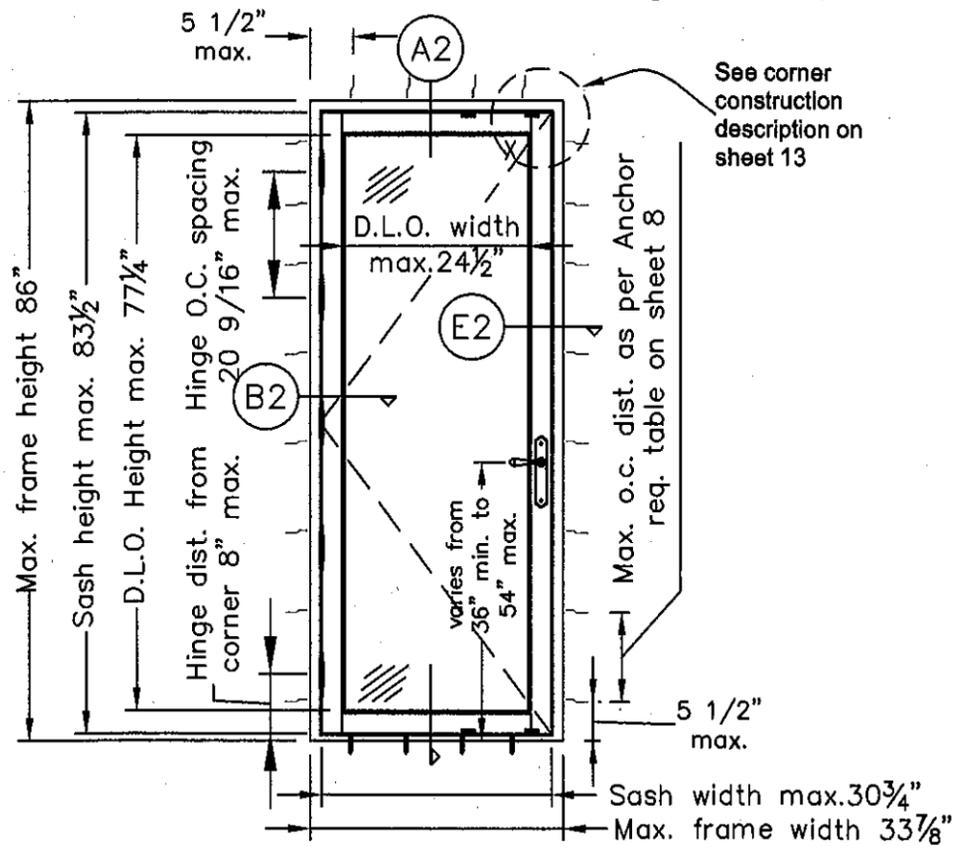

**DESIGN PRESSURE RATING:**  
Acting Inward: +60.0 psf  
Acting outward: -68.0 psf

**APPROVED SHAPES**

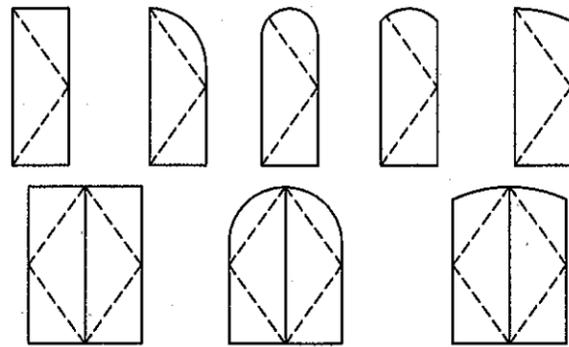

- NOTES:**
1. Other shapes may apply providing they are similar to those shown & have corner construction as described on sheet 13.
  2. All shaped units must fit inscribed into the allowable rectangular units & be governed by the allowable pressure of the respective rectangular unit.
  3. Approved shaped heads on this sheet conform to cross section A2 on sheet 4.
  4. Keepers qty & location identical to shown arched door. For single panel full arched door, keepers at head evenly distributed.

GLAZING TYPE TABLE
GLASS: SINGLE, LAMINATED
3/16"(AN)-0.090" PVB interlayer, Saflex III G by Solutia-3/16"(HS)
GLASS: DOUBLE, INSULATED
1" (O.T.) Made of: 3/16" (AN) - 0.090" PVB interlayer, Saflex III G by Solutia - 3/16" (HS) - 7/16" air space - 5/32" full tempered.
RAISED WOOD PANEL:
Max. DLO area: -MDF veneer covered: Max. 18.92 sqf. Min. specific gravity G= 0.75= 48 lb/ft3 (0.769 g/cm3). -Solid mahogany wood: Max. 7.81 sqf
NOTE: See Glazing Details on sheet 9

# NOTE: Numbers in circle are referred to the bill of materials on sheet 12.

**JS SERIE  
INSWING  
WOOD DOORS  
MIAMI DADE COUNTY**

Drawing no.: JS-4-IN  
Scale: NONE  
Date drawn: 01/10/98  
Date revised: 01/11/06  
File:   
Page: 2/13  
Drawn by: S. Marcotte  
Date revised: 01/11/06

**STRUCTURALLY REVIEWED BY:**  
*Scott Wolters*  
SCOTT WOLTERS  
FL PE# 62354  
WOLTERS ENGINEERING, INC.  
(COA# 27194)  
1271 GRANT STREET  
HOLLYWOOD, FL 33019  
DEC 6 2010

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No. 10-0902.10  
Expiration Date APR 20, 2015  
*By Ishag L. Chank*  
Miami Dade Product Control  
Division

DOORS, INSWING  
 NARROW PROFILES  
 ELEVATION VIEWS  
 CONFIGURATIONS: x, xx  
 WOOD: Mahogany  
 VIEWED FROM THE INSIDE

<b>DESIGN PRESSURE    APPLYING TO THIS PAGE</b>
Acting inward: +58 psf Acting outward: -68 psf
Note: All sizes noted are maximum sizes. Sizes smaller in width & height are permitted.
Shutters are not required.



<b>GLAZING TYPE TABLE</b>
<b>GLASS: SINGLE, LAMINATED</b>
3/16"(AN)-0.090" PVB Interlayer, Saflex IIIg by Solutia-3/16"(HS)
<b>RAISED WOOD PANEL:</b>
Max. DLO area: -MDF veneer covered: Max. 18.92 sqf. Min. specific gravity G= 0.75= 48 lb/ft3 (0.789 g/cm3). -Solid mahogany wood: Max. 7.81 sqf
<b>NOTE:</b> See Glazing Details on sheet 9

**JS SERIE  
 INSWING  
 WOOD DOORS  
 MIAMI DADE COUNTY**

Drawing no.: JS-4-IN	
Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 01/11/06
File:	Page: 3/13

**STRUCTURALLY REVIEWED BY:**  
  
 SCOTT WOLTERS  
 FL PE# 62354  
 WOLTERS ENGINEERING, INC.  
 (COA# 27194)  
 1271 GRANT STREET  
 HOLLYWOOD, FL 33019  
 DEC 6 2010

**PRODUCT REVISED**  
 as complying with the Florida Building Code  
 Acceptance No. 10-0902-10  
 Expiration Date: APR 22, 2016  
 By:   
 Miami Dade Product Control Division

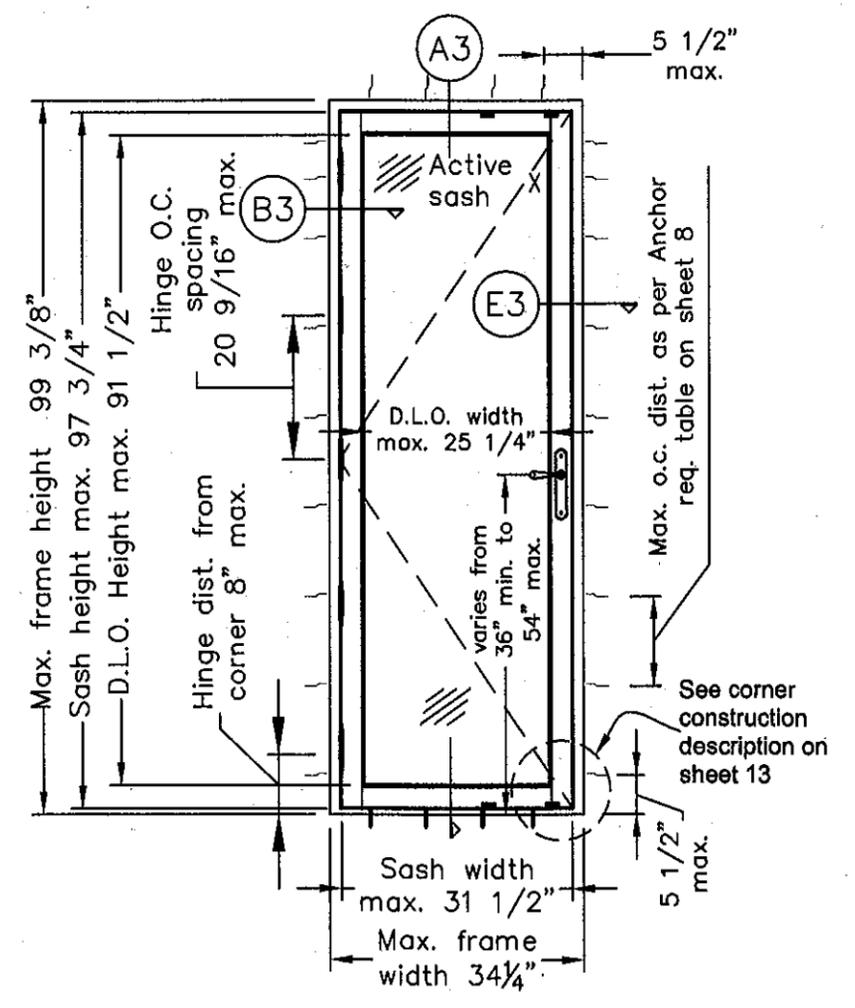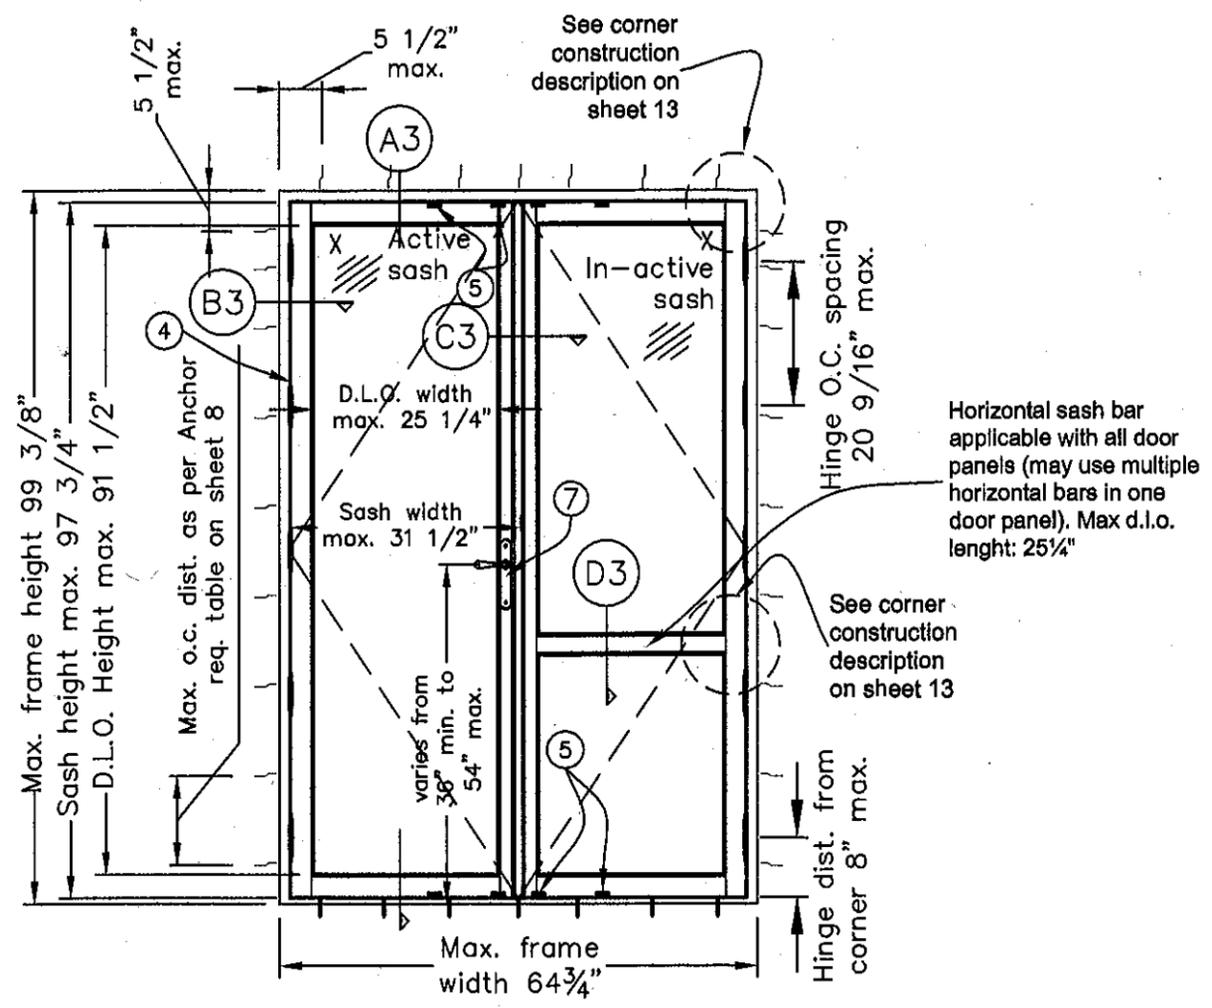

# NOTE: Numbers into circle are referring to the bill of materials on sheet 12.

# CROSS SECTION VIEWS

**JS SERIE  
 INSWING  
 WOOD DOORS  
 MIAMI DADE COUNTY**


Drawing no.: JS-4-IN	
Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 01/11/06
File:	Page: 4/13

STRUCTURALLY REVIEWED BY:

*Scott Wolters*  
 SCOTT WOLTERS  
 FL PE# 62354  
 WOLTERS ENGINEERING, INC.  
 (COA# 27194)  
 1271 GRANT STREET  
 HOLLYWOOD, FL 33019  
 DEC 6 2010


PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 10-0902-10  
 Expiration Date APR 22, 2015  
 By *Shaggy L. L...*  
 Miami Dade Product Control  
 Division

**A1 HEAD & SILL  
 IN-SWING**

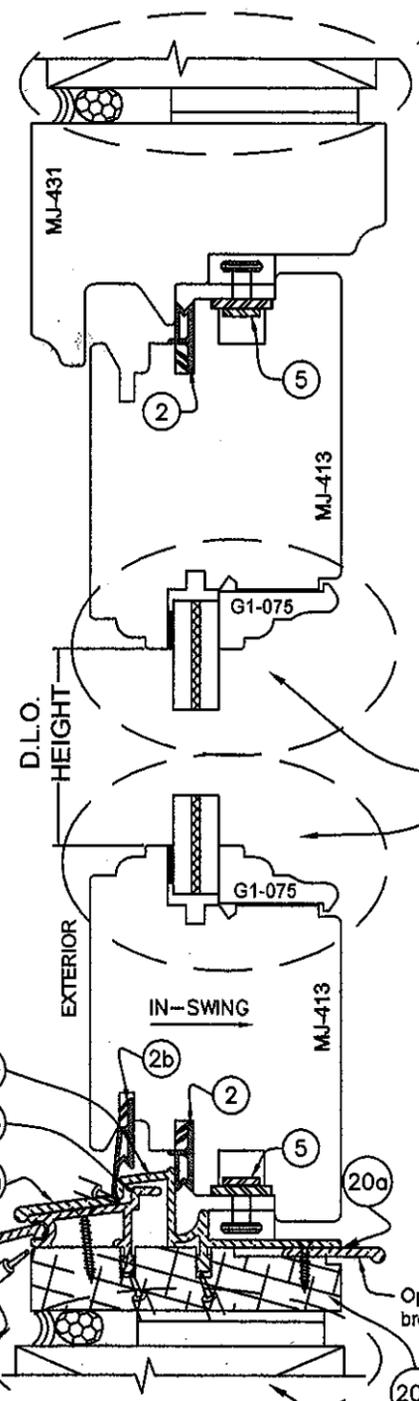

SEE ANCHORING  
 DETAILS on sheet 7 & 8


**A2 HEAD & SILL  
 IN-SWING**

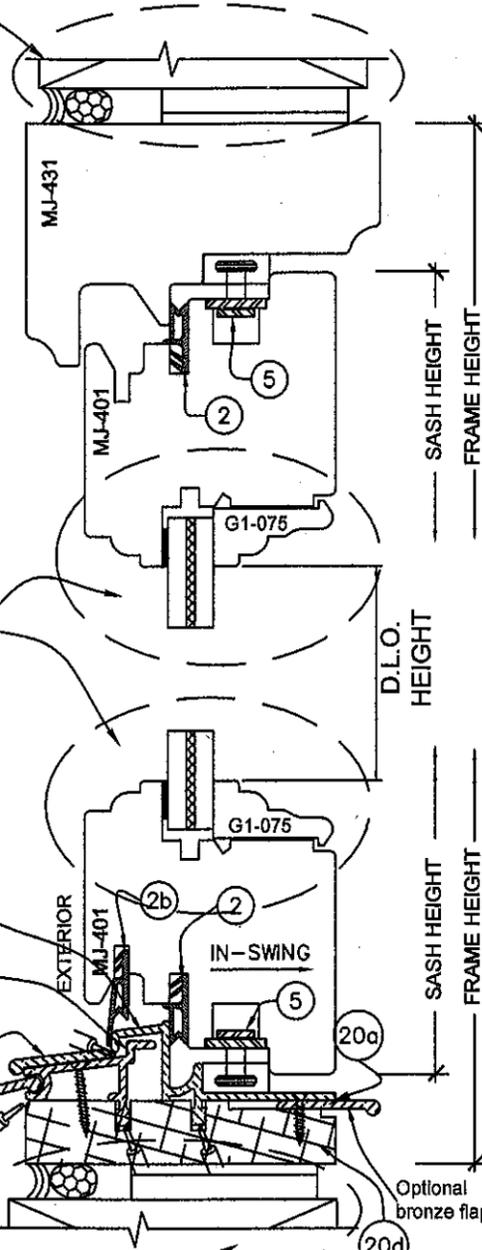

SEE GLAZING  
 DETAILS &  
 OPTIONS ON  
 sheet 9

SEE ANCHORING DETAILS  
 on sheet 7 & 8


**E1 JAMB @ Lock style  
 IN-SWING**

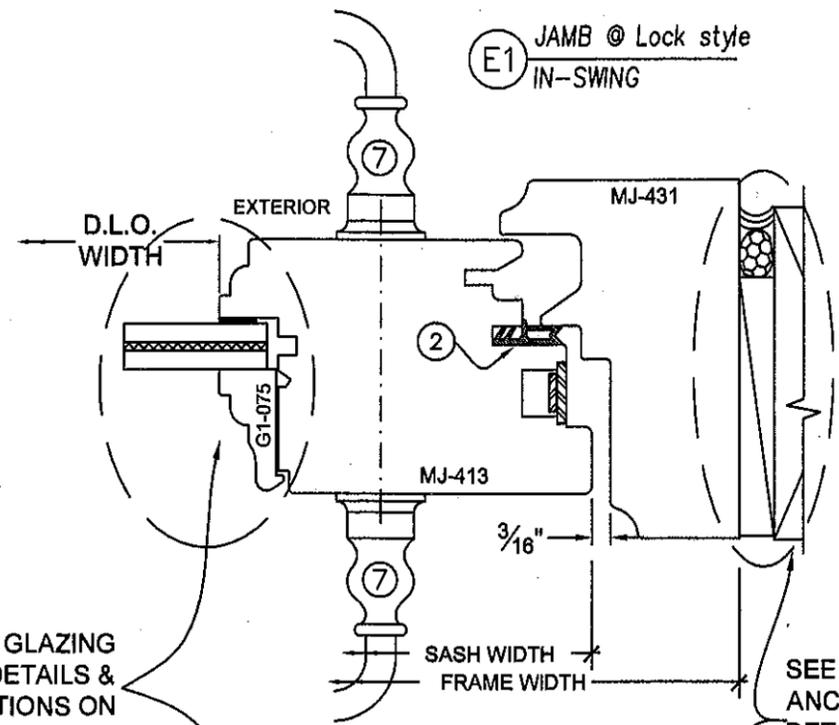

SEE GLAZING  
 DETAILS &  
 OPTIONS ON  
 sheet 9



SEE ANCHORING  
 DETAILS on  
 sheet 7 & 8

**E2 JAMB @ Lock style  
 IN-SWING**

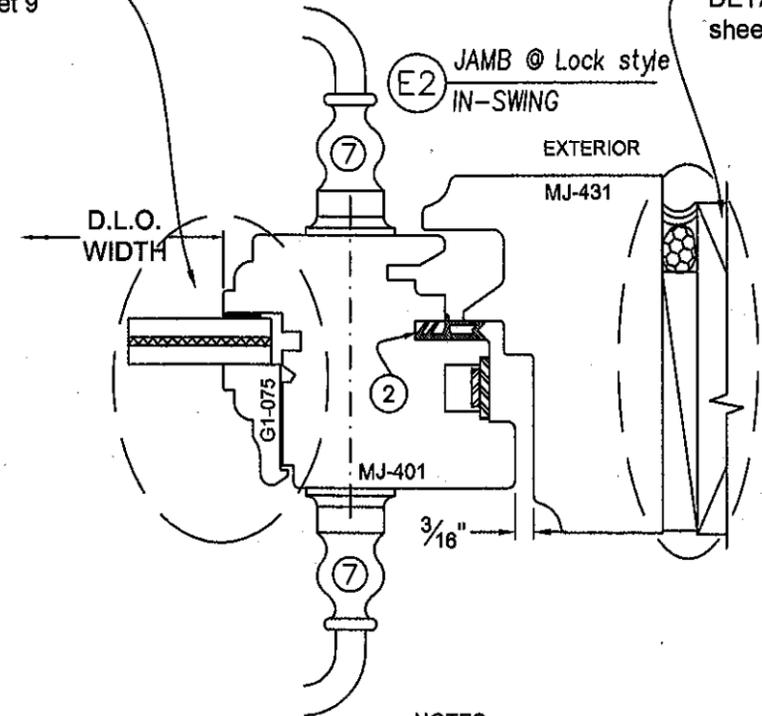

**NOTES:**

- Clear "Spectrem 2" silicone sealant at shown interfaces
- Backing rod and sealant as required
- Numbers are referring to references on bill of materials (sheet 12)

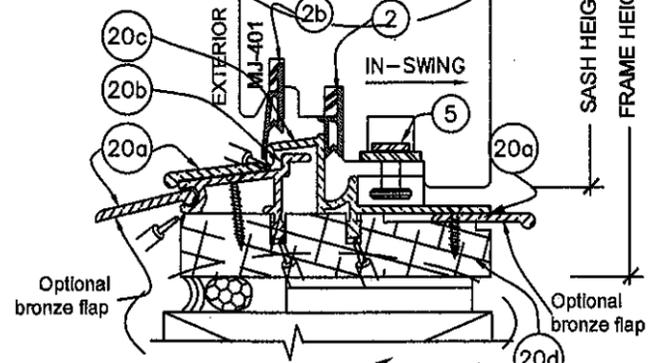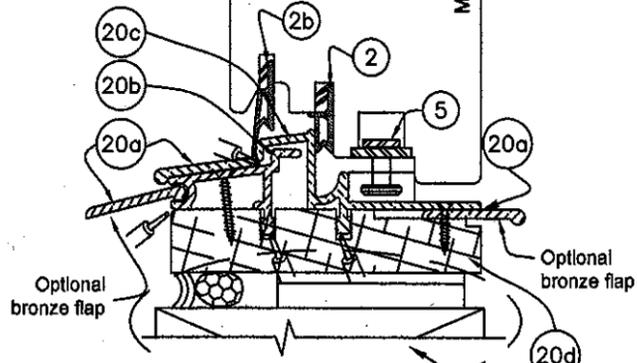

**CROSS SECTION VIEWS**

**JS SERIE  
IN-SWING  
WOOD DOORS  
MIAMI DADE COUNTY**

Drawing no.: JS-4-IN

Scale: NONE  
Drawn by: S. Marcotte

Date drawn: 01/10/98  
Date revised: 01/11/06





File: Page: 5/13

STRUCTURALLY REVIEWED BY:

*Scott Wolters*  
SCOTT WOLTERS  
FL PE# 62354

WOLTERS ENGINEERING, INC.  
(COA# 27194)  
1271 GRANT STREET  
HOLLYWOOD, FL 33019  
DEC 6 2010

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 10-0902-10  
Expiration Date APR 28, 2015  
By *Shas L. L...*  
Miami Dade Product Control  
Division

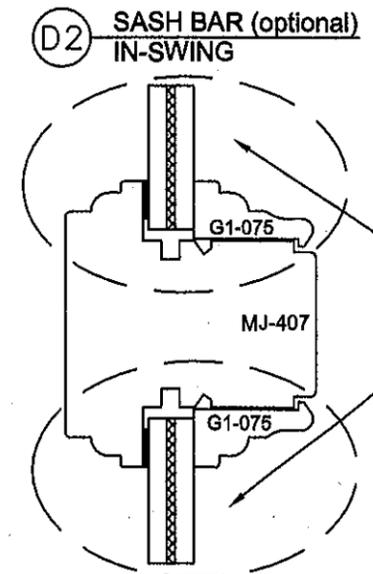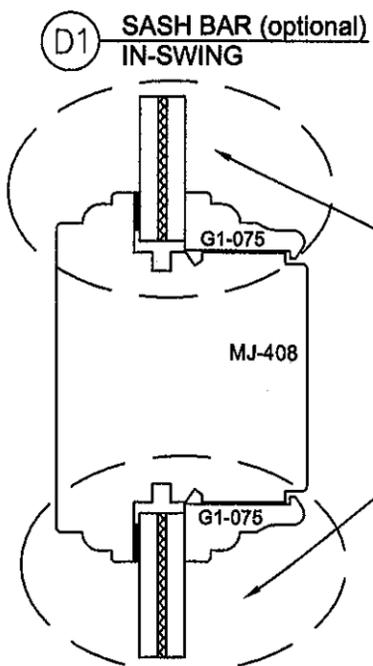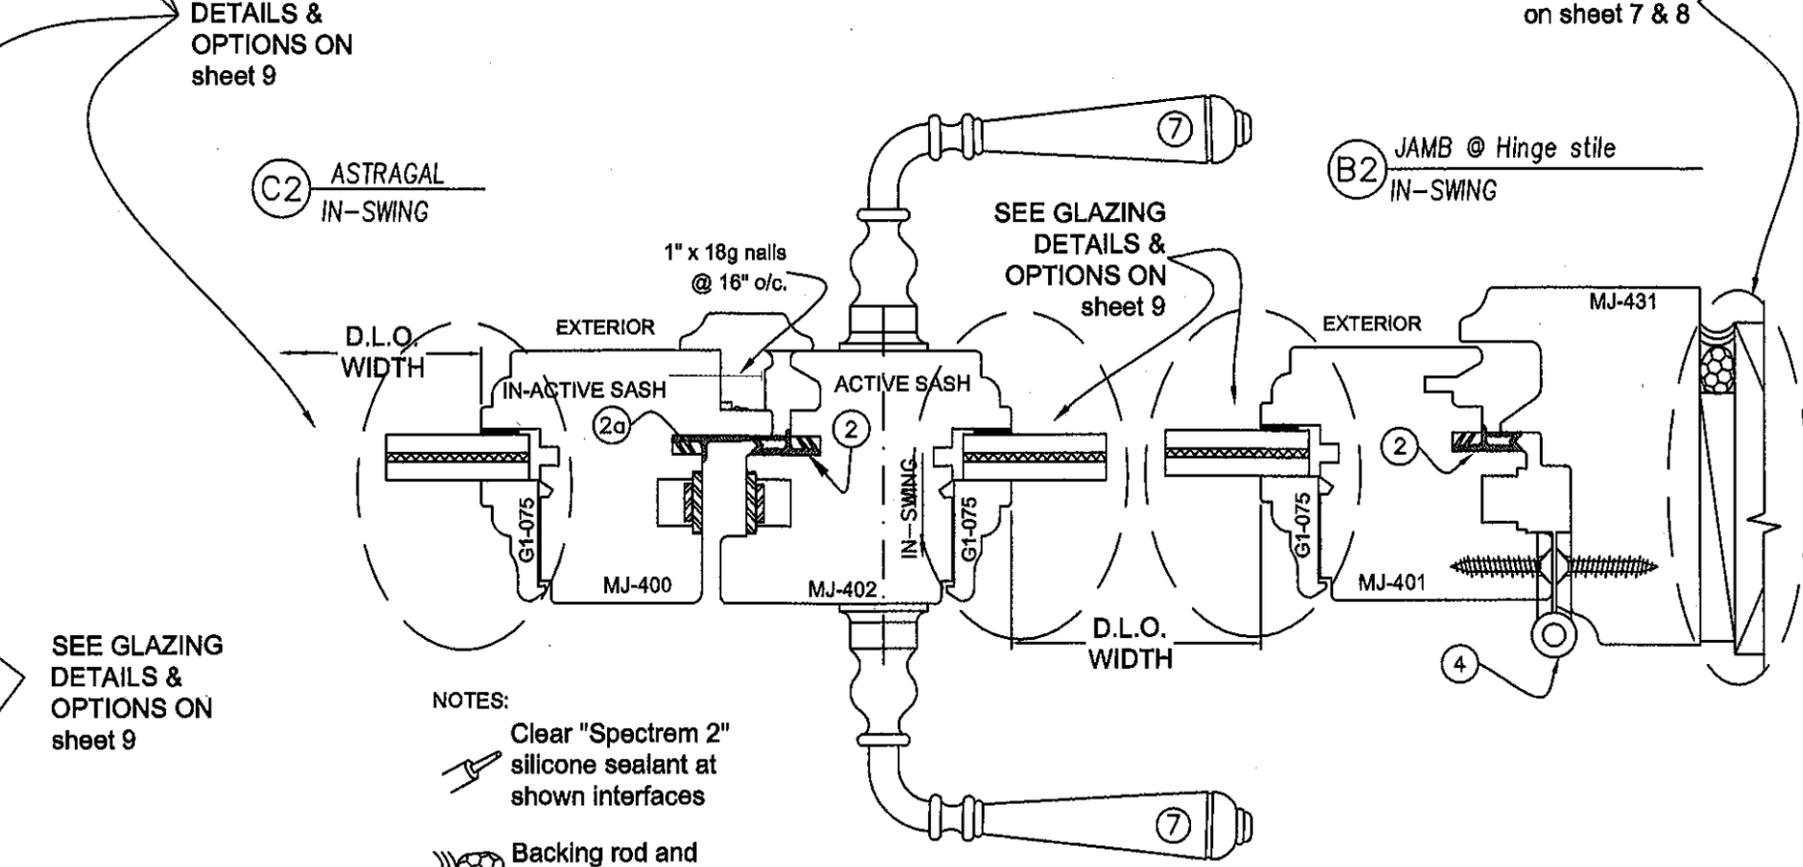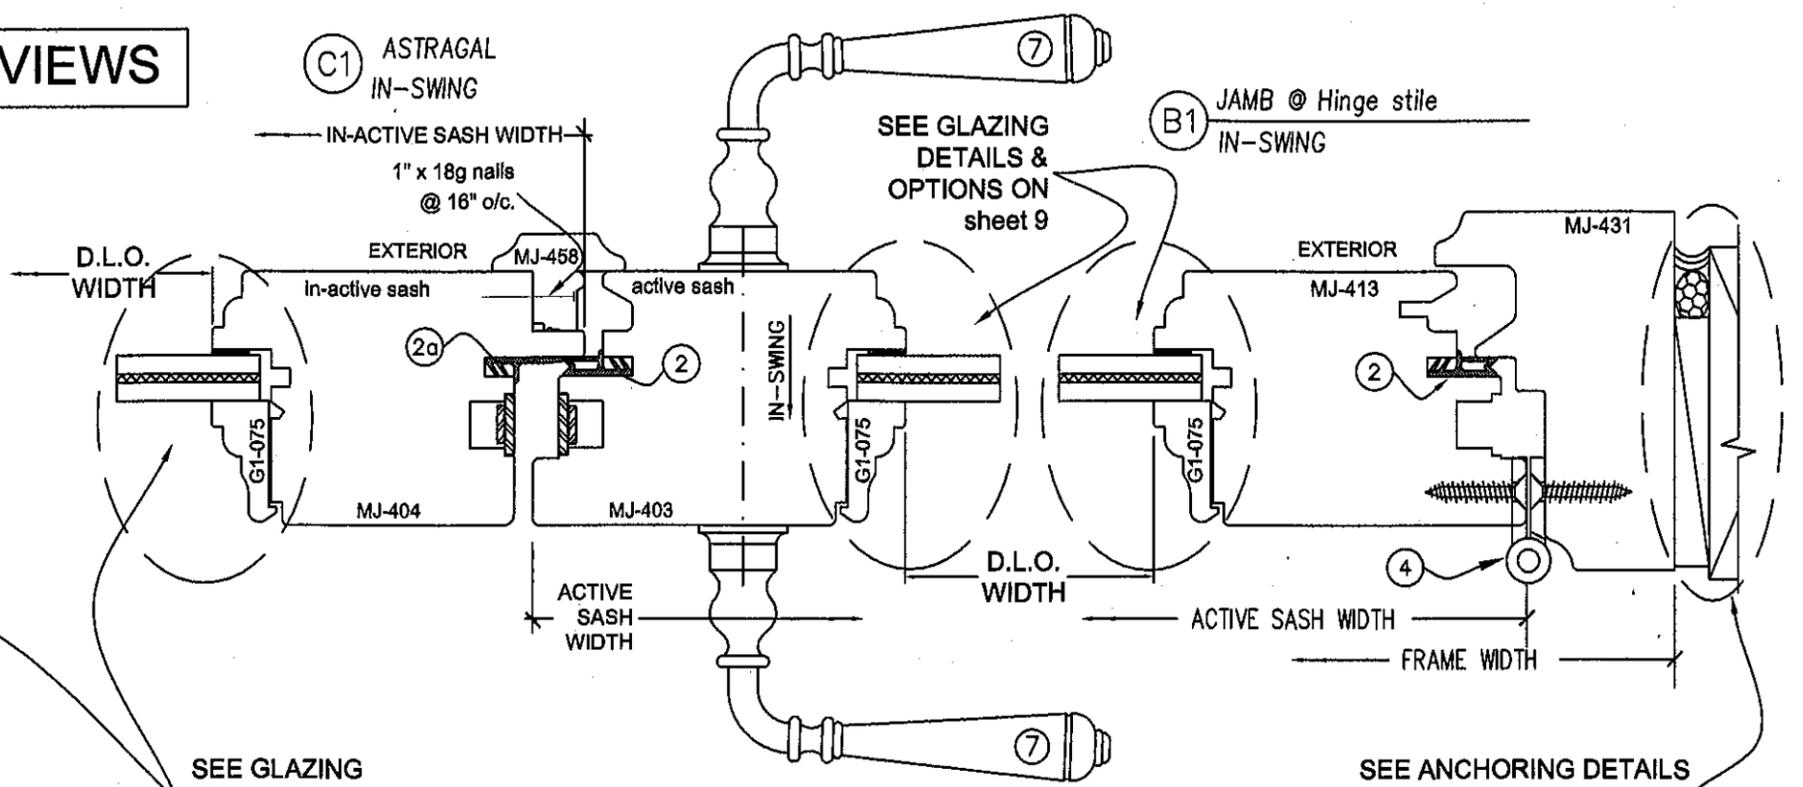



SEE GLAZING  
DETAILS &  
OPTIONS ON  
sheet 9

- NOTES:
- Clear "Spectrem 2" silicone sealant at shown interfaces
  - Backing rod and sealant as required
  - Numbers are referring to bill of materials (sheet 12)


# CROSS SECTION VIEWS

**A3 HEAD & SILL**  
 (@ head)  
 Use wood or plastic shims behind as required



See ANCHORING DETAILS on sheet 7 & 8

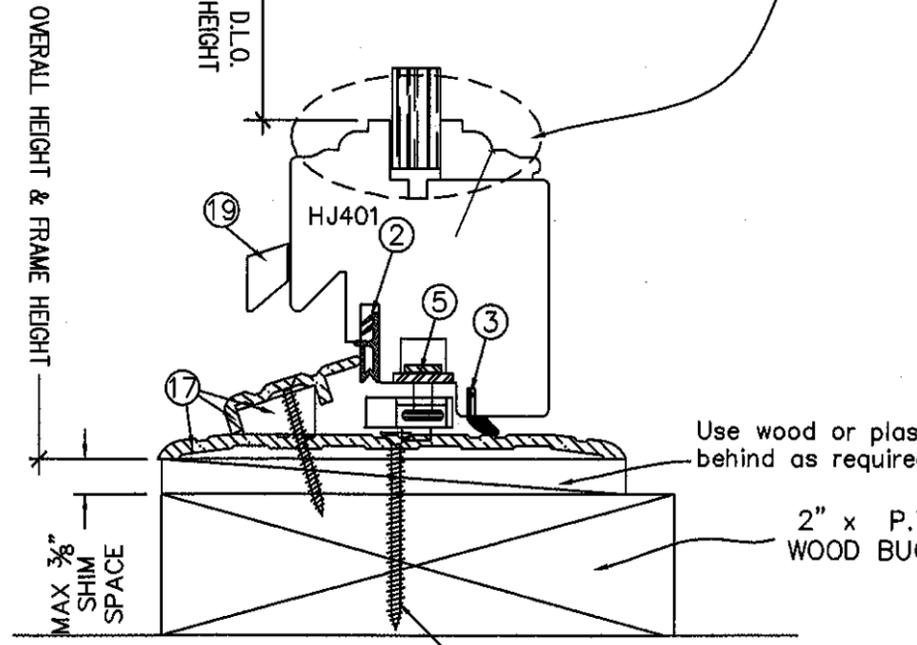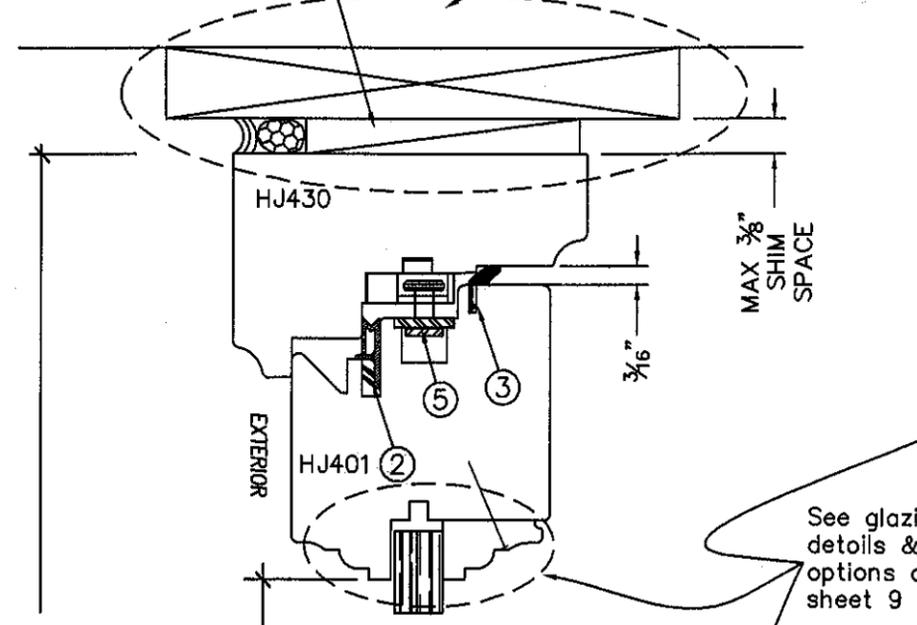

**A3 HEAD & SILL**  
 (@ Sill w/ 2x & SCREWED)  
 See A10 on ANCHOR REQUIREMENT TABLE (sheet 8) for fastener specification

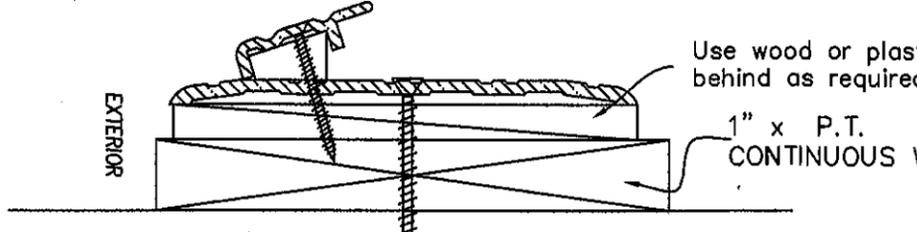


**A3 HEAD & SILL**  
 (@ Sill w/ 1x & TAPCON)  
 See A20 on ANCHOR REQUIREMENT TABLE (sheet 8) for fastener specification

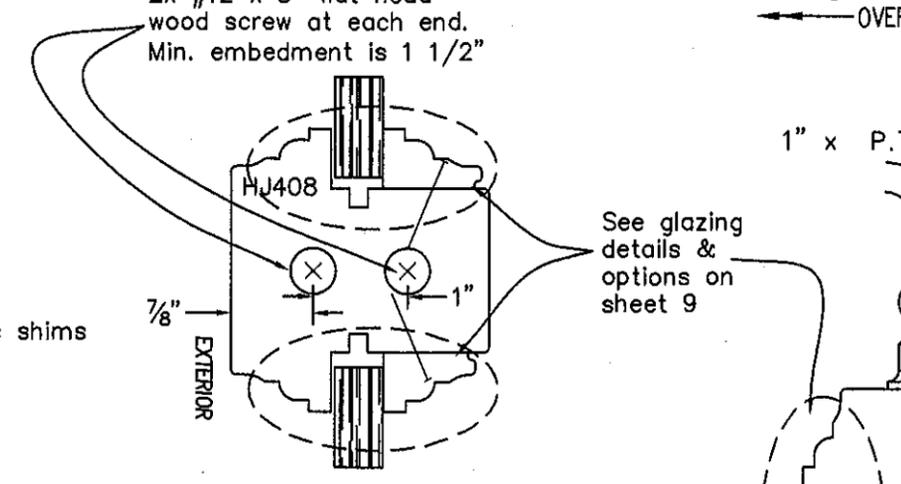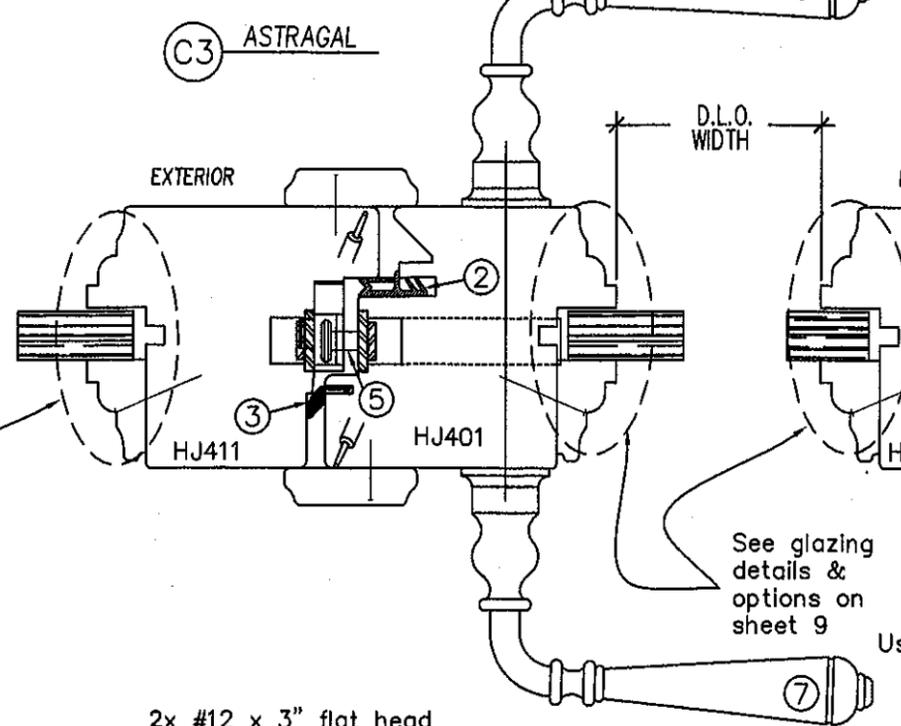


**D3 SASH BAR**  
 Optional

- NOTES:**
- Clear silicone sealant at shown interfaces
  - Backing rod and sealant as required
  - Numbers are referring to bill of materials (sheet 12)

**B3 JAMB**  
 (@ Hinge Stile)

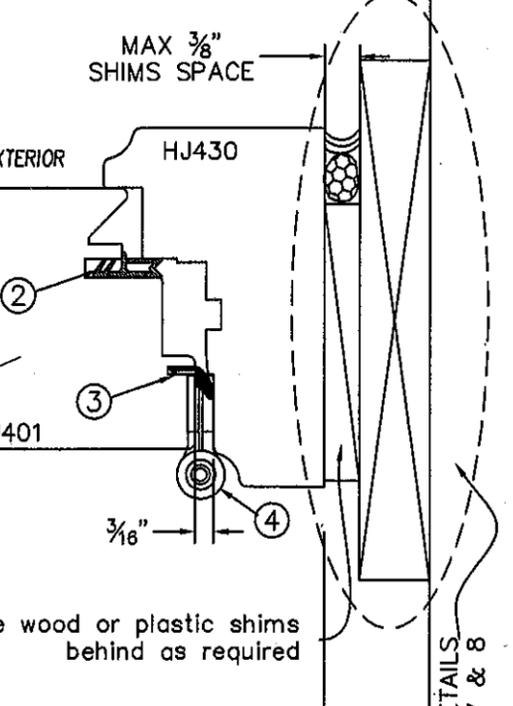

**E3 JAMB**  
 (@ Lock Stile)

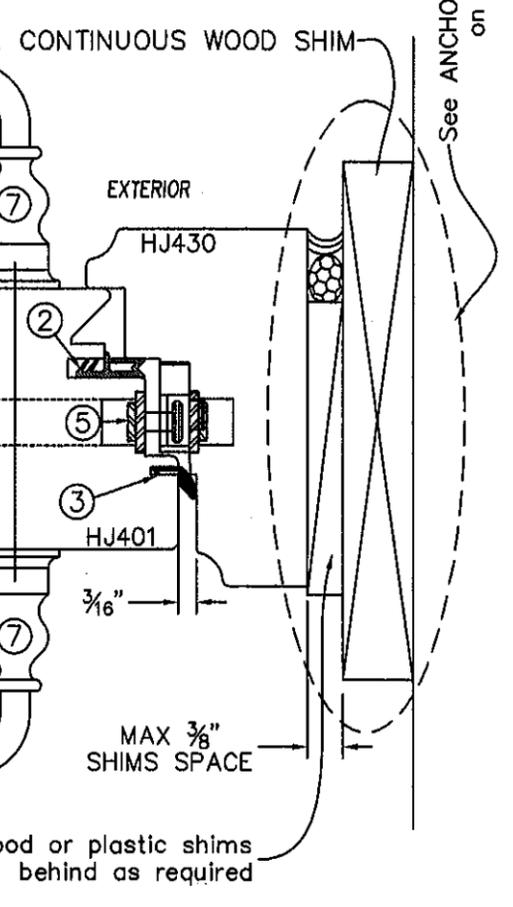

See ANCHORING DETAILS on sheet 7 & 8

**JS SERIE  
 INSWING  
 WOOD DOORS  
 MIAMI DADE COUNTY**

Drawing no.: JS-4-IN	
Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 01/11/06
File:	Page: 6/13

STRUCTURALLY REVIEWED BY:

*Scott Walters*  
 SCOTT WALTERS  
 FL PE# 62354

WALTERS ENGINEERING, INC.  
 (COA# 27194)  
 1271 GRANT STREET  
 HOLLYWOOD, FL 33019  
 DEC 6 2010

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 10-0902-10  
 Expiration Date: APR 28, 2016  
*Michael Dade Product Control  
 Division*



**JS SERIE  
INSWING  
WOOD DOORS  
MIAMI DADE COUNTY**

Drawing no.: JS-4-IN

Scale: NONE  
Drawn by: S. Marcotte

Date drawn: 01/10/98  
Date revised: 01/11/06

File: Page: 7/13



STRUCTURALLY REVIEWED BY:

*Scott Walters*  
SCOTT WALTERS  
FL PE# 62354  
WALTERS ENGINEERING, INC.  
(COA# 27194)  
1271 GRANT STREET  
HOLLYWOOD, FL 33019  
DEC 6 2010



**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No 16-0902.10  
Expiration Date APR 20, 2015  
*Michael Dede*  
Miami Dade Product Control  
Division

**ANCHORING DETAILS**


**A10 - Typical direct anchor on 2x wood buck using wood screws. Size and spacing as per ANCHOR REQUIREMENTS TABLE on sheet 8.**

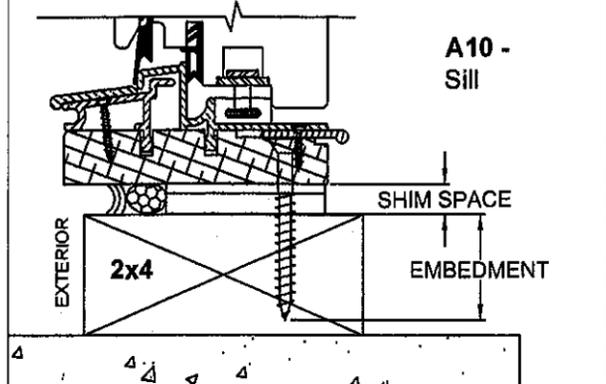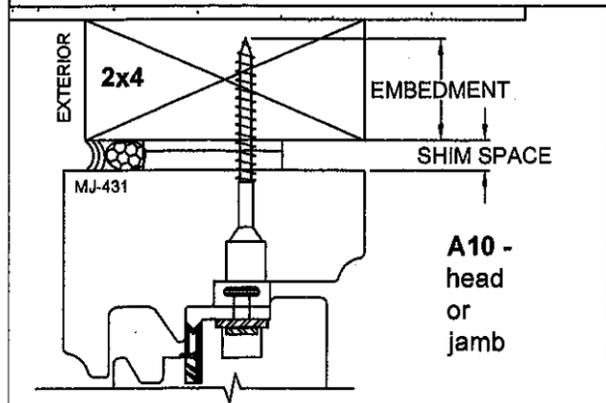

**A20 - Typical direct anchor through 1x wood buck into masonry using Tapcon screws. Size and spacing as per ANCHOR REQUIREMENTS TABLE on sheet 8.**

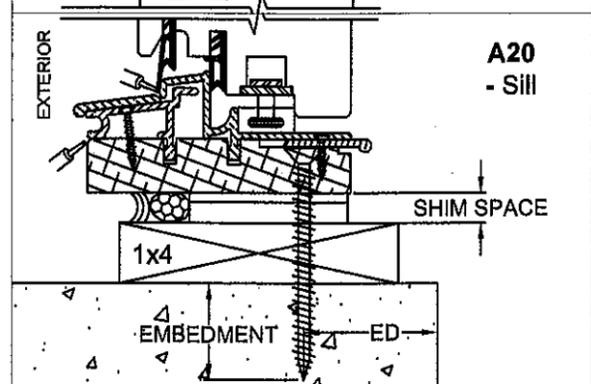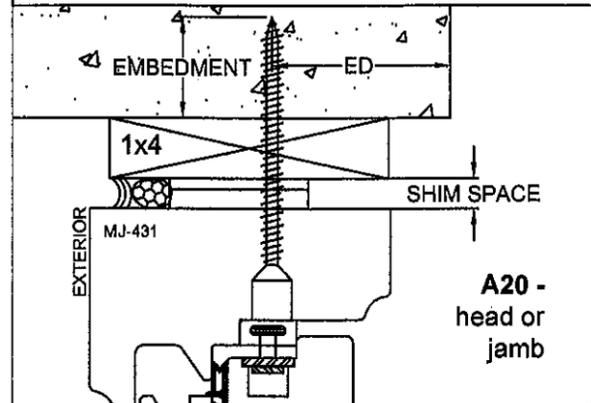


**C10 - Typical anchor (@ sill only) w/ Continuous Aluminum Angle (8a) using wood screws in 2x wood buck and door frame. Size and spacing as per ANCHOR REQUIREMENTS TABLE on sheet 8.**

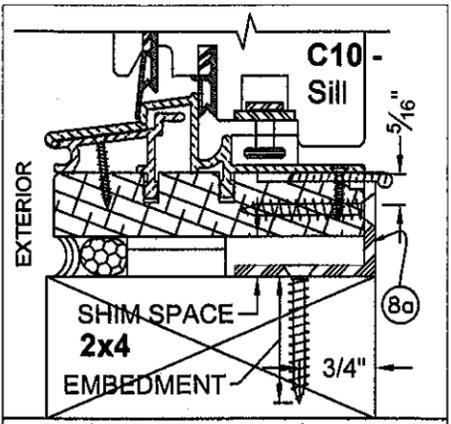

Frame's leg up on the edge of the sill, buck's leg out on the face.



Alternate typical anchor location for the continuous aluminum Angle (8a)

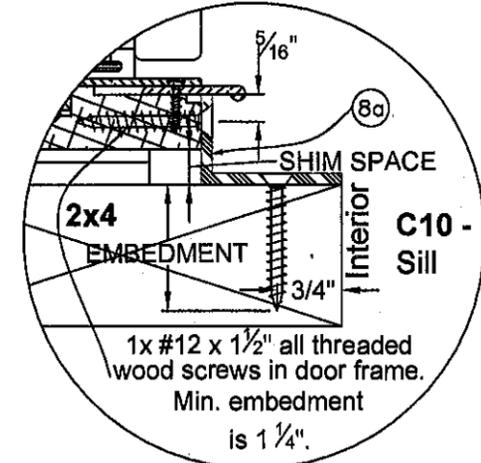



Frame's leg up on the edge of the sill, buck's leg in on the face.

1x #12 x 1 1/2" all threaded wood screws in door frame. Min. embedment is 1 1/4".


**B11, B12 - Typical anchor using Installation Bracket on 2x wood buck using wood screws as per ANCHOR REQUIREMENTS TABLE on sheet 8.**

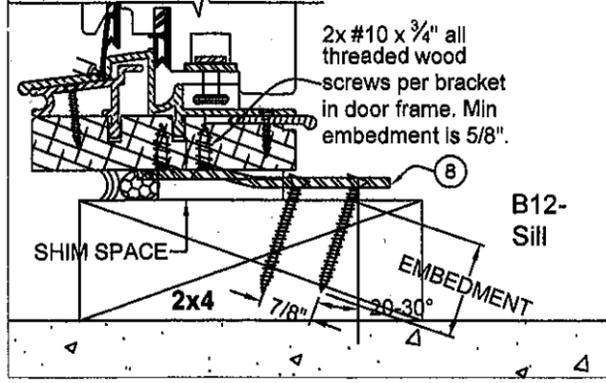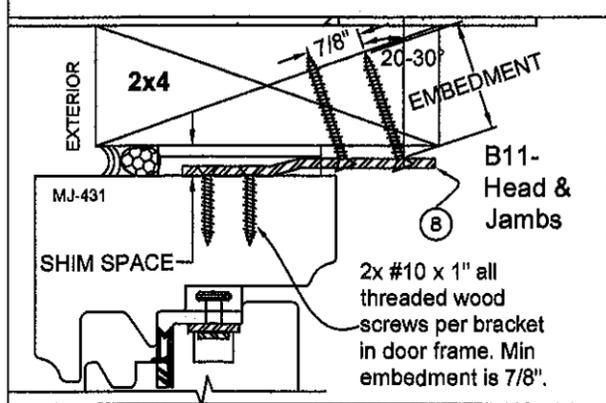

**B21, B22 - Typical anchor w/ Installation Bracket (8) using Tapcon screws through 1x wood buck into masonry as per ANCHOR REQUIREMENTS TABLE on sheet 8.**

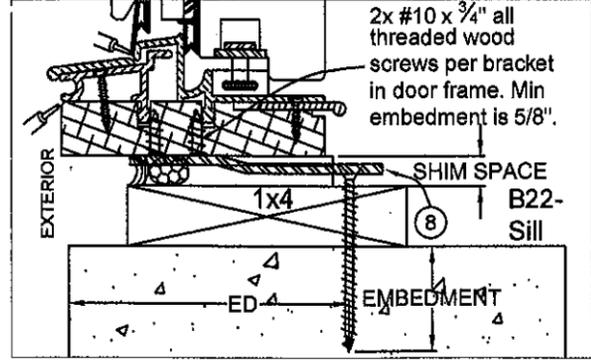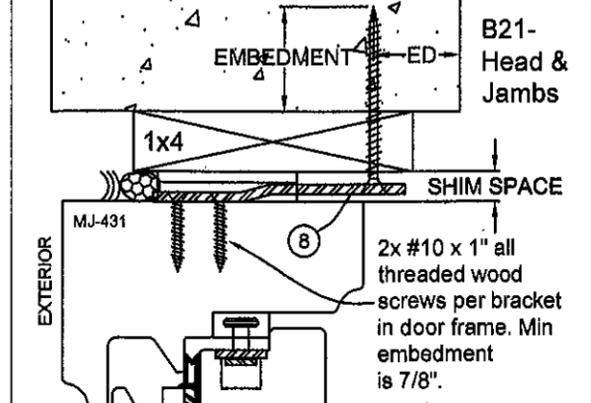


**C20 - Typical anchor w/ Continuous Aluminum Angle (8a) using Tapcon screws through 1x wood buck into masonry and wood screw into door frame. Size and spacing as per ANCHOR REQUIREMENTS TABLE on sheet 8.**

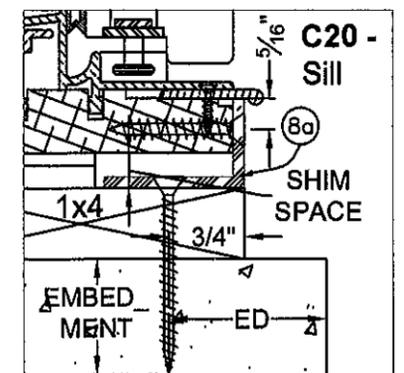

Frame's leg up on the edge of the sill, buck's leg out on the face.

Alternate typical anchor location for the continuous aluminum Angle (8a)

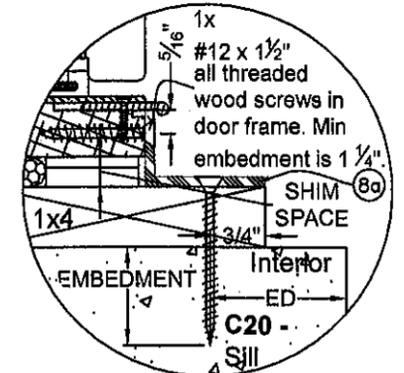

Frame's leg up on the edge of the sill, buck's leg in on the face.

1x #12 x 1 1/2" all threaded wood screws in door frame. Min embedment is 1 1/4".

# ANCHOR REQUIREMENTS TABLE

## JS SERIE INSWING WOOD DOORS MIAMI DADE COUNTY

Drawing no.: JS-4-IN  
 Scale: NONE      Drawn by: S. Marcotte  
 Date drawn: 01/10/98      Date revised: 01/11/06  
 File:      Page: 8/13

**STRUCTURALLY REVIEWED BY:**

*Scott Wolters*  
**SCOTT WOLTERS**  
 FL PE# 62354  
**WOLTERS ENGINEERING, INC.**  
 (COA# 27194)  
 1271 GRANT STREET  
 HOLLYWOOD, FL 33019  
 DEC 6 2010

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 10-0902.10  
 Expiration Date APR 20, 2016  
 By *Isaac I. Chaudhry*  
 Miami Dade Product Control  
 Division

Anchoring method	Sub-strate	Inst. Ref. No.	Fasteners type, size & embedment	Spacing		Min. dist. from wood buck edge	Min. dist. from msry edge (ED)	Min. embedment	
				From corner	On center			Into substrate	Into unit frame
Direct anchor (shear screws)	2x_ wood buck	<b>A10</b> 4 sides	Through the unit frame into the buck frame: (1) #14 x 2 3/4" wood screw.	5 1/2"	4 1/2"	3/4"	----	1 1/4"	----
	1x_ wood buck	<b>A20</b> 4 sides	Through the buck frame into the masonry: (1) 1/4" x 2 3/4" Elco / Textron Tapcon screw.	5 1/2"	5 1/2"	3/4"	2 1/2"	1 1/4"	----
PDF-FS-05/D Installation bracket	2x_ wood buck	<b>B11</b> head jamb	To the buck frame: (2) #12 X 1 1/2" all threaded (a.T.) wood screws. To the unit frame: (2) # 10 x 1" a.T. wood screws.	5 1/2"	11"	----	----	1 1/4"	7/8"
		<b>B12</b> sill	To the buck frame: (2) #12 X 1 1/2" a.T. wood screws. To the unit frame: (2) # 10 x 3/4" a.T. wood screws.	5 1/2"	6 1/2"	----	----	1 1/4"	5/8"
	1x_ wood buck	<b>B21</b> head jamb	Through the buck frame into the masonry: (1) 1/4" x 2 3/4" Elco / Textron Tapcon screw. Into the unit frame: (2) #10 x 1" a.T. wood screws.	5 1/2"	10 1/2"	3/4"	2 1/2"	1 1/4"	7/8"
		<b>B22</b> sill	Through the buck frame into the masonry: (1) 1/4" x 2 3/4" Elco / Textron Tapcon screw. To the unit frame: (2) # 10 x 3/4" a.T. wood screws.	5 1/2"	6 1/2"	3/4"	2 1/2"	1 1/4"	5/8"
Continuous aluminum angle (At sill only)	2x_ wood buck	<b>C10</b> sill	To the door sill and to the buck frame with (1) #12 x1 1/2" a. T. wood screw.	5 1/2"	10"	3/4"	----	1 1/4"	1 1/4"
	1x_ wood buck	<b>C20</b> sill	Through the buck frame into the masonry: 1/4" x 2 3/4" Elco / Textron Tapcon screw. Into the unit sill: (1) #12 x1 1/2".	5 1/2"	7"	3/4"	2 1/2"	1 1/4"	1 1/4"

**NOTES:**

- All shim spaces between door frame and wood buck max. 3/8" @ head, jambs and sill. Use std wood or plastic shims.
- Jambs anchoring identical to head anchoring shown
- Wood bucks (by others) and openings must be designed by the professional of record to properly transfer wind loads to the main structure.
- Installation brackets (B) and aluminum angles (Bc) may be positioned at the interior or exterior side of the door.
- Materials, but not limited to steel & steel screws that come in contact with other dissimilar materials shall meet with section 2003.8.4 of the Florida Building Code.





 Backing rod and sealant as required  
 Numbers in circle are referring to bill of materials (sheet 12)

# GLAZING DETAILS

Typ. glazing w/ monolithic laminated glass

Typ. glazing w/ double insulated glass




Typ. glazing w/ raised wood panel

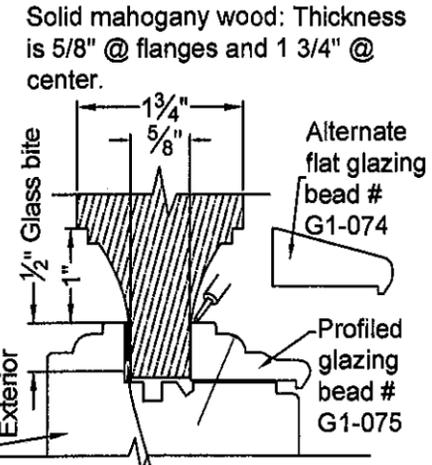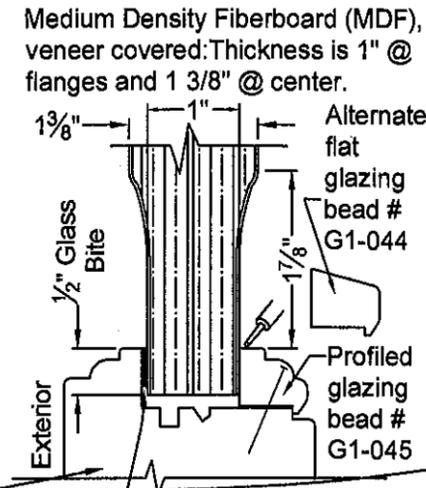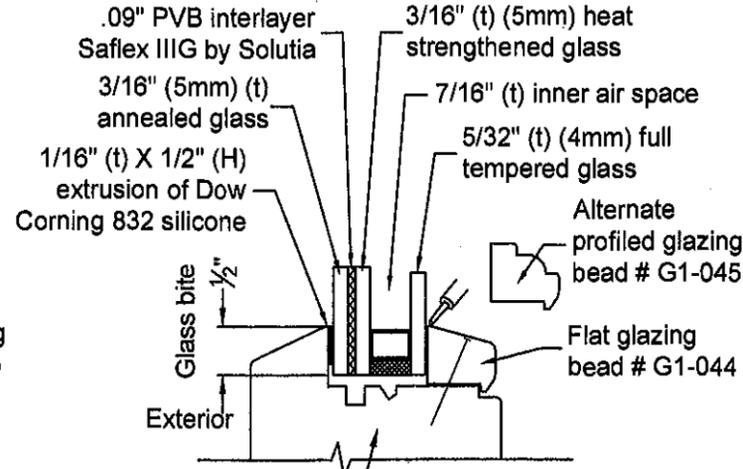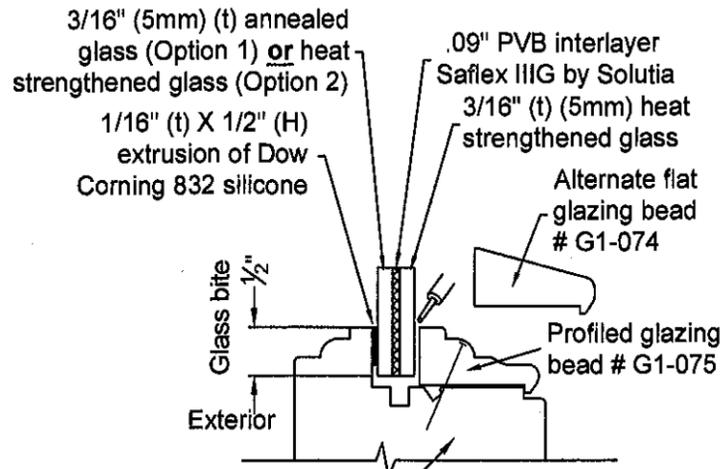



MJ-400/01/02/03/04/07/08/13 with a or t suffix and HJ401/08/11

NOTE: All glazing beads fixed at the glass perimeter w/ #18 gauge x 1" long finishing nails spaced 2" from the corners and 10" o/c.


# ACCESSORIES

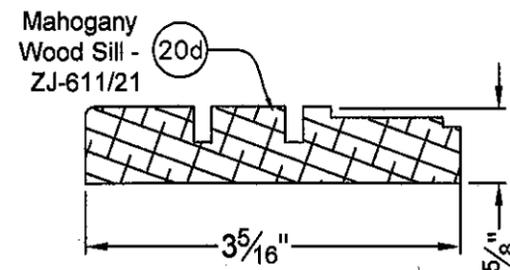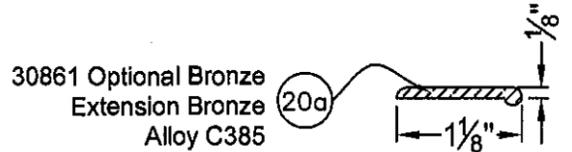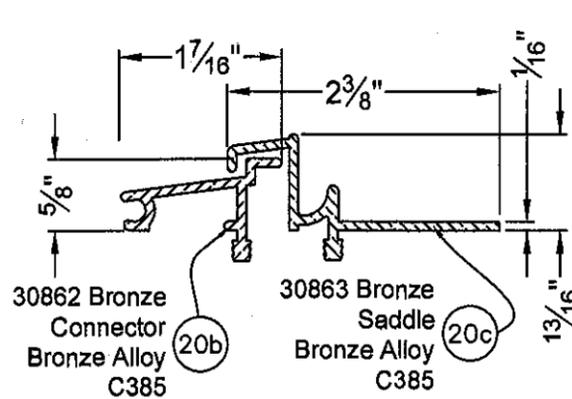

20 BRONZE SADDLE OVER WOOD SILL

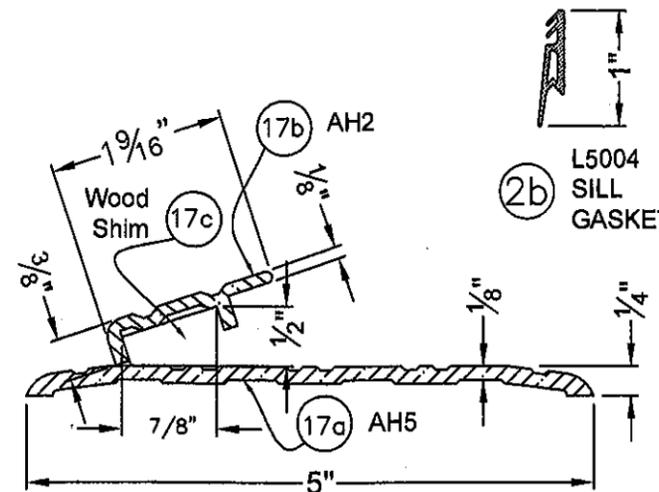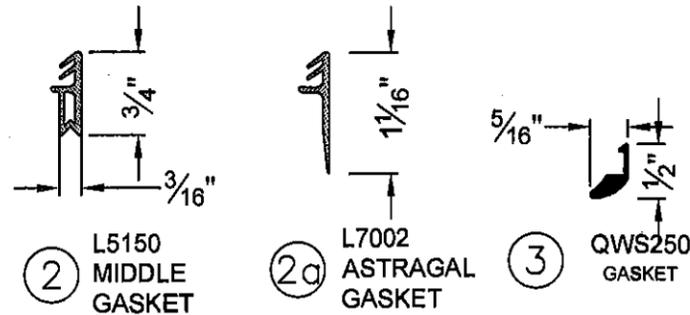

17 ALUMINUM FLAT SILL

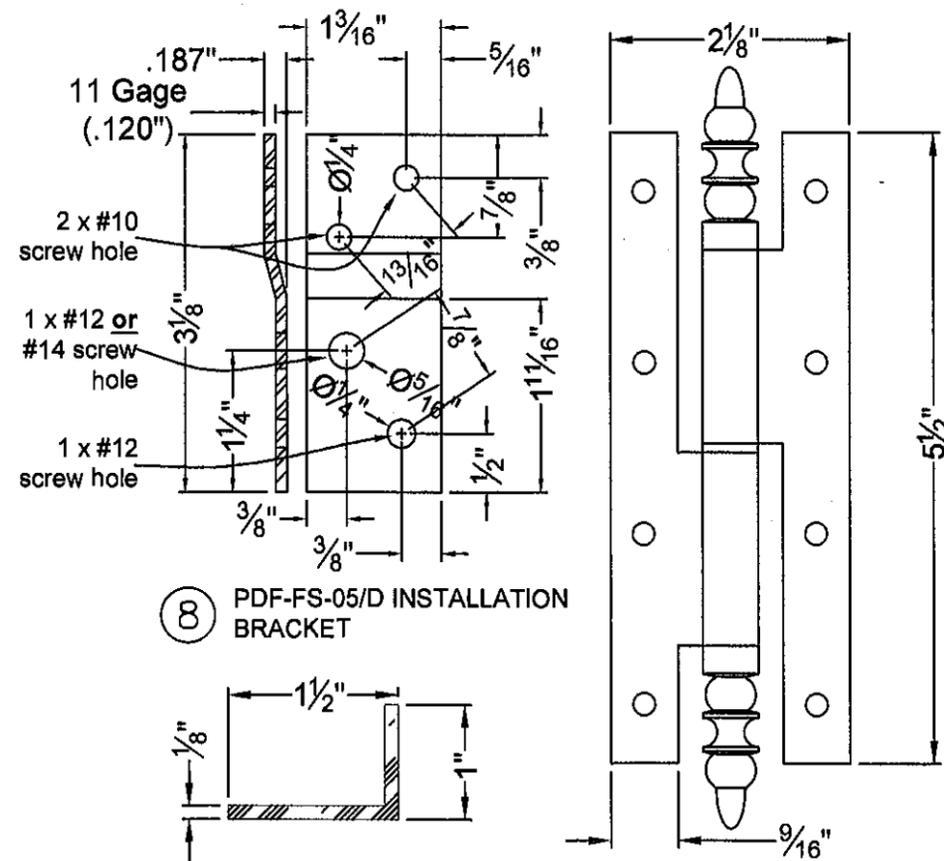

8 PDF-FS-05/D INSTALLATION BRACKET  
8a ALUMINUM SILL INSTALLATION ANGLE  
4 1488-03 HINGE (180° opening shown)

**JS SERIE  
IN SWING  
WOOD DOORS  
MIAMI DADE COUNTY**

Drawing no.: JS-4-IN	
Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 01/11/06
File:	Page: 9/13

STRUCTURALLY REVIEWED BY:  
*Scott Wolters*  
SCOTT WOLTERS  
FL PE# 62354  
WOLTERS ENGINEERING, INC.  
(COA# 27194)  
1271 GRANT STREET  
HOLLYWOOD, FL 33019  
DEC 6 2010

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 10-0902-10  
Expiration Date APR 22, 2015  
By *Wesley L. Lynch*  
Miami Dade Product Control  
Division



**JS SERIE  
 INSWING  
 WOOD DOORS  
 MIAMI DADE COUNTY**

Drawing no.: JS-4-IN	
Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 01/11/06
File:	Page: 11/13


**STRUCTURALLY REVIEWED BY:**

*Scott Wolters*  
 SCOTT WOLTERS  
 FL PE# 62354  
 WOLTERS ENGINEERING, INC.  
 (COA# 27194)  
 1271 GRANT STREET  
 HOLLYWOOD, FL 33019  
 DEC 6 2010


**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 6-0902-10  
 Expiration Date APR 20, 2015  
 By Isabel L. Chaves  
 Miami Dade Product Control  
 Division

**WOOD PROFILES**


**NOTE:**  
 These profiles apply to  
 elevations on sheet 3 only

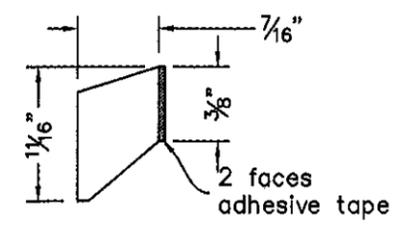





**19 ZT130  
 SASH WATER DRIP**

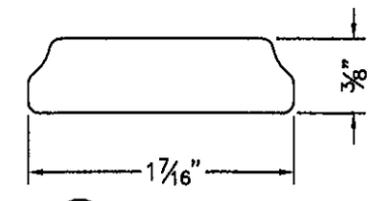

**10 ZJ142  
 ASTRAGAL MOULDING**

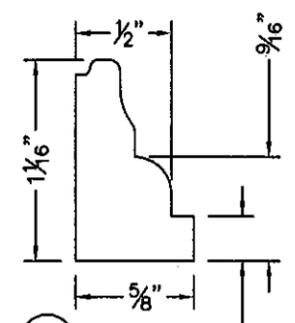

**15 GJ064  
 GLAZING BEAD**

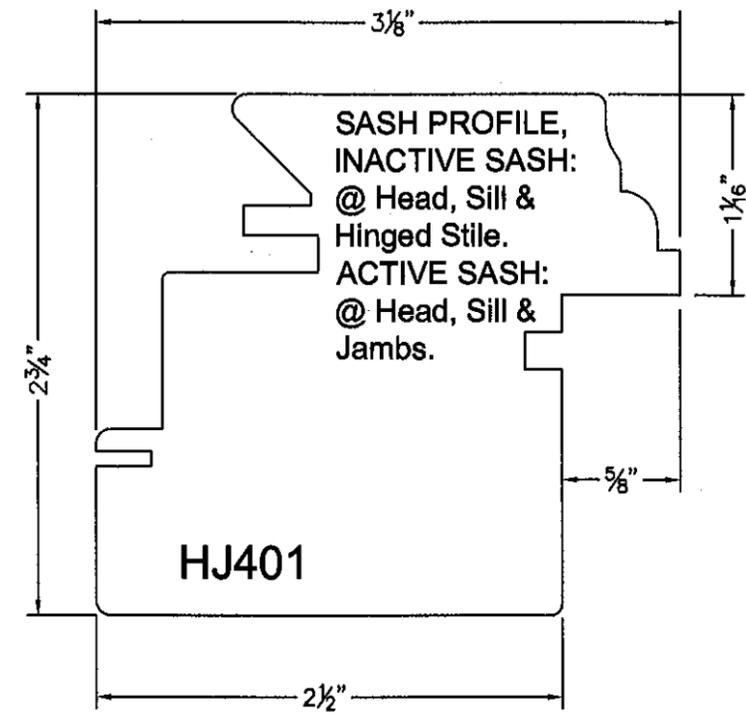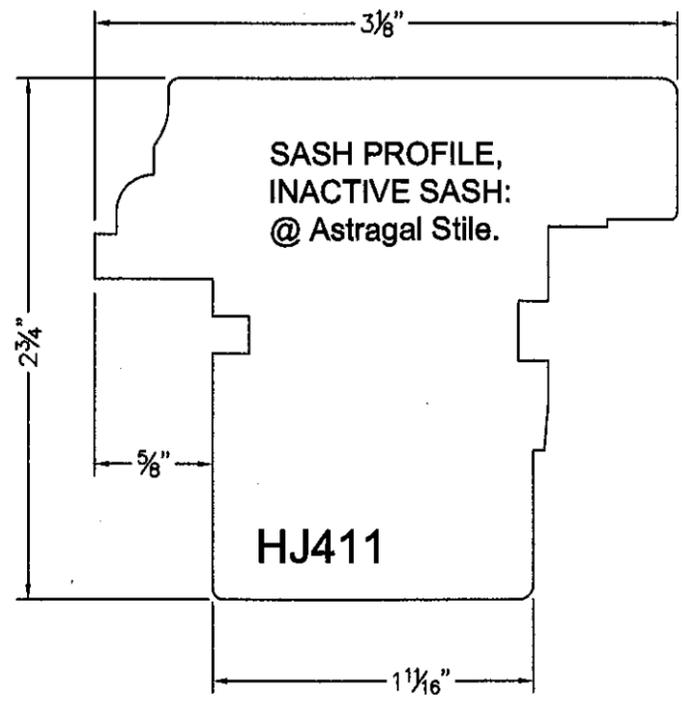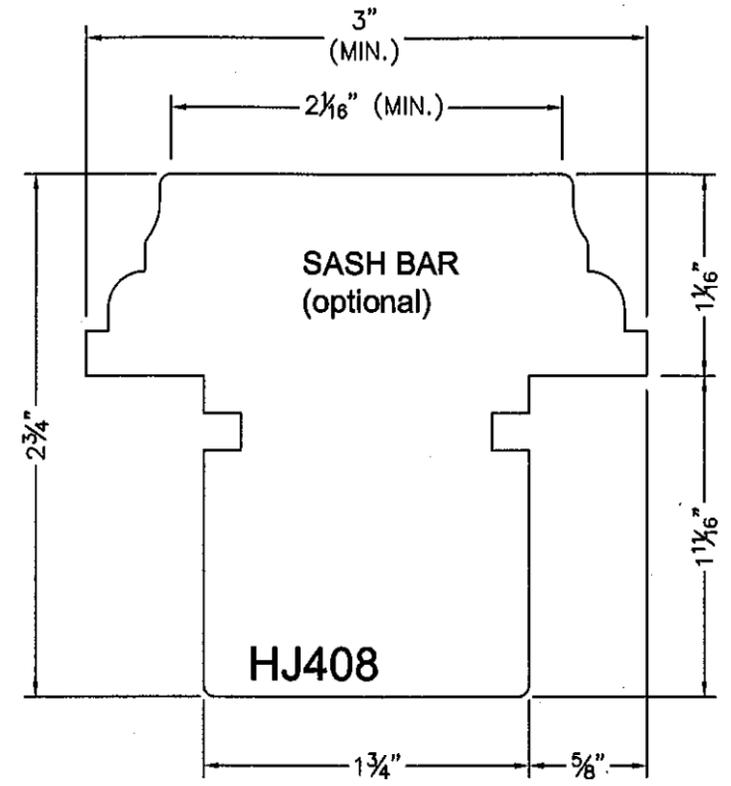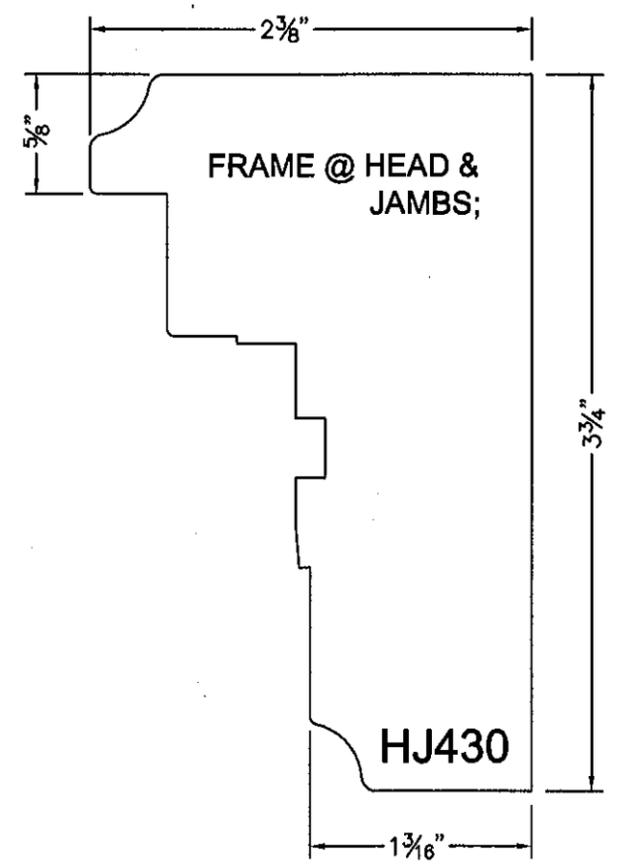

# BILL OF MATERIALS

(see also related cross sections details)

Ref.	ITEM DESCRIPTION	MANUFACTURER / NOTES
②	Brügman L5150, Push-in EPDM middle gasket	Push-in gasket, in a continuous groove around the sash.
②a	Brügman L7002, Push-in EPDM In-active astragal meeting stile middle gasket	Push-in gasket in a continuous groove. Ends @ sash's head & sill glued to the L5150 gasket
②b	Brügman L5004, Push-in EPDM sill gasket	Push-in gasket, in a continuous groove at sash sill.
③	Schlegel QWS250 Polyurethane foam gasket.	Push-in gasket, in a continuous groove around the sash. Mitre cut @ corners.
④	Jardinier Massard S.A. 1488-03 painted steel hinges	5 per hinged stile of sashes, 8" from corners; see elevations for max. o/c spacing. 4 x #7 x 1" flat head screws on sash and frame for ea hinge.
⑤	Ferco multi-point lock system.	Ferco G-20755 corner gear Ferco 6-26295 steel intermediate arm Ferco 6-25485 steel mechanism Ferco 6-26076 steel lever. Bronze cast alloy keeper, #833856.
⑦	Lock handle	As required to operate lock.
⑧	PDF-FS-05/D Installation bracket Gage 11 ASTM A653 SQ 33 G90 galvanized steel	To door frame: 2x #10 x 1" a.t. wood screws. Min. embedment is 3/4". To door sill frame: 2 x #10 x 3/4" a.t. wood screws. Min embedment is 5/8". To structure as per ANCHOR REQUIREMENTS on sheets 7
⑧a	Installation Aluminum angle (Alloy 6063-T5)	Screwed to wood sill and to structure as per ANCHOR REQUIREMENTS on sheets 7
①7a	AH5 flat saddle aluminum profile (Alloy 6063-T5)	Directly screwed to the substrate as per ANCHOR REQUIREMENTS TABLE (configuration A10 or A20) on sheet 8. Square cut @ ends.
①7b	AH2 stopper aluminum profile (Alloy 6063-T5)	Screwed to alum. sill w/ (1) #10 x 1 1/4" F.H. screw @ 14" o/c. Butt joint against the frame jambs @ both ends.
①7c	Continuous wood shim (mahogany)	See AH2 screws. Butt joint against the frame jambs @ both ends.
②0a	30861 1" Bronze extension (Alloy C385)	Brass #7 x (1/2" for 30863, 3/4" for 30862) FH screws @ 16" o/c & continuous line of silicone behind; When 30861 is used to hide screw holes, use with 3M double face acrylic tape. It may be used as an optional in or out extension to link with floor finishing material.
②0b	30862 Bronze connector (Alloy C385)	
②0c	30863 Bronze saddle (Alloy C385)	
②0d	ZJ-611/21 Mahogany wood sill	Square cut @ ea end. Screwed with 2x # 12 x 3" wood Screws to the frame jambs. See sheet 13.

# REF. NUMBERS ARE RELATED TO THOSE USED ON CROSS SECTIONS DRAWINGS



**JS SERIE  
INSWING  
WOOD DOORS  
MIAMI DADE COUNTY**

Drawing no.: JS-4-IN

Scale: NONE  
Drawn by: S. Marcotte

Date drawn: 01/10/98  
Date revised: 01/11/06

File: Page: 12/13

STRUCTURALLY REVIEWED BY:

*Scott Wolters*  
SCOTT WOLTERS  
FL PE# 62354

WOLTERS ENGINEERING, INC.  
(COA# 27194)  
1271 GRANT STREET  
HOLLYWOOD, FL 33019  
DEC 6 2010

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No. 10-0902.10  
Expiration Date: APR 30, 2015  
By: *Shas L. Chugh*  
Miami Dade/Product Control  
Division

JS SERIE  
IN SWING  
WOOD DOORS  
MIAMI DADE COUNTY

Drawing no.: JS-4-IN	
Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 01/11/06
File:	Page: 13/13



STRUCTURALLY REVIEWED BY:

*Scott Wolters*  
SCOTT WOLTERS  
FL PE# 62354  
WOLTERS ENGINEERING, INC.  
(COA# 27194)  
1271 GRANT STREET  
HOLLYWOOD, FL 33019  
DEC 6 2010

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 10-0902-10  
Expiration Date APR 20, 2016  
By *Chas. L. Chaudhry*  
Miami Dade Product Control  
Division


Sash rails and sash bar to sash stiles: 4x 7/16" x 2 3/4"  
wood dowels, w/ 1 3/8" embedment to each profile.  
Glue: Rhenocoll 3W-4B type 1 exterior glue for wood.

Finger Joints  
assembly for  
full arched  
members; Glue:  
Rhenocoll  
3W-4B type 1  
exterior glue for  
wood.

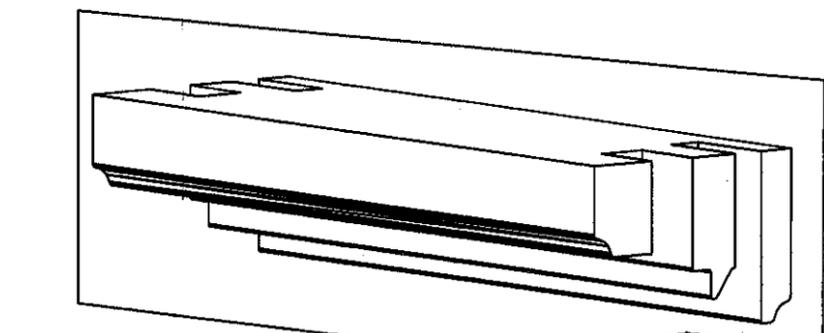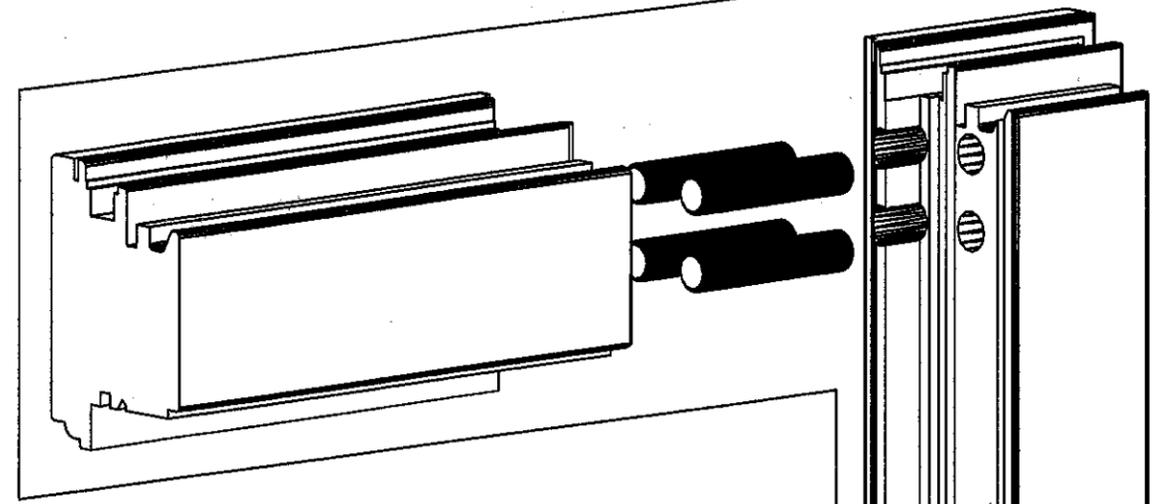

Frame head to frame  
jambs: multifork.  
Glue: Rhenocoll 3W-4B  
type 1 exterior glue for  
wood.

Frame sill to frame  
jambs: Screwed w/  
2x #12 x 3" FH screws.

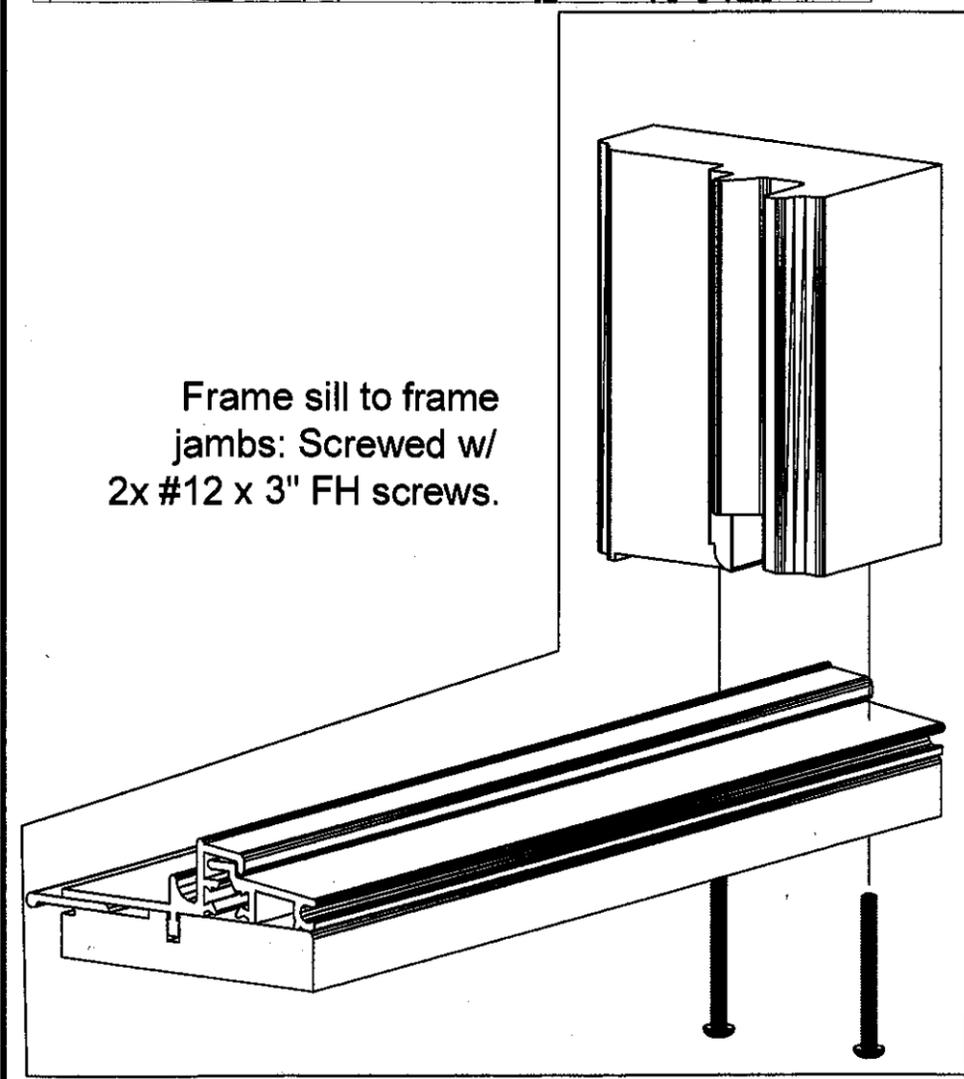

CORNER ASSEMBLY  
3D VIEW DETAILS