



MIAMI-DADE COUNTY
BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION
 11805 SW 26th Street, Room 208
 Miami, Florida 33175-2474
 T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/building

Jeld-Wen, Inc (OR)
3737 Lakeport Boulevard
Klamath Falls, OR 97601

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Section and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Premium Atlantic Vinyl 8200" White PVC Horizontal Slider Window – N.I.

APPROVAL DOCUMENT: Drawing No. **10-JWN-0016b-02**, titled "Series Premium Atlantic Vinyl 8200 Horizontal Slider Window – Non Impact", sheets 1 through 10 of 10, dated 06/29/10 with revision "02" dated 01/21/11, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and Approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None.

LIMITATIONS: Miami-Dade County Product Control Approved Shutters Or Protection Devices Shall Be Required.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1, evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
2/10/11

NOA No. 10-0913.05
Expiration Date: March 03, 2016
Approval Date: March 03, 2011
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **10-JWN-0016b**, titled "Series Premium Atlantic Vinyl 8200 Horizontal Slider Window – Non Impact", sheets 1 through 9 of 9, dated 06/29/10 with revision "02" dated 01/21/11, prepared by Engineering Express, Inc., signed and sealed by Frank L. Bennardo, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of PVC Aluminum Window, prepared by National Certified Testing Laboratories, Inc., Test Report No. **NCTL -210-3626-1**, revised, dated 08/02/10, signed and sealed by Gerard J. Ferrara, P. E.
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
4) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
5) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of PVC Aluminum Window, prepared by National Certified Testing Laboratories, Inc., Test Report No. **NCTL -210-3626-1**, dated 11/17/09, signed and sealed by Gerard J. Ferrara, P. E.

C. CALCULATIONS


1. Anchor calculations and structural analysis, complying with FBC-2007, dated 09/07/10, prepared by Engineering Express, Inc., dated 02/04/11, signed and sealed by Frank L. Bennardo, P. E.
Complies with ASTM E1300-04

D. QUALITY ASSURANCE

1. Miami-Dade Building and Neighborhood Compliance Department (BNC).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **10-0909.05** revises **99-0113.05** issued to Mikron Industries, Inc. (a division of Quanex) for "**White PVC Extrusions for Windows and Doors qualifying for AAMA 303, Voluntary Specification for Poly (Vinyl Chloride) (PVC) Exterior Profiles by AAMA Fenestration Exterior Profile Certification Program**" dated 10/01/2010, expiring on 9/30/2011.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 10-0913.05
Expiration Date: March 03, 2016
Approval Date: March 03, 2011


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of compliance with the FBC-2007, dated September 07, 2010, signed and sealed by Frank L. Bennardo, P. E.
2. Statement letter of conformance and no financial interest, dated September 07, 2010, signed and sealed by Frank L. Bennardo, P. E.
3. Laboratory compliance letter for Test Report No. NCTL -210-3626-1, issued by National Certified Testing Laboratories, Inc., revised, dated August 02, 2010, signed and sealed by Gerard J. Ferrara, P. E.
4. Laboratory compliance letter for Test Report No. NCTL -210-3626-1, issued by National Certified Testing Laboratories, Inc., dated November 17, 2009, signed and sealed by Gerard J. Ferrara, P. E.

G. OTHERS

1. None.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 10-0913.05
Expiration Date: March 03, 2016
Approval Date: March 03, 2011

PREMIUM ATLANTIC VINYL SERIES 8200 HORIZONTAL SLIDER

NON-IMPACT RESISTANT

FRANK L. BENNARDO, P.E.
PE0046549


02/04/2011

ENGINEERING EXPRESS®

160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGGEXP.COM
CERT. OF AUTH. #8885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

GENERAL NOTES

1. THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE 2007 FLORIDA BUILDING CODE, FOR USE WITHIN AND OUTSIDE THE HIGH VELOCITY HURRICANE ZONE, PER TAS 202 & ASTM E1300-04 STANDARDS.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE.
4. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS AND SUBMIT FOR ONE-TIME NOTICE OF ACCEPTANCE FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
5. THE SYSTEM DETAILED HEREIN IS NON-IMPACT RESISTANT AND SHALL BE PROTECTED WITH AN IMPACT RESISTANT COVERING WHEN INSTALLED WITHIN WIND-BORNE DEBRIS REGIONS AS DEFINED IN ASCE 7-05.
6. PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS. OPTIONAL WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
7. ALL BOLTS & WASHERS SHALL BE ZINC COATED STEEL, GALVANIZED STEEL, OR STAINLESS STEEL WITH A MINIMUM TENSILE YIELD STRENGTH OF 60 KSI.
8. PLASTIC COMPONENTS USED WITHIN THE HVHZ MUST MEET ALL APPLICABLE FIRE/SMOKE/UV PERFORMANCE REQUIREMENTS AS SET FORTH IN THE ABOVE-NOTED BUILDING CODE AND SHALL BE SUBMITTED TO THE AUTHORITY HAVING JURISDICTION FOR REVIEW AS REQUIRED.
9. ALL STEEL IN CONTACT WITH ALUMINUM SHALL BE PAINTED OR PLATED AS PRESCRIBED IN THE ABOVE-NOTED BUILDING CODE.

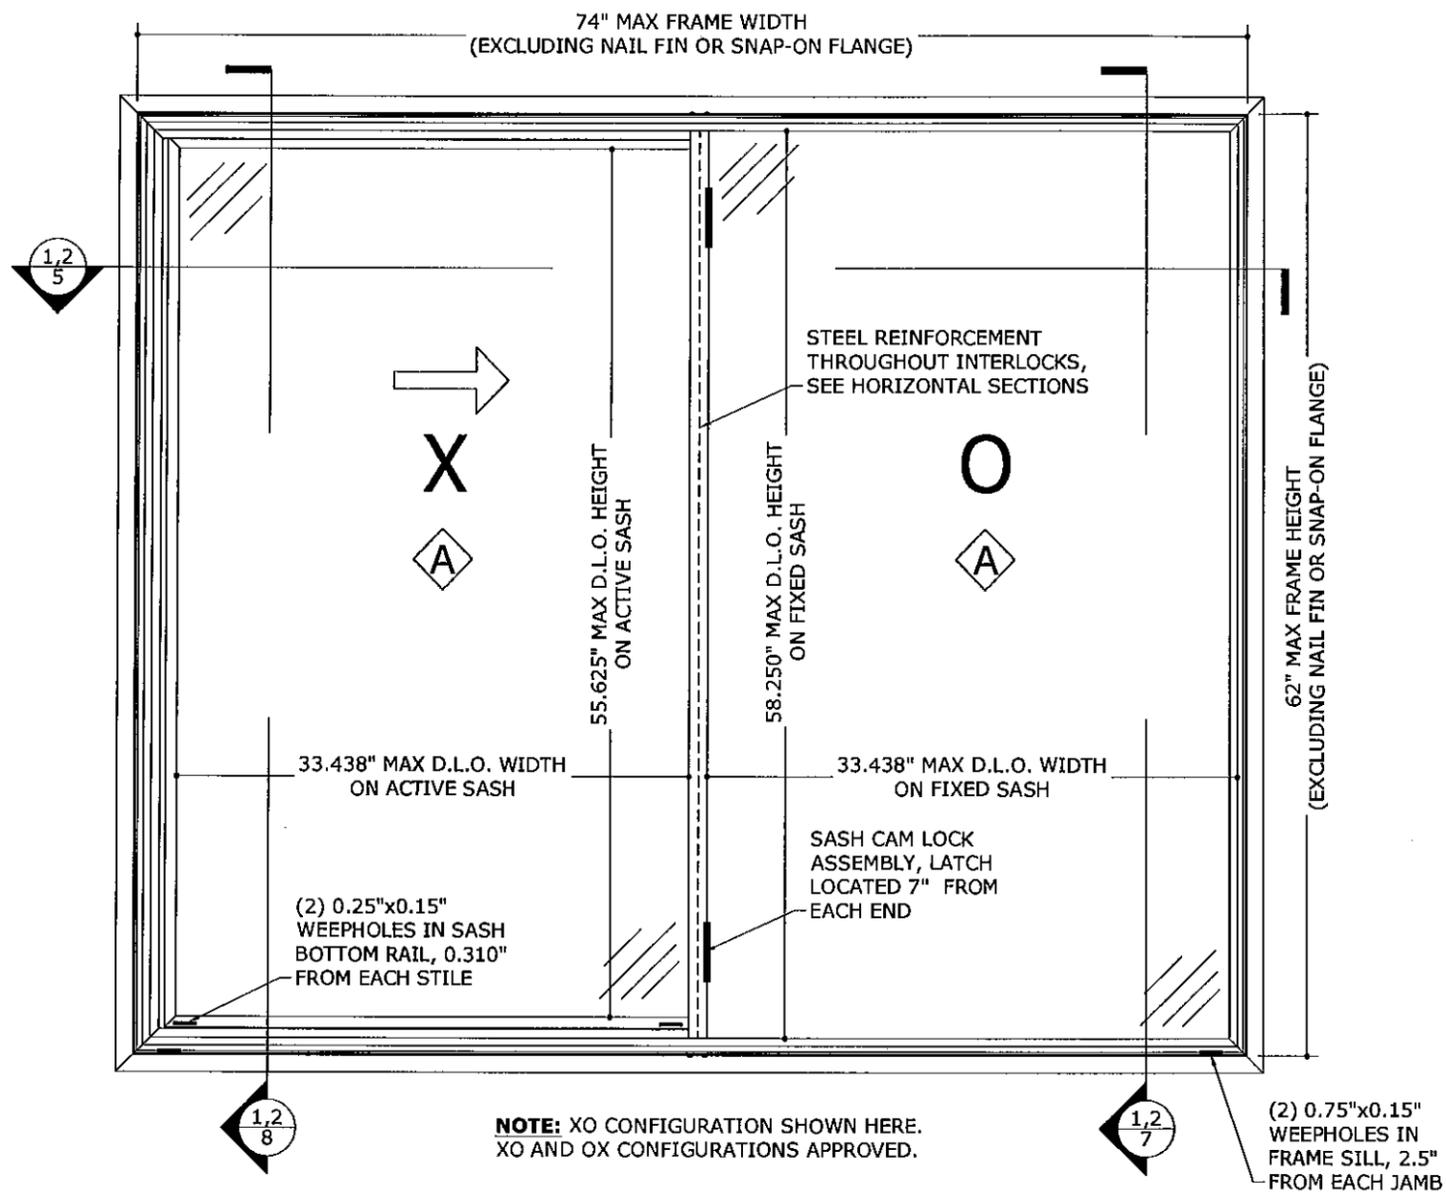

NOTE: XO CONFIGURATION SHOWN HERE. XO AND OX CONFIGURATIONS APPROVED.


1 TYPICAL 74x62 FRAME ELEVATION
W/ THRU FRAME OR NAIL FIN ANCHORAGE
1 N.T.S. EXTERIOR ELEV

**ALLOWABLE
DESIGN PRESSURES**

**+50 PSF
-55 PSF**

GLAZING TYPE **A**

7/8" INSULATED

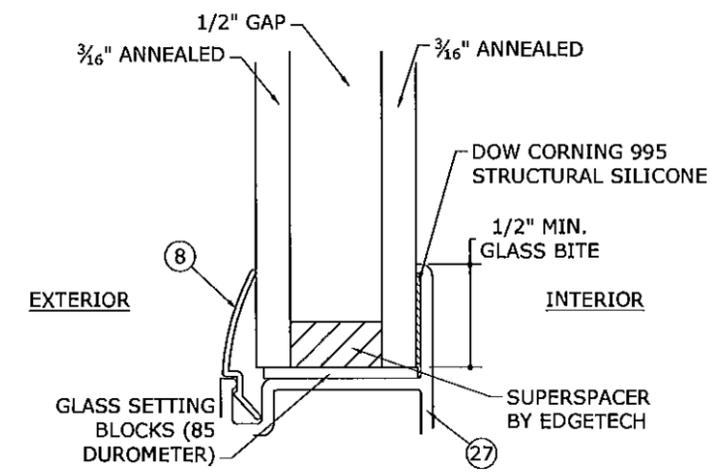

SEE GENERAL NOTE #5

2 GLAZING DETAIL (MINIMUM)
1 N.T.S. VERT SECTION

JELD-WEN
355 CENTER COURT
VENICE, FL 34285
PHONE: (941) 497 - 1984

PREMIUM ATLANTIC VINYL 8200 HORIZONTAL SLIDING WINDOW
NON-IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE	DRWN	CHKD	DATE
INIT ISSUE	06/29/10	KL	FLB	01/21/11
REV. PER BNC COMMENTS		KL	FLB	

10-JWN-0016b


SCALE: 1/2

PAGE DESCRIPTION:

Approved as complying with the
Florida Building Code
Date 03/03/2011
NOA# 10-0913.05
Miami Dade Product Control
By *[Signature]*


F:\01 Project Files\Jeld-Wen (JWN)\2010\10-JWN-0016 Premium Atlantic Vinyl 8200 HS LM1 (NOA)\10-JWN-0016b_02a Premium Atlantic Vinyl 8200 HS NI (NOA).dwg
02/04/2011 - 2:15pm keith

F:\01 Project Files\Lead-Wen (JWN)\2010\10-JWN-0016 Premium Atlantic Vinyl 8200 HS LMI (NOA)\10-JWN-0016b_02a Premium Atlantic Vinyl 8200 HS NI (NOA).dwg
02/04/2011 - 2:15pm keith

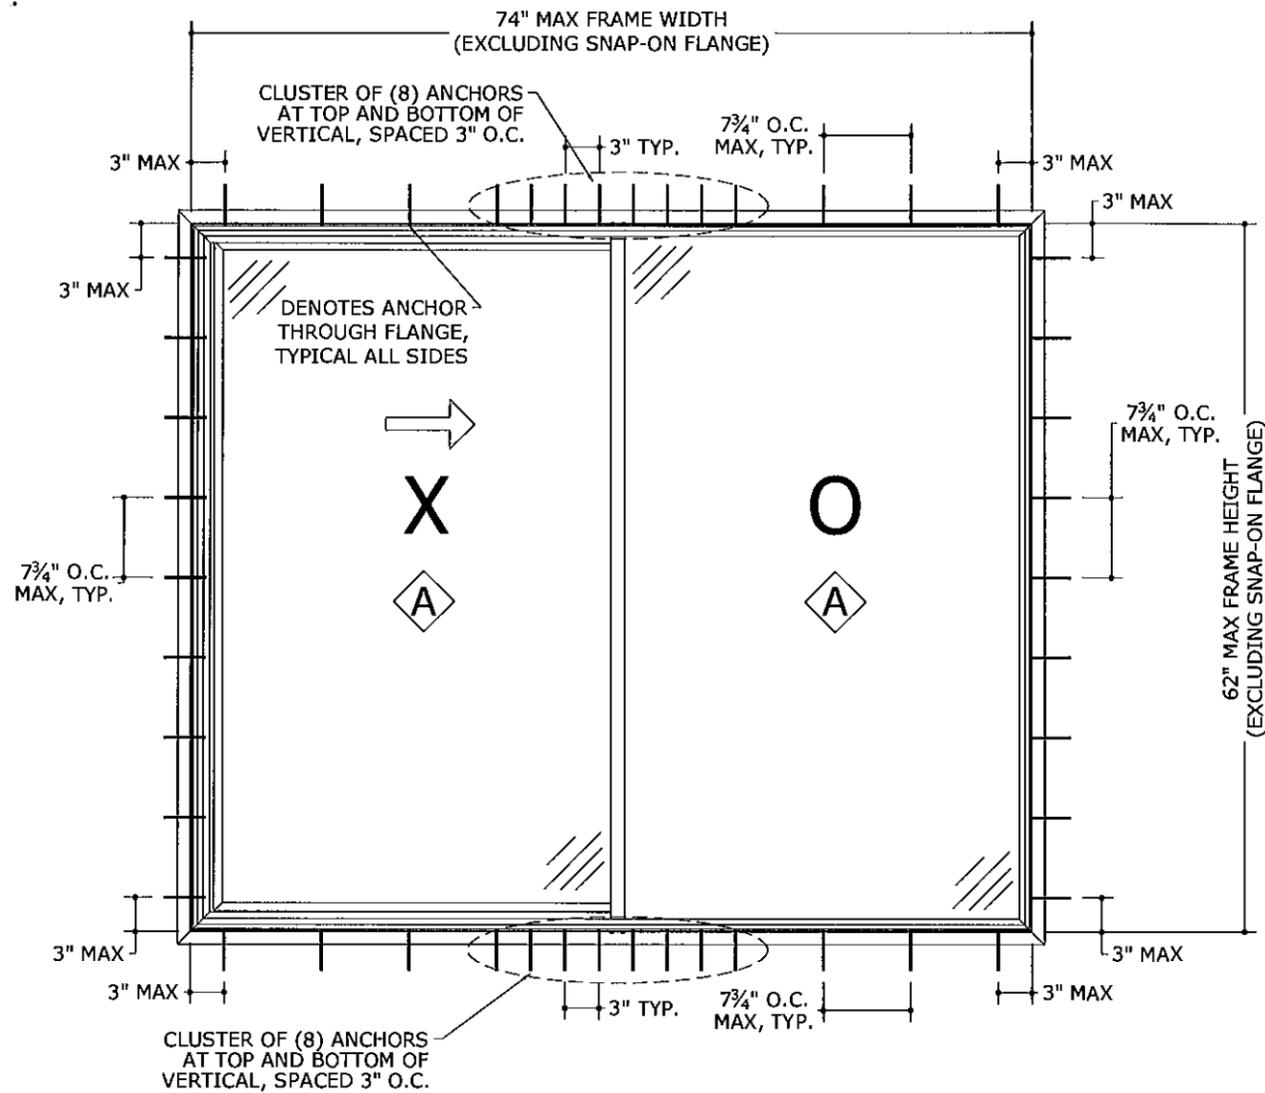

NOTE: XO CONFIGURATION SHOWN HERE.
XO AND OX CONFIGURATIONS APPROVED.

1 74x62 FRAME: THRU FRAME ANCHOR ELEVATION
2 N.T.S. EXTERIOR ELEV

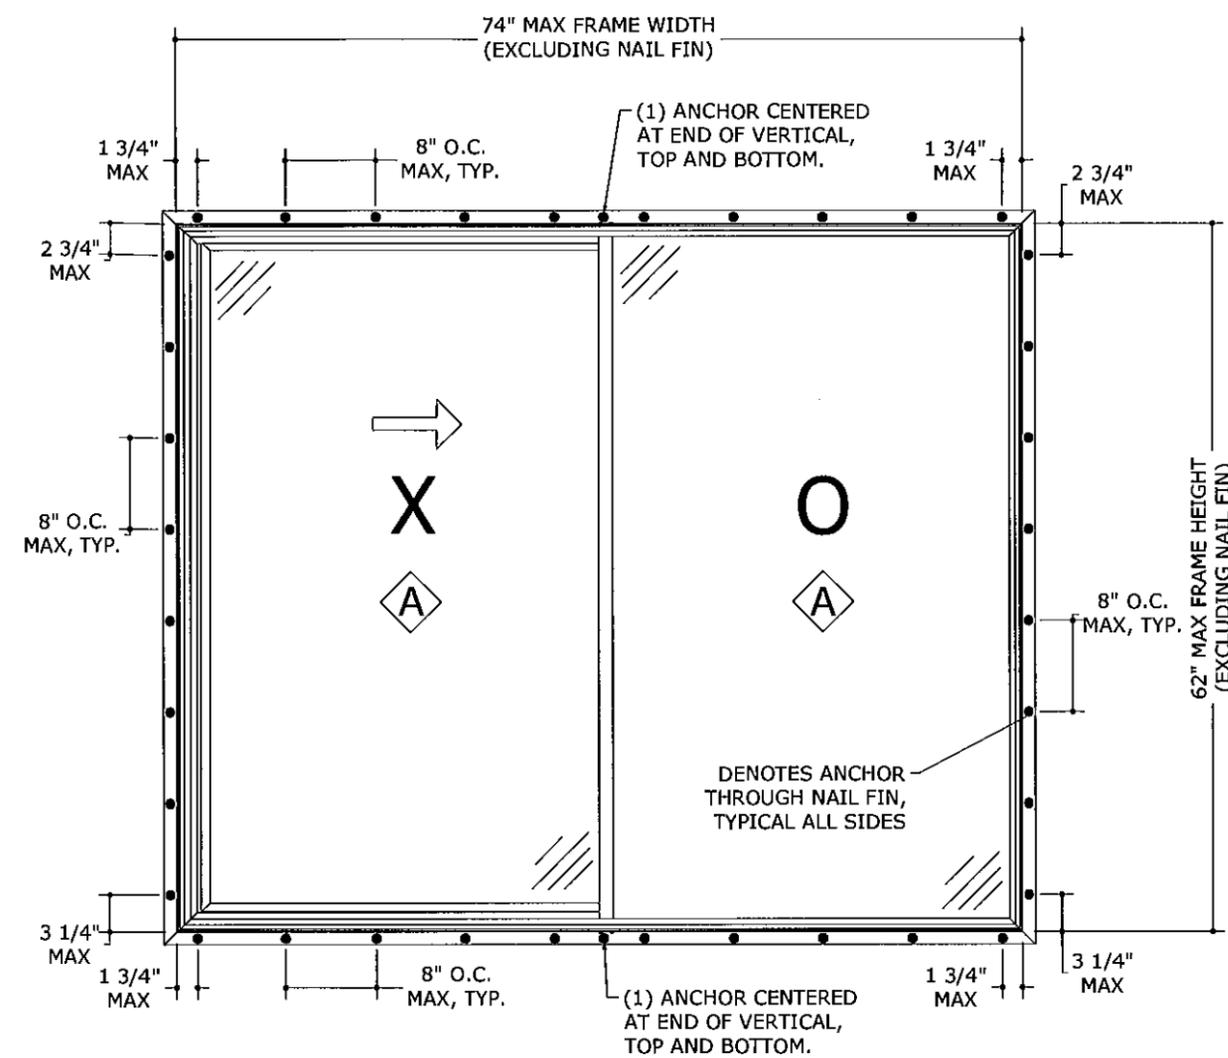

NOTE: XO CONFIGURATION SHOWN HERE.
XO AND OX CONFIGURATIONS APPROVED.

2 74x62 FRAME: NAIL FIN ANCHOR ELEVATION
2 N.T.S. EXTERIOR ELEV

ANCHOR SCHEDULE:

- TO HOLLOW BLOCK OR 3192 PSI MIN CONCRETE HOST STRUCTURE:**
- 1/4" ITW CARBON STEEL TAPCONS THRU 1X OR 2X WOOD BUCKS OR DIRECTLY INTO MASONRY/ CONCRETE WITH 1-1/4" MIN EMBED AND 1" MIN EDGE DISTANCE.
- TO WOOD BUCK OR HOST STRUCTURE (G=0.55 MIN WOOD):**
- #14 WOOD SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" MIN EDGE DISTANCE.
 - 1/4" LAG SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" MIN EDGE DISTANCE.
- TO 16 GAUGE MINIMUM STEEL STUD:**
- #14 SAE GRADE 5 SHEET METAL SCREW WITH FULL THREAD ENGAGEMENT THROUGH STUD AND 1/2" MIN EDGE DISTANCE.

ANCHOR NOTES:

1. SEE ANCHOR ELEVATION FOR ANCHOR LOCATIONS AND/OR SPACING.
2. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
3. ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS TO CONCRETE & TO HOLLOW BLOCK.
4. WHERE ANCHORS FASTEN TO NARROW FACE OF WOOD STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
5. WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
6. ANCHOR REQUIREMENTS AS SHOWN HEREIN, INCLUDING MINIMUM EMBEDMENT AND EDGE DISTANCE, EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN WITHIN THE HVHZ, A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE SHALL BE APPLIED FOR AND SECURED FROM THE MIAMI-DADE BUILDING CODE COMPLIANCE OFFICE PRODUCT CONTROL DIVISION. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN OUTSIDE THE HVHZ, THE BUILDING OFFICIAL MAY REQUIRE A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE BE OBTAINED, OR THAT SITE SPECIFIC DOCUMENTS BE PREPARED, SIGNED, DATED AND SEALED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, WHICH DETAIL AND JUSTIFY THE DEVIATION.
7. WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
8. OPTIONAL PRESSURE TREATED WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.

**ALLOWABLE
DESIGN PRESSURES**

**+50 PSF
-55 PSF**

Approved as complying with the
Florida Building Code
Date 03/02/2011
NOA# 10-0913.05
Miami-Dade Product Control
By [Signature]

FRANK L. BENNARDO, P.E.
PE0046549

02/04/2011

ENGINEERING EXPRESS®

160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #8885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELBOWEN

355 CENTER COURT
VENICE, FL 34285
PHONE: (941) 497 - 1984

PREMIUM ATLANTIC VINYL 8200 HORIZONTAL SLIDING WINDOW
NON-IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	06/29/10
REV PER BNC COMMENTS	KL	FLB	01/21/11

10-JWN-0016b

SCALE: **02**

PAGE DESCRIPTION:

2

F:\01 Project Files\Jeld-Wen (JWN)\2010\10-JWN-0016 Premium Atlantic Vinyl 8200 HS LMI (NOA)\10-JWN-0016b_02a Premium Atlantic Vinyl 8200 HS NI (NOA).dwg

FRANK L. BENNARDO, P.E.
PE0046549

02/04/2011

ENGINEERING EXPRESS®
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION


JELD-WEN
355 CENTER COURT
VENICE, FL 34285
PHONE: (941) 497 - 1984
PREMIUM ATLANTIC VINYL 8200 HORIZONTAL SLIDING WINDOW
NON-IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INT. ISSUE	KL	FLB	06/29/10
REV. PER ENG COMMENTS	KL	FLB	01/21/11


10-JWN-0016b
SCALE: 1/2
PAGE DESCRIPTION:

Approved as complying with the Florida Building Code
Date: 03/03/2010
NOA# 10-0713.0
Miami Dade Product Control
By: *[Signature]*
10

ALLOWABLE DESIGN PRESSURES
+65 PSF
-70 PSF

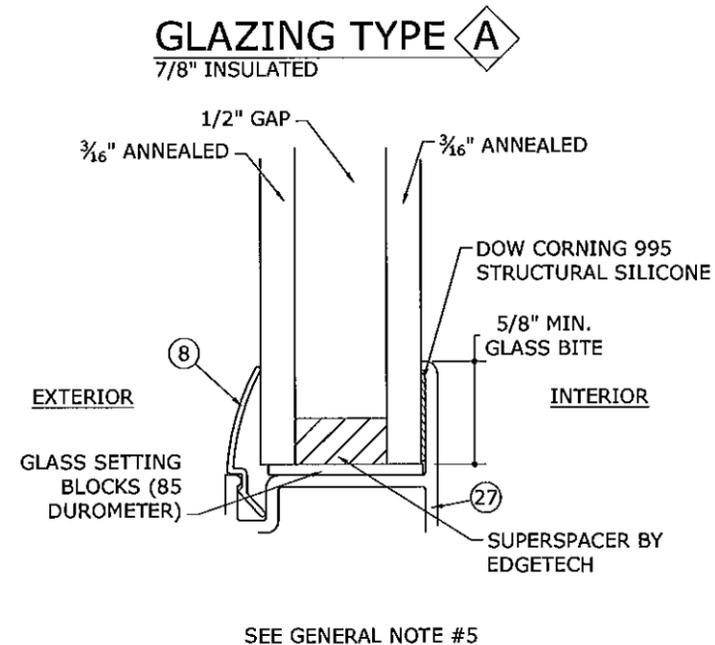

2 GLAZING DETAIL (MINIMUM)
3 N.T.S. VERT SECTION

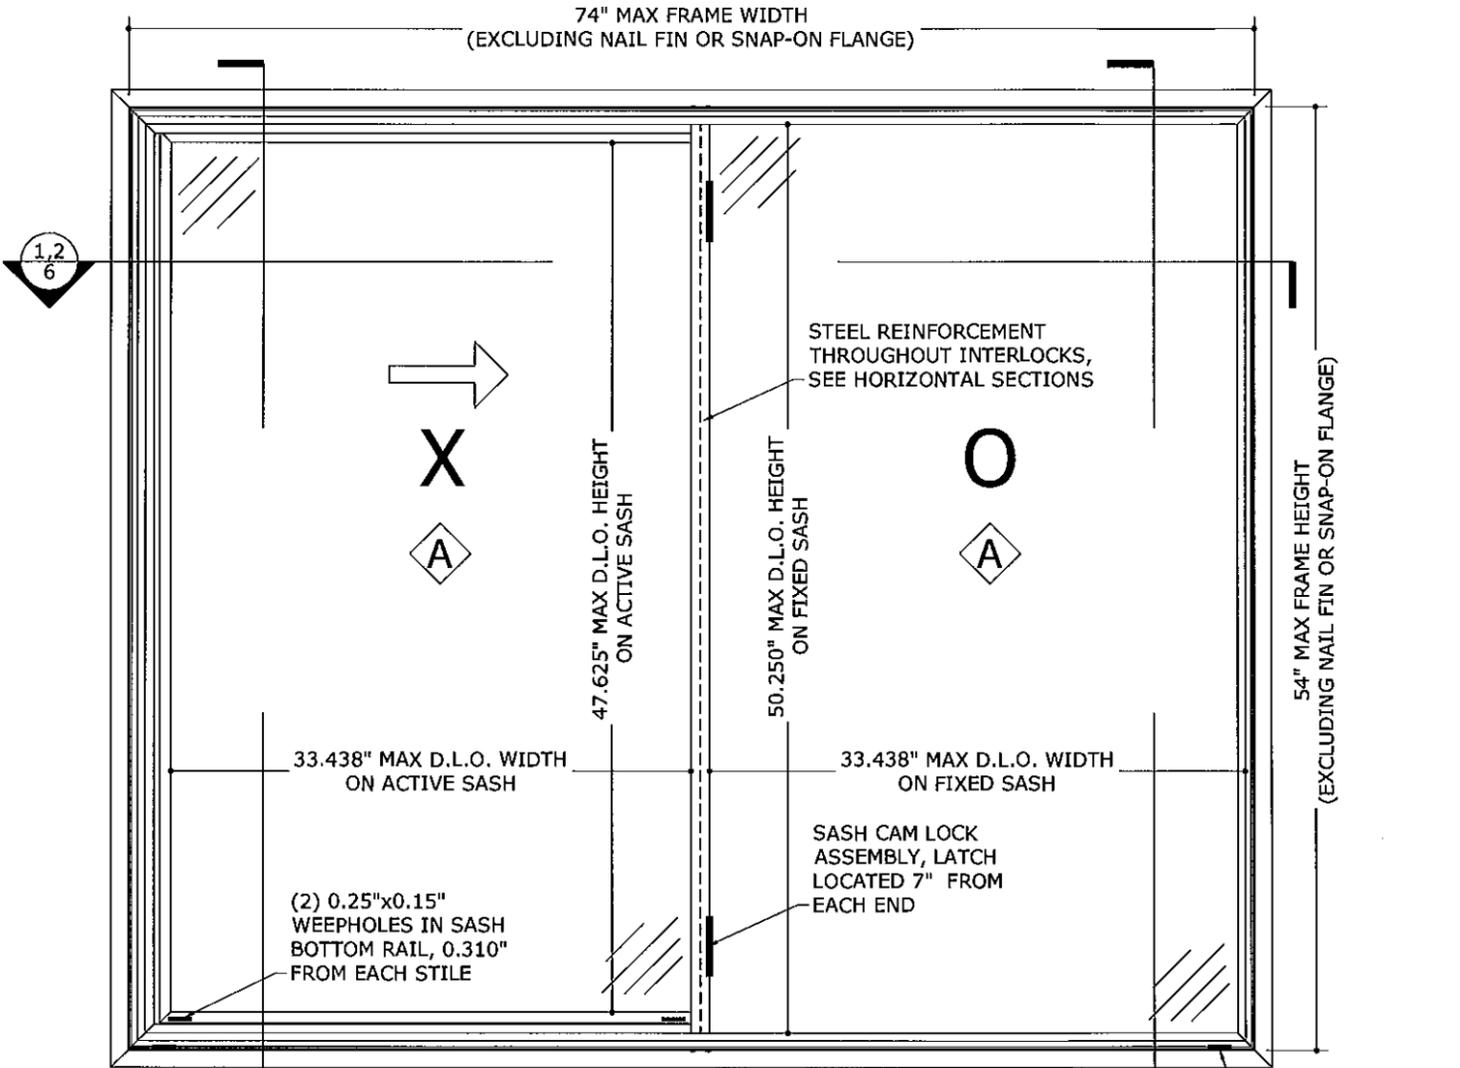

1 TYPICAL 74x54 FRAME ELEVATION W/ THRU FRAME OR NAIL FIN ANCHORAGE
3 N.T.S. EXTERIOR ELEV

NOTE: XO CONFIGURATION SHOWN HERE. XO AND OX CONFIGURATIONS APPROVED.

02/04/2011 - 2:15pm keithl

02/04/2011

ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
P: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION


JELD-WEN
355 CENTER COURT
VENICE, FL 34285
PHONE: (941) 497 - 1984
PREMIUM ATLANTIC VINYL 8200 HORIZONTAL SLIDING WINDOW
NON-IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE	DRWN	CHKD
INT ISSUE	08/29/10	KL	FLB
REV. PER ENG COMMENTS	01/21/11	KL	FLB

10-JWN-0016b


SCALE: 1/2" = 1'-0"
PAGE DESCRIPTION: 02

4

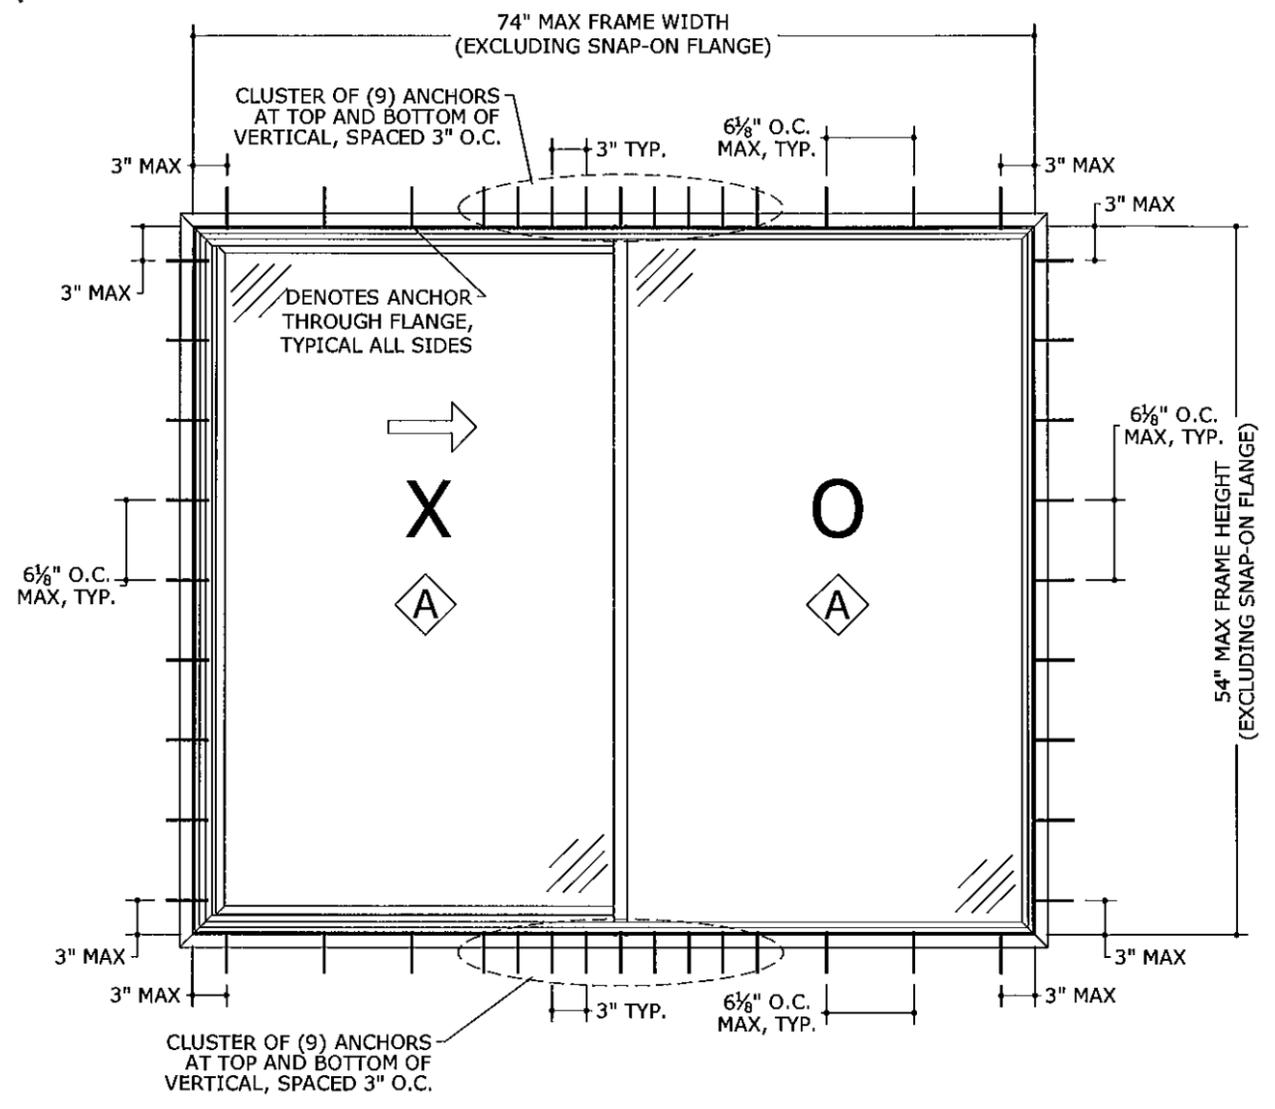

NOTE: XO CONFIGURATION SHOWN HERE.
XO AND OX CONFIGURATIONS APPROVED.

1 74x54 FRAME: THRU FRAME ANCHOR ELEVATION
4 N.T.S. EXTERIOR ELEV

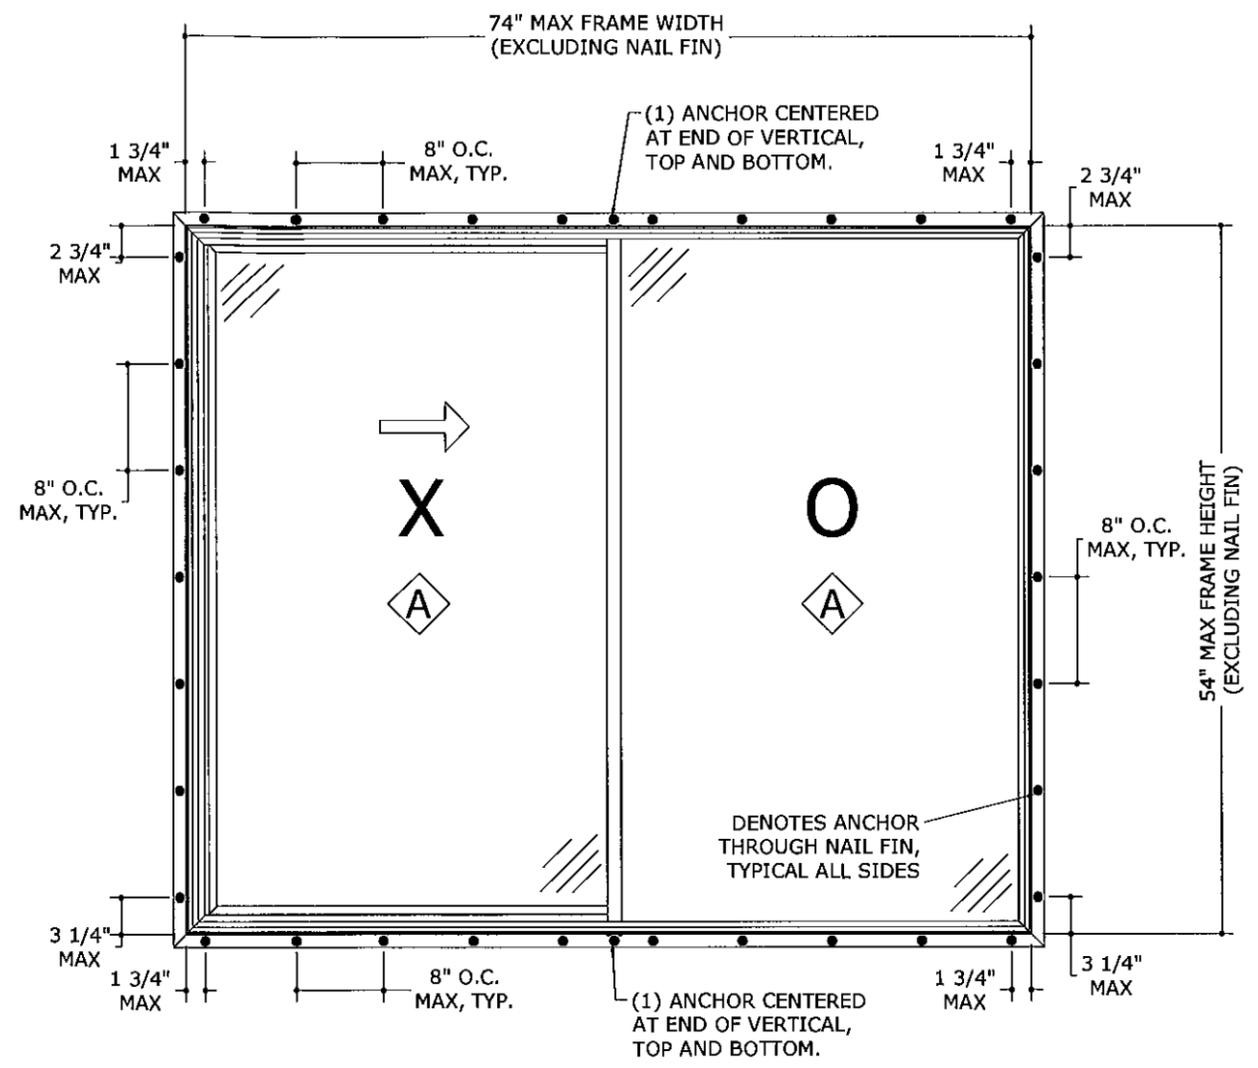

NOTE: XO CONFIGURATION SHOWN HERE.
XO AND OX CONFIGURATIONS APPROVED.

2 74x54 FRAME: NAIL FIN ANCHOR ELEVATION
4 N.T.S. EXTERIOR ELEV

ANCHOR SCHEDULE:
TO HOLLOW BLOCK OR 3192 PSI MIN CONCRETE HOST STRUCTURE:

- 1/4" ITW CARBON STEEL TAPCONS THRU 1X OR 2X WOOD BUCKS OR DIRECTLY INTO MASONRY/ CONCRETE WITH 1-1/4" MIN EMBED AND 1" MIN EDGE DISTANCE.

TO WOOD BUCK OR HOST STRUCTURE (G=0.55 MIN WOOD):

- #14 WOOD SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" MIN EDGE DISTANCE.
- 1/4" LAG SCREWS WITH 1-1/2" MIN. THREAD PENETRATION AND 3/4" MIN EDGE DISTANCE.

TO 16 GAUGE MINIMUM STEEL STUD:

- #14 SAE GRADE 5 SHEET METAL SCREW WITH FULL THREAD ENGAGEMENT THROUGH STUD AND 1/2" MIN EDGE DISTANCE.

ANCHOR NOTES:

- SEE ANCHOR ELEVATION FOR ANCHOR LOCATIONS AND/OR SPACING.
- ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
- ENSURE MINIMUM 2-1/2" EDGE DISTANCE FOR ALL ANCHORS TO CONCRETE & TO HOLLOW BLOCK.
- WHERE ANCHORS FASTEN TO NARROW FACE OF WOOD STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
- WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
- ANCHOR REQUIREMENTS AS SHOWN HEREIN, INCLUDING MINIMUM EMBEDMENT AND EDGE DISTANCE, EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN WITHIN THE HVHZ, A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE SHALL BE APPLIED FOR AND SECURED FROM THE MIAMI-DADE BUILDING CODE COMPLIANCE OFFICE PRODUCT CONTROL DIVISION. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN OUTSIDE THE HVHZ, THE BUILDING OFFICIAL MAY REQUIRE A ONE-TIME SITE-SPECIFIC NOTICE OF ACCEPTANCE BE OBTAINED, OR THAT SITE SPECIFIC DOCUMENTS BE PREPARED, SIGNED, DATED AND SEALED BY A LICENSED ENGINEER OR REGISTERED ARCHITECT, WHICH DETAIL AND JUSTIFY THE DEVIATION.
- WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
- OPTIONAL PRESSURE TREATED WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.

ALLOWABLE DESIGN PRESSURES
+65 PSF
-70 PSF

Approved as complying with the Florida Building Code
Date 03/03/2011
NOA# 10-09/3.06
Miami Dade Product Control
By *[Signature]*


F:\01 Project Files\Jeld-Wen (JWN)\2010\10-JWN-0016 Premium Atlantic Vinyl 8200 HS LMI (NOA)\10-JWN-0016b_02a Premium Atlantic Vinyl 8200 HS NI (NOA).dwg

FRANK L. BENNARDO, P.E.
PE0046549

02/04/2011


JELD-WEN ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #8885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN
355 CENTER COURT
VENICE, FL 34285
PHONE: (941) 497 - 1984
PREMIUM ATLANTIC VINYL 8200 HORIZONTAL SLIDING WINDOW
NON-IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

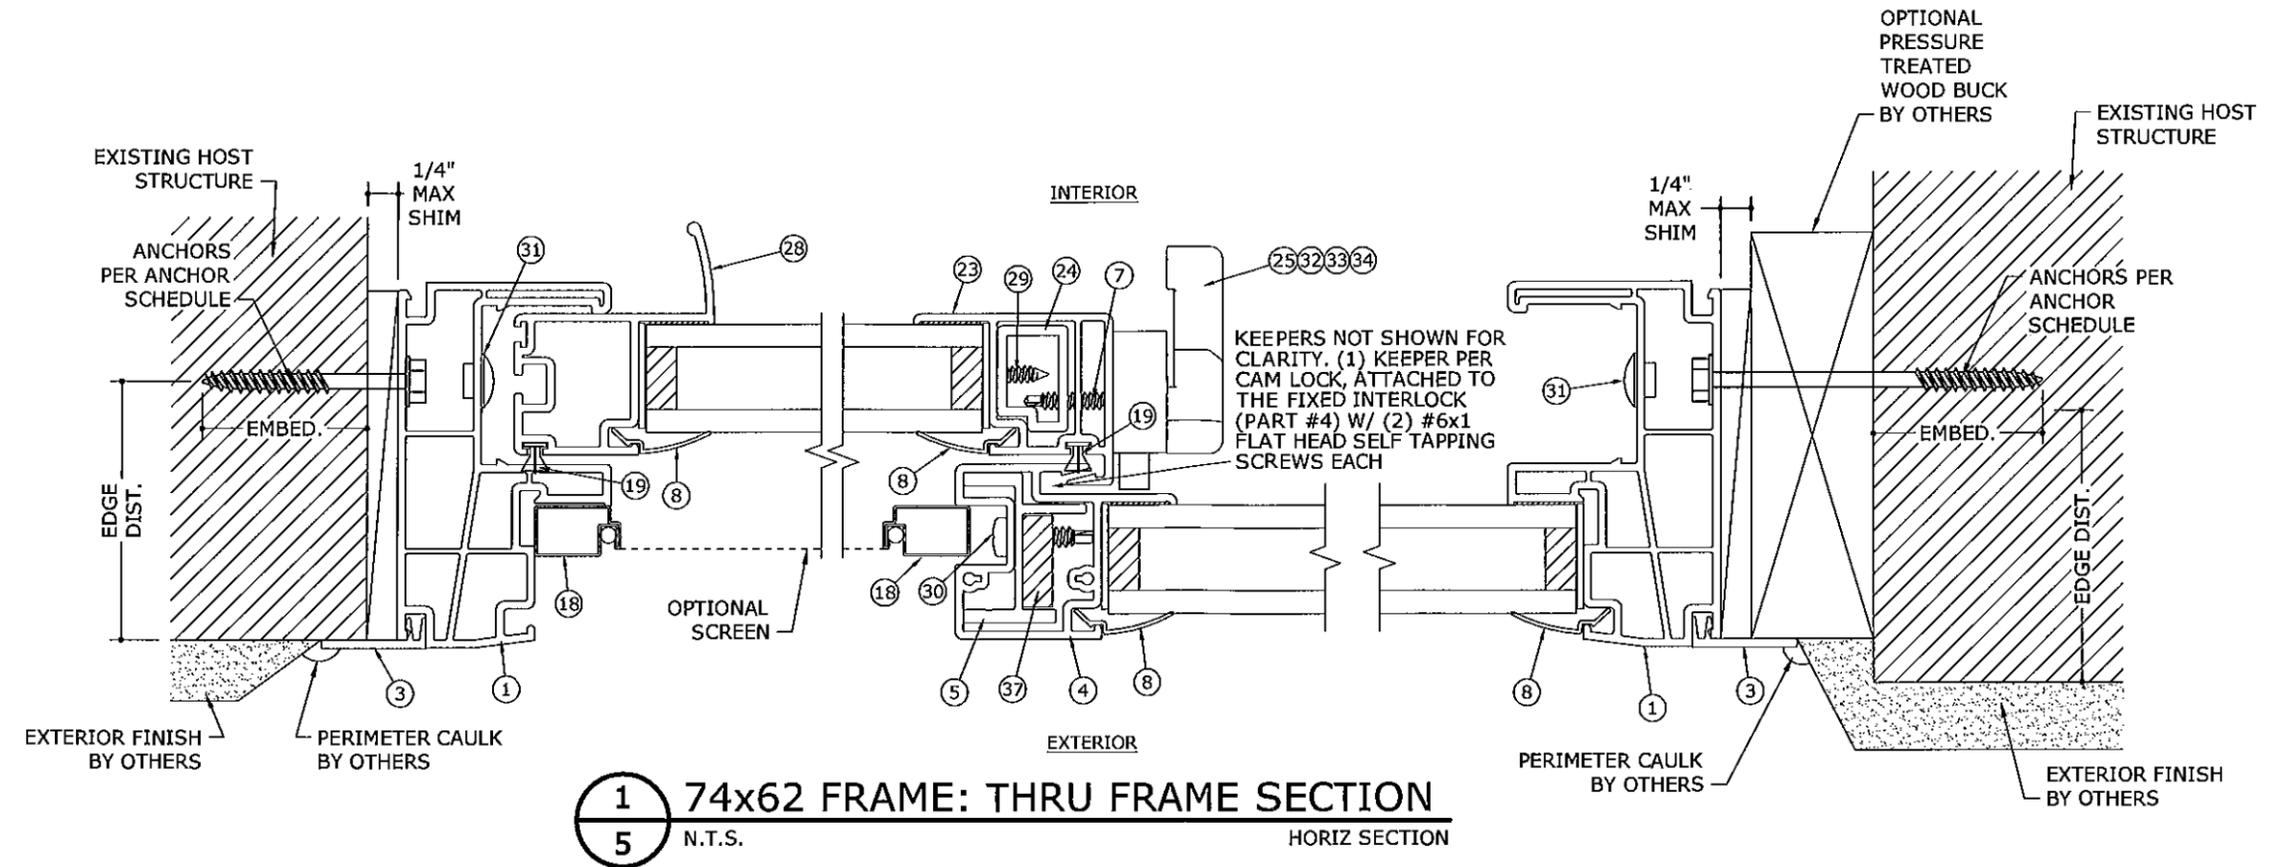

1 74x62 FRAME: THRU FRAME SECTION
5 N.T.S. HORIZ SECTION

NOTE: SEE ANCHOR ELEVATIONS FOR ANCHOR LOCATIONS AND SPACINGS. SEE ANCHOR SCHEDULE FOR MINIMUM EDGE DISTANCES AND EMBEDMENTS.

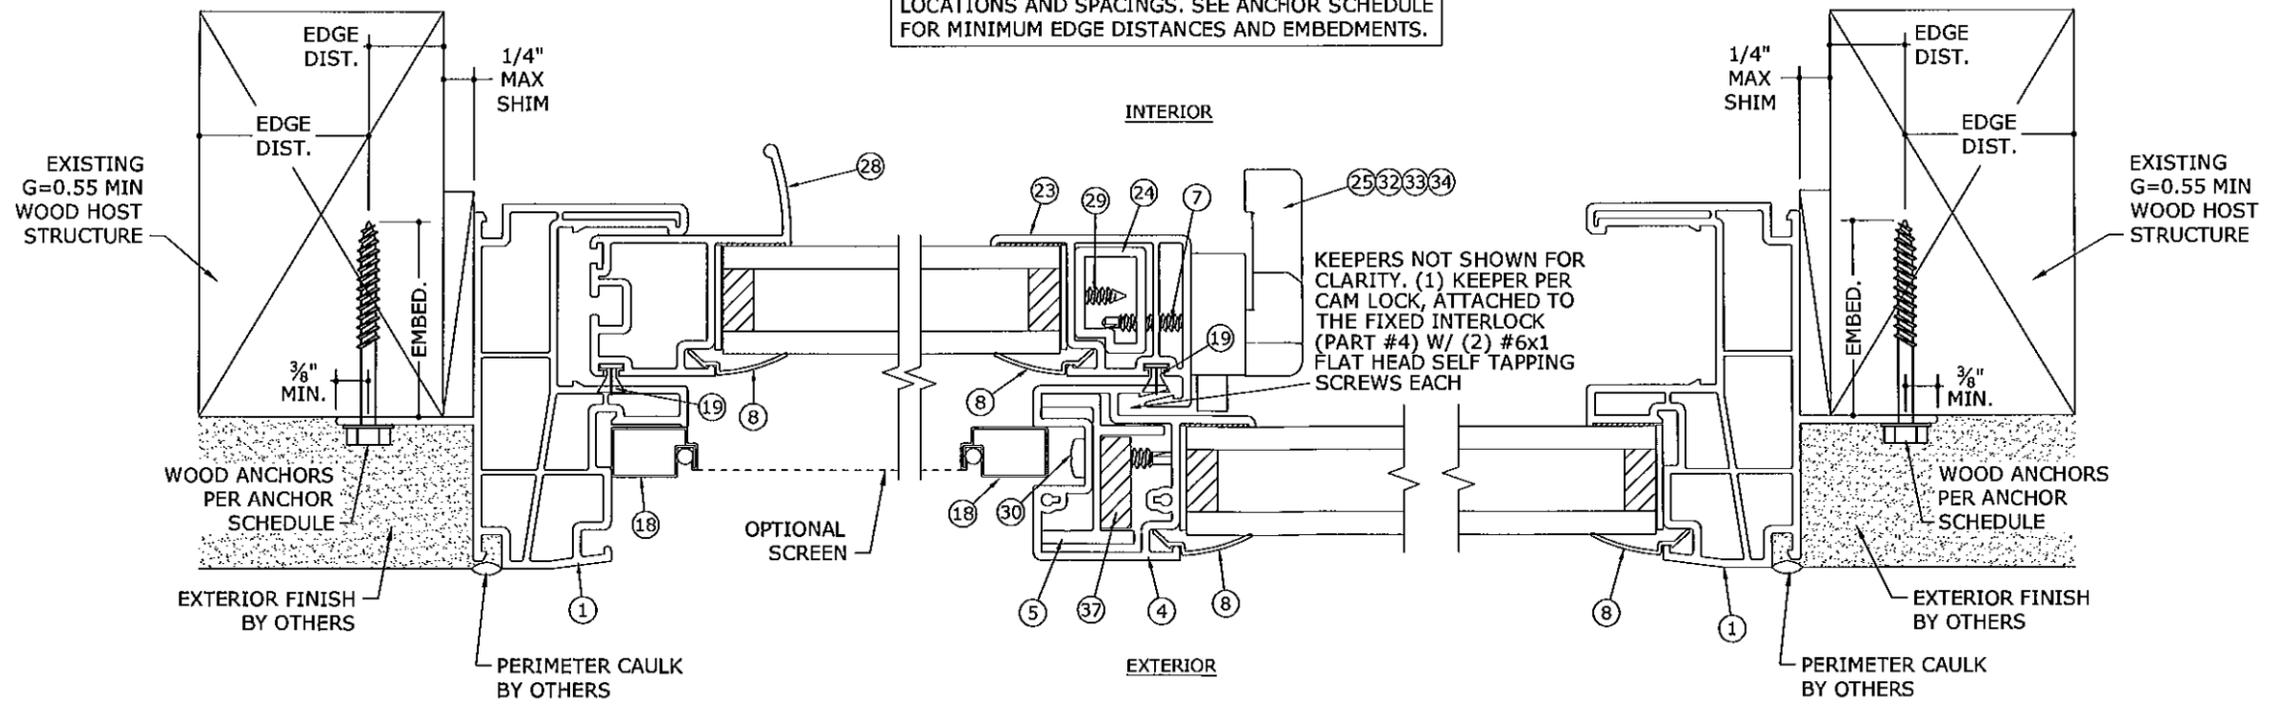

2 74x62 FRAME: NAIL FIN SECTION
5 N.T.S. HORIZ SECTION

REMARKS	DATE	DRWN	CHKD
INT ISSUE	06/29/10	KL	FLB
REV. PER BNC COMMENTS	01/21/11	KL	FLB

10-JWN-0016b
SCALE: 1/2"
PAGE DESCRIPTION: 02


Approved as complying with the
Florida Building Code
Date 03/03/2011
NOA# 10-2913.05
Miami Made Product Control
By *[Signature]*

5 10


F:\01 Project Files\Jeld-Wen (JWN)\2010\10-JWN-0016 Premium Atlantic Vinyl 8200 HS LMI (NOA)\10-JWN-0016b_02a Premium Atlantic Vinyl 8200 HS NI (NOA).dwg

keith

02/04/2011 - 2:15pm

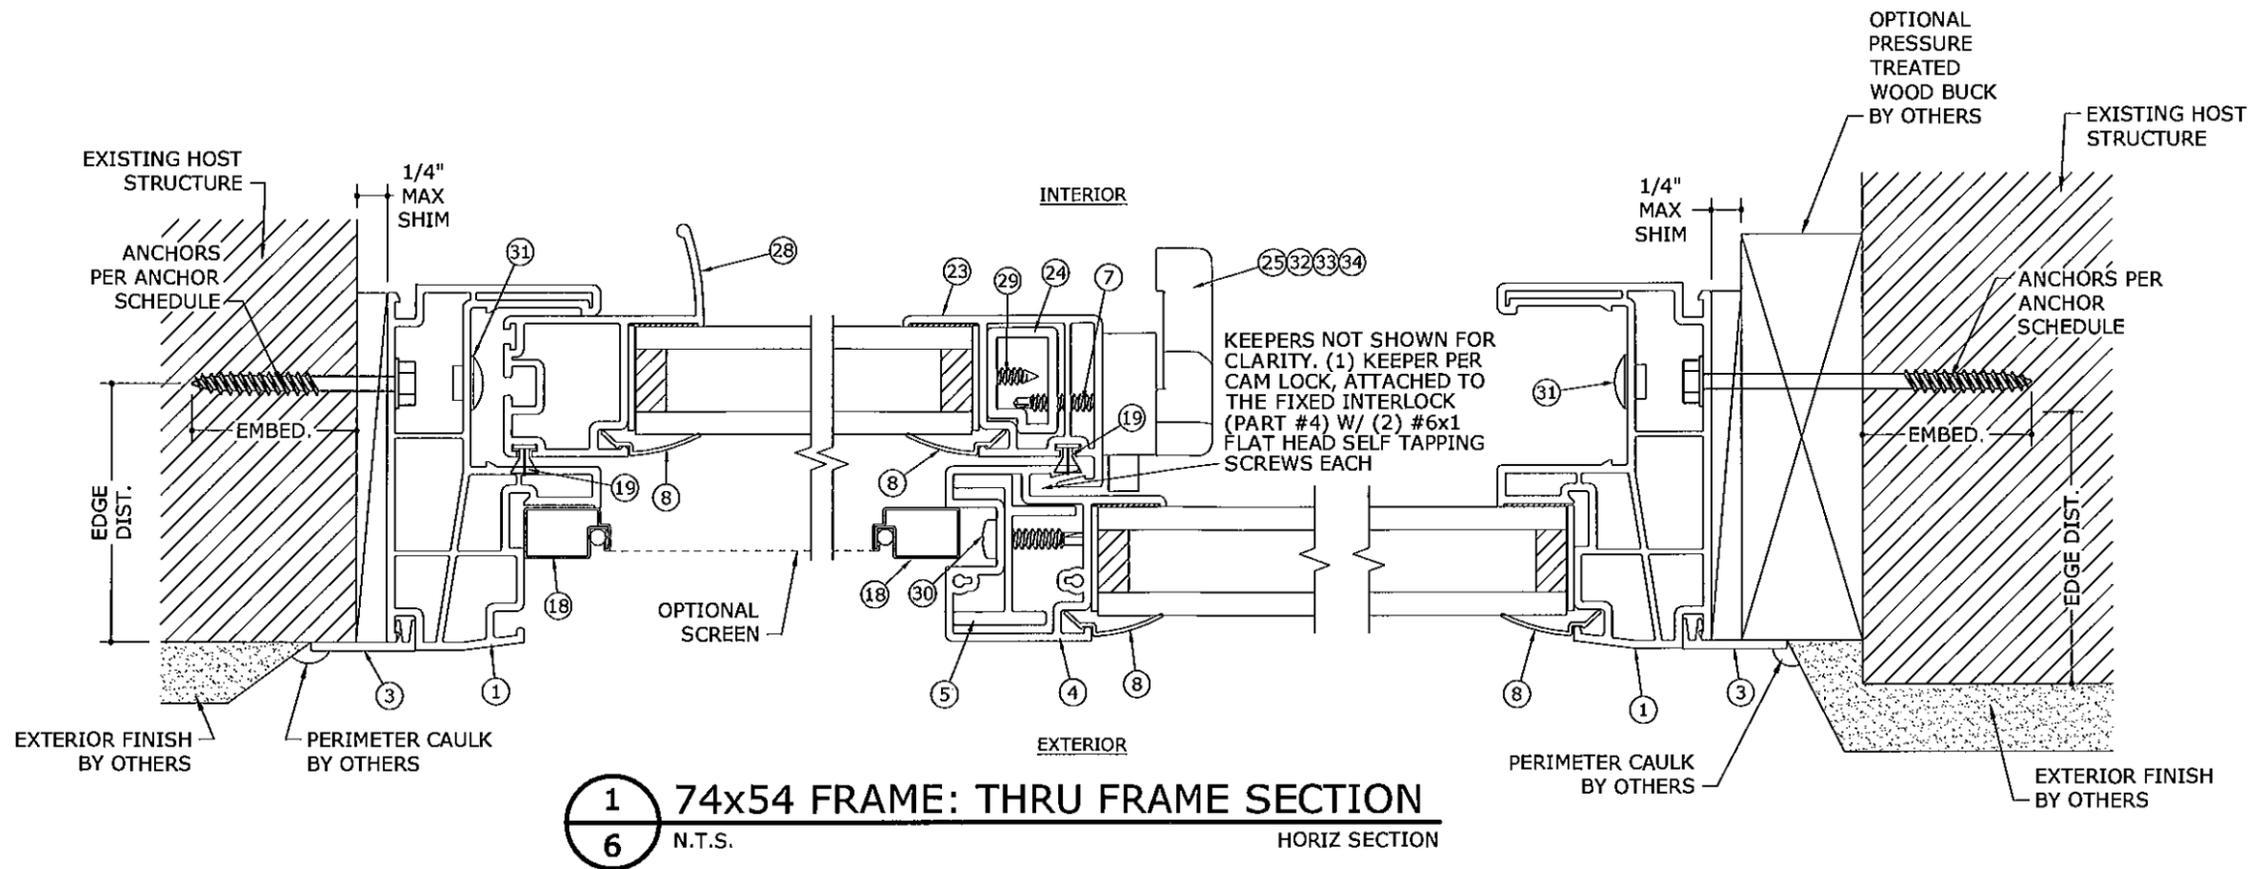

NOTE: SEE ANCHOR ELEVATIONS FOR ANCHOR LOCATIONS AND SPACINGS. SEE ANCHOR SCHEDULE FOR MINIMUM EDGE DISTANCES AND EMBEDMENTS.

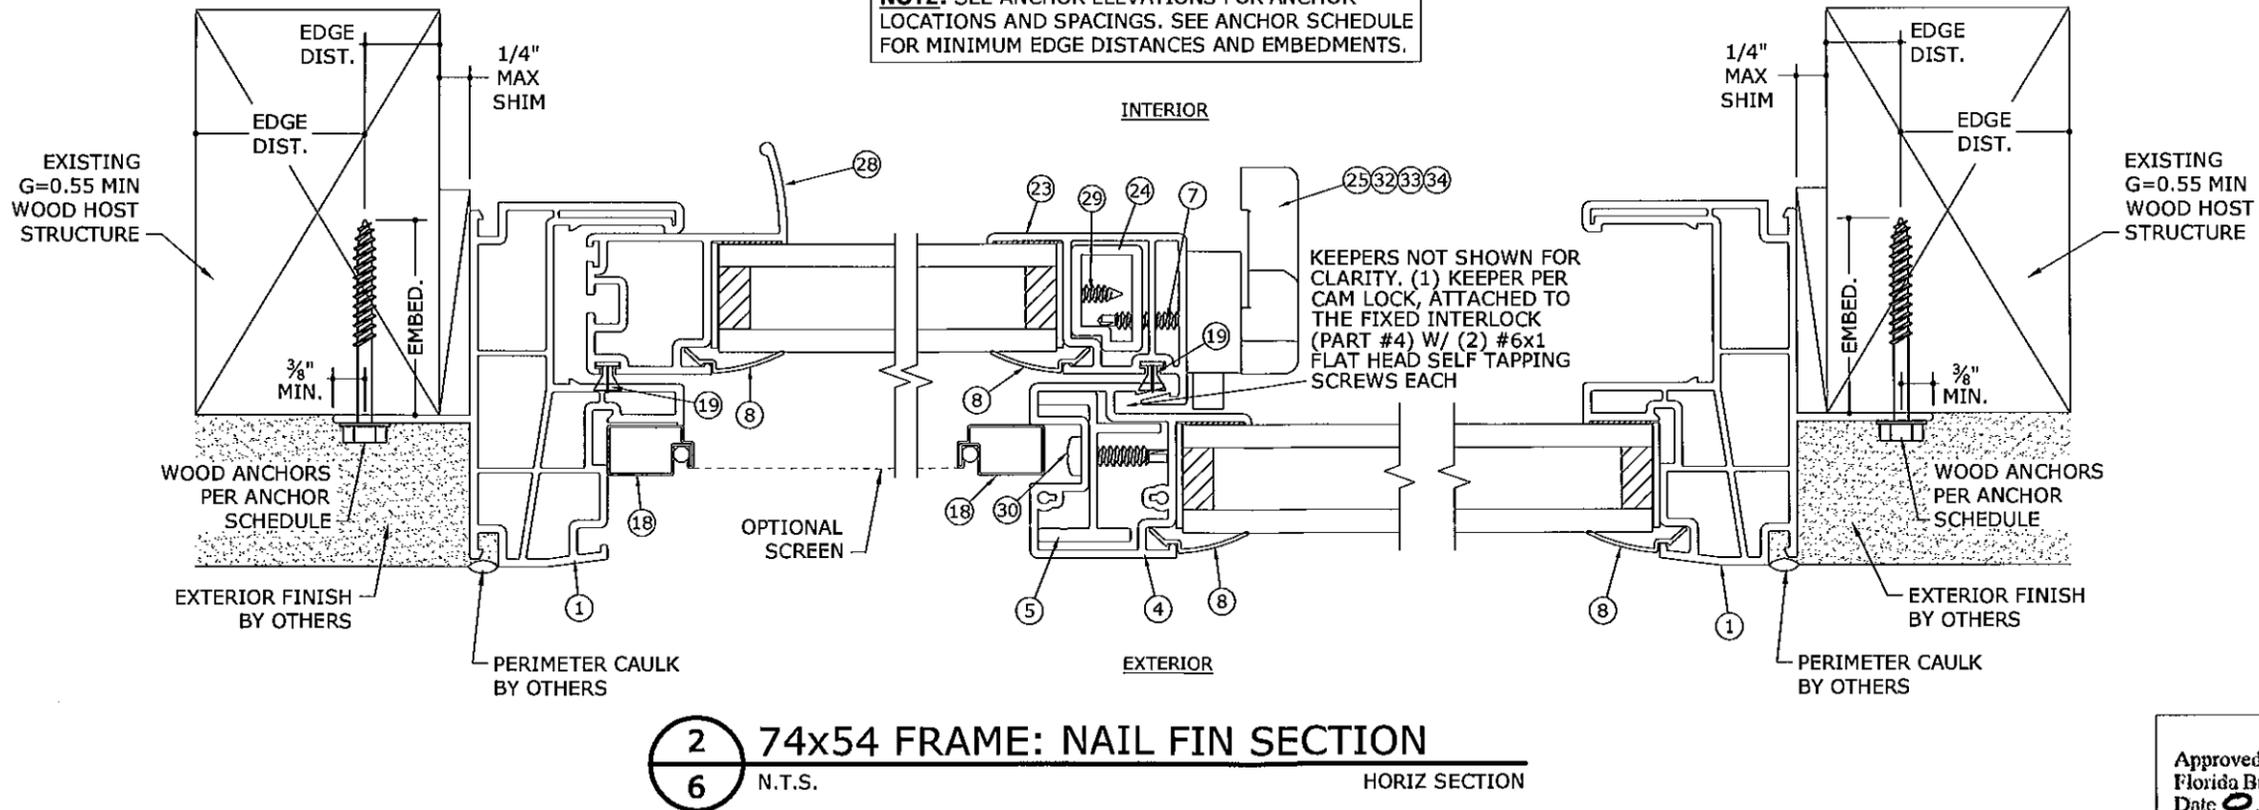

Approved as complying with the Florida Building Code
Date: 03/03/2011
NOA# 10-09/3.05
Miami Dade Product Control
By: *[Signature]*

FRANK L. BENNARDO, P.E.
#BE0046549

02/04/2011

JELD-WEN ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.JENGEXP.COM
CERT OF AUTH #888
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN
355 CENTER COURT
VENICE, FL 34285
PHONE: (941) 497 - 1984
PREMIUM ATLANTIC VINYL 8200 HORIZONTAL SLIDING WINDOW
NON-IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE


DRWN	CHKD	DATE
KL	FLB	06/29/10
REV. PER BNC COMMENTS	KL	01/21/11

10-JWN-0016b

SCALE: 02
PAGE DESCRIPTION:


10
6

F:\01 Project Files\Jeld-Wen (JWN)\2010\10-JWN-0016 Premium Atlantic Vinyl 8200 HS LMI (NOA)\10-JWN-0016b_02a Premium Atlantic Vinyl 8200 HS NI (NOA).dwg

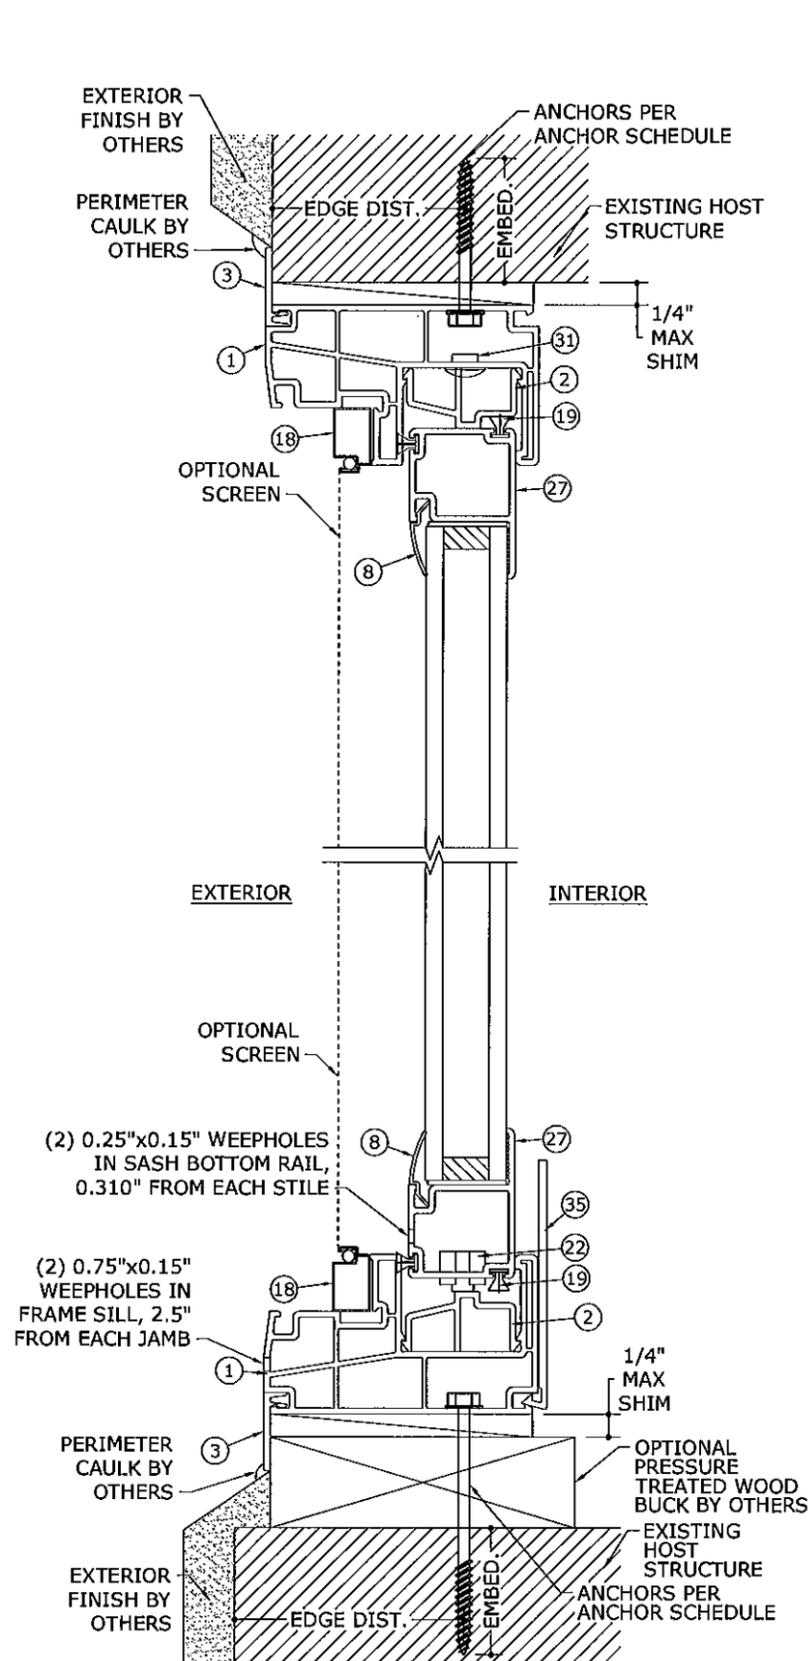

1
8 TYPICAL THRU FRAME SECTION AT ACTIVE SASH
N.T.S. VERT SECTION

NOTE: SEE ANCHOR ELEVATIONS FOR ANCHOR LOCATIONS AND SPACINGS. SEE ANCHOR SCHEDULE FOR MINIMUM EDGE DISTANCES AND EMBEDMENTS.

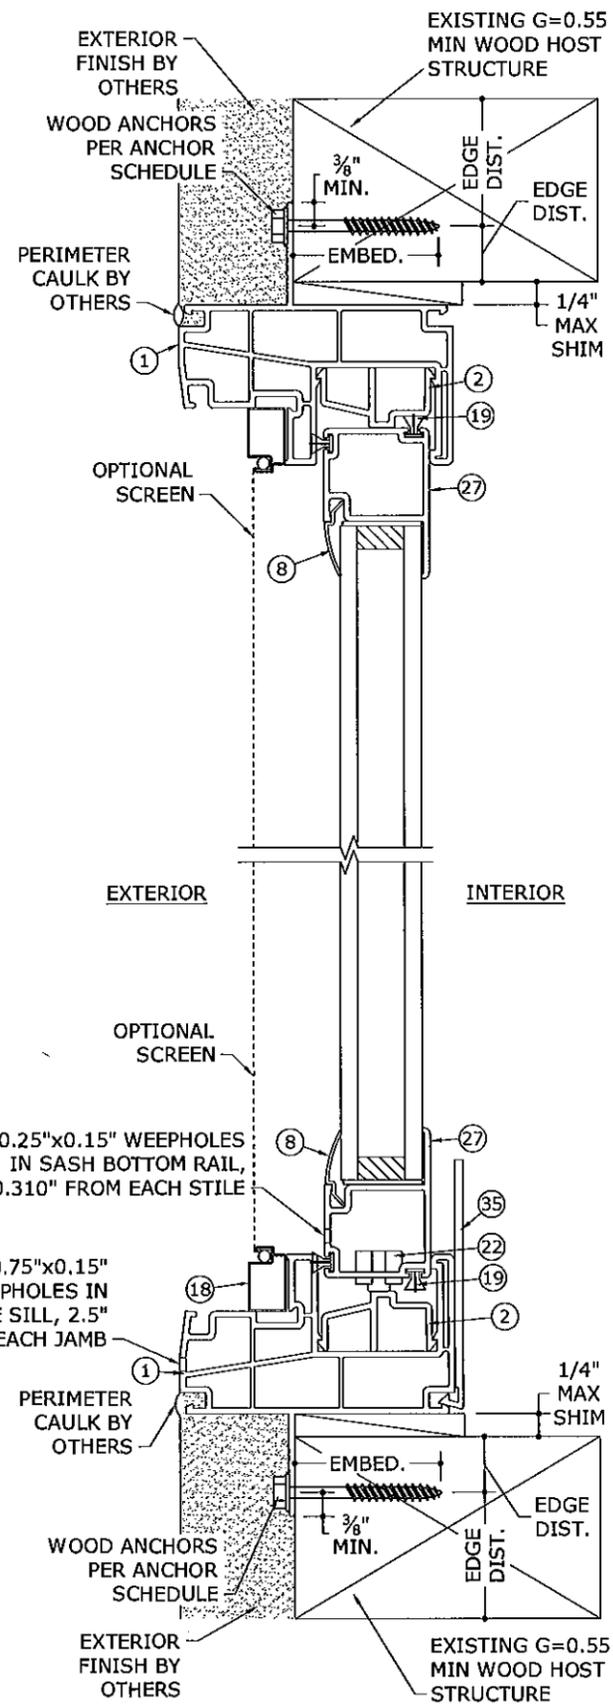

2
8 TYPICAL NAIL FIN SECTION AT ACTIVE SASH
N.T.S. VERT SECTION

Approved as complying with the Florida Building Code
Date **03/03/2011**
NOA# **10-0913-05**
Miami-Dade Product Control
By *[Signature]*

FRANK L. BENNARD, P.E.
PE0046549

02/04/2011

ENGINEERING EXPRESS

160 SW 12th Avenue, #106
Deerfield Beach, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM

CERT. OF AUTH. #888
A FRANK L. BENNARD, P.E., INC. INNOVATION

JELD-WEN

355 CENTER COURT
VENICE, FL 34285
PHONE: (941) 497 - 1984

PREMIUM ATLANTIC VINYL 8200 HORIZONTAL SLIDING WINDOW
NON-IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INT. ISSUE	KL	FLB	08/29/10
REV. PER ENG COMMENTS	KL	FLB	01/21/11


10-JWN-0016b

SCALE: **02**

PAGE DESCRIPTION:

10

02/04/2011 - 2:16pm keithl F:\01 Project Files\Jeld-Wen (JWN)\2010\10-JWN-0016 Premium Atlantic Vinyl 8200 HS LMI (NOA)\10-JWN-0016b_02a Premium Atlantic Vinyl 8200 HS NI (NOA).dwg

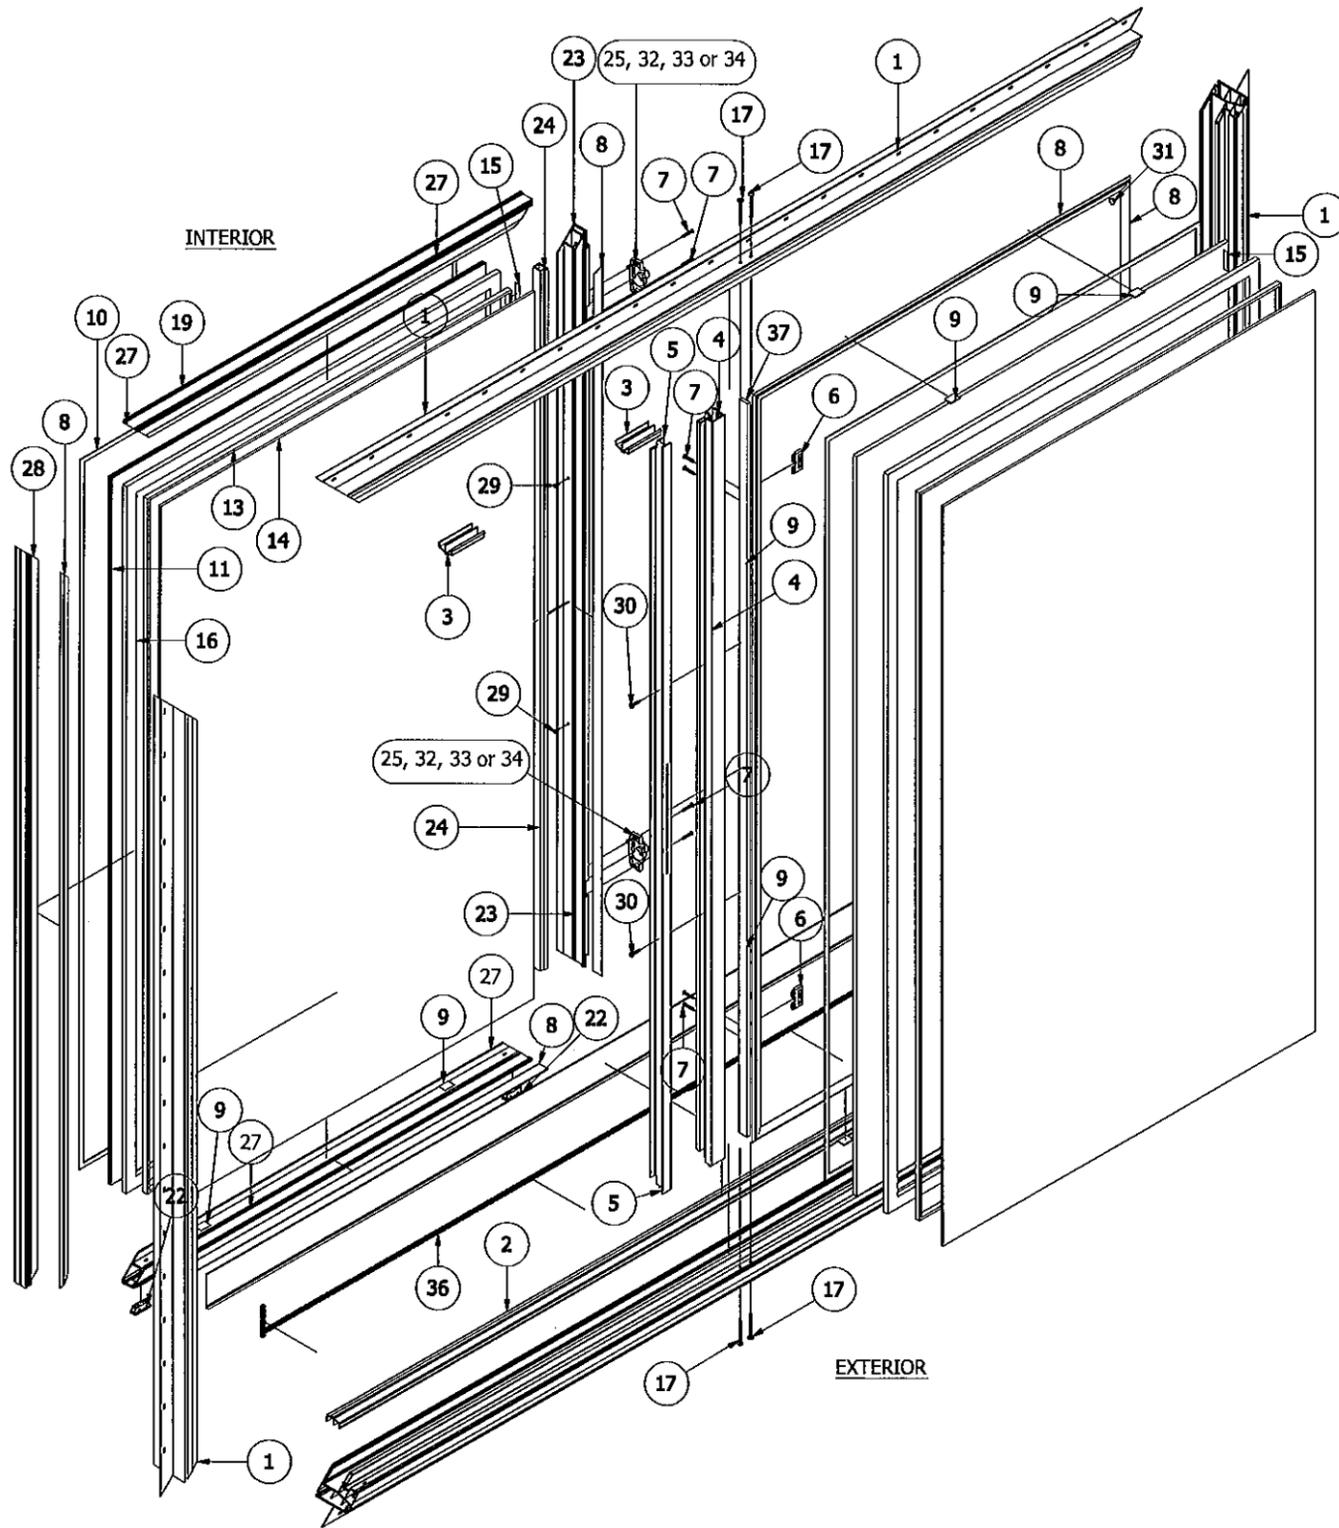

1 TYPICAL ASSEMBLY DETAIL
9 N.T.S. ISOMETRIC

BILL OF MATERIALS				
ITEM	PART NUMBER	STOCK NUMBER	DESCRIPTION	VENDOR
1*	02075	Die: 7130	RW Main Frame (75-80 Shore D)	Mikron
2*	01856/01857	Die: 7123	Roller Track/Anti-Lift (75-80 Shore D)	Mikron
3*	01885	Die: 8864	Snap-In Flange (75-80 Shore D)	Mikron
4*	01859	7126 - Interlock	Fixed - Interlock (75-80 Shore D)	Mikron
5	00647	7126.1 - Reinforcement	Fixed Rail Reinforcement (6063-T6 Aluminum)	Indalex
6	01919	677183	Keeper - Deco 677183	Deco
7	01930	94195A125	6x1 PPH Self Tapping	Merchants Fasteners
8*	01846	6177 - Ins Glazing Bead	Glass Stop (75-80 Shore D)	Mikron
9	01934	6573 - Glazing Block	Setting Block (85 Durometer)	Frank Lowe
10	00095	Dow 995 - White	Part of IG Stack	Dow Corning
11	Glass - DSB	1/8" Annealed	Part of IG Stack	Cardinal
12	Interlayer	DuPont .090" PVB or SGP	Part of IG Stack	Cardinal
13	04943	SuperSpacer - .375"	Part of IG Stack	EdgeTech
14	Glass - 1875	3/16" Annealed	Part of IG Stack	Cardinal
15	10407	.375" Mylar Tape	Part of IG Stack	EdgeTech
16	04878	Butyl Sealer - HL5160c-125	Part of IG Stack	HB Fuller
17	03320	Fixed Interlock Fasteners	#6 x 2.00" Truss Head PPH SS	Merchants Fasteners
18	-----	Screen Frame	Screen Frame (6063-T6 Aluminum)	Indalex
19	01093	.187" x .250" Weather Strip	*Varies*	Ultra Fab
22	01254	Wheel Assembly	*Varies*	RoMai
23*	01835	Die: 7092	Vent Interlock (75-80 Shore D)	Mikron
24	00635	7092.1 - Reinforcement	Sash Reinforcement - Vertical (6063-T6 Alum)	Mikron
25	01918	Die: 677509K26	Deco Cam Lock (w/button)	Deco
27*	01838	Die: 7093	Vent Head / Sill (75-80 Shore D)	Mikron
28*	01839	7745 - Pull Stile	Pull Rail (75-80 Shore D)	Mikron
29	00235	#6 x 1/2" PPH SMS - Tan	90065A148	Merchants Fasteners
30	00173	#8-18 x 3/4" PPH TEK	8100/8200/8700/8800/4500	Merchants Fasteners
31	01975	Hole Plug	*Varies*	Ro-Mai
32	05029	Die: 677209K19	Deco Cam Lock (w/o button)	Deco
33	12477	Die: 12477-5	JW Cam Lock - LH	Fastek
34	12478	Die: 12478-5	JW Cam Lock - RH	Fastek
35*	01864	Die: 7155	Sill Riser (75-80 Shore D)	Mikron
36	07168	Dow 1199	Dow 1199 - Clear	Dow Corning
37	02067	1/4" x 3/4" CRS	Used only in the 64" tall unit. (Galv. Steel Fy=33ksi)	Alro

***NOTE:** RIGID WHITE PVC BY MIKRON IS UNDER SEPARATE CURRENT MIAMI-DADE NOTICE OF ACCEPTANCE (NOA). WHITE PVC EXTRUSIONS SHALL BE LABELED WITH AAMA EXTRUDER CODE, EXTRUDER NAME, CITY, STATE & "MIAMI-DADE COUNTY APPROVED".

FRANK L. BENNARDO, P.E.
PE0046549

02/04/2011

JELD-WEN ENGINEERING EXPRESS
 160 SW 12th AVENUE, #106
 DEERFIELD BEACH, FL 33442
 Ph: (954) 354-0660 Fax: (954) 354-0443
 WWW.ENGINEERINGEXPRESS.COM
 CERT. OF AUTH. #8885
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN
 355 CENTER COURT
 VENICE, FL 34285
 PHONE: (941) 497 - 1984
 PREMIUM ATLANTIC VINYL 8200 HORIZONTAL SLIDING WINDOW
 NON-IMPACT RESISTANT
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE	DRWN	CHKD
INT. ISSUE	06/29/10	KL	FLB
REV. PER BNC COMMENTS	01/21/11	KL	FLB

10-JWN-0016b
 SCALE: 1/2
 PAGE DESCRIPTION:

Approved as complying with the Florida Building Code
 Date: 03/03/2011
 NOA#: 10-0913.05
 Miami Dade Product Control
 By: *[Signature]*

10

F:\01 Project Files\Jeld-Wen (JWN)\2010\10-JWN-0016 Premium Atlantic Vinyl 8200 HS NI (NOA)10-JWN-0016b_02a Premium Atlantic Vinyl 8200 HS NI (NOA).dwg

FRANK L. BENNARDO, P.E.
PE0046549

02/04/2011


ENGINEERING EXPRESS®
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGGEXP.COM
CERT OF AUTH #888
A FRANK L. BENNARDO, P.E., INC. INNOVATION

JELD-WEN
355 CENTER COURT
VENICE, FL 34285
PHONE: (941) 497 - 1984
PREMIUM ATLANTIC VINYL 8200 HORIZONTAL SLIDING WINDOW
NON-IMPACT RESISTANT
MIAMI-DADE NOTICE OF ACCEPTANCE


REMARKS	DATE	DRWN	CHKD
INIT ISSUE	06/29/10	KL	FLB
REV. PER ENG COMMENTS	01/21/11	KL	FLB

10-JWN-0016b
SCALE: 1/2"
PAGE DESCRIPTION:


10

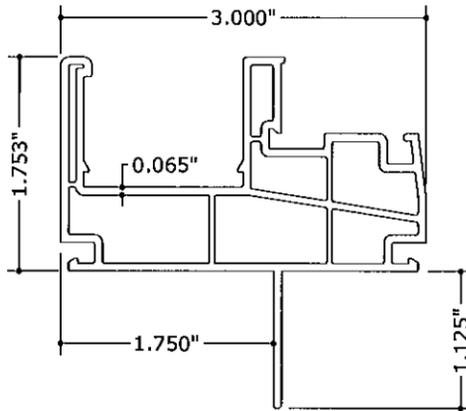


1 MAIN FRAME
8" = 1'-0" PVC

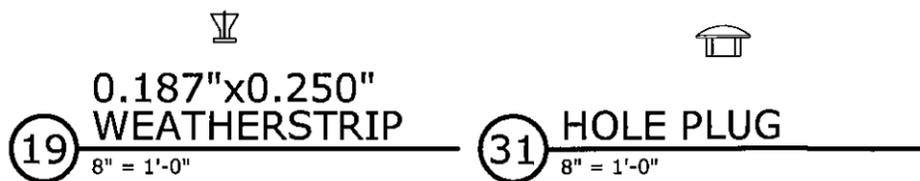


19 0.187"x0.250" WEATHERSTRIP
8" = 1'-0"
31 HOLE PLUG
8" = 1'-0"

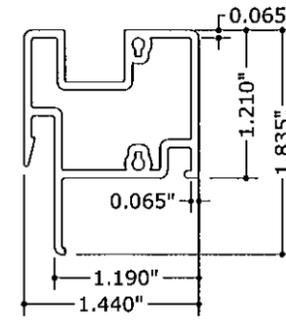


4 FIXED INTERLOCK
8" = 1'-0" PVC

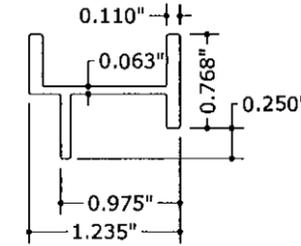


5 FIXED INTERLOCK REINFORCEMENT
8" = 1'-0" 6063-T6 ALUM




8 GLAZING BEAD
8" = 1'-0" PVC

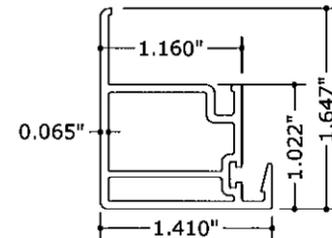


23 VENT INTERLOCK
8" = 1'-0" PVC




24 VENT INTERLOCK REINFORCEMENT
8" = 1'-0" 6063-T6 ALUM




27 VENT RAIL
8" = 1'-0" PVC

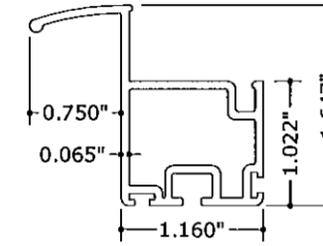


28 PULL RAIL
8" = 1'-0" PVC




35 SILL RISER
8" = 1'-0" PVC




37 FIXED INTERLOCK REINFORCEMENT
8" = 1'-0" STEEL




18 SCREEN FRAME
8" = 1'-0" 6063-T6 ALUM




9 SETTING BLOCK
8" = 1'-0"




6 KEEPER
8" = 1'-0"

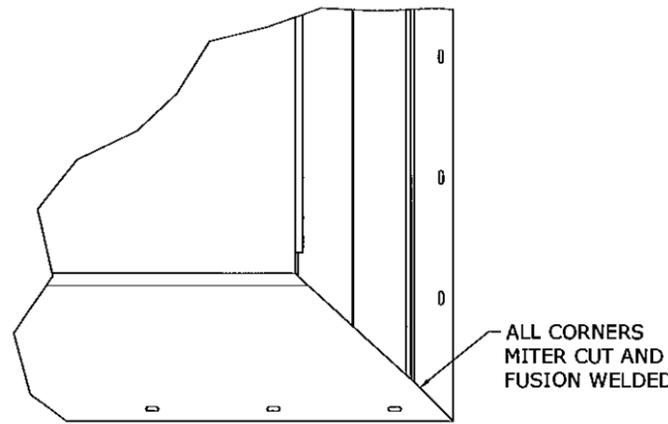


1 FRAME CORNER DETAIL
10 N.T.S. EXTERIOR ELEV

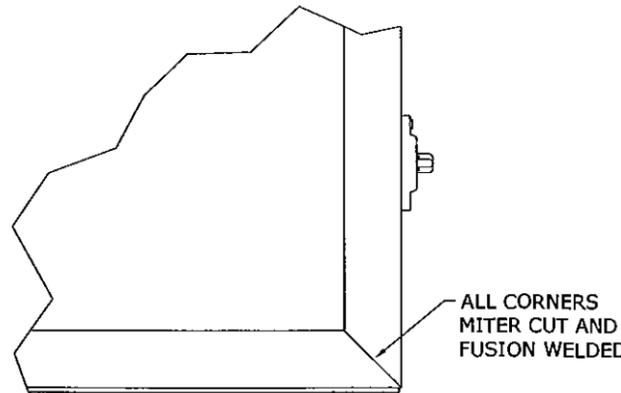


2 SASH CORNER DETAIL
10 N.T.S. EXTERIOR ELEV

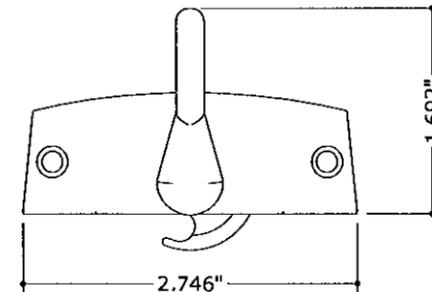

25, 32 SASH LOCK ASS'Y
8" = 1'-0"

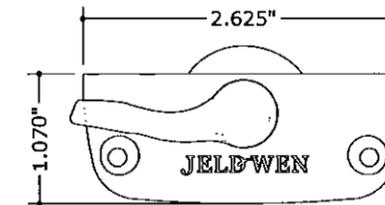

33, 34 SASH LOCK ASS'Y
8" = 1'-0"



22 WHEEL ASSEMBLY
8" = 1'-0"

Approved as complying with the Florida Building Code
Date: 03/03/2011
NOA# 10-09/13.05
Miami Dade Product Control
By: *[Signature]*