



MIAMI-DADE COUNTY
BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
 11805 SW 26 Street, Room 208
 Miami, Florida 33175-2474
 T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidadecounty.gov/building/home/asp

The Cookson Company
2417 S. 50 Avenue
Phoenix, AZ 85043

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Section and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: 14'-5" Wide Insulated Steel Roll-up Door

APPROVAL DOCUMENT: Drawing No. **FBC-145-120-DC-01**, titled "Dade County Approved 14'-5" wide I20 psf Insulated Rolling Steel Door", sheets 1 and 2 of 2, dated 09/10/10, prepared by The Cookson Company, signed and sealed by Joseph H. Dixon, Jr., P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the private labeler's name or logo, private labeler's location, the NOA number and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



[Handwritten Signature]
 01/18/11

NOA No. 10-0929.01
 Expiration Date: May 10, 2012
 Approval Date: December 30, 2010
 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **FBC-145-120-DC-01**, titled "Dade County Approved 14'-5" wide 120 psf Insulated Rolling Steel Door", sheets 1 and 2 of 2, dated 09/10/10, prepared by The Cookson Company, signed and sealed by Joseph H. Dixon, Jr., P.E.

B. TESTS "Submitted under NOA # 06-1205.07"

1. Test reports on 1) Uniform Static Air Pressure Test (Structural only) per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings of Model ESD20 Thermiser Galvanized Steel Roll-up Door, Report No. **CTLA-1600W**, prepared by Certified Testing Laboratories, dated 11/28/06, signed and sealed by Ramesh Patel, P.E.
2. Test report on Tensile Test per ASTM E8 of Galvanized Steel, Report No. **CTLA-1600W** and **1600W-1**, prepared by Certified Testing Laboratories, dated 12/04/06, signed and sealed by Ramesh Patel, P.E.
3. Test report on Evaluation of Painted Panels Test per ASTM D 1654 (ASTM B 117), Report No. **ETC-06-1071-18365.0**, prepared by ETC Laboratories, dated 11/02/06, signed and sealed by Joseph L. Doldan, P.E.
4. Test report on Ignition Temperature per ASTM D1929 and Flame Spread/ Smoke generation per ASTM E84, Report No. **ETC-07-1071-18738.0**, prepared by ETC Laboratories, dated 02/15/07, signed and sealed by Joseph L. Doldan, P.E.

C. CALCULATIONS: "Submitted under NOA # 08-1219.05"

1. Anchoring calculations and structural analysis, dated 11/18/06, and 12/15/08, prepared, signed and sealed by Joseph H. Dixon, Jr., P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Building and Neighborhood Compliance Department (BNC)

E. MATERIAL CERTIFICATIONS


1. None.

F. STATEMENTS "Submitted under NOA # 08-1219.05"

1. Statement letter of code conformance with FBC 2007, dated 12/17/08, signed and sealed by Joseph H. Dixon, Jr., P.E.
2. Statement letter of no financial interest, dated 12/15/08, signed and sealed by Joseph H. Dixon, Jr., P.E.

G. OTHERS

1. Private labeling agreement dated 09/07/10.



Carlos M. Utrera, P.E.


Product Control Examiner

NOA No. 10-0929.01

Expiration Date: May 10, 2012



Approval Date: December 30, 2010

LTR	REVISION	DATE	BY	E.C.O.
•	ORIGINAL ISSUE	09/10/10	R.M.	•

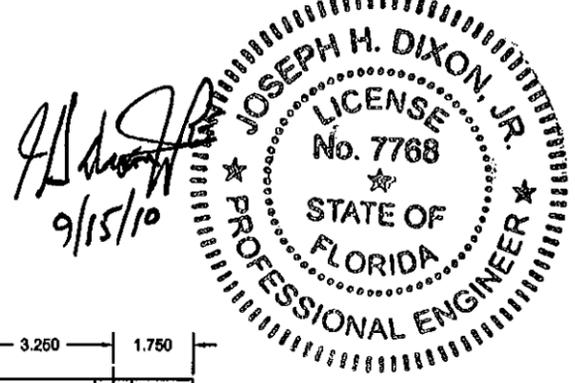

Handwritten signature and date:
9/15/10



ROLL-UP MECHANISM NOT INCLUDED IN THIS APPROVAL. MUST BE CERTIFIED BY AN INDEPENDENT TESTING AGENCY IF REQUIRED.

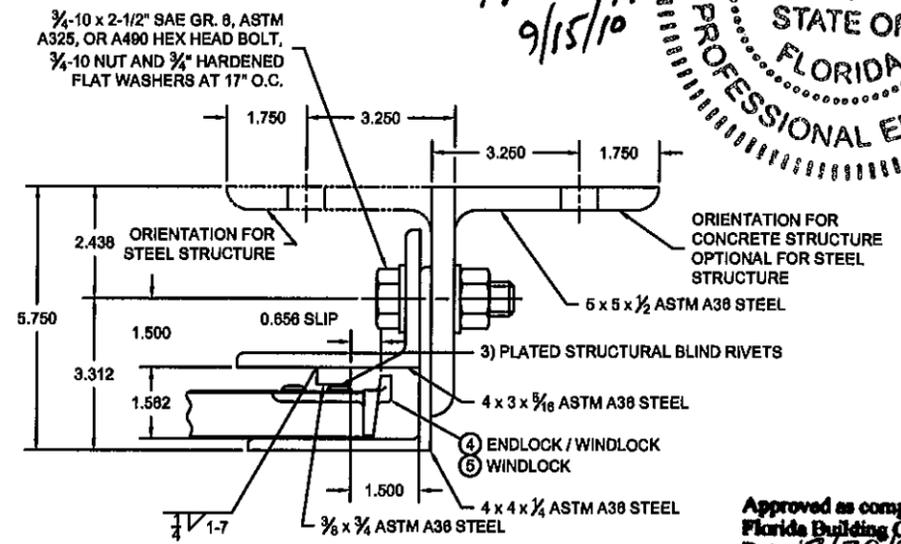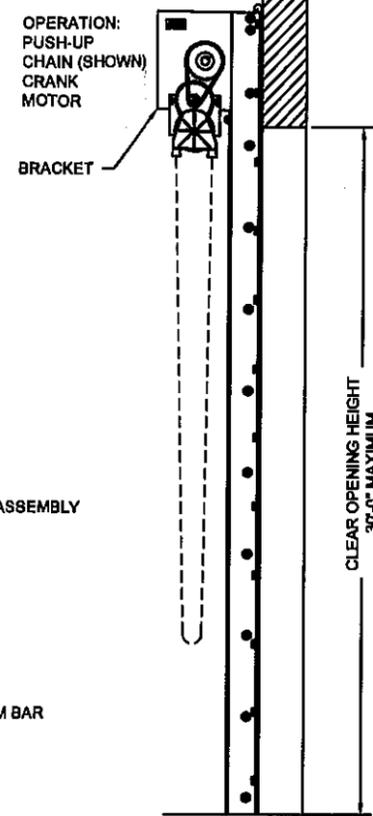

① GUIDE ASSEMBLY DETAIL
1/2 SCALE


Approved as complying with the Florida Building Code
Date 12/30/2010
MOA# 10-0729-01
Miami Dade Product Control
Division
By *[Signature]*

- NOTES:
- THIS ROLL-UP DOOR SYSTEM IS DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, LATEST EDITION, AS A LARGE MISSILE IMPACT RESISTANT SYSTEM.
 - POSITIVE AND NEGATIVE DESIGN PRESSURE CALCULATIONS SHALL BE PERFORMED FOR SPECIFIC JOBS IN ACCORDANCE WITH ASCE 7 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES. WIND LOADS DETERMINED FOR OPENINGS SHALL BE LESS THAN OR EQUAL TO DOOR DESIGN PRESSURES NOTED BELOW.
POSITIVE DESIGN LOAD = 120 PSF
NEGATIVE DESIGN LOAD = 120 PSF
 - THE DETAILS AND SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED FOR UNIFORM STATIC AIR PRESSURE IN CONFORMANCE WITH DADE COUNTY PROTOCOLS TAS 201, 202 AND 203.
POSITIVE DESIGN LOAD = 120 PSF
NEGATIVE DESIGN LOAD = 120 PSF
 - TESTING PERFORMED BY CERTIFIED TESTING LABORATORIES (ORLANDO, FL.) TEST REPORT No. CTLA-1600W.
 - SUPERIMPOSED LOADS ON THE JAMBS FROM THIS DOOR ARE DESIGNATED AS F1, F2 AND F3 HEREIN. CONTRACTORS SHALL HAVE FLORIDA REGISTERED PROFESSIONAL ENGINEER VERIFY ADEQUACY OF BUILDING STRUCTURE TO RESIST SUPERIMPOSED LOADS F1, F2, AND F3.
 - ALL WELDING SHALL BE PERFORMED BY QUALIFIED WELDERS IN ACCORDANCE WITH AWS SPECIFICATIONS, LATEST EDITION. ALL WELDING ELECTRODES SHALL CONFORM TO AWS A5.1, GRADE E-70. MINIMUM WELDING PROCESS SHALL BE ARC WELDING AWS E7014 OR MIG WELDING AWS E708-6.
 - ANCHOR NOTES:
A. EMBEDMENT DEPTH DOES NOT INCLUDE STUCCO FINISH.
B. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS SPECIFICATIONS.
 - FOAMED IN PLACE INSULATION, TESTED IN ACCORDANCE WITH ASTM E-94 AND D-1920 OR MINERAL WOOL INSULATION.
 - DOOR MAY BE INSTALLED ON THE INSIDE OR OUTSIDE OF AN EXTERIOR WALL.
 - A 33% INCREASE IN ALLOWABLE STRESS HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT.

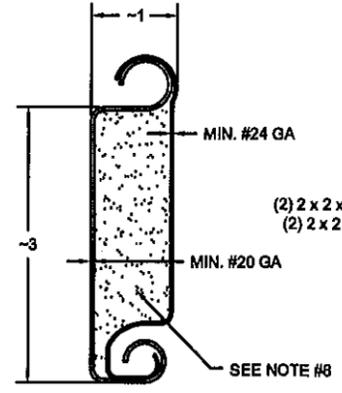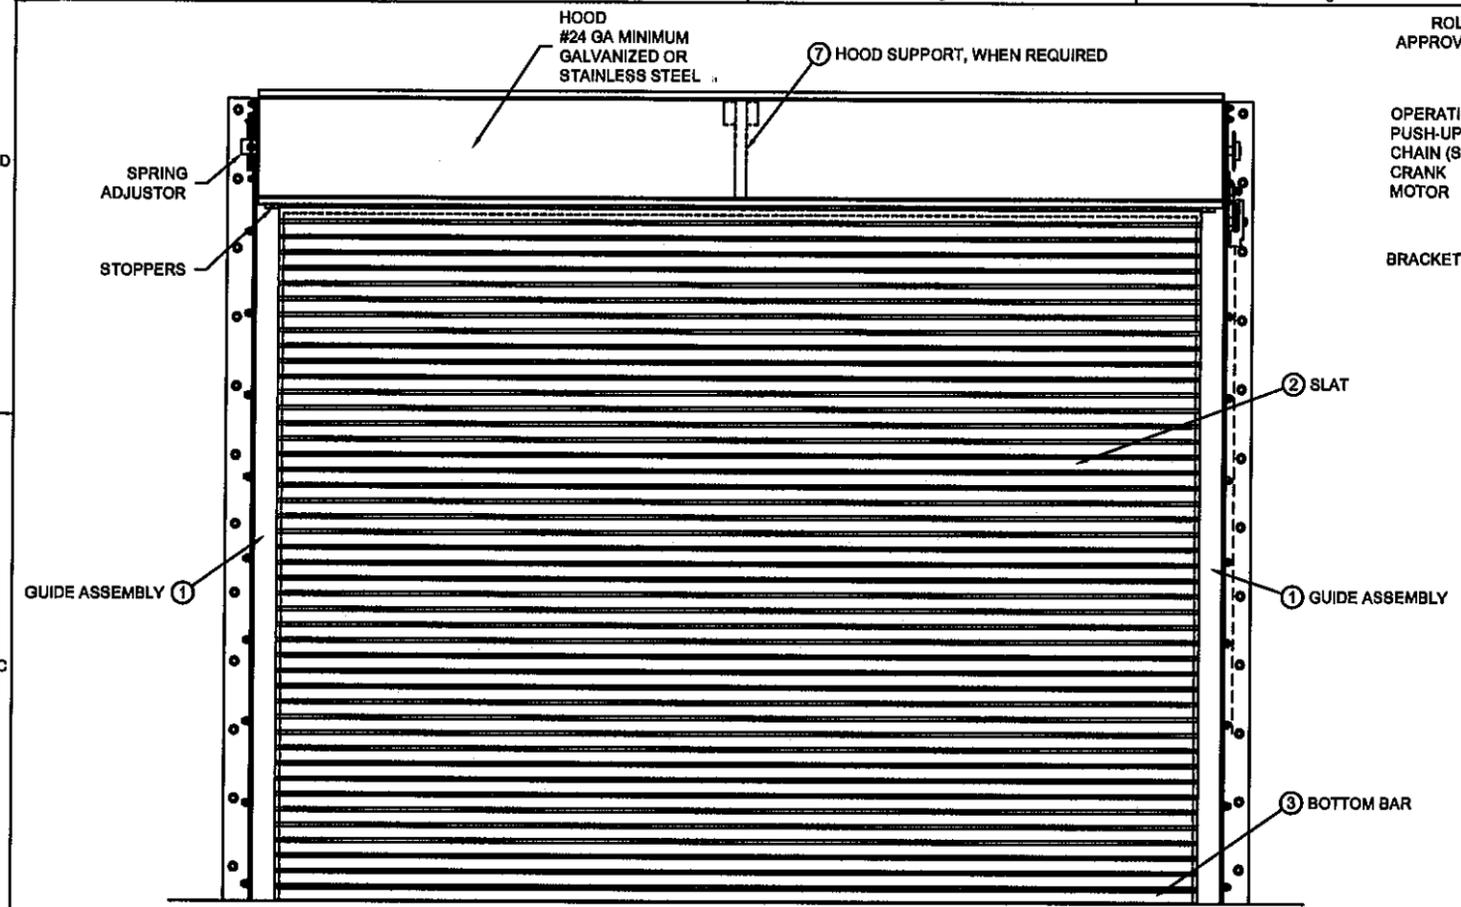


② SLAT DETAIL
TYPICAL SECTION

ASTM A653 HSLAS TYPE B GRADE 40 G60 OR
ASTM A653 HSLAS TYPE A GRADE 40 G60 OR
ASTM A653 STRUCTURAL STEEL GRADE 40 G60
OR TYPE 304 STAINLESS STEEL (MIN. YIELD 40,000 psi)
OR TYPE 430 STAINLESS STEEL (MIN. YIELD 40,000 psi)
OR TYPE 201 STAINLESS STEEL (MIN. YIELD 40,000 psi)
FULL SCALE

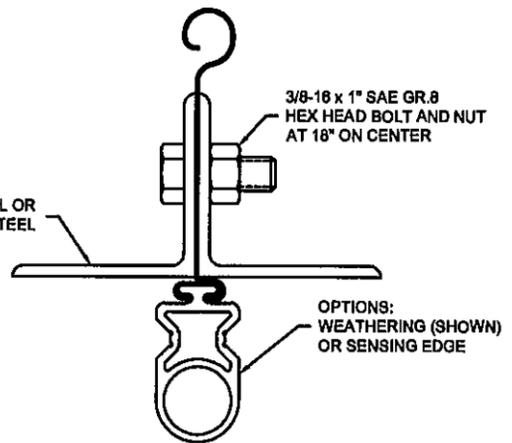


③ BOTTOM BAR DETAIL
TYPICAL SECTION
FULL SCALE

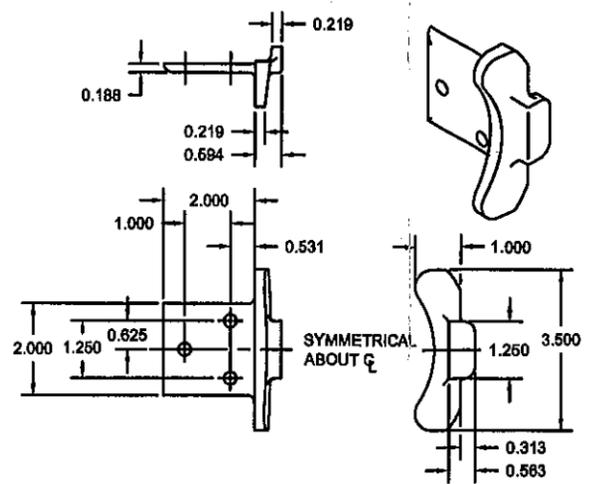

④ ENDLOCK / WINDLOCK DETAIL

CAST MALLEABLE IRON ASTM A47, GRADE 32510, OR
DUCTILE IRON PER ASTM A634 GRADE 65-45-12, GALVANIZED IN
ACCORDANCE WITH ASTM A123, GRADE 85 ZINC-COATING
1/2 SCALE

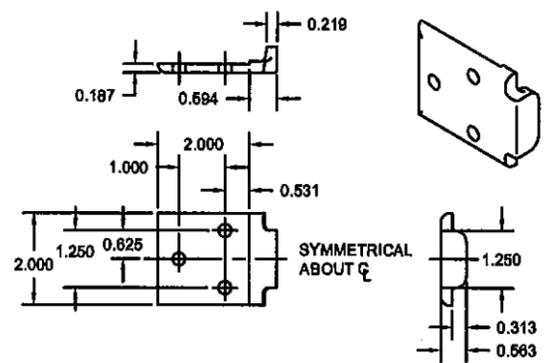


⑤ WINDLOCK DETAIL

CAST MALLEABLE IRON ASTM A47, GRADE 32510, OR
DUCTILE IRON PER ASTM A634 GRADE 65-45-12, GALVANIZED IN
ACCORDANCE WITH ASTM A123, GRADE 85 ZINC-COATING
1/2 SCALE


THE COOKSON COMPANY, INC. 2417 S. 50th AVENUE PHOENIX, AZ 85043 800 TULIP DRIVE GASTONIA, NC 28052		
DADE COUNTY APPROVED 14'-5" WIDE 120 PSF INSULATED ROLLING STEEL DOOR		
SIZE D	DRAWN R. MAGGIO	DWG NO FBC-145-120-DC-01
SCALE 1:16 & AS NOTED	SHEET 1 OF 2	REV •

LTR	REVISION	DATE	BY	E.C.O.
*	ORIGINAL ISSUE	09/10/10	R.M.	****


CONCRETE STRENGTH (psi)	MAXIMUM FASTENER SPACING (in.)	
	HILTI	SIMPSON
3000	7 1/2	8
4000	11	9 1/2

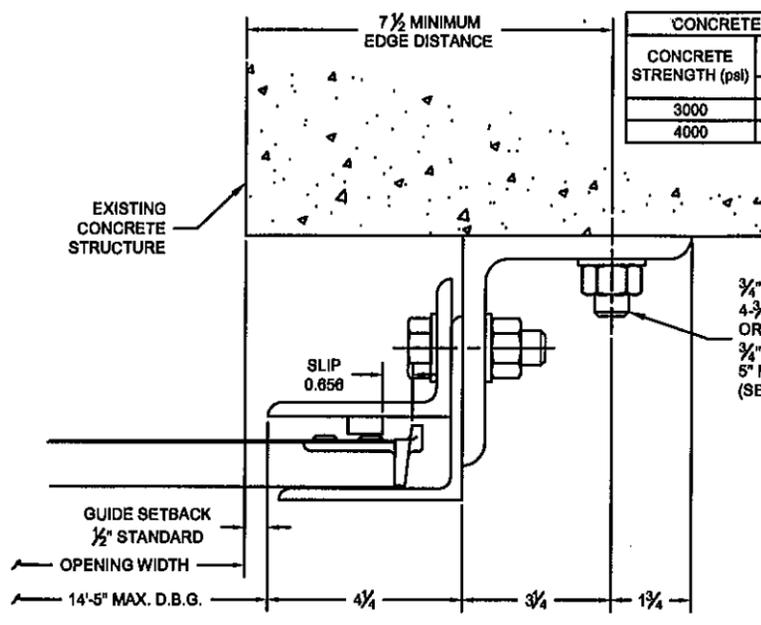


**GUIDE ASSEMBLY
CONCRETE STRUCTURE**

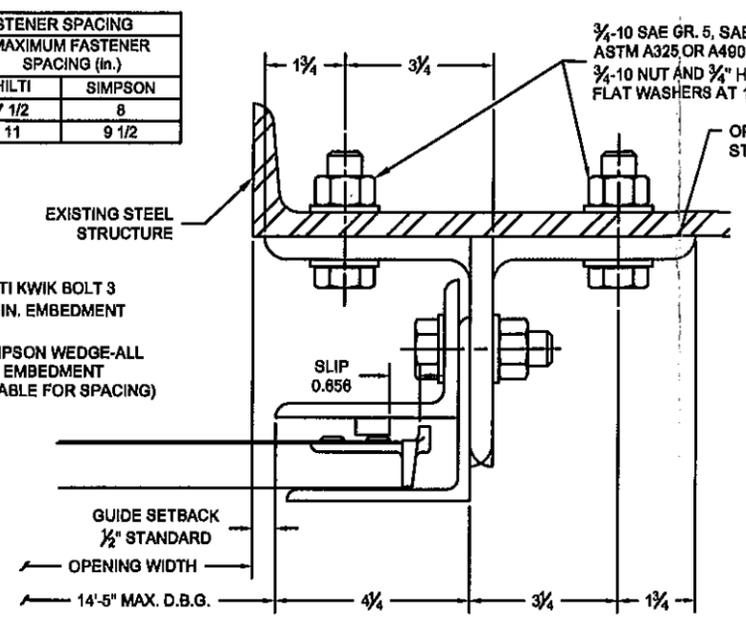

**GUIDE ASSEMBLY
STEEL STRUCTURE**

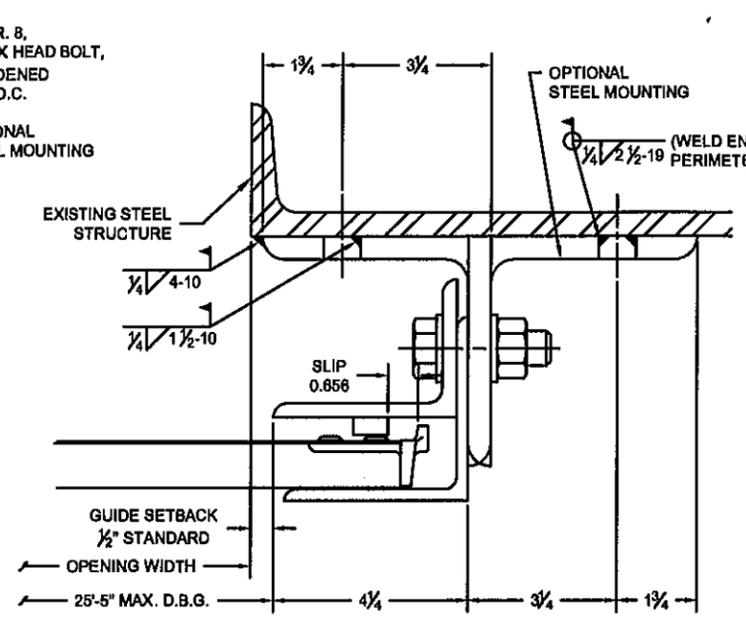


**GUIDE ASSEMBLY
STEEL STRUCTURE**

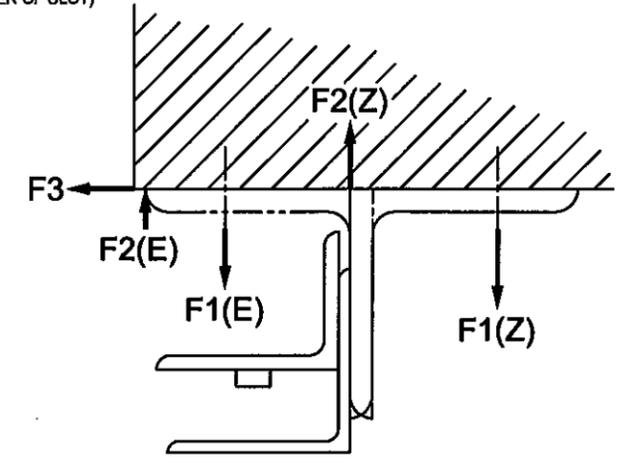


**UNREDUCED WIND FORCES
ON BUILDING STRUCTURE**

BUILDING DESIGNER NOTE:
STRUCTURE MUST BE DESIGNED TO SUPPORT F1, F2, AND F3 FORCES (LBS./FT. OF OPENING HEIGHT) AT EACH JAMB.


FORCES ON STRUCTURE (LBS / FOOT OF HEIGHT)											
Z-GUIDE						E-GUIDE					
POSITIVE			NEGATIVE			POSITIVE			NEGATIVE		
F1	F2	F3	F1	F2	F3	F1	F2	F3	F1	F2	F3
2287	1422	2614	4134	4999	2614	6471	6806	2614	6454	6319	2614

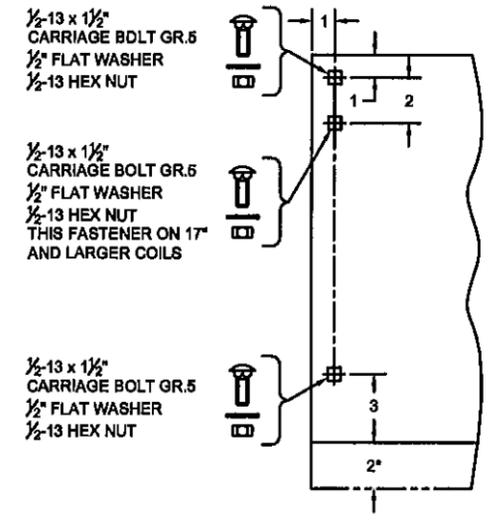

BRACKET MOUNTING DETAIL
0.172 MIN. THICKNESS
* 2" EXTENSION WHEN 8" AND LARGER SHAFT ASSEMBLY IS SUPPLIED
SCALE: FULL

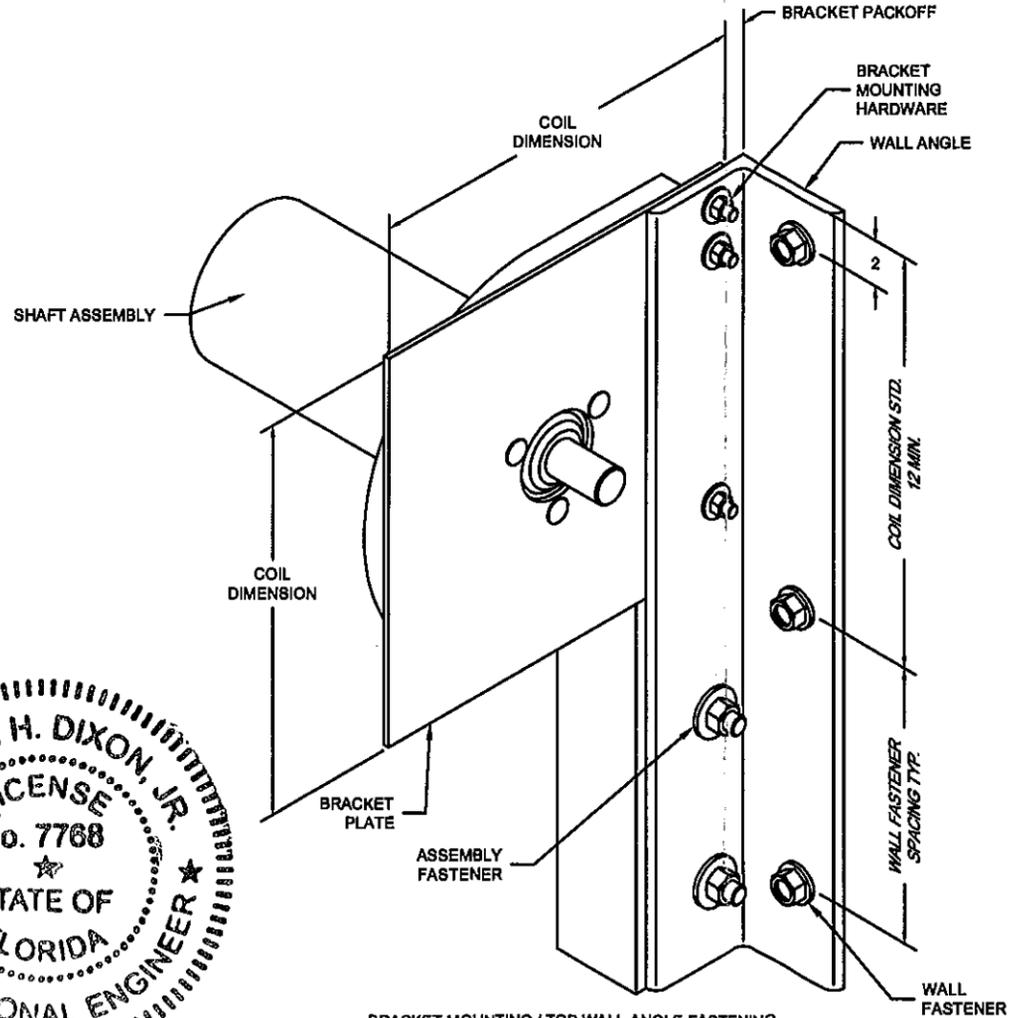

BRACKET MOUNTING / TOP WALL ANGLE FASTENING
BRACKET MOUNTING PER DETAIL 6 DEPICTED,
OTHER BRACKET MOUNTINGS ARE AVAILABLE
SCALE: NTS

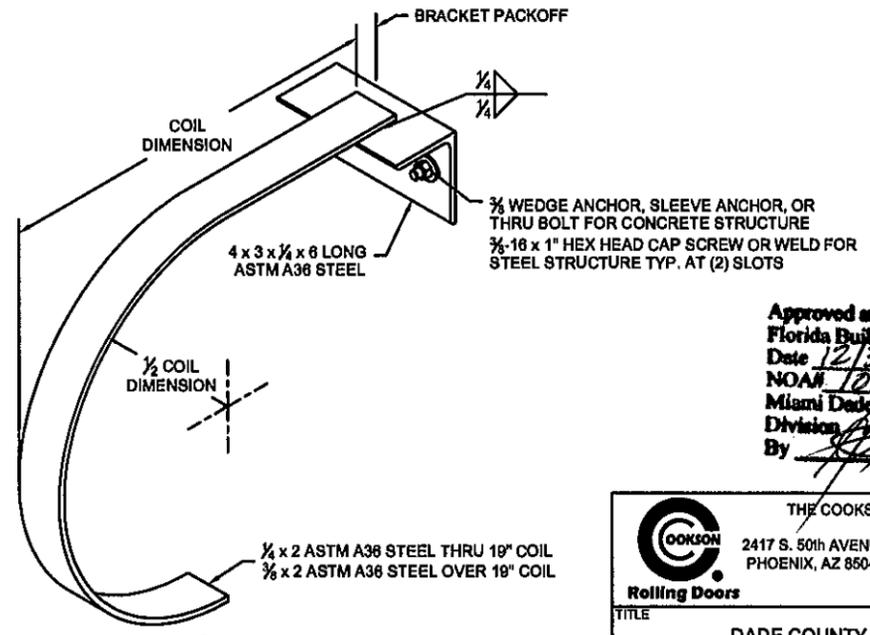

MID-HOOD SUPPORT DETAIL
(WHEN REQUIRED)
SCALE: NTS

JOSEPH H. DIXON, JR.
LICENSE
No. 7768
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
9/15/10

Approved as complying with the
Florida Building Code
Date 12/30/2010
NOAH 10-0929.01
Miami Dade Product Control
Division
By *[Signature]*

THE COOKSON COMPANY, INC.
2417 S. 50th AVENUE 800 TULIP DRIVE
PHOENIX, AZ 85043 GASTONIA, NC 28052

Rolling Doors

TITLE
**DADE COUNTY APPROVED
14'-5" WIDE 120 PSF INSULATED
ROLLING STEEL DOOR**

SIZE (DRAWN) DWG NO. REV
D R. MAGGIO FBC-145-120-DC-02

SCALE: 1:2 & AS NOTED SHEET 2 OF 2