



BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/building/home/asp

Arch Windows, LLC dba AWP
8130 NW 74th Avenue
Medley, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Section and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "1600 Impact View" Aluminum Horizontal Sliding Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. W03-104, titled "Series -1600 Impact View Alum Horiz. Sliding Wdw.", sheets 1 through 5 of 5, prepared by Al-Farooq Corp., dated 11/18/03 with revision "C" dated 09/02/10, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA # 07-1018.05 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 10-0930.01
Expiration Date: March 04, 2014
Approval Date: January 08, 2011
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W03-104**, titled "Series-1600 Impact View Alum Horiz. Sliding Wdw." sheets 1 through 5 of 5, prepared by Al Farooq Corp., dated 11/18/03 with revision "C" dated 09/02/10, signed and sealed by Javad Ahmad, P.E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3791**, dated 07/12/03, signed and sealed by Joseph Chan, P.E.
(Submitted under previous NOA#03-1203.02)
2. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3763**, dated 05/03/03, signed and sealed by Joseph Chan, P.E.
(Submitted under previous NOA#03-1203.02)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated 11/03/08 and 09/03/10, signed and sealed by Javad Ahmad, P.E.
2. Glazing complies with ASTM E1300-04.

D. QUALITY ASSURANCE

1. Miami-Dade Building and Neighborhood Compliance Department (BNC).


Manuel Perez, P.E.
Product Control Examiner
NOA No. 10-0930.01

Expiration Date: March 04, 2014
Approval Date: January 08, 2011

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **06-0216.06** issued to **Solutia, Inc.** for their “**Saflex III G Clear or colored Interlayer**” dated 05/04/06, expiring on 05/21/11.
2. Notice of Acceptance No. **10-0331.02** issued to **Cytec Industries, Inc.** for their “**Uvekol S Laminated Glass Interlayer**”, dated 05/05/10, expiring on 02/08/14.

F. STATEMENTS

1. Statement letter of conformance and no financial interest, dated September 03, 2010, signed and sealed by Javad Ahmad, P.E.
2. Legal documents for name change, including asset purchase agreement, dated January 14, 2010.

G. OTHER



1. Notice of Acceptance No. **07-1018.05**, issued to AWP, LLC for their “Series ‘1600 Impact View’ Aluminum Horizontal Sliding Window – L.M.I., approved on 02/04/09 and expiring on 03/04/14.


Manuel Perez, P.E.
Product Control Examiner

NOA No. 10-0930.01

Expiration Date: March 04, 2014

Approval Date: January 08, 2011

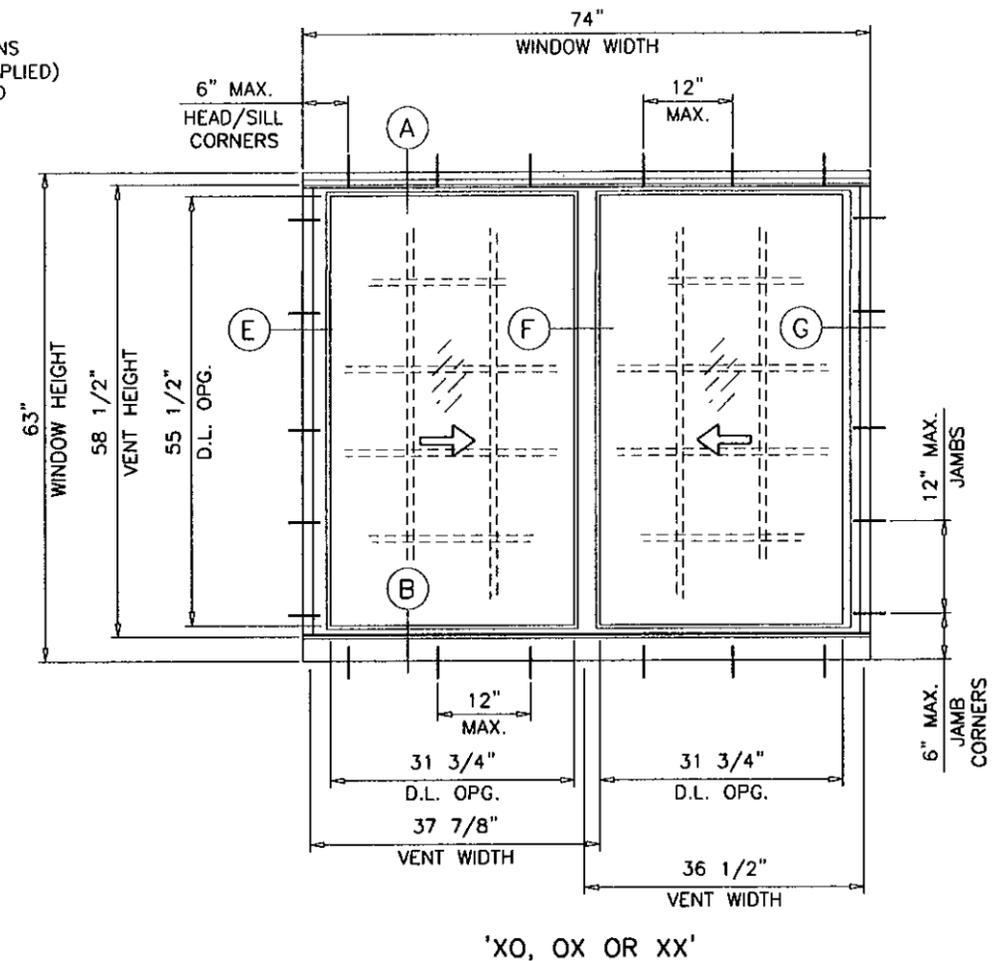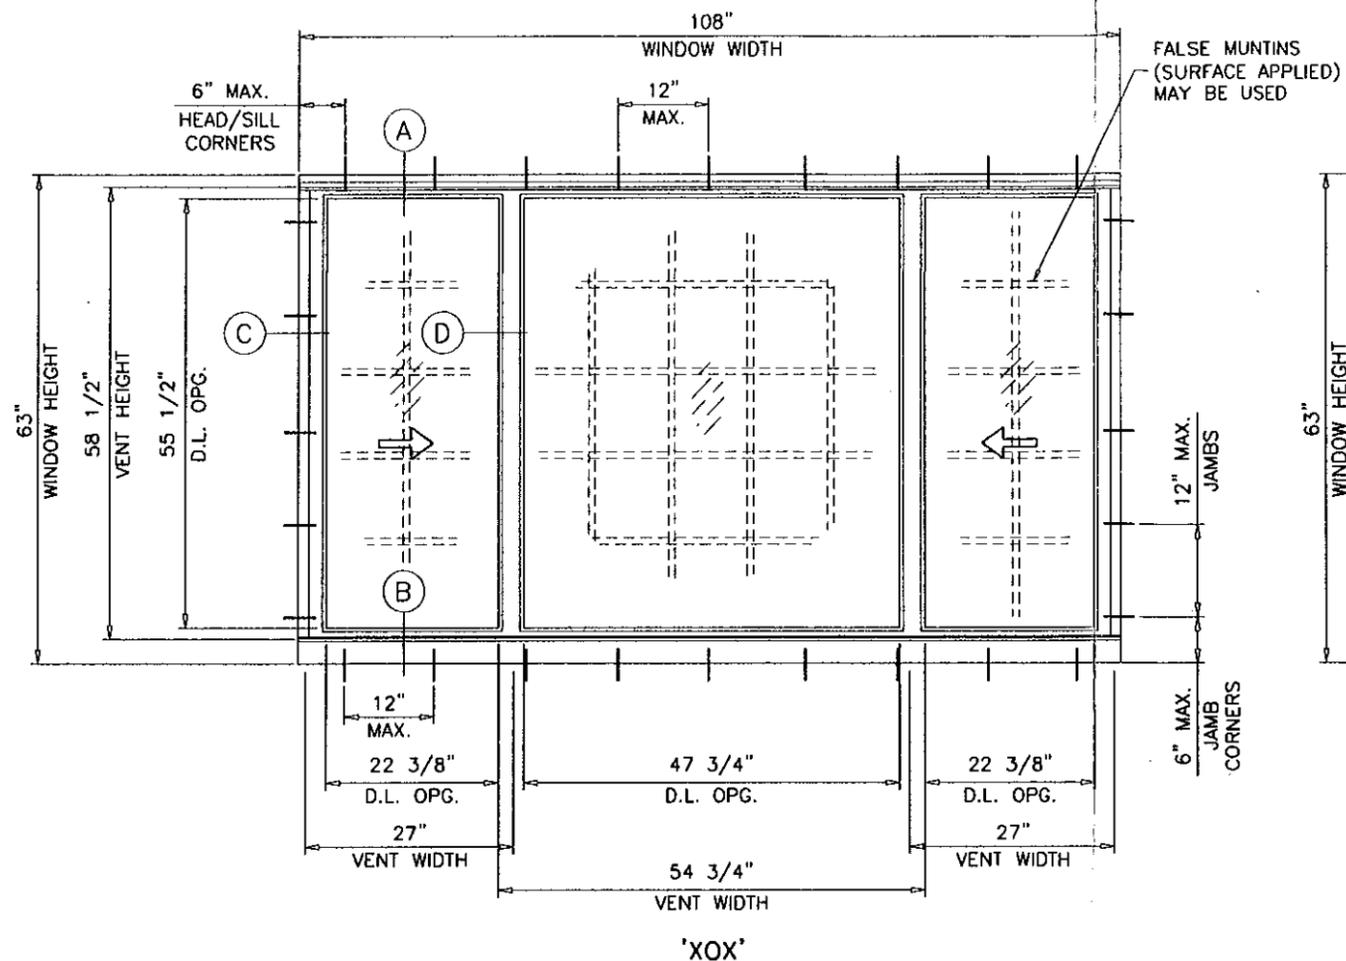

TYPICAL ELEVATIONS
TESTED UNITS

THESE WINDOWS ARE RATED FOR LARGE MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

**SERIES-1600 IMPACT VIEW
ALUMINUM HORIZONTAL SLIDING WINDOW**

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER
CHARTS SHOWN SHEET 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS
OF H.R./H.R. OR H.R. WDW. WITH OTHER MIAMI-DADE COUNTY
APPROVED WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS
IN BETWEEN.
LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL
WILL APPLY TO ENTIRE SYSTEM.



THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING
HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER
LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS
EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS
ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO
CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS
OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

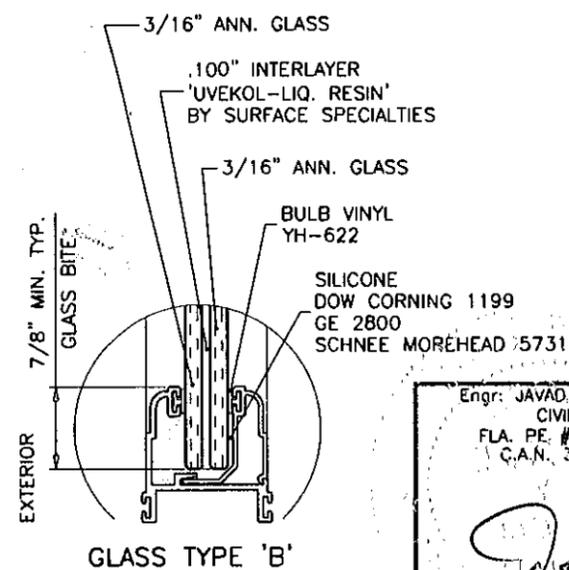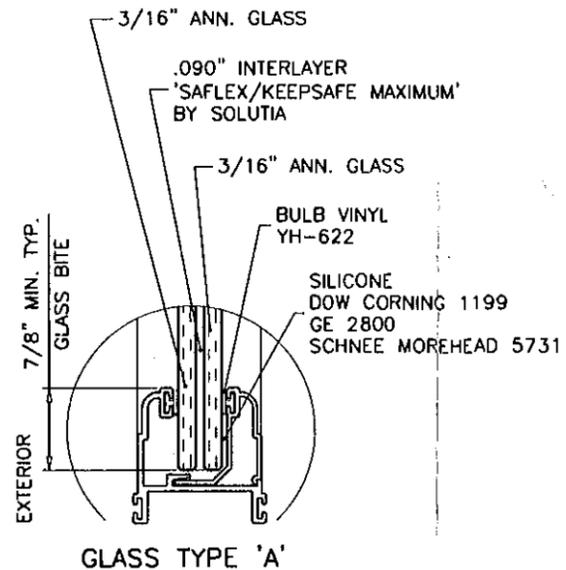

GLAZING OPTIONS

Engr. JAVAD AHMAD
CIVIL
FLA. PE. # 70592
C.A.N. 3633
SEP 09 2010

PRODUCT REVISED
complying with the Florida
Building Code
Acceptance No. 10-0930.01
Expiration Date MARCH 2014
By *Manuel Perez*
Miami Dade Product Control
Division

SERIES-1600 IMPACT VIEW ALUM. HORIZ. SLIDING WDW.
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no.	date	description
A	01.23.04	REV. PER BCCO COMMENTS
B	11.06.08	UPDATED FOR 2007 FBC
C	09.02.10	MANUF. NAME REVISED

date: 11-18-03
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:


drawing no.
W03-104
sheet 1 of 5

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W03-104YO

DESIGN LOAD CAPACITY - PSF (X0, OX OR XX SIZES)


WINDOW DIMS.		A	GLASS TYPES 'A' & 'B'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)
26-1/2"	26" (3)	3	90.0	140.0
37"		4	90.0	140.0
53-1/8"		5	90.0	140.0
74"		7	90.0	140.0
26-1/2"	38-3/8" (3)	3	90.0	140.0
37"		4	90.0	140.0
53-1/8"		5	90.0	140.0
74"		7	90.0	140.0
26-1/2"	50-5/8" (4)	3	90.0	140.0
37"		4	90.0	140.0
53-1/8"		5	90.0	140.0
74"		7	90.0	131.1
26-1/2"	63" (5)	3	90.0	140.0
37"		4	90.0	140.0
53-1/8"		5	90.0	109.9
74"		7	89.5	89.5
24"	24" (2)	2	90.0	140.0
36"		3	90.0	140.0
48"		4	90.0	140.0
60"		5	90.0	140.0
72"		6	90.0	140.0
24"	36" (3)	2	90.0	140.0
36"		3	90.0	140.0
48"		4	90.0	140.0
60"		5	90.0	140.0
72"		6	90.0	140.0
24"	48" (4)	2	90.0	140.0
36"		3	90.0	140.0
48"		4	90.0	140.0
60"		5	90.0	140.0
72"		6	90.0	140.0
24"	60" (5)	2	90.0	140.0
36"		3	90.0	140.0
48"		4	90.0	126.6
60"		5	90.0	108.9
72"		6	90.0	98.3

A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB



LEFT AND RIGHT VENTS TO BE OF EQUAL GLASS DLO WIDTHS

'XX'




'XO OR OX'

DESIGN LOAD CAPACITY - PSF (XOX SIZES)

WINDOW DIMS.		A	GLASS TYPES 'A' & 'B'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)
74"	26" (3)	7	90.0	140.0
106-1/4"		9	90.0	140.0
111"		10	90.0	140.0
74"	38-3/8" (3)	7	90.0	140.0
106-1/4"		9	90.0	140.0
111"		10	90.0	140.0
74"	50-5/8" (4)	7	90.0	140.0
106-1/4"		9	90.0	126.6
111"		10	90.0	124.2
74"	63" (5)	7	90.0	115.9
106-1/4"		9	90.0	91.6
72"	24" (2)	6	90.0	140.0
84"		7	90.0	140.0
96"		8	90.0	140.0
108"		9	90.0	140.0
72"	36" (3)	6	90.0	140.0
84"		7	90.0	140.0
96"		8	90.0	140.0
108"		9	90.0	140.0
72"	48" (4)	6	90.0	140.0
84"		7	90.0	140.0
96"		8	90.0	140.0
108"		9	90.0	136.7
72"	60" (5)	6	90.0	122.2
84"		7	90.0	113.8
96"		8	90.0	104.8
108"		9	90.0	97.6

A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB

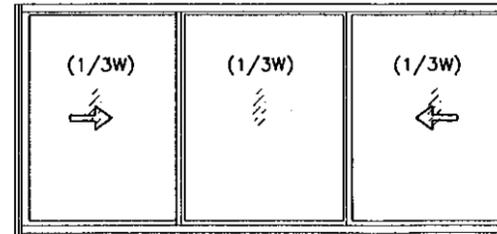


OPERATING VENTS TO BE 1/3 OF THE WINDOW WIDTH

'XOX'

DESIGN LOAD CAPACITY - PSF (XOX SIZES)

WINDOW DIMS.		A	GLASS TYPES 'A' & 'B'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)
74"	26" (3)	7	90.0	140.0
106-1/4"		9	90.0	140.0
111"		10	90.0	140.0
74"	38-3/8" (3)	7	90.0	140.0
106-1/4"		9	90.0	140.0
111"		10	90.0	139.2
74"	50-5/8" (4)	7	90.0	140.0
106-1/4"		9	90.0	113.4
111"		10	90.0	108.8
74"	63" (5)	7	90.0	110.5
106-1/4"		9	90.0	90.7
72"	24" (2)	6	90.0	140.0
84"		7	90.0	140.0
96"		8	90.0	140.0
108"		9	90.0	140.0
72"	36" (3)	6	90.0	140.0
84"		7	90.0	140.0
96"		8	90.0	140.0
108"		9	90.0	140.0
72"	48" (4)	6	90.0	140.0
84"		7	90.0	139.2
96"		8	90.0	130.1
108"		9	90.0	116.3
72"	60" (5)	6	90.0	113.8
84"		7	90.0	110.3
96"		8	90.0	102.5
108"		9	90.0	97.1

A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB

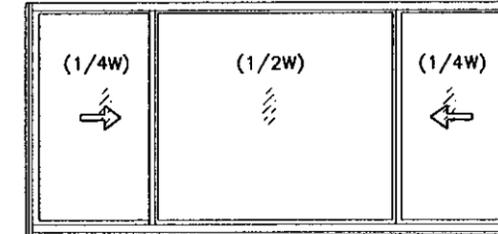

OPERATING VENTS TO BE 1/4 OF THE WINDOW WIDTH

'XOX'

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Engr: JAVAD AHMAD
CIVIL
FLA. RE #170592
C.A.N. 3538

SEP 09 2010

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-0930.01
Expiration Date MARCH 4, 2014
By *Manuel Perez*
Miami Trade Product Control
Division



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-104YO





SERIES-1600 IMPACT VIEW ALUM HORIZ. SLIDING WDW.
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	description
A	01.23.04	REV. PER BCCO COMMENTS
B	11.06.08	UPDATED FOR 2007 FBC
C	09.02.10	MANUF. NAME REVISED

date: 11-18-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-104

sheet 2 of 5

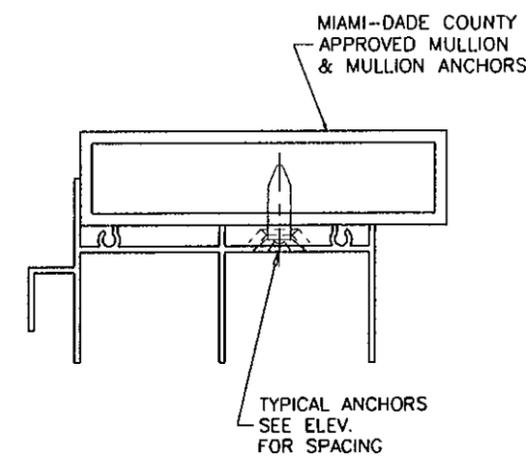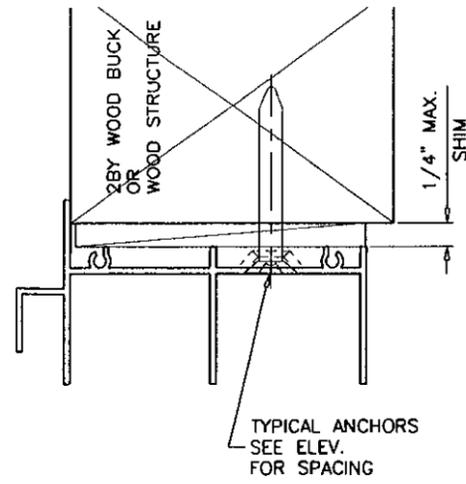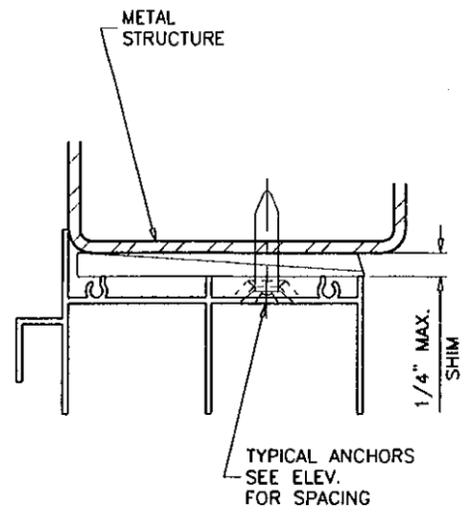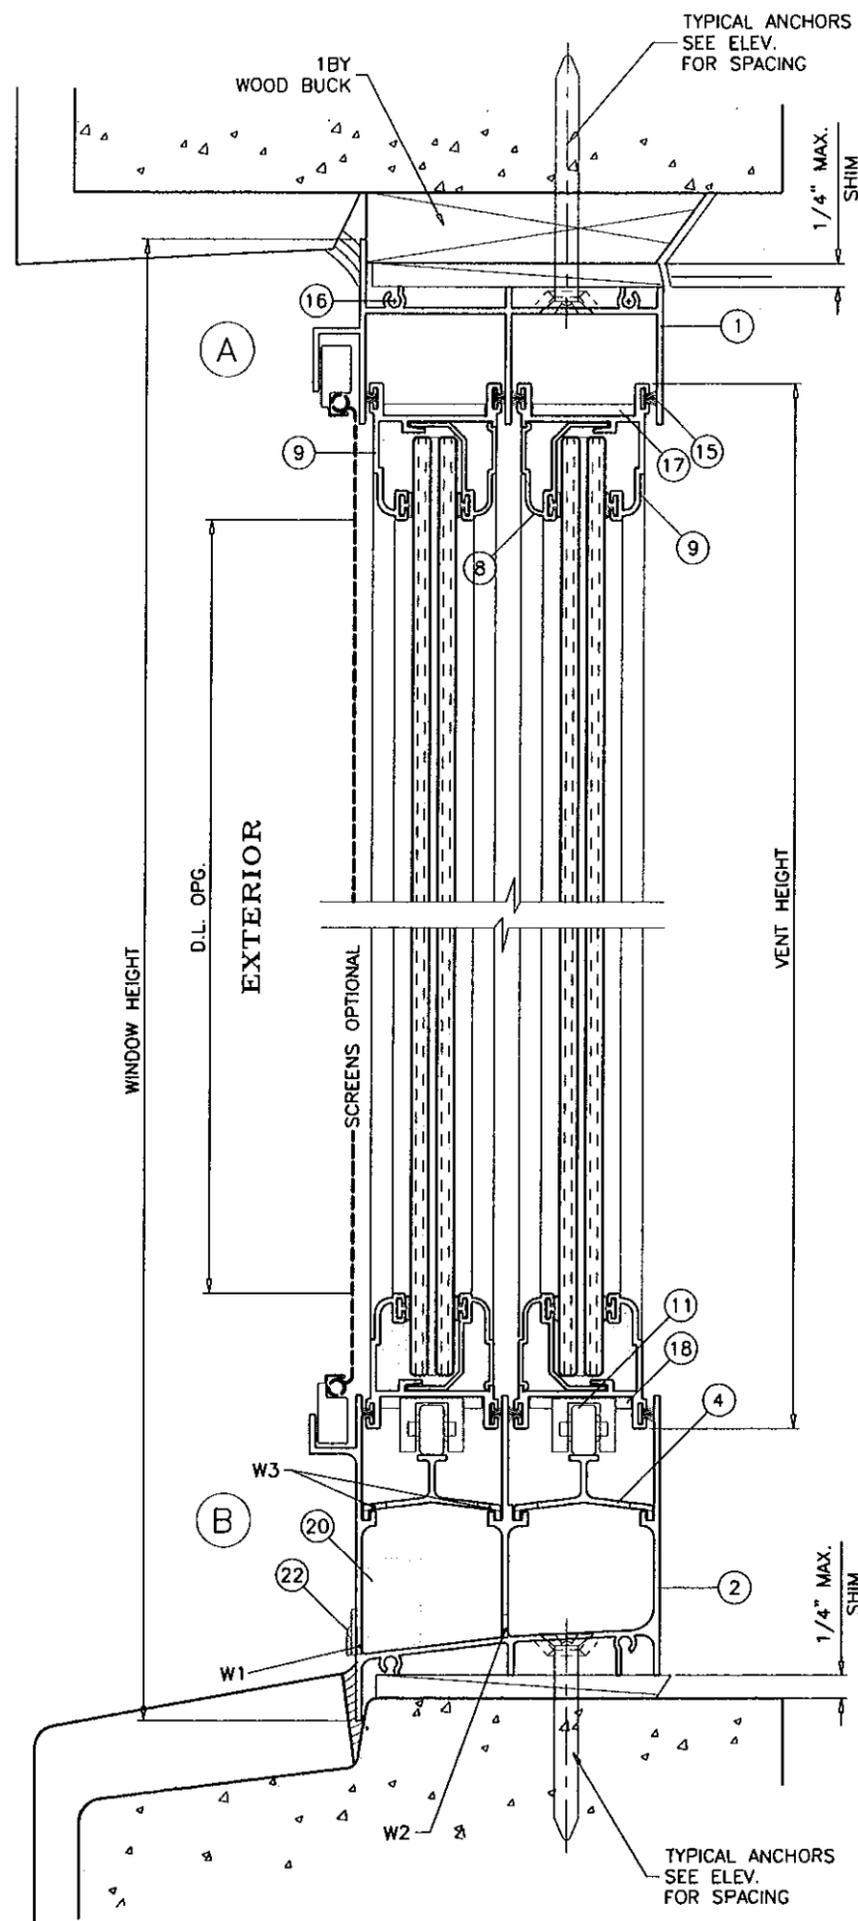

WOOD BUCKS AND METAL STRUCTURE NOT BY AWP WDW. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#12 SMS OR SELF DRILLING SCREWS
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 (NO SHIM SPACE)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

SEALANTS:
 FRAME AND VENT CORNERS AND INSTALLATION SCREWS AT SILL SEALED WITH WHITE/ALUMINUM COLORED SEALANT.

WEEPHOLES:
 W1 = 1-5/8" X 1/4" WEEPHOLES AT 12" FROM EACH END WITH PLASTIC BAFFLE
 W2 = 3/4" X 5/8" WEEPHOLE AT EACH END
 W3 = 1-1/4" X 1/4" WEEPHOLES AT 16-1/2" FROM EACH END

Engr. JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 SEP 09 2010

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 10-0930.01
 Expiration Date DECEMBER 4, 2014
 By *Manuel Perez*
 Miami Dade Product Control
 Division

af c

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W03-104YO




SERIES-1600 IMPACT VIEW ALUM. HORIZ. SLIDING WDW.
 ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

no.	date	by	description
A	01.23.04		NO CHANGE THIS SHEET
B	11.06.08		UPDATED FOR 2007 FBC
C	09.02.10		MANUF. NAME REVISED

revisions:

date: 11-18-03 scale: 1/2" = 1" dr. by: HAMID chk. by:

drawing no. **W03-104**
 sheet 3 of 5

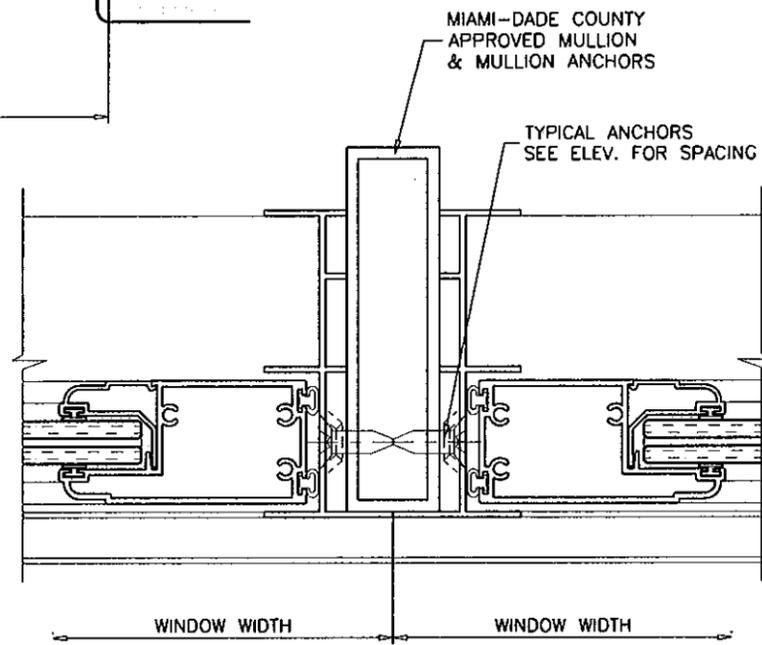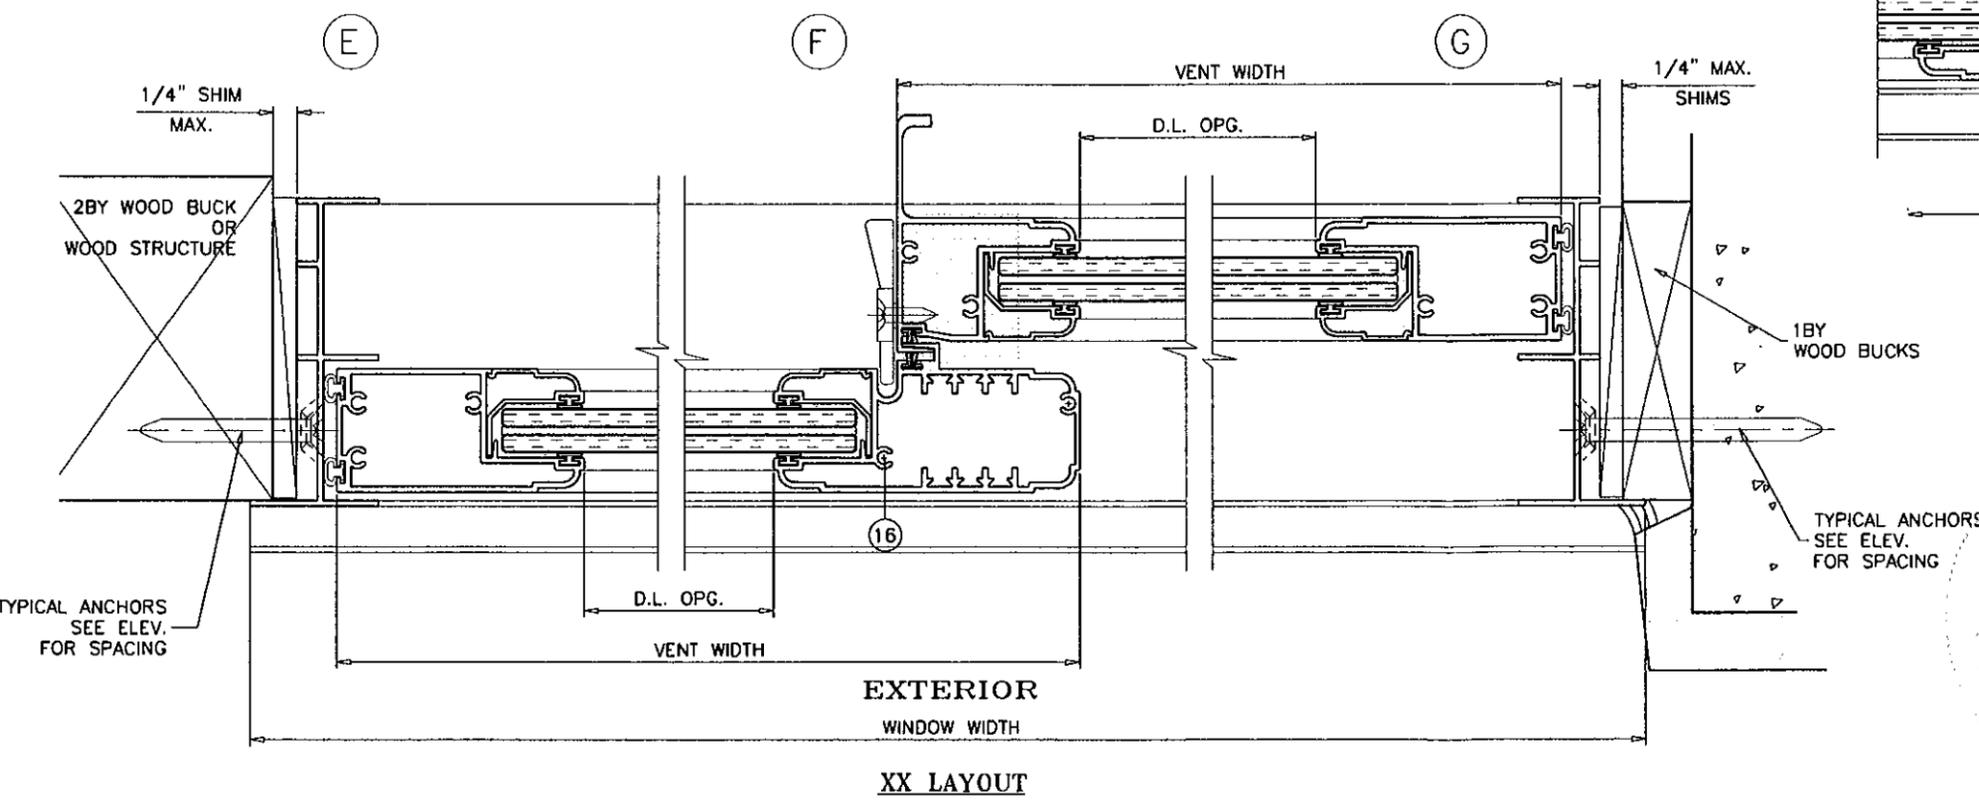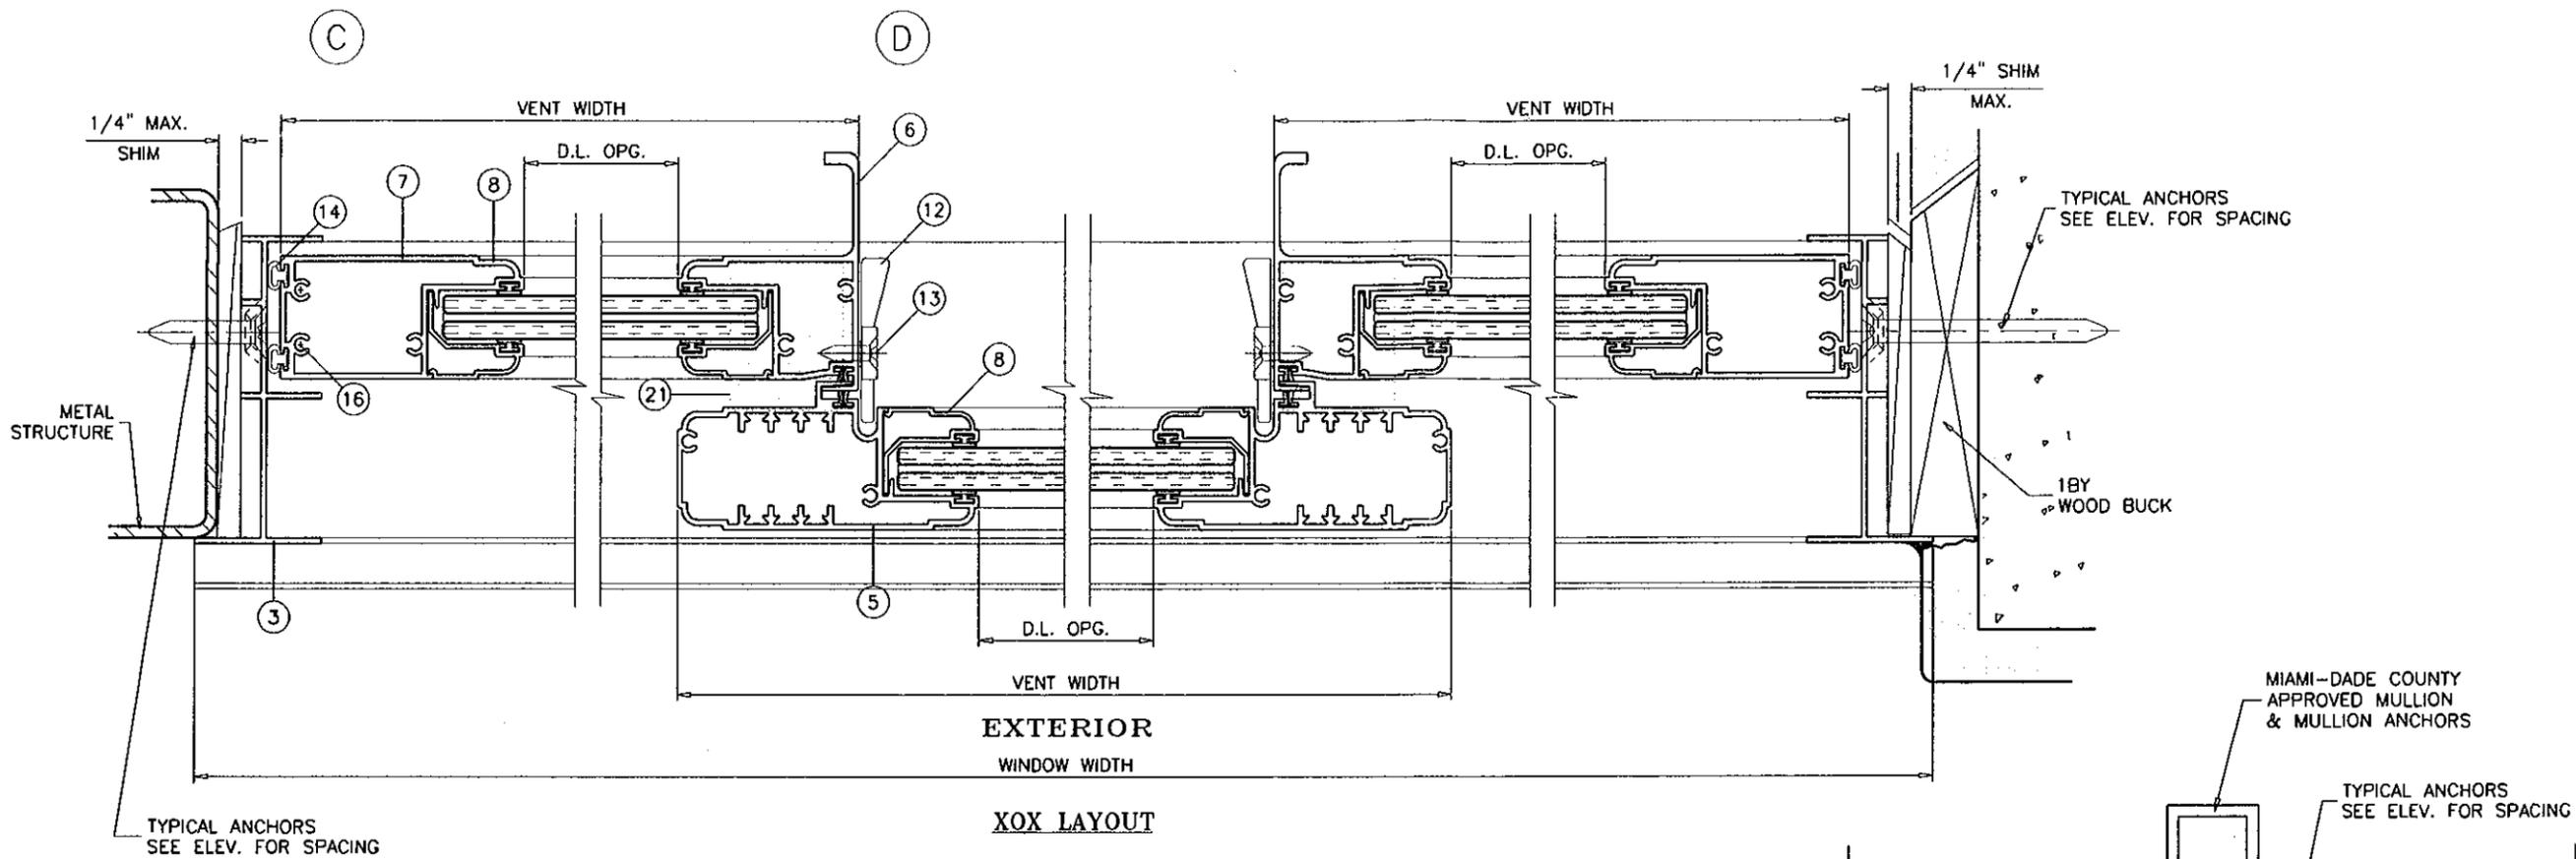

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3338

SEP 09 2010

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-0930-01
Expiration Date MARCH 4, 2014

By *Mauro Peres*
Miami Dade Product Control
Division

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP--ANL \ W03-104YO

SERIES-1600 IMPACT VIEW ALUM HORIZ. SLIDING WDW.


ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
A	01.23.04	REV. PER BCCO COMMENTS	
B	11.06.08	UPDATED FOR 2007 FBC	
C	09.02.10	MANUF. NAME REVISED	


date: 11-18-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-104


sheet 4 of 5

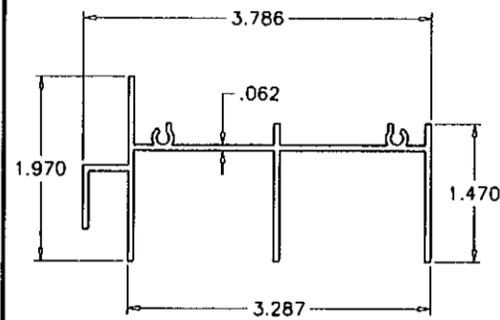


FRAME HEAD

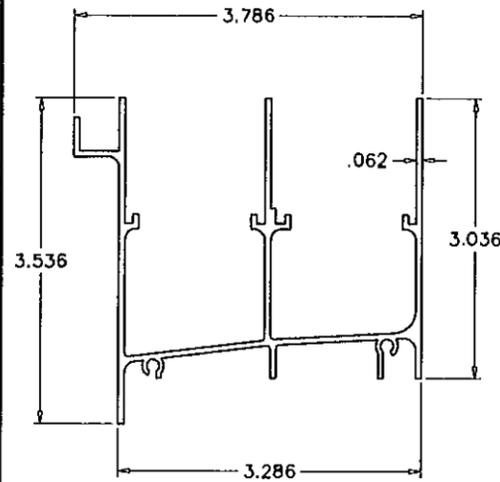


FRAME SILL




SILL TRACK

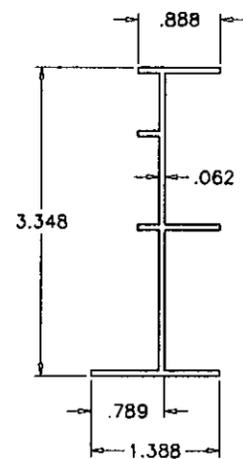


FRAME JAMB




VENT TOP/BOTTOM RAIL

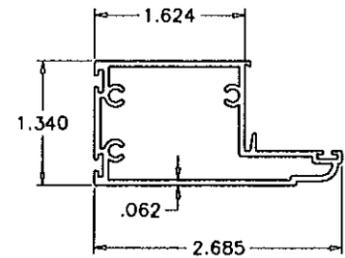


JAMB STILE

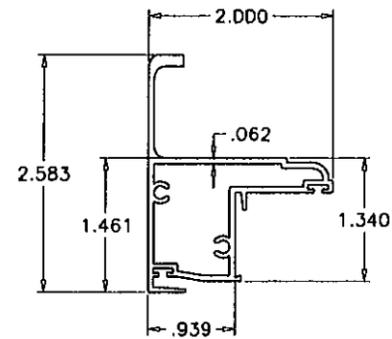

MEETING RAIL

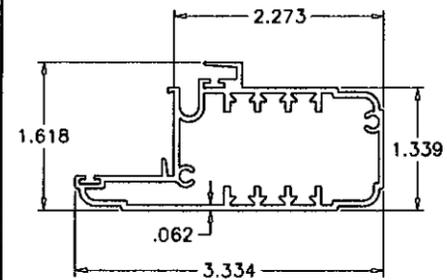


FIXED MTG. RAIL




GLAZING BEAD


ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	YE-1600	1	FRAME HEAD	6063-T6	-
2	YE-1601	1	FRAME SILL	6063-T6	-
3	YE-1602	1	FRAME JAMB	6063-T6	-
4	YE-1605	1	SILL TRACK INSERT	6063-T5	-
5	YE-1603	1/ VENT	FIXED RAIL	6063-T5	-
6	YE-1704	1/ VENT	VENT MEETING RAIL	6063-T5	-
7	YE-1604	1/ VENT	JAMB STILE	6063-T5	-
8	YE-1707	AS REQD.	GLAZING BEAD	6063-T5	-
9	YE-1706	2/ VENT	TOP AND BOTTOM RAIL	6063-T5	-
10	-	-	-	-	-
11	YH-1605	2/ VENT	ROLLER ASSEMBLY	NYLON	YALE, 3" FROM EACH END
12	YH-715	2/ VENT	VENT LATCH	-	AT 8-1/2" & 46-1/2" FROM BOTTOM
13	YF-62	2/ LATCH	VENT LATCH SCREWS	-	-
14	YH-622	AS REQD.	BULB W'STRIPPING	-	SULLIVAN & SULLIVAN
15	YH-6009	AS REQD.	FIN SEAL W'STRIPPING	-	ULTRAFAB
16	YF-10	AS REQD.	FRAME/VENT ASSEMBLY SCREWS	CRS	#8 X 1" P.H. SMS
17	YH-1602	2/ VENT	TOP GUIDE	VINYL	YALE
18	YH-1603	2/ VENT	BOTTOM GUIDE	STEEL	YALE
19	YF-71	2/ GUIDE	GUIDE SCREWS	-	SMS
20	YH-1601	1/ WEEP	OPEN CELL FOAM PAD (1" X 1" X 3/4")	-	YALE
21	YH-1604	-	OPEN CELL FOAM PAD (1-1/4" X 1/4" X 1-3/4")	-	YALE
22	YH-1606	2	WEEPHOLE COVERS	-	YALE

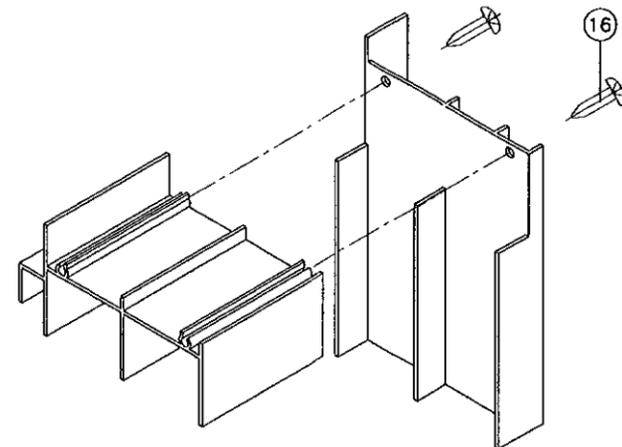

FRAME TOP CORNER

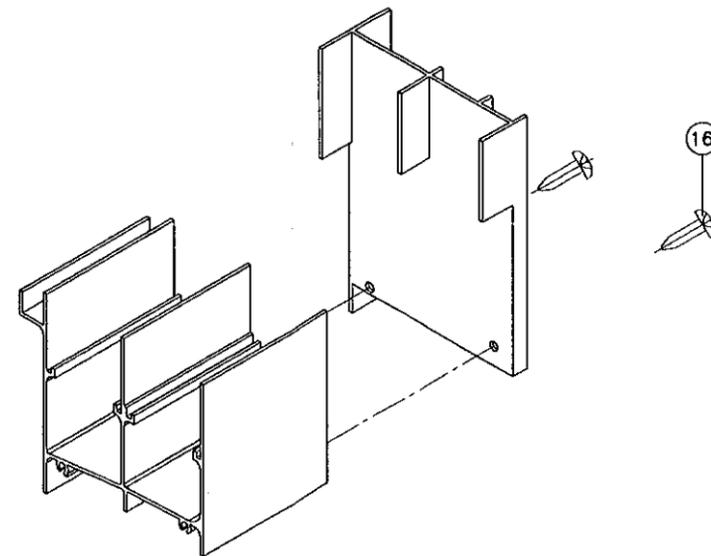

FRAME BOTTOM CORNER

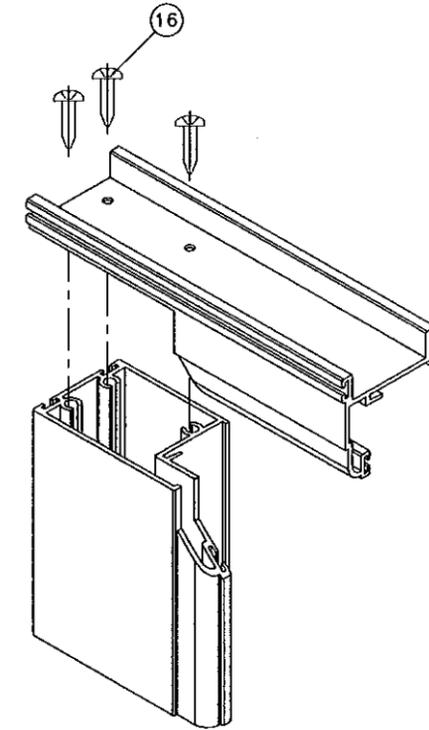

VENT TOP/BOTTOM CORNERS

Engr. JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

SEP 09 2010

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 10-0930.01
Expiration Date MARCH 4, 2014

by *Manuel Perez*
Miami Dade Product Control
Division

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\W03-104YO

SERIES-1600 IMPACT VIEW ALUM HORIZ. SLIDING WDW.
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	description	by
A	01.23.04	REV. PER BCCO COMMENTS	
B	11.06.08	UPDATED FOR 2007 FBC	
C	09.02.10	MANUF. NAME REVISED	

date: 11-18-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-104
sheet 5 of 5