



**BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION**

**MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION**
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/building/home/asp

Arch Windows, LLC dba AWP
8130 NW 74th Avenue
Medley, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Section and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Exterior Glazed" Aluminum Fixed Window – N.I.

APPROVAL DOCUMENT: Drawing No. **W00-53**, titled "Exterior Glazed Alum Fixed Window (N.I)", sheets 1 through 5 of 5, prepared by Al-Farooq Corp., dated 12/12/00 with revision D dated on 09/02/10, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None.

LIMITATION: Miami-Dade County approved shutters are required.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA # **09-0331.13** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 10-0930.04
Expiration Date: December 13, 2011
Approval Date: January 06, 2011
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS


1. Manufacturer's die drawings and sections.
2. Drawing No **W00-53**, titled "Exterior Glazed Alum Fixed Window (N.I.)", Sheets 1 through 5 of 5, dated 12/12/00 with revision "D" dated 09/02/10, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, PA 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, PA 202-94
3) Water Resistance Test, per FBC, PA 202-94
along with marked-up drawings and installation diagram of an aluminum fixed arch window w/ 3/16" temp. glass, prepared by Hurricane Engineering & Testing Inc., Report No. **HETI-00-1174A** dated 10/10/00, signed and sealed by Arshad Viqar, P.E. *(Submitted under NOA# 06-1229.02)*
2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, PA 202-94
along with marked-up drawings and installation diagram of an aluminum fixed window w/ 3/16" ann. glass, prepared by Hurricane Engineering & Testing Inc., Report No. **HETI-00-1174B** dated 10/13/00, signed and sealed by Arshad Viqar, P.E. *(Submitted under NOA# 06-1229.02)*
3. Test reports on: 1) Air Infiltration Test, per FBC, PA 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, PA 202-94
3) Water Resistance Test, per FBC, PA 202-94
along with marked-up drawings and installation diagram of an aluminum fixed arch window w/ 3/16" temp. glass, prepared by Hurricane Engineering & Testing Inc., Report No. **HETI-00-1174C** dated 10/09/00, signed and sealed by Arshad Viqar, P.E. *(Submitted under NOA# 06-1229.02)*
4. Test reports on: 1) Air Infiltration Test, per FBC, PA 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, PA 202-94
3) Water Resistance Test, per FBC, PA 202-94
along with marked-up drawings and installation diagram of an aluminum fixed arch window w/ 3/16" temp. glass, prepared by Hurricane Engineering & Testing Inc., Report No. **HETI-00-1174D** dated 10/09/00, signed and sealed by Arshad Viqar, P.E. *(Submitted under NOA# 06-1229.02)*

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated 03/02/09 and 09/03/10, signed and sealed by Javad Ahmad, P.E.
2. Glazing complies with ASTM E1300-04.

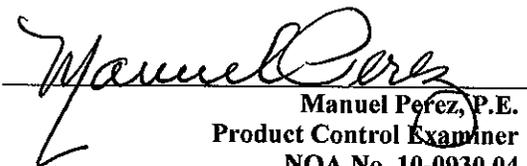
Manuel Perez, P.E.
Product Control Examiner
NOA No. 10-0930.04

Expiration Date: December 13, 2011

Approval Date: January 06, 2011

Arch Windows, LLC dba AWP

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. Miami-Dade Building and Neighborhood Compliance Department (BNC).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance and no financial interest, dated September 03, 2010, signed and sealed by Javad Ahmad, P.E.
2. Legal documents for name change, including asset purchase agreement, dated January 14, 2010.

G. OTHER





1. Notice of Acceptance No. **09-0331.13**, issued to AWP, LLC for their "Series Exterior Glazed Aluminum Fixed Windows" approved on 05/27/09 and expiring on 12/13/11.




**Manuel Perez, P.E.
Product Control Examiner
NOA No. 10-0930.04**

Expiration Date: December 13, 2011

Approval Date: January 06, 2011

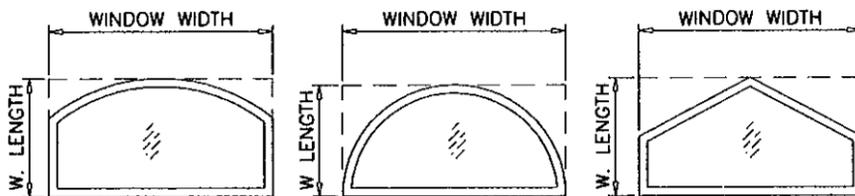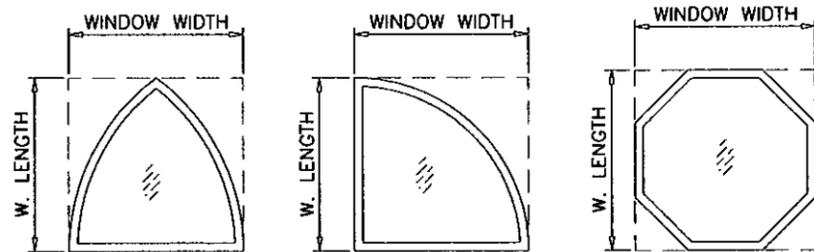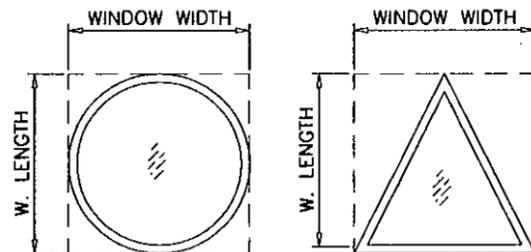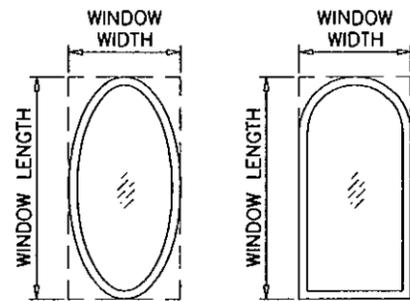

ALLOWABLE LOADS FOR ALTERNATE SHAPES AS SHOWN ABOVE OR SIMILAR CAN BE VERIFIED BY INSCRIBING PICTURE WINDOW SHAPE WITHIN SQUARE OR RECTANGLE AS SHOWN IN DOTTED LINES AND OBTAINING ALLOWABLE LOADS FROM THOSE SHAPES.

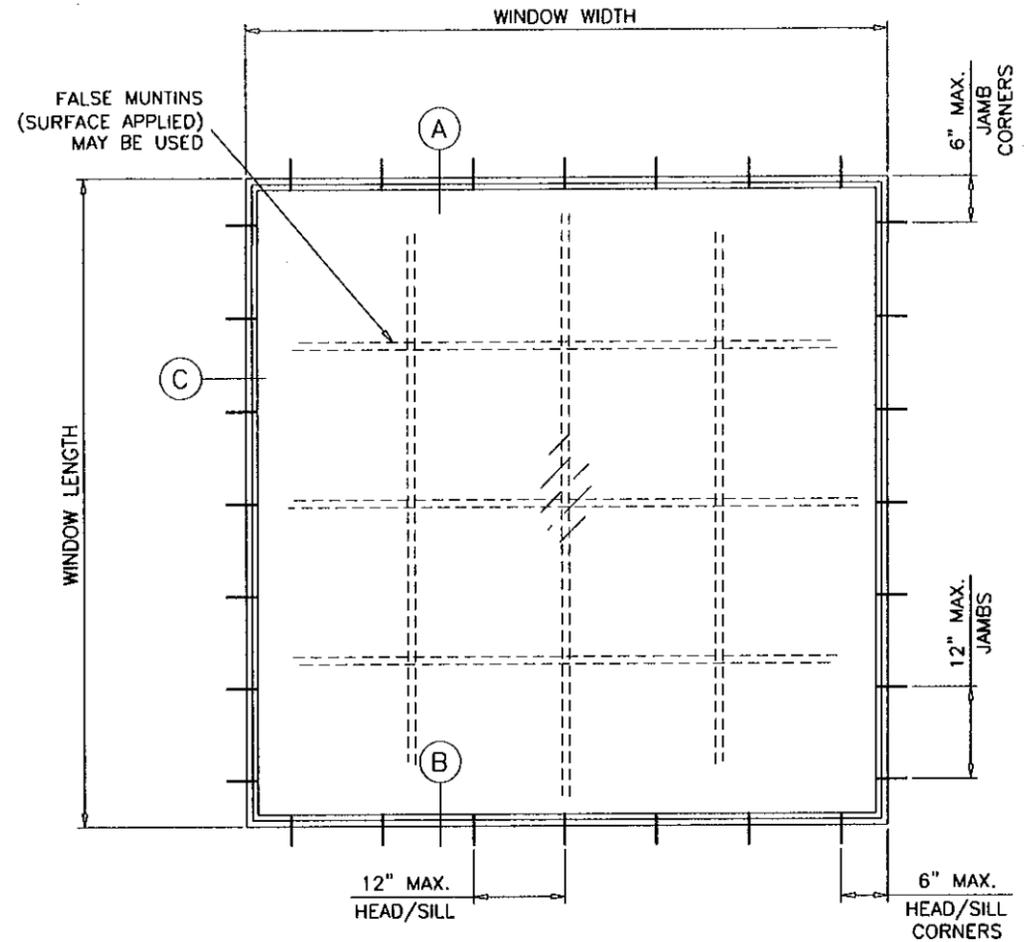

TYPICAL ELEVATION

EXTERIOR GLAZED ALUMINUM FIXED WINDOW

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIXED/FIXED OR FIXED WITH OTHER MIAMI-DADE COUNTY APPR'D WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHARTS ON SHEET 2.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

WINDOWS NOT RATED FOR IMPACT. INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES COMPLYING WITH HVHZ REQUIREMENTS. INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

Engr. JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
SEP 09 2010

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-0930.04
Expiration Date Dec 13, 2011
By *Manuel Perez*
Miami Dade Product Control
Division

no.	date	by	description
A	10.02.01		CHARTS REV. PER ASTM E-1300
B	12.11.06		UPDATED FOR 2004 FBC
C	03.25.09		NOTES REV., MANUF. NAME CHANGE
D	09.02.10		MANUF. NAME REVISED

date: 12-12-00
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:

drawing no.
W00-53
sheet 1 of 5

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL \ W00-53YO


EXTERIOR GLAZED ALUM FIXED WINDOW (N.I.)
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

DESIGN LOAD CAPACITY - PSF								
WINDOW DIMS.		3/16" ANN. GLASS		3/16" TEMPERED GLASS				
		ANCHORS TYPE 'A'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		
WIDTH	LENGTH	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	
18"	24"	80.0	82.2	80.0	153.6	80.0	186.7	
24"		61.7	61.7	80.0	140.0	80.0	140.0	
30"		61.7	61.7	80.0	140.0	80.0	140.0	
36"		61.7	61.7	80.0	108.0	80.0	140.0	
42"		61.7	61.7	80.0	115.2	80.0	140.0	
48"		61.7	61.7	80.0	96.0	80.0	140.0	
54"		59.5	59.5	80.0	102.9	80.0	135.0	
60"		57.8	57.8	80.0	90.0	80.0	131.3	
66"		56.5	56.5	80.0	96.0	80.0	128.3	
72"		55.6	55.6	80.0	86.4	80.0	126.0	
18"	36"	80.0	82.2	80.0	128.0	80.0	186.7	
24"		61.7	61.7	80.0	108.0	80.0	140.0	
30"		49.3	49.3	80.0	98.7	80.0	112.0	
36"		41.1	41.1	80.0	93.3	80.0	93.3	
42"		41.1	41.1	80.0	93.3	80.0	93.3	
48"		41.1	41.1	76.8	76.8	80.0	93.3	
54"		41.1	41.1	80.0	80.0	80.0	93.3	
60"		41.1	41.1	68.6	68.6	80.0	93.3	
66"		41.1	41.1	72.0	72.0	80.0	93.3	
72"		38.1	38.1	64.0	64.0	80.0	93.3	
18"	48"	75.9	75.9	80.0	118.2	80.0	172.3	
24"		61.7	61.7	80.0	96.0	80.0	140.0	
30"		49.3	49.3	80.0	83.8	80.0	112.0	
36"		41.1	41.1	76.8	76.8	80.0	93.3	
42"		35.2	35.2	73.1	73.1	80.0	80.0	
48"		30.8	30.8	70.0	70.0	70.0	70.0	
54"		30.8	30.8	70.0	70.0	70.0	70.0	
60"		-	-	60.0	60.0	70.0	70.0	
66"		-	-	61.7	61.7	70.0	70.0	
72"		-	-	54.0	54.0	70.0	70.0	
18"	60"	72.5	72.5	80.0	112.9	80.0	164.7	
24"		57.8	57.8	80.0	90.0	80.0	131.3	
30"		49.3	49.3	76.8	76.8	80.0	112.0	
36"		41.1	41.1	68.6	68.6	80.0	93.3	
42"		35.2	35.2	63.3	63.3	80.0	80.0	
48"		-	-	60.0	60.0	70.0	70.0	
54"		-	-	58.2	58.2	62.2	62.2	
60"		-	-	56.0	56.0	56.0	56.0	
66"		-	-	56.0	56.0	56.0	56.0	
72"		-	-	49.4	49.4	56.0	56.0	
18"	72"	70.5	70.5	80.0	109.7	80.0	160.0	
24"		55.5	55.5	80.0	86.4	80.0	126.0	
30"		44.7	44.7	72.8	72.8	80.0	106.1	
36"		38.1	38.1	64.0	64.0	80.0	93.3	
42"		-	-	58.1	58.1	80.0	80.0	
48"		-	-	54.0	54.0	70.0	70.0	
54"		-	-	51.2	51.2	62.2	62.2	
60"		-	-	49.4	49.4	56.0	56.0	
18"		84"	69.1	69.1	80.0	107.5	80.0	156.8
24"			54.0	54.0	80.0	84.0	80.0	122.5
30"	40.7		40.7	70.1	70.1	80.0	102.3	
36"	-		-	61.1	61.1	80.0	89.1	
42"	-		-	54.9	54.9	80.0	80.0	
48"	-		-	50.4	50.4	70.0	70.0	
54"	-		-	47.2	47.2	62.2	62.2	


DESIGN LOAD CAPACITY - PSF								
WINDOW DIMS.		3/16" ANN. GLASS		3/16" TEMPERED GLASS				
		ANCHORS TYPE 'A'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'		
WIDTH	LENGTH	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	
18"	96"	68.0	68.0	80.0	105.9	80.0	154.5	
24"		52.9	52.9	80.0	82.3	80.0	120.0	
30"		-	-	68.3	68.3	80.0	99.6	
36"		-	-	59.1	59.1	80.0	86.2	
42"		-	-	52.7	52.7	76.8	76.8	
48"		-	-	48.0	48.0	70.0	70.0	
18"	108"	57.5	57.5	80.0	104.7	80.0	152.7	
24"		52.0	52.0	80.0	81.0	80.0	118.1	
30"		-	-	66.9	66.9	80.0	97.5	
36"		-	-	57.6	57.6	80.0	84.0	
42"		-	-	51.1	51.1	74.5	74.5	
18"		114"	50.8	50.8	80.0	109.7	80.0	152.0
24"	50.8		50.8	80.0	84.7	80.0	117.4	
30"	-		-	69.8	69.8	80.0	96.7	
36"	-		-	60.0	60.0	80.0	83.1	
18"	120"		45.3	45.3	80.0	103.8	80.0	151.4
24"			-	-	80.0	80.0	80.0	116.7
30"		-	-	65.8	65.8	80.0	96.0	
36"		-	-	56.5	56.5	80.0	82.4	
18"		132"	36.6	36.6	80.0	103.0	80.0	146.4
24"			-	-	79.2	79.2	80.0	115.5
30"	-		-	65.0	65.0	80.0	94.8	
18"	144"		30.1	30.1	80.0	102.4	80.0	120.3
24"			-	-	78.5	78.5	80.0	114.5
30"			-	-	64.3	64.3	80.0	93.8

DESIGN LOAD CAPACITY - PSF							
WINDOW DIMS.		3/16" ANN. GLASS		3/16" TEMPERED GLASS			
		ANCHORS TYPE 'A'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'	
WIDTH	LENGTH	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
19-1/8"	26"	77.4	77.4	80.0	175.7	80.0	175.7
26-1/2"		56.9	56.9	80.0	129.2	80.0	129.2
37"		56.9	56.9	80.0	129.2	80.0	129.2
53-1/8"		56.5	56.5	80.0	99.4	80.0	128.3
19-1/8"	38-3/8"	77.3	77.3	80.0	150.5	80.0	175.5
26-1/2"		55.8	55.8	80.0	124.6	80.0	126.8
37"		40.0	40.0	80.0	90.8	80.0	90.8
53-1/8"		38.6	38.6	79.6	79.6	80.0	87.6
19-1/8"	59"	69.3	69.3	80.0	109.7	80.0	157.3
26-1/2"		54.0	54.0	80.0	85.5	80.0	122.6
37"		40.0	40.0	69.2	69.2	80.0	90.8
53-1/8"		-	-	60.2	60.2	63.2	63.2
19-1/8"	63"	68.4	68.4	80.0	121.7	80.0	155.3
26-1/2"		53.0	53.0	80.0	94.4	80.0	120.4
37"		40.0	40.0	75.6	75.6	80.0	90.8
53-1/8"		-	-	63.2	63.2	63.2	63.2
19-1/8"	74-1/4"	66.6	66.6	80.0	117.3	80.0	151.2
26-1/2"		51.0	51.0	80.0	89.8	80.0	115.8
37"		-	-	70.4	70.4	80.0	90.7
53-1/8"		-	-	57.3	57.3	63.2	63.2

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS).

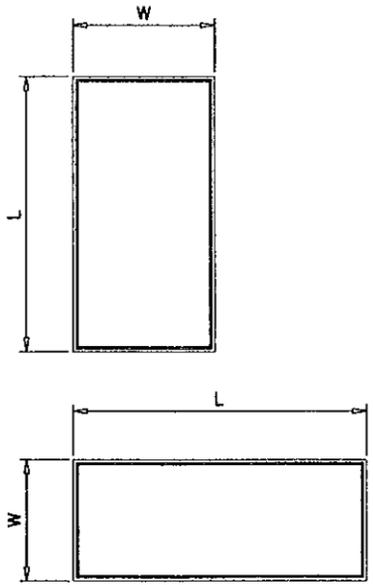

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

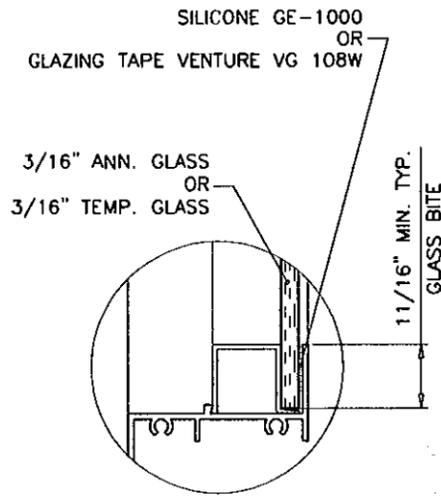

GLAZING DETAIL

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

SEP 09 2010

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-0930.04
Expiration Date Dec. 13, 2011

By *Muhammad J. J.*
Miami Dade Product Control
Division

afC

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL \ W00 - 53Y0

EXTERIOR GLAZED ALUM FIXED WINDOW (N.I.)





ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

revisions:	no.	date	description
	B	12.11.06	UPDATED FOR 2004 FBC
	C	03.25.09	NOTES REV., MANUF. NAME CHANGE
	D	09.02.10	MANUF. NAME REVISED

date: 12-12-00
scale: -
dr. by: HAMID
chk. by:

drawing no.
W00-53

sheet 2 of 5

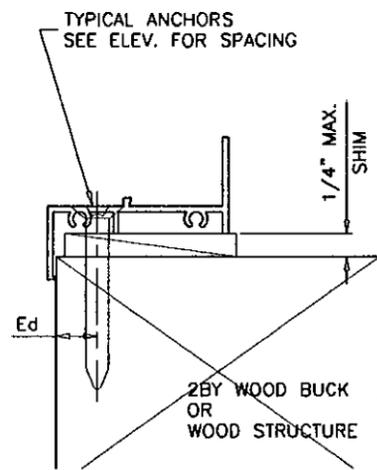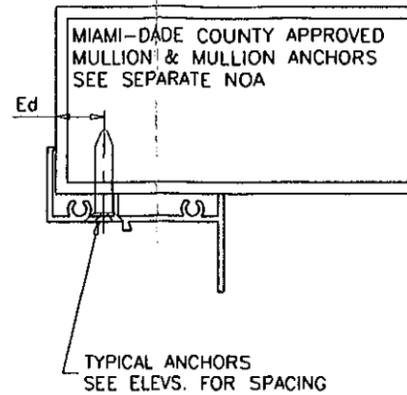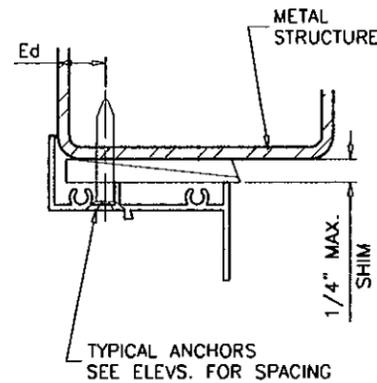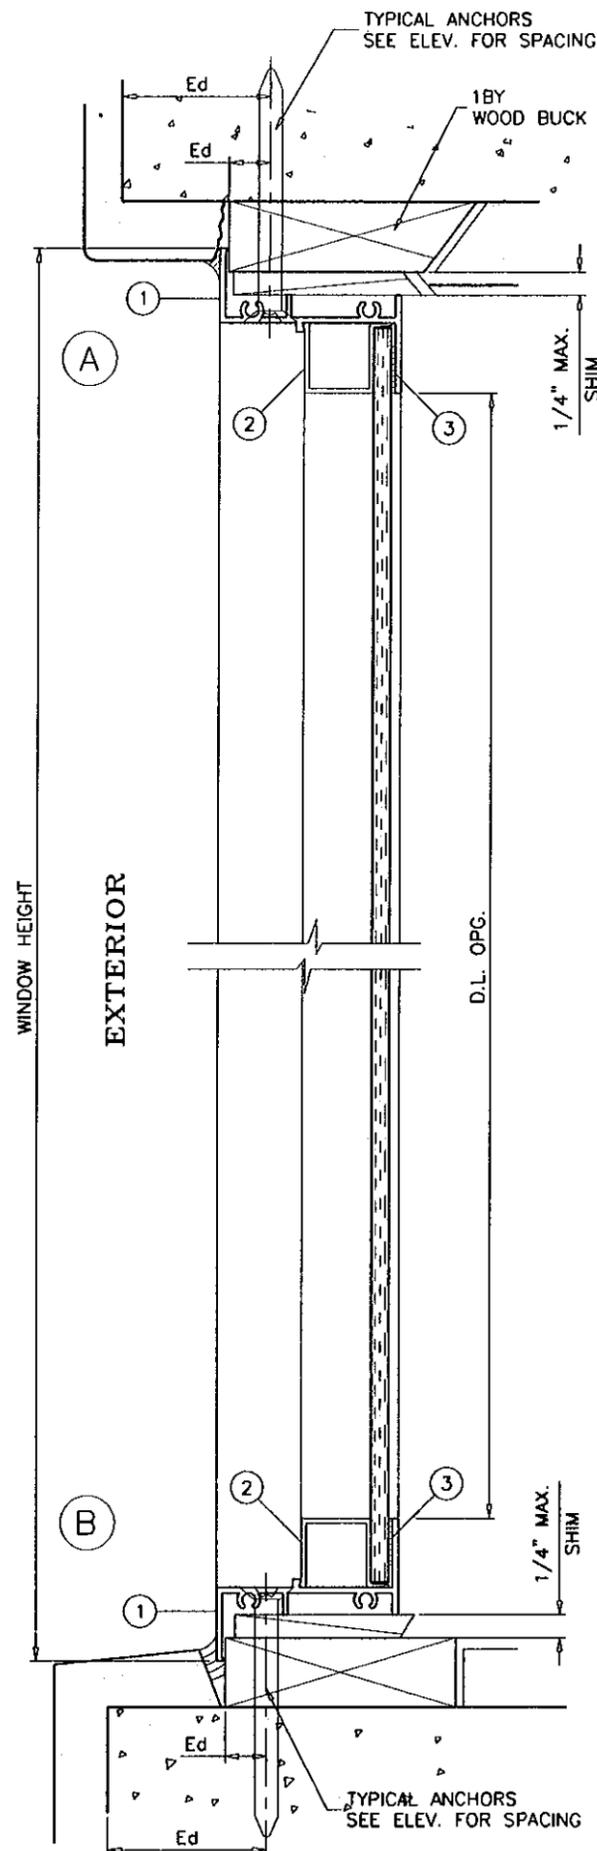

WOOD BUCKS AND METAL STRUCTURE NOT BY AWP WDW. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A'- 3/16" TAPCONS

INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
1-3/8" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY
DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

TYPE 'B'- 1/4" TAPCONS

INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
1-3/8" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY
DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

3/16" TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)

INTO METAL STRUCTURES
STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#10 SMS OR SELF DRILLING SCREWS

INTO DADE COUNTY APPROVED MULLIONS
(NO SHIM SPACE)

Ed = ANCHOR EDGE DISTANCE

INTO CONCRETE AND MASONRY = 1-1/4" MIN.
INTO WOOD STRUCTURE = 9/16" MIN.
INTO METAL STRUCTURE = 1/2" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

SEALANTS:

FRAME CORNERS AND INSTALLATION SCREWS SEALED WITH GE SILICONE SEALANT.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

SEP 09 2010

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-0930.04
Expiration Date DEC 13 2011

By *Manuel Perez*
Miami Dade Product Control
Division

afc




AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W00-53YO

EXTERIOR GLAZED ALUM FIXED WINDOW (N.I.)
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no.	date	description
B	12.11.06	UPDATED FOR 2004 FBC
C	03.25.09	MANUF. NAME CHANGE
D	09.02.10	MANUF. NAME REVISED

date: 12-12-00
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W00-53
sheet 3 of 5

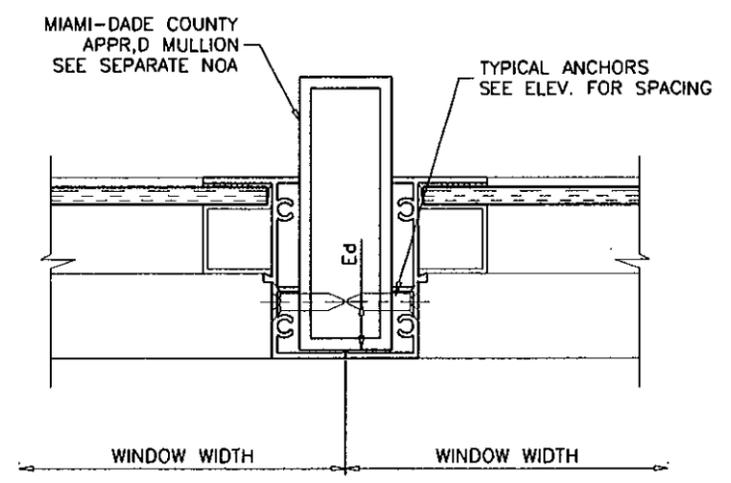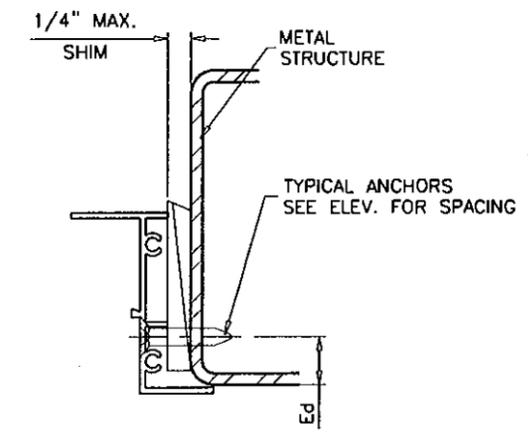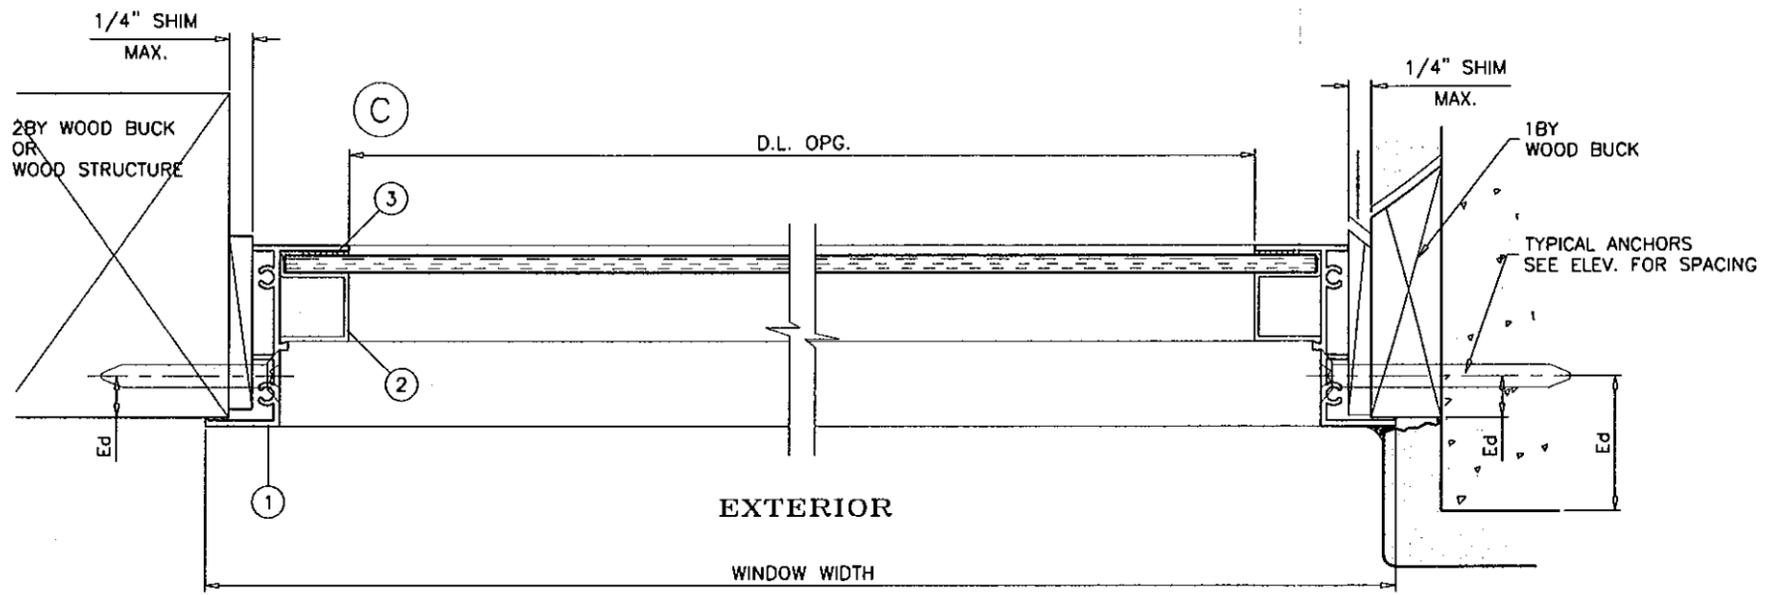

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

J.A.
 SEP 09 2010

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No **10-0930.04**
 Expiration Date **DEC 13, 2011**
 By *Manuel Perez*
 Miami Dade Product Control
 Division


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W00-53YO

EXTERIOR GLAZED ALUM FIXED WINDOW (N.I.)
 ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309


no.	date	by	description
B	12.11.06		UPDATED FOR 2004 FBC
C	03.25.09		MANUF. NAME CHANGE
D	09.02.10		MANUF. NAME REVISED

date: 12-12-00
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W00-53
 sheet 4 of 5

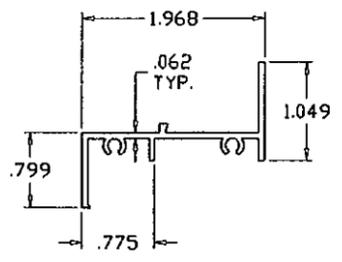


WINDOW FRAME




GLAZING STOP


ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPLIER/REMARKS
1	YE-60	4	WINDOW FRAME	ALUMINUM	6063-T5
2	YE-42	4	GLAZING STOP	ALUMINUM	6063-T5
3	GE-1000	AS REQD.	GLAZING COMPOUND	SILICONE	-
3A	VG 108W	AS REQD.	GLAZING TAPE (1/2" X 1/8")	-	VENTURE
4	#8 X 1"	2/ CORNER	FRAME ASSEMBLY SCREWS	-	-

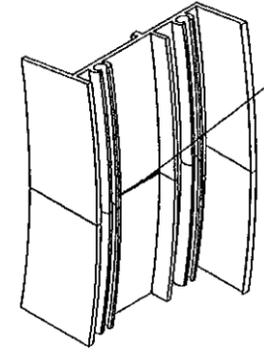

CIRCULAR WINDOWS

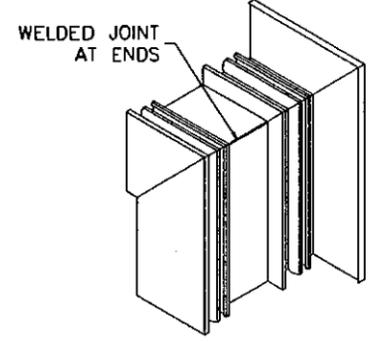

OPTIONAL CORNER

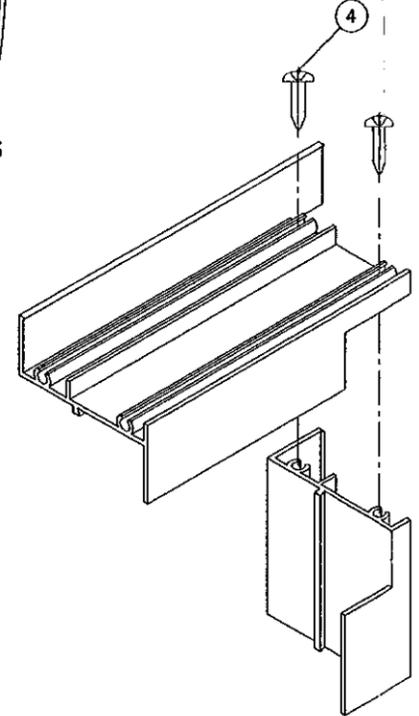

RECT. OR SQUARE WINDOWS

TYP. CORNER DETAILS

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W00-53YO

EXTERIOR GLAZED ALUM FIXED WINDOW (N.I.)
ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

no.	date	by	description
B	12.11.06		UPDATED FOR 2004 FBC
C	03.25.09		MANUF. NAME CHANGE
D	09.02.10		MANUF. NAME REVISED

date: 12-12-00
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W00-53

sheet 5 of 5

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

 SEP 09 2010

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No **10-0930.04**
 Expiration Date **DEC. 13, 2011**
 By
 Miami Dade Product Control
 Division