



BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/building/home/asp

NOTICE OF ACCEPTANCE (NOA)

Exclusive Wood Doors, Inc.
1950 N. W. 70th Ave.
Miami, Florida 33126

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County BNC -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BNC reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "EWD" Outswing glazed Wood Doors-L. M. Impact

APPROVAL DOCUMENT: Drawing No. **EXD003**, titled "Glazed Wood Doors", sheets 1 thru 9 of 9 dated 11/17/10 and last revised on 07/08/11, prepared by Certworks, LLC, signed and sealed by Alexis Spyrou, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

Limitation:

1. Masonry unit conforming to C-90 with min net area compressive strength =1900 psi and grouted masonry with grout conforming to ASTM C-476 and min grout compressive strength = 2000 psi required.
2. Two (2) surface bolts (top/bottom) of active and in-active doors are required.
3. Partial raised panels are limited to max. 23"W X 27" H

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, **Santa Cruz, Bolivia** and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



8/2/11

NOA No 10-1220.01
Expiration Date: August 11, 2016
Approval Date: August 11, 2011

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's parts and sections drawings.
2. Drawing No. **EXD003**, titled "Glazed Wood Doors", sheets 1 thru 9 of 9 dated 11/17/10 and last revised on 07/08/11, prepared by Certworks, LLC, signed and sealed by Alexis Spyrou, P. E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
 - 5) Large Missile impact Test per FBC, TAS 201-94
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of Outswing glazed Wood door, prepared by Certified Testing Laboratories, Test Report No(s). **CTLA 2016W**, dated 11/15/10, signed & sealed by Ramesh Patel, P.E.

(These test reports have been revised by an addendum letter dated April 02, 2010, issued by Certified Testing Lab, signed & sealed by Ramesh Patel, P.E. Additionally revised raised panel detail marked-up by Certified Testing lab dated 06/23/11 has been provided)

C. CALCULATIONS

1. Anchor verification calculations, dated 05/19/11 and last revised on 07-08-11, prepared by Certworks, LLC, signed and sealed by Alexis Spyrou, P.E.,
2. Glazing complies with ASTM E-1300-02 & 04

D. QUALITY ASSURANCE

1. Miami Dade Building and Neighborhood Compliance Department (BNC).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **08-0206.01** issued to Solutia, for "Saflex HP", expiring on 04/14/2013.

F. STATEMENTS

1. Statement letters of conformance and "No financial interest", both dated 05/18/11, signed and sealed by Alexis Spyrou, P.E.
2. Addendum letter dated 04/02/10, issued by Certified Testing Laboratories, signed by Ramesh Patel, P. E.
3. Statement of compliance, issued as part of the above referenced test report issued by Certified Testing Laboratories.

G. OTHER

1. Test proposal # 09-1386 dated 11/19/09, approved by BCCO
2. Raised panel detail marked-up drawing dated 06/23/11, issued by Certified Testing.
3. Distribution Agreement between Carpinteria "Don Fernando" S.R.L., Bolivia and Exclusive Wood Doors, USA, dated 06/22/11, signed by Juan C. Nisenbaum and Fernando Nisenbaum, respectively.



Ishaq I. Chanda, P.E.

Product Control Examiner

NOA No 10-1220.01

Expiration Date: August 11, 2016

Approval Date: August 11, 2011

EXCLUSIVE WOOD DOORS

GLAZED WOOD OUTSWING DOUBLE DOOR (IMPACT)



1980 NW 70TH AVE.
MIAMI, FL 33126

PH: 305-477-2278 FX: 305-477-7140

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/16 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. FOR INSTALLATION INTO 2X WOOD BUCK USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
5. FOR INSTALLATION THROUGH PROPERLY SECURED 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 3/16 INCH DIAMETER ITW TAPCON OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT, 3" O.C., AND 2 1/2" EDGE DISTANCE.
6. FOR INSTALLATION THROUGH STEEL STUD USE #10-16 SELF-TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE MINIMUM PENETRATION OF 3 THREADS BEYOND STEEL STRUCTURE.
7. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
8. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
9. FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
10. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
11. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 2700 PSI.
 - C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE S OR M.
 - D. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 33 MILS. (20 GAUGE OR 0.033 IN.) MUST BE DESIGNED TO ADEQUATELY TRANSFER LOADS APPLIED.

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2007 FLORIDA BUILDING CODE (FBC) ALSO WITH 2006 INTERNATIONAL BUILDING CODE AND THE 2006 INTERNATIONAL RESIDENTIAL CODE, INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS AND TO BE REVIEWED BY A.H.J. (AUTHORITY HAVING JURISDICTION).
5. DEVIATION FROM NOA WITHIN THE HVHZ REQUIRES ONE-TIME APPROVAL FROM MIAMI-DADE COUNTY (BNC).
6. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7. DOOR FRAME MATERIAL: MARA MACHO MAHOGANY (CEDRELINGA CATENAEFORMIS DUCKE, MIN. SG=0.44) OR OAK (MIN. SG=0.67)
8. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 6 FOR GLAZING DETAILS.
9. DESIGNATION "X" STANDS FOR THE FOLLOWING:
X: OPERABLE PANEL
10. CUSTOM SIZES AVAILABLE UPON REQUEST.
11. COMPLIANCE TO EGRESS REQUIREMENTS OF THIS DOOR TO BE REVIEWED BY A.H.J. (AUTHORITY HAVING JURISDICTION).

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	-	GENERAL & INSTALLATION NOTES
2	-	ELEVATIONS & ANCHOR LAYOUTS
3	-	ELEVATIONS & ANCHOR LAYOUTS
4	-	ELEVATIONS & ANCHOR LAYOUTS
5	-	VERTICAL SECTIONS
6	-	HORIZONTAL SECTIONS
7	-	COMPONENTS & BILL OF MATERIALS
8	-	CORNER SECTIONS & GLAZING DETAILS
9	-	QUALIFIED PANEL CONFIGURATIONS

DESIGN PRESSURE RATING		
DESIGN PRESSURE - ALL SIZES		MISSILE IMPACT RATING
+70/- 70 PSF	W/ WATER INFILTRATION REQUIRED	LARGE AND SMALL MISSILE IMPACT RATED
	W/O WATER INFILTRATION REQUIRED	

TITLE: GLAZED WOOD OUTSWING DOUBLE DOOR

GENERAL & INSTALLATION NOTES

PREPARED BY: CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

REVISIONS	DESCRIPTION	NO.	DATE



Approved as complying with the Florida Building Code
Date: Aug 11, 2011
NOA# 10-12-2011
Miami Dade Product Control
By: Isang I. Chae


DATE: 11.17.10
DWN BY: JLA
CHK BY: HFN
SCALE: NTS

DWG #: **EXD003**
SHEET: 1 OF 9




1980 NW 70TH AVE.
MIAMI, FL 33126


PH: 305-477-2278 FX: 305-477-7140

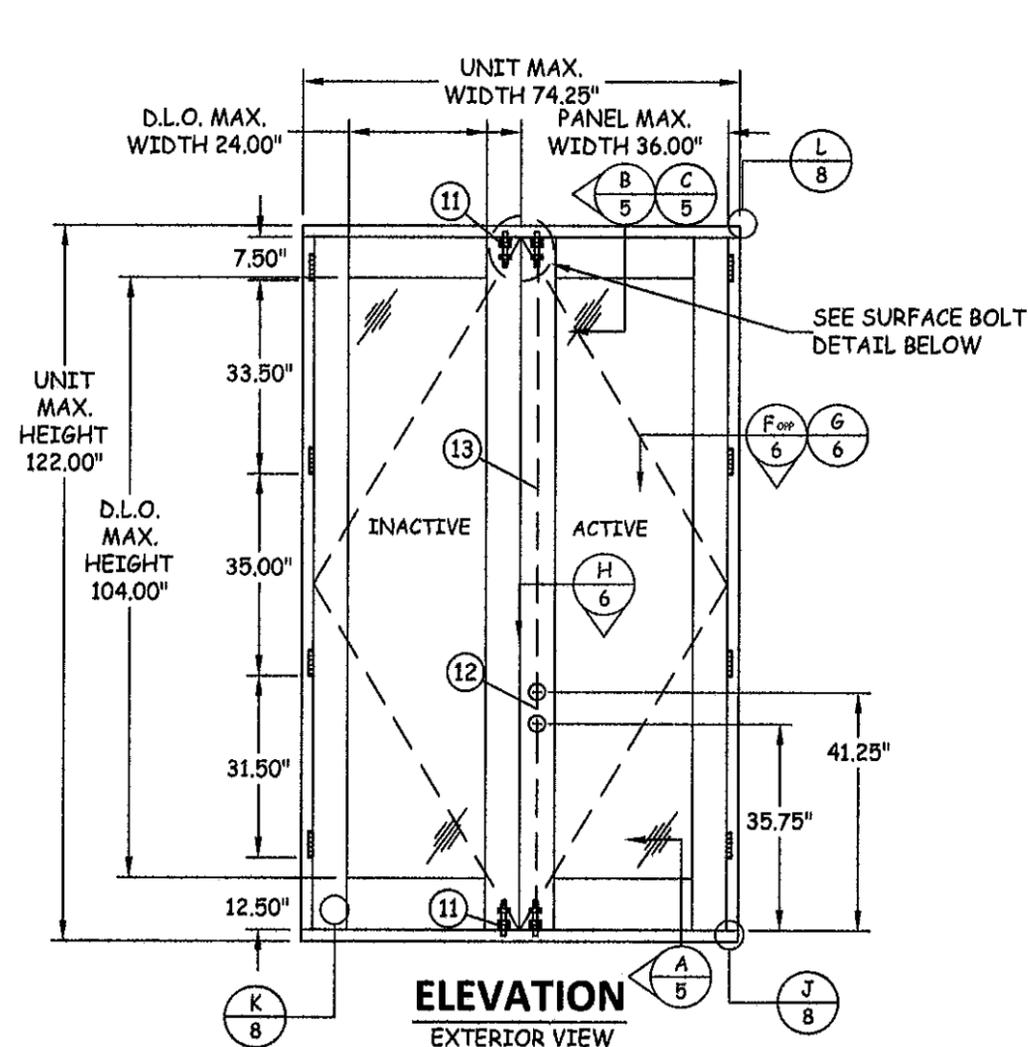

ELEVATION
EXTERIOR VIEW

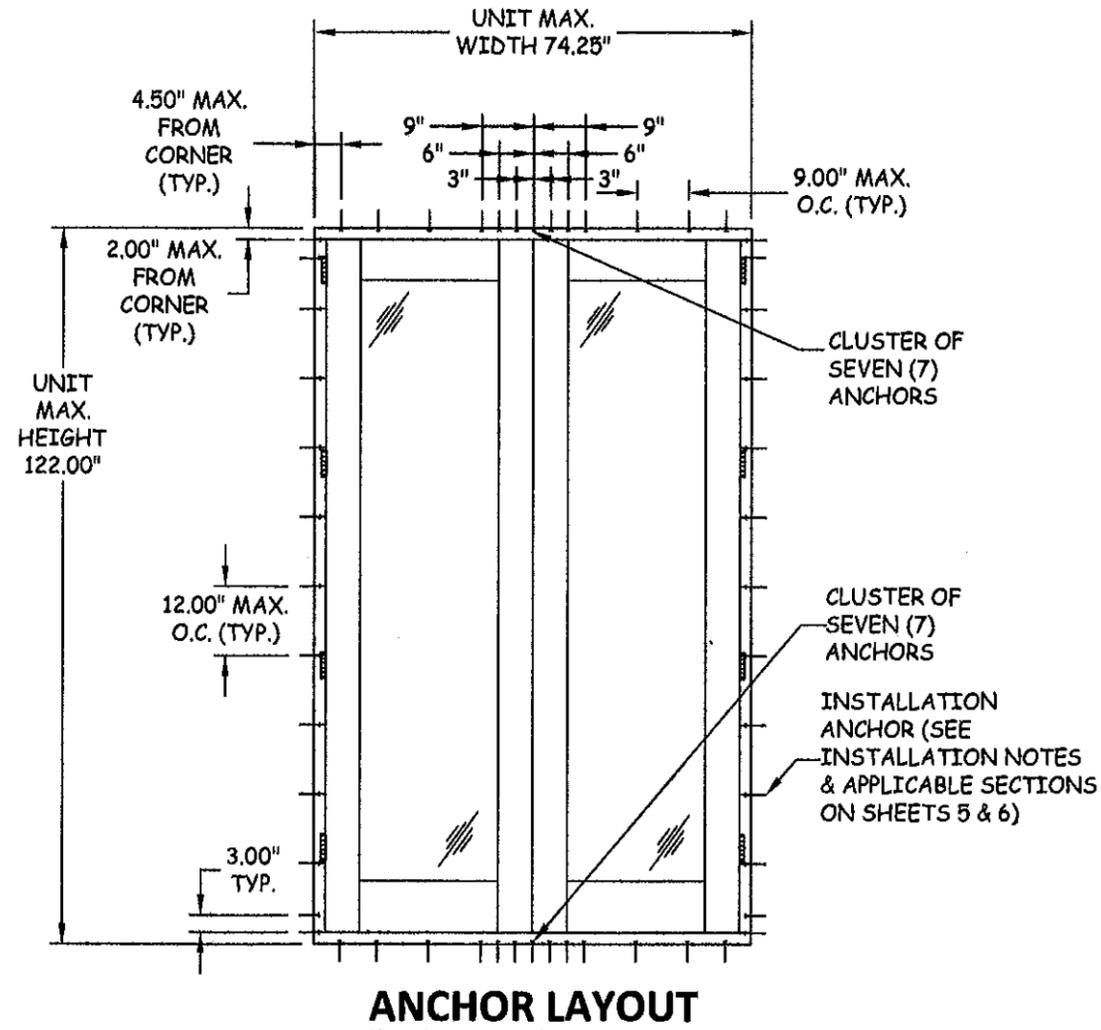

ANCHOR LAYOUT

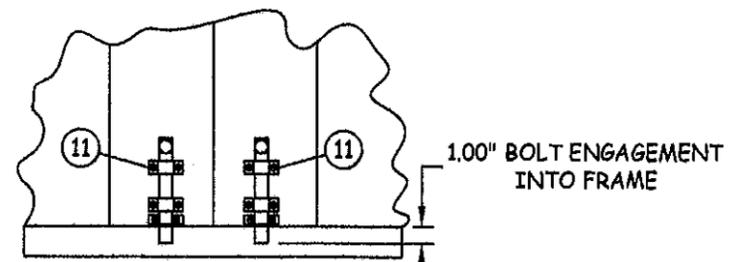

SURFACE BOLT DETAIL

LOCATED AT TOP & BOTTOM OF EACH ACTIVE & INACTIVE PANEL (INTERIOR SIDE OF PANEL)

TITLE: GLAZED WOOD OUTSWING DOUBLE DOOR ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY: CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

NO.	REVISIONS	DESCRIPTION	BY	DATE



Approved as per:
Florida Building Code
Date: 8/11/11
NOA# 10-1220-01
Miami Code Product Control
Michael J. Chaudhry

DATE: 11.17.10
DWN BY: JLA
CHK BY: HFN
SCALE: NTS

DWG #: **EXD003**
SHEET: 2 OF 9





1950 NW 70TH AVE.
MIAMI, FL 33126

PH: 305-477-2278 FX: 305-477-7140

PREPARED BY:
CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

TITLE: GLAZED WOOD
OUTSWINGING DOUBLE DOOR
ELEVATIONS &
ANCHOR LAYOUTS

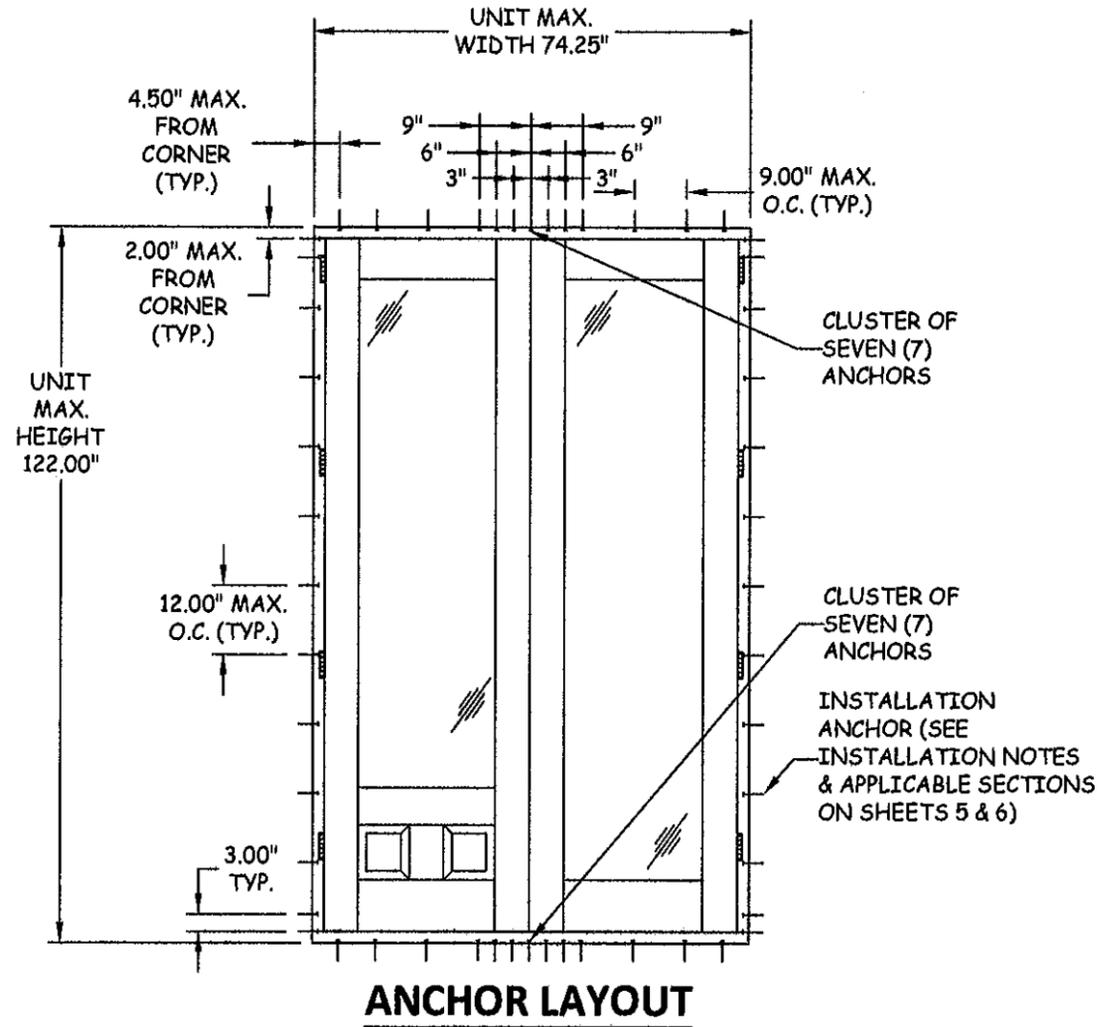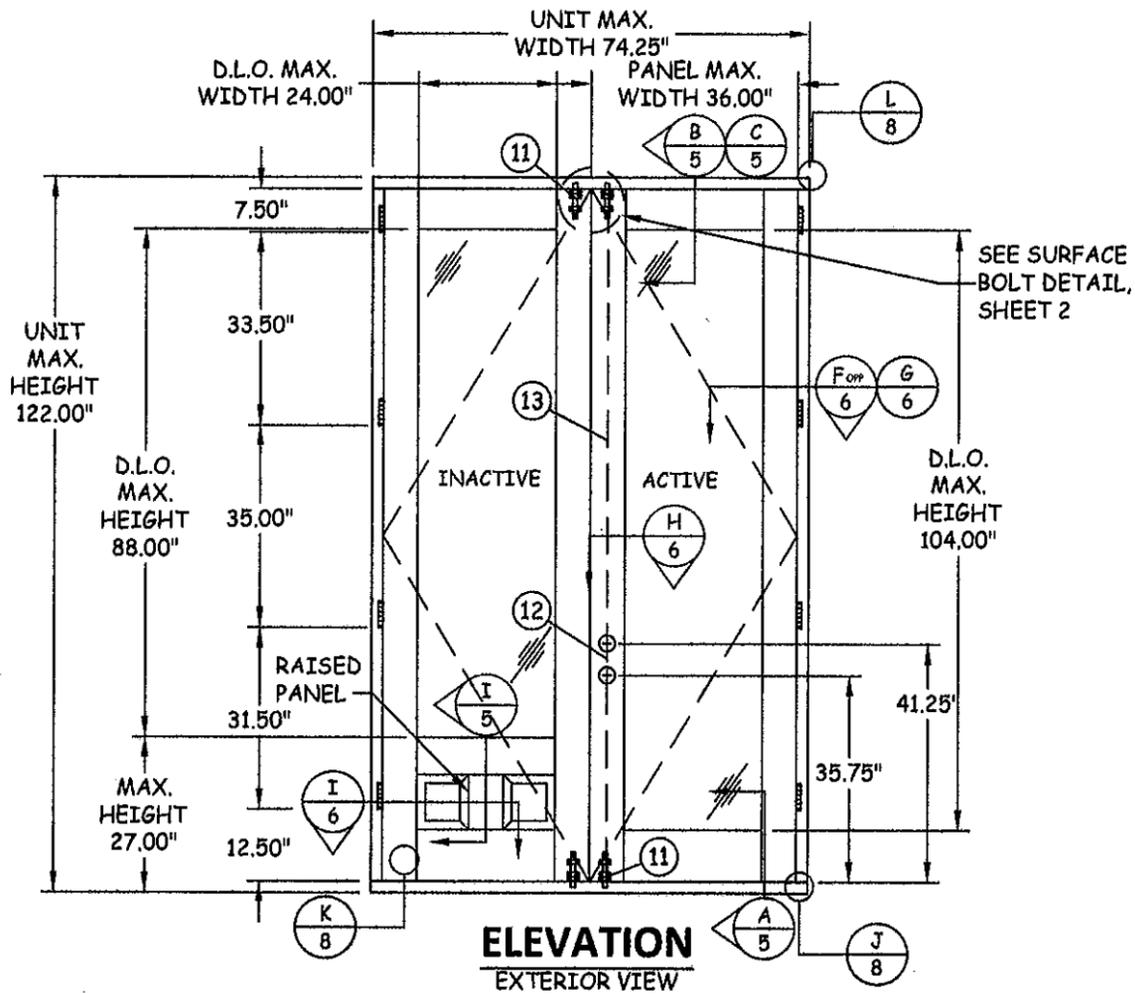

REVISIONS

NO.	DESCRIPTION	BY	DATE





Approved as complying with the Florida Building Code
Date: 8/11/11
NOAS 10-1220-01
Miami-Dade Product Control
By: Ishag I. Chande

DATE: 11.17.10
DWN BY: JLA
CHK BY: HFN
SCALE: NTS

DWG #: **EXD003**
SHEET: **3 OF 9**



1980 NW 70TH AVE.
MIAMI, FL 33126
PH: 305-477-2278 FX:305-477-7140

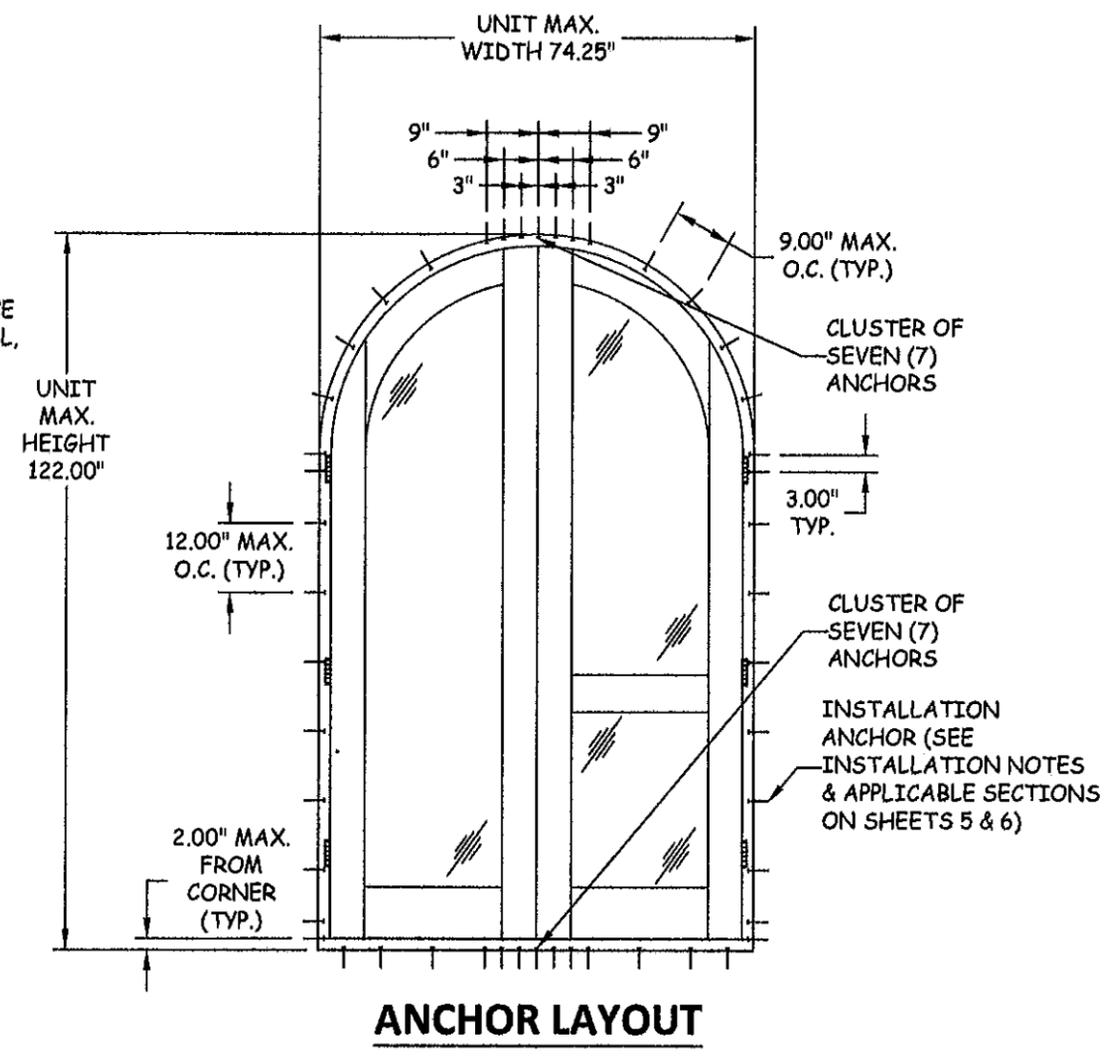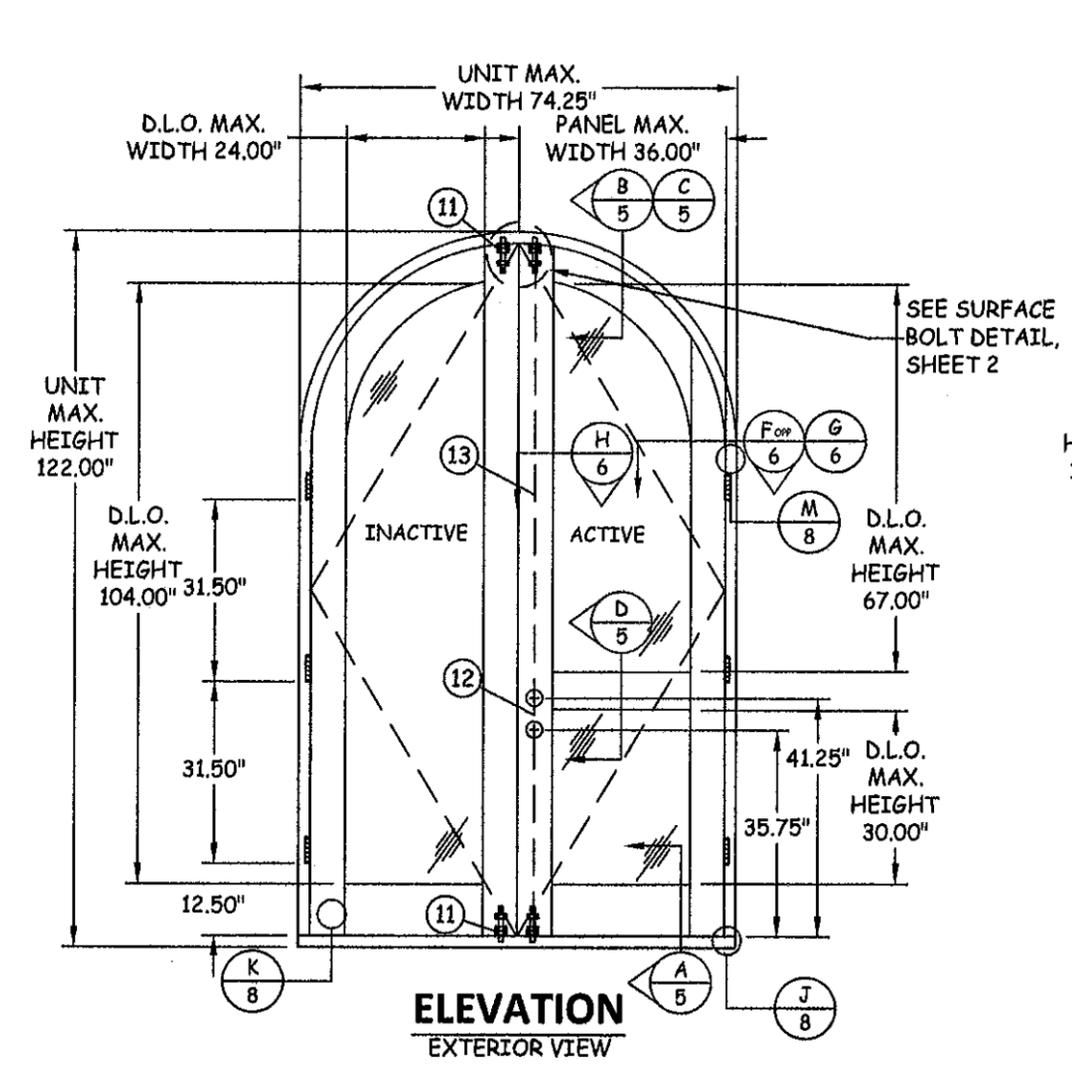

TITLE: GLAZED WOOD OUTSWINGING DOUBLE DOOR ELEVATIONS & ANCHOR LAYOUTS
PREPARED BY: CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-5957 FX: (407) 644-2366

NO.	DESCRIPTION	REVISIONS	
		BY	DATE



Approved as complying with Florida Building Code
Date: 11/17/10
Miami Made Product Control
By: *Isabel L. Chavez*


DATE: 11.17.10
DWN BY: JLA
CHK BY: HFN
SCALE: NTS

DWG #: EXD003
SHEET: 4 OF 9




1950 NW 70TH AVE.
MIAMI, FL 33126
PH: 305-477-2278 FX: 305-477-7140


TITLE: GLAZED WOOD DOUBLE DOOR
VERTICAL SECTIONS
PREPARED BY:
CER TWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

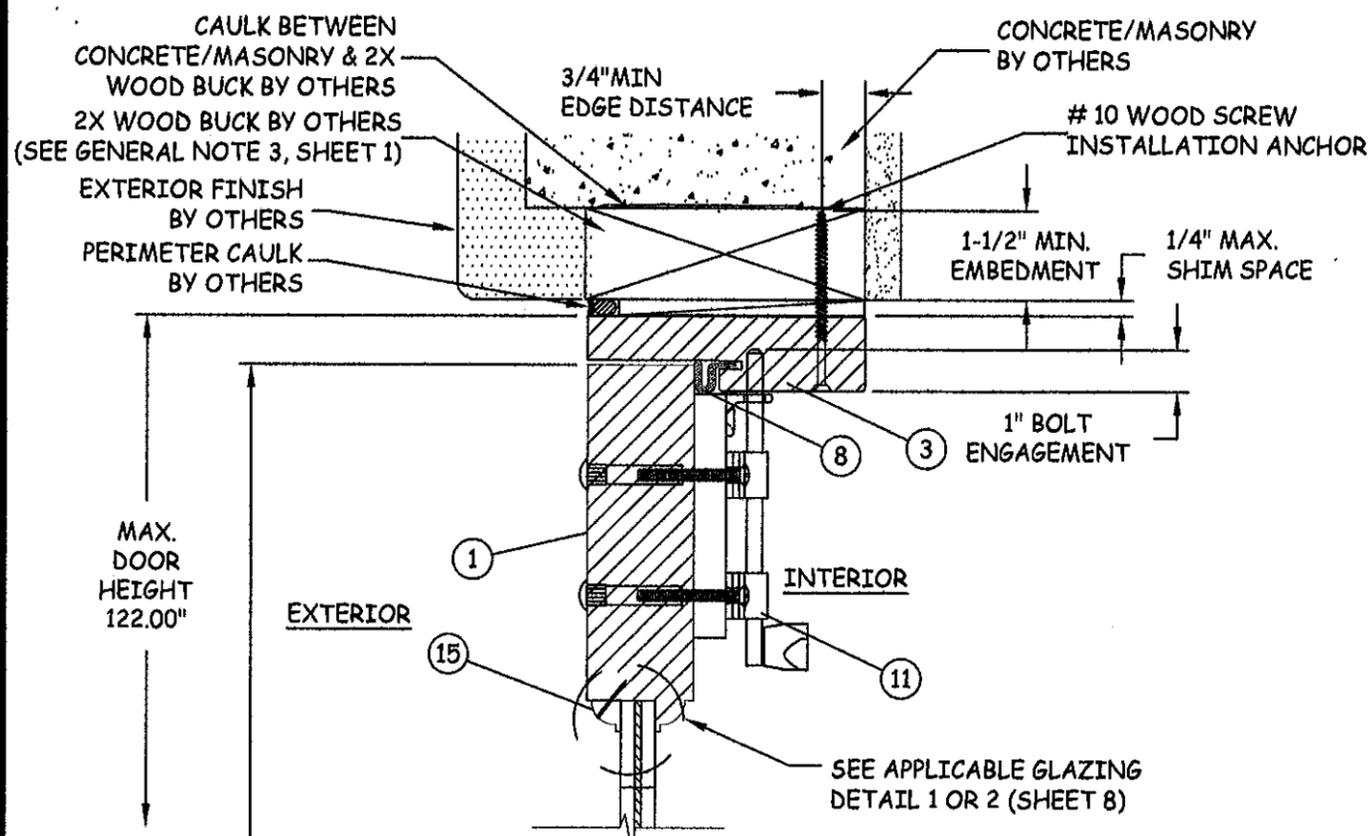


B
5
VERTICAL SECTION
HEAD - 2X WOOD BUCK

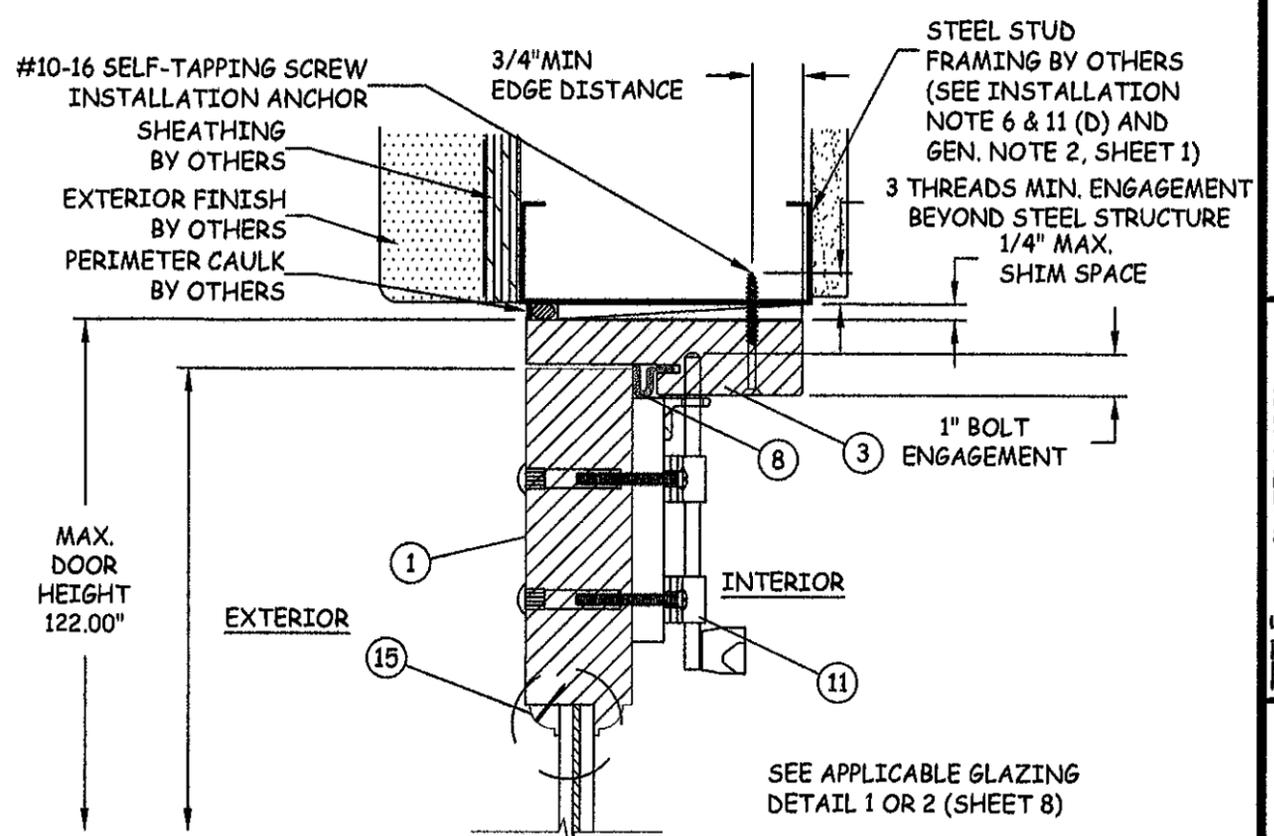


C
5
VERTICAL SECTION
HEAD - STEEL STUD FRAME

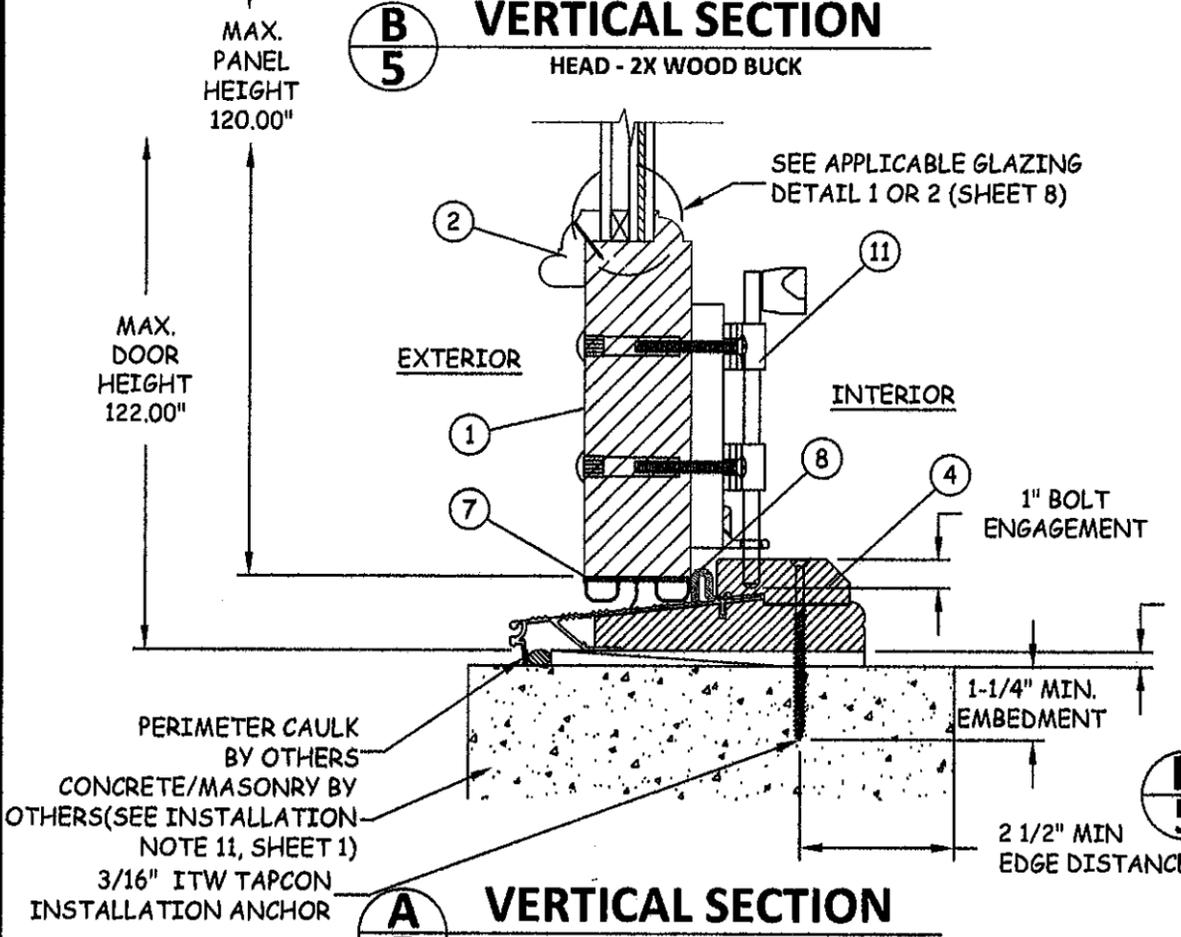

A
5
VERTICAL SECTION
SILL - CONCRETE

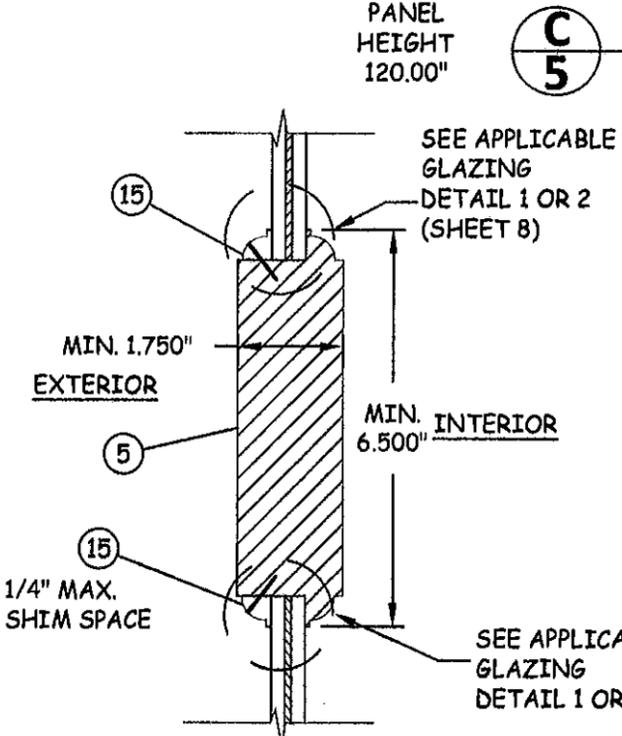

D
5
VERTICAL SECTION
MIDRAIL FULLY GLAZED

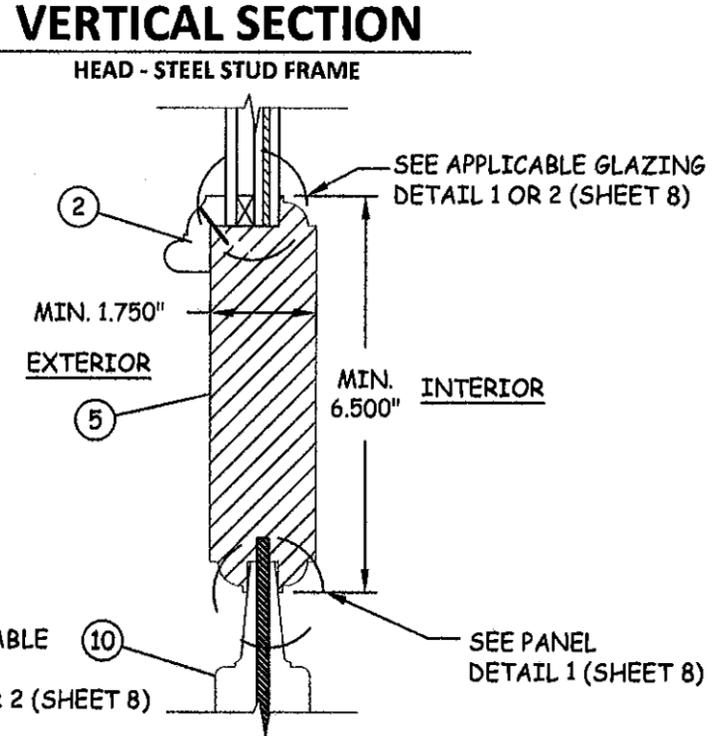

E
5
VERTICAL SECTION
MIDRAIL GLAZED & PARTIAL RAISED PANEL


REVISIONS	DESCRIPTION	DATE	
		BY	DATE
NO.			




Approved as complying with the Florida Building Code
Date: 8/11/10
NOAF 10-1220-01
Miami Code Product Control
By: Ismael J. L. Gande

DATE: 11.17.10
DWN BY: JLA
CHK BY: HFN
SCALE: NTS


DWG #: **EXD003**
SHEET: **5 OF 9**

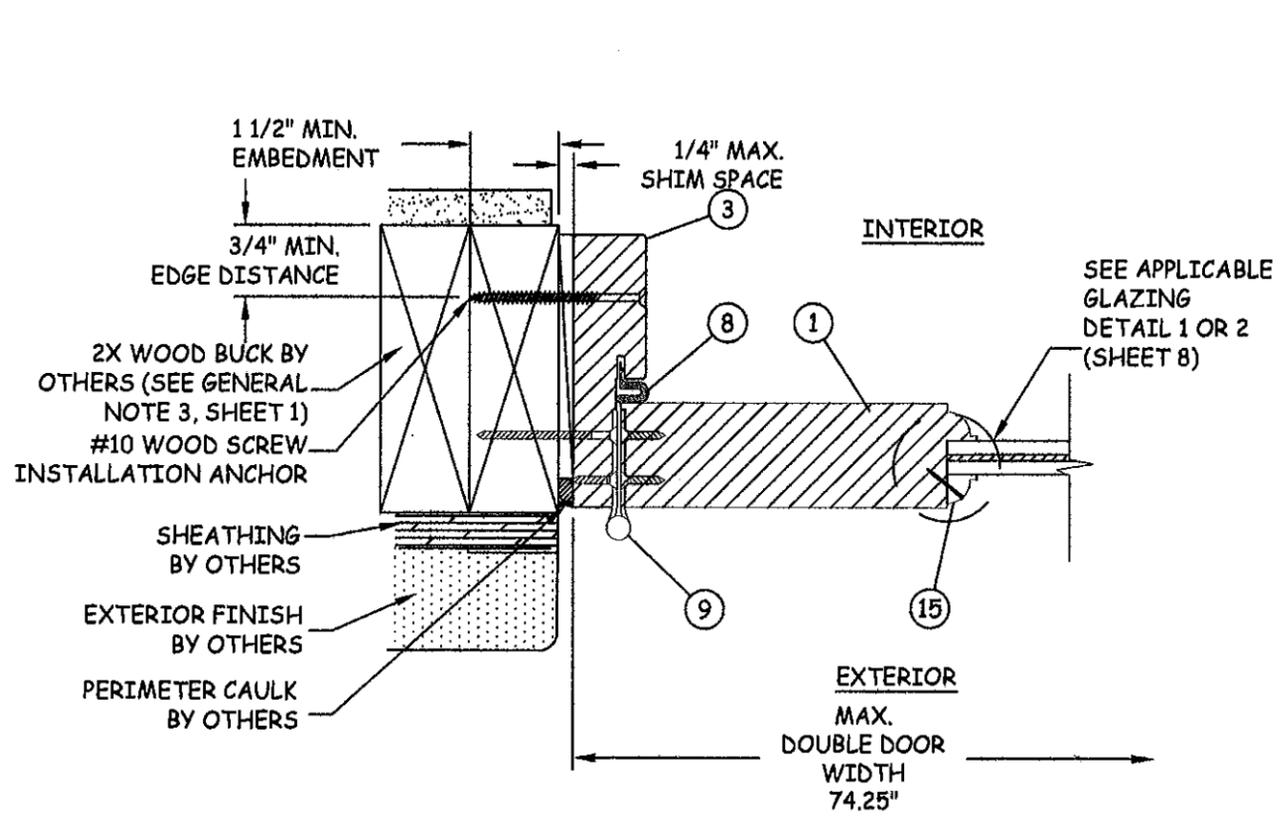


F
6 **HORIZONTAL SECTION**
JAMB
2X WOOD FRAME

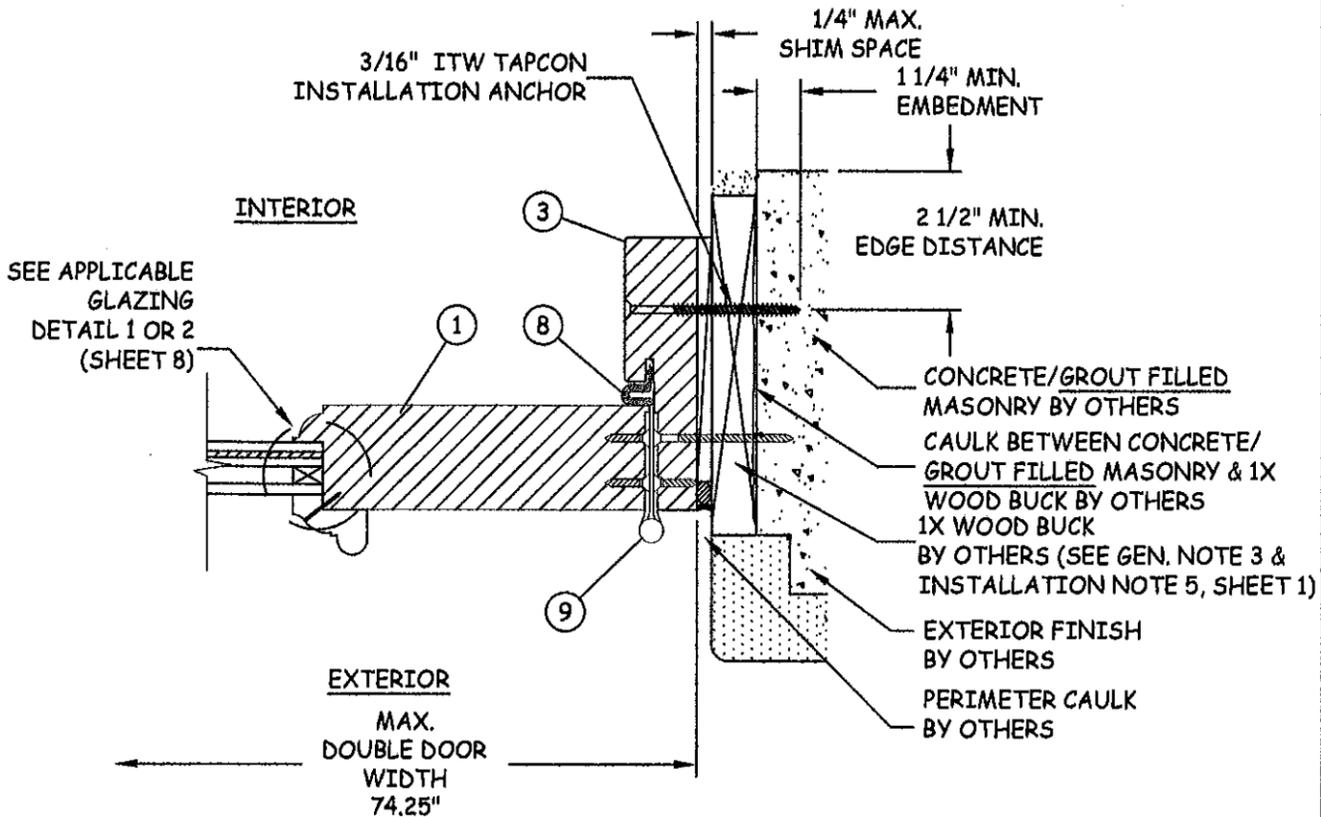

G
6 **HORIZONTAL SECTION**
JAMB
1X WOOD FRAME

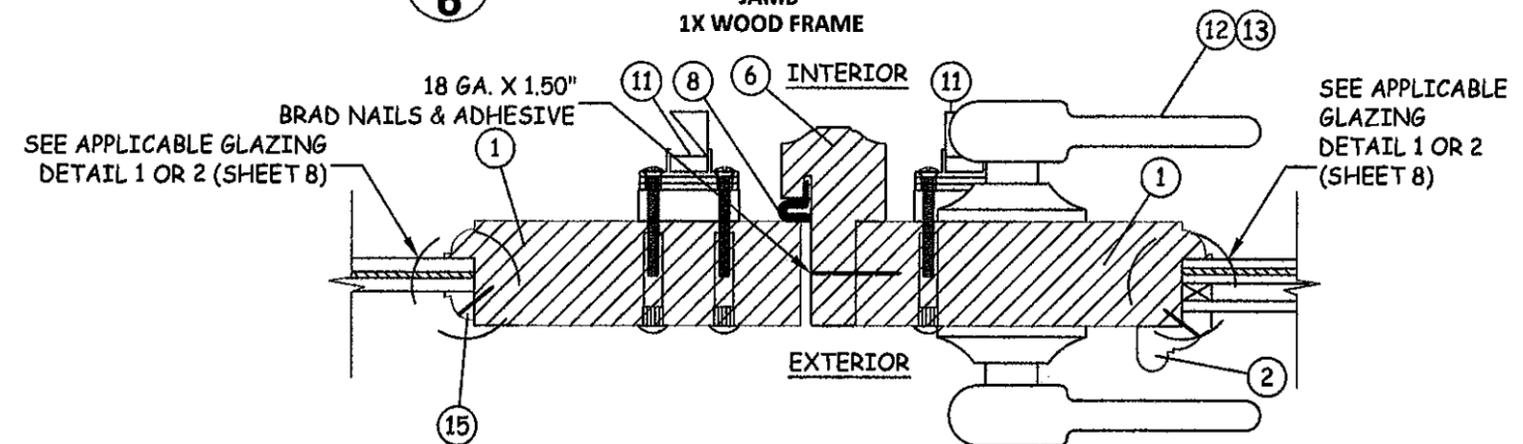

H
6 **HORIZONTAL SECTION**
ASTRAGAL

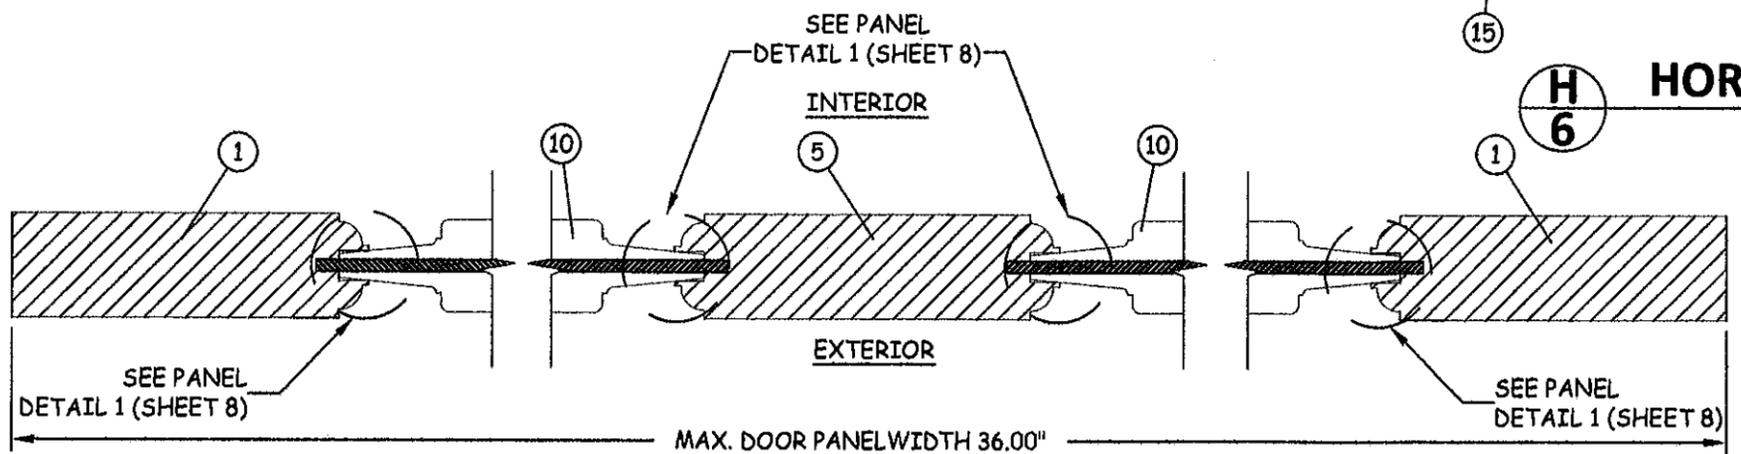

I
6 **HORIZONTAL SECTION**
RAISED PANEL/MIDSTILE

TITLE: GLAZED WOOD DOUBLE DOOR
HORIZONTAL SECTIONS
PREPARED BY:
GERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

NO.	DESCRIPTION	BY	DATE



Approved as complying with the
Florida Building Code
Date: 11/17/10
NOAS 10-12220-01
Florida State Product Control
By: [Signature]


DATE: 11.17.10
DWN BY: JLA
CHK BY: HFN
SCALE: NTS
DWG #: **EXD003**
SHEET: **6 OF 9**

BILL OF MATERIALS


ITEM NO.	DESCRIPTION	MATERIAL	MANUFACTURER
1	PANEL RAIL/STILE/MIDRAIL	MAHOGANY (MIN. SG=0.44)	EXCLUSIVE
2	STEP GLASS STOP	MAHOGANY (MIN. SG=0.44)	EXCLUSIVE
3	HEAD & JAMB	MAHOGANY (MIN. SG=0.44)	EXCLUSIVE
4	SILL (3-PIECE)	MAHOGANY/AL. 6063-T5	EXCLUSIVE
5	MIDRAIL	MAHOGANY (MIN. SG=0.44)	EXCLUSIVE
6	ASTRAGAL	MAHOGANY (MIN. SG=0.44)	EXCLUSIVE
7	DOOR SWEEP	URETHANE FOAM	Q-LON
8	COMPRESSION WEATHERSTRIP	URETHANE FOAM	Q-LON
9	4-1/2" x 4-1/2" BUTT HINGE	12 GA. STEEL	PENROD
10	PARTIAL RAISED PANEL	MAHOGANY W/ PLYWOOD CORE	EXCLUSIVE
11	SURFACE BOLTS W/ STRIKE PLATE	STAINLESS STEEL	DELTANA
12	ENTRY LATCH & DEADBOLT	CAST IRON	KWIKSET
13	5-PT LOCKING SYSTEM	CAST IRON	TRILENNIUM
14	GLASS SPACER	BUTYL RUBBER	
15	GLASS STOP	MAHOGANY (MIN. SG=0.44)	EXCLUSIVE

NOTE: ALL MAHOGANY TO BE MARA MACHO (CEDRELINGA CATENAEFORMIS DUCKE, E_{min}=1440 KSI, SG=0.44) OR OAK (E_{min}=1400 KSI, SG=0.67)


1 PANEL RAIL/STILE/MIDRAIL MAHOGANY

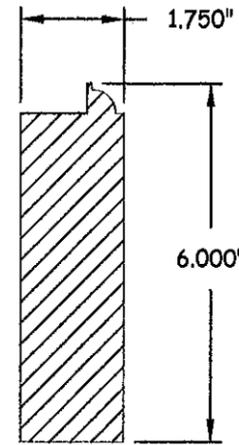


2 STEP GLASS STOP MAHOGANY




3 HEAD AND JAMB MAHOGANY

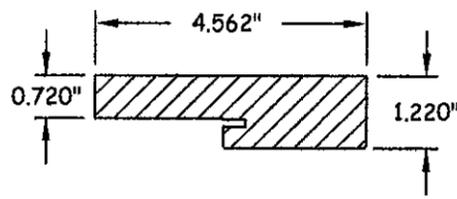


4 SILL (3 PIECES) MAHOGANY/AL. 6063-T5

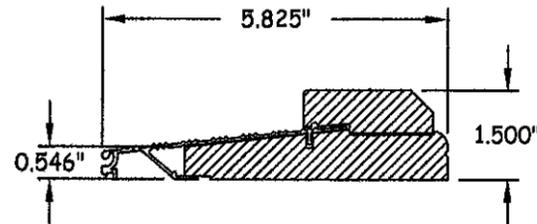


5 MIDRAIL MAHOGANY

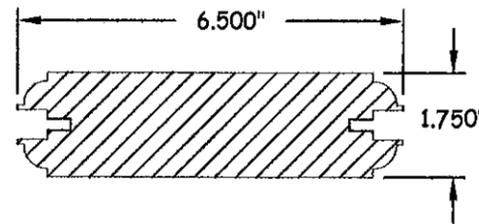


6 ASTRAGAL MAHOGANY

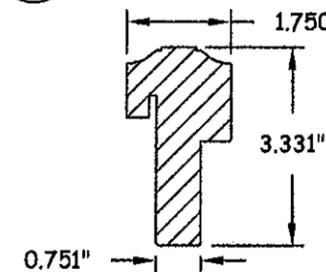


7 DOOR SWEEP URETHANE FOAM




8 COMPRESSION WEATHERSTRIP URETHANE FOAM




9 BUTT HINGE 12 GA. STEEL

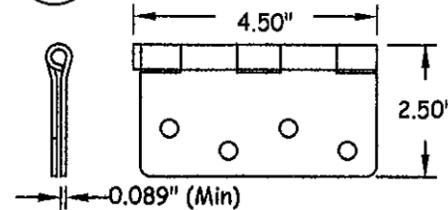


10 PARTIAL RAISED PANEL MAHOGANY WITH PLYWOOD CORE (SEE PANEL DETAIL 1, SHEET 8)

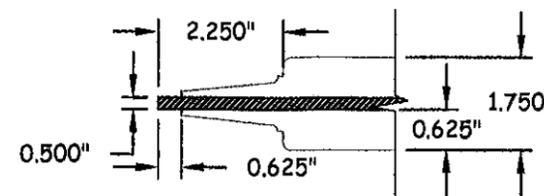


11 SURFACE BOLTS W/ STRIKE PLATE STAINLESS STEEL

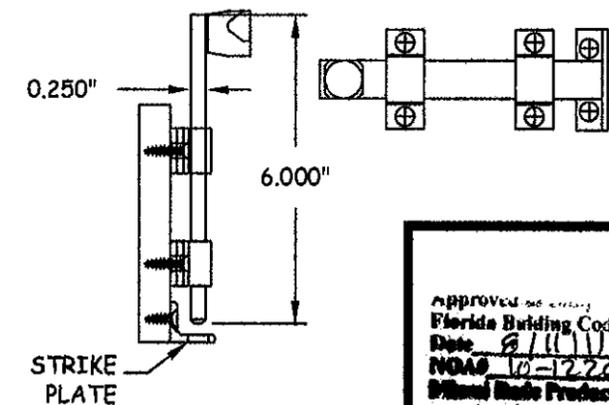

14 GLASS SPACER BUTYL RUBBER



15 GLASS STOP MAHOGANY



TITLE: GLAZED WOOD OUTSWING DOUBLE DOOR COMPONENTS & BOM
 PREPARED BY: CERTWORKS, LLC
 127 W. FAIRBANKS AVE., STE. 438
 WINTER PARK, FL 32789
 PH: (407) 644-6957 FX: (407) 644-2366


REVISIONS	DESCRIPTION	BY	DATE




Approved for Florida Building Code
 Date: 8/11/11
 DWG #: EXD003
 SHEET: 7 OF 9

DATE: 11.17.10
 DWN BY: JLA
 CHK BY: HFN
 SCALE: NTS


TITLE: GLAZED WOOD DOOR
CORNER SECTIONS & GLAZING DETAILS
PREPARED BY:
CERTWORKS, LLC
127 W. FAIRBANKS AVE., STE. 438
WINTER PARK, FL 32789
PH: (407) 644-6957 FX: (407) 644-2366

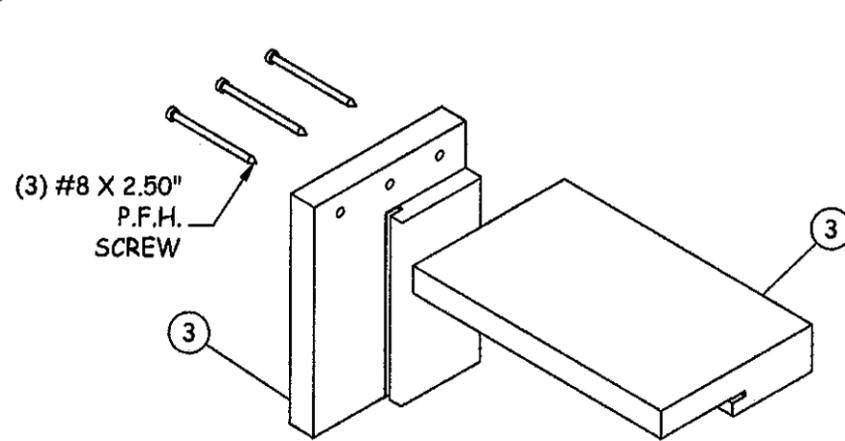


L
8
CORNER SECTION
RECTANGULAR FRAME TOP ASSEMBLY

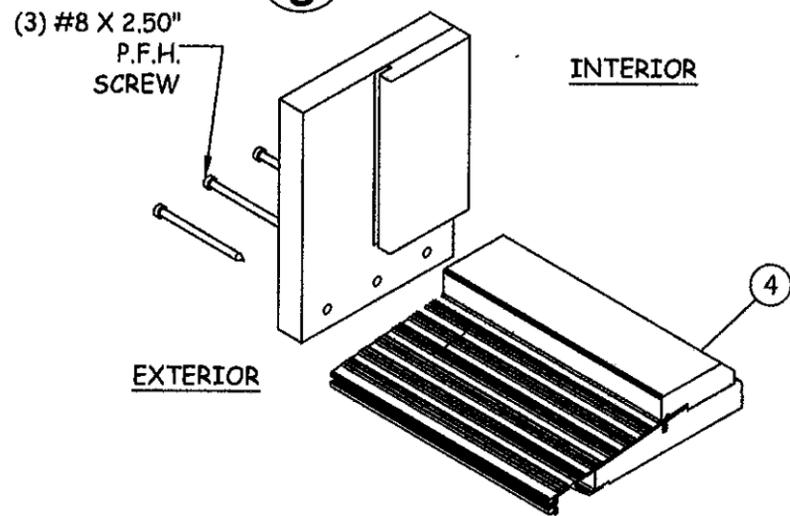


J
8
CORNER SECTION
FRAME BOTTOM ASSEMBLY

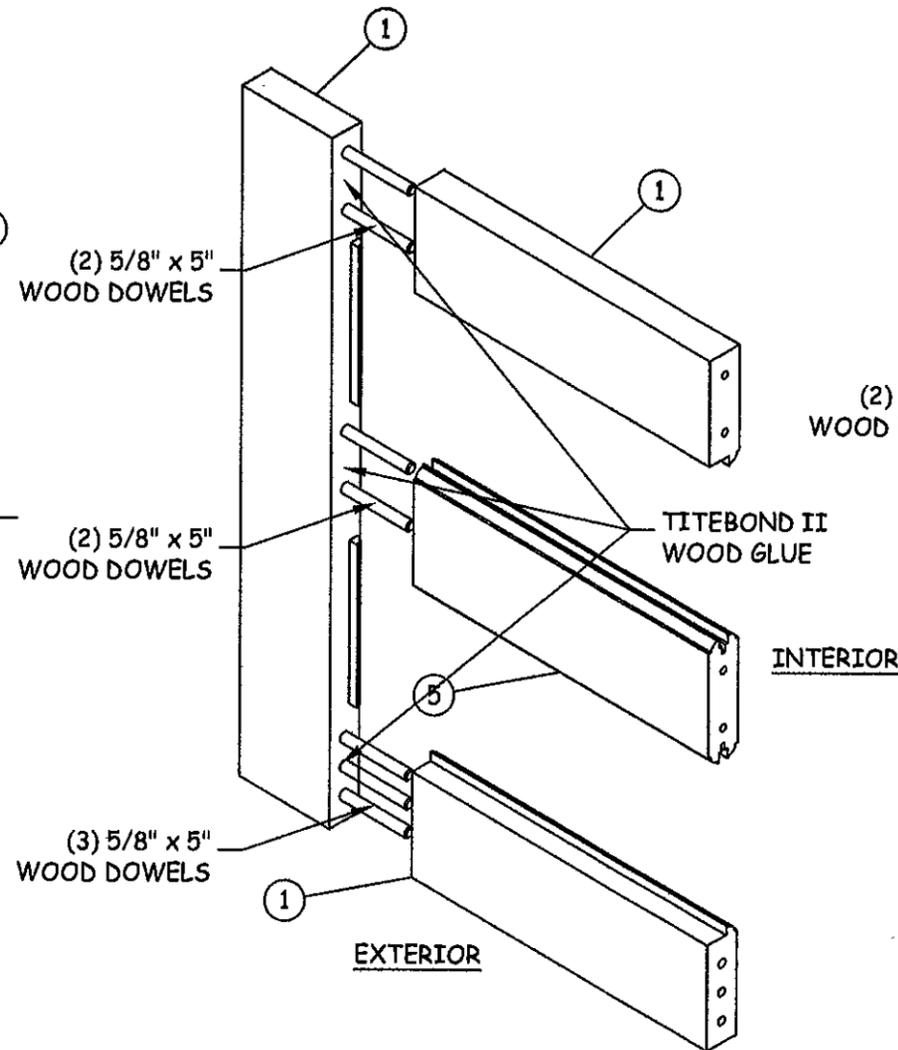

K
8
CORNER SECTION
PANEL ASSEMBLY, TYP.

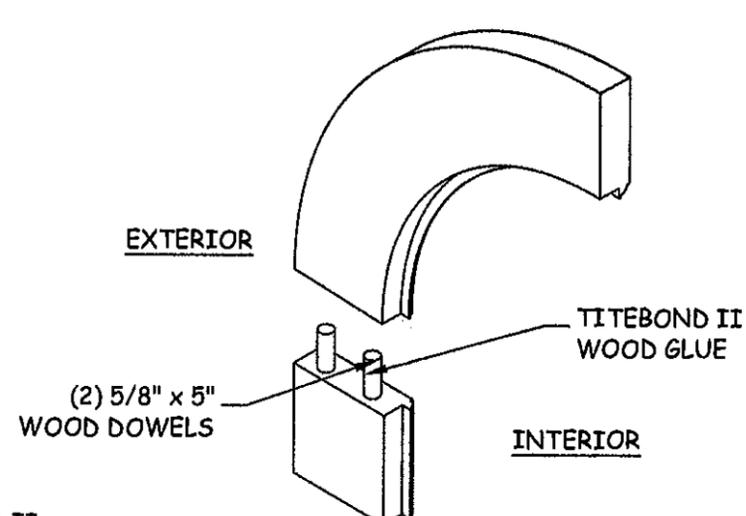


N
8
CORNER SECTION
CURVED PANEL ASSEMBLY, TYP.

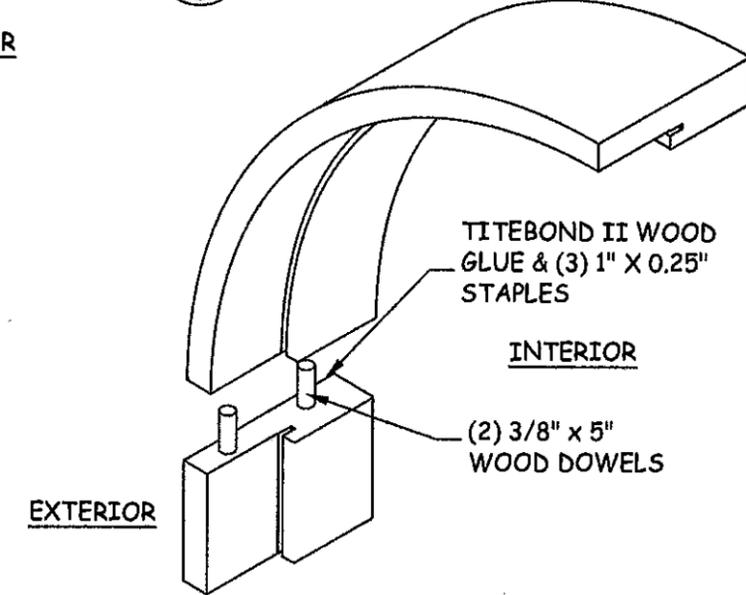


M
8
CORNER SECTION
CURVED FRAME ASSEMBLY, TYP.

BRAD NAIL SPACING AT GLAZING STOPS


- 2" FROM CORNER
- 12" MAX. O.C. ALL SIDES

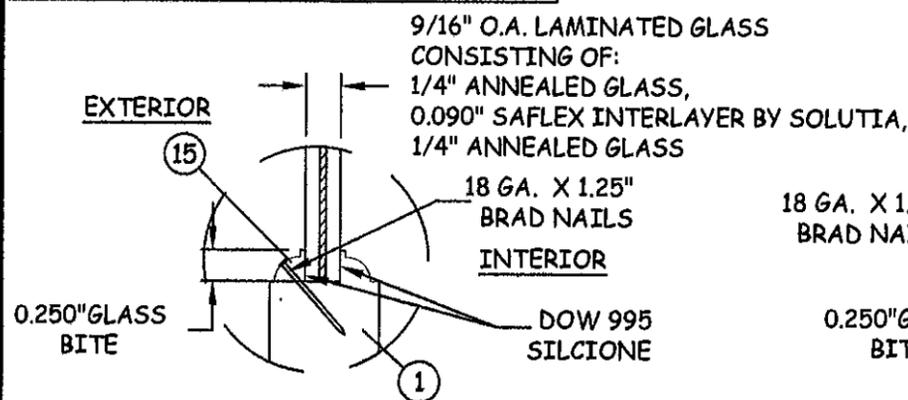

GLAZING DETAIL 1
9/16" ANNEALED LAMINATED GLASS

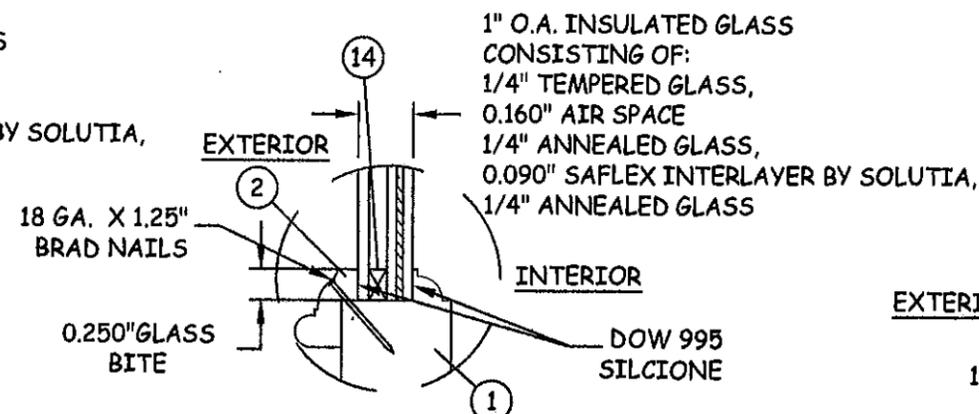

GLAZING DETAIL 2
1" ANNEALED INSULATED LAMINATED GLASS

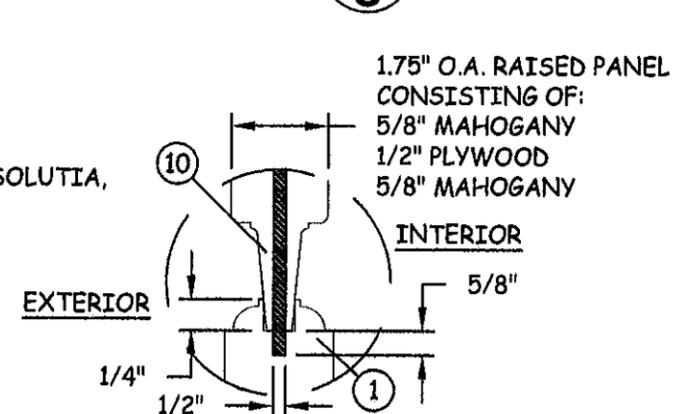

PANEL DETAIL 1
OPAQUE RAISED PANEL

REVISIONS

DESCRIPTION	BY	DATE

Approved as complying with the Florida Building Code
Date: 11.17.10
NOAS 10-1220-01
Florida State Product Control
By: *Ising J. Houde*

DATE: 11.17.10
DWN BY: JLA
CHK BY: HFN
SCALE: NTS

DWG #: **EXD003**
SHEET: 8 OF 9

