



**MIAMI-DADE COUNTY**  
**BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)**  
**BOARD AND CODE ADMINISTRATION DIVISION**

**MIAMI-DADE COUNTY, FLORIDA**  
**PRODUCT CONTROL SECTION**  
 11805 SW 26<sup>th</sup> Street, Room 208  
 Miami, Florida 33175-2474  
 T (786) 315-2590 F (786) 315-2599

[www.miamidade.gov/building](http://www.miamidade.gov/building)

**NOTICE OF ACCEPTANCE (NOA)**

**Sunshine Windows Manufacturing, Inc.**  
**1745 W. 33<sup>rd</sup> Place**  
**Hialeah, FL 33012**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Section and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "4302" Aluminum Fixed Window – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **PW08-01**, titled "Series 4302 Aluminum Fixed Window Impact Resistant", sheets 1 through 8 of 8, dated 08/18/08 with revision dated 01/24/11, prepared by Sunshine Windows Manufacturing, Inc., signed and sealed by Francisco Hernandez, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises NOA No. 08-0902.10** and consists of this page 1, evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



*J. Gascon*  
 2/2/11

**NOA No. 10-1221.01**  
**Expiration Date: September 11, 2013**  
**Approval Date: February 24, 2011**  
 Page 1

**Sunshine Windows Manufacturing, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **PW08-01**, titled "Series 4302 Aluminum Fixed Window Impact Resistant", sheets 1 through 8 of 8, dated 08/18/08 with revision dated 01/24/11, prepared by Sunshine Windows Manufacturing, Inc., signed and sealed by Francisco Hernandez, P. E.

**B. TESTS**

- 1.
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of aluminum arch, eyebrow and rectangular fixed windows, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3388**, dated August 14, 2002, signed and sealed by Joseph Chan, P.E. *(Submitted under previous NOA N° 03-0314.07)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Sunshine Windows Manufacturing, Inc., dated 12/17/10, signed, sealed and dated 01/26/11 by Franco Hernandez, P. E.  
**Complies with ASTM E1300-02/ 04**

**D. QUALITY ASSURANCE**

1. Miami-Dade Building and Neighborhood Compliance Department (BNC).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "**Saflex III G Clear or colored interlayer**" dated 05/04/06, expiring on 05/21/11.

**F. STATEMENTS**

1. Statement letter of compliance with the FBC-2007, dated February 02, 2011, signed and sealed by Franco Hernandez, P. E.
2. Statement letter of conformance, dated February 02, 2011, signed and sealed by Franco Hernandez, P. E.



Jaime D. Gascon, P. E.

Product Control Section Supervisor

NOA No. 10-1221.01

Expiration Date: September 11, 2013

Approval Date: February 24, 2011

Sunshine Windows Manufacturing, Inc.


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**F. STATEMENTS (CONTINUED)**

3. Statement letter of no financial interest, dated February 02, 2011, signed and sealed by Franco Hernandez, P. E.
4. Laboratory compliance letter for Test Report No. **FTL-3388**, issued by Fenestration Testing Laboratory, Inc., dated September 5, 2002, signed and sealed by Joseph Chan, P. E.  
*(Submitted under previous NOA N<sup>o</sup>. 03-0314.07)*

**G. OTHERS**


1. Notice of Acceptance No. **08-0902.10**, issued to Sunshine Windows Manufacturing, Inc. for their Series "**4302 Aluminum Fixed Window - L.M.I.**", approved on 10/23/08 and expiring on 09/11/13.



---

Jaime D. Gascon, P. E.  
Product Control Section Supervisor  
NOA No. 10-1221.01  
Expiration Date: September 11, 2013  
Approval Date: February 24, 2011

WINDOW SIZE L X S INCHES	DESIGN PRESSURE CHART - PSF				
	NUMBER OF ANCHORS			POS.	NEG.
	LONG SIDE	INCLINED SIDE	SHORT SIDE		
108 X 26	11	12	3	90.00	90.00
96 X 26	10	11	3	90.00	90.00
91 X 26	10	11	3	90.00	90.00
84 X 26	9	10	3	90.00	90.00
78 X 37	8	9	4	84.20	84.20
78 X 26	8	9	3	90.00	90.00
78 X 19	8	9	3	90.00	90.00
63 X 46	7	8	5	76.30	76.30
63 X 39	7	8	5	90.00	90.00
63 X 37	7	8	4	90.00	90.00
63 X 26	7	8	3	90.00	90.00
63 X 19	7	8	3	90.00	90.00
48 X 48	5	6	5	73.10	73.10
53 X 46	6	7	5	76.30	76.30
53 X 39	6	7	5	90.00	90.00
53 X 37	6	7	4	90.00	90.00
53 X 26	6	7	3	90.00	90.00
53 X 19	6	7	3	90.00	90.00
46 X 39	5	6	5	90.00	90.00
46 X 37	5	6	4	90.00	90.00
46 X 26	5	6	3	90.00	90.00
46 X 19	5	6	3	90.00	90.00
38 X 37	4	5	4	90.00	90.00
38 X 26	4	5	3	90.00	90.00
38 X 19	4	5	3	90.00	90.00
26 X 26	3	4	3	90.00	90.00
26 X 19	3	4	3	90.00	90.00
74 X 39	8	9	5	87.20	87.20
74 X 37	8	9	4	90.00	90.00
74 X 26	8	9	3	90.00	90.00
74 X 19	8	9	3	90.00	90.00

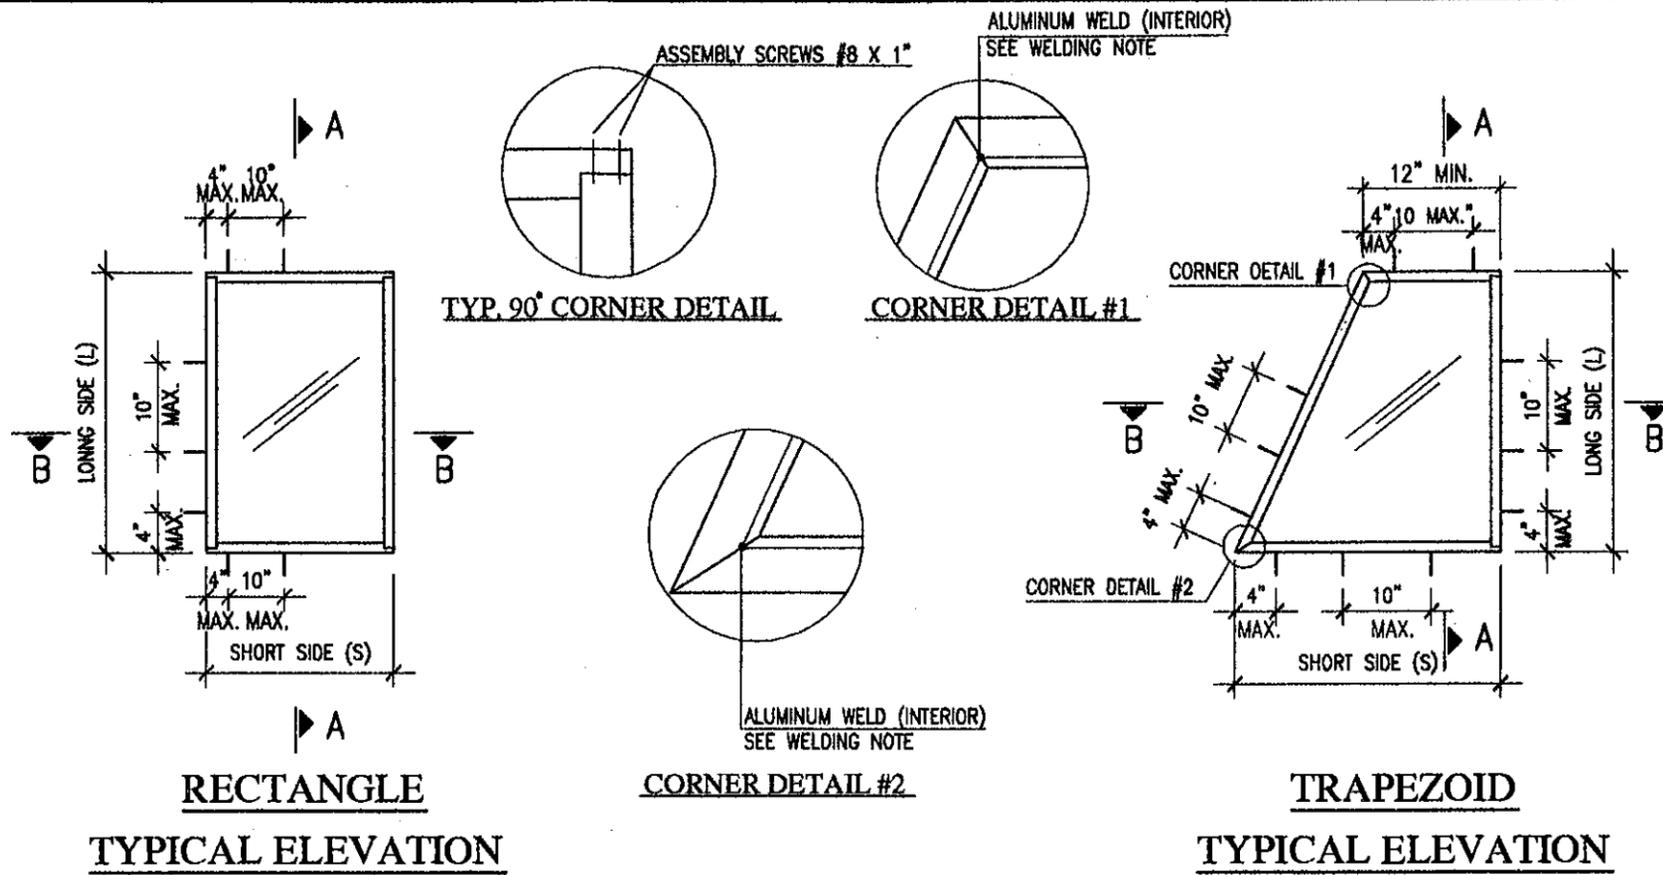

**ANCHORS:**

1. FOR CONNECTION TO CONCRETE BLOCK USE 1/4" ELCO ULTRACON WITH 1 1/2" MINIMUM EMBEDMENT INTO WALL.
2. FOR CONNECTION TO METAL STRUCTURE USE 1/4" SMS GRADE 5. STEEL MATERIAL SHALL CONFORM TO ASTM A500, A653 OR A36 WITH 1/8" MINIMUM WALL THICKNESS. ALUMINUM ALLOY 6063-T5 WITH 1/8" MINIMUM WALL THICKNESS.
3. FOR CONNECTION TO 2BY WOOD BUCK OR WOOD STRUCTURE USE 1/4" ELCO ULTRACON WITH 1 1/2" MINIMUM EMBEDMENT INTO WOOD.
4. THIS PRODUCT MEETS THE REQUIREMENTS OF THE 2007 FLORIDA BUILDING CODE.

**GLASS:**

0.34" OVERALL LAMINATED GLASS USING TWO LITES OF 1/8" HEAT STRENGTHENED GLASS WITH A 0.090 SAFLEX IIIIG INTERLAYER FILM BY SOLUTIA.

**WELDING:**

FOR CORNER WELDED CONNECTIONS USE 1/8" FILLET WELD WITH 1 1/4" MINIMUM LENGTH MADE WITH ER4043 FILLER ALLOY.

**Sunshine Windows Manufacturing, Inc.**  
 1745 W. 33rd Place  
 Hialeah, Florida 33012  
 Ph: (305)364-9952  
 Fax: (305)828-5118

**SERIES 4302 ALUMINUM  
 FIXED WINDOW IMPACT RESISTANT**

Drawn By: **NM**  
 Date: **08-18-08**  
 Scale: **1/2" = 1'**  
 Revision: **01-24-11**  
 Revision:




DRAWING NO.  
**PW08-01**

SHEET  
**1 OF 8**

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No **10-1221.01**  
 Expiration Date **09/11/2013**  
 By *[Signature]*  
 Miami Dade Product Control

*[Signature]*  
**1-26-11**  
 FRANCISCO HERNANDEZ  
 FLORIDA PE # 51393

WINDOW SIZE L X S INCHES	DESIGN PRESSURE CHART - PSF				
	NUMBER OF ANCHORS			POS.	NEG.
	LONG SIDE	INCLINED SIDE	SHORT SIDE		
108 X 26	11	12	3	90.00	90.00
96 X 26	10	11	3	90.00	90.00
91 X 26	10	11	3	90.00	90.00
84 X 26	9	10	3	90.00	90.00
78 X 37	8	9	4	84.20	84.20
78 X 26	8	9	3	90.00	90.00
78 X 19	8	9	3	90.00	90.00
63 X 46	7	8	5	76.30	76.30
63 X 39	7	8	5	90.00	90.00
63 X 37	7	8	4	90.00	90.00
63 X 26	7	8	3	90.00	90.00
63 X 19	7	8	3	90.00	90.00
48 X 48	5	6	5	73.10	73.10
53 X 46	6	7	5	76.30	76.30
53 X 39	6	7	5	90.00	90.00
53 X 37	6	7	4	90.00	90.00
53 X 26	6	7	3	90.00	90.00
53 X 19	6	7	3	90.00	90.00
46 X 39	5	6	5	90.00	90.00
46 X 37	5	6	4	90.00	90.00
46 X 26	5	6	3	90.00	90.00
46 X 19	5	6	3	90.00	90.00
38 X 37	4	5	4	90.00	90.00
38 X 26	4	5	3	90.00	90.00
38 X 19	4	5	3	90.00	90.00
26 X 26	3	4	3	90.00	90.00
26 X 19	3	4	3	90.00	90.00
74 X 39	8	9	5	87.20	87.20
74 X 37	8	9	4	90.00	90.00
74 X 26	8	9	3	90.00	90.00
74 X 19	8	9	3	90.00	90.00

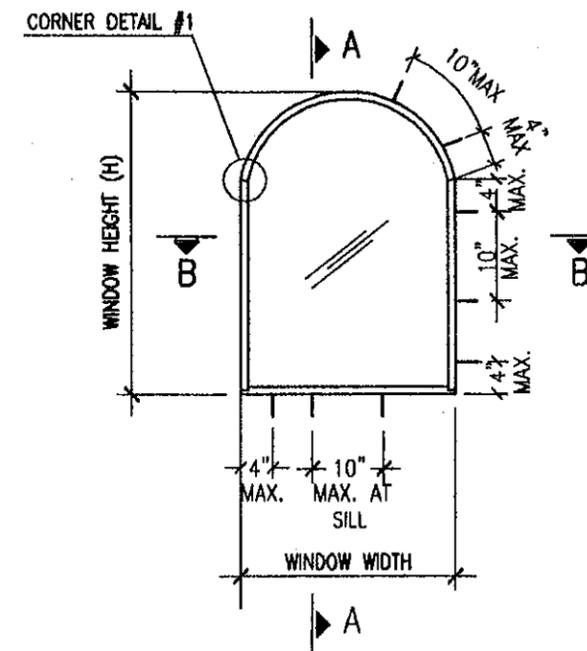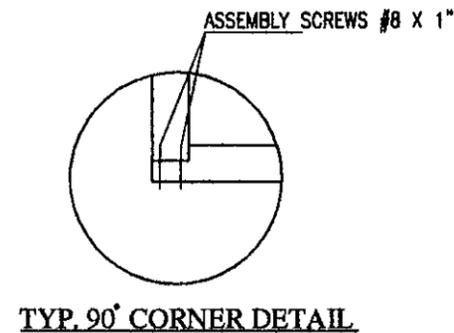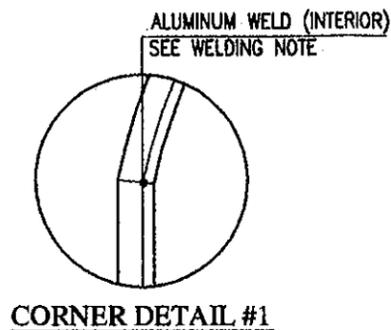

**ANCHORS:**

1. FOR CONNECTION TO CONCRETE BLOCK USE 1/4" ELCO ULTRACON WITH 1 1/2" MINIMUM EMBEDMENT INTO WALL.
2. FOR CONNECTION TO METAL STRUCTURE USE 1/4" SMS GRADE 5. STEEL MATERIAL SHALL CONFORM TO ASTM A500, A653 OR A36 WITH 1/8" MINIMUM WALL THICKNESS. ALUMINUM ALLOY 6063-T5 WITH 1/8" MINIMUM WALL THICKNESS.
3. FOR CONNECTION TO 2BY WOOD BUCK OR WOOD STRUCTURE USE 1/4" ELCO ULTRACON WITH 1 1/2" MINIMUM EMBEDMENT INTO WOOD.
4. THIS PRODUCT MEETS THE REQUIREMENTS OF THE 2007 FLORIDA BUILDING CODE.

**GLASS:**

0.34" OVERALL LAMINATED GLASS USING TWO LITES OF 1/8" HEAT STRENGTHENED GLASS WITH A 0.090 SAFLEX III G INTERLAYER FILM BY SOLUTIA.

**WELDING:**

FOR CORNER WELDED CONNECTIONS USE 1/8" FILLET WELD WITH 1 1/4" MINIMUM LENGTH MADE WITH ER4043 FILLER ALLOY.

Sunshine Windows  
Manufacturing, Inc.  
1745 W. 33rd Place  
Hialeah, Florida 33012  
Ph: (305)384-8852  
Fax: (305)828-5118

SERIES 4302 ALUMINUM  
FIXED WINDOW IMPACT RESISTANT

Drawn By: NM  
Date: 08-18-08  
Scale: 1/2"=1'  
Revision: 01-24-11  
Revision:




DRAWING NO.  
PW08-01

SHEET  
2 OF 8

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 10-122101  
Expiration Date 09/13/2011  
By Francisco Hernandez  
Miami Dade Product Control

1-26-11  
FRANCISCO HERNANDEZ  
FLORIDA PE # 51393

WINDOW SIZE L X S INCHES	DESIGN PRESSURE CHART - PSF				
	NUMBER OF ANCHORS			POS.	NEG.
	LONG SIDE	INCLINED SIDE	SHORT SIDE		
108 X 26	11	12	3	90.00	90.00
96 X 26	10	11	3	90.00	90.00
91 X 26	10	11	3	90.00	90.00
84 X 26	9	10	3	90.00	90.00
78 X 37	8	9	4	84.20	84.20
78 X 26	8	9	3	90.00	90.00
78 X 19	8	9	3	90.00	90.00
63 X 46	7	8	5	76.30	76.30
63 X 39	7	8	5	90.00	90.00
63 X 37	7	8	4	90.00	90.00
63 X 26	7	8	3	90.00	90.00
63 X 19	7	8	3	90.00	90.00
48 X 48	5	6	5	73.10	73.10
53 X 46	6	7	5	76.30	76.30
53 X 39	6	7	5	90.00	90.00
53 X 37	6	7	4	90.00	90.00
53 X 26	6	7	3	90.00	90.00
53 X 19	6	7	3	90.00	90.00
46 X 39	5	6	5	90.00	90.00
46 X 37	5	6	4	90.00	90.00
46 X 26	5	6	3	90.00	90.00
46 X 19	5	6	3	90.00	90.00
38 X 37	4	5	4	90.00	90.00
38 X 26	4	5	3	90.00	90.00
38 X 19	4	5	3	90.00	90.00
26 X 26	3	4	3	90.00	90.00
26 X 19	3	4	3	90.00	90.00
74 X 39	8	9	5	87.20	87.20
74 X 37	8	9	4	90.00	90.00
74 X 26	8	9	3	90.00	90.00
74 X 19	8	9	3	90.00	90.00

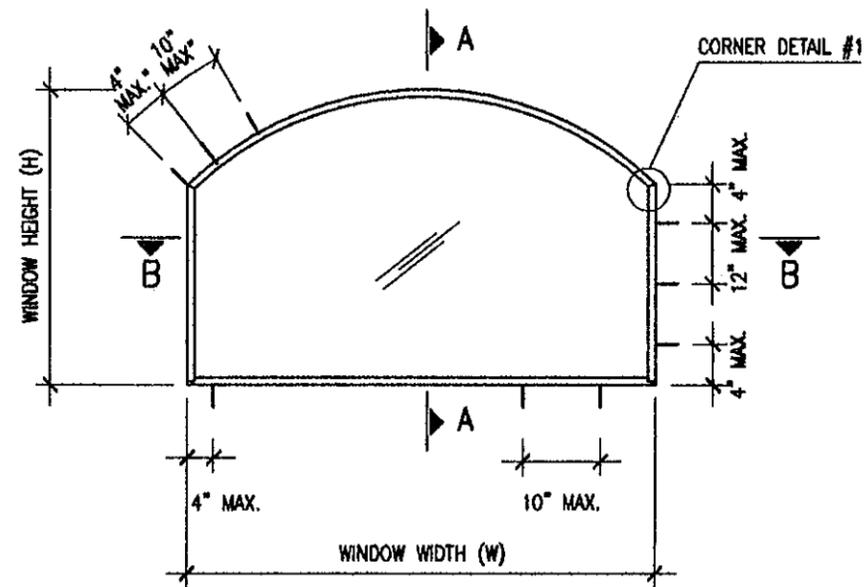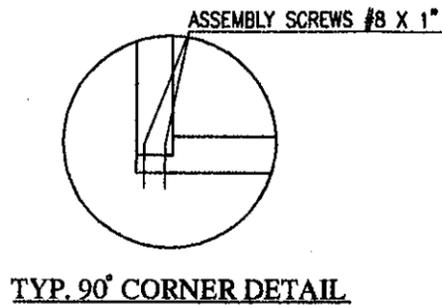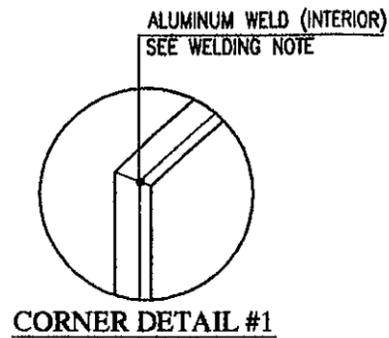

**ANCHORS:**

1. FOR CONNECTION TO CONCRETE BLOCK USE 1/4" ELCO ULTRACON WITH 1 1/2" MINIMUM EMBEDMENT INTO WALL.
2. FOR CONNECTION TO METAL STRUCTURE USE 1/4" SMS GRADE 5. STEEL MATERIAL SHALL CONFORM TO ASTM A500, A653 OR A36 WITH 1/8" MINIMUM WALL THICKNESS. ALUMINUM ALLOY 6063-T5 WITH 1/8" MINIMUM WALL THICKNESS.
3. FOR CONNECTION TO 2BY WOOD BUCK OR WOOD STRUCTURE USE 1/4" ELCO ULTRACON WITH 1 1/2" MINIMUM EMBEDMENT INTO WOOD.
4. THIS PRODUCT MEETS THE REQUIREMENTS OF THE 2007 FLORIDA BUILDING CODE.

**GLASS:**

0.34" OVERALL LAMINATED GLASS USING TWO LITES OF 1/8" HEAT STRENGTHENED GLASS WITH A 0.090 SAFLEX III INTERLAYER FILM BY SOLUTIA.

**WELDING:**

FOR CORNER WELDED CONNECTIONS USE 1/8" FILLET WELD WITH 1 1/4" MINIMUM LENGTH MADE WITH ER4043 FILLER ALLOY.

Sunshine Windows  
Manufacturing, Inc.  
1745 W. 33rd Place  
Hialeah, Florida 33012  
Ph: (305)364-9952  
Fax: (305)828-5118

SERIES 4302 ALUMINUM  
FIXED WINDOW IMPACT RESISTANT

Drawn By: NM  
Date: 08-18-08  
Scale: 1/2"=1'  
Revision: 01-24-11  
Revision:


DRAWING NO.  
PW08-01

SHEET  
3 OF 8

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 10-1221-01  
Expiration Date 09/1/2011  
By Francisco Hernandez  
Miami Dade Product Control

*Francisco Hernandez*  
1-26-11  
FRANCISCO HERNANDEZ  
FLORIDA PE # 51393

WINDOW SIZE W X H INCHES	DESIGN PRESSURE CHART - PSF			
	NUMBER OF ANCHORS		POS.	NEG.
	SILL	ARCH		
108 X 26	11	14	90.00	90.00
96 X 26	10	13	90.00	90.00
91 X 26	10	13	90.00	90.00
84 X 26	9	12	90.00	90.00
78 X 37	8	14	84.20	84.20
78 X 26	8	12	90.00	90.00
78 X 19	8	11	90.00	90.00
63 X 32	7	12	90.00	90.00
63 X 26	7	10	90.00	90.00
63 X 19	7	9	90.00	90.00
48 X 24	5	9	90.00	90.00
53 X 27	6	10	90.00	90.00
53 X 19	6	8	90.00	90.00
46 X 23	5	9	90.00	90.00
46 X 19	5	8	90.00	90.00
38 X 19	4	7	90.00	90.00
26 X 13	3	5	90.00	90.00
74 X 37	8	14	90.00	90.00
74 X 26	8	11	90.00	90.00
74 X 19	8	10	90.00	90.00

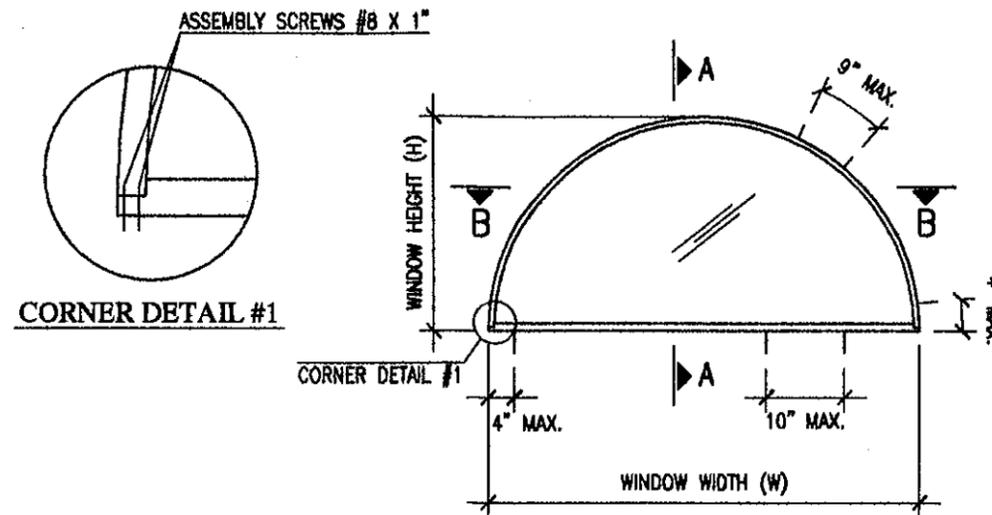

**ARCH  
TYPICAL ELEVATION**

**ANCHORS:**


1. FOR CONNECTION TO CONCRETE BLOCK USE 1/4" ELCO ULTRACON WITH 1 1/2" MINIMUM EMBEDMENT INTO WALL.
2. FOR CONNECTION TO METAL STRUCTURE USE 1/4" SMS GRADE 5. STEEL MATERIAL SHALL CONFORM TO ASTM A500, A653 OR A36 WITH 1/8" MINIMUM WALL THICKNESS. ALUMINUM ALLOY 6063-T5 WITH 1/8" MINIMUM WALL THICKNESS.
3. FOR CONNECTION TO 2BY WOOD BUCK OR WOOD STRUCTURE USE 1/4" ELCO ULTRACON WITH 1 1/2" MINIMUM EMBEDMENT INTO WOOD.
4. THIS PRODUCT MEETS THE REQUIREMENTS OF THE 2007 FLORIDA BUILDING CODE.

**GLASS:**

0.34" OVERALL LAMINATED GLASS USING TWO LITES OF 1/8" HEAT STRENGTHENED GLASS WITH A 0.090 SAFLEX III G INTERLAYER FILM BY SOLUTIA.

**WELDING:**

FOR CORNER WELDED CONNECTIONS USE 1/8" FILLET WELD WITH 1 1/4" MINIMUM LENGTH MADE WITH ER4043 FILLER ALLOY.



Sunshine Windows  
Manufacturing, Inc.  
1745 W. 33rd Place  
Hialeah, Florida 33012  
Ph: (305)364-9952  
Fax: (305)828-5118


**SERIES 4302 ALUMINUM  
FIXED WINDOW IMPACT RESISTANT**

Drawn By: **NM**  
Date: **08-18-08**  
Scale: **1/2"=1'**  
Revision: **01-24-11**  
Revision:

DRAWING NO.  
**PW08-01**

SHEET  
**4 OF 8**

PRODUCT REVISED as complying with the Florida Building Code Acceptance No <b>10-1221-01</b> Expiration Date <b>07/11/2015</b> By <i>[Signature]</i> Miami Dade Product Control	
--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--




Sunshine Windows  
Manufacturing, Inc.  
1745 W. 33rd Place  
Hialeah, Florida 33012  
Ph: (305)364-9952  
Fax: (305)828-5118

SERIES 4302 ALUMINUM  
FIXED WINDOW IMPACT RESISTANT

Drawn By: NM  
Date: 08-18-08  
Scale: 1/2"=1'  
Revision: 01-24-11  
Revision:

DRAWING NO.  
PW08-01


SHEET  
5 OF 8

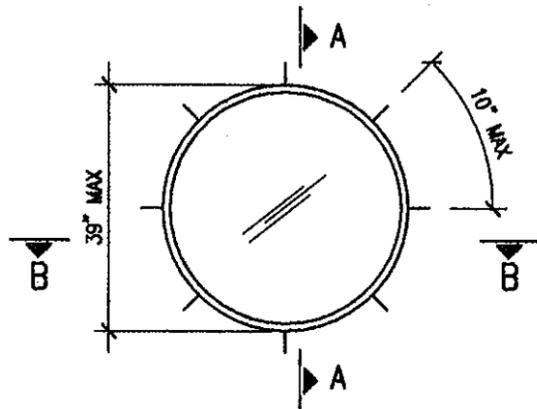


**FULL ROUND**  
**TYPICAL ELEVATION**

**DESIGN PRESSURES**


POSITIVE = +90.00 PSF  
NEGATIVE = -90.00 PSF

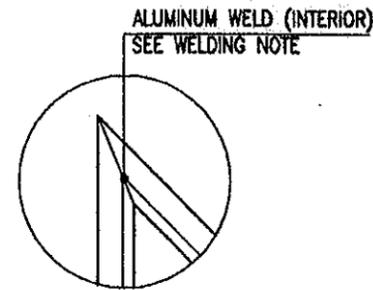

**CORNER DETAIL #1**

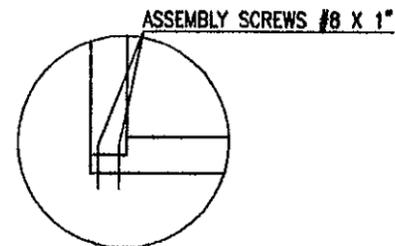


**TYP. 90° CORNER DETAIL**

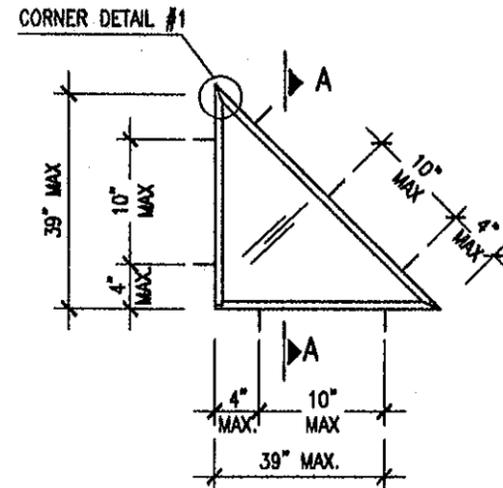


**TRIANGLE**  
**TYPICAL ELEVATION**

**DESIGN PRESSURES**

POSITIVE = +90.00 PSF  
NEGATIVE = -90.00 PSF

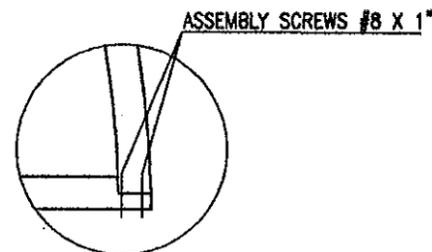

**CORNER DETAIL #2**

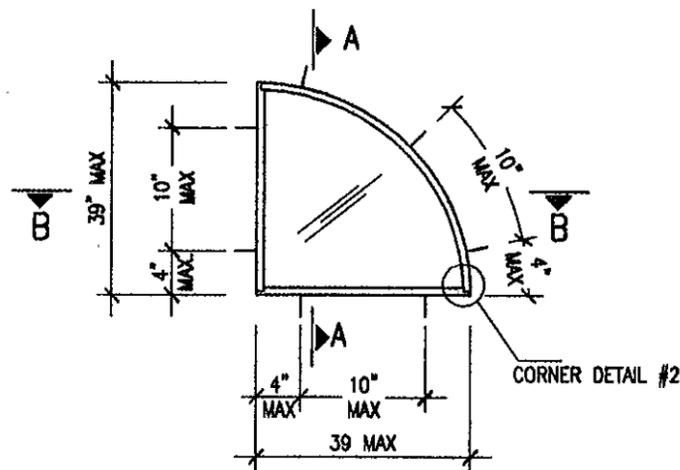

**QUARTER ROUND**  
**TYPICAL ELEVATION**

**DESIGN PRESSURES**

POSITIVE = +90.00 PSF  
NEGATIVE = -90.00 PSF

**ANCHORS:**

1. FOR CONNECTION TO CONCRETE BLOCK USE 1/4" ELCO ULTRACON WITH 1 1/2" MINIMUM EMBEDMENT INTO WALL.
2. FOR CONNECTION TO METAL STRUCTURE USE 1/4" SMS GRADE 5. STEEL MATERIAL SHALL CONFORM TO ASTM A500, A653 OR A36 WITH 1/8" MINIMUM WALL THICKNESS. ALUMINUM ALLOY 6063-T5 WITH 1/8" MINIMUM WALL THICKNESS.
3. FOR CONNECTION TO 2BY WOOD BUCK OR WOOD STRUCTURE USE 1/4" ELCO ULTRACON WITH 1 1/2" MINIMUM EMBEDMENT INTO WOOD.
4. THIS PRODUCT MEETS THE REQUIREMENTS OF THE 2007 FLORIDA BUILDING CODE.

**GLASS:**


0.34" OVERALL LAMINATED GLASS USING TWO LITES OF 1/8" HEAT STRENGTHENED GLASS WITH A 0.090 SAFLEX III INTERLAYER FILM BY SOLUTIA.

**WELDING:**

FOR CORNER WELDED CONNECTIONS USE 1/8" FILLET WELD WITH 1 1/4" MINIMUM LENGTH MADE WITH ER4043 FILLER ALLOY.

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 10-1221-01  
Expiration Date 09/11/20  
By *[Signature]*  
Miami Dade Product Control


*[Signature]*  
1-26-11  
FRANCISCO HERNANDEZ  
FLORIDA PE # 51393

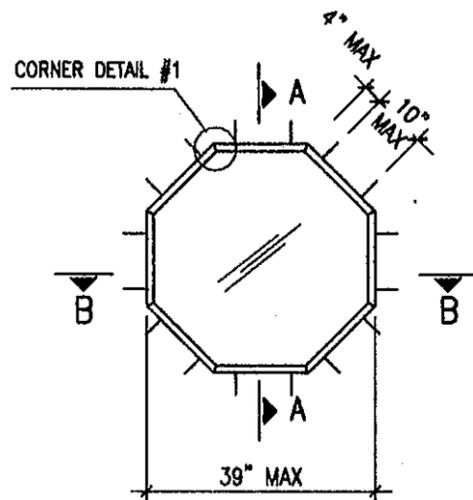


**OCTAGON  
TYPICAL ELEVATION**

**DESIGN PRESSURES**

POSITIVE = +90.00 PSF  
NEGATIVE = -90.00 PSF

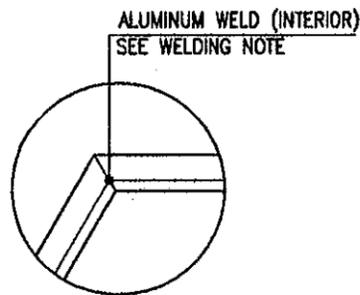

**CORNER DETAIL #1**

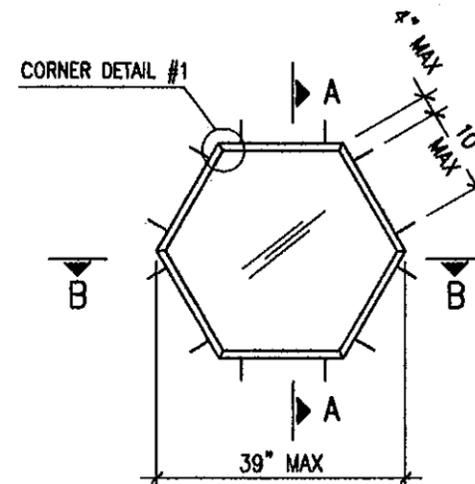

**HEXAGON  
TYPICAL ELEVATION**

**DESIGN PRESSURES**

POSITIVE = +90.00 PSF  
NEGATIVE = -90.00 PSF

**ANCHORS:**


1. FOR CONNECTION TO CONCRETE BLOCK USE 1/4" ELCO ULTRACON WITH 1 1/2" MINIMUM EMBEDMENT INTO WALL.
2. FOR CONNECTION TO METAL STRUCTURE USE 1/4" SMS GRADE 5. STEEL MATERIAL SHALL CONFORM TO ASTM A500, A653 OR A36 WITH 1/8" MINIMUM WALL THICKNESS. ALUMINUM ALLOY 6063-T5 WITH 1/8" MINIMUM WALL THICKNESS.
3. FOR CONNECTION TO 2BY WOOD BUCK OR WOOD STRUCTURE USE 1/4" ELCO ULTRACON WITH 1 1/2" MINIMUM EMBEDMENT INTO WOOD.
4. THIS PRODUCT MEETS THE REQUIREMENTS OF THE 2007 FLORIDA BUILDING CODE.

**GLASS:**

0.34" OVERALL LAMINATED GLASS USING TWO LITES OF 1/8" HEAT STRENGTHENED GLASS WITH A 0.090 SAFLEX IIIIG INTERLAYER FILM BY SOLUTIA.

**WELDING:**

FOR CORNER WELDED CONNECTIONS USE 1/8" FILLET WELD WITH 1 1/4" MINIMUM LENGTH MADE WITH ER4043 FILLER ALLOY.



Sunshine Windows  
Manufacturing, Inc.  
1745 W. 33rd Place  
Hialeah, Florida 33012  
Ph: (305)364-9852  
Fax: (305)828-5118

**SERIES 4302 ALUMINUM  
FIXED WINDOW IMPACT RESISTANT**


Drawn By: NM  
Date: 08-18-08  
Scale: 1/2"=1'  
Revision: 01-24-11  
Revision:

DRAWING NO.  
PW08-01


SHEET  
6 OF 8

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 10-1211-01  
Expiration Date 09/11/2018  
By: *[Signature]*  
Miami Dade Product Control


*[Signature]*  
1-26-11  
FRANCISCO HERNANDEZ  
FLORIDA PE # 51393

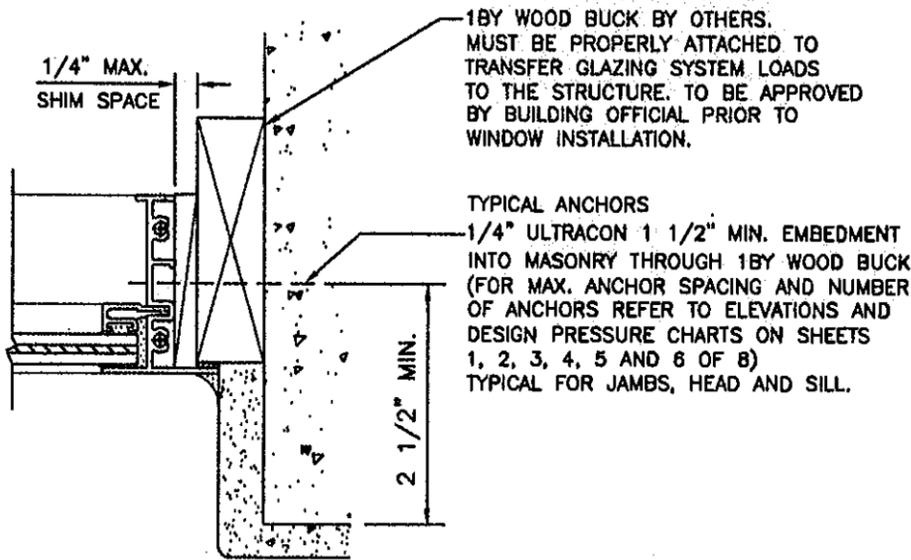


ATTACHMENT TO MASONRY

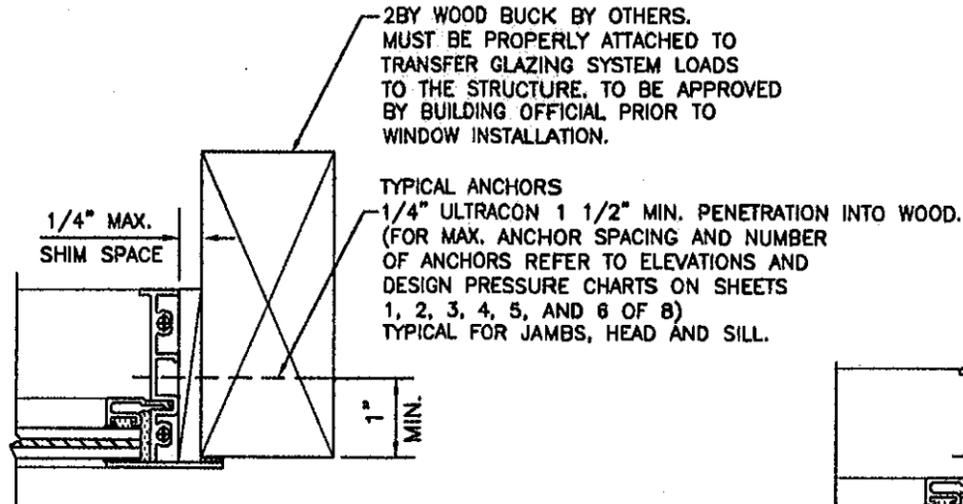


ATTACHMENT TO WOOD

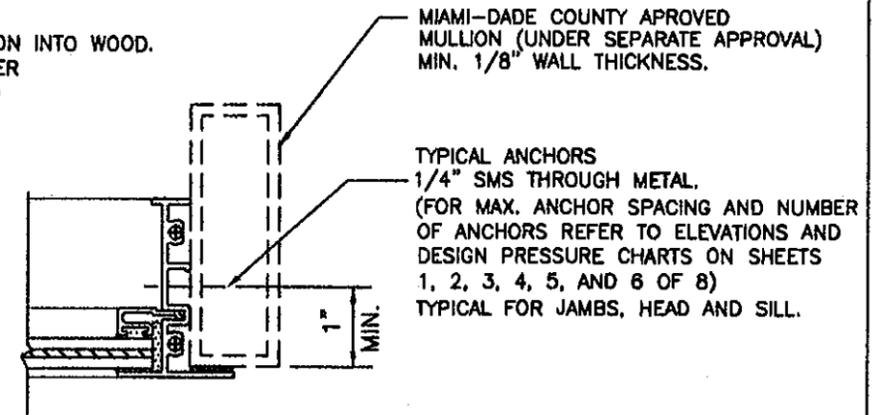


ATTACHMENT TO MULLION DETAIL

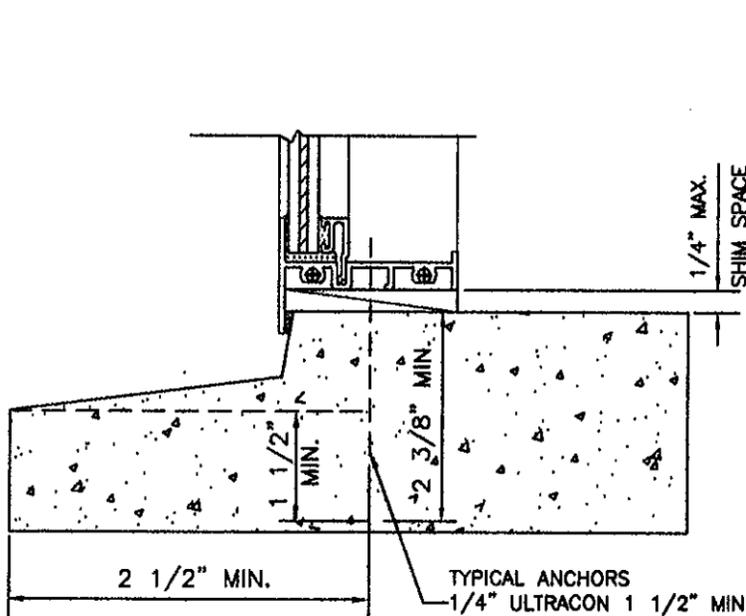

ATTACHMENT TO PRE-CAST SILL

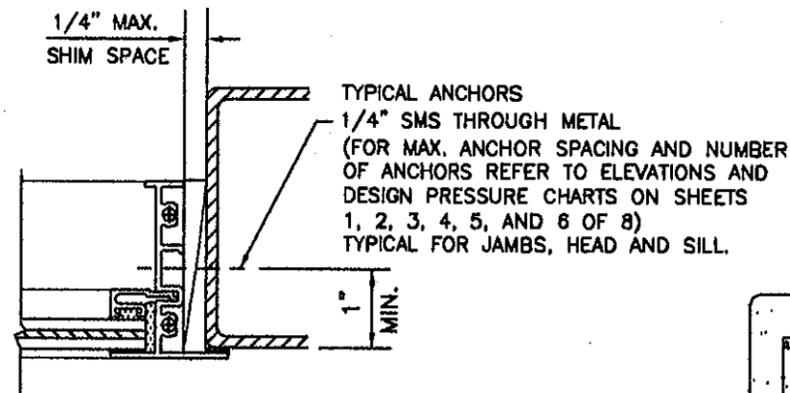


ATTACHMENT TO METAL STRUCTURE  
(STEEL OR ALUMINUM 1/8" MIN. THICKNESS)

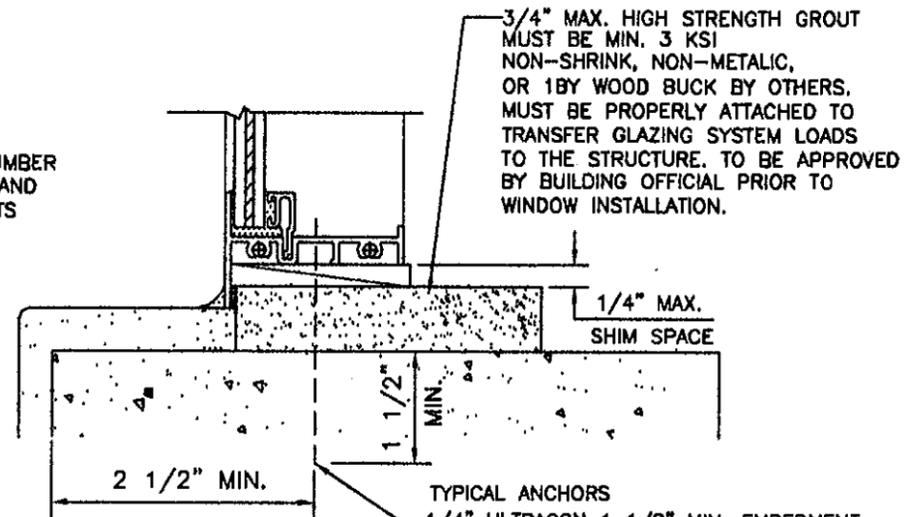

ATTACHMENT TO MASONRY

TYPICAL SECTIONS



Sunshine Windows  
Manufacturing, Inc.  
1745 W. 33rd Place  
Hialeah, Florida 33012  
Ph: (305)364-8952  
Fax: (305)828-5118

SERIES 4302 ALUMINUM  
FIXED WINDOW IMPACT RESISTANT


Drawn By: NM  
Date: 08-18-08  
Scale: 1/2"=1'  
Revision: 01-24-11  
Revision:

DRAWING NO.  
PW08-01


SHEET  
7 OF 8

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 10-1221.01  
Expiration Date 09/11/2013  
By: *[Signature]*  
Miami Dade Product Control

*[Signature]*  
1-26-11  
FRANCISCO HERNANDEZ  
FLORIDA PE # 51393

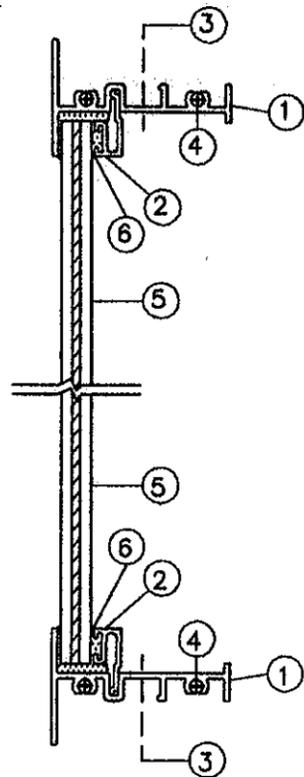


**SECTION A - A**

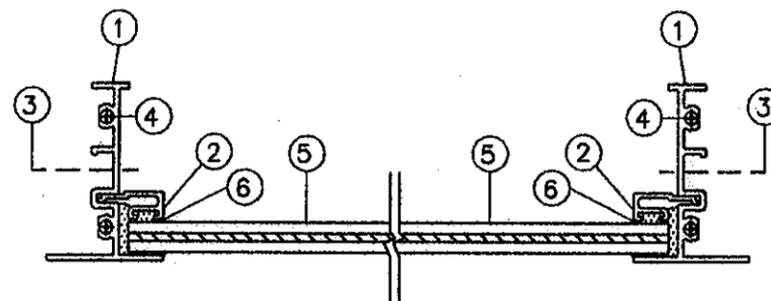


**SECTION B - B**

**GLAZING DETAIL**

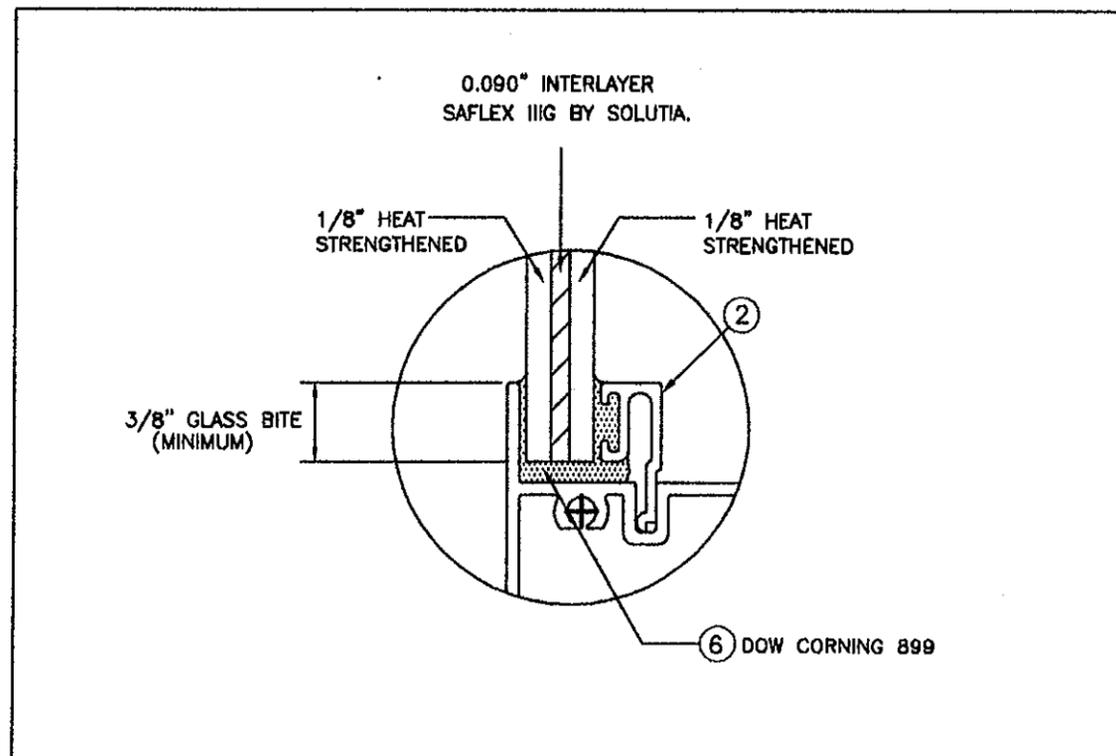

**MATERIAL LIST**


ITEM #	PART	DESCRIPTION	MATERIAL
1	SW-101	HEAD, SILL AND JAMB	6063-T6
2	SSW-101	GLAZING BEAD	6063-T6
3	ANCHORS	SEE ELEVATION SHEETS	
4	# 8" X 1" PH S.M.S	ASSEMBLY SCREW	
5	.340" (11/32") LAMINATED GLASS/HEAT STR.	SEE GLAZING DETAIL SHEET 8	
6	-	STRUCTURAL SILICONE	DOW CORNING 899

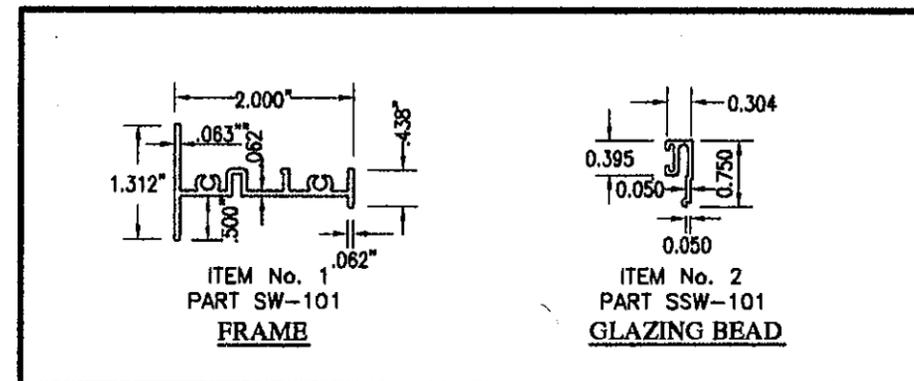

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 10-1221/01  
Expiration Date 09/11/13

By *Francisco Hernandez*  
Miami Dade Product Control

*Francisco Hernandez*  
1-26-11  
FRANCISCO HERNANDEZ  
FLORIDA PE # 51393



Sunshine Windows  
Manufacturing, Inc.  
1745 W. 33rd Place  
Hialeah, Florida 33012  
Ph: (305)364-9852  
Fax: (305)828-5118

SERIES 4302 ALUMINUM  
FIXED WINDOW IMPACT RESISTANT

Drawn By: NM  
Date: 08-18-08  
Scale: 1/2"=1'  
Revision: 01-24-11  
Revision:

DRAWING NO.  
PW08-01

SHEET  
8 OF 8