



BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION
11805 SW 26th Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/building

NOTICE OF ACCEPTANCE (NOA)

Arch Windows, LLC d/b/a AWP
8130 NW 74th Avenue
Medley, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County BNC-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BNC reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "6900" Aluminum Horizontal Sliding Window - L.M.I.

APPROVAL DOCUMENT: Drawing No. W10-78, titled "Series 6900 Alum. Horizontal Sliding Wdw. (L.M.I.)", sheets 1 through 6 of 6, dated 11/18/10 with revision "A" dated 03/23/11, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and Approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/ series and following statement: "Miami-Dade County Product Control Approved" unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1, evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
4/13/11

NOA No. 11-0107.08
Expiration Date: April 21, 2016
Approval Date: April 21, 2011
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W10-78**, titled "Series 6900 Alum. Horizontal Sliding Wdw. (L.M.I.)", sheets 1 through 6 of 6, dated 11/18/10 with revision "**A**" dated 03/23/11, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of single hung window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-6263**, dated 10/14/2010, signed and sealed by Jorge A. Causo, P.E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, dated 12/01/2010, prepared by Al-Farooq Corporation, signed, sealed and dated 03/04/2011 by Javad Ahmad, P. E.
Complies with ASTM E1300-04

D. QUALITY ASSURANCE

1. Miami-Dade Building and Neighborhood Compliance Department (BNC).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their "**Saflex III G Clear or colored interlayer**" dated 05/04/06, expiring on 05/21/11.

E. STATEMENTS



1. Statement letter of no financial interest, conformance and compliance with the FBC 2007, dated April 30, 2010, signed and sealed by Javad Ahmad, P. E.
2. Laboratory compliance letter for Test Report No. **FTL-6263**, issued by Fenestration Testing Laboratory, Inc., dated 10/14/2010, signed and sealed by Jorge A. Causo, P. E.
3. Proposal issued by BCCO, dated 03/08/2010, signed by Manuel Perez, P. E.

F. OTHERS

1. None.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 11-0107.08
Expiration Date: April 21, 2016
Approval Date: April 21, 2011

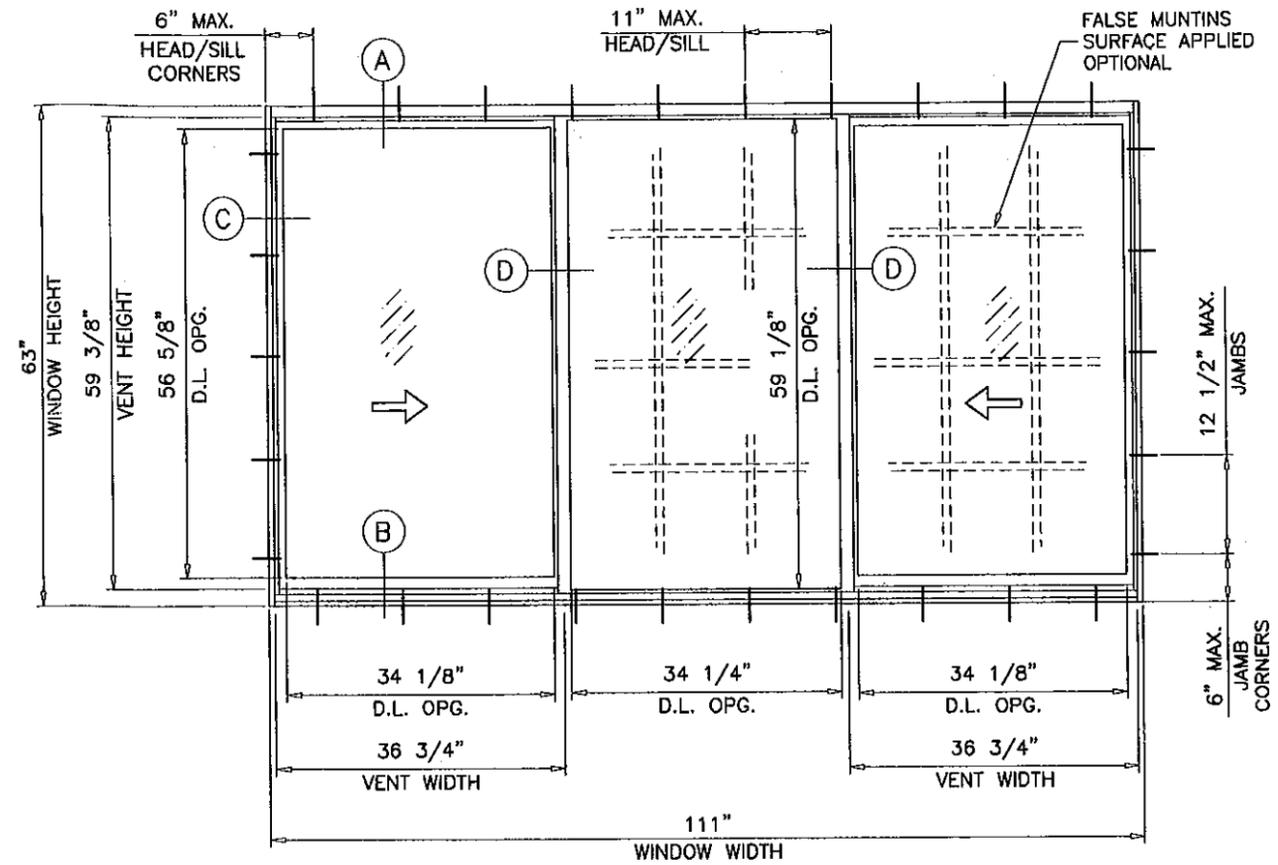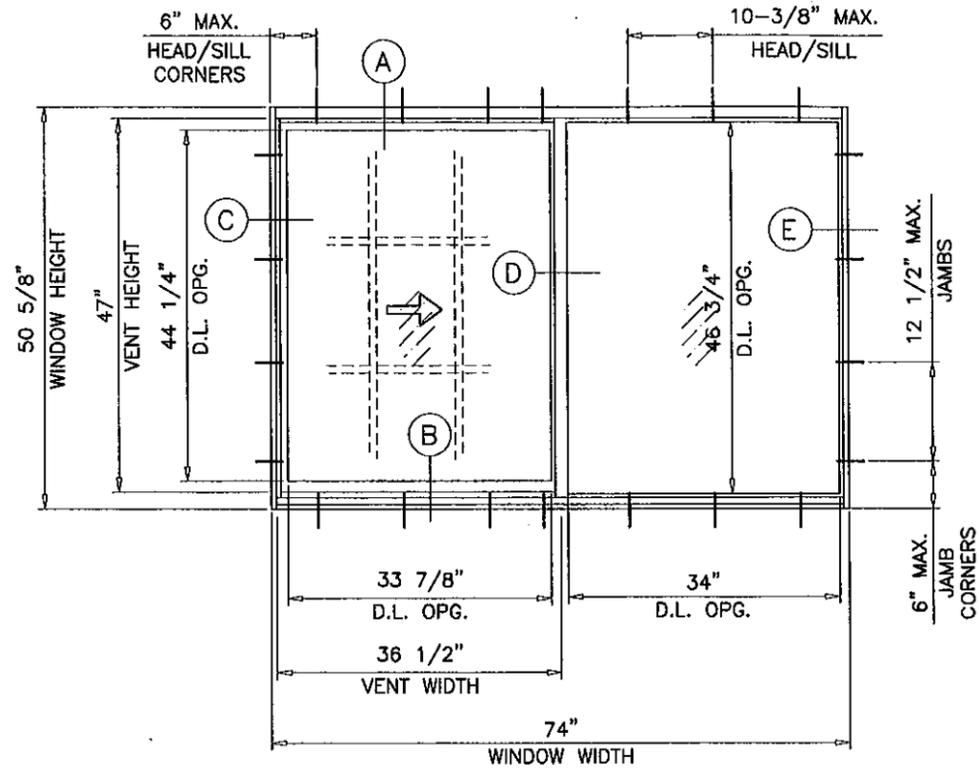

TYPICAL ELEVATIONS
TESTED UNITS

SERIES 6900
ALUMINUM HORIZONTAL SLIDING WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE HORIZONTAL SLIDING WINDOWS, ALSO COMBINATIONS OF H.S./H.S. OR HORIZONTAL SLIDING WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

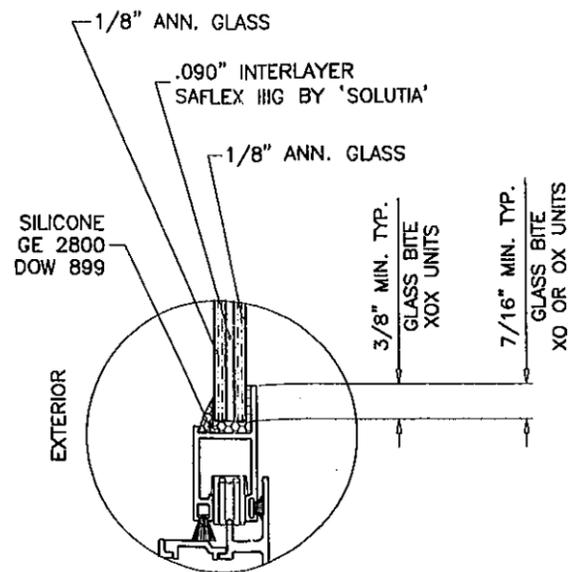

GLAZING DETAIL

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
Javad Ahmad
MAR 20 2011

Approved as complying with the
Florida Building Code
Date 04/12/2016
NOA# 11-0167-08
Miami Dade Product Control
By *[Signature]*



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\W10-78AWP

SERIES 6900 ALUM HORIZONTAL SLIDING WDW. (L.M.I.)
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309


no	date	by	description	REV. PER	COMMENTS
A	03.03.11				

date: 11-18-10
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W10-78
sheet 1 of 6

DESIGN LOAD CAPACITY - PSF (XO OR OX SIZES)				
WINDOW DIMS.		A	5/16" LAM. GLASS	
WIDTH	HEIGHT		EXT.(+)	INT.(-)
24"	24"	3	60.0	80.0
36"		4	60.0	80.0
48"		5	60.0	80.0
60"		6	60.0	80.0
72"		7	60.0	80.0
24"	36"	3	60.0	80.0
36"		4	60.0	80.0
48"		5	60.0	80.0
60"		6	60.0	80.0
72"		7	60.0	80.0
24"	48"	3	60.0	80.0
36"		4	60.0	80.0
48"		5	60.0	80.0
60"		6	60.0	80.0
72"		7	60.0	80.0
24"	60"	3	60.0	80.0
36"		4	60.0	80.0
48"		5	60.0	80.0
60"		6	60.0	73.2
72"		7	60.0	60.0
26-1/2"	26"	3	60.0	80.0
37"		4	60.0	80.0
53-1/8"		5	60.0	80.0
74"		7	60.0	80.0
26-1/2"	38-3/8"	3	60.0	80.0
37"		4	60.0	80.0
53-1/8"		5	60.0	80.0
74"		7	60.0	80.0
26-1/2"	50-5/8"	3	60.0	80.0
37"		4	60.0	80.0
53-1/8"		5	60.0	80.0
74"		7	60.0	80.0
26-1/2"	63"	3	60.0	80.0
37"		4	60.0	80.0
53-1/8"		5	60.0	74.8
74"		7	60.0	60.0

A = NO. OF ANCHORS PER HEAD & SILL

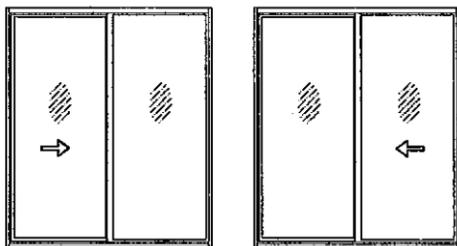


XO

OX

DESIGN LOAD CAPACITY - PSF (XOX SIZES)				
WINDOW DIMS.		A	5/16" LAM. GLASS	
WIDTH	HEIGHT		EXT.(+)	INT.(-)
72"	24"	7	60.0	80.0
84"		8	60.0	80.0
96"		9	60.0	80.0
108"		10	60.0	80.0
72"		36"	7	60.0
84"	8		60.0	80.0
96"	9		60.0	80.0
108"	10		60.0	80.0
72"	48"		7	60.0
84"		8	60.0	80.0
96"		9	60.0	80.0
108"		10	60.0	80.0
72"		60"	7	60.0
84"	8		60.0	76.7
96"	9		60.0	60.0
108"	10		60.0	60.0
74"	26"		7	60.0
106-1/4"		10	60.0	80.0
111"		10	60.0	80.0
74"	38-3/8"	7	60.0	80.0
106-1/4"		10	60.0	80.0
111"		10	60.0	80.0
74"	50-5/8"	7	60.0	80.0
106-1/4"		10	60.0	80.0
111"		10	60.0	80.0
74"	63"	7	60.0	79.0
106-1/4"		10	60.0	60.0
111"		10	60.0	60.0

A = NO. OF ANCHORS PER HEAD & SILL

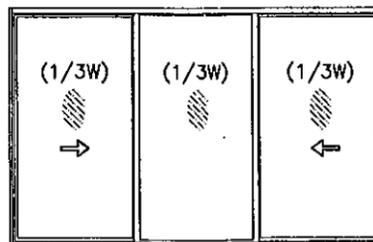


OPERATING VENTS TO BE 1/3 OF THE WINDOW WIDTH

XOX

DESIGN LOAD CAPACITY - PSF (XOX SIZES)					
WINDOW DIMS.		A	5/16" LAM. GLASS		
WIDTH	HEIGHT		EXT.(+)	INT.(-)	
72"	24"	7	60.0	80.0	
84"		8	60.0	80.0	
96"		9	60.0	80.0	
108"		10	60.0	80.0	
72"		36"	7	60.0	80.0
84"	8		60.0	80.0	
96"	9		60.0	80.0	
108"	10		60.0	60.0	
72"	48"		7	60.0	80.0
84"		8	60.0	60.0	
96"		9	60.0	60.0	
72"		60"	7	60.0	60.0
74"			7	60.0	80.0
106-1/4"	26"	10	60.0	80.0	
111"		10	60.0	80.0	
74"	38-3/8"	7	60.0	80.0	
106-1/4"		10	60.0	60.0	
111"		10	60.0	60.0	
74"	50-5/8"	7	60.0	80.0	
74"		7	60.0	60.0	

A = NO. OF ANCHORS PER HEAD & SILL

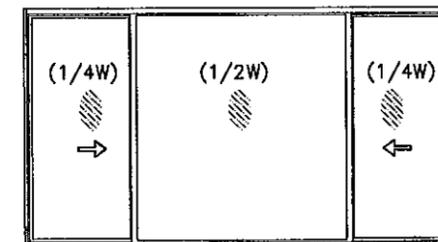

OPERATING VENTS TO BE 1/4 OF THE WINDOW WIDTH

XOX

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

11/19/04 2011

Approved as complying with the
Florida Building Code
Date 09/21/2016
NOA# 11-0107-08
Miami Dade Product Control





By *[Signature]*

af
AL-FAROQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W10-78AWP

SERIES 6900 ALUM HORIZONTAL SLIDING WDW. (L.M.I.)
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309


Revisions:	no	date	description
	A	03.03.11	NO CHANGE THIS SHEET

date: 11-18-10	scale: -	dr. by: HAMID	chk. by:
drawing no. W10-78			
sheet 2 of 6			

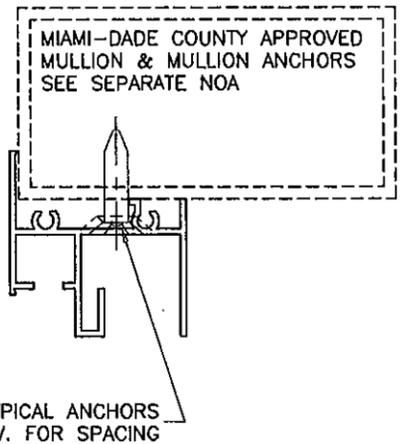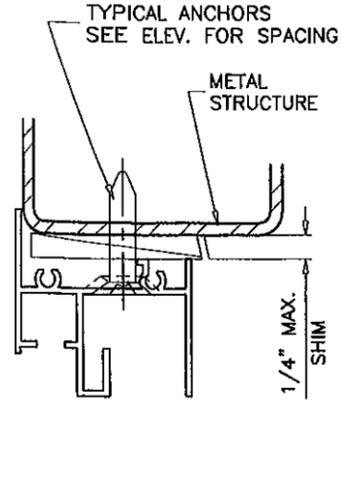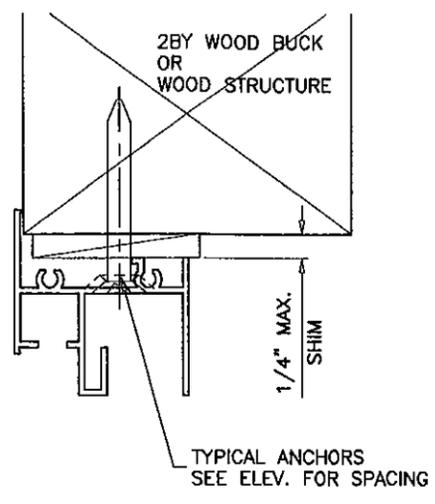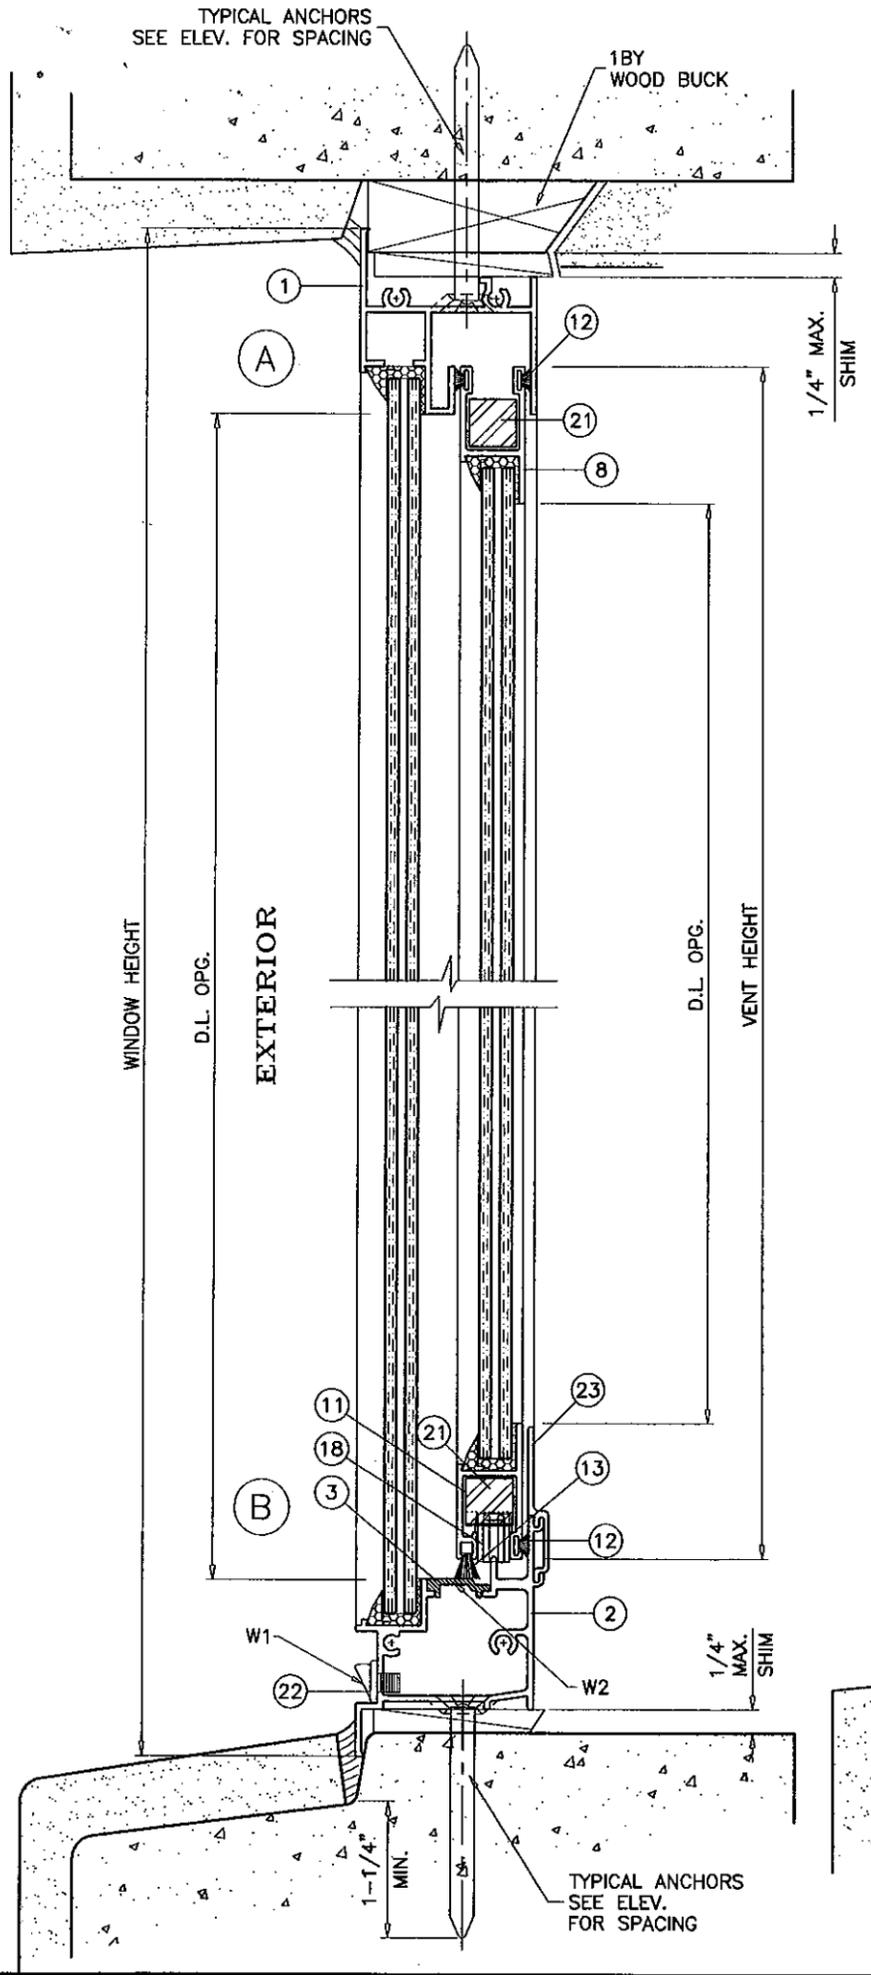

WOOD BUCKS AND METAL STRUCTURE NOT BY AWP WDW. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
 1/4" DIA. TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)
 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)
#12 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = 1/8")
 (NO SHIM SPACE)
TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

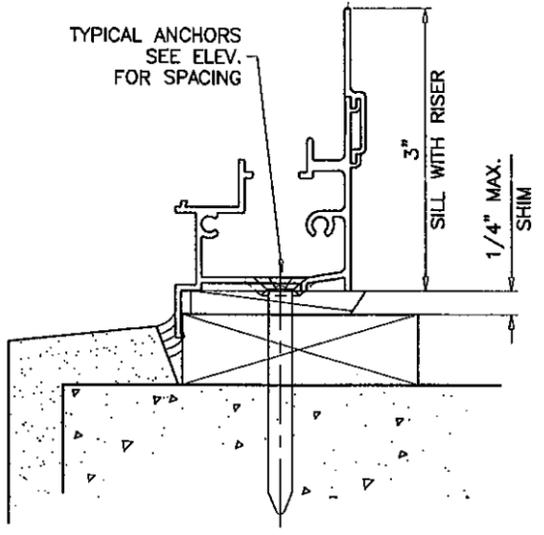

SEALANTS:

FRAME CORNERS AND VENT CORNER SEAMS TO BE SEALED WITH 'SCHNEE MOREHEAD 5504' SEALANT.

WEEPHOLES:

W1 = 1-1/2" X 1/4" WEEPHOLES AT 6" FROM SASH ENDS WITH PLASTIC BAFFLE.
 W2 = 1" LONG WEEP NOTCH AT EACH END

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 Approved as complying with the Florida Building Code
 Date 07/21/2016
 NOAH 11-2117-08
 Miami Dade Product Control
 By [Signature]
 MAR 04 2011


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W10-78AWP

SERIES 6900 ALUM HORIZONTAL SLIDING WDW. (L.M.I.)
 ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

no.	date	by	description
A	03.03.11		REV. PER BCCO COMMENTS

date: 11-18-10
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:


drawing no. **W10-78**
 sheet 3 of 6

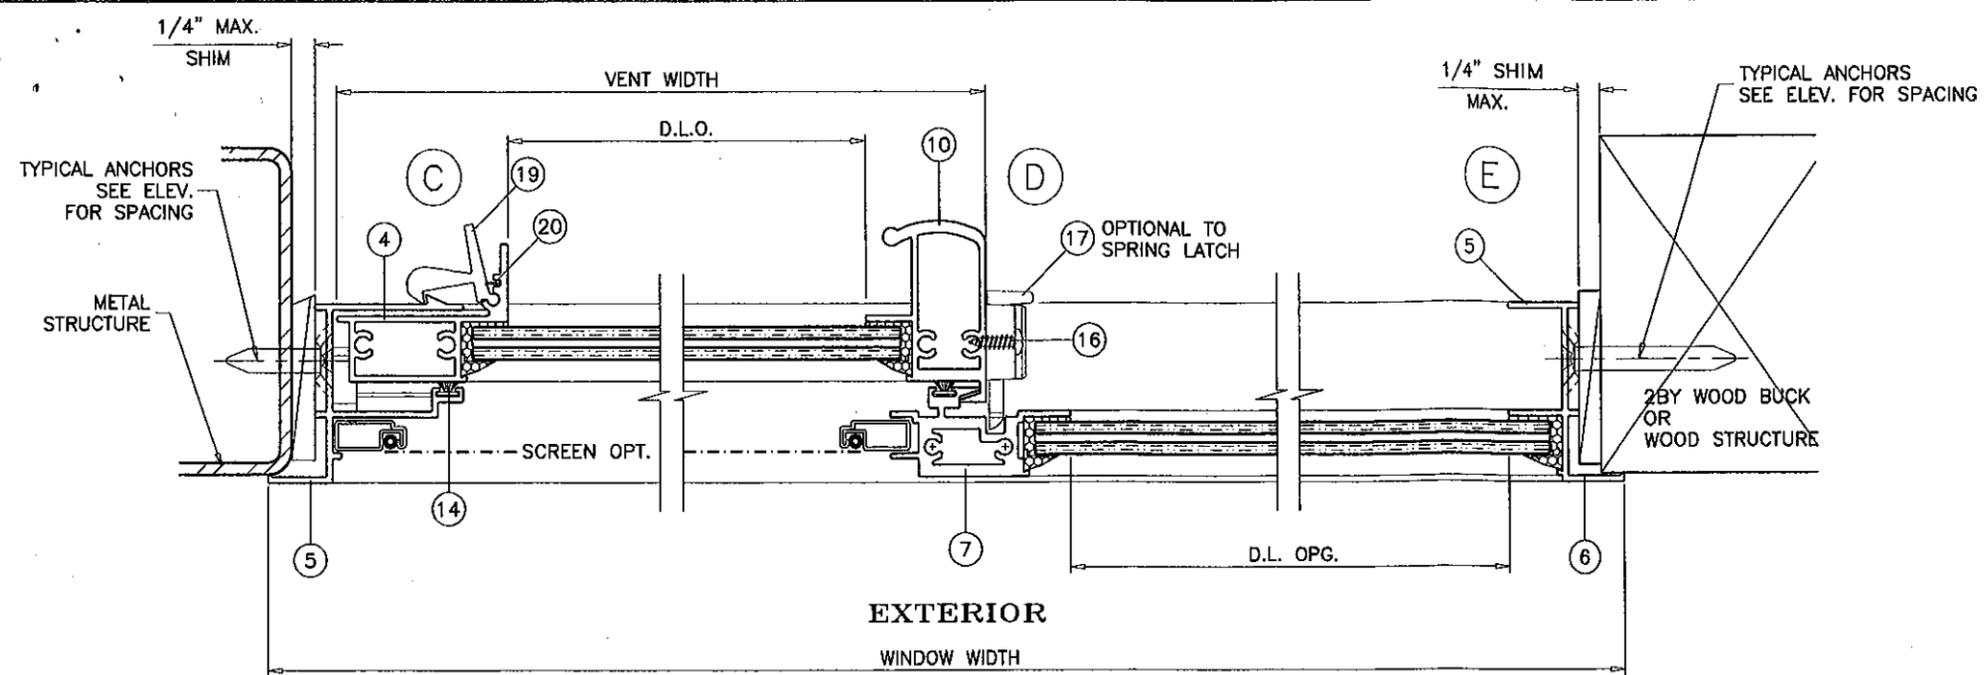

EXTERIOR

WINDOW WIDTH


XO LAYOUT
OX OPPOSITE

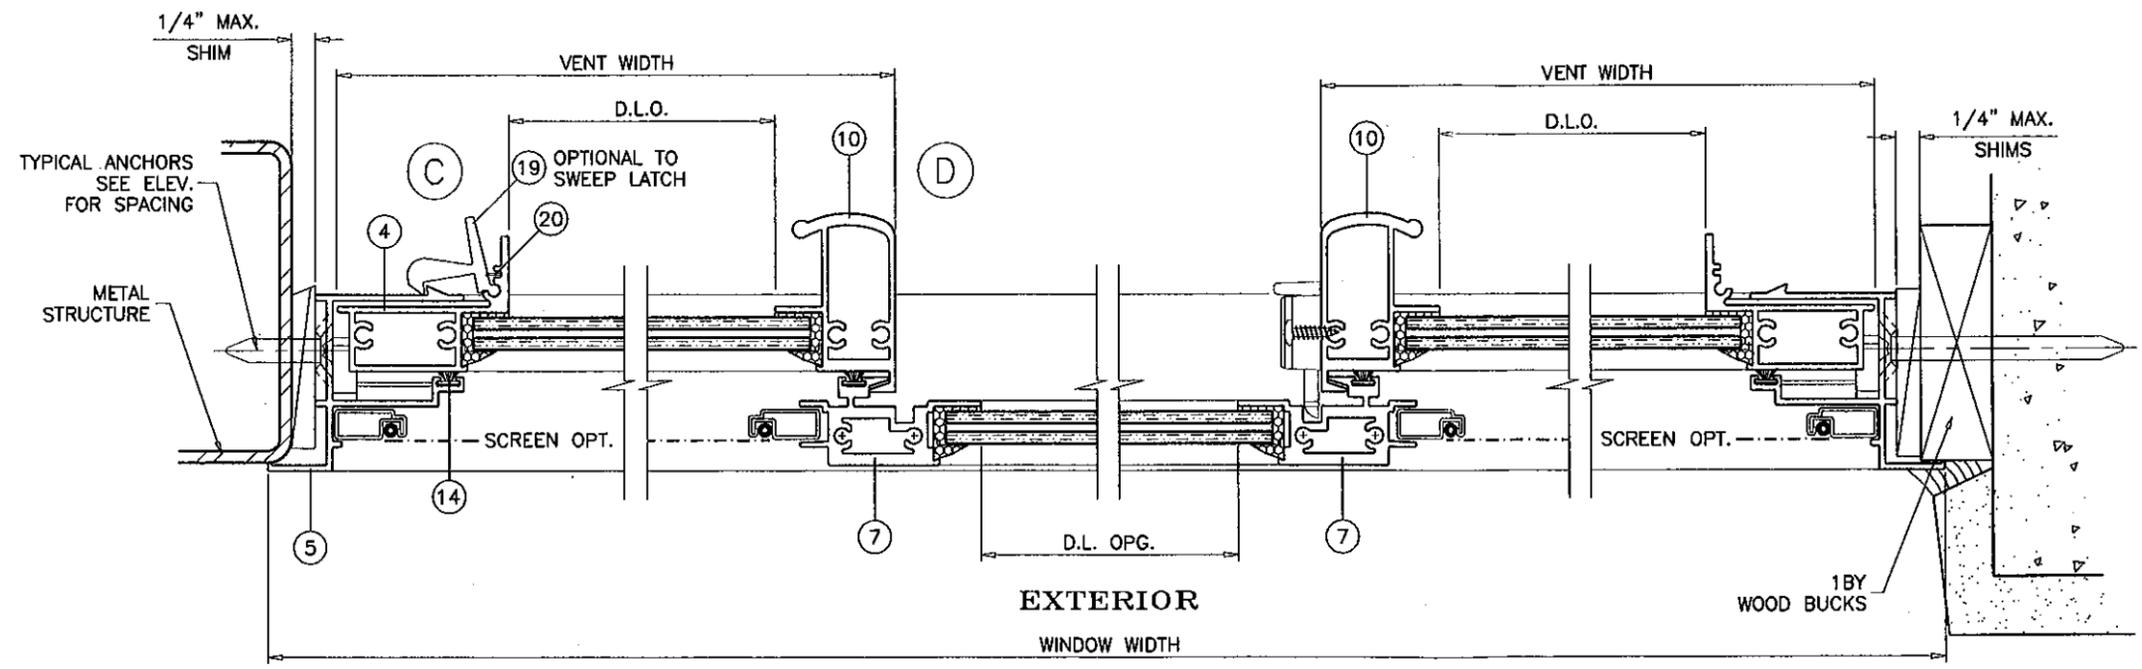

EXTERIOR

WINDOW WIDTH

XOX LAYOUT

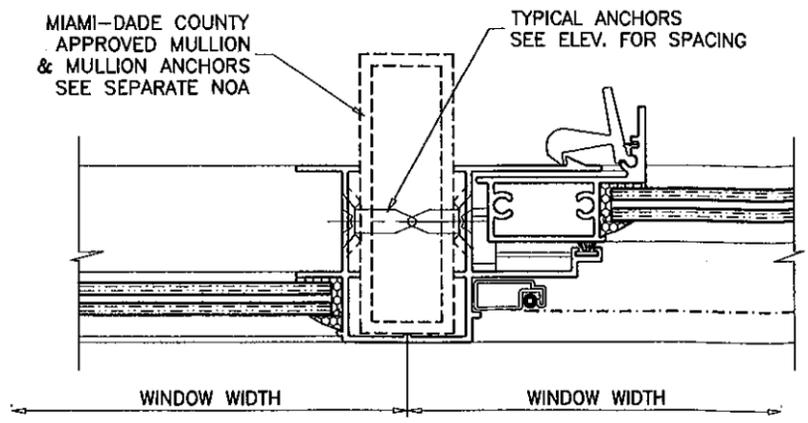

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

Javad Ahmad
MAR 24 2011

Approved as complying with the
Florida Building Code
Date 04-12-16/2016
NOA# 11-8167-08
Miami Dade Product Control
By *Javad Ahmad*


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\W10-78AWP

SERIES 6900 ALUM HORIZONTAL SLIDING WDW. (L.M.I.)
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL (305) 887-2646 FAX (305) 883-1309


Revisions:	
no	description
A	03.03.11 REV. PER BCCO COMMENTS

date: 11-18-10
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W10-78
sheet 4 of 6

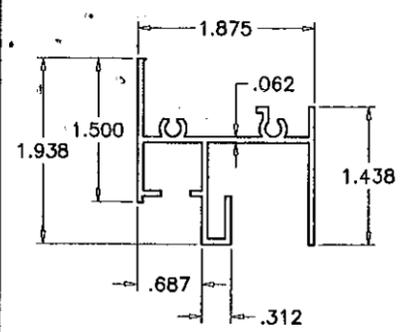


1 FRAME HEAD

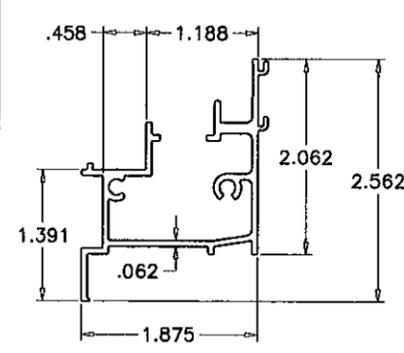


2 FRAME SILL

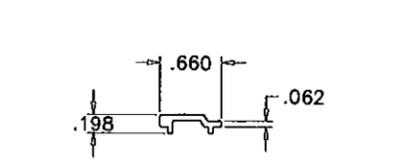


3 SILL INSERT

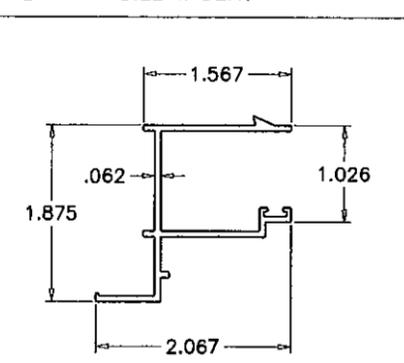


5 FRAME JAMB VENT

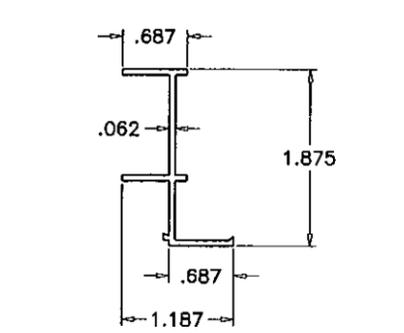


6 FRAME JAMB FIXED

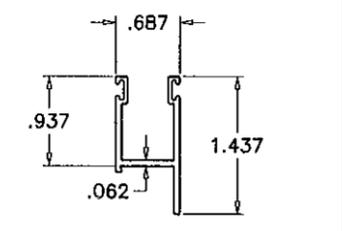


8 VENT TOP RAIL

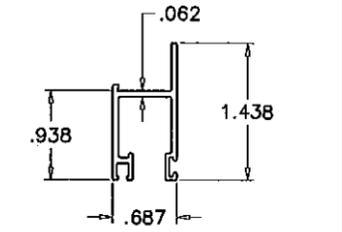


9 VENT BOTTOM RAIL

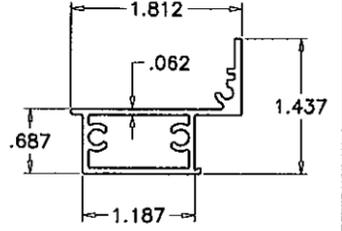


4 JAMB STILE

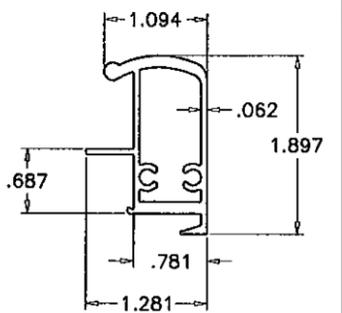


10 MEETING STILE

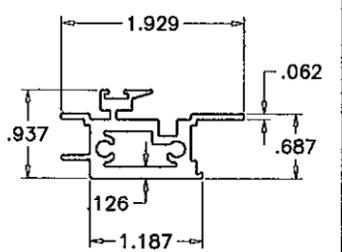

7 FIXED MTG. STILE



21 REINF. BAR



23 SILL RISER

ITEM #	PART No.	QUANTITY	DESCRIPTION	MATERIAL	MANUF./SUPPLIER/REMARKS
1	YE-5030	1	FRAME HEAD	6063-T6	-
2	YE-5039	1	FRAME SILL	6063-T6	-
3	YE-5038	1	FRAME SILL INSERT	6063-T6	-
4	YE-6902	AS REQ'D.	VENT STILE	6063-T6	-
5	YE-6901	AS REQ'D.	FRAME JAMB (VENT SIDE)	6063-T6	-
6	YE-5031	AS REQ'D.	FRAME JAMB (FIXED SIDE)	6063-T6	-
7	YE-5037	AS REQ'D.	FRAME MEETING RAIL	6063-T6	-
8	YE-6904	AS REQ'D.	VENT TOP RAIL	6063-T6	-
9	YE-6903	AS REQ'D.	VENT BOTTOM RAIL	6063-T6	-
10	YE-6905	AS REQ'D.	VENT INTERLOCK STILE	6063-T6	-
11	-	2/SASH	ROLLER ASSY. SPACER (ACCEPTS 2 ROLLERS EACH)	PLASTIC	-
12	YH-4004	AS REQ'D.	ULTRAFAB .187" x .250" FIN SEAL WEATHERSTRIP	-	TOP/BOTTOM RAIL (INTERIOR)
13	YH-6006	AS REQ'D.	ULTRAFAB .115" x .500" FIN SEAL WEATHERSTRIP	-	BOTTOM RAIL (EXTERIOR)
14	YH-6007	AS REQ'D.	ULTRAFAB .229" x .260" FIN SEAL WEATHERSTRIP	-	MEETING RAIL/FRAME JAMB
15	YF-1	AS REQ'D.	ASSEMBLY SCREW (#10 x 3/4" PH. SMS.)	CAD PLATED	-
15A	YF-79	AS REQ'D.	ASSEMBLY SCREW (#10 x 1-1/2" PH. SMS.)	CAD PLATED	MTG. RAIL BOT.ONLY
16	YF-14	2/LOCK	SWEEP LOCK SCREW (#8 x 5/8" OH. SMS.)	CAD PLATED	-
17	YH-6016	1/ SASH	SWEEP LOCK	CAST (ZAMAK)	AT MIDSPAN OF SASH
18	YH-6001/ASSY	2/SASH	ROLLER ASSEMBLY (HOUSING, WHEEL & AXEL)	-	(YH-6001, 6002 & 6003)
19	YH-504	2/ SASH	LATCH LOCK	PLASTIC	AT 11-1/2" FROM TOP & BOTTOM
20	YH-512	1/LATCH	LATCH LOCK SPRING	STEEL	-
21	-	2/VENT	1/2" x 1/2" x FULL LENGHT REINFORCEMENT BAR	STEEL	A-36 COLD FINISHED
22	YH-1610	2	WEEEP HOLE COVER	RIGID PLASTIC	INJECTION MOLDED
23	-	1	SILL RISER	6063-T6	-

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W10-78AWP

SERIES 6900 ALUM HORIZONTAL SLIDING WDW. (L.M.I.)
ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

no.	date	description
A	03.03.11	NO CHANGE THIS SHEET


date: 11-18-10
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W10-78
 sheet 5 of 6


Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

MAR 04 2011


Approved as complying with the
 Florida Building Code
 Date **04/21/2016**
 NOA# **11-610708**
 Miami Dade Product Control
 By *[Signature]*

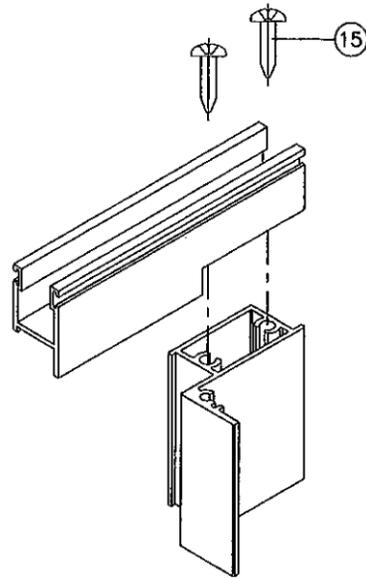


VENT TOP/BOTTOM CORNERS

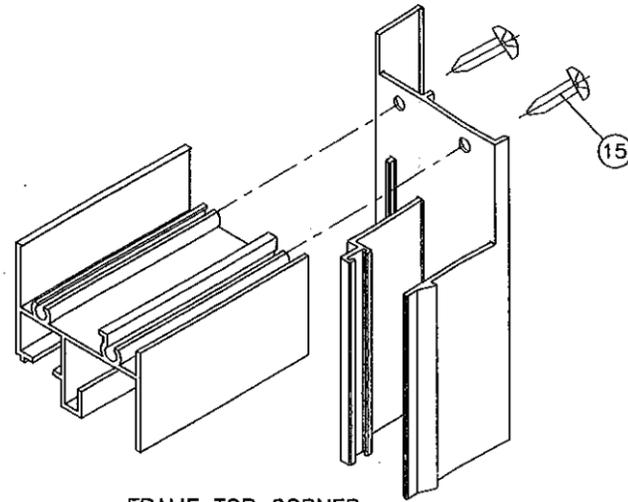

FRAME TOP CORNER

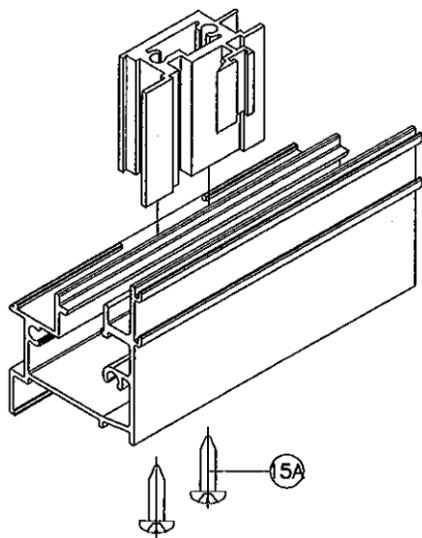

FIXED MTG. RAIL CORNER

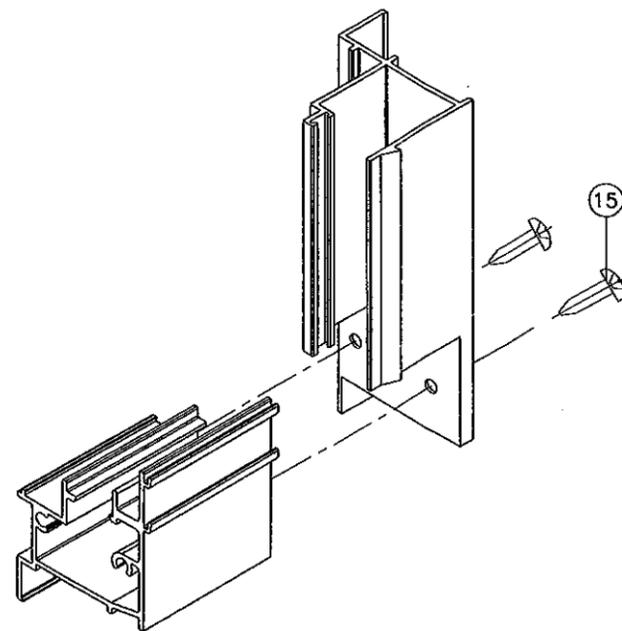

FRAME BOTTOM CORNER

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

J.A.
 MAR 04 2011

Approved as complying with the
 Florida Building Code
 Date 04/21/2016
 NOA# 11-0167-08
 Miami Dade Product Control
 By *[Signature]*

afc

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W10-78AWP

SERIES 6900 ALUM HORIZONTAL SLIDING WDW. (L.M.I.)
ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
A	03.03.11		NO CHANGE THIS SHEET

date: 11-18-10
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W10-78
 sheet 6 of 6