



BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION
11805 SW 26th Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/building

NOTICE OF ACCEPTANCE (NOA)

M. Q. Windows, Inc.
1855 Griffin Road, Suite A-271
Dania, Fl. 33004

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Section and accepted by the Board of Rules and Appeals (BORA) to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "JS-IN" Fixed Shaped Inward Mahogany Wood Window - L.M.I.

APPROVAL DOCUMENT: Drawing No. JS-2-IN, titled "JS Series Wood Fixed Windows Sash Inward" Sheets 1 through 12 of 12, dated 01/10/99 and last revised on 01/17/11, prepared by manufacturer, signed and sealed by Scott Wolters, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LABELING: Each unit shall bear a permanent label with the logo of M. Q. Windows, Inc. or M. Q. Windows, Inc., Montreal, Quebec, Canada, model/ series and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises and renews NOA No. 05-1004.04 and consists of this page 1, evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
3/23/11

NOA No. 11-0201.02
Expiration Date: March 01, 2012
Approval Date: March 31, 2011
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **JS-2-IN**, titled "JS Series Wood Fixed Windows Sash Inward" Sheets 1 through 12 of 12, dated 01/10/99 and last revised on 01/17/11, prepared by manufacturer, signed and sealed by Scott Wolters, P. E.

B. TESTS


1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
(**Approved for HJ435 sill only**, all other sills NOT approved for water infiltration (See Limitations on page 1 of 3))
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94along with marked-up drawings and installation diagram of wood fixed window, prepared by Hurricane Testing Laboratories, Inc., Test Reports No.'s **HTL-0118-1006-98 (Sp#4 TAS-201/203)**, **HTI-0118-1103-98 ((Sp#1 & Sp#2 (TAS-202)) and (Sp#5, TAS-201, 202, 203)**, **HTL-0118-1298-98 (Sp#6, # 7 (TAS-201/ 203))** , **HTL-0118-1218-98 (Sp#6 (TAS-201/ 203))** prepared by, dated 10/15/98 thru 07/06/99, signed and sealed by Timothy S. Marshall, P. E.
(Submitted under previous NOA No.99-1228.03)

C. CALCULATIONS

1. Statement letter of conformance and compliance with the FBC-2007, dated January 27, 2011, signed and sealed by Scott Wolters, P. E.
2. Letter of "*Adoption of as his Own, the Work of another Engineer*" per Section **61G15-27** of the FBPE, dated January 25th, 2011 signed and sealed by Scott Wolters, P. E.
3. Anchor verification calculations and structural analysis, complying with FBC-2004, prepared by Tilteco Inc., dated September 13th, 2005, signed and sealed by Walter A. Tillit, Jr., P. E.
Complies with ASTM E1300-98
(Submitted under previous NOA No.05-1004.04)

D. QUALITY ASSURANCE

1. Miami-Dade Building and Neighborhood Compliance Department (BNC).



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 11-0201.02
Expiration Date: March 01, 2012
Approval Date: March 31, 2011

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **06-0216.06** issued to Solutia Inc. for their “**Saflex III G Clear or colored interlayer**” dated 05/04/06, expiring on 05/21/11.

F. STATEMENTS

1. Statement letter of conformance and compliance with the FBC-2007, dated January 27, 2011, signed and sealed by Scott Wolters, P. E.
2. Statement letter of no financial interest, dated January 27, 2011, signed and sealed by Scott Wolters, P. E.
3. Letter of *Adoption of as his Own, the Work of another Engineer* per Section 61G15-27 of the FBPE, dated January 25th, 2011 signed and sealed by Scott Wolters, P. E.
4. Proposal issued by Product Control, dated June 08, 2010, signed by Jaime D. Gascon, P. E.
5. Testing agreement letter, dated October 20th, 2010 between Intertek Testing Services NA., Ltd. (ITS) and M. Q. Windows, Inc., issued by ITS.
6. One year conditional approval, subjected to successful verification test, approved on March 31st, 2011 and expiring on March 01st, 2012.
7. Addendum letters for Test Reports No.’s **HTL-0118-1006-98** and **HTI-0118-1103-98**, issued by Hurricane Test Laboratory, Inc., dated April 27, 2000, signed and sealed by Vinu J. Abraham, P. E.
(Submitted under previous NOA No.05-1004.04)
8. Laboratory compliance letters for Test Reports No.’s **HTL-0118-1006-98**, **HTI-0118-1103-98**, **HTL-0118-1298-98** and **HTL-0118-1218-98**, issued by Hurricane Test Laboratory, Inc., dated March 1, 1999, signed and sealed by Timothy S. Marshall, P. E.
(Submitted under previous NOA No.05-1004.04)

G. OTHERS

1. Notice of Acceptance No. **05-1004.04**, issued to M. Q. Windows, Inc. for their Series “**JS Fixed Shaped Outward Mahogany Wood Window – L.M.I.**”, approved on 06/20/06 and expiring on 03/01/11.
2. One year conditional approval, subjected to successful verification test, the final approval will be balanced of total 5 years.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 11-0201.02
Expiration Date: March 01, 2012
Approval Date: March 31, 2011

RECTANGULAR FIXED UNITS

CONFIGURATIONS: O

GENERAL NOTES:

- THIS PRODUCT IS DESIGNED TO COMPLY WITH THE PROVISIONS OF THE HIGH VELOCITY HURRICANE ZONE (HVHZ) OF THE 2007 EDITION OF THE FLORIDA BUILDING CODE WITH THE 2009 SUPPLEMENT.
- THIS PRODUCT IS LARGE MISSILE IMPACT RESISTANT AND HAS BEEN TESTED IN ACCORDANCE WITH THE HIGH VELOCITY HURRICANE ZONE PROTOCOLS TAS201, 202 AND 203. NO SHUTTERS ARE REQUIRED.
- WOOD BUCKS (BY OTHERS) AND OPENINGS MUST BE DESIGNED BY THE PROFESSIONAL OF RECORD TO PROPERLY TRANSFER WIND LOADS TO THE MAIN STRUCTURE.
- SPECIFIED ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
- IN ORDER TO VERIFY THAT ANCHORS FOR THIS PRODUCT WERE NOT OVERSTRESSED AS TESTED, A 33% ALLOWABLE STRESS INCREASE WAS NOT USED IN THEIR ANALYSIS. HOWEVER, A LOAD DURATION FACTOR OF $C_d = 1.6$ WAS USED TO VERIFY THEIR SPACING IN WOOD SUBSTRATES.

VIEWED FROM THE INSIDE
WOOD: Mahogany

DESIGN PRESSURE
Positive Pressure: +58 psf Negative Pressure: -68 psf
NOTE: Refer to table 1 for minimum and maximum sizes width (FW) & height (FH)

Information on this page applies to cross sections 1 & 20 (sash "inward") ONLY

Frame Size vs d.l.o. relation is:
Long d.l.o.= long frame dimension - 9"
Short d.l.o.=short Frame dimension- 9"

NOTE:
See sections 1 and 20 on pages 6 & 7 respectively.

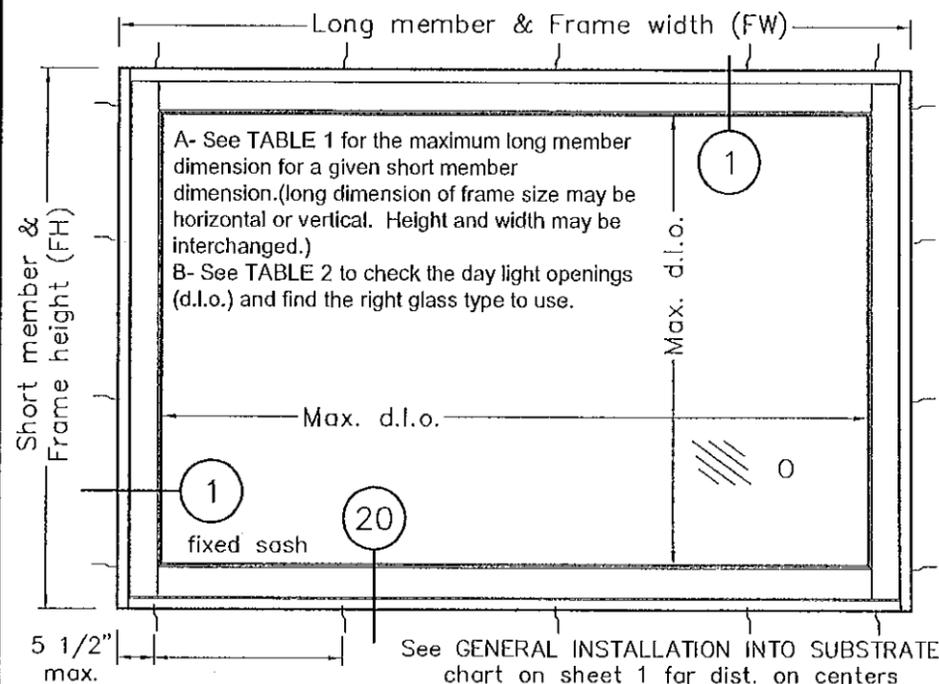


TABLE 2 GLASS TYPES FOR FRAME DIMENSIONS OF TABLE 1 OR FOR BASIC RECTANGLES GIVEN ON SHEETS 2, 3, 4 AND 5 OF THIS DRAWING			
If, for a given long member d.l.o., the actual short member daylight opening exceeds the maximum dimension indicated on table 2, then			
TYPE 2 heat strengthened laminated glass [3/16" HS - .09" PVB interlayer, Saflex III G by Solutia - 3/16" HS] OR TYPE 3 full tempered laminated glass [3/16" FT - .09" PVB interlayer, Saflex III G by Solutia - 3/16" FT] MUST BE USED			
Maximum daylight opening for type 1 laminated glass [3/16" AN - .09" PVB interlayer, Saflex III G by Solutia - 3/16" HS]			
Given Long member d.l.o. up to (in.)	Max. short member d.l.o. (in.)	Given Long member d.l.o. up to (in.)	Max. short member d.l.o. (in.)
47 1/4	47.244	90 1/2	28.150
51	41.339	94 1/2	27.953
55	38.386	98 1/2	27.559
59	36.220	102 1/4	27.362
63	34.055	106 1/4	26.969
66	32.480	110 1/4	26.772
70 3/4	31.496	114	26.575
74 3/4	30.512	118	26.378
78 3/4	29.528	122	26.220
82 1/2	28.937	126	26.102
86 1/2	28.543	130	25.984

GENERAL INSTALLATION INTO SUBSTRATE			
Using PDF-FS-05/D Inst. Bracket			
Fastener	Into 2x wood buck	Into concrete	
(1) 1/4" x 2 3/4" Elco/Textron Tapcon screws		max. o/c	min. emb.
(2) #12 x 1 1/2" wood screw	max. o/c 11"	min. emb. 1 1/4"	
Direct Mount (At sill only)			
Fastener	Into 2x wood buck	Into concrete	
(1) 1/4" x 2 3/4" Elco/Textron Tapcon screws		max. o/c	min. emb.
(1) #14 x 2" wood screw	max. o/c 4"	min. emb. 1 1/4"	
-Materials, but not limited to steel & steel screws that come in contact with other dissimilar materials shall meet with section 2003.8.4 of the Florida Building Code.			

TABLE 1 MAXIMUM SHORT & LONG FRAME DIMENSIONS FOR RECTANGULAR UNITS	
GIVEN FRAME SHORT MEMBER dimension (in.) min - max.	MAX. FRAME LONG MEMBER dimension (in.) max.
35 - 40.00	139.000
34 - 41.49	134.000
33 - 43.10	129.000
32 - 44.04	124.000
31 - 44.56	119.000
30 - 45.17	114.000
29.68 - 45.375	112.375
0 - 45.38	112.374
0 - 46.00	108.167
0 - 47.00	102.447
0 - 48.00	97.783
0 - 49.00	93.927
0 - 50.00	90.703
0 - 51.00	87.983
0 - 52.00	85.672
0 - 53.00	83.695
0 - 54.00	81.997
0 - 55.00	80.533
0 - 56.00	79.267
0 - 60.00	75.690
0 - 64.00	73.719
0 - 68.00	72.747
0 - 70.00	72.526
0 - 72.00	72.440
0 - 72.438	72.438

GENERAL INSTALLATION NOTES

All PDF-FS-05D Installation brackets screwed to the window frame using (2) #10 x 1" a.t. wood screws w/ 7/8" min. embedment.

Spacing: All fasteners spacing is 5 1/2" from corners and o/c as specified in GENERAL INSTALLATION INTO SUBSTRATE chart on sheet 1.

Min. edge distance is 2 1/2" for concrete fasteners.

Shim Space: 3/8" MAX. @ head, jambs & sill. Use std shims behind as required.



1855 GRIFFIN ROAD,
SUITE A-271
DANIA, FL 33004

JS SERIES WOOD FIXED WINDOWS SASH INWARD

Drawing no.: JS-2-IN

Scale: NONE
Drawn by: S. Marcotte

Date drawn: 01/10/99
Date revised: 01/17/11

File: JS-2-IN
Page: 1 / 12

STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING, INC
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
JAN 27 2011

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 11-0201-02
Expiration Date 03/01/2012
By *[Signature]*
Miami Dade Product Control

**RECTANGULAR
FIXED UNITS**

CONFIGURATIONS: 0

MAX. FW & FH AS INDICATED


Information on this page applies to cross sections 1 & 21 (sash "inward") ALUMINUM THRESHOLD ONLY

VIEWED FROM THE INSIDE
WOOD: Mahogany

DESIGN PRESSURE
Positive Pressure: +58 psf Negative Pressure -68 psf
maximum frame width (FW) and height (FH) as indicated NO SHUTTERS ARE REQUIRED.

See GENERAL INSTALLATION INTO SUBSTRATE chart on sheet 1 for dist. on centers

5 1/2" max.

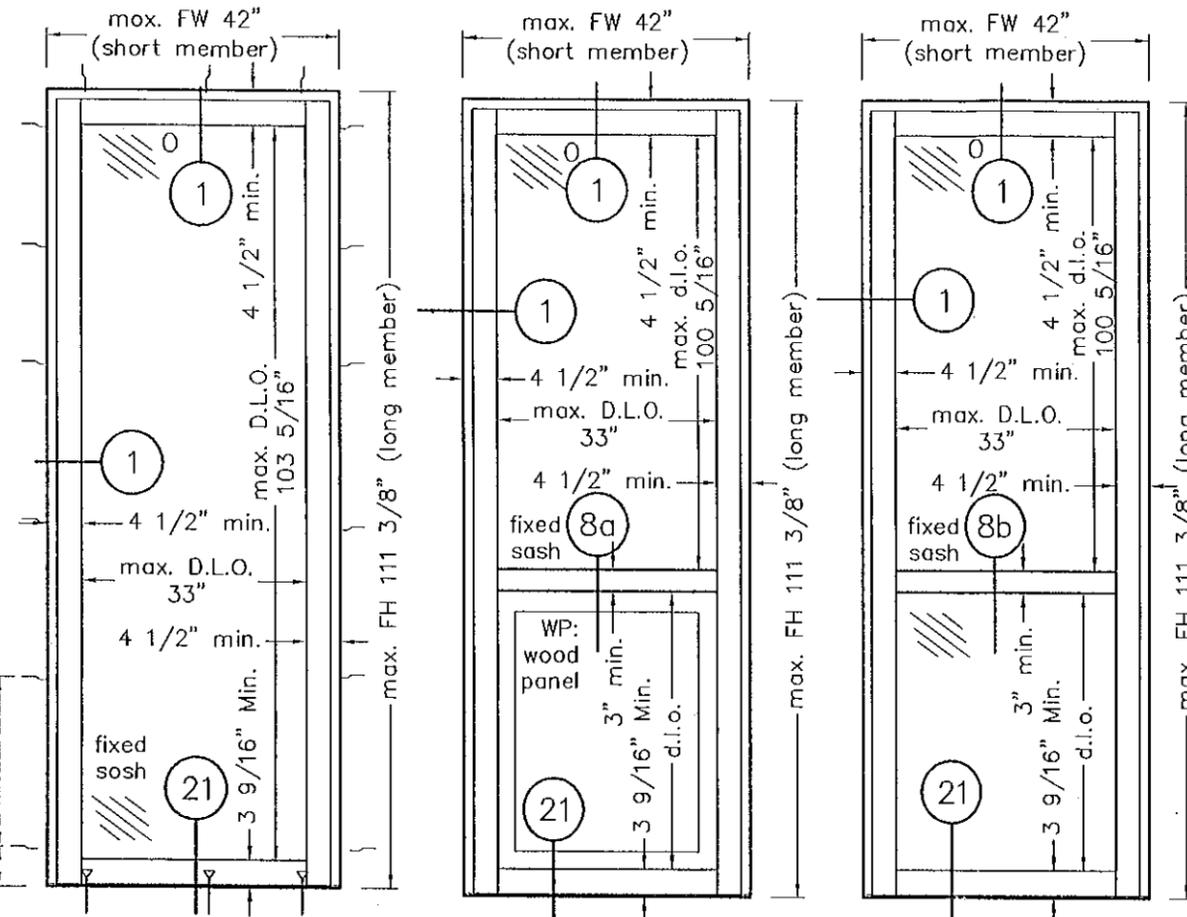

TYPE OF GLASS: SINGLE, 15/32" LAMINATED

For sizes shown on table 2, sheet 11:
TYPE 1, MADE OF:
3/16"(AN)-0.090" PVB Saflex III G interlayer by Solutia-3/16"(HS)

For sizes over those on table 2:
TYPE 2, MADE OF:
3/16"(HS)-0.090" PVB Saflex III G interlayer by Solutia-3/16"(HS)
OR TYPE 3, MADE OF:
3/16"(FT)-0.090" PVB Saflex III G interlayer by Solutia-3/16"(FT)


WP: 1 3/4" RAISED WOOD PANEL

Solid Mahogany, MAX. D.L.O. AREA: 7.81 sqf. See detail on sheet 9

Spacing: All fasteners spacing is 5 1/2" from corners and o/c as specified in GENERAL INSTALLATION INTO SUBSTRATE chart on sheet 1.

Shim Space: 3/8" MAX. @ head, jambs & sill. Use std shims behind as required. Use 4 x brackets at each end of an astragal meeting.

Min. edge distance is 2 1/2" for masonry fasteners.

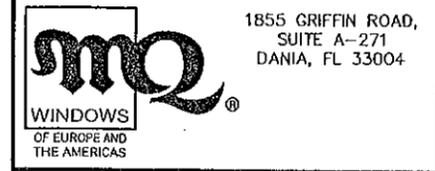

**JS SERIES
WOOD FIXED WINDOWS
SASH INWARD**

Drawing no.: JS-2-IN

Scale: NONE

Date drawn: 01/10/99

File: JS-2-IN

Drawn by: S. Marcotte


Date revised: 05/12/06

Page: 2 / 12

STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354


WOLTERS ENGINEERING, INC
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
JAN 27 2011

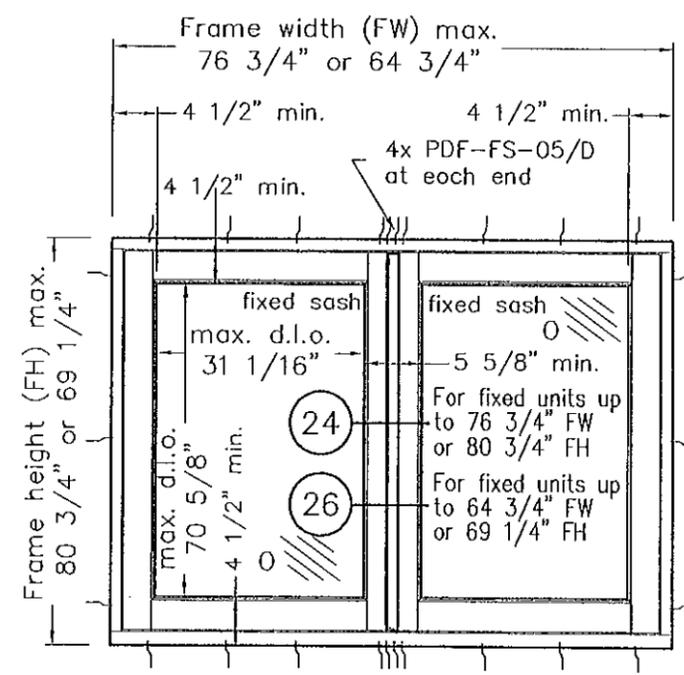

OPTIONAL: FIXED ASTRAGAL

NOTE:
See sections 1, 8a, 8b, 21, 24 and 26 on pages 6 & 7 respectively.

See GENERAL INSTALLATION INTO SUBSTRATE chart on sheet 1 for dist. on centers

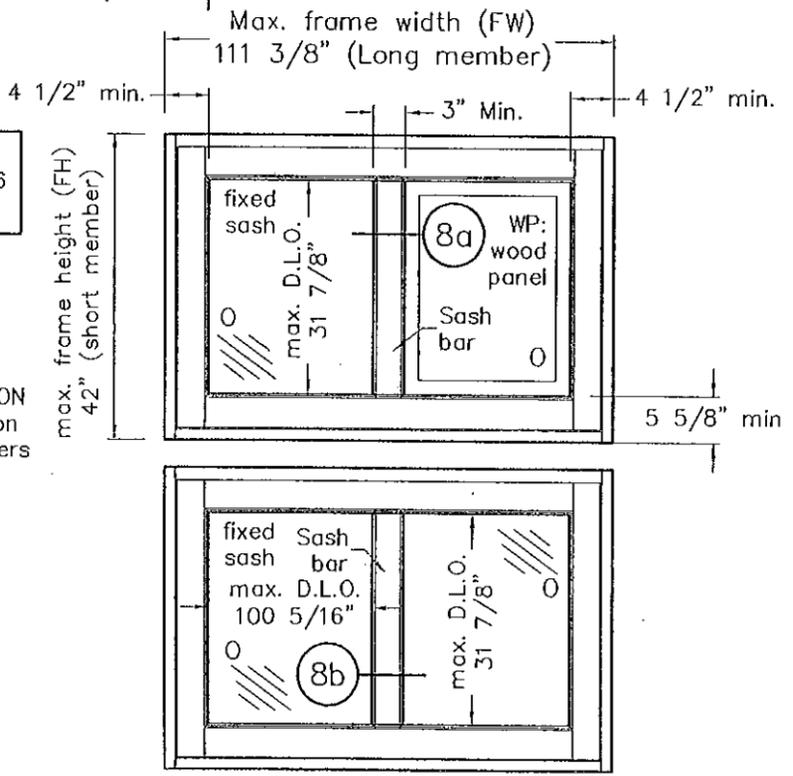

OPTIONAL: SASH BAR

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 11-0201-02
Expiration Date 03/01/2012

By *[Signature]*
Miami Dade Product Control


TRIANGULAR FIXED SHAPES

CONFIGURATIONS: 0

VIEWED FROM THE INSIDE
WOOD: Mahogany

DESIGN PRESSURE
Positive Pressure: +58 psf Negative Pressure -68 psf
NOTE: Refer to basic rectangles for minimum and maximum sizes width (FW) & height (FH) NO SHUTTERS ARE REQUIRED.

TO DETERMINE THE MAX. FW AND FH: SHAPES ON THIS PAGE MUST BE INSCRIBED INTO ANY ONE OF THE FOLLOWING BASIC RECTANGLES
42" (FW) x 111 3/8" (FH)
111 3/8" (FW) x 42" (FH)
72 7/16" (FW) x 72 7/16" (FH)

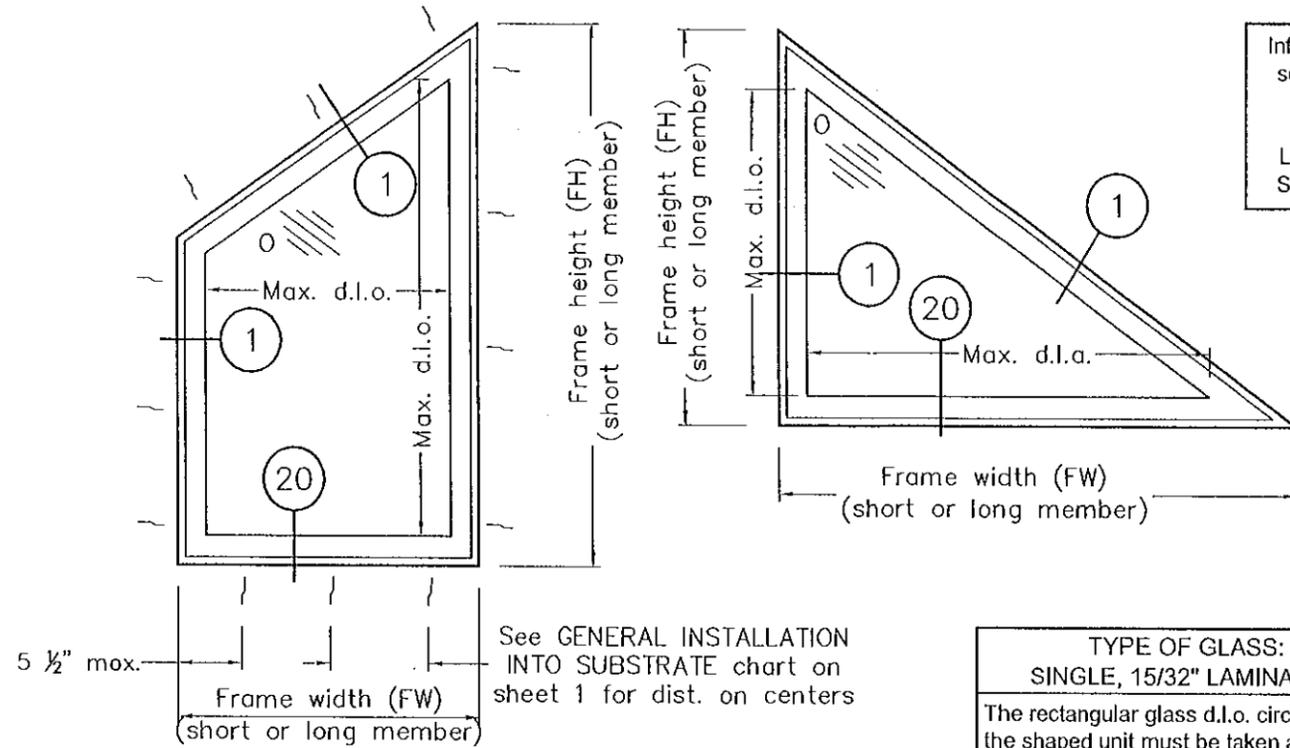

Information on this page applies to cross sections 1 & 20 (sash "inward") ONLY

Frame Size vs d.l.o. relation is:
Long d.l.o.= long frame dimension - 9"
Short d.l.o.=short Frame dimension- 9"

NOTE:
See sections 1 and 20 on pages 6 & 7 respectively.

TYPE OF GLASS:
SINGLE, 15/32" LAMINATED

The rectangular glass d.l.o. circumscribing the shaped unit must be taken and checked into table 2, sheet 11/12

For sizes shown on table 2, sheet 11:
TYPE 1, MADE OF: 3/16" (AN) - 0.090" PVB Saflex III G interlayer by Solutia-3/16"(HS)

For sizes over those on table 2:
TYPE 2, MADE OF: 3/16"(HS) - 0.090" PVB Saflex III G interlayer by Solutia-3/16"(HS)
OR
TYPE 3, MADE OF: 3/16" (FT) - 0.090" PVB Saflex III G interlayer by Solutia-3/16"(FT)


WP: 1 3/4" RAISED WOOD PANEL

Solid Mahogany, MAX. D.L.O.
AREA: 7.81 sqf. See detail on sheet 9

Spacing: All fasteners spacing is 5 1/2" from corners and o/c as specified in GENERAL INSTALLATION INTO SUBSTRATE chart on sheet 1.

Shim Space: 3/8" MAX. @ head, jambs & sill. Use std shims behind as required.

Min. edge distance is 2 1/2" for masonry fasteners.

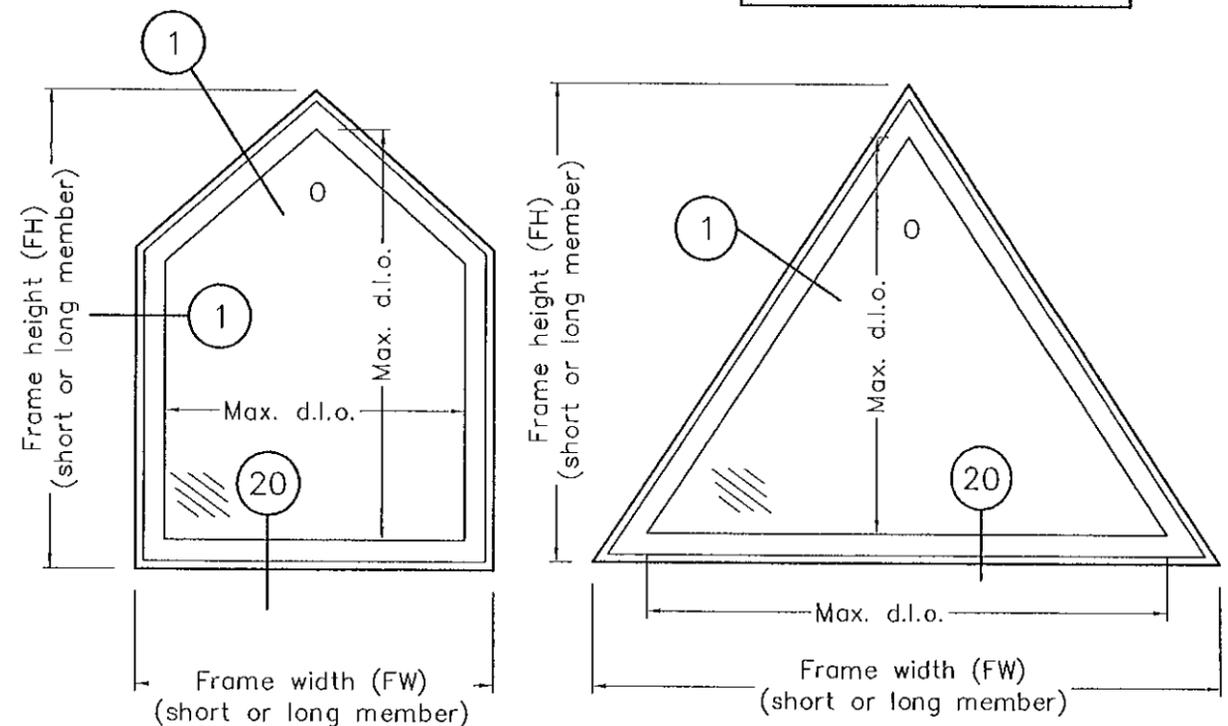

1855 GRIFFIN ROAD,
SUITE A-271
DANIA, FL 33004

WINDOWS
OF EUROPE AND
THE AMERICAS

JS SERIES WOOD FIXED WINDOWS SASH INWARD

Drawing no.: JS-2-IN	Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/99	Date revised: 05/12/06	
File: JS-2-IN	Page: 3/12	

STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING, INC
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
JAN 27 2011

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-9201.02
Expiration Date 03/01/2012

By *Jacob M.*
Miami Dade Product Control

ARCHED FIXED SHAPES



CONFIGURATIONS: O

VIEWED FROM THE INSIDE
WOOD: Mahogany

DESIGN PRESSURE
Positive Pressure: +58 psf Negative Pressure -68 psf
NOTE: Refer to basic rectangles for minimum and maximum sizes width (FW) & height (FH) NO SHUTTERS ARE REQUIRED.



TO DETERMINE THE MAX. FW AND FH: SHAPES ON THIS PAGE MUST BE INSCRIBED INTO ANY ONE OF THE FOLLOWING BASIC RECTANGLES
42" (FW) x 111 3/8" (FH)
111 3/8" (FW) x 42" (FH)
72 7/16" (FW) x 72 7/16" (FH)
76 3/4" (FW) x 58 1/2" (FH)

See GENERAL INSTALLATION INTO SUBSTRATE chart on sheet 1 for dist. on centers

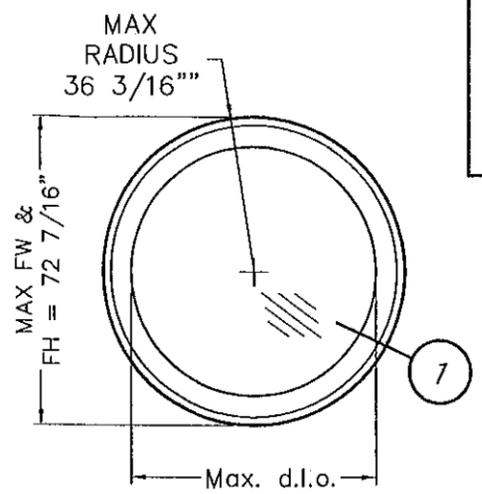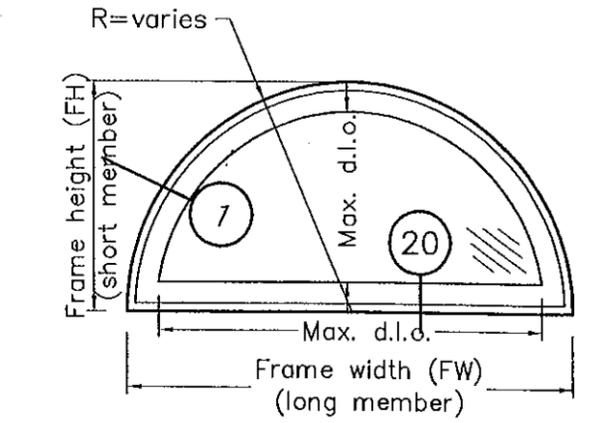


Information on this page applies to cross sections 1 & 20 (sash "inward") ONLY

Frame Size vs d.i.o. relation is:
Long d.i.o.= long frame dimension - 9"
Short d.i.o.=short Frame dimension- 9"

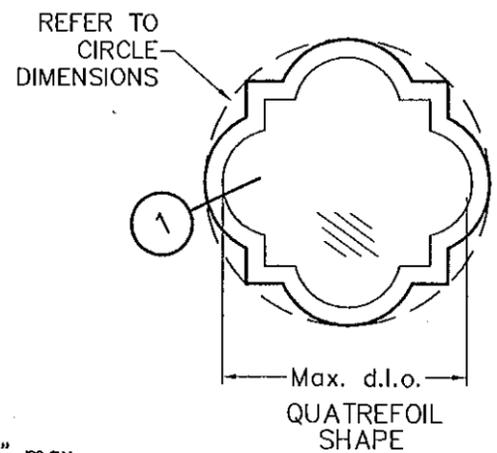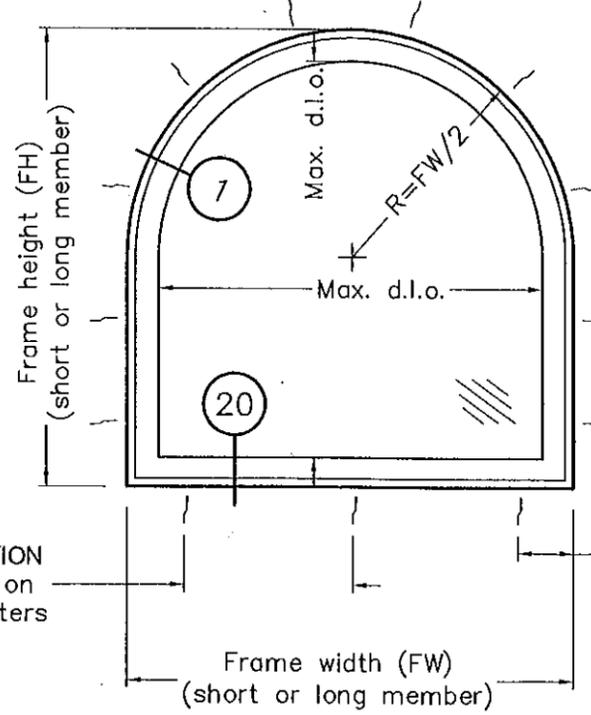

NOTE:
See sections 1 and 20 on pages 6 & 7 respectively.

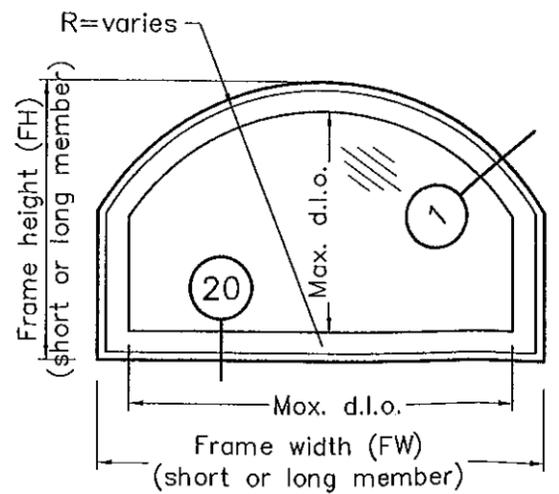

TYPE OF GLASS:
SINGLE, 15/32" LAMINATED
The rectangular glass d.i.o. circumscribing the shaped unit must be taken and checked into table 2, sheet 11/12
For sizes shown on table 2, sheet 11: TYPE 1, MADE OF: 3/16" (AN) - 0.090" PVB Safflex III G interlayer by Solutia-3/16"(HS)
For sizes over those on table 2: TYPE 2, MADE OF: 3/16"(HS) - 0.090" PVB Safflex III G interlayer by Solutia-3/16"(HS) OR TYPE 3, MADE OF: 3/16" (FT) - 0.090" PVB Safflex III G interlayer by Solutia-3/16"(FT)
WP: 1 3/4" RAISED WOOD PANEL
Solid Mahogany, MAX. D.L.O. AREA: 7.81 sqf. See detail on sheet 9

Spacing: All fasteners spacing is 5 1/2" from corners and o/c as specified in GENERAL INSTALLATION INTO SUBSTRATE chart on sheet 1.

Shim Space: 3/8" MAX. @ head, jambs & sill. Use std shims behind as required.

Min. edge distance is 2 1/2" for masonry fasteners .



1855 GRIFFIN ROAD,
SUITE A-271
DANIA, FL 33004

JS SERIES WOOD FIXED WINDOWS SASH INWARD

Drawing no.: JS-2-IN	Drawn by: S. Marcotte
Scale: NONE	Date revised: 05/12/06
Date drawn: 01/10/99	Page: 4 / 12
File: JS-2-IN	

STRUCTURALLY REVIEWED BY:
Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
1-27-11

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 11-0201.02
Expiration Date 03/01/2012
By *[Signature]*
Miami Dade Product Control


OVAL FIXED SHAPES

CONFIGURATIONS: O


VIEWED FROM THE INSIDE
WOOD: Mahogany

DESIGN PRESSURE
Positive Pressure: +58 psf Negative Pressure -68 psf
NOTE: Refer to basic rectangles for minimum and maximum sizes width (FW) & height (FH) NO SHUTTERS ARE REQUIRED.

TO DETERMINE THE MAX. FW AND FH: SHAPES ON THIS PAGE MUST BE INSCRIBED INTO ANY ONE OF THE FOLLOWING BASIC RECTANGLES
42" (FW) x 111 3/8" (FH)
111 3/8" (FW) x 42" (FH)
72 7/16" (FW) x 72 7/16" (FH)
76 3/4" (FW) x 58 1/2" (FH)

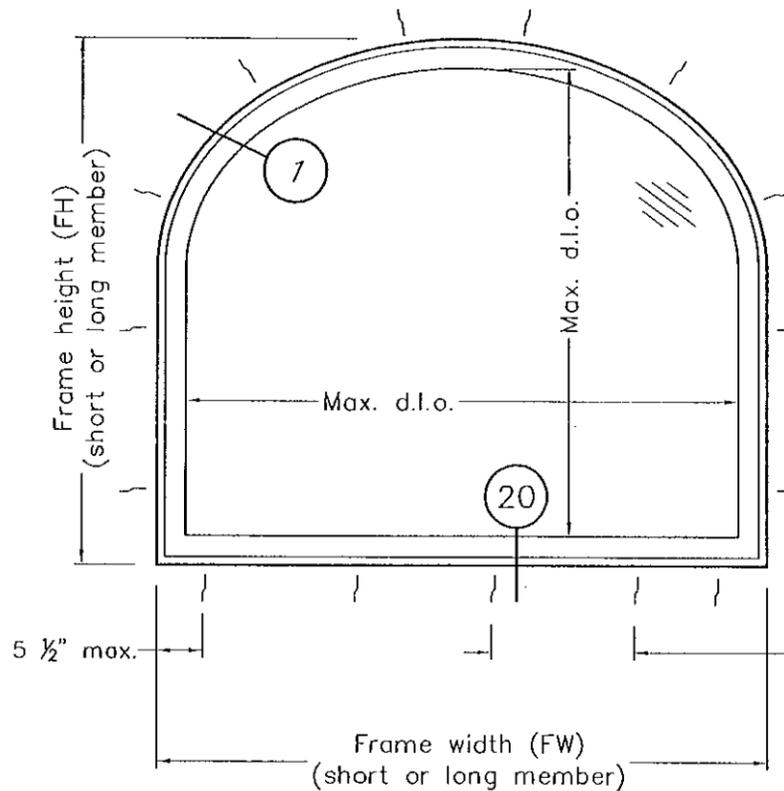

See GENERAL INSTALLATION INTO SUBSTRATE chart on sheet 1 for dist. on centers

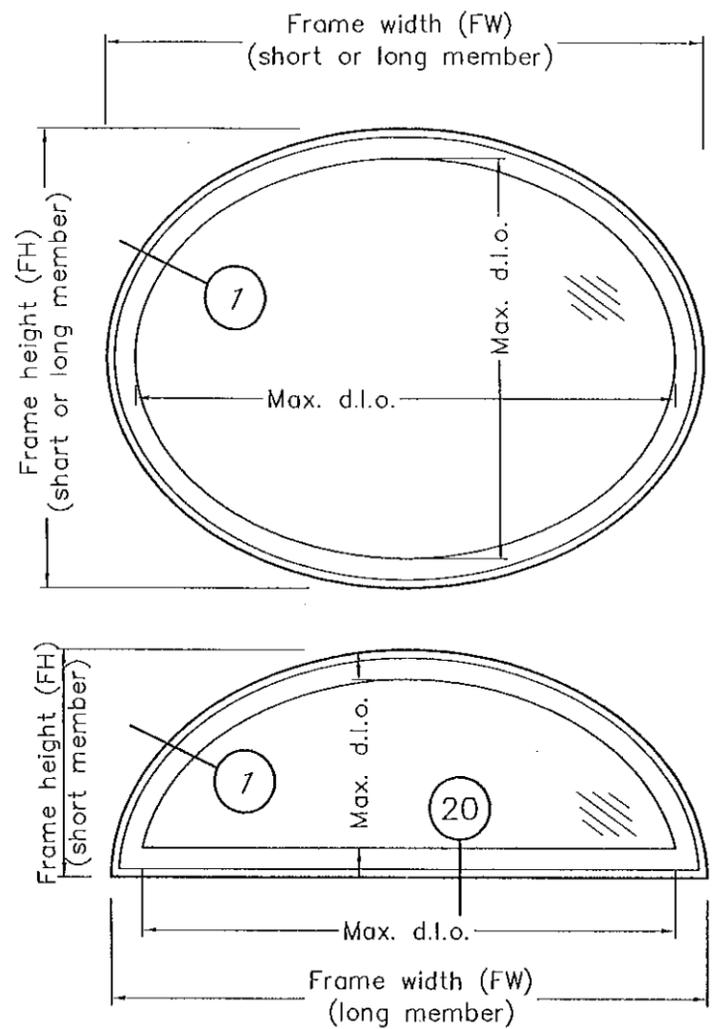

Information on this page applies to cross sections 1&20 (sash "inward") ONLY

Frame Size vs d.i.o. relation is:
Long d.i.o.= long frame dimension - 9"
Short d.i.o.=short Frame dimension- 9"

NOTE:
See sections 1 and 20 on pages 6 & 7 respectively.

TYPE OF GLASS: SINGLE, 15/32" LAMINATED
The rectangular glass d.i.o. circumscribing the shaped unit must be taken and checked into table 2, sheet 11/12
For sizes shown on table 2, sheet 11: TYPE 1, MADE OF: 3/16" (AN) - 0.090" PVB Saflex III G interlayer by Solutia-3/16"(HS)
For sizes over those on table 2: TYPE 2, MADE OF: 3/16"(HS) - 0.090" PVB Saflex III G interlayer by Solutia-3/16"(HS) OR TYPE 3, MADE OF: 3/16" (FT) - 0.090" PVB Saflex III G interlayer by Solutia-3/16"(FT)
WP: 1 3/4" RAISED WOOD PANEL
Solid Mahogany, MAX. D.L.O. AREA: 7.81 sqf. See detail on sheet 9

Spacing: All fasteners spacing is 5 1/2" from corners and o/c as specified in GENERAL INSTALLATION INTO SUBSTRATE chart on sheet 1.

Shim Space: 3/8" MAX. @ head, jambs & sill. Use std shims behind as required.

Min. edge distance is 2 1/2" for masonry fasteners .



JS SERIES WOOD FIXED WINDOWS SASH INWARD

Drawing no.:	JS-2-IN
Scale:	NONE
Drawn by:	S. Marcotte
Date drawn:	01/10/99
Date revised:	05/12/06
File:	JS-2-IN
Page:	5 / 12

STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING, INC
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
JAN 27 2011

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 11-0201-02
Expiration Date 02/01/2012
By *[Signature]*
Miami Dade Product Control



1855 GRIFFIN ROAD,
SUITE A-271
DANIA, FL 33004

JS SERIES
WOOD FIXED WINDOWS
SASH INWARD

Drawing no.: JS-2-IN

Scale: NONE
Drawn by: S. Marcotte

Date drawn: 01/10/99
Date revised: 05/12/06

File: JS-2-IN
Page: 6 / 12


STRUCTURALLY REVIEWED BY:

Scott Walters
SCOTT WALTERS
FL PE# 62354


WALTERS ENGINEERING, INC
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
JAN 27 2011

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 11-0201.02
Expiration Date 03/01/2012
By *[Signature]*
Miami Dade Product Control


FOR WINDOWS UP TO
64 3/4" FW OR 69 1/4" FH
26 FIXED ASTRAGAL
sash -inward

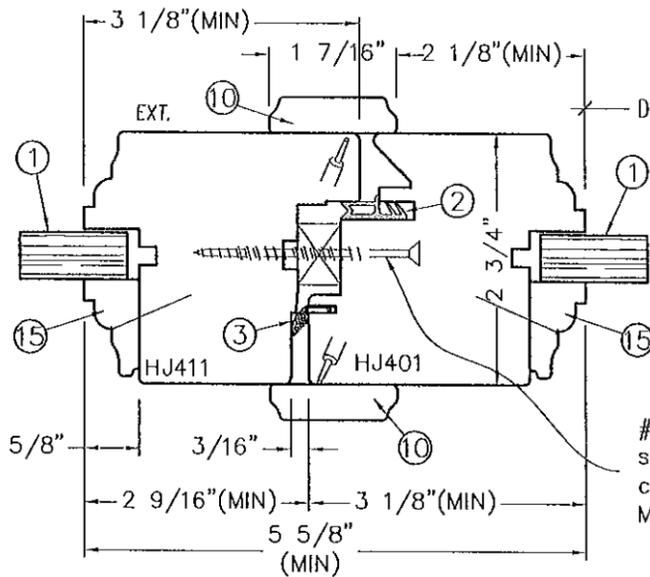

8a horizontal
or vertical
SASH BAR
w/ wood panel
(Optional)

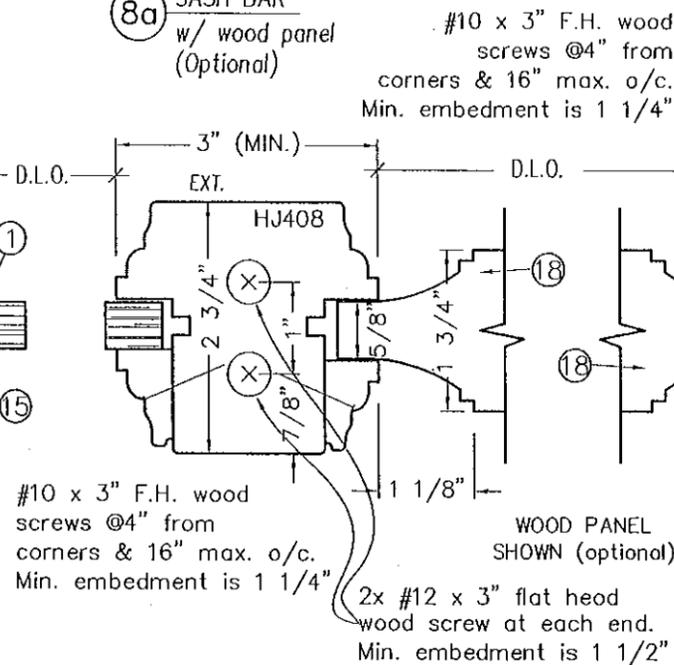


1 JAMB, sash inward
(1x & INSTALLATION BRACKET)

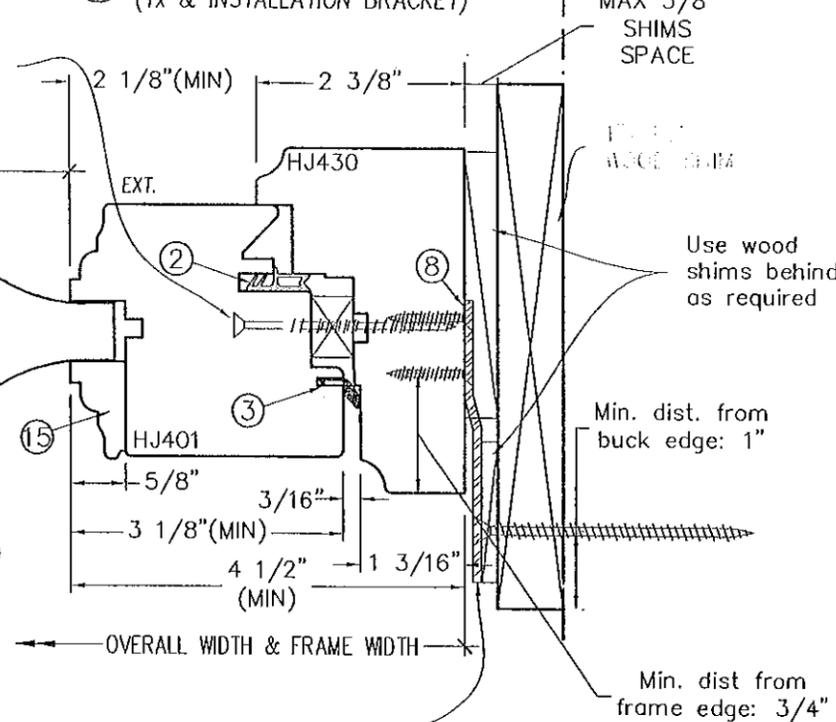


FOR WINDOWS UP TO
76 3/4" FW OR 80 3/4" FH

24 FIXED ASTRAGAL
sash inward

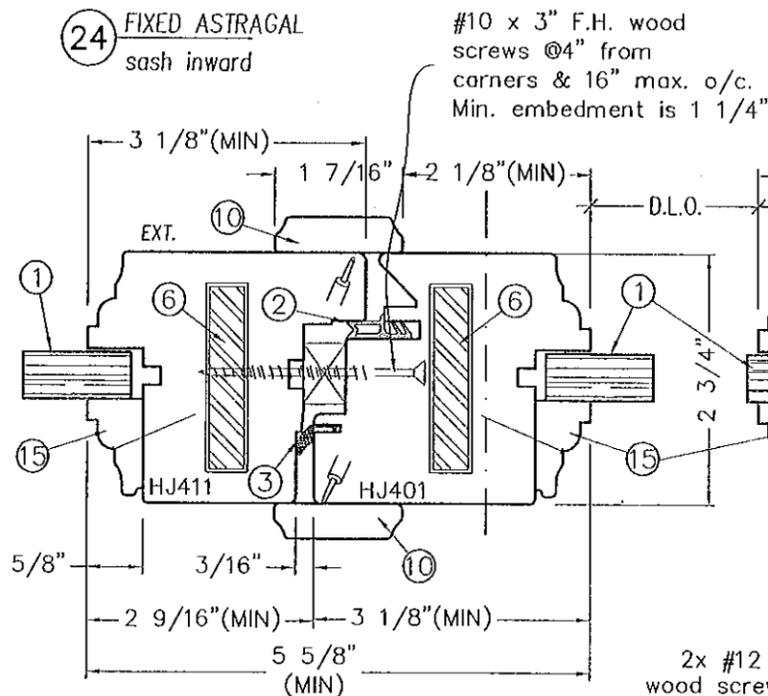


#10 x 3" F.H. wood
screws @4" from
corners & 16" max. o/c.
Min. embedment is 1 1/4"

8b horizontal
or vertical
SASH BAR
(Optional)

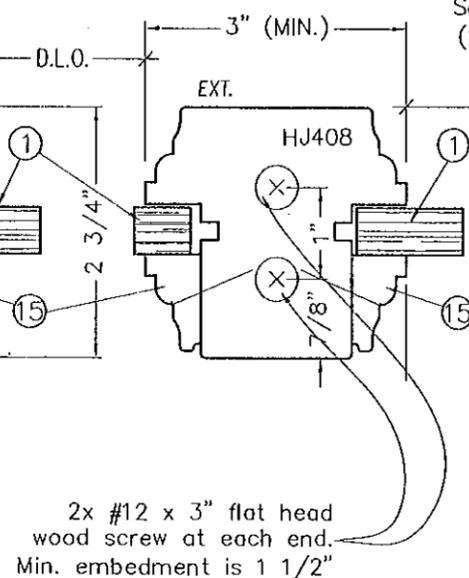

Installation bracket PDF-FS-05/D
screwed @ max. 11" o/c, to
the buck frame using (2) #12
x 1 1/2" all threaded (a.T.) wood
screws. Min. embedment is 1 1/4".
Screwed to the unit frame using
(2) #10 x 1" a.T. wood screws.
Min. embedment is 7/8".

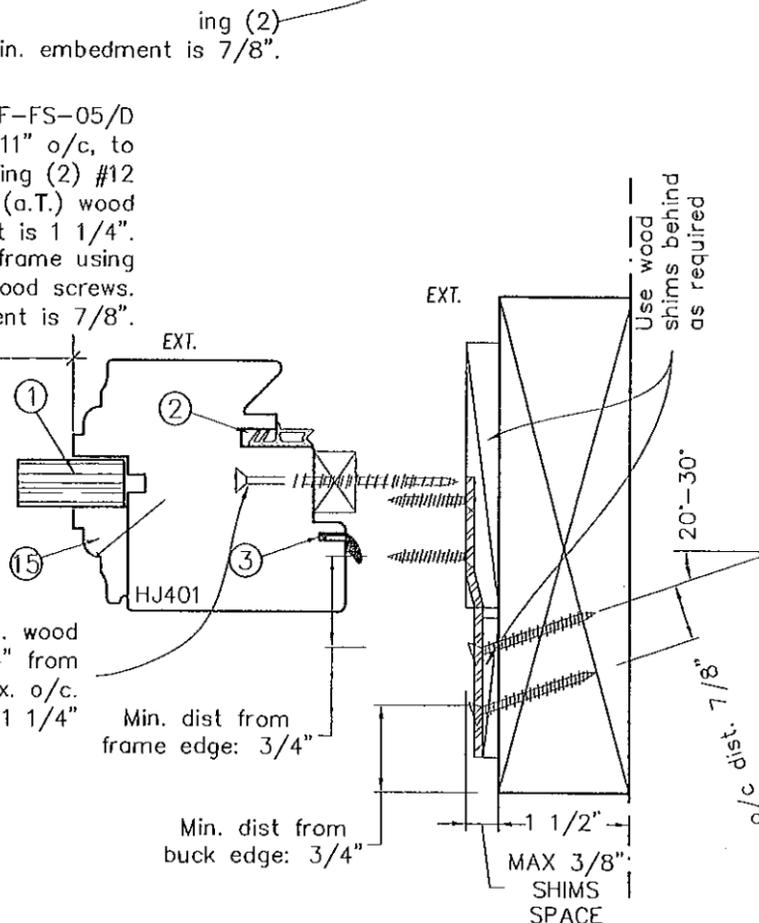

NOTE: Clear "Spectrem 2" silicone sealant at shown interfaces **#** NUMBERS ARE REFERRING TO THE ASSEMBLY LISTS ON PAGES 9 TO 11



1855 GRIFFIN ROAD,
SUITE A-271
DANIA, FL 33004







**JS SERIES
WOOD FIXED WINDOWS
SASH INWARD**

Drawing no.: JS-2-IN	
Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/99	Date revised: 05/12/06
File: JS-2-IN	Page: 8 / 12

STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
JAN 27 2011

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **11-0201-02**
Expiration Date **03/01/2012**
By *[Signature]*
Miami Dade Product Control

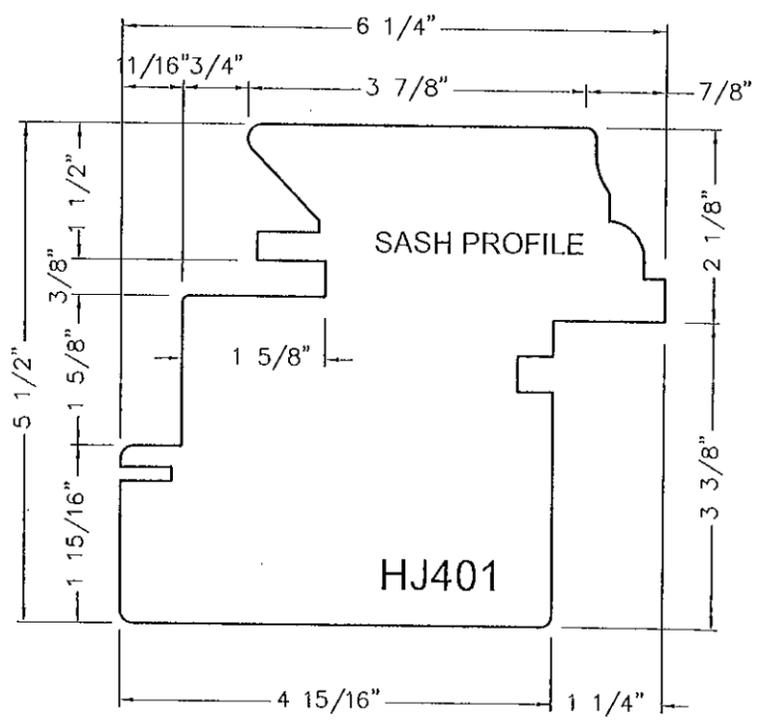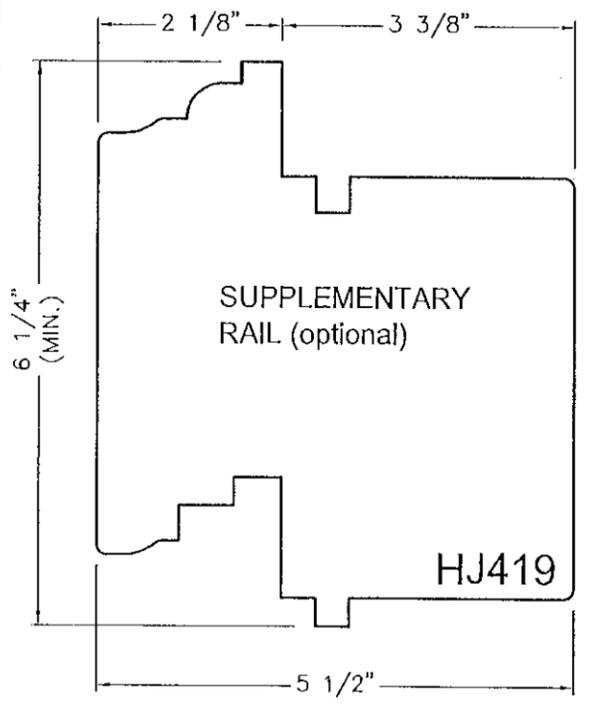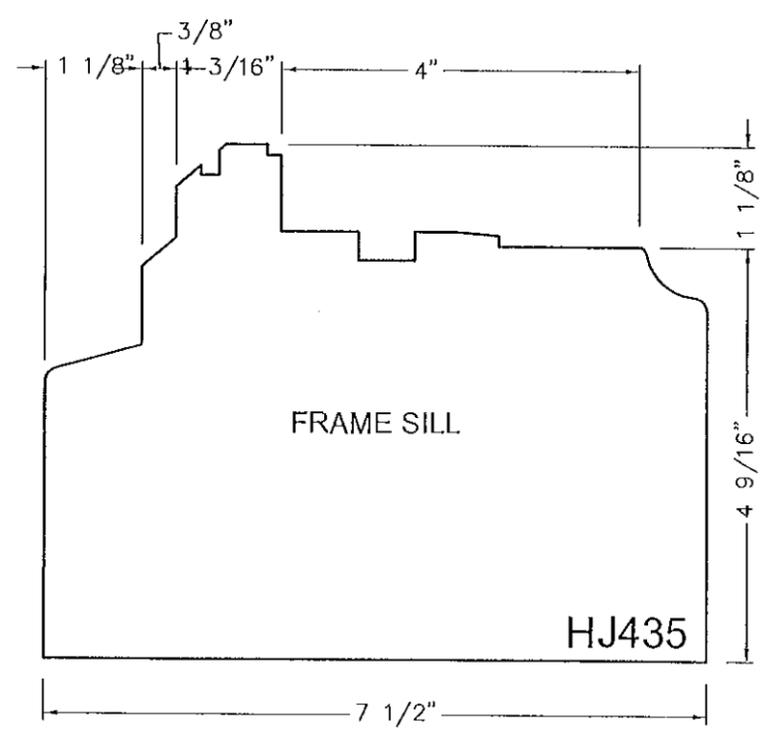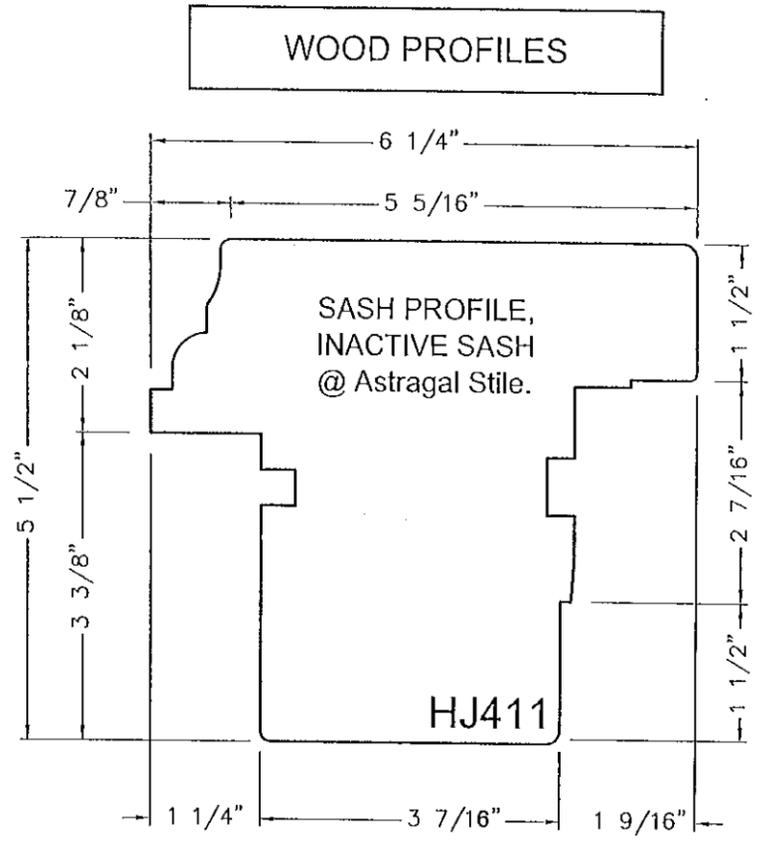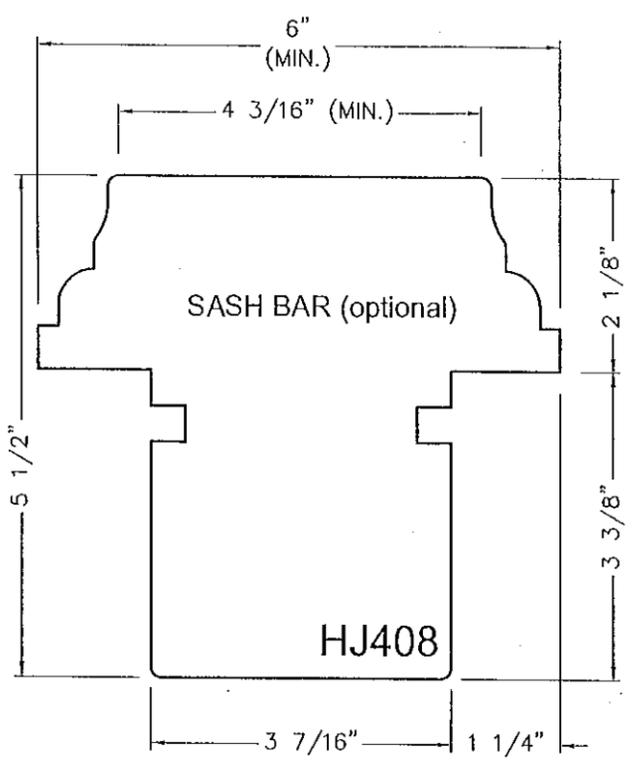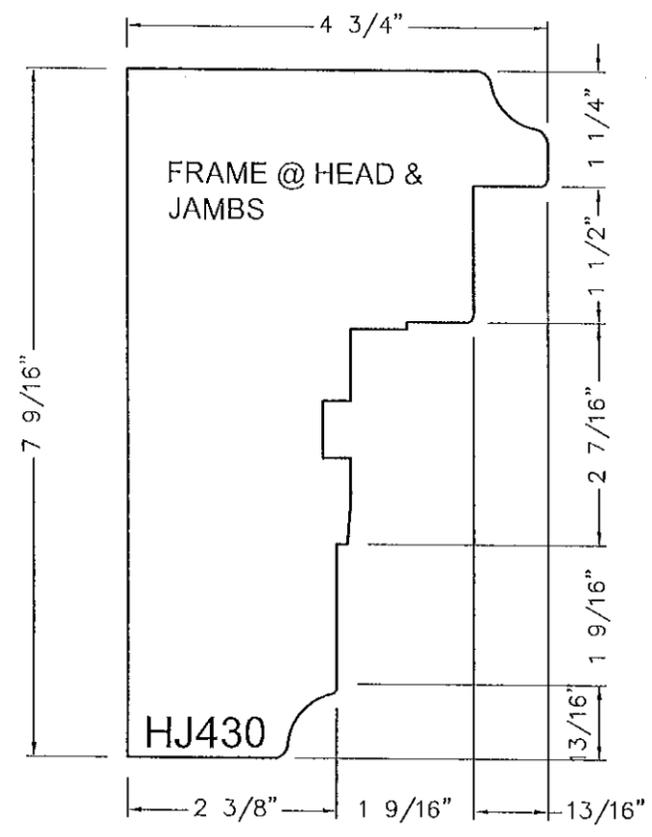



1855 GRIFFIN ROAD,
SUITE A-271
DANIA, FL 33004

JS SERIES
WOOD FIXED WINDOWS
SASH INWARD


Drawing no.: JS-2-IN
Scale: NONE Drawn by: S. Marcotte
Date drawn: 01/10/99 Date revised: 05/12/06
File: JS-2-IN Page: 9 / 12

STRUCTURALLY REVIEWED BY:

Scott Wolters

SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
JAN 27 2011

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0201-02
Expiration Date 03/01/2012
By *[Signature]*
Miami Dade Product Control

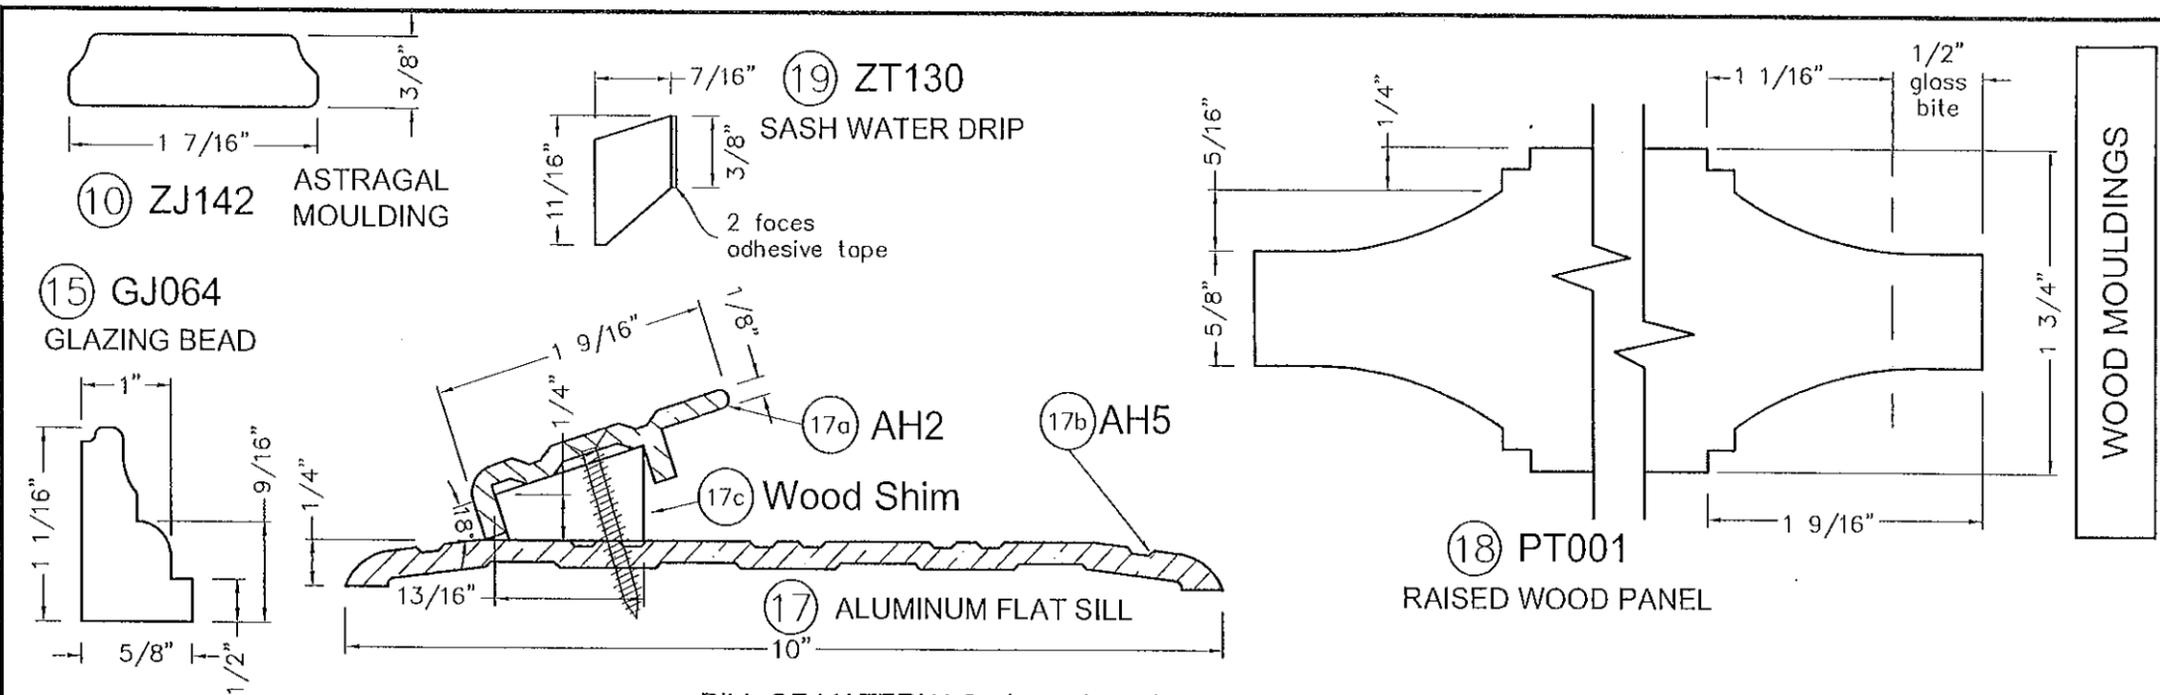

BILL OF MATERIALS (see also related cross sections details)

REF.	QTY	Component	DESCRIPTION	MATERIAL	DIMENSIONS	MEAN OF ATTACHMENT	LOCATION
10	2 per astragal meeting	Astragal moulding	ZJ142 astragal wood cover. Square cut at the ends.	Mahogany	3/8"(d) x 1 7/16"(w) x sash height	18 gauge, 5/8" galvanized finishing nails spaced 16" o/c.	SASH INWARD: One nailed on the interior face of the active sash & one nailed on the exterior face of the passive sash.
15	1 per glass edge	Glazing bead	GJ064 wood profile, mitre cut at corners.	Mahogany	1 1/16"(d) x 5/8"(w)	18 gauge, 1" finishing nails spaced 2" from the corners and 10" o/c	@ the perimeter of the glass or wood panel; Nailed through the glazing bead to the sash profile. SEE ALSO "GLAZING METHOD", SHEET 14/15
17a	1 per door sill	Flat saddle	AH5 aluminum profile	Alu. alloy 6063-T5	1/4"(h) x 5"(d) x 1/8"(t)	2x #12 x 2" F.H. screw	Door frame sill. Screwed @ both ends into the unit frame jambs. Square cut @ ends. See "Aluminum flat sill assembly" on sheet 12 / 12.
17b	1 per door sill	Stopper	AH2 aluminum profile	Alu. alloy 6063-T5	3/8"(h) x 1 9/16"(d) x 1/8"	#12 x 1" flat head screws	Door frame sill. Screws spacing is 14" o/c. Butt joint against the frame jambs @ both ends.
17c	1 per door sill	Shim	Continuous wood shim	Mahogany	13/16"(d) x 1/2"(h)	See AH2 screw.	Door frame sill. Screws spacing is 14" o/c. Butt joint against the frame jambs @ both ends.
18	One	Wood panel	Raised wood panel: 5/8"(t) @ flanges, 1 3/4"(t) @ center.	Mahogany	1" wider & higher than glass opening.	Dow Corning 995 structural silicone at the perimeter;	Where indicated as WP (WOOD PANEL) on elevations
19	1 per sash, open in	Sash water drip	ZT130 Wood moulding. Square cut at the ends	Mahogany	7/16"(d) x 11/16"(w)	18 gauge, 1" finishing nails spaced 2" from the corners and 10" o/c	SASH INWARD ONLY: Nailed against the exterior face of the bottom rail of the operable sashes; a double face adhesive tape is used in between.

REF. NUMBERS ARE RELATED TO THOSE USED ON CROSS SECTIONS DRAWINGS

Clear "Spectrem 2" silicone sealant at shown interfaces



1855 GRIFFIN ROAD,
SUITE A-271
DANIA, FL 33004

JS SERIES
WOOD FIXED WINDOWS
SASH INWARD

Drawing no.: JS-2-IN

Scale: NONE
Drawn by: S. Marcotte

Date drawn: 01/10/99
Date revised: 05/12/06

File: JS-2-IN
Page: 11 / 12


STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING, INC
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
JAN 27 2011

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 11-0201.02
Expiration Date 03/01/2012
By *[Signature]*
Miami Dade Product Control

GLAZING METHOD (inside glazed)

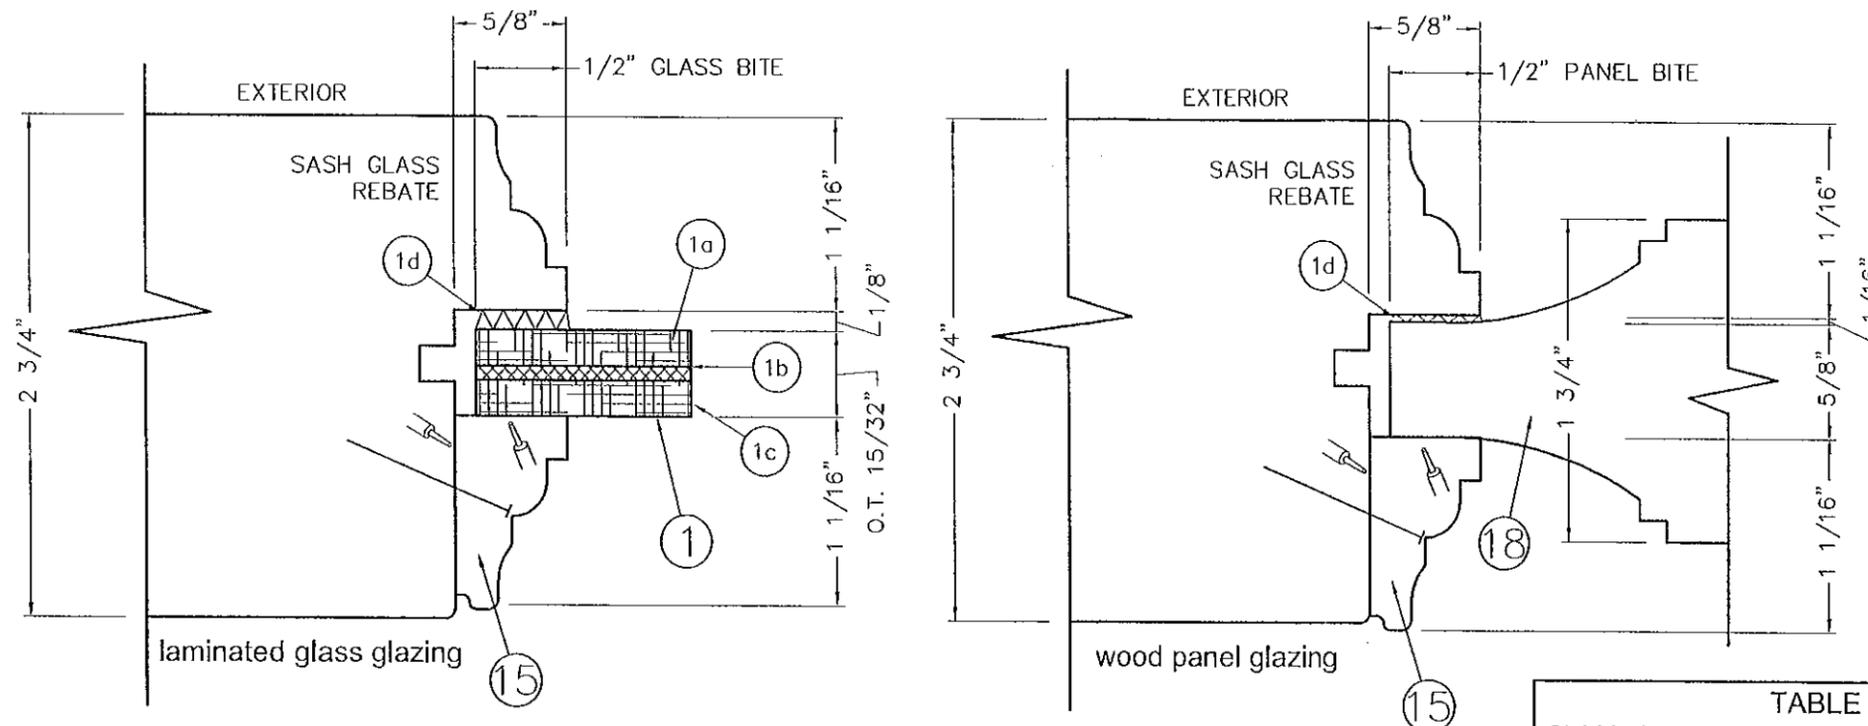

BILL OF MATERIALS

REF.	Component	DESCRIPTION	MEAN OF ATTACHMENT	LOCATION
①	Impact Glass, see components 1a,1b,1c	15/32" (t) Laminated glass (3/8" [10mm] designation)	See components 1d, and 15	As indicated on elevations drawings by the symbol.
①a	Exterior glass sheet	3/16" (t) (5mm) as following: >Type 1: Annealed glass for d.l.o. dimensions on table 3 >Type 2: Heat strengthened glass for d.l.o. dimensions exceeding those into table 3	See components 1b: PVB interlayer	Exterior side
①b	Saflex III G PVB interlayer by Solutia	Saflex III G 0.090" (t) PVB plastic film by Solutia, per current approval	2 sides adhesive film	Between the interior and the exterior sheets of glass
①c	Interior glass sheet	3/16" (t) (5mm) heat strengthened glass	See components 1b: PVB interlayer	Interior side (glazing bead side)
①d	Structural silicone	Dow Corning 995 black silicone	1/8"(t) x 1/2"(w) bonding extrusion	Continuous extrusion between the wood back fence & the exterior sheet edge of the laminated glass or wood panel.
⑮	Glazing bead	GJ064 wood profile (5/8"(t) x 1 1/16"(d))	18 gouge, 1" finishing nails spaced 2" from the corners and 10" o/c	@ the perimeter of the glass.
⑮	Wood panel	Mahogany, raised: 5/8"(t) @ flanges, 1 3/4"(t) @ center; Max. d.l.o. area up to 7.81 sqf	See components 1d, and 15	As indicated on elevation drawings.

TABLE 2
GLASS TYPES FOR FRAME DIMENSIONS OF TABLE 1 OR FOR BASIC RECTANGLES GIVEN ON SHEETS 2, 3, 4 AND 5 OF THIS DRAWING

If, for a given long member d.l.o., the actual short member daylight opening exceeds the maximum dimension indicated on table 2, then

TYPE 2 heat strengthened laminated glass
[3/16" HS - .09" PVB interlayer, Saflex III G by Solutia - 3/16" HS]

OR TYPE 3 full tempered laminated glass
[3/16" FT - .09" PVB interlayer, Saflex III G by Solutia - 3/16" FT]


MUST BE USED

Maximum daylight opening for type 1 laminated glass [3/16" AN - .090" PVB interlayer by Solutia - 3/16" HS]


Given Long member d.l.o. up to (in.)	Max. short member d.l.o. (in.)	Given Long member d.l.o. up to (in.)	Max. short member d.l.o. (in.)
47 1/4	47.244	90 1/2	28.150
51	41.339	94 1/2	27.953
55	38.386	98 1/2	27.559
59	36.220	102 1/4	27.362
63	34.055	106 1/4	26.969
66	32.480	110 1/4	26.772
70 3/4	31.496	114	26.575
74 3/4	30.512	118	26.378
78 3/4	29.528	122	26.220
82 1/2	28.937	126	26.102
86 1/2	28.543	130	25.984

Clear "Spectrem 2" silicone sealant at shown interfaces


REF. NUMBERS ARE RELATED TO THOSE USED ON CROSS SECTIONS DRAWINGS

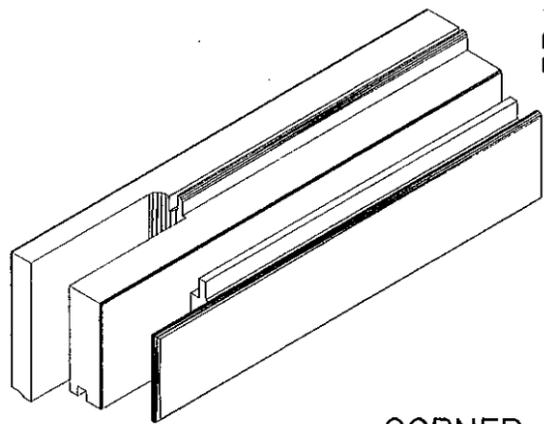

TYPE OF GLUE:
RESIBOIS 222 no 30222-01 TYPE 1
EXTERIOR GLUE FOR WOOD

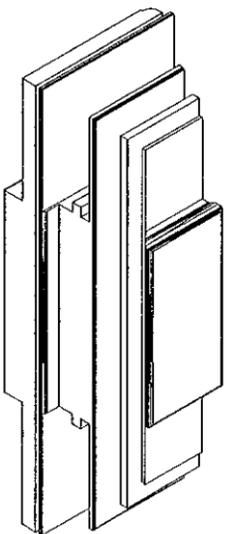


CORNER
ASSEMBLY
(MULTI-FORK)

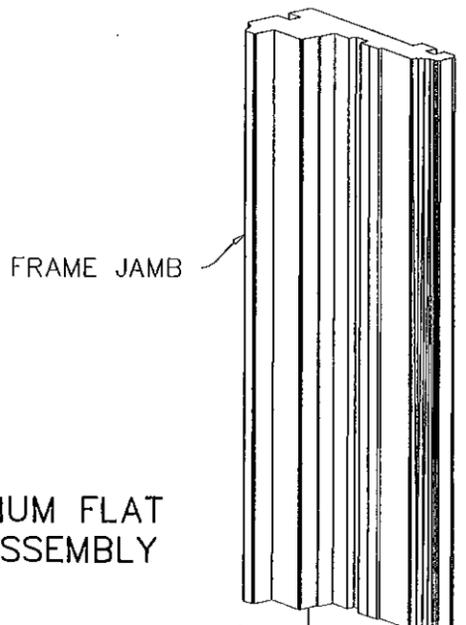


FRAME JAMB

ALUMINUM FLAT
SILL ASSEMBLY

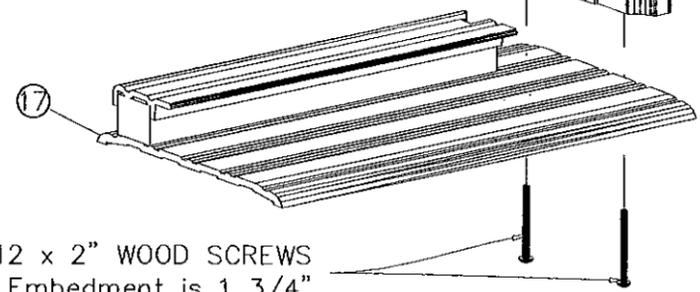

#12 x 2" WOOD SCREWS
Embedment is 1 3/4"

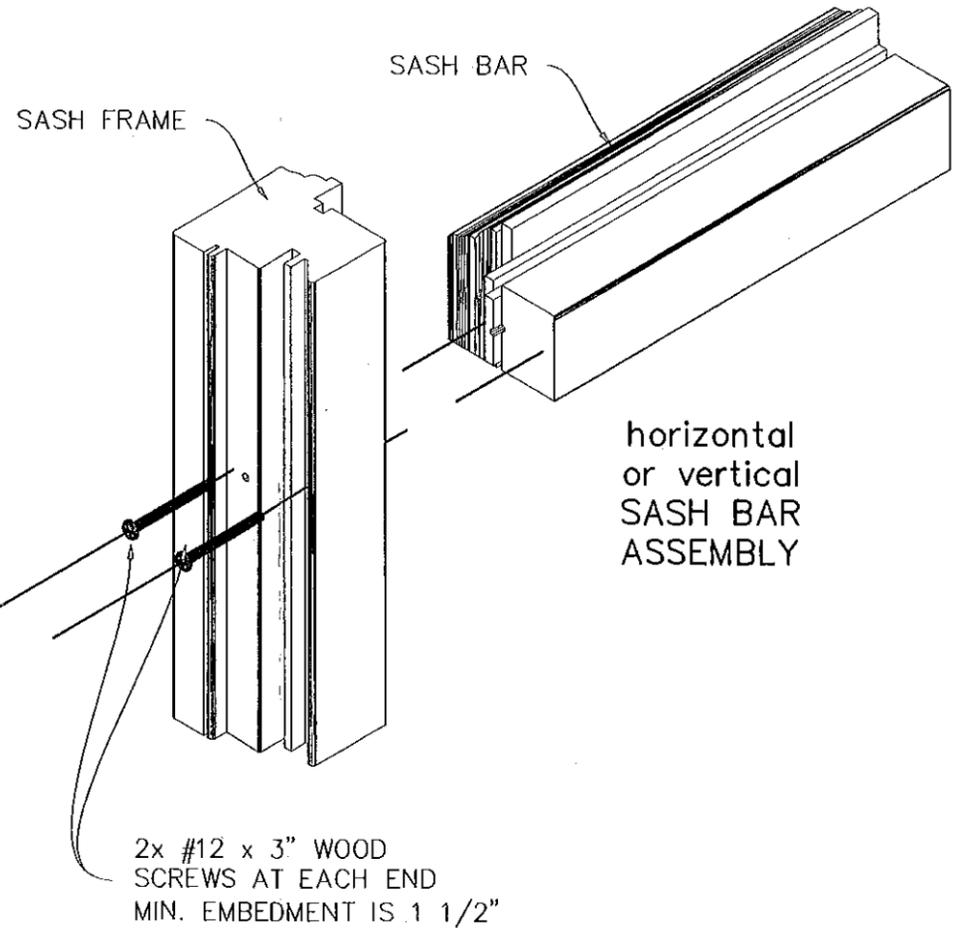

SASH FRAME

SASH BAR

horizontal
or vertical
SASH BAR
ASSEMBLY

2x #12 x 3" WOOD
SCREWS AT EACH END
MIN. EMBEDMENT IS 1 1/2"



1855 GRIFFIN ROAD,
SUITE A-271
DANIA, FL 33004

JS SERIES
WOOD FIXED WINDOWS
SASH INWARD

Drawing no.: JS-2-IN	
Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/99	Date revised: 05/12/06
File: JS-2-IN	Page: 12 / 12

STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
JAN 27 2011

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0201.02
Expiration Date 03/01/2012
By *[Signature]*
Miami Dade Product Control