



**BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION**

**MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION**
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/building/

NOTICE OF ACCEPTANCE (NOA)

Innovative Distribution LLC, DBA J.M. Metals
1505 Cox Road
Cocoa, FL 32926

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County BNC - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BNC reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Nail Strip @ Metal Roof Panel

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This revises NOA#09-0121.14 and consists of pages 1 through 7.
The submitted documentation was reviewed by Alex Tigera.



NOA No.: 11-0207.03
Expiration Date: 02/11/14
Approval Date: 04/21/11
Page 1 of 7

ROOFING SYSTEM APPROVAL:

Category: Roofing
Sub-Category: Metal, Panels(Non-Structural)
Material: Steel /Copper Plus
Deck Type: Wood
Maximum Design Pressure -118 psf

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
Nail Strip Metal Panel	l = various w = 16" min. 0.0190" thick	TAS 110 & TAS 125	Metal Roof panel coated with coatings of Fluoropon®.
Nail Strip Copper Plus Panel	l = various w = 16" min. 0.0190" thick	TAS 110 & TAS 125	Copper Plus Roof panel.
Trim Pieces	l = varies w = varies min. 0.0190" thick	TAS 110	Standard flashing and trim pieces. Manufactured for each panel width.

EVIDENCE SUBMITTED

Test Agency	Test Identifier	Test Name/Report	Date
The Valspar Corporation	Lab Test Certification	ASTM B-117 ASTM G-23	03/08/03
Hurricane Test Laboratories, Inc.	0223-0313-02	TAS 125	04/22/02
Hurricane Test Laboratories, Inc.	0223-1015-06	TAS 125	11/20/06
PRI Asphalt Technologies, Inc.	JMM-002-01-01	TAS 100	02/07/03
Hurricane Engineering and Testing, Inc.	HETI-08-T102	ASTM E 8	01/16/08



NOA No.: 11-0207.03
 Expiration Date: 02/11/14
 Approval Date: 04/21/11
 Page 2 of 7

APPROVED ASSEMBLIES

SYSTEM A-1: "Nail Strip" 26 ga. Metal or "Nail Strip" Copper Plus Panels

Deck Type: Wood, Non-insulated

Deck Description: $1\frac{9}{32}$ " or greater plywood or wood plank.

Slope Range: 2":12" or greater

Maximum Uplift

Pressure: See Fastening Conditions Below

Deck Attachment: In accordance with applicable Building Code, but in no case shall it be less than 8d ring shank nails spaced 6" o.c. In reroofing, where the deck is less than $1\frac{9}{32}$ " thick (Minimum $1\frac{5}{32}$ "") The above attachment method must be in addition to existing attachment.

Underlayment: Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant tin-caps and 12 gauge 1 $\frac{1}{4}$ " annular ring-shank nails, spaced 6" o.c. at all laps and two staggered rows 12" o.c. in the field of the roll. Or, any approved underlayment having a current NOA.

Valleys: Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with Innovative Distribution LLC, DBA J.M. Metals' current published installation instructions.

Fire Barrier Board: Any approved fire barrier having a current NOA. Refer to a current fire directory listing for fire ratings of this roofing system assembly as well as the location of the fire barrier within the assembly. See Limitation # 1.

Metal Panels and Accessories:

Install the "Nailstrip Roofing Panels" and accessories in compliance with Innovative Distribution LLC, DBA J.M. Metals' current, published installation instructions and details. Flashing, penetrations, valley construction and other details shall be constructed in compliance with the minimum requirements provided in Roofing Application Standards RAS 133.

- Fastening Pattern (field condition)**
1. At the eave, rake, and ridge, fasteners shall be located not more than 1" away from the panel end.
 2. 1" Nail Strip Roofing panels shall be attached to the plywood substrate along its male rib with a minimum of #10 x 1" pancake head, corrosion resistant screw of sufficient length to penetrate through the sheathing a minimum of $\frac{3}{16}$ ", at a spacing not exceed 6" o.c. parallel to the slope of the roof. (See detail A)
 3. Attach adjacent panel by placing the female rib over the male rib.

Maximum Design Pressure (field Condition): -55 psf. (See General Limitation #2)



NOA No.: 11-0207.03
Expiration Date: 02/11/14
Approval Date: 04/21/11
Page 3 of 7

**Fastening Pattern
(perimeter and
corner condition)**

1. At the eave, rake, and ridge, fasteners shall be located not more than 1" away from the panel end.
2. 1" Nail Strip Roofing panels shall be attached to the plywood substrate along its male rib with a minimum of #10 x 1" pancake head, corrosion resistant screw of sufficient length to penetrate through the sheathing a minimum of $\frac{3}{16}$ ", at a spacing not exceed 6" o.c. parallel to the slope of the roof. **(See Detail A)**
3. Apply a 1/8" x 1/8" bead of Bostik® Chem-Calk® 915 polyurethane sealant atop the rear leg of the male joint, adjacent to the fasteners and along the entire length of the panel. **(See Detail B)**
4. Attach adjacent panel by placing the female rib over the male rib.

**Maximum Design Pressure: -118 psf. (See General Limitation #2)
(Perimeter and corner cond.)**

SYSTEM LIMITATIONS

1. Fire classification is not part of this acceptance; refer to a current Approved Roofing Materials Directory for fire ratings of this product.
2. The maximum designed pressure listed herein shall be applicable to all roof pressure zones (i.e. field, perimeters, and corners). Neither rational analysis, nor extrapolation shall be permitted for enhanced fastening at enhanced pressure zones (i.e. perimeters, extended corners and corners).
3. Panels shall be roll formed in continuous lengths from eave to ridge. Maximum lengths shall be as described in Miami-Dade County Roofing Application Protocol RAS 133.
4. All panels shall be permanently labeled with the manufacturer's name and/or logo, and the following statement: "Miami-Dade County Product Control Approved" or with the Miami-Dade County Product Control Seal as seen below. All clips shall be permanently labeled with the manufacturer's name and/or logo, and/or model.






5. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 9B-72 of the Florida Administrative Code.
6. Panels may be jobsite roll formed with machine model #06010463 from JM Coils Association Inc.



PROFILE DRAWINGS


DETAIL A

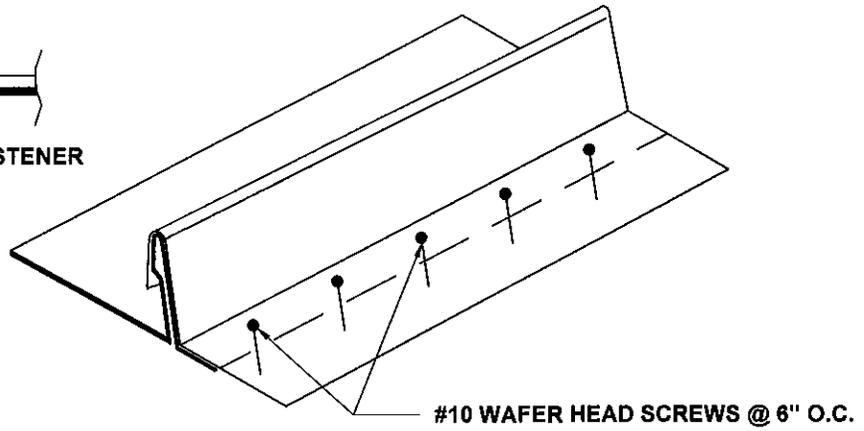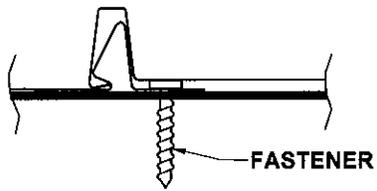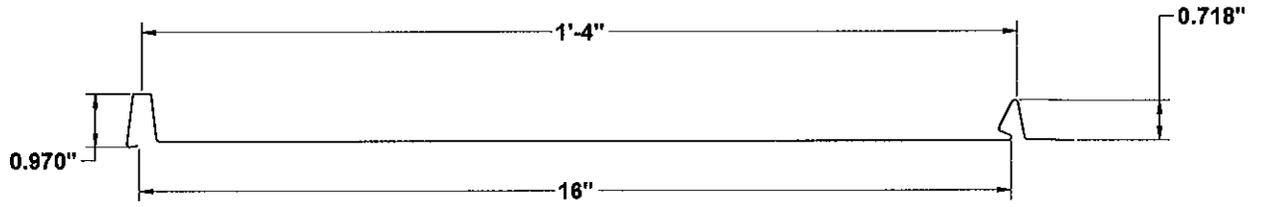

"NAIL STRIP" METAL OR COPPER PLUS ROOF PANELS



DETAIL B

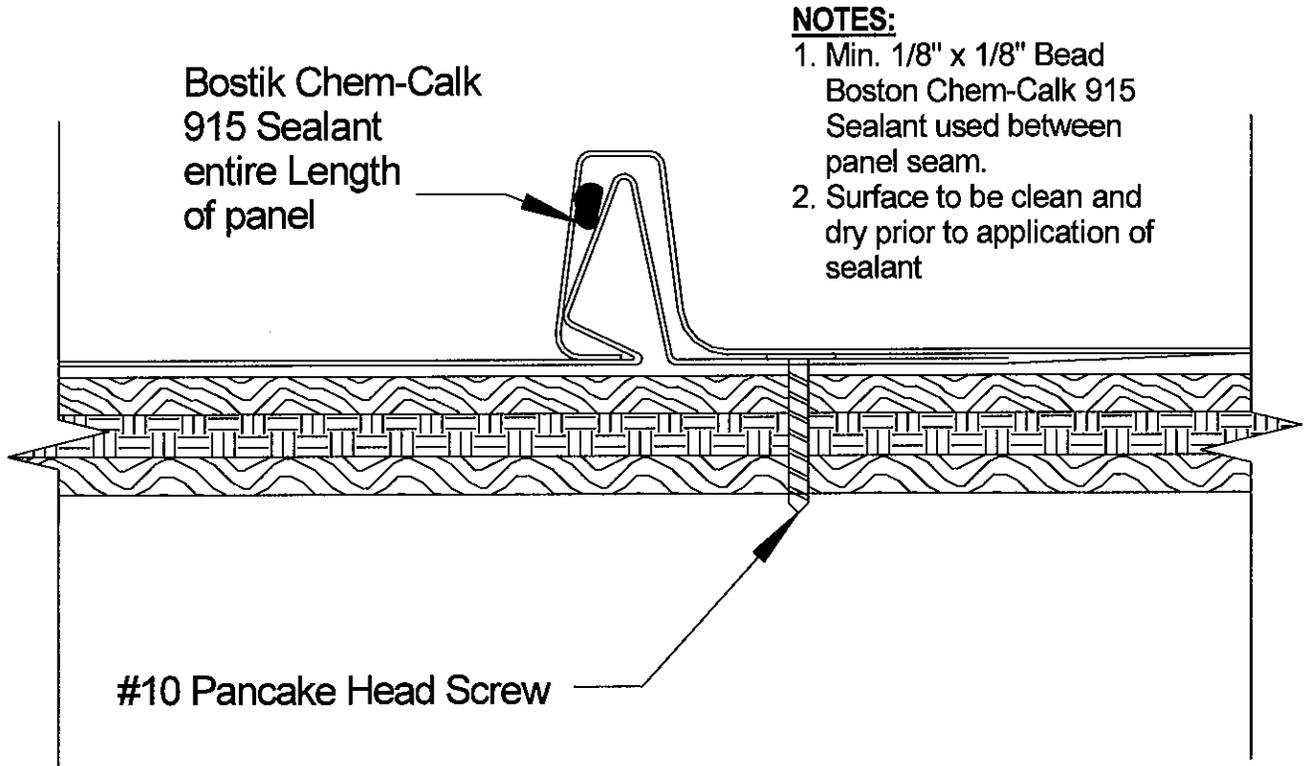

END OF THIS ACCEPTANCE

