

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/building/home/asp

**Master Security Doors Inc.,
2179 N. Powerline Road, Suite #2
Pompano Beach, FL 33069**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County BNC -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BNC reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "EX3" Single Inswing Steel Door -L.M.I.

APPROVAL DOCUMENT: Drawing No. 11-036, titled "EX3 USA Inswing Door Large Missile Impact Resistant", sheets 1 through 11 of 11, dated 11/10/05 and last revised on 04-18-11, prepared by Tilteco Inc., signed and sealed by Walter A. Tillit Jr., P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

Limitation:

1. Refer to sheet 3 of the Dwgs for Design Pressure Vs anchor type and anchor spacing "S"
2. Min (5) retention clip per side jamb required (Max 28.74" OC), See detail X/11 in sheets 3 and 11.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and Series/Model and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises & renews NOA # 05-1121.04 and consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



NOA No 11-0228.03
Expiration Date: February 23 , 2016
Approval Date: April 28, 2011
Page 1

4/20/11

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS (transferred from file # 05-1121.04)

1. Manufacturer's die drawings and sections.
2. Drawing No. **11-036**, titled "EX3 USA Inswing Door Large Missile Impact Resistant", sheets 1 through 11 of 11, dated 11/10/05 and last revised on 04-18-11, prepared by Tilteco Inc., signed and sealed by Walter A. Tillit Jr., P.E.

B. TESTS (transferred from file # 05-1121.04)

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

Along with marked-up drawings and installation diagram of inswing steel door, prepared by American Test Lab of South Florida, Test Report No. **ATL# 0708.01-05**, dated 11/09/05, signed and sealed by William R. Mehner, P.E.

C. CALCULATIONS

1. Statement letter of compliance to FBC 2007, dated 04/14/11 issued by Tilteco Inc., signed and sealed by Walter A. Tillit Jr., P.E.
2. Anchor Calculation and Structural analysis complying w/ FBC 2004, prepared by Tilteco, Inc., dated 09/09/05, signed and sealed by Walter A. Tillit Jr., P.E. (transferred from file # 05-1121.04)

D. QUALITY ASSURANCE

1. Miami Dade Building and Neighborhood Compliance Department (BNC).

E. MATERIAL CERTIFICATIONS

1. Tensile test report # 5HM-763 dated Aug 17, 2005 per ASTM E-8, issued by Metallurgical Inc, signed by Frank Grate.

F. STATEMENTS

1. Statement letter of compliance to FBC 2007, dated 04/14/11 issued by Tilteco Inc., signed and sealed by Walter A. Tillit Jr., P.E.
2. Statement letter dated October 11, 2005, "No financial interest" and conformance to FBC 2004, signed and sealed by Walter A. Tillit, P.E. (transferred from file # 05-1121.04)
3. Statement of lab compliance, as part of the test report.

G. OTHER

1. This NOA **revises & renews** NOA # **05-1121.04**, expired on February 23, 2011.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.

Product Control Examiner

NOA No 11-0228.03

Expiration Date: February 23, 2016

Approval Date: April 28, 2011

GENERAL NOTES

1. EX-3 USA, Inswing single door, large missile impact resistant shown on this Product Approval Document (P.A.D.) has been verified for compliance in accordance with the 2007 edition of the Florida Building Code. Door may be installed at High Velocity Hurricane Zones. Design wind loads shall be determined as per section 1620 of the above mentioned code. In order to verify that anchors on this P.A.D., as tested, were not overstressed, a 33% increase in allowable stresses for wind loads was not used in their analysis. A duration factor $C_D = 1.60$ was used to verify fasteners in wood. This door's adequacy for impact and cyclic resistance has been verified in accordance with section 1626 of the above mentioned code, as per TAS 201, 202 and 203 protocols, per ATL Report #0708.01-05, and as per submitted calculations performed as per section 1612 of the Florida Building Code.

2. **Max Design Pressure Rating: + 70, -200 psf**
This pressure rating is only valid if door is assembled with required hardware indicated on sheet 2 of this drawing.

3. **This Door is approved for Air and Water Infiltration.**
This approval is only valid if door is sealed with required gasketing and weather stripping as indicated on Bill of Materials on sheet 3, and sealant specified on General Note 10 below.

4. **This Door will not require a Hurricane Protective Device.**

5. Wood bucks by others, and must be properly anchored to transfer loads to the existing structure. Wood bucks must be Southern Pine #2, with specific Gravity G equal or greater than 0.55.

6. Anchors for fastening door subframe to existing structure must be as indicated on sheet 3.

7. All welding to conform to the 2007 American welding Society AWS D1.3 and AWS D1.9. Regulations. Use certified welders.

8. All screws used for assembly connections (metal to metal) to be stainless steel 304 or 316 series or corrosion resistant coated carbon steel as per DIN 50018 with 50 ksi minimum yield strength and 90 ksi tensile strength and shall comply with F.B.C. section 2411.3.3.4

9. Remaining components for this door system shall be as indicated on Bill of Materials on sheet 2 of this drawing.

10. Sealing of door components shall be as follows:

Sealant:
Frame: The interior and exterior perimeter joints and all frame connections shall be sealed with silicone sealant. The two sheet metal 45° angle shaped sections at the corner key shall be sealed to each other and to the sheet metal fabricated corner section with silicone sealant. The two steel sections at the sill shall be sealed with silicone sealant. Hinges shall be also sealed to hinge jamb with silicone sealant.

Sub-frame: The interior and exterior perimeter joints and all sub-frame connections shall be sealed with silicone sealant. Sub-frame shall be also sealed to the frame with silicone sealant around the exterior perimeter. Sub-frame shall be sealed to the wood buck using silicone sealant.

Door: The interior and exterior perimeter joints and all door connections to the main casing at the top rail, bottom rail and stiles shall be sealed with silicone sealant. Hinges shall also be sealed to hinge stile with silicone sealant. The plywood panel on exterior side of door shall be sealed around perimeter of the top rail, bottom rail and stiles with silicone sealant. The interior and exterior perimeter joints and all frame connections were sealed with silicone sealant. The sill flashing was sealed to the door panel with silicone sealant.

11. **Frame and Sub-frame Material:** Hot rolled steel DD12 Reference EN 10111 with Tensile Strength = 55,900 psi; Yield Strength at 0.2% = 52,400 psi; Ultimate Elongation 24.5%.

12. **Door Material:** Hot rolled zinc plated DX51 + Z100 (275 G/M² 0.6 Oz/Ft²) Reference EN 10142 + A1-97 with Tensile Strength = 54300 psi, Yield Strength at 49,600 psi; Ultimate Elongation = 23%.

13. **ASTM Designation for Steel:** Equivalent to ASTM A 653 CQ Grade 50 at frame and ASTM A 653 CQ Grade 50 at door.

14. **Galvanizing type:** G60 (initial shop coated), followed by a second coat of asphalt paint in accordance w/ 2007 F.B.C., section 2220.2

15. **Decorative Wood Clad Panels:** 0.250 (1/4") thick plywood (min. E=1300 ksi.), oak (min. E=1573 ksi.), pine (min. E=1417 ksi.), mahogany (min. E=1204 ksi.), Douglas fir (min. E=1390 ksi.) with 10-12% maximum moisture content, painted with minimum of two (2) coats of water based varnishes, protective impregnators and coatings for outdoor installations.


16. Door's manufacturer label shall be placed on the exposed surface of door's frame or sub-frame. One Label shall be placed for every door. Label shall read as follows:

Master Security Doors, Inc.
Deerfield Beach, Fl
Miami Dade County Product Control Approved.

17.

- This P.A.D. prepared by this engineer is generic and does not provide information for a specific project; i.e., where the site conditions deviate from the P.A.D.
- Contractor to be responsible for the selection, purchase and installation, including life safety of this product, based on this P.A.D., provide he/she does not deviate from the conditions detailed on this document. Construction safety at site is the contractor's responsibility.
- This P.A.D. will be considered invalid if altered by any means.
- Original P.A.D. shall bear the date and original seal and signature of the professional engineer of record that prepared it.

18. Materials, included but not limited to steel / metal screws, that come in contact with other dissimilar materials shall meet the requirements of 2007 Florida Building Code section 2003.8.4.

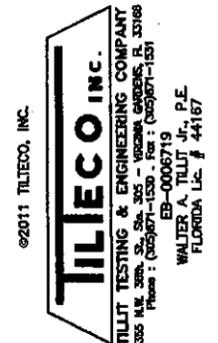

MASTER SECURITY DOORS, INC
2179 N POWER LINE ROAD
SUITE 2
POMPANO BEACH, FL 33069
TELEPHONE: 954-971-4747
FAX: 954-971-4925

MODEL: EX3 USA
INSWING DOOR
LARGE MISSILE
IMPACT RESISTANT

DRAWING: ELEVATION

SCALE: NONE

DRAWN BY: KP, RE

DATE DWN: 11/10/05, REV. 04/18/11




PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0228-03
Expiration Date FEB 23, 2016
Walter A. Tillit Jr.
Miami Dade Product Control

11-036
DRAWING N°
SHEET 1 OF 11

BILL OF MATERIALS

ITEM #	DESCRIPTION	MATERIAL	QTY	COMMENTS
1	HANDLE SET W/DEAD BOLT	MISC.	1	NOT APPLICABLE
2	EXTERIOR PANEL (SEE NOTE 15)	0.250 THK. WOOD G >= 0.55	1	ATTACHED TO ITEM 11 WITH LIQUID NAIL GLUE
3	INTERIOR PANEL (SEE NOTE 15)	0.250 THK. WOOD G >= 0.55	1	ATTACHED TO ITEM 11 WITH LIQUID NAIL GLUE
4	FRAME JAMBS, HEAD	HR STL W/ A52 PVC FILM	3	NOT APPLICABLE
5	FRAME CORNER KEY	GALV. STEEL	2	REFER TO SHEET 8
6	HINGE ASSEMBLY	STEEL	3	REFER TO SHEET 10
7	ROCKWOOL INSULATION	FIBERGLASS	A/R	PANEL CAVITY
8	REINF (MULTI-POINT LOCK HOUSING)	STEEL	1	AT LOCK STILE
9	9/16" X 1/8" THK OPEN CELL FOAM	EPS	A/R	W/ADHESIVE BACKING AND GLUED TO COMPRESSION GASKET
10	PANEL REINF (HINGE STILE)	STEEL	1	AT HINGE STILE
11	PANEL TOP, BOTTOM & STILE RAILS	HR STL W/ A52 PVC FILM	4	NOT APPLICABLE
12	#5 X 1/2" PPHSMS	STEEL	19	PANEL ASSY SCREW
13	CISA CYLINDER ASSEMBLY LOCK	STEEL	1	REFER TO SHEET 9
14	BACKING TOBAR	GALV. STEEL	2	NOT APPLICABLE
15	TOP FRAME SILL	HR STL W/ A52 PVC FILM	1	REFER TO SHEET 6
16	REAR PANEL PLATE	HOT ROLLED STEEL	1	0.059" THK, SPOT WELDED TO ITEM 8 IN THE LOCK STILE WITH TWO ROWS OF SPOT WELDS, 4" APART, FIRST ROW AT 5/8" FROM LOCK STILE. EACH ROW WITH (8) WELDS, LOCATED (1) AT 1 1/2" FROM TOP RAIL, BALANCE AT 13 1/8", 17 1/4", 16", 3 3/4", 11", 10 3/4", 16" AND ALSO SPOT WELDED TO ITEM 10 IN THE HINGE STILE WITH ONE ROW OF (6) SPOT WELDS AT 2 1/2" FROM HINGE STILE, AND AT 2 1/2" FROM TOP RAIL, WITH BALANCE AT 14 1/2", 17", 17 7/8", 18" AND 19 1/2".
17	FRONT PANEL FORMED PLATE	HOT ROLLED STEEL	1	0.059" THK, WELDED TO THE STEEL FORMED SECTION AROUND THE ENTIRE PERIMETER ON INTERIOR AND EXTERIOR SIDE, (20) WELDS AT EACH STILE, LOCATED AT (1) AT 1/ 1/8" FROM TOP RAIL, THEN (19) WELDS AT 4 3/4" O-C. (8) WELDS AT TOP AND BOTTOM RAIL, EACH LOCATED (1) AT 1" FROM LOCK STILE, THEN (7) AT 5" O-C.
18	SUBFRAME HEAD	HOT ROLLED STEEL	1	REFER TO DETAIL 18, SHEET 7
19	SUBFRAME JAMBS	HOT ROLLED STEEL	2	REFER TO DETAIL 19, SHEET 7
20	LOWER FRAME SILL	HR STL W/ A52 PVC FILM	1	REFER TO DETAIL 20, SHEET 7
21	SUBFRAME CORNER KEY	GALV. STEEL	2	REFER TO DETAIL 21, SHEET 7 AND DETAIL 5, SHEET 8
22	FRAME GASKET	VINYL	A/R	REFER TO DETAIL 22, SHEET 11
23	COMPRESSION GASKET	VINYL	A/R	REFER TO DETAIL 23, SHEET 11
24	BLOT W/THREADED SLEEVE	STEEL	5	REF DET 24, SHEET 6 AND REF DET 28, SHEET 7. LOCATED AT 1 3/8" WIDE X 1 1/8" HIGH CUT OUTS COVERED WITH VINYL COVER (5) AT HINGE JAMB
25	RETENTION CLIP HOUSING	GALV STEEL	10	5 PER JAMB. SEE LOCATIONS ON SHEET 3. REF. DET 25, SHEET 11
26	RETENTION CLIP	GALV. STEEL	10	5 PER JAMB. SEE LOCATIONS ON SHEET 3. REF. DET 26, SHEET 11
27	M8 X 30MM ALLEN HEAD BOLT	STEEL	5	SEE SHEET 3 FOR LOCATIONS
28	BLOT KEEPER	PLASTIC	5	REF DET 28, SHEET 7. USE 5 AT HINGE JAMB AT ITEM 24.
29	SILL SWEEP	STEEL W/A52 PVC FILM	1	REFER TO DETAIL 29, SHEET 7
30	SILL SWEEP END GASKET	VINYL	2	REFER TO DETAIL 30, SHEET 7
31	SILL SWEEP FASTENER	STEEL	2	REFER TO SHEET 4
32	5/8" X 0.090" THK OPEN CELL FOAM	EPS	1	AT SILL SWEEP, BETWEEN SILL SWEEP AND DOOR PANEL
33	CHANNEL COVER (0.227" X 0.390" X 0.38 THK)	PLASTIC	1	REFER TO DETAIL ON SHEET 04 (AT SILL)

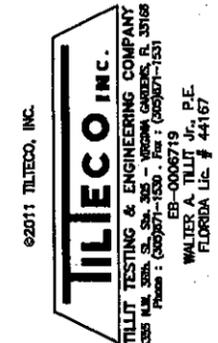

MASTER SECURITY DOORS, INC
 2179 N POWER LINE ROAD
 SUITE 2
 POMPANO BEACH, FL 33069
 TELEPHONE: 954-971-4747
 FAX: 954-971-4925

MODEL: EX3 USA
 INSWING DOOR
 LARGE MISSILE
 IMPACT RESISTANT

DRAWING: ELEVATION


SCALE: NONE

DRAWN BY: KP, RE


DATE DWN: 11/10/05, REV. 04/18/11

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 11-0228-03
 Expiration Date FEB 23, 2016



Walter A. Tilit Jr.
 Professional Engineer

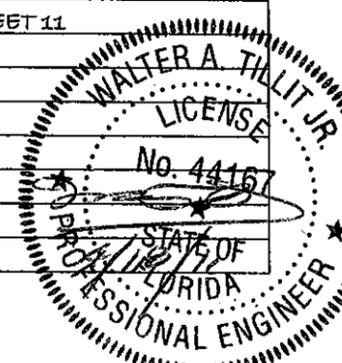

11-036
DRAWING N°
SHEET 2 OF 11

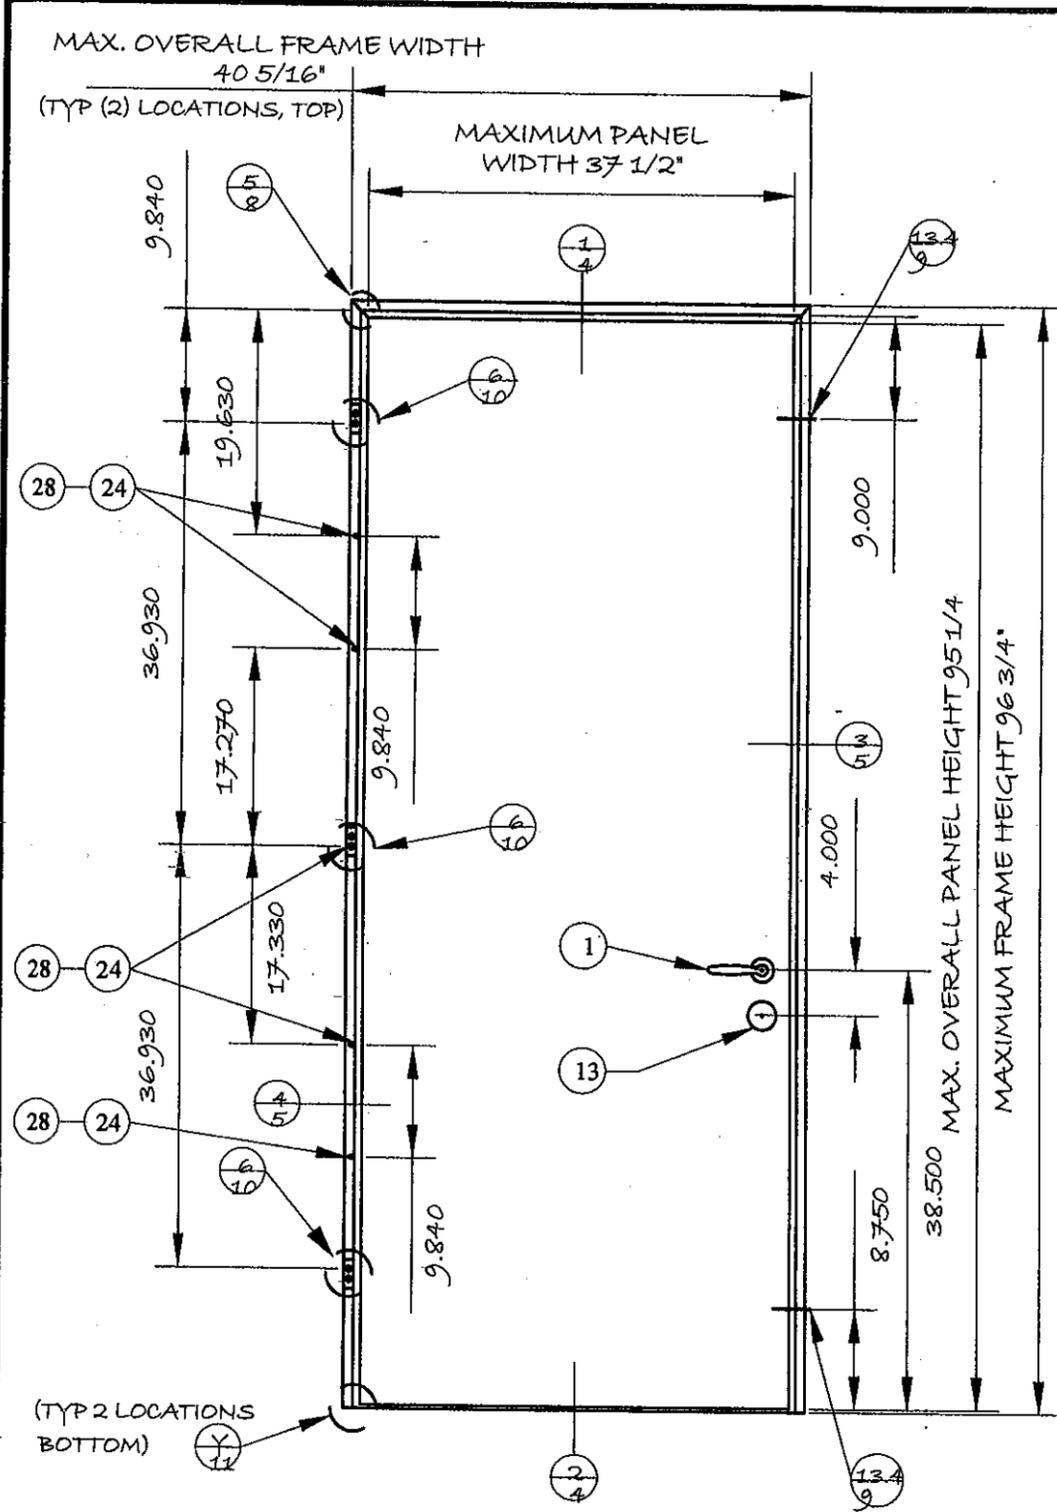

DOOR ASSEMBLY/HARDWARE
(EXTERIOR ELEVATION)

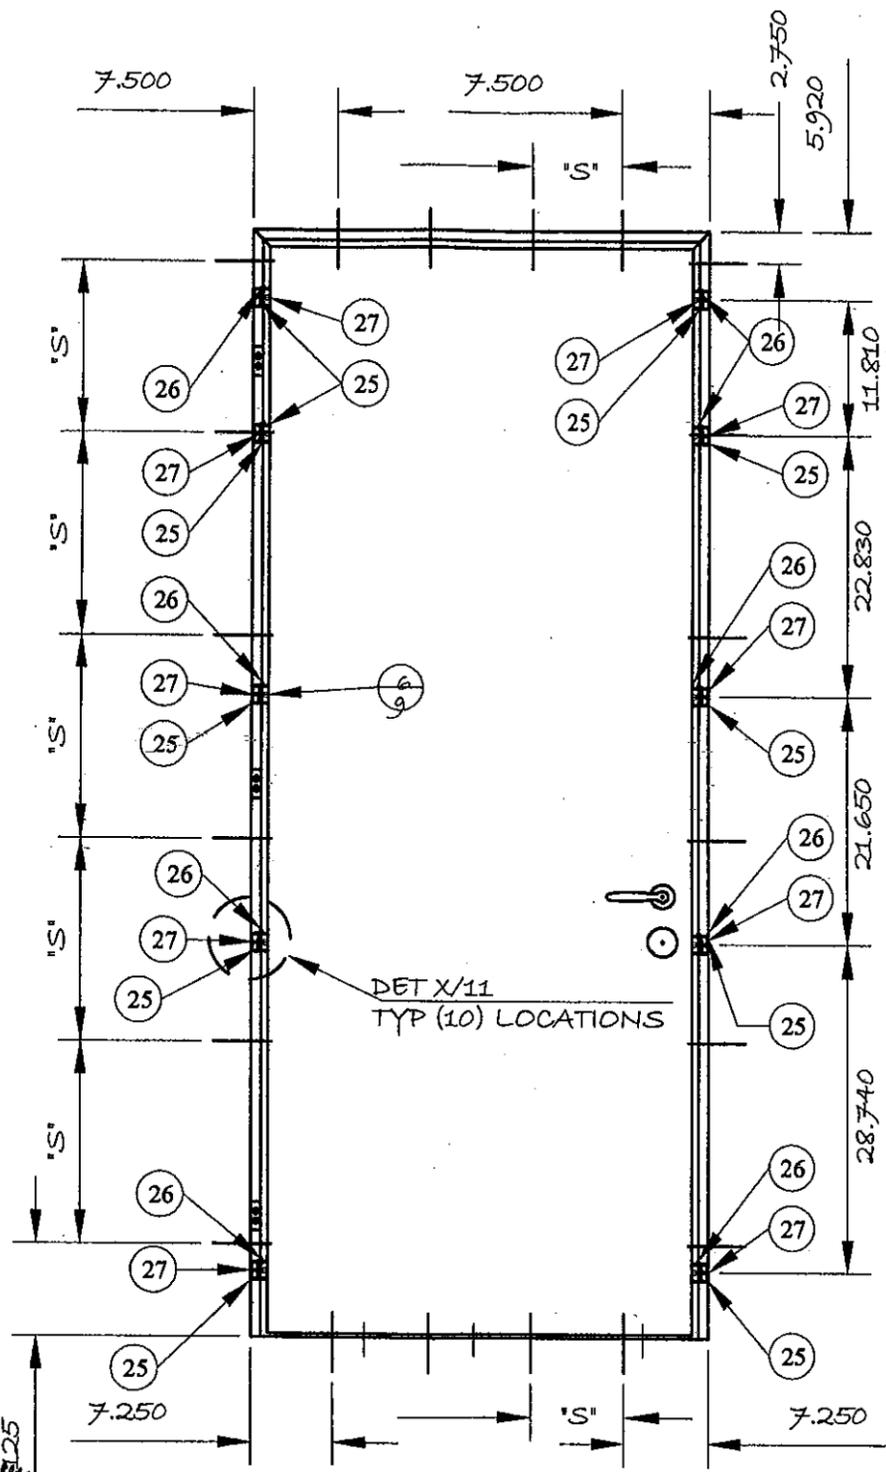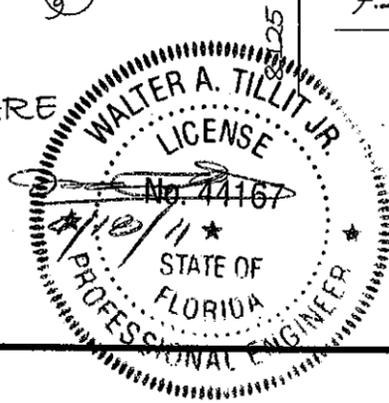

DOOR SUBFRAME CONNECTION
TO DOOR FRAME & DOOR
SUBFRAME CONNECTION TO EXISTING
STRUCTURE (EXTERIOR ELEVATION)

MAXIMUM ANCHOR
SPACING "S" SCHEDULE
FOR SUBFRAME ANCHORAGE
TO EXISTING STRUCTURE

DOOR FRAME	DESIGN LOAD	ANCHOR TYPE	
		1	2
JAMBS	UP TO 100 PSF	10' O.C.	17 3/4' O.C.
	>100 TO 200 PSF	5' O.C.	9' O.C.
HEAD & SILL	UP TO 100 PSF	12 7/8' O.C.	25' O.C.
	>100 TO 200 PSF	6 3/8' O.C.	8 5/8' O.C.

* VALID FOR EITHER POURED CONCRETE, CONCRETE BLOCK, OR WOOD SUBSTRATES (REFER TO ANCHOR LEGEND)

- ANCHOR LEGEND:
- 1/4" TAPCON ANCHORS, BY ELCO
TEXTRON W/ 1 1/4" MIN. EMBEDMENT TO F_c = 3.32 KSI CONCRETE, OR ASTM C-90 CONCRETE BLOCK AND WITH 3" MIN. EMBEDMENT TO WOOD SUBSTRATE W/ G ≥ 0.55 MIN EDGE DISTANCE = 2 1/2" (MASONRY) AND MIN. EDGE DISTANCE 1" (WOOD).
 - 3/8" TAPPERS BY POWER FASTENERS, INC; W/ 1 1/4" MIN. EMBEDMENT TO F_c = 3.0 KSI CONCRETE OR ASTM C-90 CONCRETE BLOCK WALL AND WITH 3" MIN. EMBED. TO WOOD SUBSTRATE W/ G ≥ 0.55 MIN EDGE DISTANCE = 4 1/2" (MASONRY), MIN. EDGE DISTANCE = 1 1/2" (WOOD).

— = PERIMETER FASTENER LOCATIONS
(SEE ANCHOR LEGEND, THIS SHEET)

©2011 TILTECO, INC.
TILECO INC.
TILIT TESTING & ENGINEERING COMPANY
6335 N.W. 36th St., Suite 205 - Victoria Gardens, Ft. Lauderdale, FL 33309
Phone: (954) 971-1530, Fax: (954) 971-1531
E-mail: info@tileco.com
WALTER A. TILLIT JR., P.E.
FLORIDA LIC. # 44167

MASTER SECURITY DOORS, INC
2179 N POWER LINE ROAD
SUITE 2
POMPANO BEACH, FL 33069
TELEPHONE: 954-971-4747
FAX: 954-971-4925



MODEL: EX3 USA
INSWING DOOR
LARGE MISSILE
IMPACT RESISTANT
DRAWING: ELEVATION
SCALE: NONE
DRAWN BY: KP, RE
DATE DWN: 11/10/05, REV. 04/18/11

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0228-03
Expiration Date FEB 23, 2016
John L. Chang
Professional Engineer

11-036
DRAWING N°
SHEET 3 OF 11

MASONRY INSTALLATION

WOOD INSTALLATION

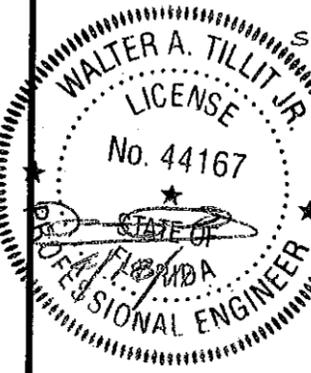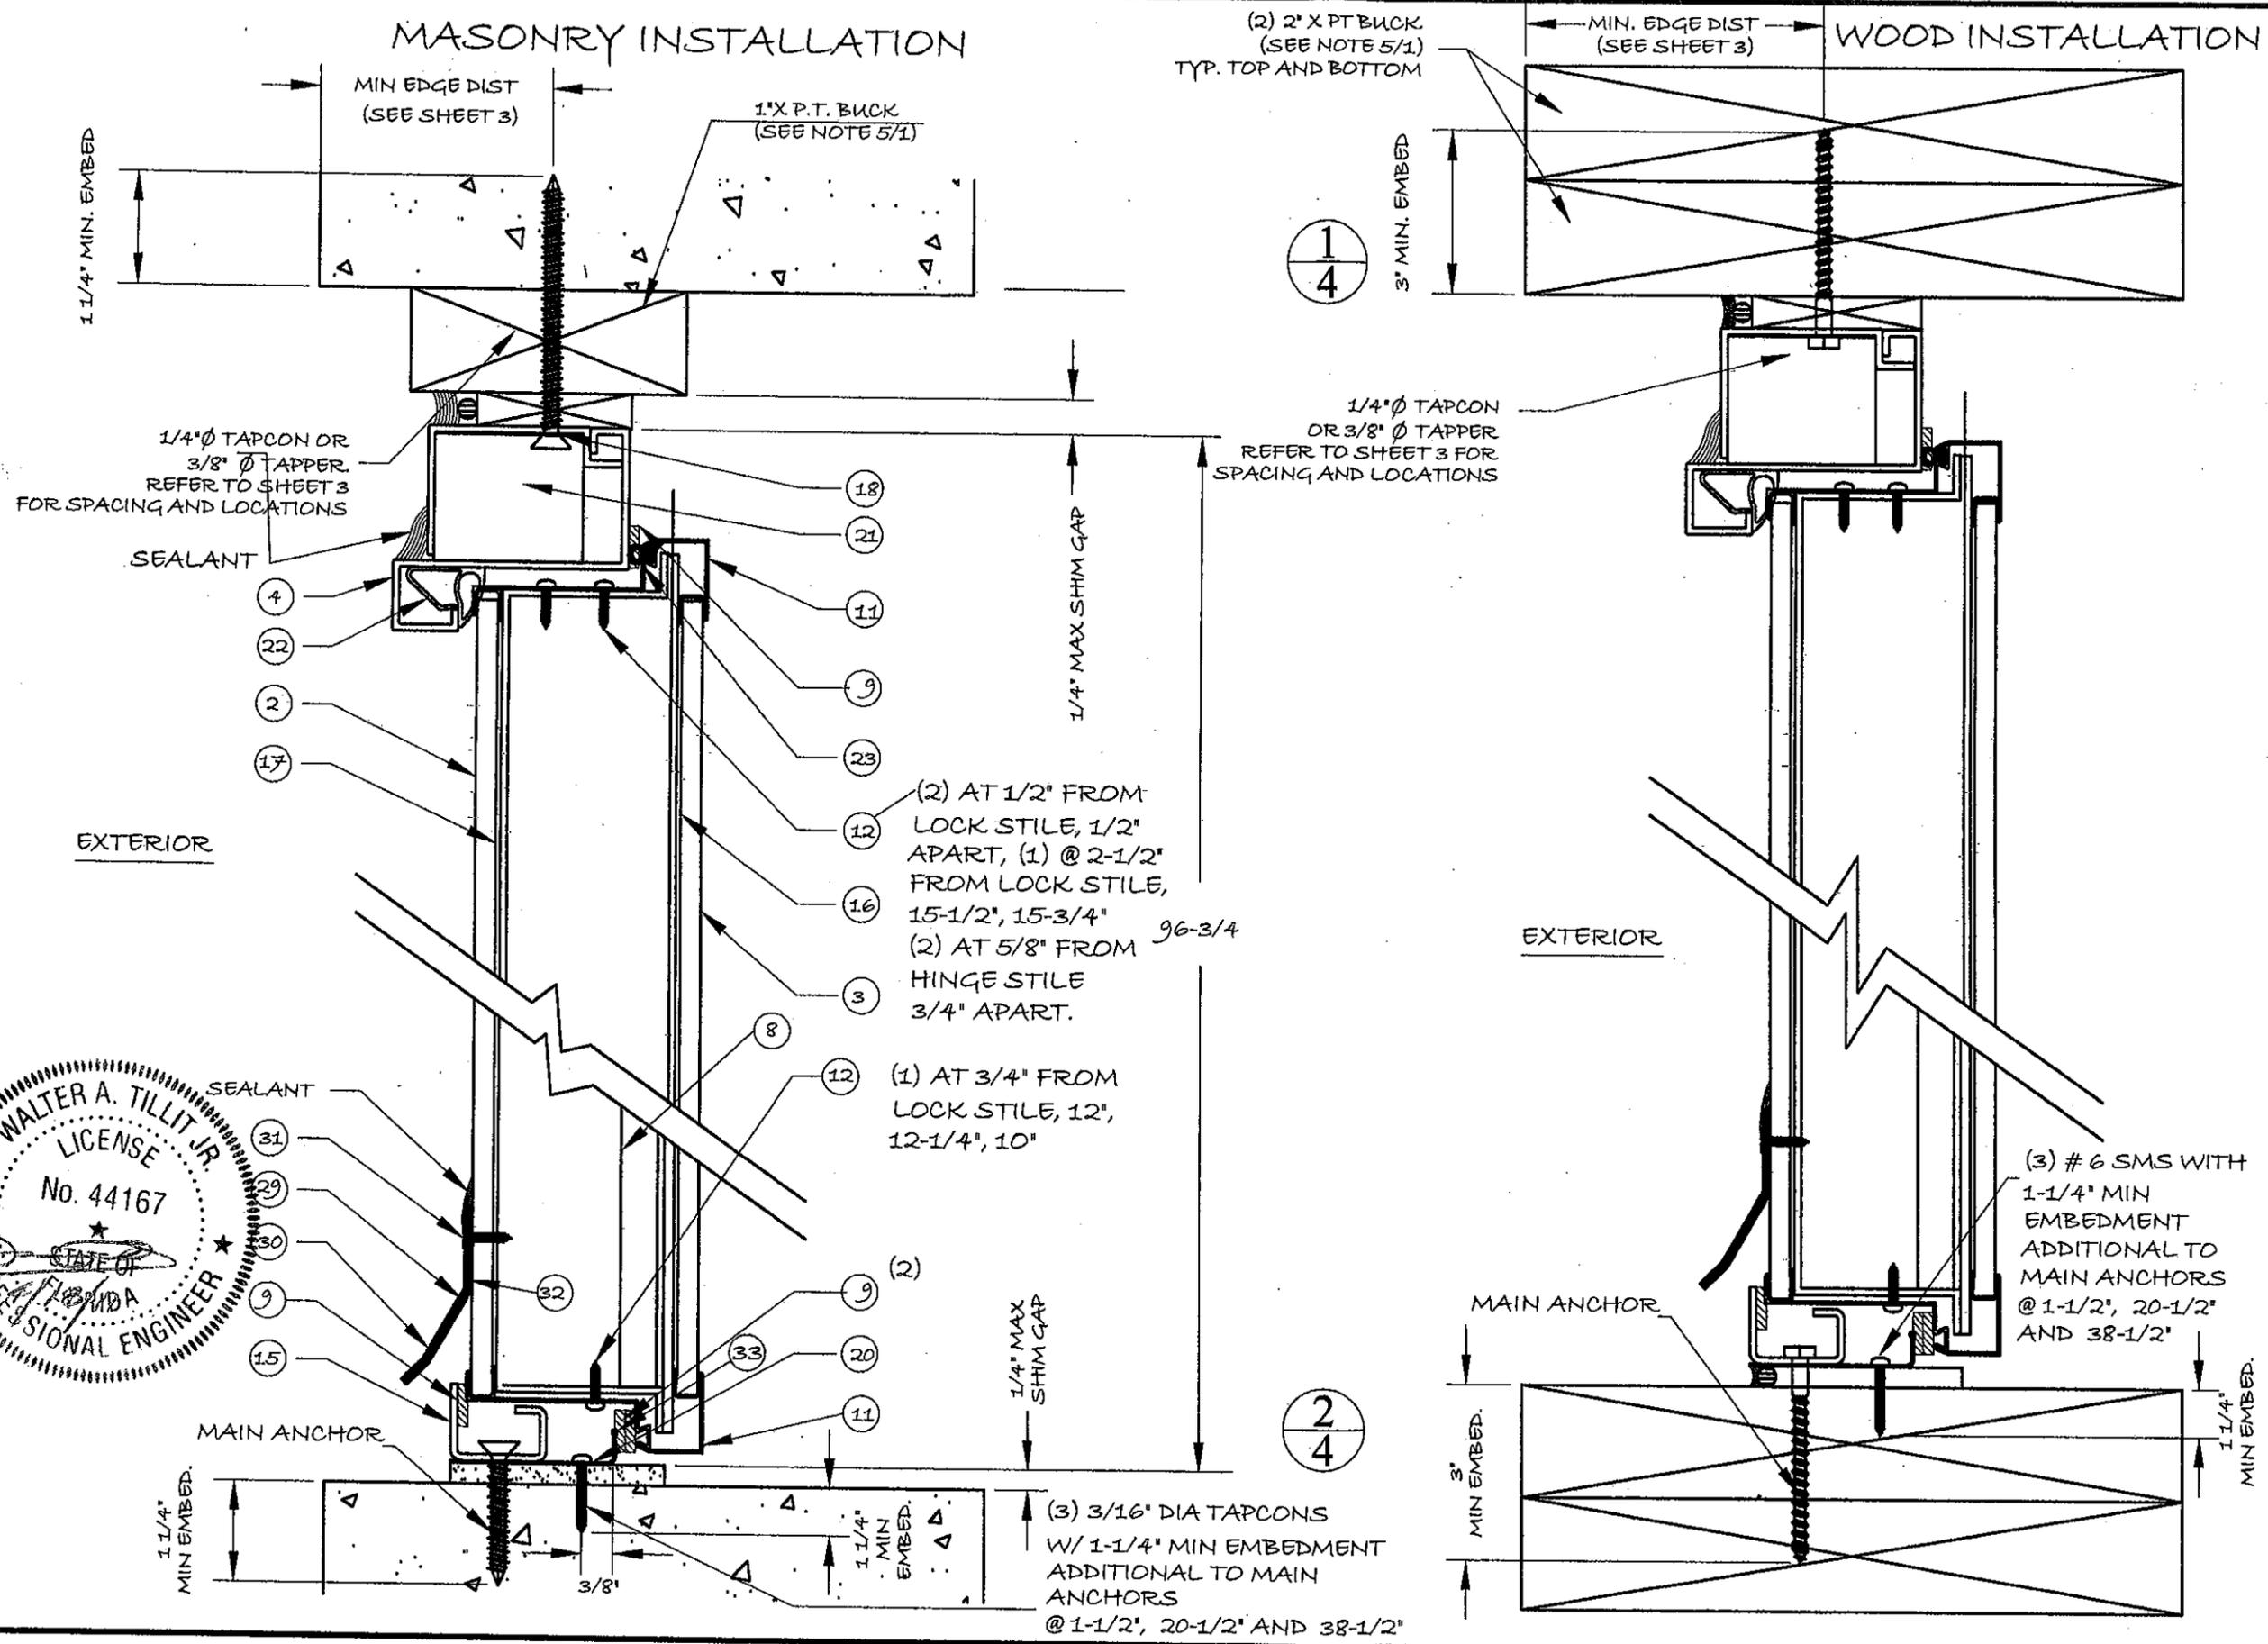



©2011 TILTECO, INC.
TILTECO INC.
 TILIT TESTING & ENGINEERING COMPANY
 6325 N.W. 30th St., Suite 205, Pompano Beach, FL 33069
 Phone: (954) 971-4747
 Walter A. Tillit, P.E.
 Florida Lic. # 44167

MASTER SECURITY DOORS, INC
 2179 N POWER LINE ROAD
 SUITE 2
 POMPANO BEACH, FL 33069
 TELEPHONE: 954-971-4747
 FAX: 954-971-4925

MODEL: EX3 USA
 INSWING DOOR
 LARGE MISSILE
 IMPACT RESISTANT
 DRAWING: VERT. CROSS SECT
 SCALE: NONE
 DRAWN BY: KP, RE
 DATE DWN: 11/10/05, REV. 04/18/11

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 11-0228-03
 Expiration Date: FEB 23, 2016
 By: *Michael Chan*
 Product Control

11-036
 DRAWING N°
 SHEET 4 OF 11

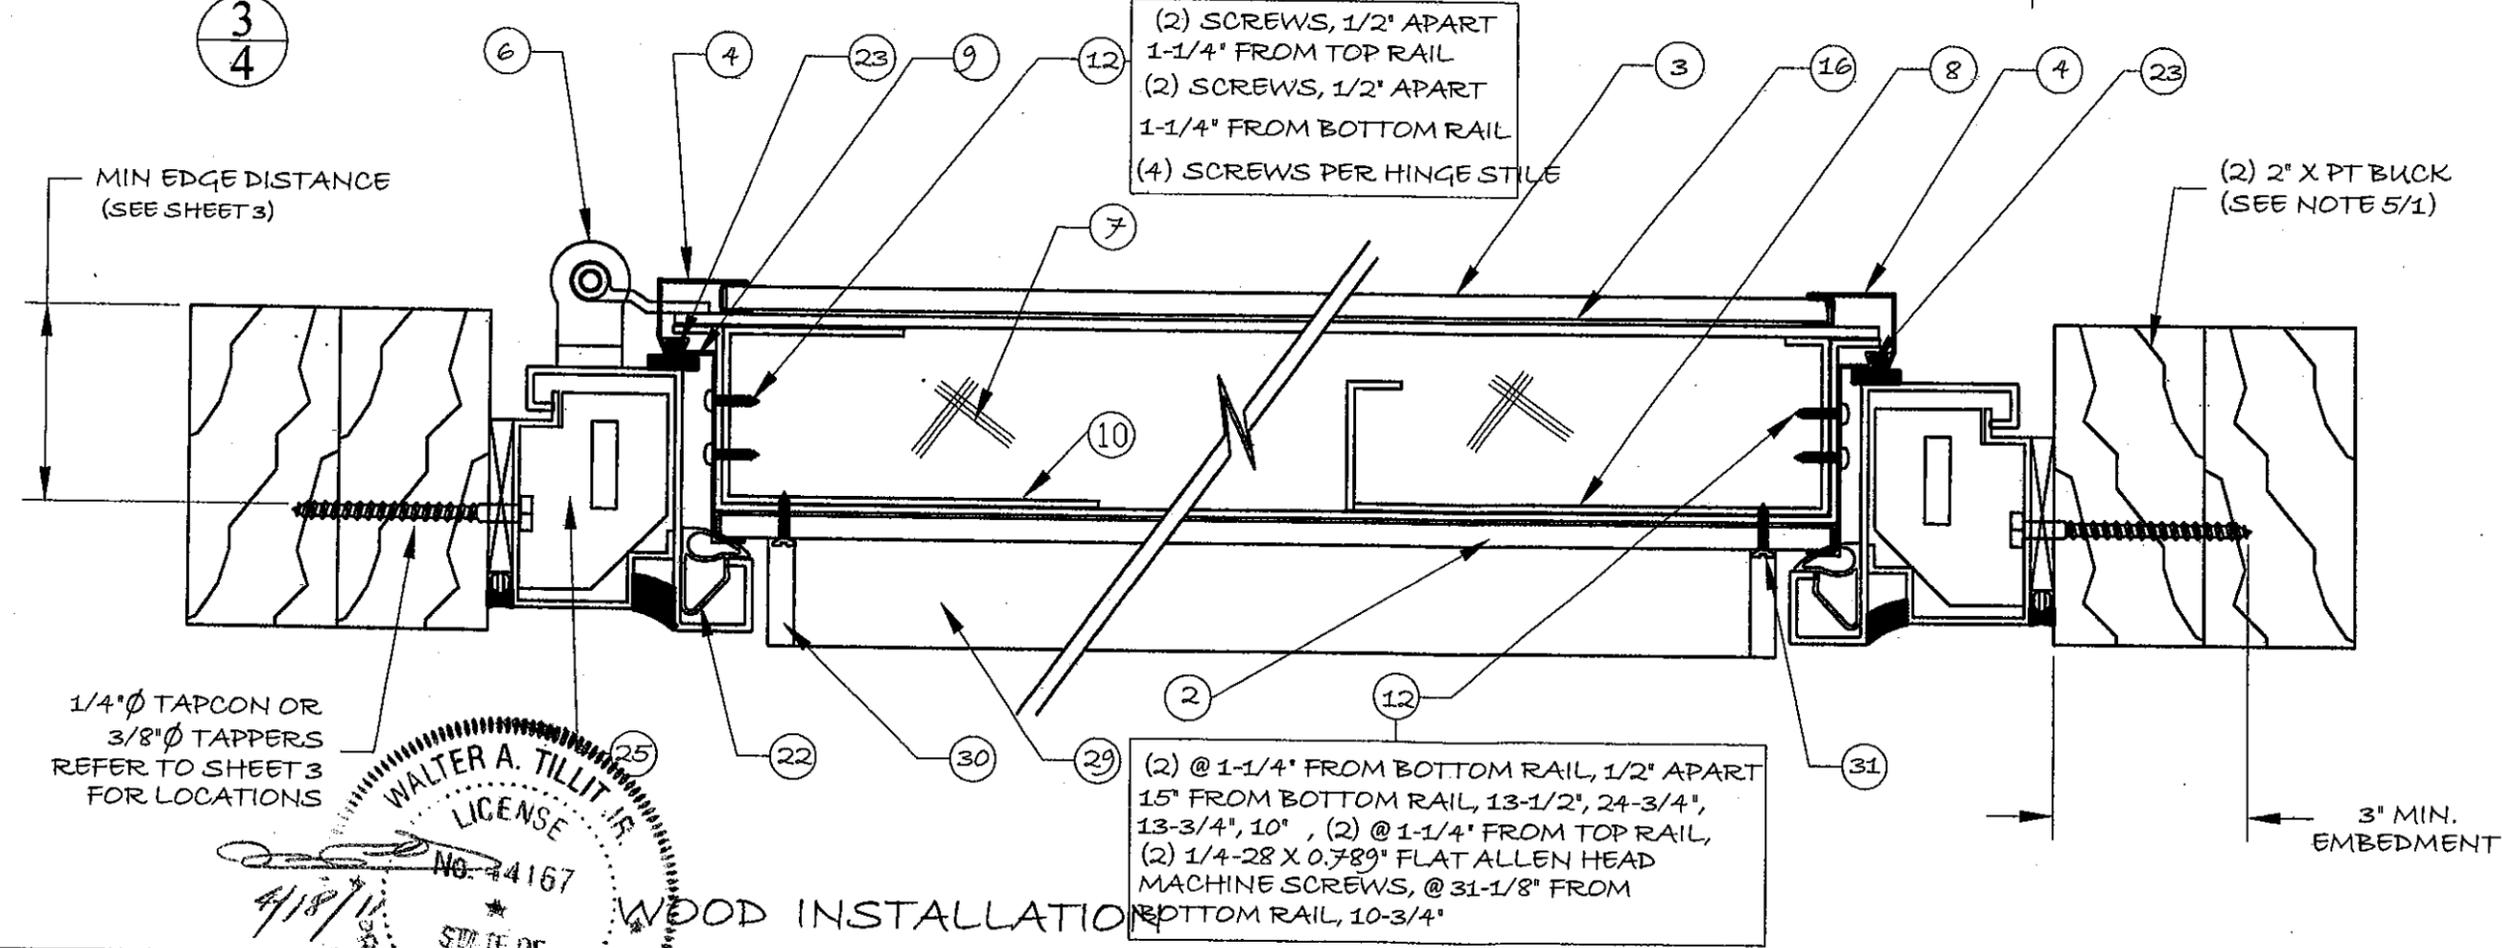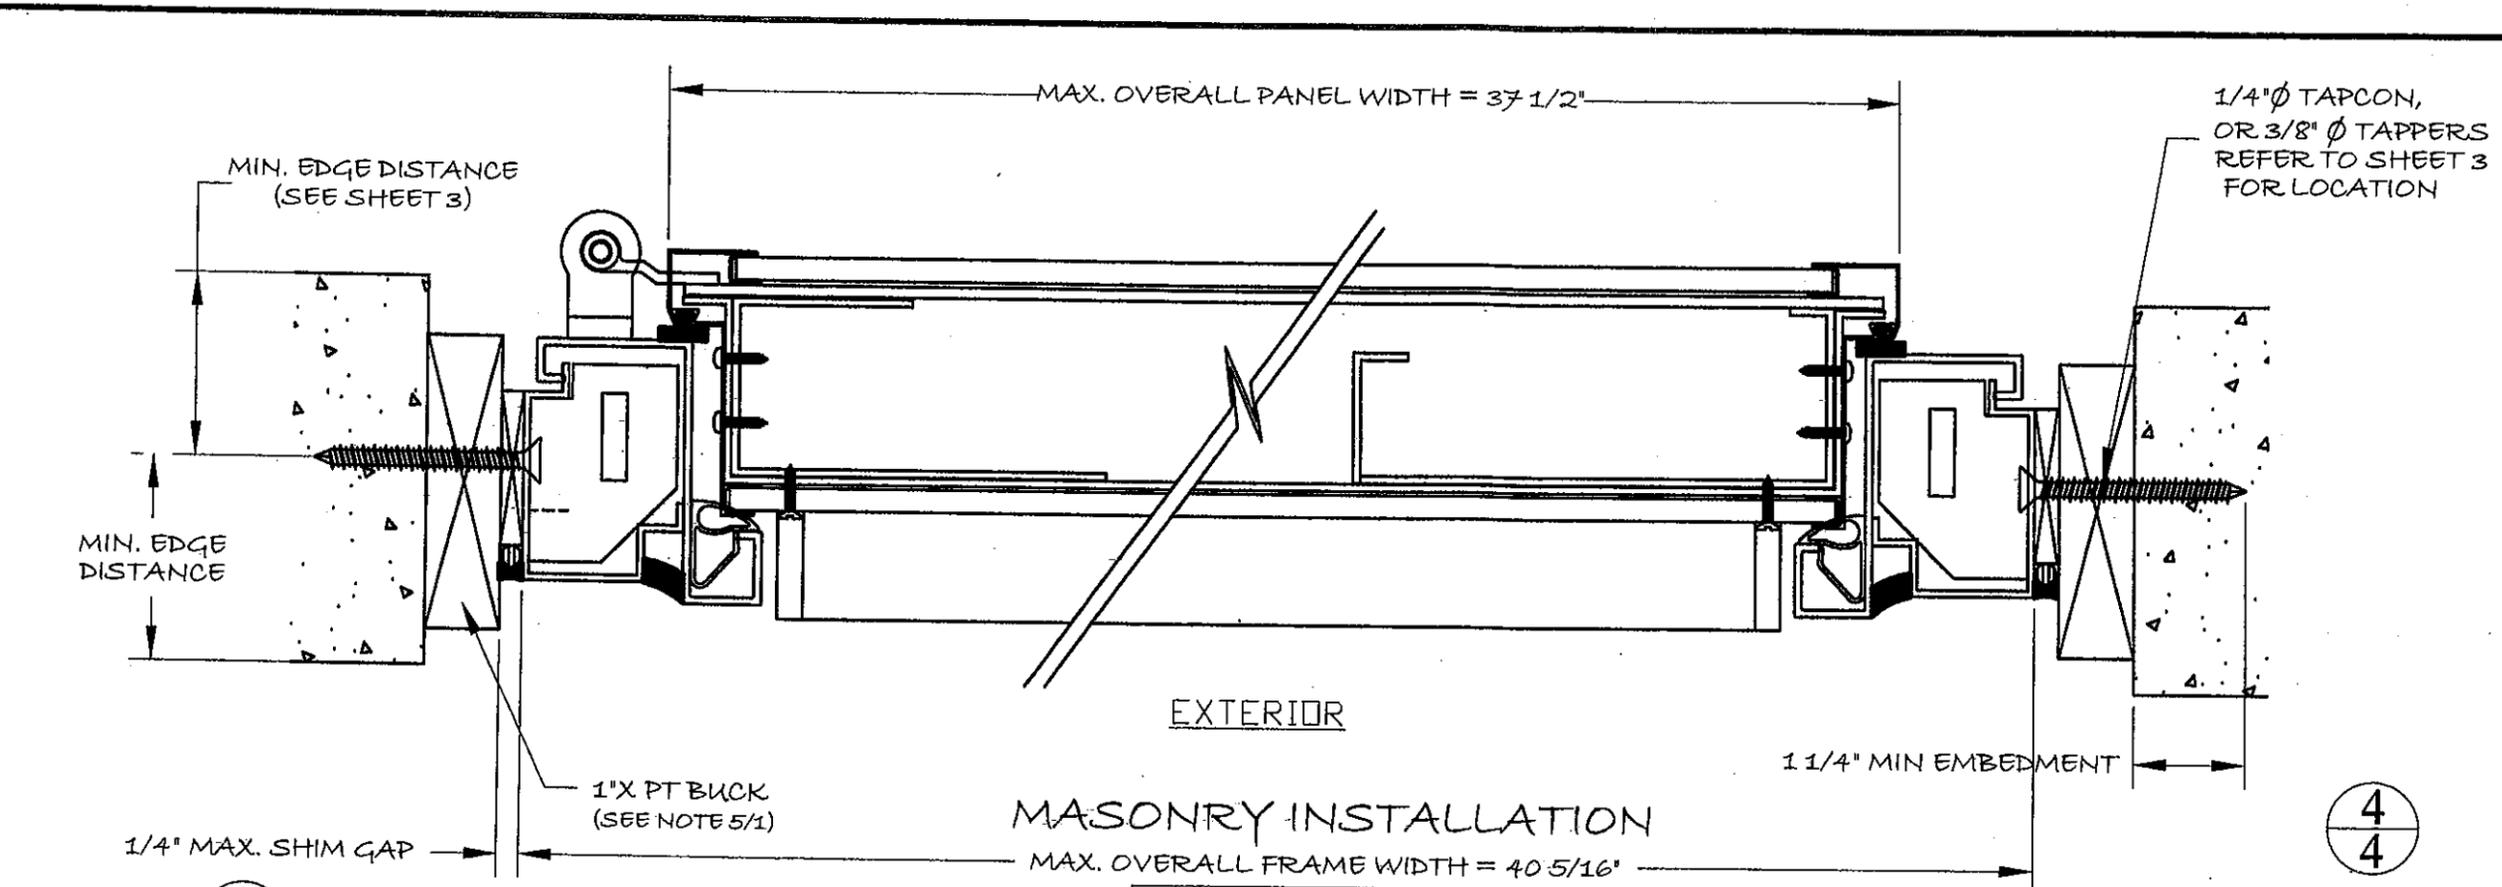


©2011 TILECO, INC.
TILECO INC.
 TILIT TESTING & ENGINEERING COMPANY
 6355 W. 30th, Suite 100, Pompano Beach, FL 33069
 Phone: (954) 971-4925 Fax: (954) 971-4925
 WALTER A. TILIT, JR., P.E.
 FLORIDA Lic. # 44167


MASTER SECURITY DOORS, INC
 2179 N POWER LINE ROAD
 SUITE 2
 POMPANO BEACH, FL 33069
 TELEPHONE: 954-971-4747
 FAX: 954-971-4925

MODEL: EX3 USA
 INSURING DOOR
 LARGE MISSILE
 IMPACT RESISTANT
 DRAWING: HORIZ. CROSS SECT
 SCALE: NONE
 DRAWN BY: KP, RE
 DATE DWN: 11/10/05, REV. 04/18/11


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 11-0228.03
 Expiration Date FEB 23, 2016
 Walter A. Tillit, Jr.
 Professional Engineer

11-036
 DRAWING N°
 SHEET 5 OF 11

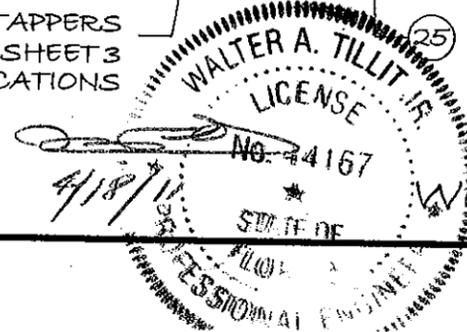


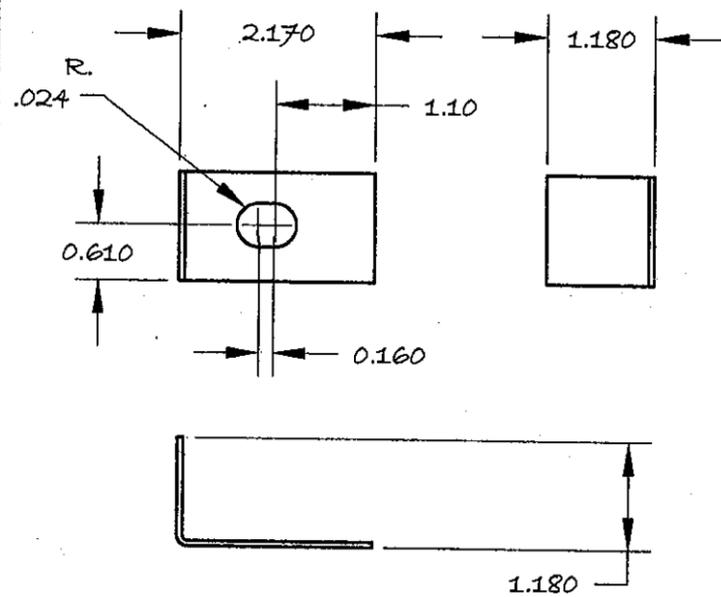


14/6 BACKING TOBAR

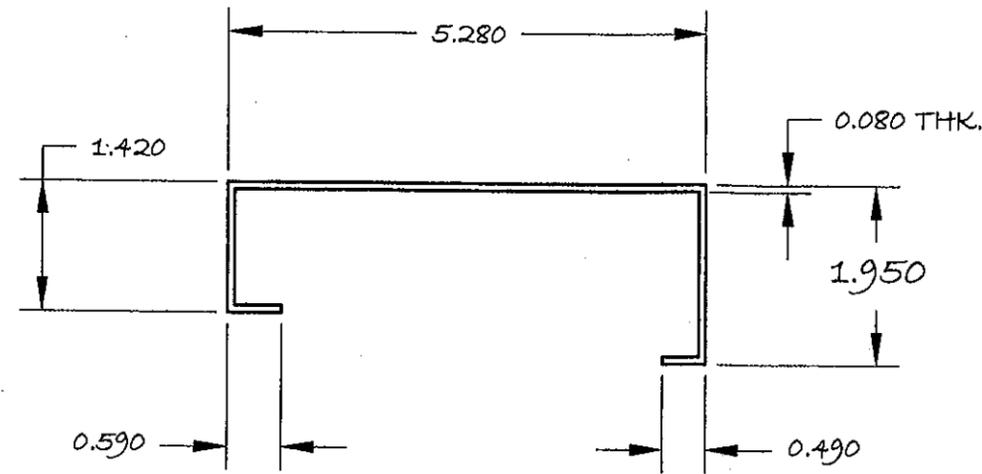


8/6 REINFORCEMENT LOCK STILE (FULL LENGTH)

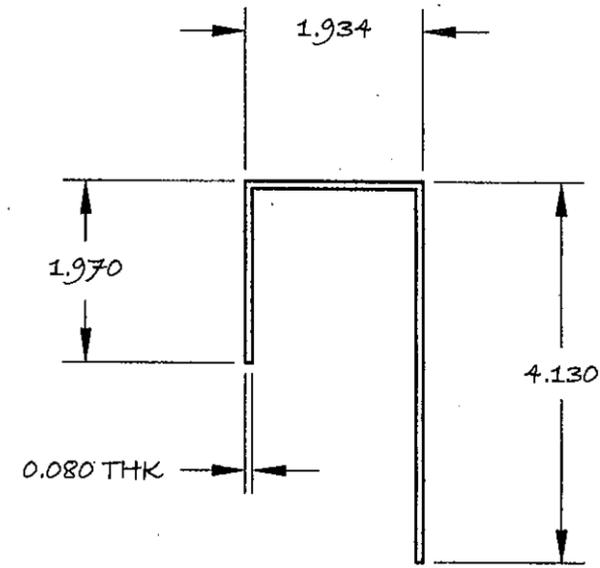



10/6 REINF HINGE STILE (FULL LENGTH)

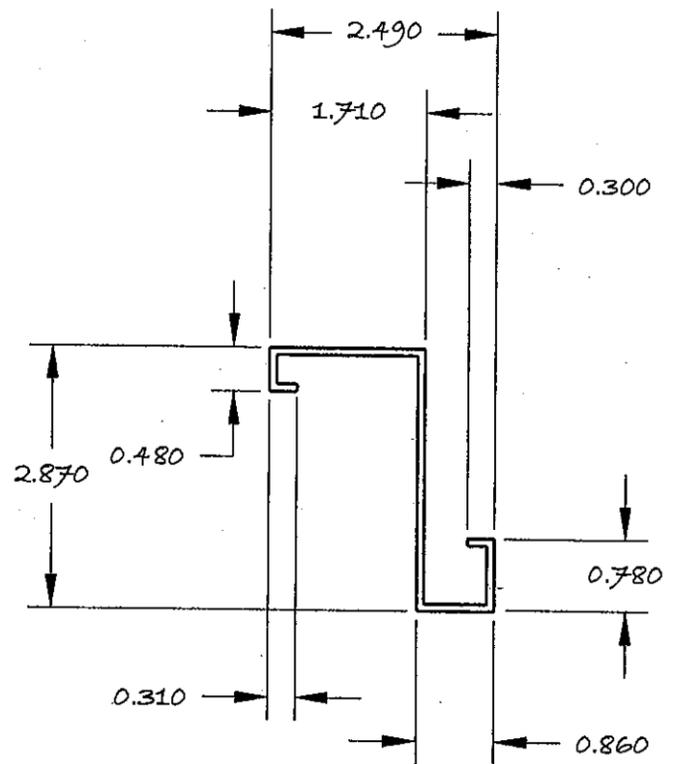


4/6 FRAME: JAMBS & HEAD

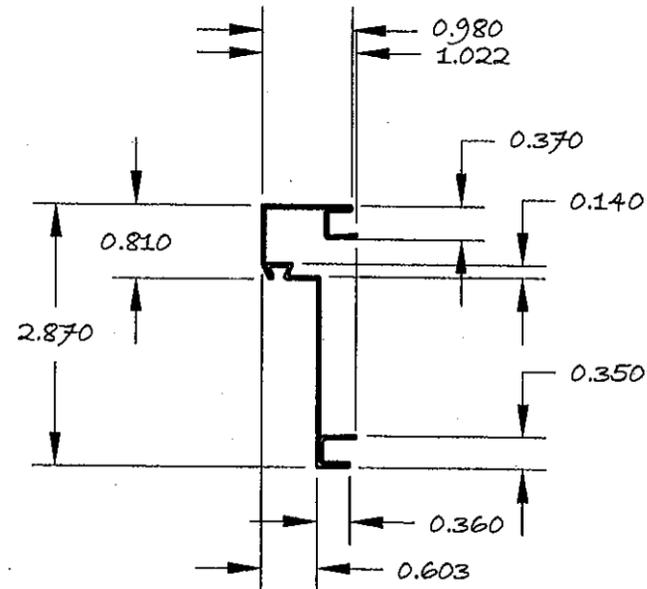

11/6 DOOR PANEL TOP RAIL BOTTOM RAIL AND VERTICAL STILES

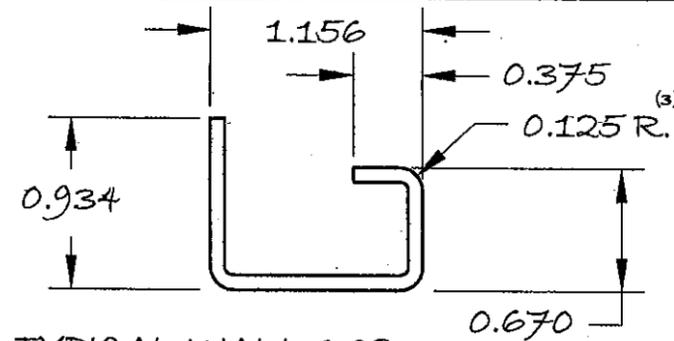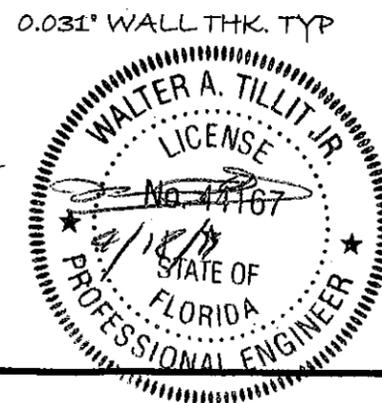

15/6 TOP FRAME SILL

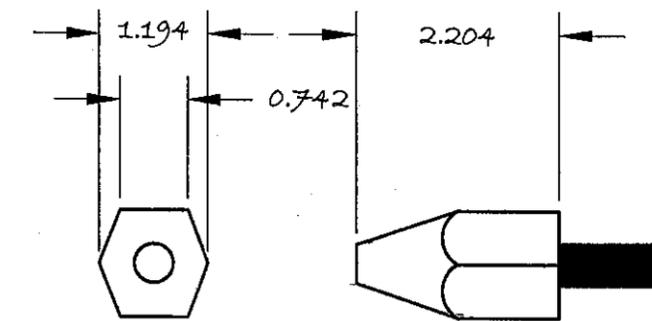

24/6 BLOT




MASTER SECURITY DOORS, INC
 2179 N POWER LINE ROAD
 SUITE 2
 POMPANO BEACH, FL 33069
 TELEPHONE: 954-971-4747
 FAX: 954-971-4925


MODEL: EX3 USA
 INSWING DOOR
 LARGE MISSILE
 IMPACT RESISTANT
 DRAWING: DETAILS
 SCALE: NONE
 DRAWN BY: KP, RE
 DATE DWN: 11/10/05, REV. 04/18/11

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 11-0228-03
 Expiration Date 04/23/2016
 By: Ishaq I. Chaudhry
 Master Seal Product Control


11-036
 DRAWING N°
 SHEET 6 OF 11

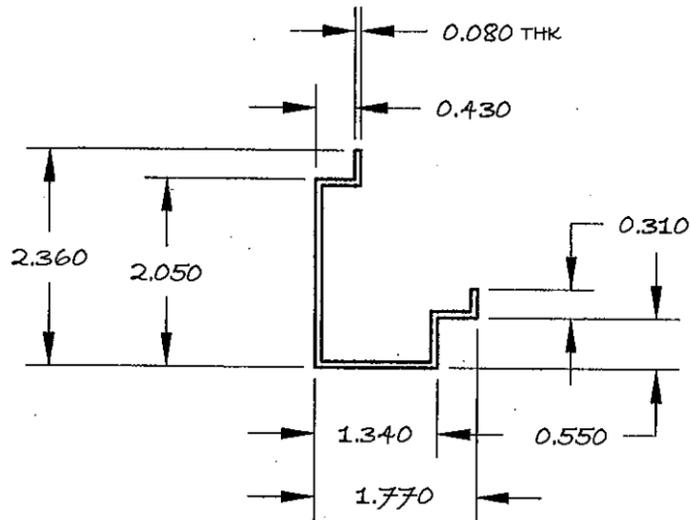


19/7 SUBFRAME JAMBS
SCALE: 1/2

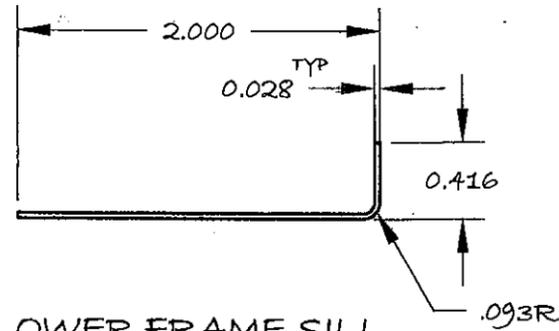


20/7 LOWER FRAME SILL
SCALE: 1/2

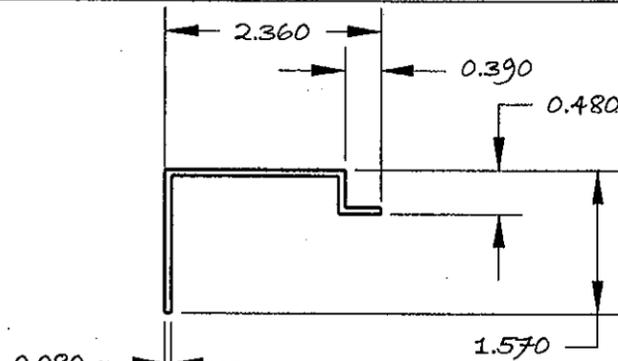


18/7 SUB FRAME HEAD
SCALE: 1/2

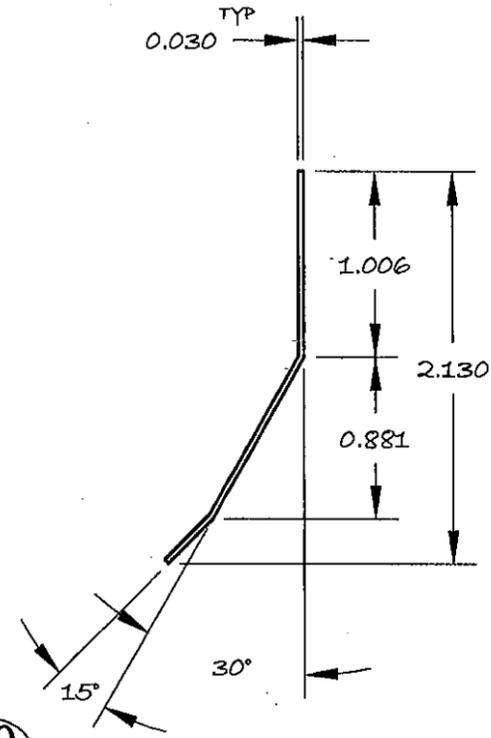


29/7 SILL SWEEP
SCALE: 1X

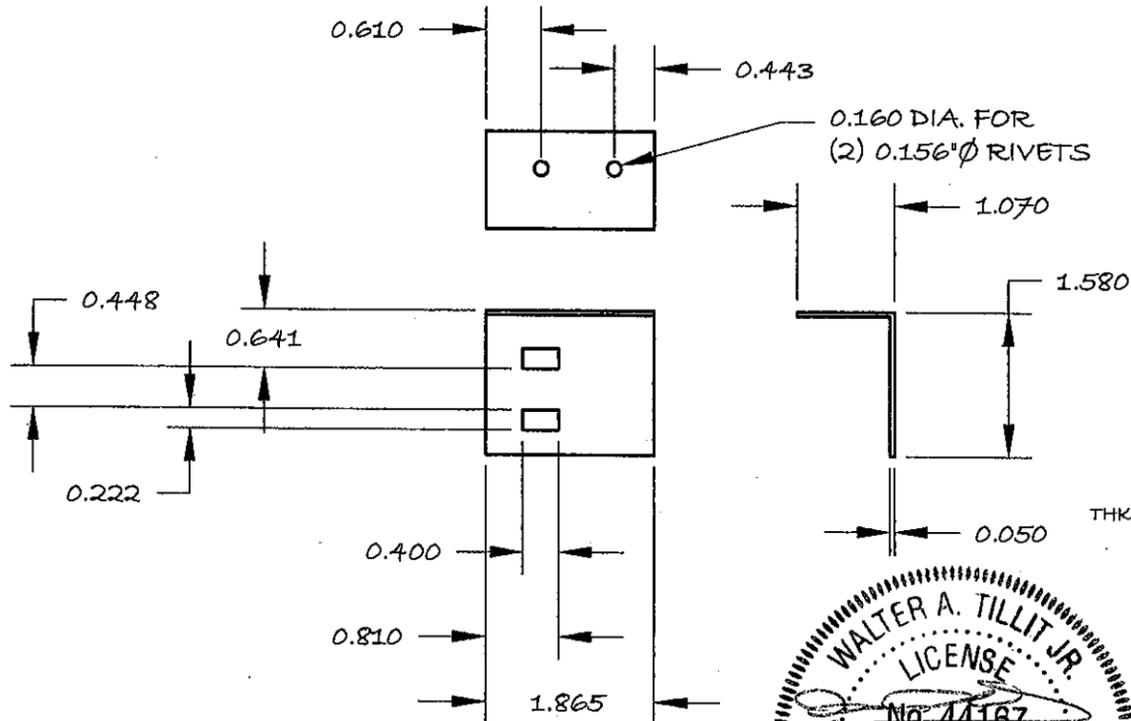


21/7 SUB FRAME CORNER KEY
SCALE: 1/2

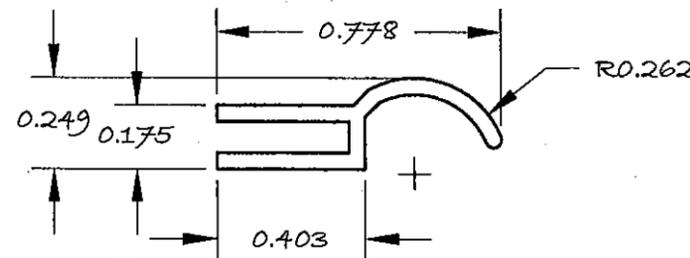

30/7 SWEEP GASKET
SCALE: 2X

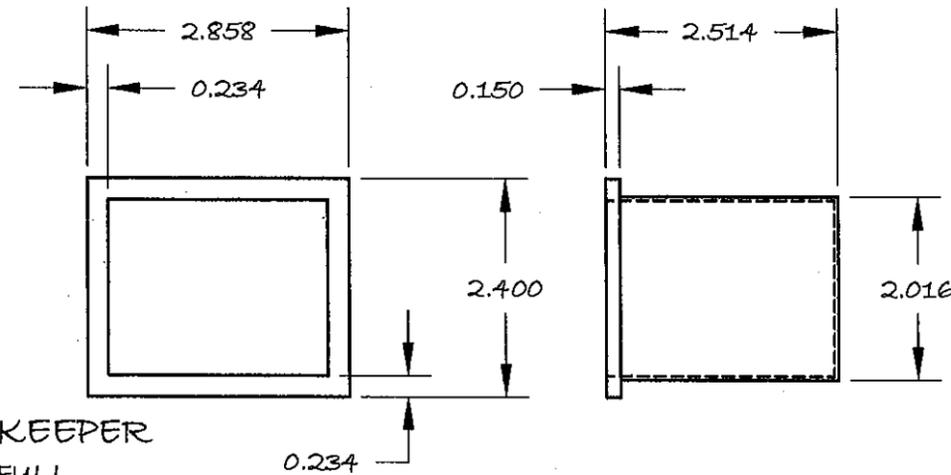

28/7 BLOT KEEPER
SCALE: FULL

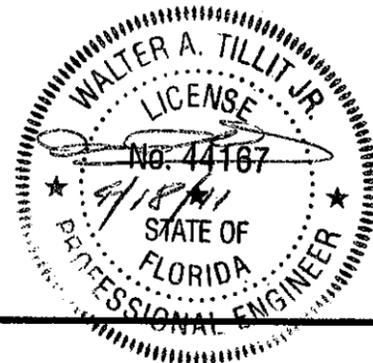


MASTER SECURITY DOORS, INC.
2179 N POWER LINE ROAD
SUITE 2
POMPANO BEACH, FL 33069
TELEPHONE: 954-971-4747
FAX: 954-971-4925


MODEL: EX3 USA
INSWING DOOR
LARGE MISSILE
IMPACT RESISTANT
DRAWING: SUBFRM DETAILS
SCALE: NONE
DRAWN BY: KP, RE
DATE DWN: 11/10/05, REV. 04/18/11

PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No. 11-0228-03
Expiration Date: FEB 23, 2016
By: [Signature]
Special Use: Product Control


11-036
DRAWING N°
SHEET 7 OF 11

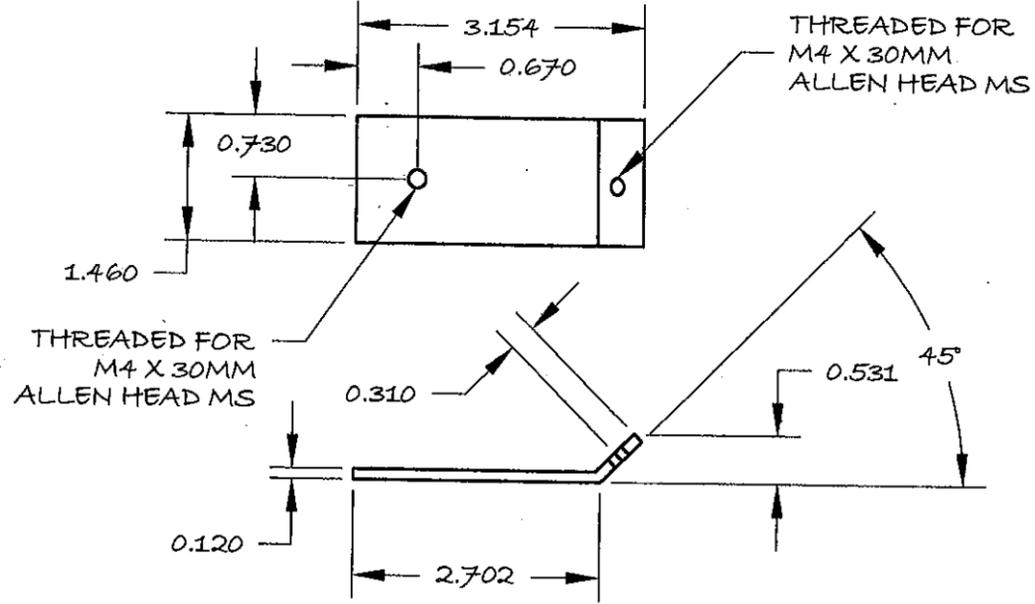



A
8 CORNER FRAME PLATE
SCALE: HALF

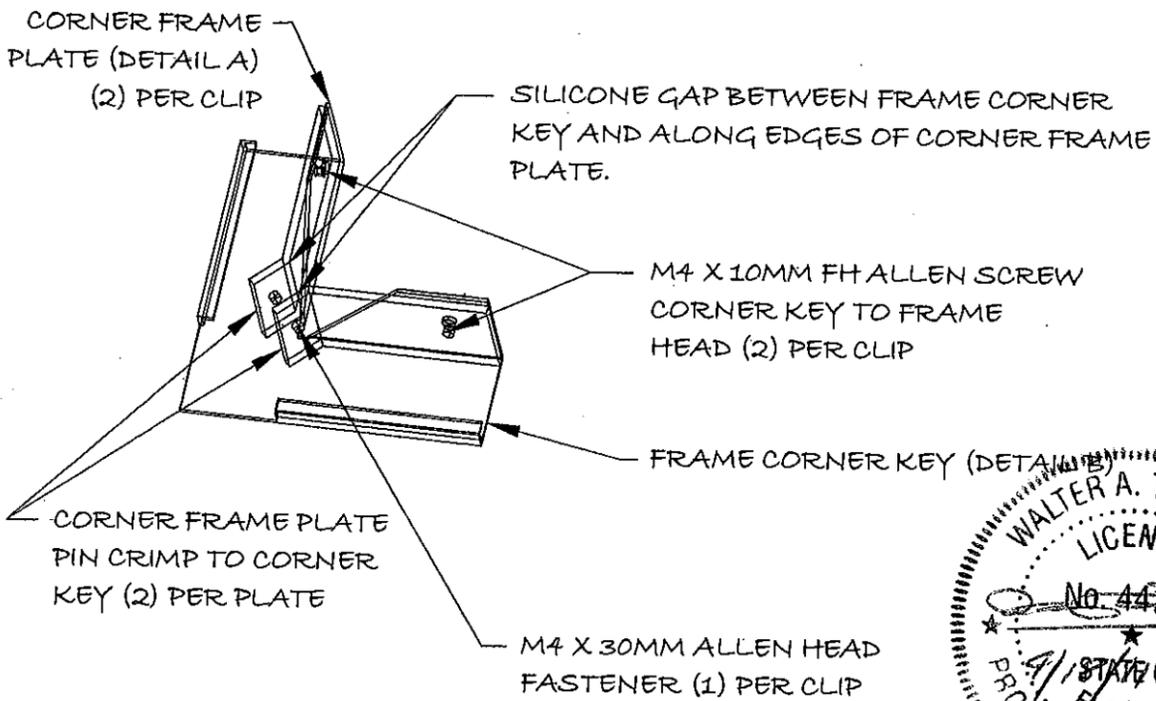

5
8 FRAME CORNER KEY ASS'Y

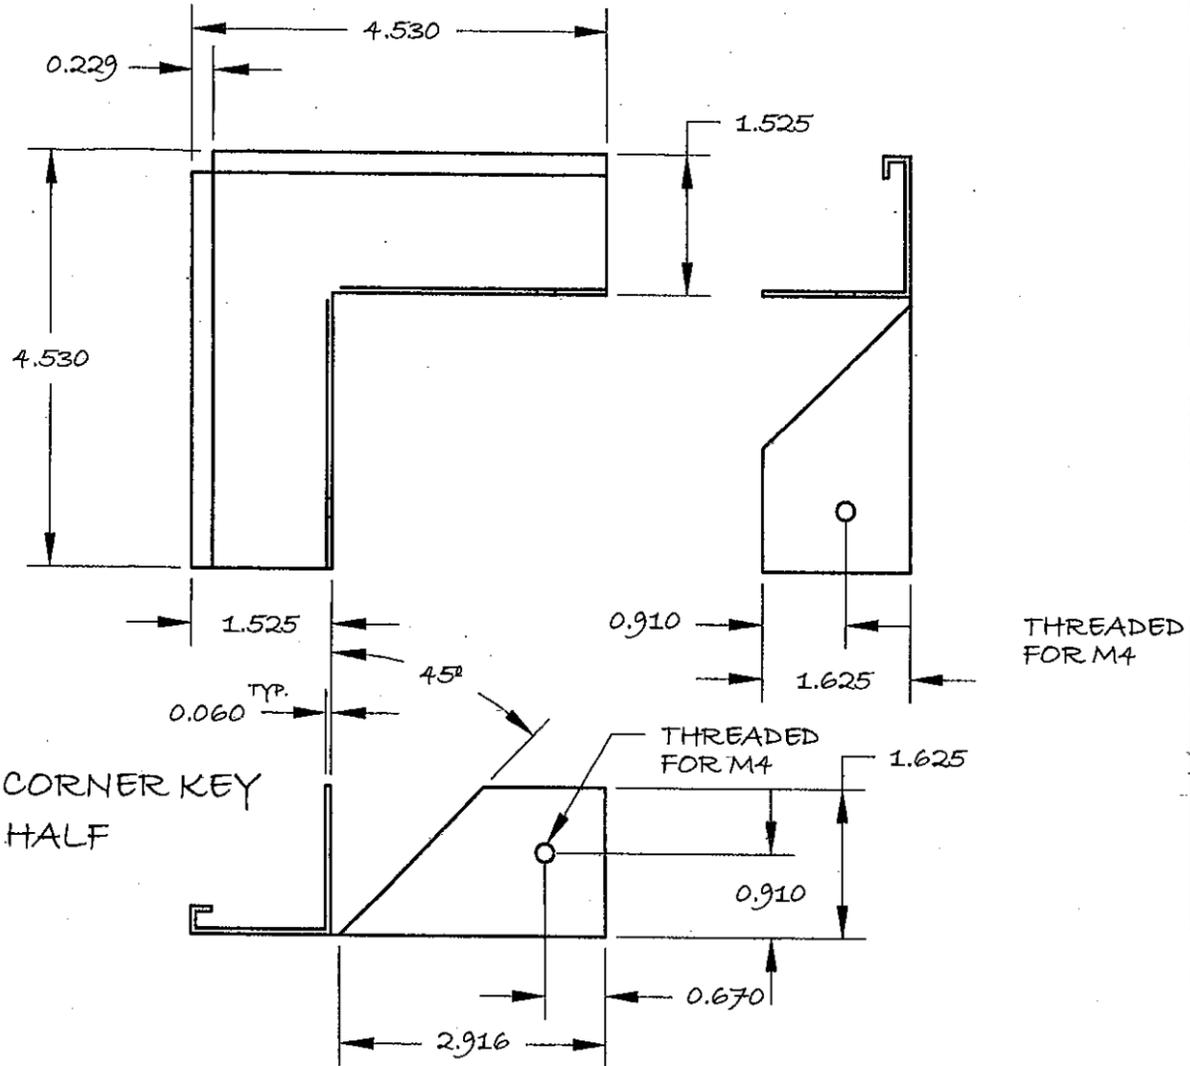

B
8 FRAME CORNER KEY
SCALE: HALF

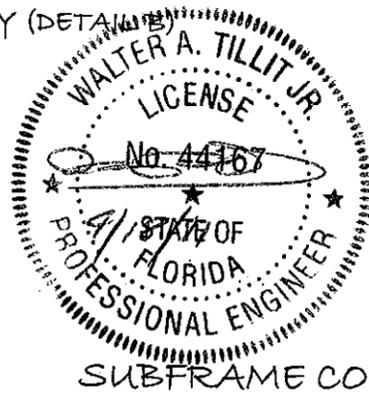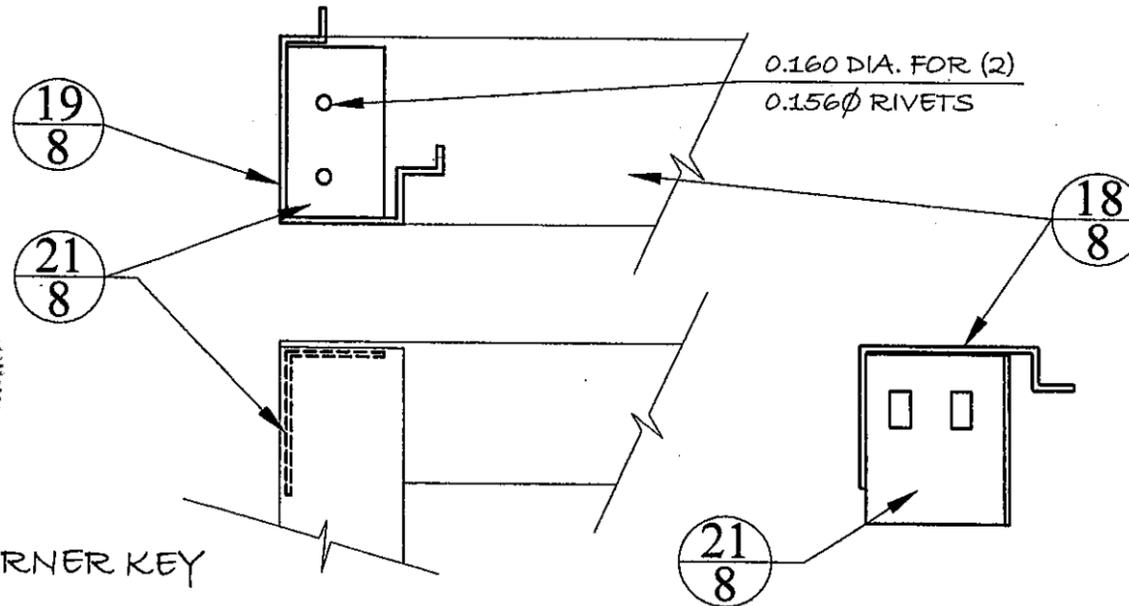

SUBFRAME CORNER KEY

©2011 TILTECO, INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6325 N.W. 38th St., Suite 303 - Yeehwa Gardens, Ft. Lauderdale, FL 33316
Phone: (954) 971-1536 Fax: (954) 971-1531
WALTER A. TILLIT JR., P.E.
EB-006719
FLORIDA Lic # 44167

MASTER SECURITY DOORS, INC
2179 N POWER LINE ROAD
SUITE 2
POMPANO BEACH, FL 33069
TELEPHONE: 954-971-4747
FAX: 954-971-4925

MODEL: EX3 USA
INSWING DOOR
LARGE MISSILE
IMPACT RESISTANT

DRAWING: DETAILS


SCALE: NONE

DRAWN BY: KP, RE

DATE DWN: 11/10/05, REV. 04/18/11


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0228-03
Expiration Date Feb 23, 2016
by *Shag I. Chandra*
Miami Dade Product Control

11-036
DRAWING N°
SHEET 8 OF 11

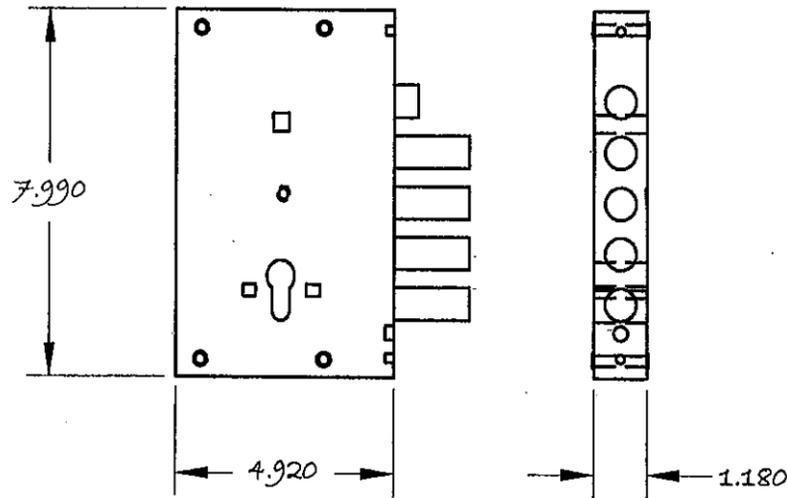

13.1 LOCK
SCALE: 1/4

ATTACHED TO LOCK
STILE W/ (2) 1/4-28
X 1/2" FH ALLEN SCR.

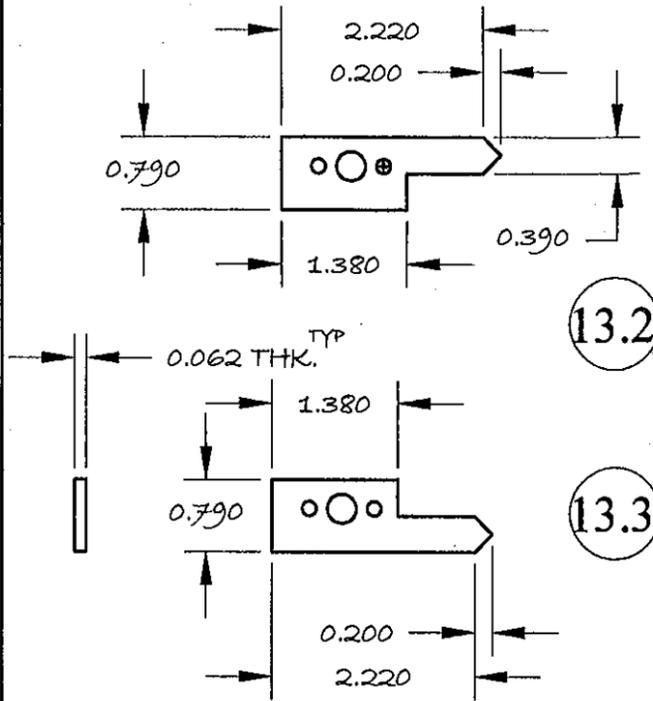


13.2

13.3

TONQUE UPPER AND LOWER
SCALE: 1/2


ITEM #	DESCRIPTION	QUANTITY
13.1	LOCK	1
13.2	TONQUE UPPER	1
13.3	TONQUE LOWER	1
13.4	LOCK SLIDE BOLTS	2
13.5	CONNECTOR ROD (NOT SHOWN)	2
13.6	LOCK STRIKE PLATE	1

13
9 MULTI-POINT LOCKING SYSTEM

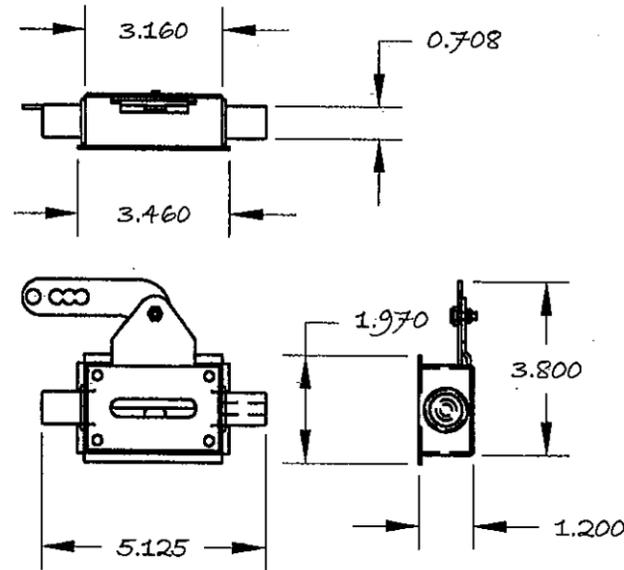


(2) REQUIRED AT
LOCK STILE

13.4 LOCK SLIDE BOLTS
SCALE: 1/4

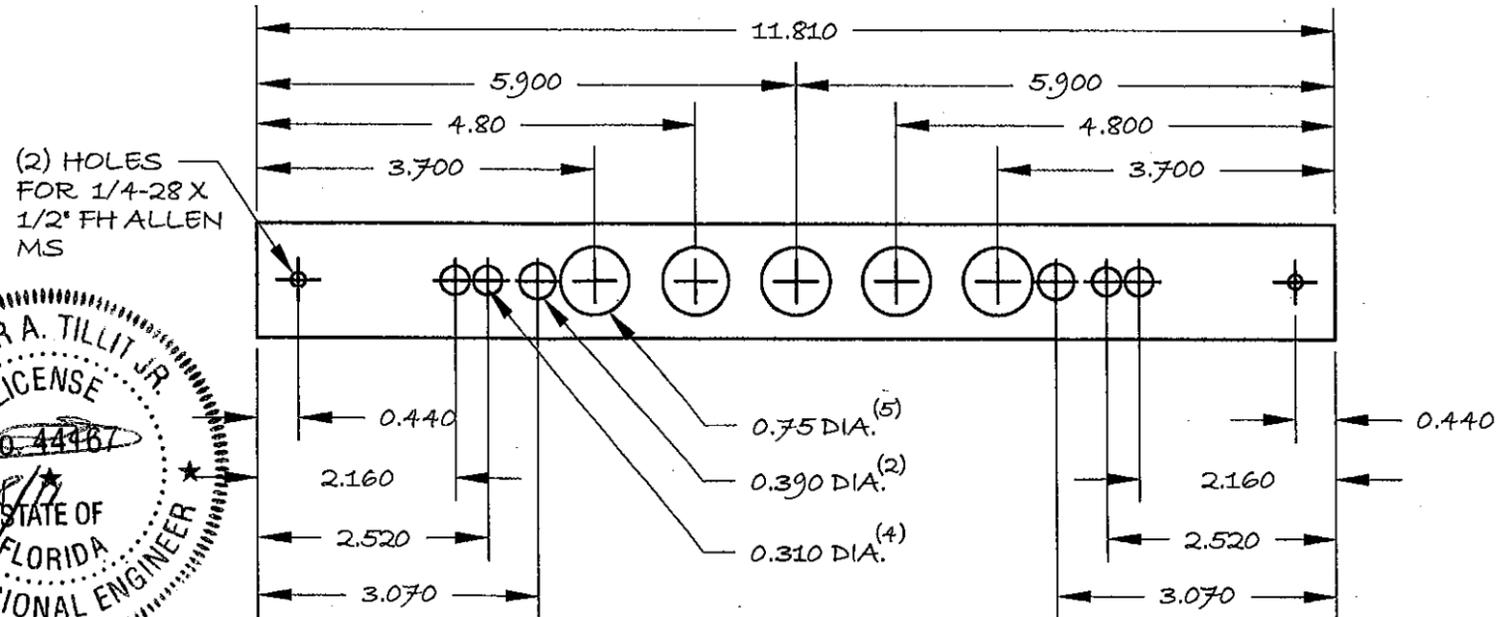

(2) HOLES
FOR 1/4-28 X
1/2" FH ALLEN
MS

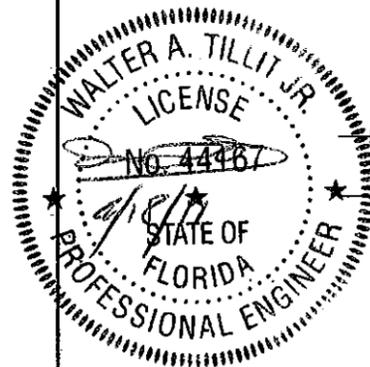

13.6 LOCK STRIKE PLATE
SCALE: 1/2



©2011 TILTECO, INC.
TILTECO INC.
TILIT TESTING & ENGINEERING COMPANY
6055 N.W. 36th St., Ste. 305 - VERO BEACH, FL 32908
Phone: (888)971-1536 Fax: (888)971-1531
WALTER A. TILLIT JR., P.E.
EB-0006719
FLORIDA LIC. # 44167

MASTER SECURITY DOORS, INC
2179 N POWER LINE ROAD
SUITE 2
POMPANO BEACH, FL 33069
TELEPHONE: 954-971-4747
FAX: 954-971-4925


MODEL: EX3 USA
INSWING DOOR
LARGE MISSILE
IMPACT RESISTANT
DRAWING: LOCK SYSTEM
SCALE: NONE
DRAWN BY: KP, RE
DATE DWN: 11/10/05, REV. 04/18/11

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0228-03
Expiration Date FEB 23, 2016
L. Charles L. Linn
Product Control


11-036
DRAWING N°
SHEET 9 OF 11

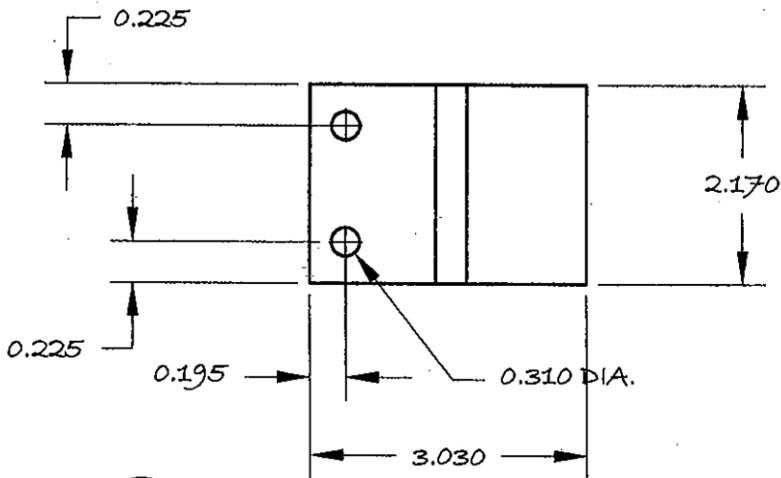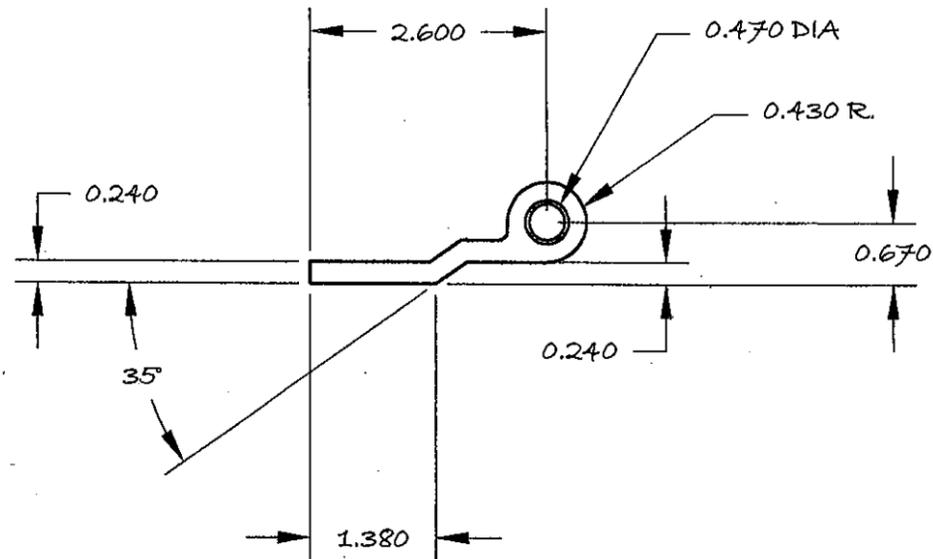

6.1 HINGE MALE
SCALE: HALF

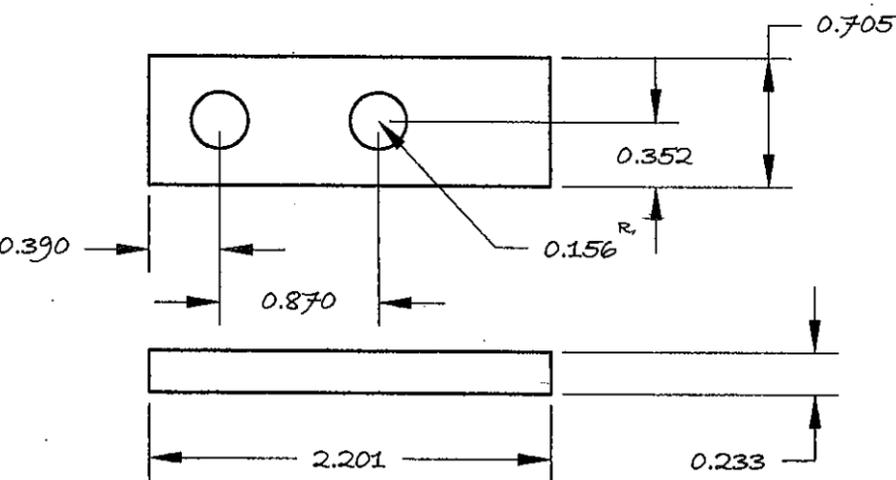


6.2 HINGE BACKER PLATE
SCALE: FULL



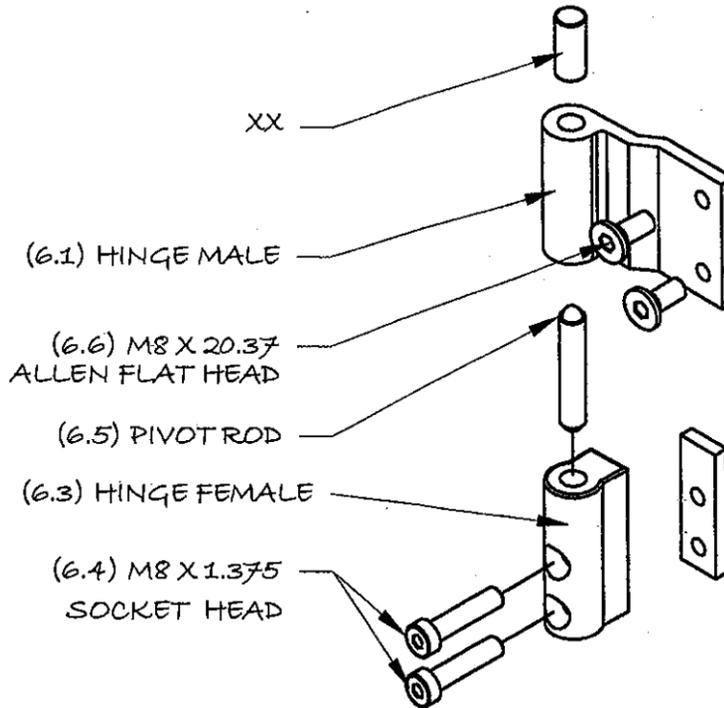


6
10 HINGE ASSEMBLY

ITEM #	DESCRIPTION	QUANTITY
6.1	HINGE MALE	1/ASSY
6.2	HINGE BACKER PLATE	1/ASSY
6.3	HINGE FEMALE	1/ASSY
6.4	M8 X 1.375 SOCKET HEAD	2/ASSY
6.5	PIVOT ROD	1/ASSY
6.6	M8 X 20.37 ALLEN FH	2/ASSY

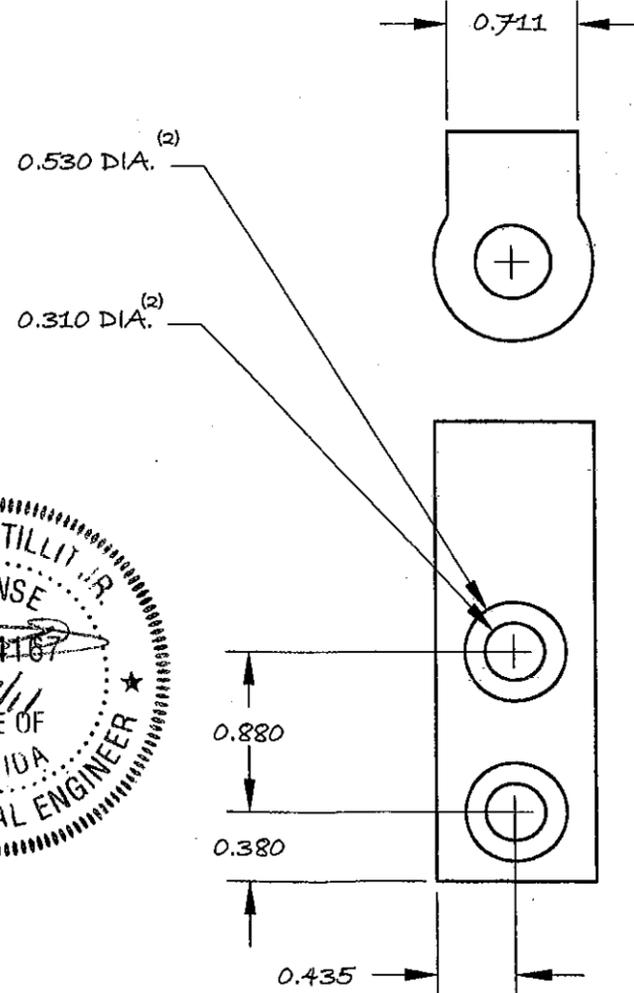

6.3 HINGE FEMALE
SCALE: FULL

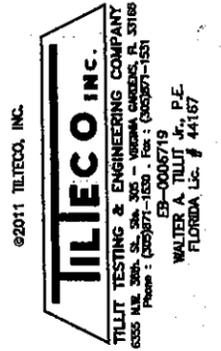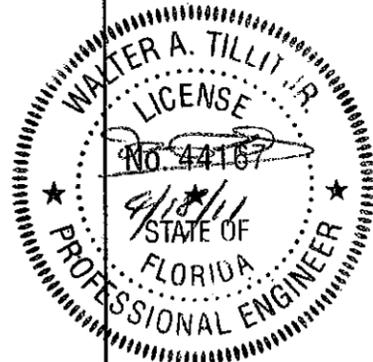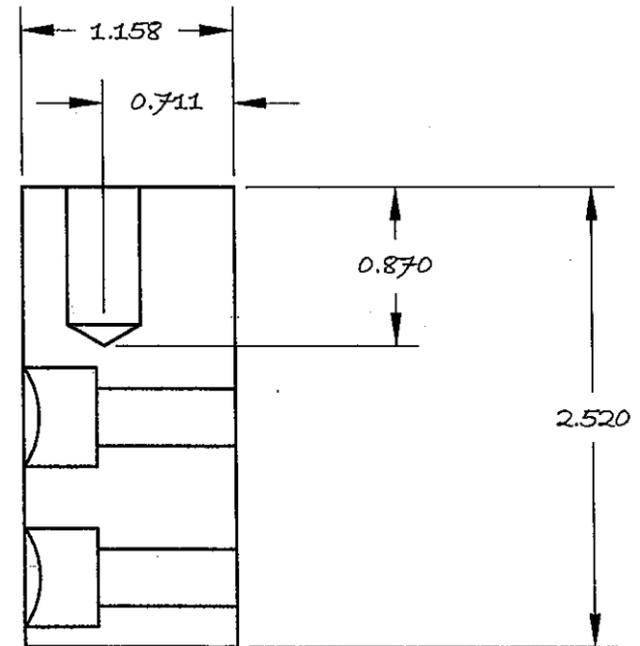


MASTER SECURITY DOORS, INC
2179 N POWER LINE ROAD
SUITE 2
POMPANO BEACH, FL 33069
TELEPHONE: 954-971-4747
FAX: 954-971-4925


MODEL: EX3 USA
INSWING DOOR
LARGE MISSILE
IMPACT RESISTANT
DRAWING: HINGE ASSY
SCALE: NONE
DRAWN BY: KP, RE
DATE DWN: 11/10/05, REV. 04/18/11

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0228-03
Expiration Date FEB 23, 2016
Ishag I. Ahmad
Missed Date Product Control


11-036
DRAWING N°
SHEET 10 OF 11

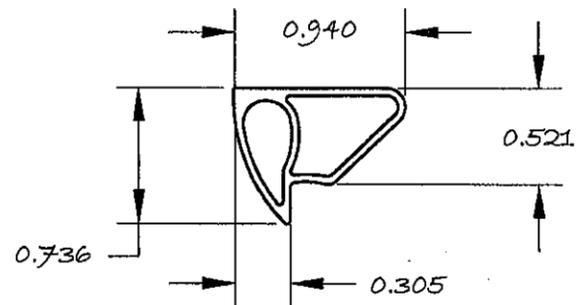



22
11 FRAME GASKET
SCALE: FULL

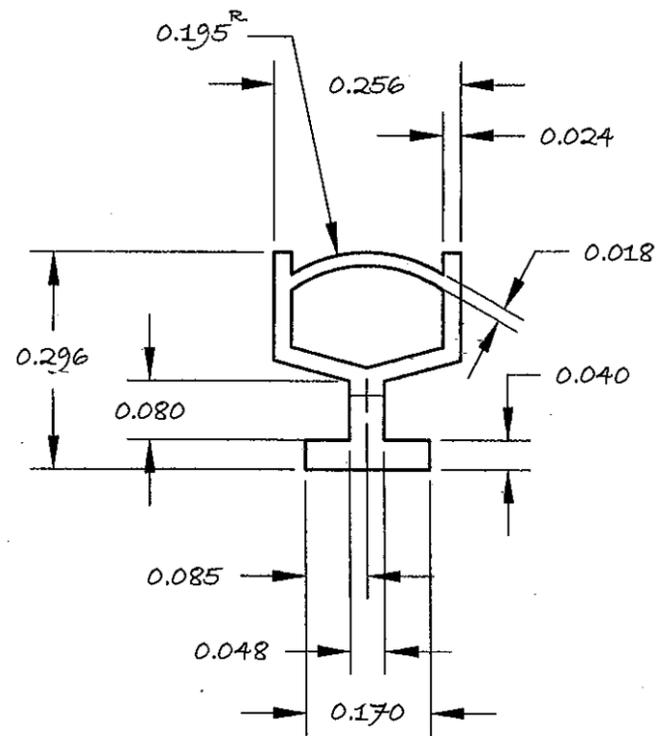


23
11 COMPRESSION GASKET
SCALE: 10X

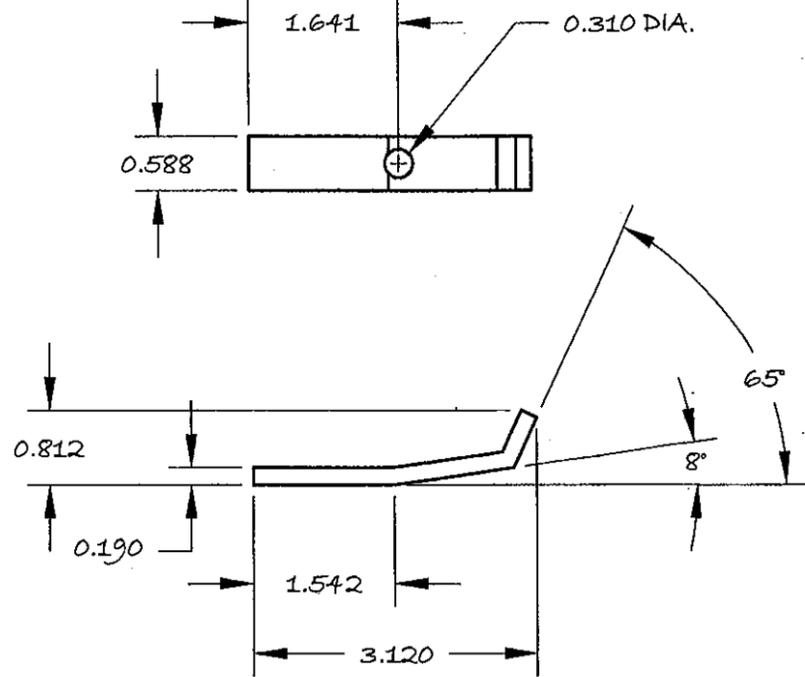

26
11 RETENTION CLIP
SCALE: HALF

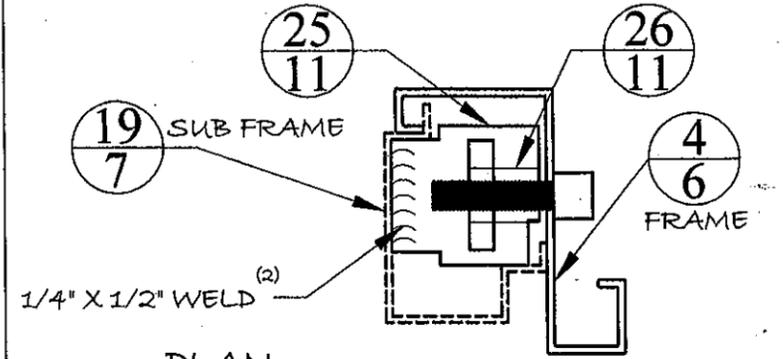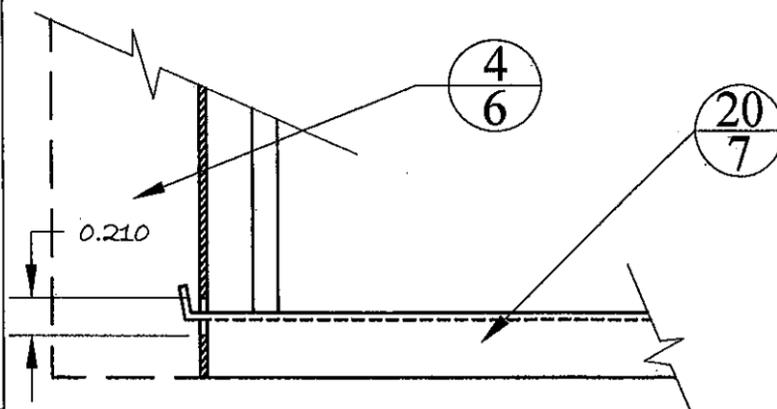


PLAN

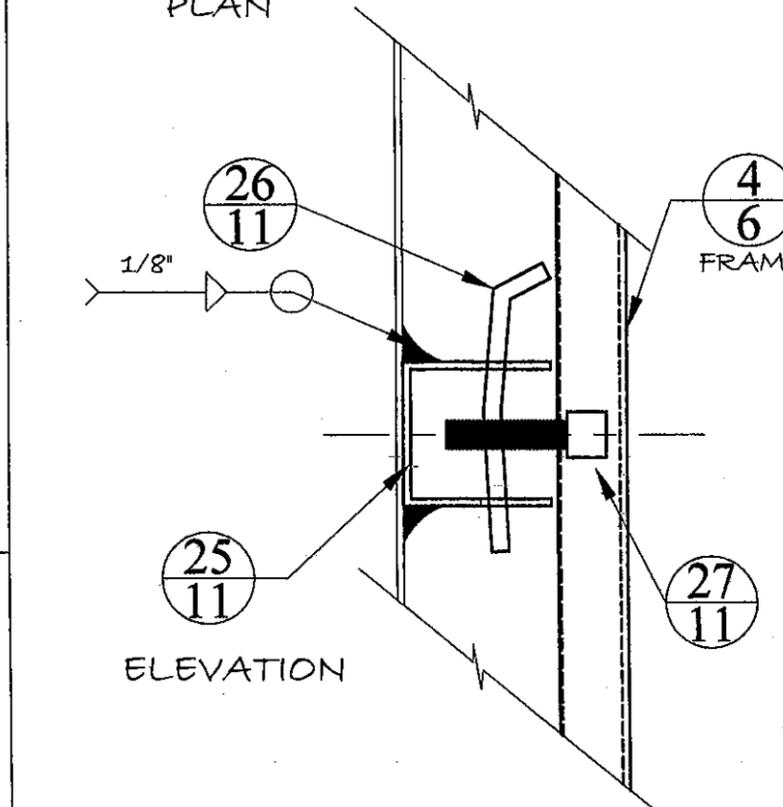


ELEVATION

X
11 SUBFRAME CONNECTION TO FRAME

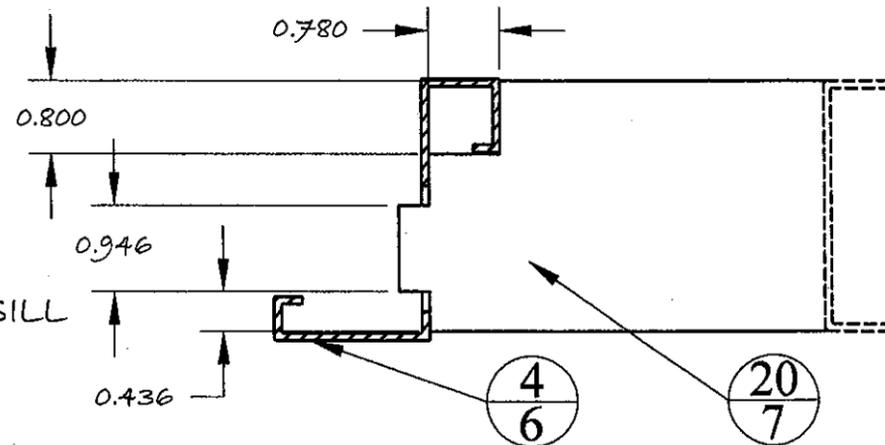

Y
11 LOWER FRAME SILL
TO FRAME JAMB
CONNECTION

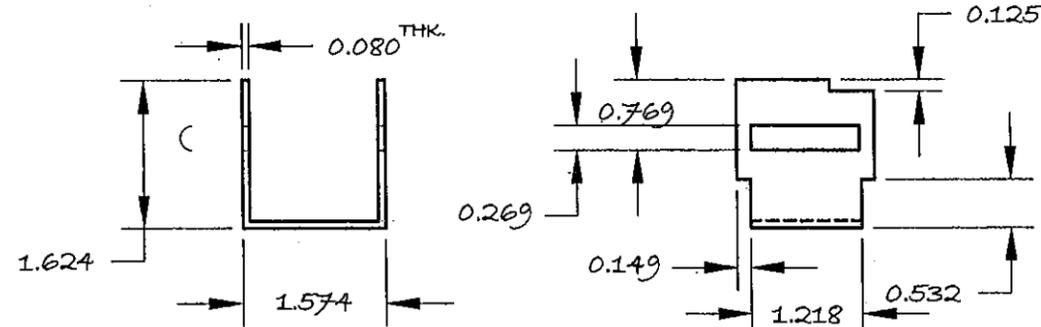

25
11 ADJ RETENTION CLIP HOUSING
SCALE: 1/2

©2011 TILTECO, INC.
TILECO INC.
TILIT TESTING & ENGINEERING COMPANY
6325 N.W. 39th St., Ste. 202 - WESLAK, GARDENS, FL 33168
Phone: (305) 971-1530 Fax: (305) 971-1531
E-mail: TILIT@TILCO.COM
WALTER A. TILIT JR., P.E.
FLORIDA Lic # 44167

MASTER SECURITY DOORS, INC
2179 N POWER LINE ROAD
SUITE 2
POMPANO BEACH, FL 33069
TELEPHONE: 954-971-4747
FAX: 954-971-4925

MODEL: EX3 USA
INSWING DOOR
LARGE MISSILE
IMPACT RESISTANT
DRAWING: DETAILS
SCALE: NONE
DRAWN BY: KP, RE
DATE DWN: 11/10/05, REV. 04/18/11

PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No 11-0228-03
Expiration Date Feb 23, 2016
Walter A. Tilit Jr. P.E.
Master Security Doors Product Control

11-036
DRAWING N°
SHEET 11 OF 11

