

NOTICE OF ACCEPTANCE (NOA)

Arch Windows, LLC dba AWP
8130 NW 74th Avenue
Medley, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County BNC -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BNC reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "1900" Aluminum Sliding Glass Door

APPROVAL DOCUMENT: Drawing No. **W11-04**, titled "Series" 1900" Alum SLD. Glass Door (L.M.I.)", sheets 1 through 7 of 7, dated MAY 12, 2011, prepared by AL-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

Limitations:

1. Design Pressures for OXO and OXXO configurations are limited to =+/- 80 PSF (3-1/2" sill riser is required for positive design pressure water rating).
2. Design Pressure rating for down sizes OX or XO w/ 48" Wide X 96" High or smaller (up to code limits) DP = +80/-120 PSF.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and Series and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **08-1028.02 (Former AWP, LLC)** and consists of this page 1 and evidence pages E-1 & E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



6/1/11

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- A. DRAWINGS** (transferred from file # **08-1028.02**)
1. Manufacturer's die drawings and sections.
 2. Drawing No. **W11-04**, titled "Series" 1900" Alum SLD. Glass Door (L.M.I.)", sheets 1 through 7 of 7, dated MAY 12, 2011, prepared by AL-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
- B. TESTS** (transferred from file # **08-1028.02 & 08-0722.05**)
1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Force Entry Resistant per FBC, TAS 202-94
Along with marked-up drawings and installation diagram of OXXO Alum Sliding Glass Doors, prepared by Fenestration Testing Laboratory Inc, Test Report No. **FTL-5508 (FTL-08009)**, dated 03/19/08, signed & sealed by Carlos S. Rionda, P. E.
 2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
Along with marked-up drawings and installation diagram of OX Alum Sliding Glass Doors, prepared by Fenestration Testing Laboratory Inc, Test Report No. **FTL-5727 (FTL-08138)**, dated 10/08/08, signed & sealed by Carlos S. Rionda, P. E.
- C. CALCULATIONS**
1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated 03/11/11, signed and sealed by Javad Ahmad, P.E
 2. Glazing complies w/ ASTME-1300-02 & -04
- D. QUALITY ASSURANCE**
1. Miami Dade Building and Neighborhood Compliance Department (BNC).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. **11-0325.05** issued to Solutia, Inc. for "**Saflex & Vanceva™ Clear & Color interlayer**", expiring on May 21, 2016.
- F. STATEMENTS**
1. Statement letter of conformance and letter of no financial interest, prepared by Al-Farooq Corporation, dated 02/24/11, signed and sealed by Javad Ahmad, P.E.
 2. Statement letter of compliance, part of the above referenced test reports.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 11-0325.01

Expiration Date: September 18, 2013
Approval Date: June 09, 2011

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (continue)

3. Sales agreement between AWP, LLC (seller) and Arch Aluminum & Glass Enterprise, a Delaware Corp (purchaser) dated Jan 14, 2010, signed by Leon J. Silverstein and Wm, Robert Wright, respectively.
4. Certificate of registration of Arch Windows, LLC in State of Delaware, dated 02-03-10.
5. Certificate of registration of Arch Windows, LLC (Delaware) in State of Florida dated 02-04, 2010, managed by Arch Intermediate Holding, LLC.
6. Florida Dept of State, listing of Arch Window, LLC (Foreign Limited Liability Co.), managed by Arch Intermediate Holding, LLC, Tamarac, Fl.
7. Asset purchase agreement dated 11/01/06 among AWP, LLC (Buyer) and Yale Ogron Windows & Door Inc. (seller), signed by Leon J. Silverstein and Manny Valladares, respectively.
8. Statement letter dated March 25, 2010, issued by Arch Windows, LLC that it has purchased all assets of AWP, LLC effectively Jan 29, 2010, signed by Leon Silverstein, President/CEO (Arch Windows, LLC).


G. OTHER

1. This NOA **revises** NOA # **08-1028.02**, expiring on September 18, 2013.
2. Test proposal dated 08/04/08 approved by BCCO.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 11-0325.01

Expiration Date: September 18, 2013
Approval Date: June 09, 2011

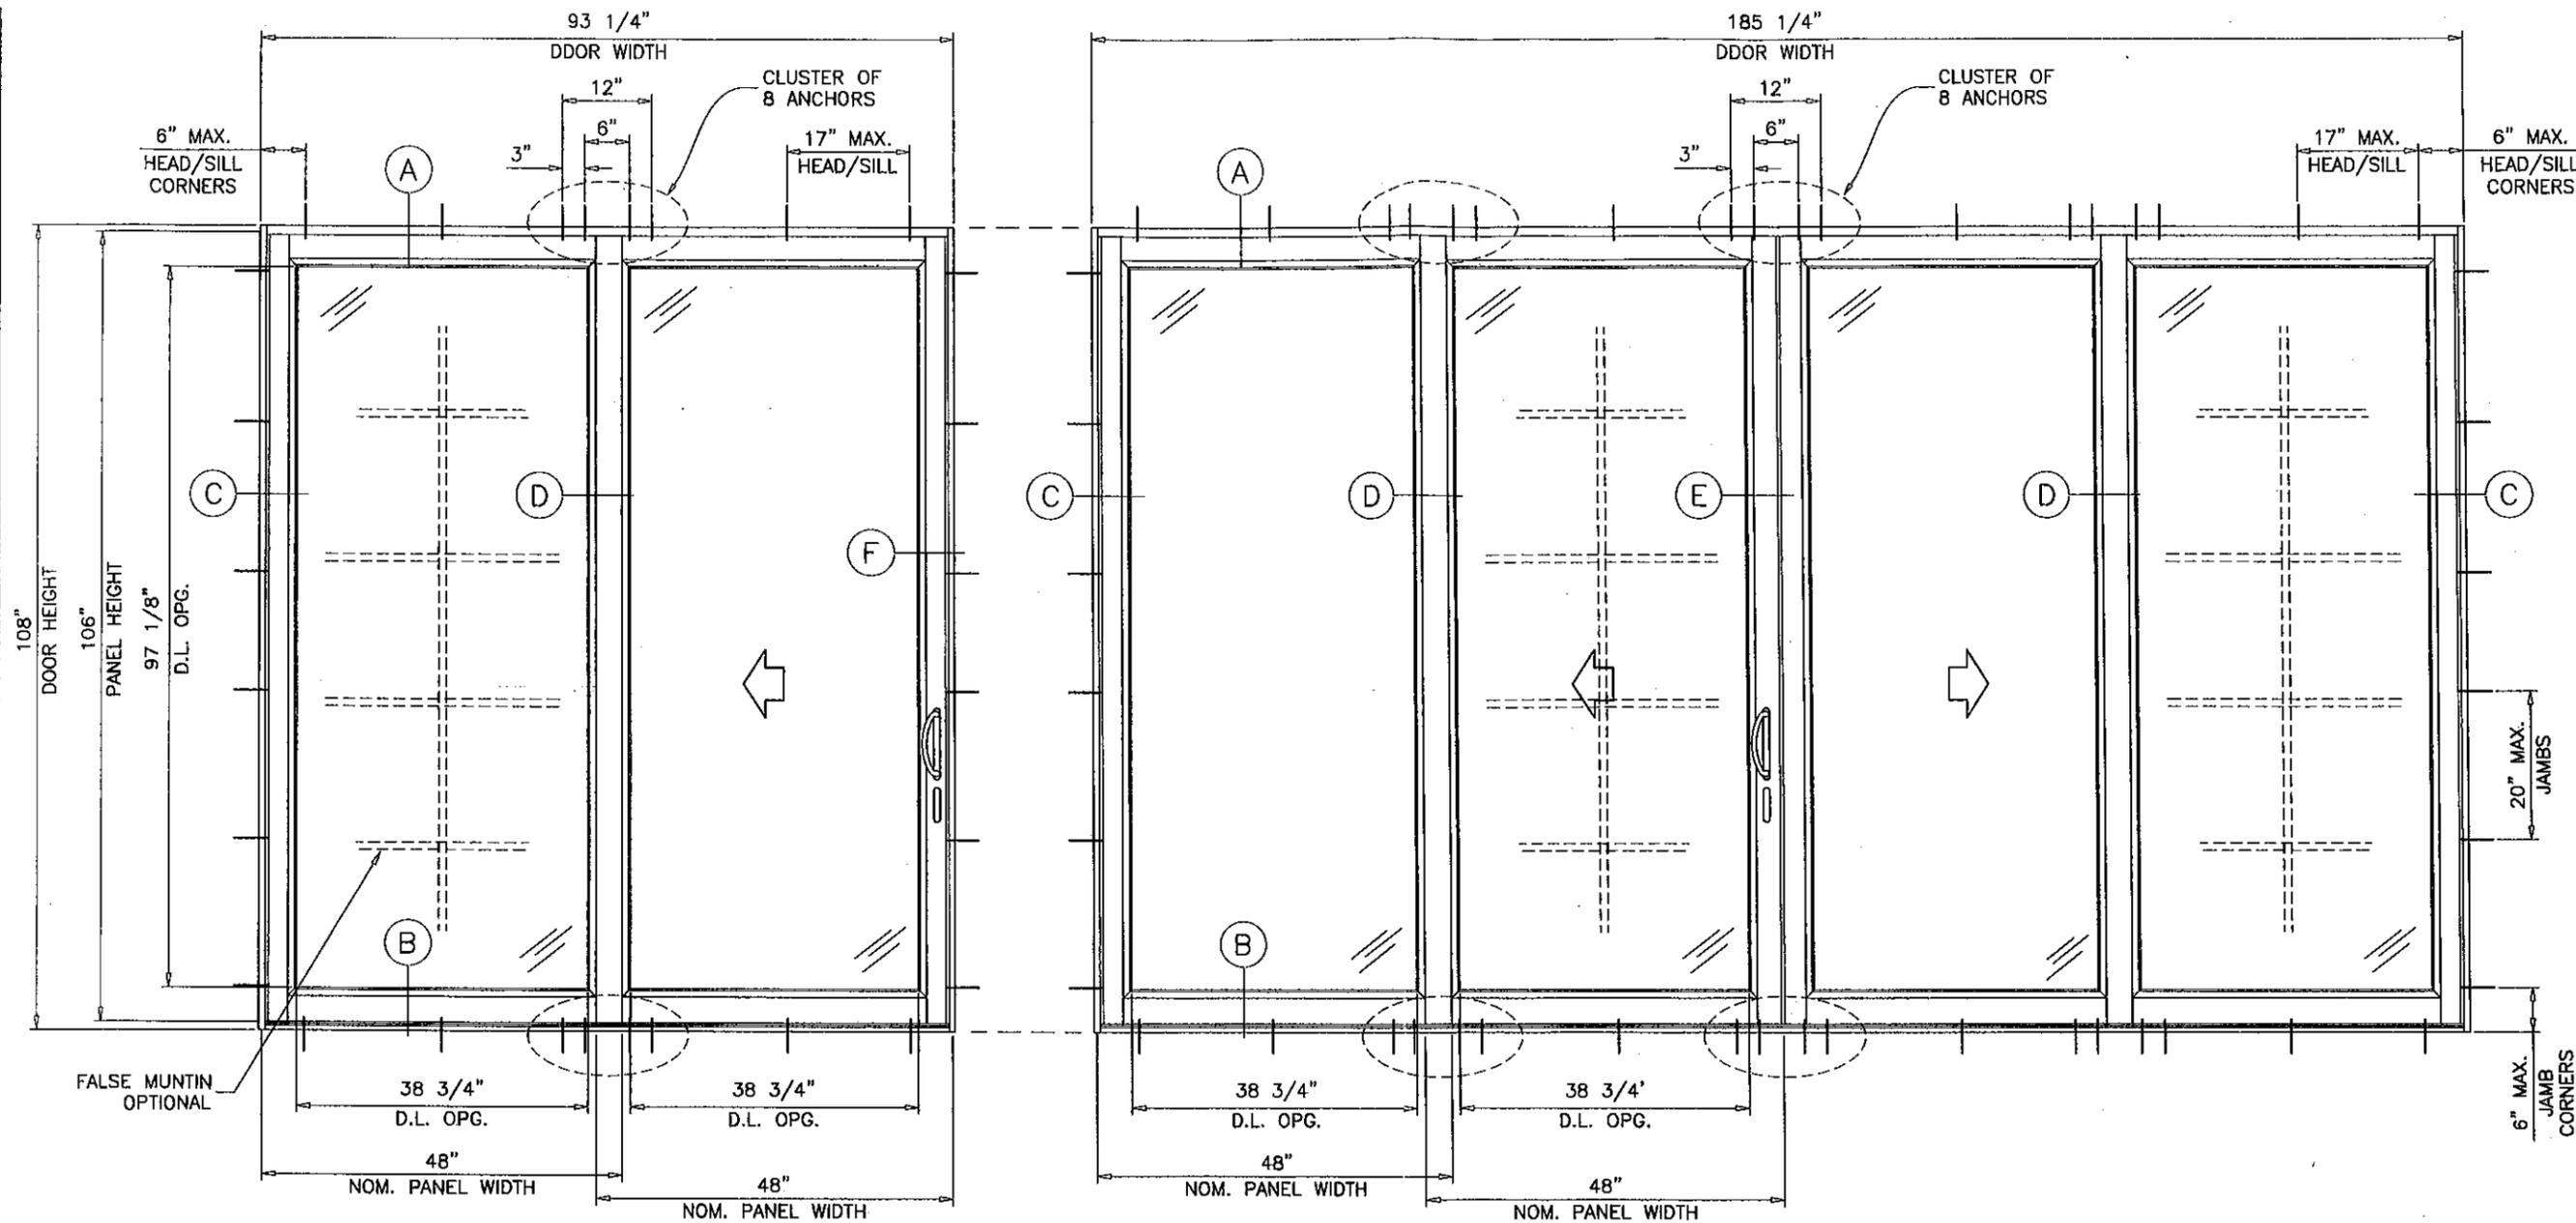

DESIGN LOAD CAPACITY - PSF			
MAX. PANEL WIDTH NOMINAL INCHES	MAX. DOOR HEIGHT INCHES	XO OR OX DOORS	
		EXT. (+)	INT. (-)
49-11/16	96	80.0	120.0
48	108	80.0	80.0

DAYLITE OPENINGS:
D.L.O. HEIGHT = PANEL HEIGHT - 8.875"
D.L.O. WIDTH = PANEL WIDTH - 9.250"

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT
AND REQUIRE NO SHUTTERS.

TYPICAL ELEVATIONS

SERIES 1900 ALUMINUM SLIDING GLASS DOOR

DESIGN LOAD CAPACITY FOR DOORS TO BE AS PER CHARTS SHOWN.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING
HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO
TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS
EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS
ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO
CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS
OF 2007 FLORIDA BLDG. CODE SECTION 2003.8.4.

DESIGN LOAD CAPACITY - PSF			
MAX. PANEL WIDTH NOMINAL INCHES	MAX. DOOR HEIGHT INCHES	OXO OR OXXO DOORS	
		EXT. (+)	INT. (-)
48	108	80.0	80.0

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0325-01
Expiration Date Sep 18, 2013
by *Ichang L. Choudhry*
Regional Product Control

LAMINATED GLASS
LARGE MISSILE IMPACT

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

[Signature]
MAY 12 2011


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W11-04AWP

SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309


NO.	DATE	BY	DESCRIPTION
A	05.04.11		REV. PER BNC COMMENTS

date: 02-17-11
scale: 3/8"=1'-0"
dr. by: HAMID
chk. by:


drawing no.
W11-04
sheet 1 of 7

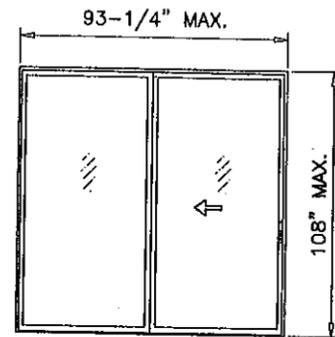


OX (SHOWN)
XO

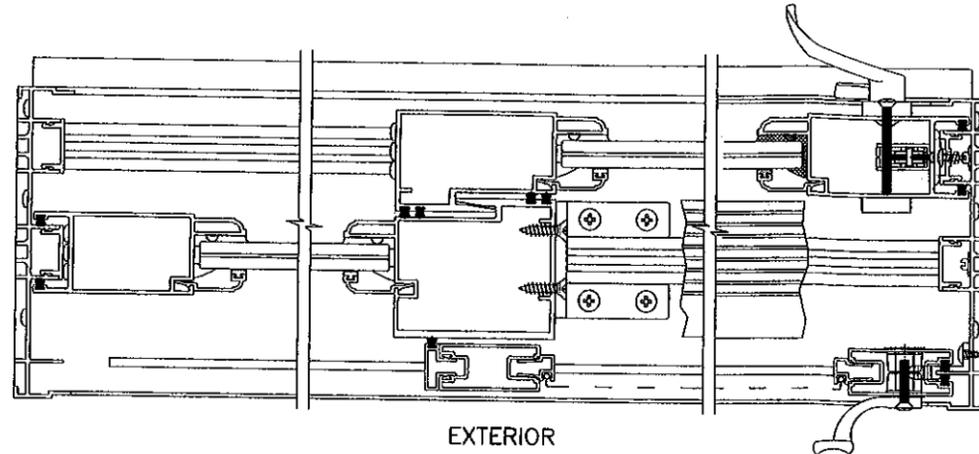


EXTERIOR

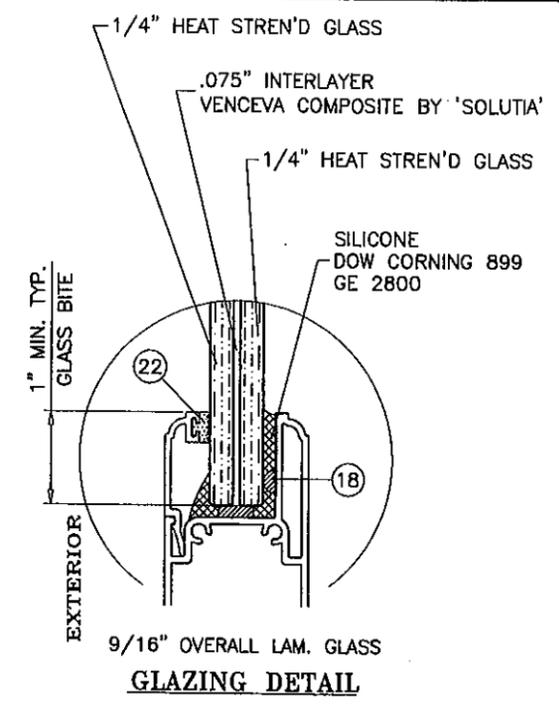

9/16" OVERALL LAM. GLASS
GLAZING DETAIL

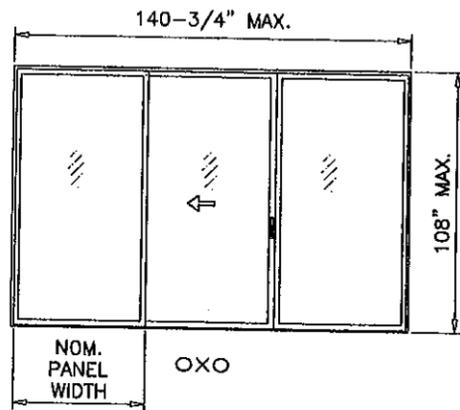


NOM. PANEL WIDTH
OXO

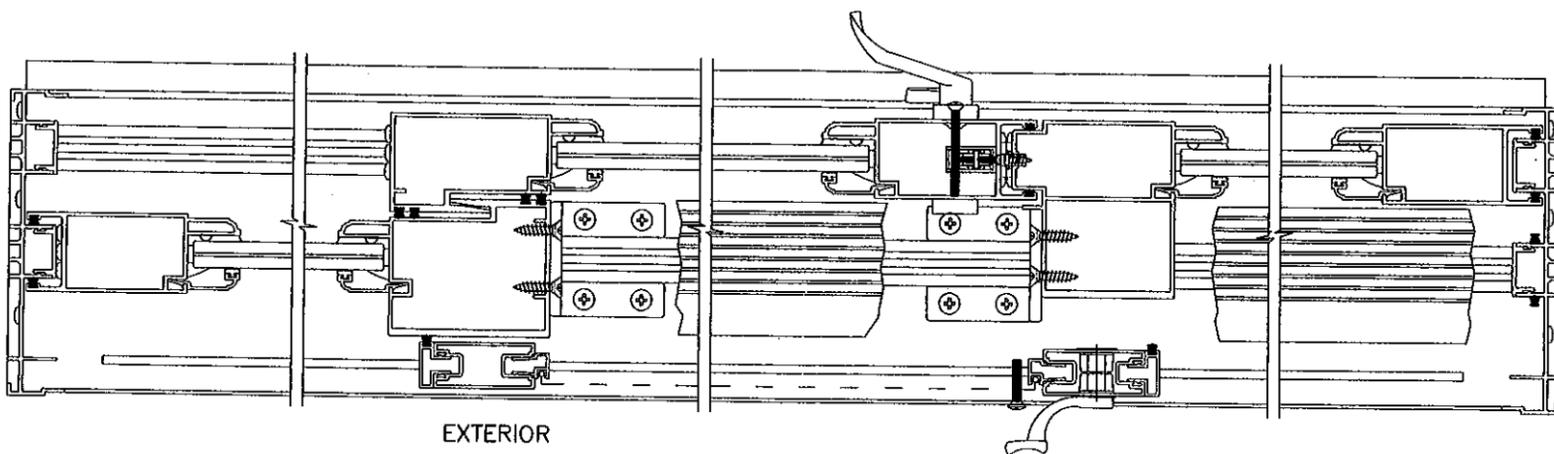


EXTERIOR

PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No. 11-0325.01
Expiration Date 5/21/2013
By Ishara I. Ghandi
Technical Data Product Control

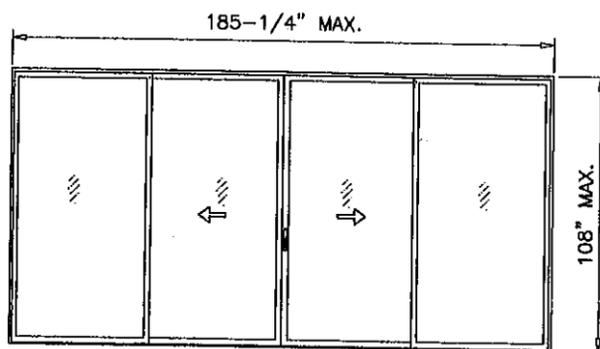

OXXO

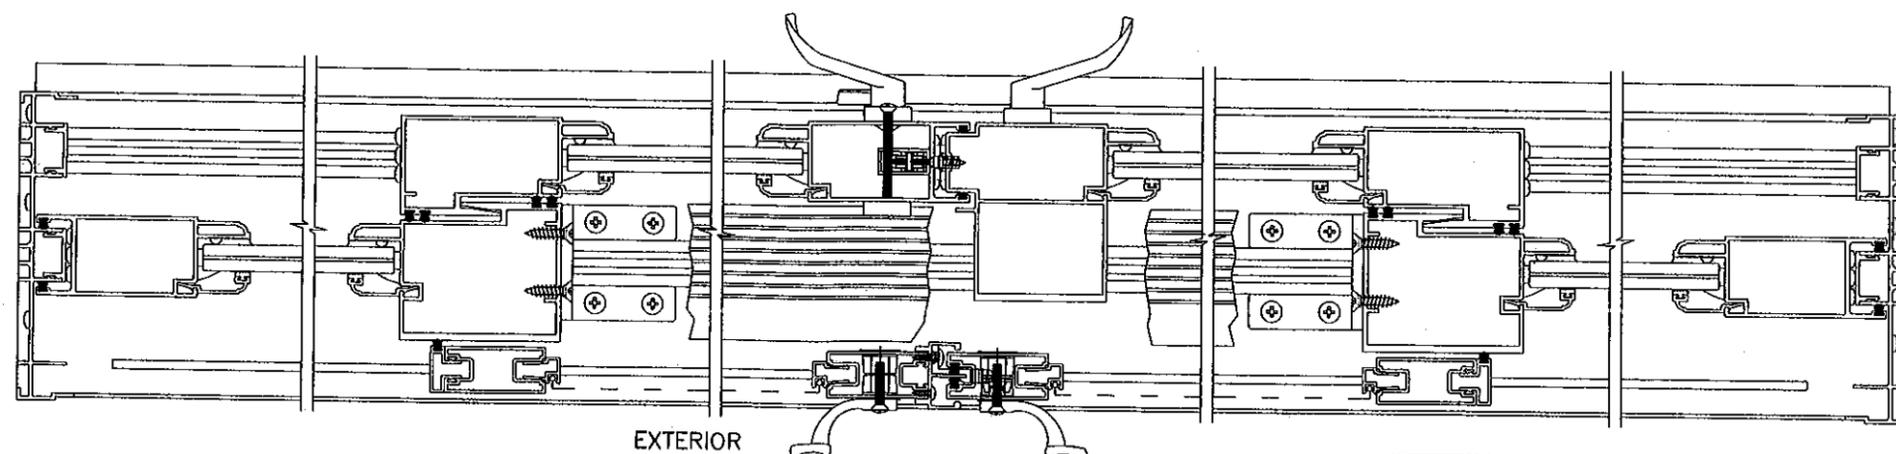

EXTERIOR

APPROVED CONFIGURATIONS

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70593
C.A.N. 3538
[Signature]
MAY 12 2011

CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSE
SEE SHEETS 3 THRU 5 FOR ANCHORS AND SUBSTRATE.

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\W11-04AWP



SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL (305) 887-2646 FAX (305) 883-1309

NO	date	by	description
A	05.04.11		REV. PER BNC COMMENTS


date: 02-17-11
scale: -
dr. by: HAMID
chk. by:

drawing no.
W11-04


sheet 2 of 7

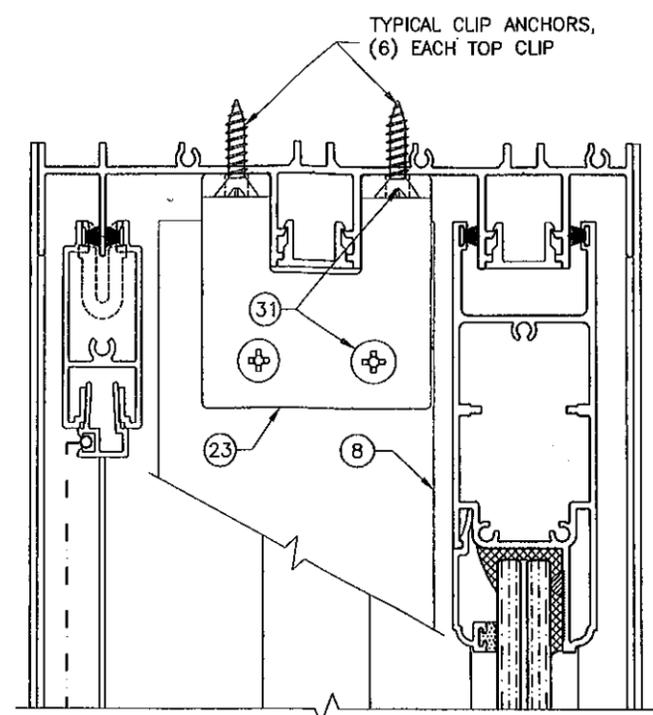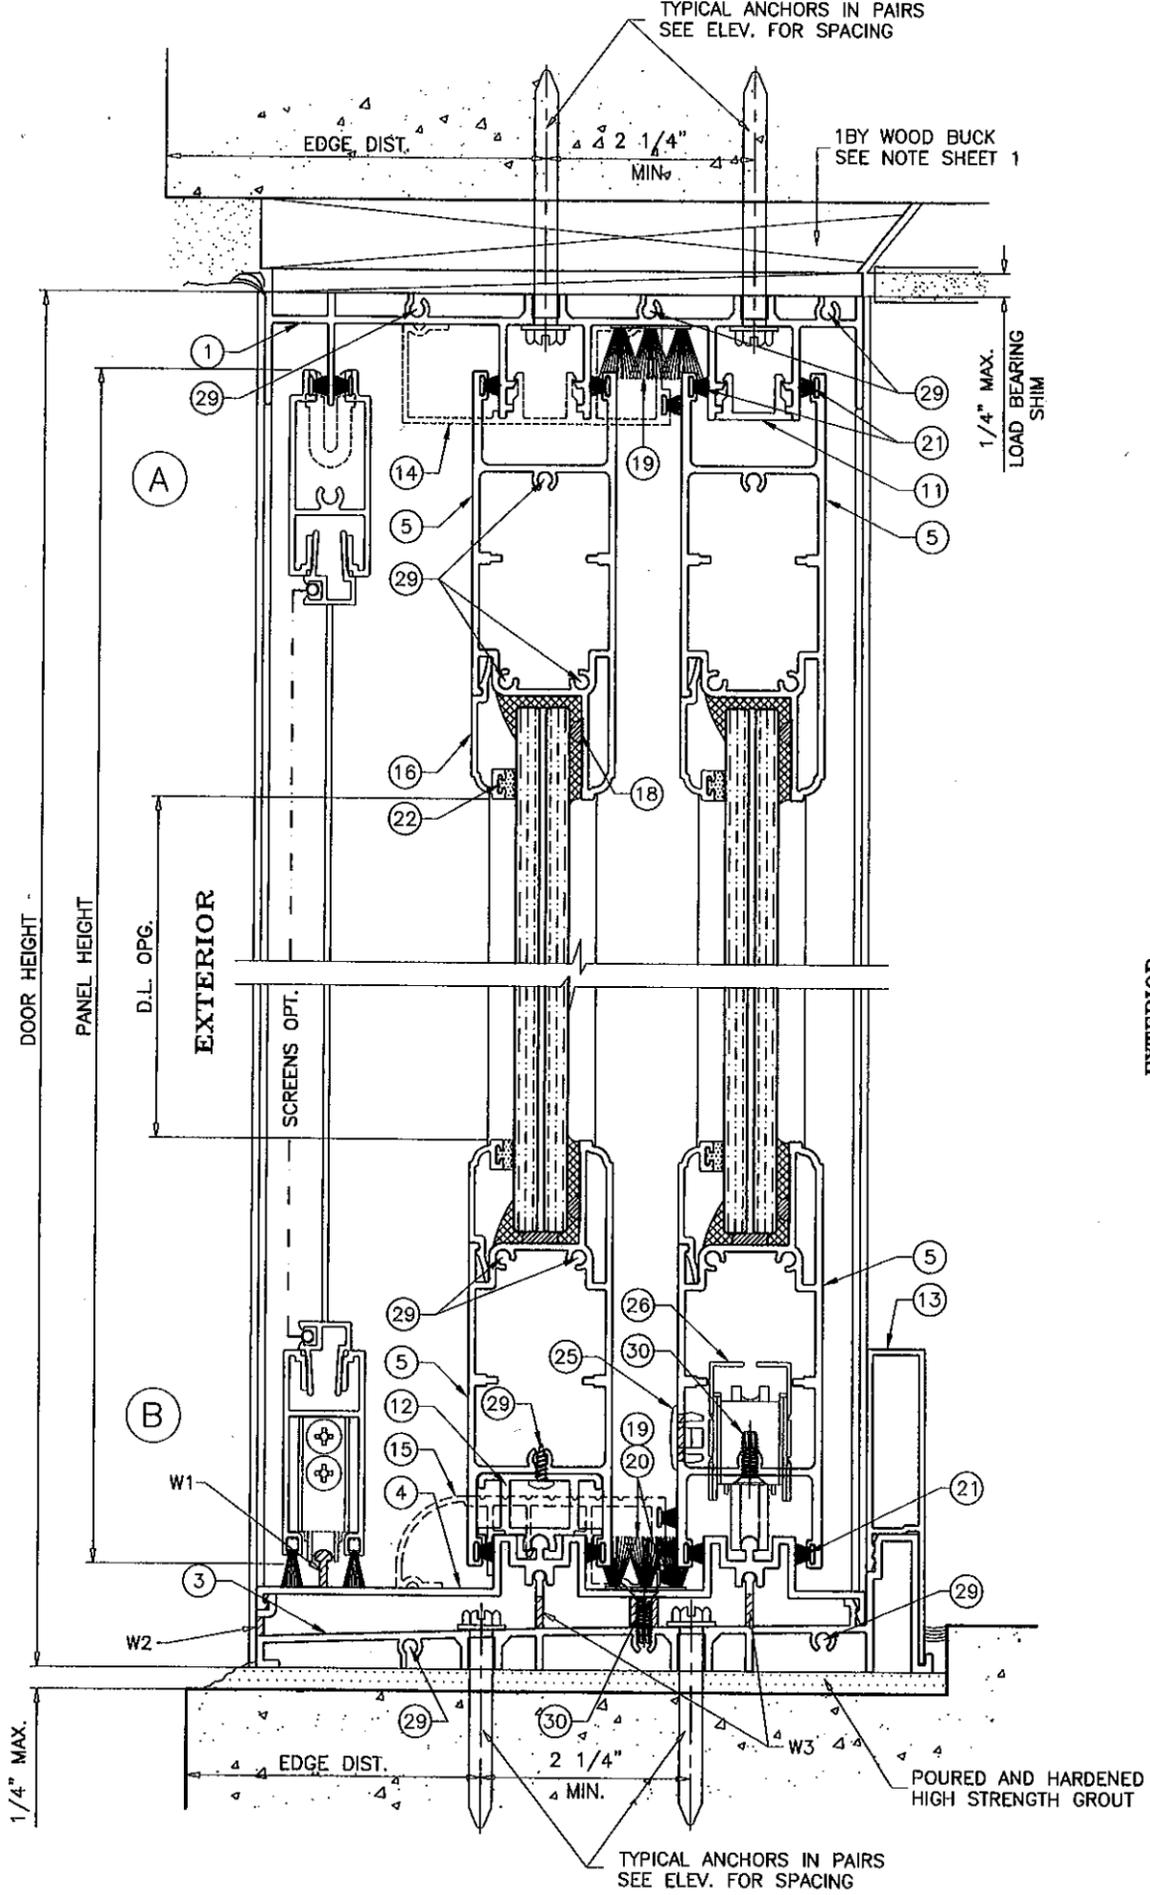


HEAD COVER REMOVED TO SHOW CLIP

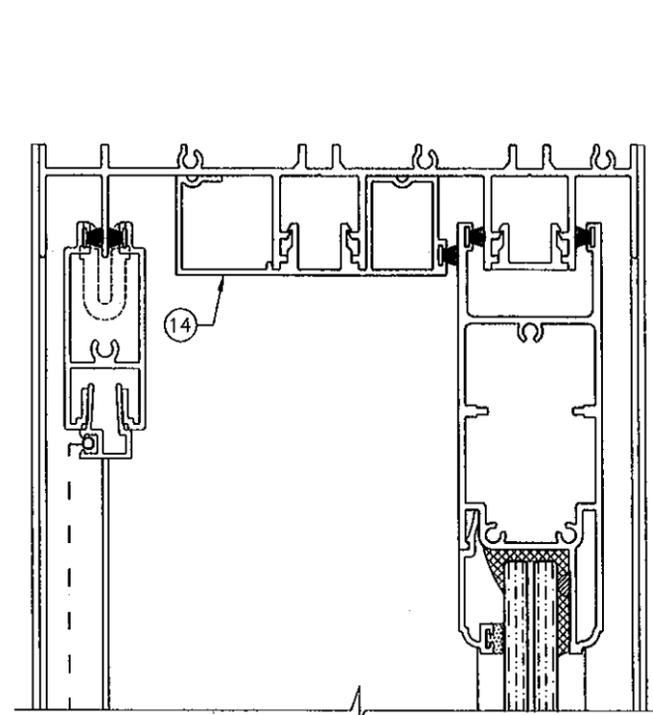

HEAD COVER BETWEEN FIX. PANELS

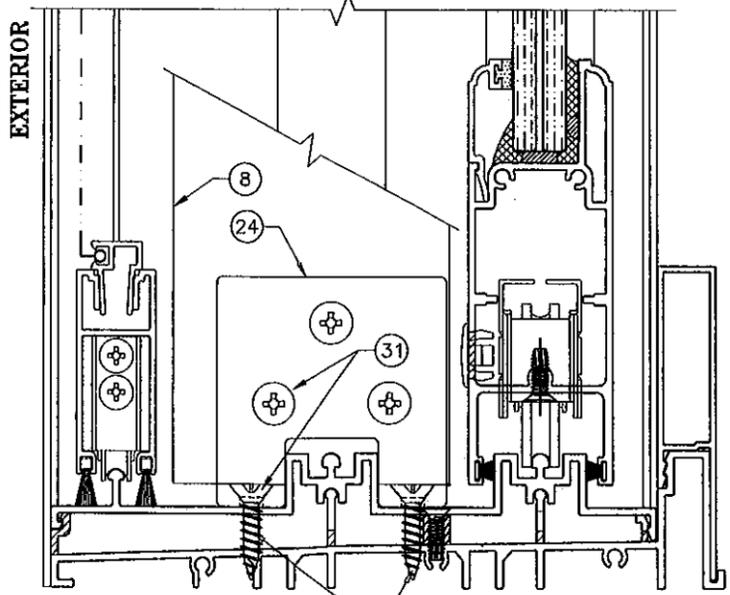

SILL COVER REMOVED TO SHOW CLIP

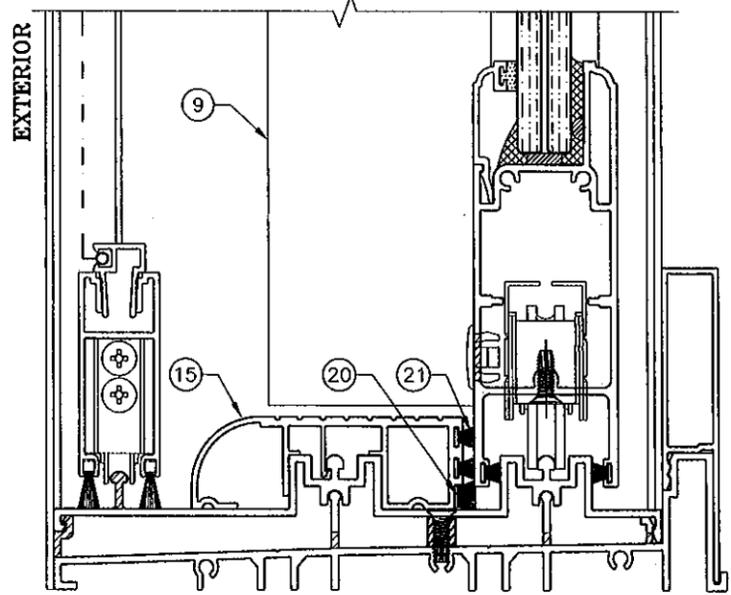

SILL COVER BETWEEN FIX. PANELS

- WEEPHOLES:**
- W1 = 7/8" WEEP NOTCH AT EACH END OF SCREEN TRACK
 - W2 = 7/8" WEEP SLOT AT EACH END OF SILL
 - W3 = 1/2" WEEP NOTCH AT SILL FLANGES AT 6" FROM PANEL ENDS AND AT MIDSPAN

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

[Signature]
 MAY 12 2014

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 11-032501
 Expiration Date: SEP 18, 2013

by *[Signature]*
 Manual Fabrication Control

af c


AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W11-04AWP

SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)
 ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL 33166
 TEL. (305) 887-2646 FAX (305) 883-1309


revisions:	no.	date	by	description
	A	05.04.11	REV. PER BNC COMMENTS	

date: 02-17-11	scale: 1/2" = 1"
dr. by: RAMID	chk. by:


drawing no.	W11-04
sheet	3 of 7

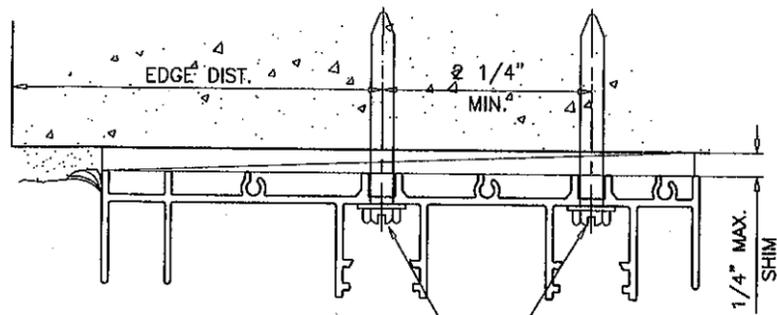


TYPICAL ANCHORS IN PAIRS
SEE ELEV. FOR SPACING

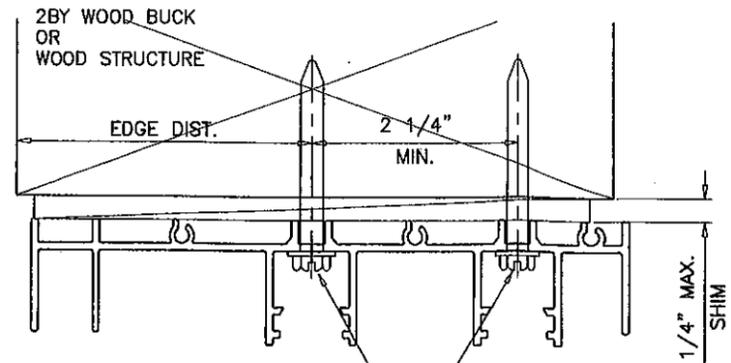

TYPICAL ANCHORS IN PAIRS
SEE ELEV. FOR SPACING

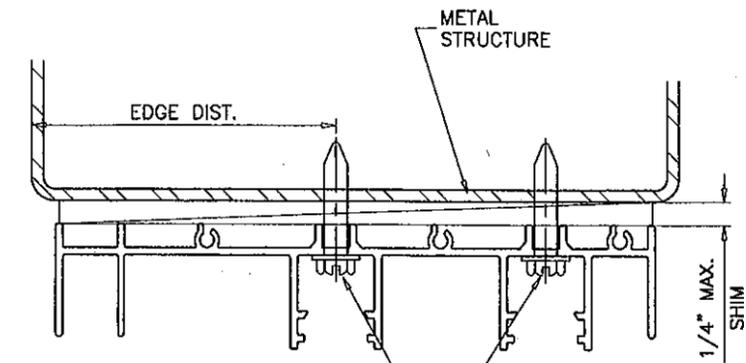

TYPICAL ANCHORS IN PAIRS
SEE ELEV. FOR SPACING

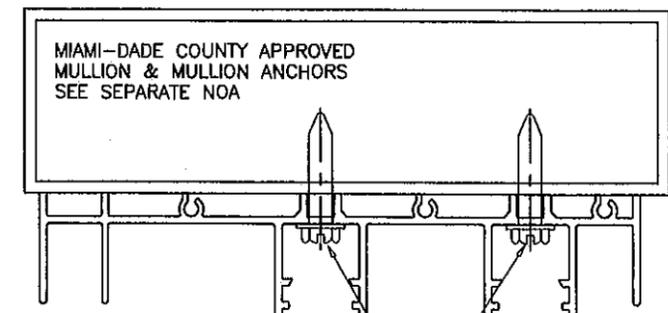

TYPICAL ANCHORS IN PAIRS
SEE ELEV. FOR SPACING

WOOD BUCKS AND METAL STRUCTURE NOT BY AWP
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)
1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = 1/8")
 INTO METAL STRUCTURES
 STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)
TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 11-0325-01
 Expiration Date SEP 13, 2013
 By: *J. Ahmad*
 Miami Dade Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
J.A.
 MAY 18 2011

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W11-04AWP




SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)
ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL (305) 887-2646 FAX (305) 883-1309

revisions:	
no	date by description
A	05.04.11 NO CHANGE THIS SHEET

date: 02-17-11
 scales: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W11-04
 sheet 4 of 7

MOVING PANEL WIDTH

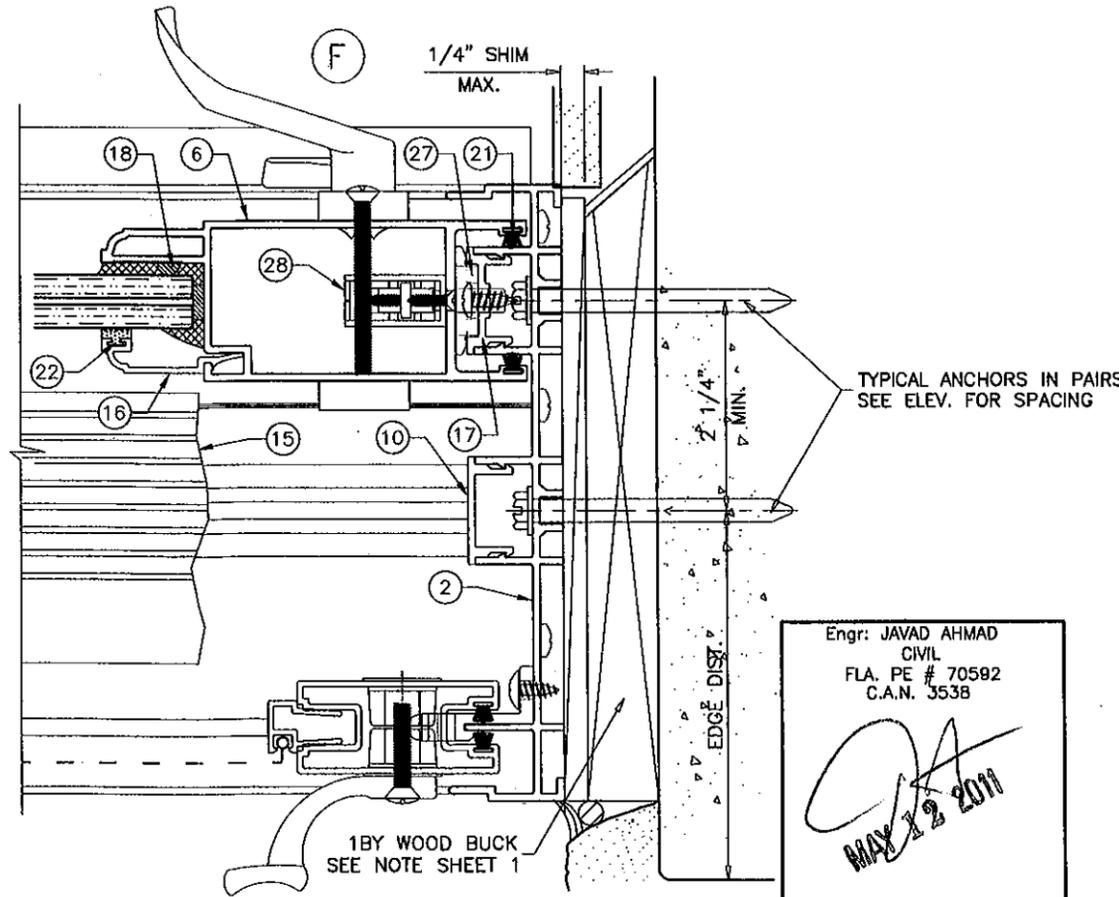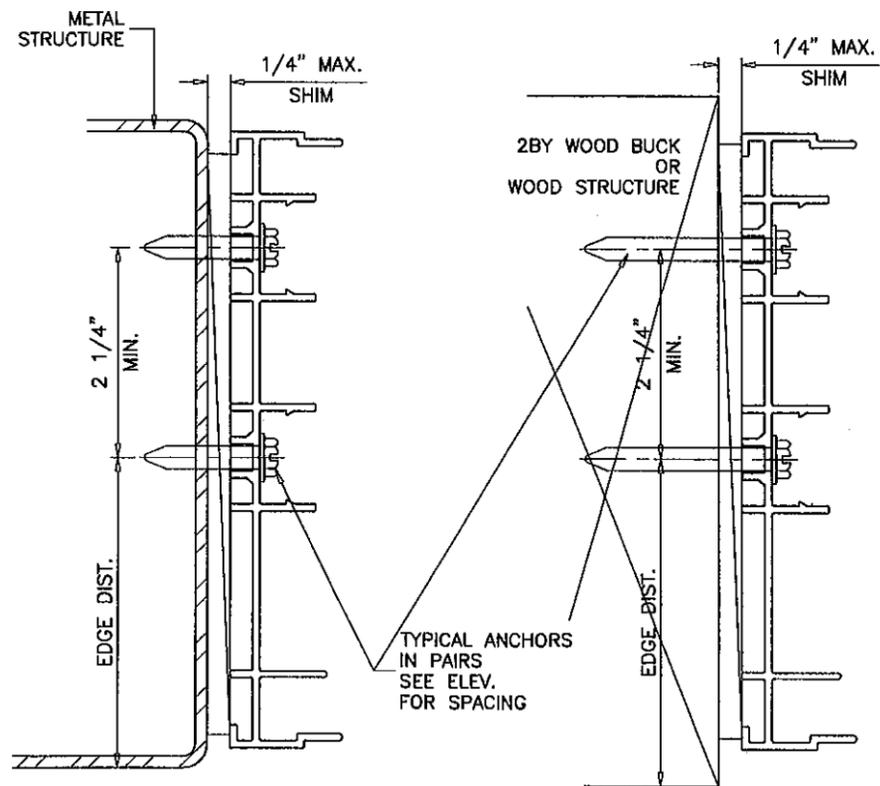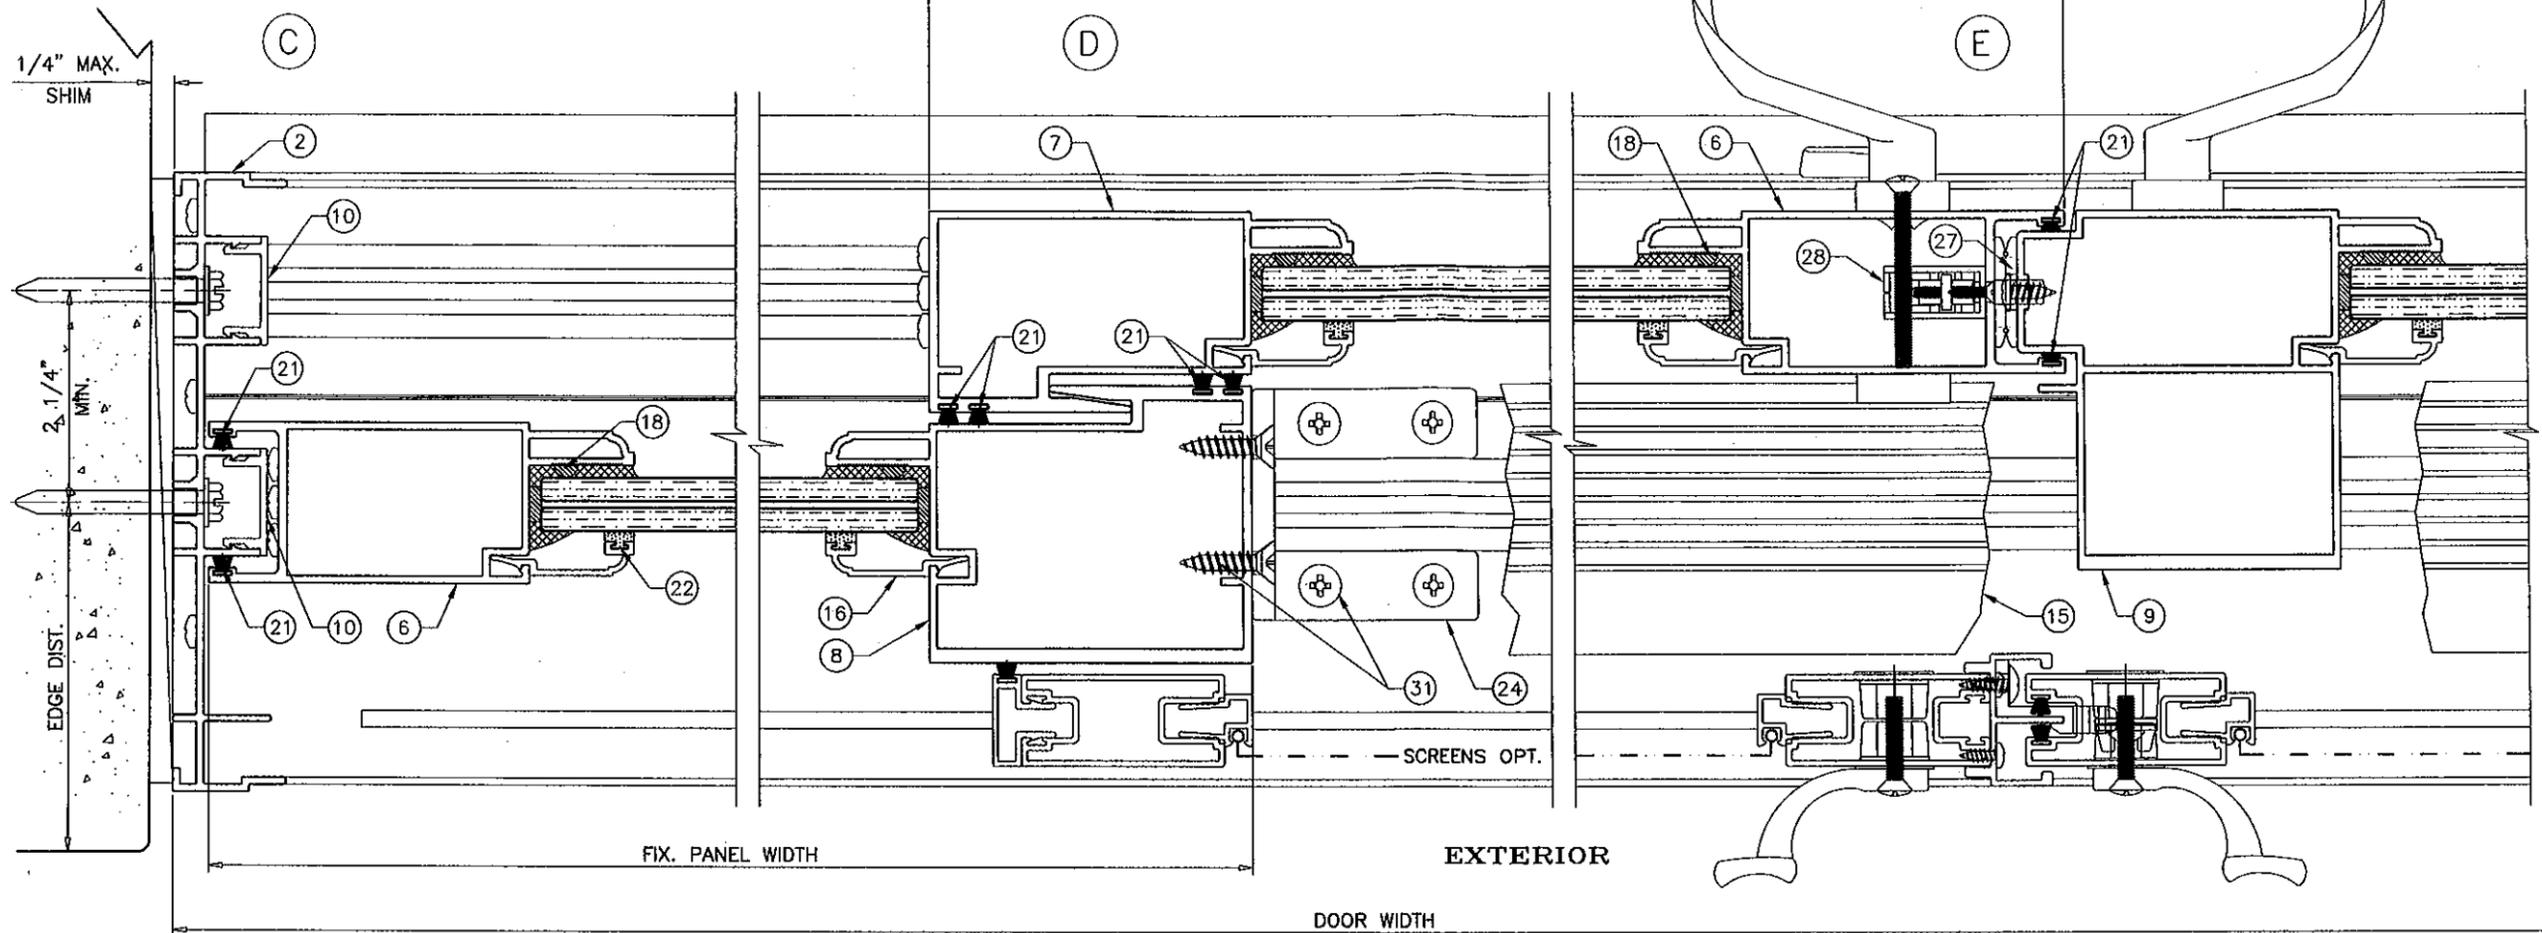

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70582
 C.A.N. 3538

[Signature]
 MAY 28 2011

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 11-032501
 Expiration Date: SEP 12, 2013
 By: *[Signature]*
 Quality Control




AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W11-04AWP

SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)
 ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309


no.	date	description	rev.	per	comments
A	05.04.11				

date:	02-17-11
scale:	1/2" = 1"
dr. by:	HAMID
chk. by:	


drawing no.	W11-04
sheet	5 of 7

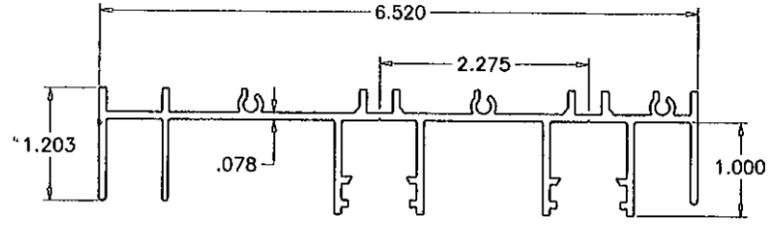


① FRAME HEAD

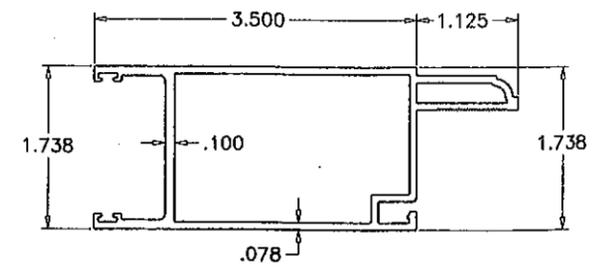


⑥ LOCK STILE

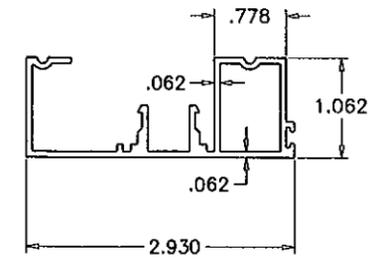


⑭ HEAD COVER

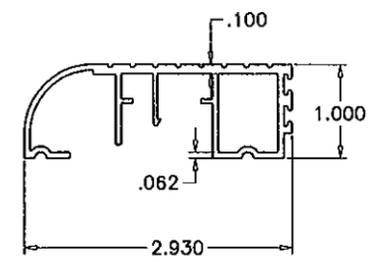


⑮ SILL COVER




⑯ GLAZING STOP

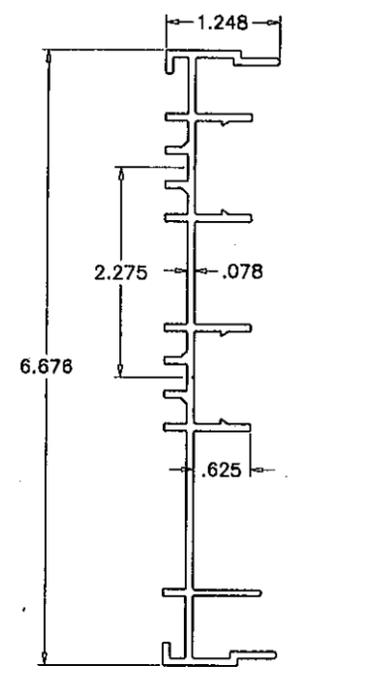


② FRAME JAMB

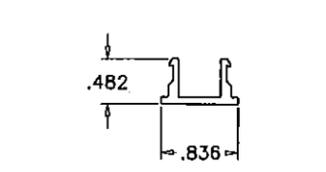


⑪ FRAME HEAD INSERT

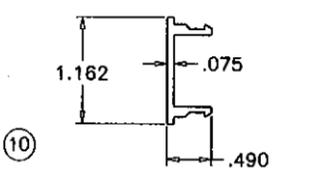


⑩ FRAME JAMB INSERT

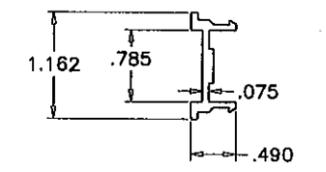


⑰ FRAME JAMB INSERTS

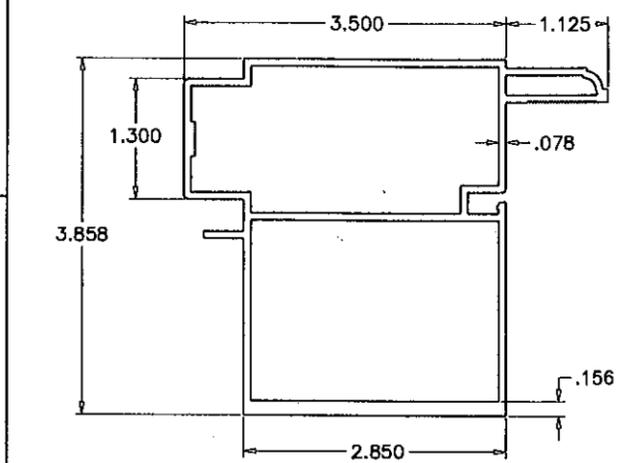


⑨ ASTRAGAL

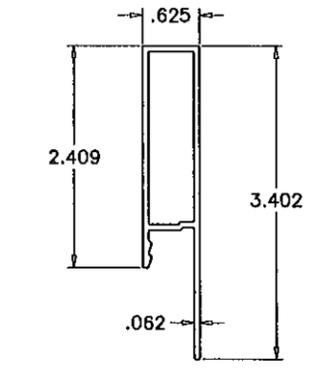


⑬ SILL RISER

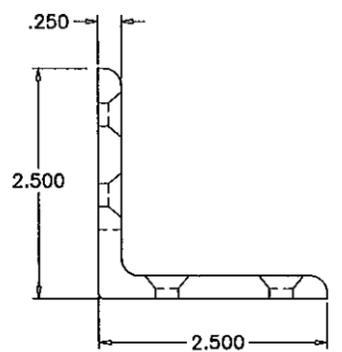


⑳ BOTTOM CLIP ANGLE

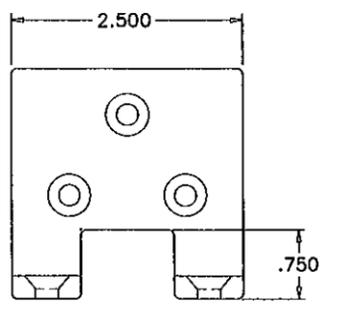


㉓ TOP CLIP ANGLE

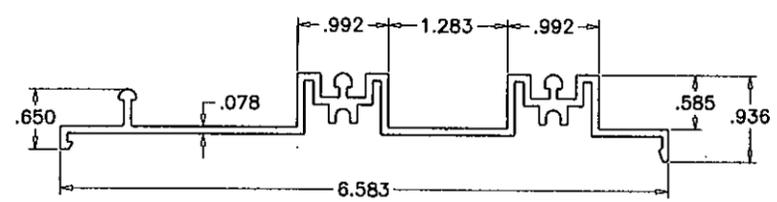


④ FRAME SUB-SILL

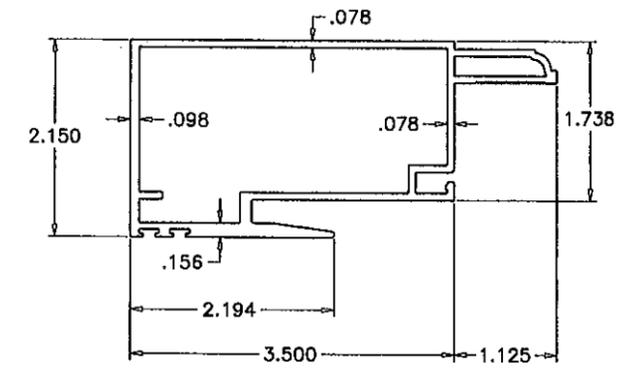


⑦ INNER INTERLOCK

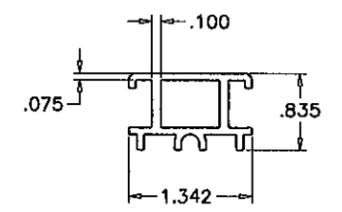


⑫ FIXED PANEL ADAPTER

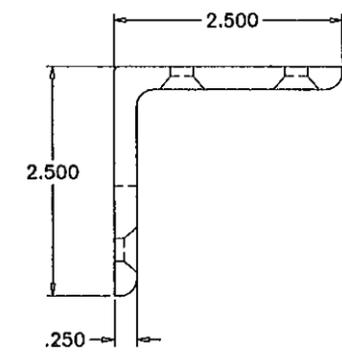


㉓ TOP CLIP ANGLE

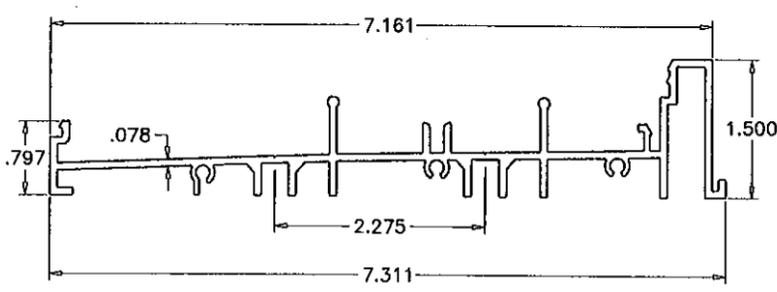

③ FRAME SILL

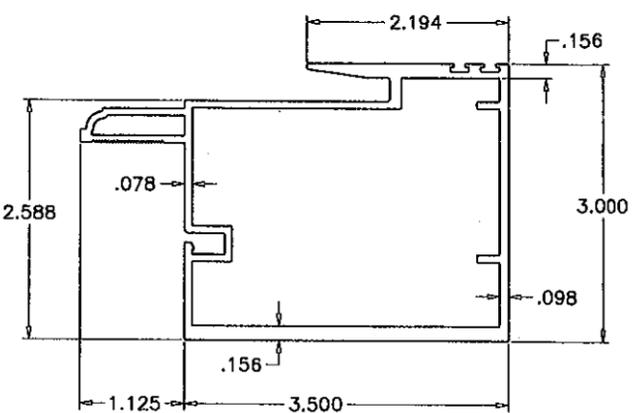

⑧ OUTER INTERLOCK

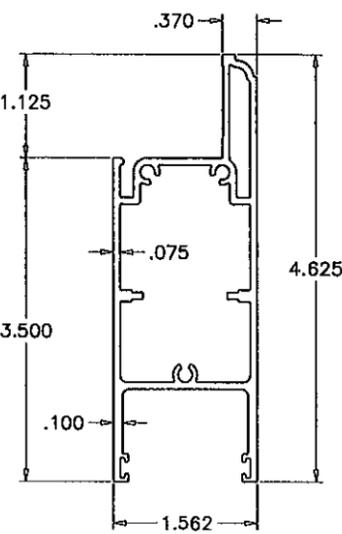

⑤ TOP/BOTTOM RAIL

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

[Signature]
MAY 12 2011


PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No. 11-032501
Expiration Date 3/21/13
[Signature]
Final Product Control

af
AL-FAROQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W11-04AWP

SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)
ARCH WINDOWS, LLC dba AWP
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no.	date	by	description
A	05.04.11		NO CHANGE THIS SHEET

date: 02-17-11
scale: 1/2" = 1"
dr. by: HAMID
chk. by:
drawing no.
W11-04
sheet 6 of 7

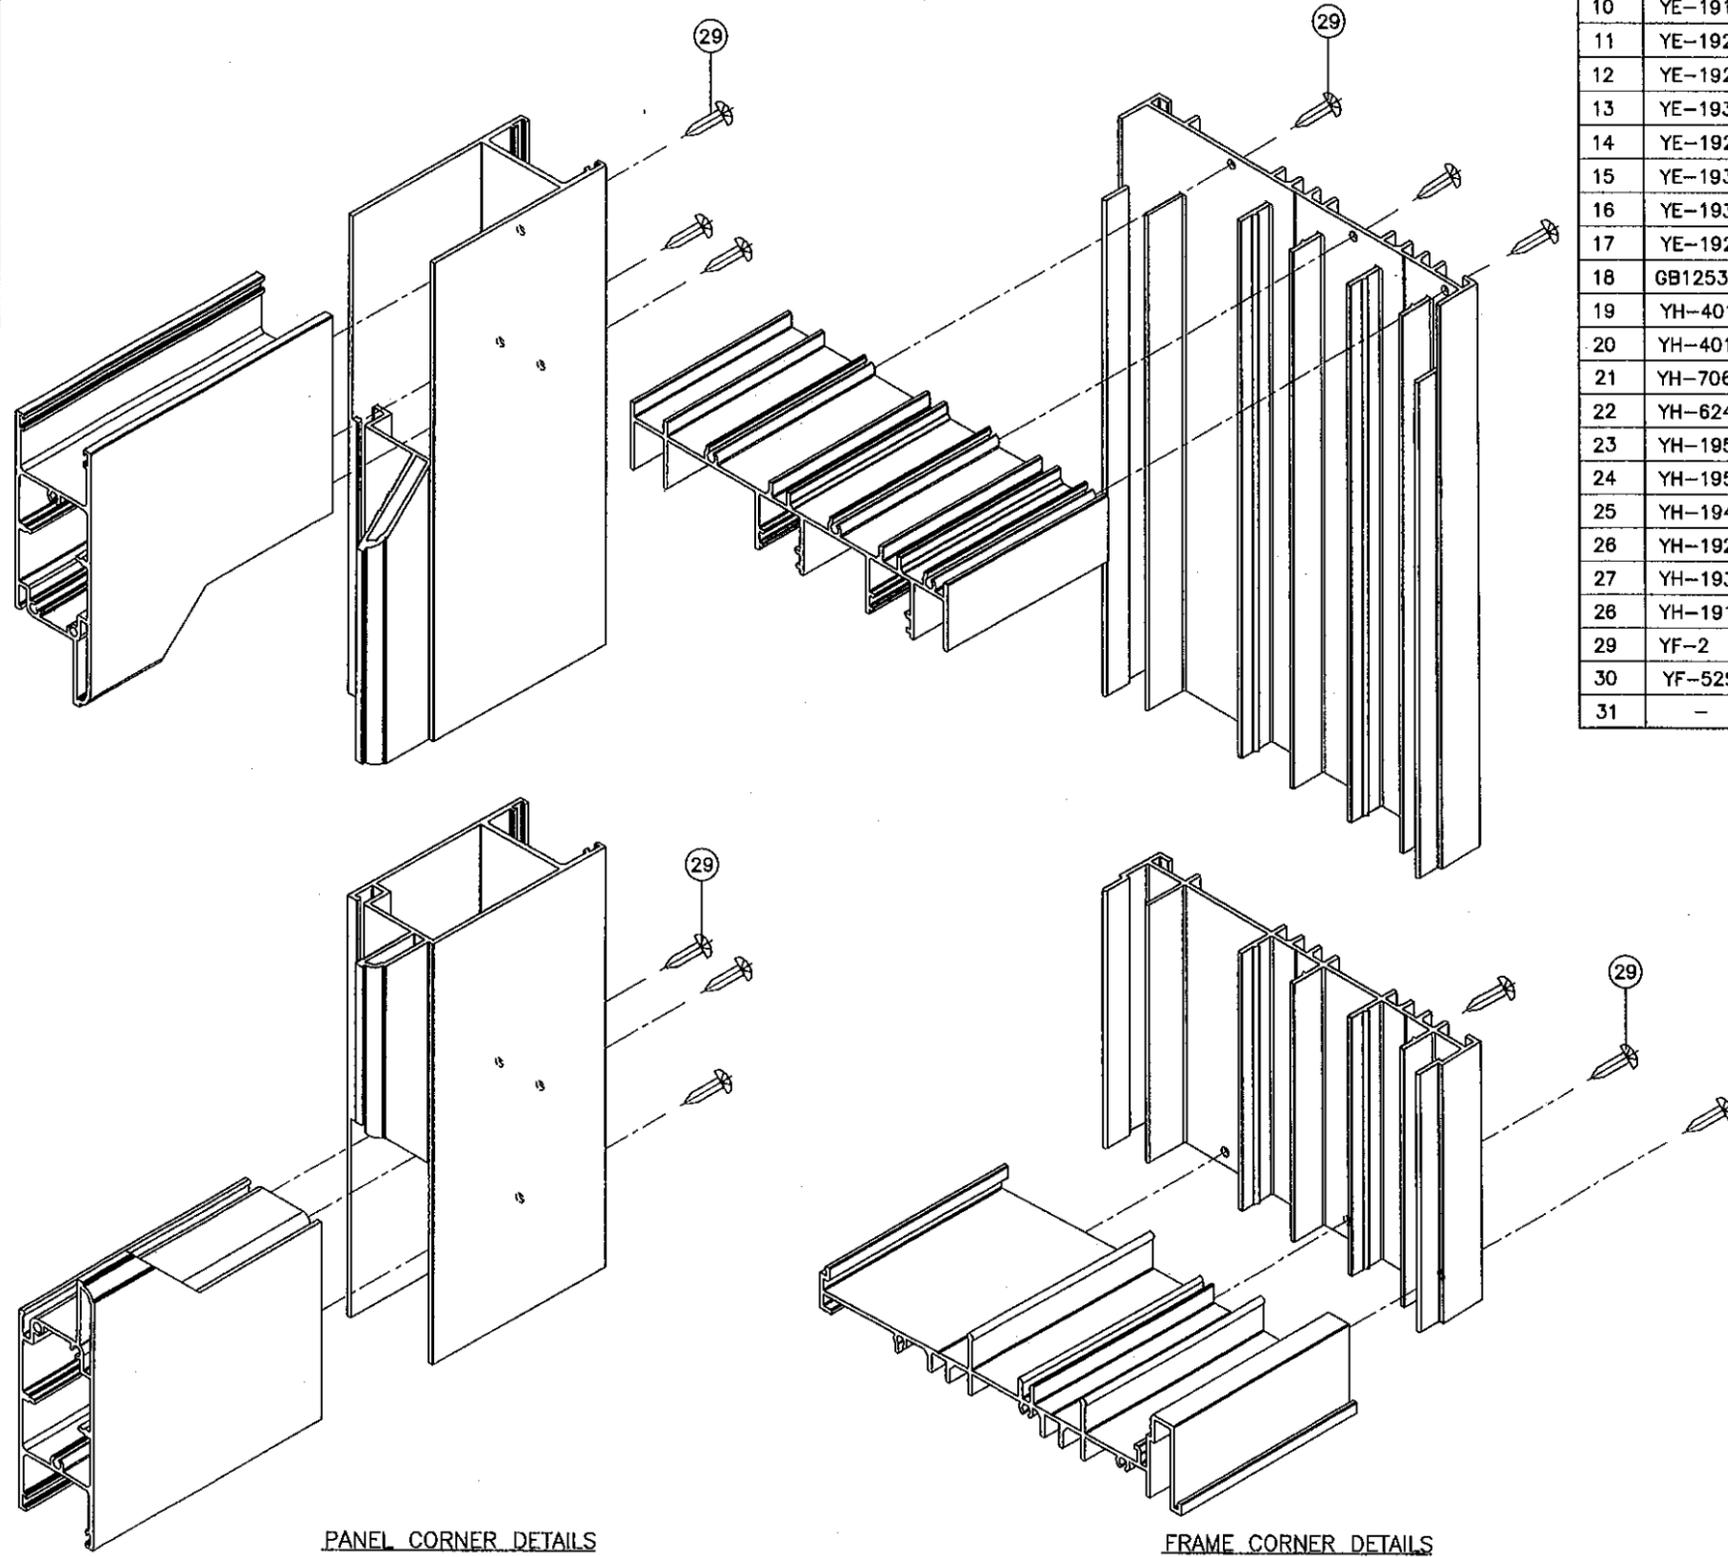

PANEL CORNER DETAILS

FRAME CORNER DETAILS

ITEM	PART No.	QUANTITY	DESCRIPTION	MATERIAL/REMARKS
1	YE-1901	1	FRAME HEAD	ALUM. (6063-T6)
2	YE-1902	2	FRAME JAMB	ALUM. (6063-T6)
3	YE-1903	1	FRAME SILL	ALUM. (6063-T6)
4	YE-1906	1	FRAME SUB SILL	ALUM. (6063-T6)
5	YE-1908	2/PANEL	PANEL TOP & BOTTOM RAIL	ALUM. (6063-T6)
6	YE-1910	AS REQ'D.	PANEL LOCK & END STILE	ALUM. (6063-T6)
7	YE-1912	AS REQ'D.	PANEL INNER (MOVING) INTERLOCK	ALUM. (6063-T6)
8	YE-1914	AS REQ'D.	PANEL OUTER (FIXED) INTERLOCK	ALUM. (6063-T6)
9	YE-1916	AS REQ'D.	PANEL ASTRAGAL	ALUM. (6063-T6)
10	YE-1918	AS REQ'D.	FRAME JAMB INSERT (FIXED SIDE)	ALUM. (6063-T6)
11	YE-1922	AS REQ'D.	FRAME HEAD INSERT	ALUM. (6063-T6)
12	YE-1924	2/PANEL	FIXED PANEL ADAPTER (2-1/2" LONG)	ALUM. (6063-T6)
13	YE-1930	1	SILL RAISER ADAPTER	ALUM. (6063-T6)
14	YE-1923	1	HEAD COVER	ALUM. (6063-T6)
15	YE-1935	1	SILL COVER	ALUM. (6063-T6)
16	YE-1936	AS REQ'D.	GLAZING STOP	ALUM. (6063-T6)
17	YE-1920	AS REQ'D.	FRAME JAMB INSERT (LOCK END)	ALUM. (6063-T6)
18	GB125375	AS REQ'D.	GLAZING SPACER AT 10" O.C.	-
19	YH-4013	AS REQ'D.	13/16 x 2-1/2" SELF ADHESIVE PAD	ULTRAFAB (P6803AFG)
20	YH-4013	AS REQ'D.	9/16 x 7/8" SELF ADHESIVE PAD	ULTRAFAB (P6803AFG)
21	YH-706	AS REQ'D.	.187" x .250" FIN SEAL WEATHERSTRIP	ULTRAFAB (W41255)
22	YH-624	AS REQ'D.	GLAZING GASKET	VINYL
23	YH-1950	1/F.PANEL	2 1/2 x 2 1/2 x 2 1/2 x 1/4" TOP ANGLE	ALUM. (6061-T6511)
24	YH-1955	1/F.PANEL	2 1/2 x 2 1/2 x 2 1/2 x 1/4" BOT. ANGLE	ALUM. (6061-T6511)
25	YH-1940	2/PANEL	WHEEL ADJUSTING SCREW HOLE PLUG	PVC
26	YH-1920	2/PANEL	1988-PRN-166-SS-125 WHEEL ASSY.	SS/DELRON
27	YH-1930	1/LOCK	"GEMINI" SERIES 2470 FLAT KEEPER	SS., BY AMESBURY
28	YH-1910	1	"GEMINI" 2468 DUAL POINT LOCK ASSY.	STEEL, BY AMESBURY
29	YF-2	AS REQ'D.	#10 x 1" PH. SMS.	CAD PLATED CRS.
30	YF-52SS	AS REQ'D.	#10-24 x 1/2" FH. UC. MS. POINT F	STAINLESS STEEL
31	-	AS REQ'D.	#14 x 1" SMS. (TYP. CLIP ANCHOR)	CAD PLATED CRS.

SEALANT:

ALL FRAME AND PANEL JOINTS AND HEADS OF ANCHOR SCREWS AT SILL TO BE SEALED WITH WHITE/ALUMINUM COLORED SILICONE.

PRODUCT REVISED
 to comply with the Florida
 Building Code
 Acceptance No. 11-0325-01
 Expiration Date SEP 19, 2013
 By: Ismail Dada
 Ismail Dada Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

 MAY 12 2011

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-AN\W11-04AWP

SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)
 ARCH WINDOWS, LLC dba AWP
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
A	05.04.11		NO CHANGE THIS SHEET

date: 02-17-11
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W11-04

sheet 7 of 7