



MIAMI-DADE COUNTY
BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
 11805 SW 26 Street, Room 208
 Miami, Florida 33175-2474
 T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/building

Kaycan
1 Memorial Drive.
Richford, VT 05476

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County BNC - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BNC reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: SP-600 Aluminum Soffit

APPROVAL DOCUMENT: Drawing No. **KBP-DC-102**, titled "Aluminum Soffit SP-600", sheet 1 of 1, dated 10/02/05, with no revisions, prepared by Kaycan Building Products, signed and sealed by Allen N. Reeves, P.E., bearing the Miami-Dade County Product Control renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, City, State, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **renews NOA # 05-0802.03** and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



Carlos M. Utrera
 05/19/11

NOA No. 11-0325.03
Expiration Date: June 01, 2016
Approval Date: May 26, 2011
 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **KBP-DC-102**, titled "Aluminum Soffit SP-600", sheet 1 of 1, dated 10/02/05, with no revisions, prepared by Kaycan Building Products, signed and sealed by Allen N. Reeves, P.E.

B. TESTS *"Submitted under NOA # 05-0802.03"*

1. Test report of Cyclic Load Pressure Test per TAS 203 and test report of Uniform Static Load Test per TAS 202 on Aluminum Soffit SP-600 prepared by Architectural Testing, Test Report No. **55982.02-122-18**, dated 07/18/05, signed and sealed by S. M. Urich, P.E.
2. Test report of Tensile Test per ASTM E8 on Aluminum Vented Soffit, prepared by Architectural Testing, Test Report No. **55982.03-122-18**, dated 04/26/05, signed and sealed by Joseph A. Reed, P.E.

C. CALCULATIONS *"Submitted under NOA # 05-0802.03"*

1. Anchor calculations prepared by H. R. Engineering, Inc., pages 1 through 3, dated 07/25/05, signed and sealed by Allen N. Reeves, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Building and Neighborhood Compliance Department (BNC)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance with FBC 2007 issued by HR Engineering, Inc., dated 05/09/11, signed and sealed by Allen N. Reeves, P.E.
2. Distributor agreement dated 04/25/11.


"Submitted under NOA # 05-0802.03"

3. Code Compliance letter prepared by H R Engineering, Inc., dated 07/29/05, signed by Allen N. Reeves, P.E.
4. No financial interest letter issued by H. R. Engineering, Inc., dated 07/21/05, signed by Allen N. Reeves, P.E. and notarized by C. R. King.




05/19/11


Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 11-0325.03
Expiration Date: June 01, 2016
Approval Date: May 26, 2011

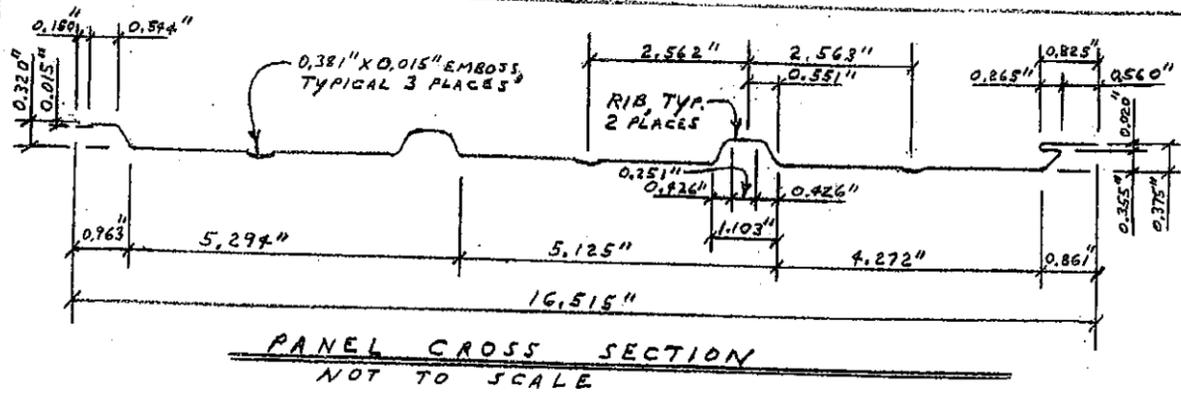


PANEL CROSS SECTION
NOT TO SCALE

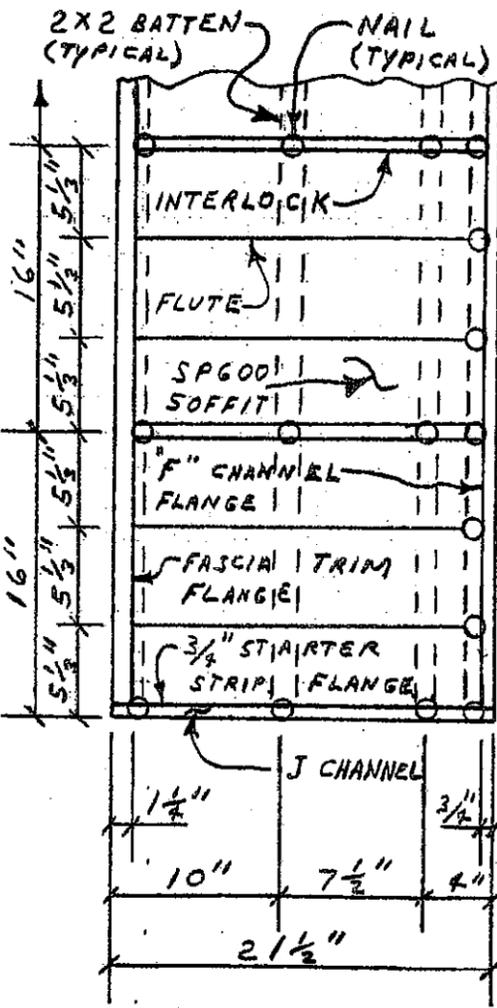


VIEW A-A
SCALE: 1" = 10"

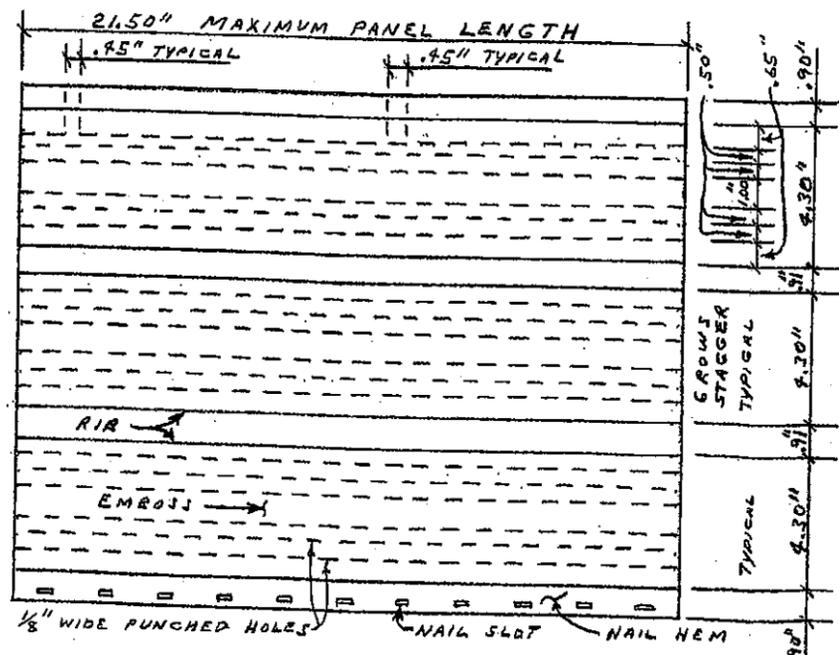

PANEL DETAILS
NOT TO SCALE

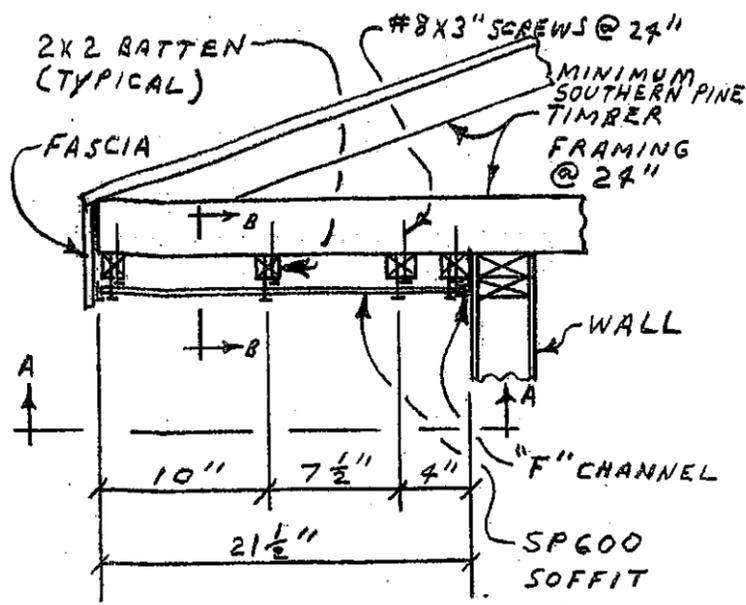

SOFFIT INSTALLATION - SP600
SCALE: 1" = 10"

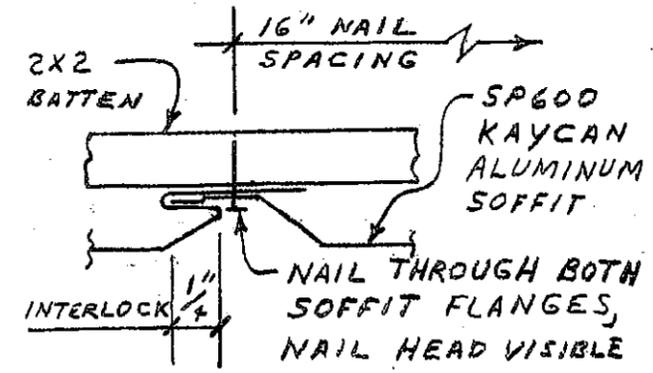

SECTION B-B
NOT TO SCALE

GENERAL NOTES

1. THE ABOVE INSTALLATION HAS ALLOWABLE DESIGN WIND PRESSURES OF +55.0 & -35.0 PSF.
2. ALUMINUM SOFFIT MINIMUM THICKNESS 0.015" AND 3004 H19 ALLOY & TEMPER.
3. INSTALLATION FASTENERS ARE GALVANIZED STEEL ROOFING NAILS 1 1/2" LONG WITH 1/8" DIAMETER SHANKS AND 3/8" DIAMETER HEADS.
4. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE. WOOD/CBS OVERHANG CONSTRUCTION BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
5. FASTENERS SHALL BE LISTED AND SPACED AS SHOWN ON DETAILS. FASTENERS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING.
6. OVERHANG RECEIVING ALUMINUM SOFFIT SHALL BE CHECKED FOR STRUCTURAL INADEQUACY, CRACKS OR DEFECTS THAT SHALL BE ELIMINATED.
7. OVERHANG WHERE ALUMINUM SOFFIT SHALL BE INSTALLED MUST BE DESIGNED BY A PROFESSIONAL PER THE FLORIDA BUILDING CODE.
8. INSTALLATION OF SOFFIT ACCESSORIES AND ACCESSORIES SUCH AS CORNER POSTS, STARTER STRIPS, AND TRIM AROUND OPENINGS SHALL BE DONE IN ACCORDANCE WITH THE FLORIDA BUILDING CODE AND THE MANUFACTURER'S INSTRUCTIONS.

Approved as complying with the Florida Building Code
Date: 06/01/06
WCA# 03-030203
Miami Dade Product Control
Division

PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No 11-0325.03
Expiration Date 06/01/2016
By: *[Signature]*
Miami Dade Product Control

ALUMINIUM SOFFIT 16"
SOLID AND VENTED
PRODUCT CALIPER - .015" ± .002
UNDEVELOPED LENGTH - 18.030"

Allen N. Rivera
5 MAY 2006

KAYCAN BUILDING PRODUCTS			
This Drawing and/or Design is the property of Kaycan Building Products and is not to be copied or used by others without the expressed written consent of Kaycan Building Products.			
Drawn By	Date	10/2/2005	
Checked By	Date		
Approved By	Date		
Scale	FULL	Reference	Sheet 1 of 1
Drawing Number			KBP-DC-102