



BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/building/

NOTICE OF ACCEPTANCE (NOA)

Southern Metal Products, LLC.
D/B/A Aeicor Metal Products
472 West McNab Road
Ft. Lauderdale, FL. 33309

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County BNC - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BNC reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Aeicor SS-4-16 System with 1" Snap Cap

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This renews NOA# 07-0723.01 and consists of pages 1 through 7.
The submitted documentation was reviewed by Alex Tigera.



NOA No.: 11-0420.04
Expiration Date: 06/07/16
Approval Date: 06/02/11
Page 1 of 7

ROOFING ASSEMBLY APPROVAL

Category: Roofing
Sub-Category: Non structural Metal-Roofing
Material: Steel
Maximum Design Pressure: -106.5 psf.

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
SS-4-16 Snap Cap	Length: various Height: $\frac{5}{8}$ " Width = 16 $\frac{1}{2}$ " Thickness: 0.0276		Corrosion resistant, galvalume, performed, standing seam, coated, pre-finished, metal panels.
Panel Clips	Length: 2" Width : 1" Height: $\frac{3}{4}$ " Thickness: 0.019"		Corrosion resistant, formed, plated steel clips for metal panel installation.
Trim Pieces	Length: varies Width: varies Thickness: 0.0276		Standard flashing and trim pieces, corrosion resistant galvalume.

MANUFACTURING LOCATION:

1. Ft. Lauderdale, FL..



NOA No.: 11-0420.04
Expiration Date: 06/07/16
Approval Date: 06/02/11
Page 2 of 7

EVIDENCE SUBMITTED

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
Construction Research Laboratory, Inc.	6176J	Uplift Pressure Testing ASTM E 330 (16 ½" Wide Panels Direct Deck with no Insulation)	May 1995
Lilly Industries, Inc.	Technical Literature	Salt Spray ASTM B 117	Sept. 1993
Lilly Industries, Inc. C.R.L.	Technical Literature Test # 5786	Accelerated Weathering ASTM G 23 TAS 100	Sept. 1993 May 1993
Hurricane Test Laboratory, Inc.	HETI 95-T81C	ASTM E 8	May 1995
Celotex Corp.	# 258340	TAS 100-95	December 1997
Hurricane Test Laboratory, Inc	#0154-0302-98	TAS 125	March 1998
Hurricane Test Laboratory, Inc	#0154-0612-01	TAS 125	07/12/01
Hurricane Test Laboratory, Inc	#0154-0707-06	TAS 125	01/11/07

SYSTEM APPROVAL:

System A-1: SS-4-16 panel with 1" Snap Cap
Deck Type: Wood, Non-insulated
Deck Description: New Construction ¹⁹/₃₂" or greater plywood or wood plank.
Slope Range: 2": 12" or greater
Maximum Uplift Pressure: See Table A below. (See General Limitation #2)

Deck Attachment: In accordance with applicable building code, but in no case shall it be less than # 8 x 2" long screws spaced 6" O.C. In reroofing, where the deck is less than ¹⁹/₃₂" thick (Minimum ¹⁵/₃₂"") the above attachment method must be in addition to existing attachment.

Underlayment: Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant tin-caps and 1 1/4" annular ring-shank nails, spaced 6" o.c. at all laps and two staggered rows 12" o.c. in the field of the roll.

Fire Barrier Board: Any approved fire barrier having a current NOA. Refer to a current fire directory listing for fire ratings of this roofing system assembly as well as the location of the fire barrier within the assembly. See Limitation # 1.

Valleys: Valley construction shall be in compliance with RAS 133 and with the current published installation instructions and details in Aeicor Metal Roofing Installation Manual.

Metal Panels and Accessories Install the "SS-4-16 Snap Cap Panel" and accessories in compliance with the current published installation instructions and details in Aeicor Metal Roofing Installation Manual. Flashings, penetrations, valley construction and other details shall be constructed in compliance with RAS 133.

Panels shall be installed with approved clips, attached to substrate with one corrosion resistant #8-14 screws of sufficient length to penetrate through the sheathing ³/₁₆" at a maximum spacing listed in Table A below. Once the clips are secured in place, the clip tabs are folded over and the snap cap is applied along the full length of the seam.

TABLE A MAXIMUM DESIGN PRESSURES		
Roof Areas	Field	Perimeter and Corner ¹
Maximum Design Pressures	-92.5 psf	-106.5 psf
Maximum Clip Spacing	8" o.c.	4" o.c.
1. Extrapolation shall not be allowed		



System B-1: SS-4-16 panel with 1" Snap Cap
Deck Type: Steel, Non-insulated
Deck Description: New Construction 22 gage type B steel deck.
Slope Range: 2": 12" or greater
Maximum Uplift Pressure: The maximum allowable uplift pressure for the 16 1/2" wide panels shall be -97.5 psf. (See System Limitation #2)

Deck Attachment: Minimum 22 gage Type B steel deck fastened to steel supports at a maximum span of 5 feet o.c. Steel deck shall be fastened with minimum 5/16" puddle welds with 1 x 7/8" weld washer at a maximum spacing of 6" o.c. Side laps shall be fastened with #10 x 3/4" HH TEK screws.

Fire Barrier Board: 1/4" Dens Deck fastened to steel deck with approved insulation fasteners & 3" steel plate at a density of 1:4ft in accordance with RAS 117.
or
Any approved fire barrier having a current NOA. Refer to a current fire directory listing for fire ratings of this roofing system assembly as well as the location of the fire barrier within the assembly. See Limitation # 1.

Underlayment: A single layer of any Miami-Dade County Product Control Approved self-adhered underlayment with a 4" overlap is fully adhered to Dens deck.
Or
An ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment fastened with approved insulation fasteners and plates. Spaced 12" o.c. on the laps and two rows spaced 24" o.c. in the field of roll.

Valleys: Valley construction shall be in compliance with RAS 133 and with the current published installation instructions and details in Aeicor Metal Roofing Installation Manual.

Metal Panels and Accessories Install the "SS-4-16 Snap Cap Panel" and accessories in compliance with the current published installation instructions and details in Aeicor Metal Roofing Installation Manual. Flashings, penetrations, valley construction and other details shall be constructed in compliance with RAS 133.

Panels shall be installed with approved clips, attached to substrate with one corrosion resistant #8 Wafer Head TEK screws of sufficient length to penetrate through the bottom flute a minimum of 3/4". The clips shall be located 3" away from each seam end and 6" on center thereafter. Once the clips are secured in place, the clip tabs are folded over and the snap cap is applied along the full length of the seam.



SYSTEM LIMITATIONS


1. Fire classification is not part of this acceptance; refer to a current Approved Roofing Materials Directory for fire ratings of this product.
2. The maximum designed pressure listed herein shall be applicable to all roof pressure zones (i.e. field, perimeters, and corners). Neither rational analysis, nor extrapolation shall be permitted for enhanced fastening at enhanced pressure zones (i.e. perimeters, extended corners and corners).
3. Panels may be rolls formed in continuous lengths from eave to ridge. Maximum lengths shall be as described in Roofing Application Standard RAS 133
4. All panels shall be permanently labeled with the manufacturer's name and/or logo, and the following statement: "Miami-Dade County Product Control Approved" or with the Miami-Dade County Product Control Seal as seen below. All clips shall be permanently labeled with the manufacturer's name and/or logo, and/or model.




5. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 9B-72 of the Florida Administrative Code.





PROFILE DRAWINGS

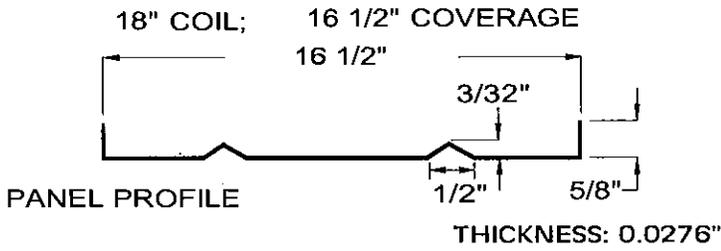

THICKNESS: 0.0276"

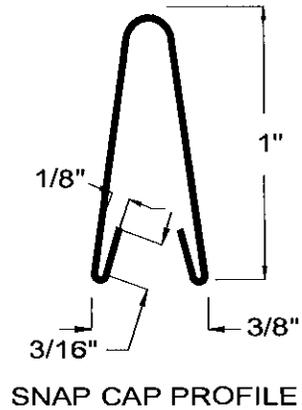

ONE NO. 8-14 x 1" min
WAFFER HEAD SCREW
AT EA. CLIP

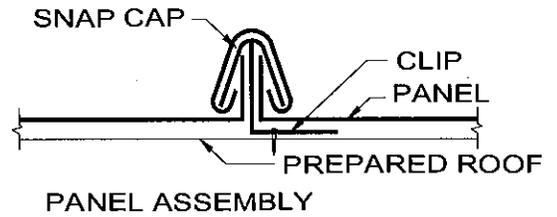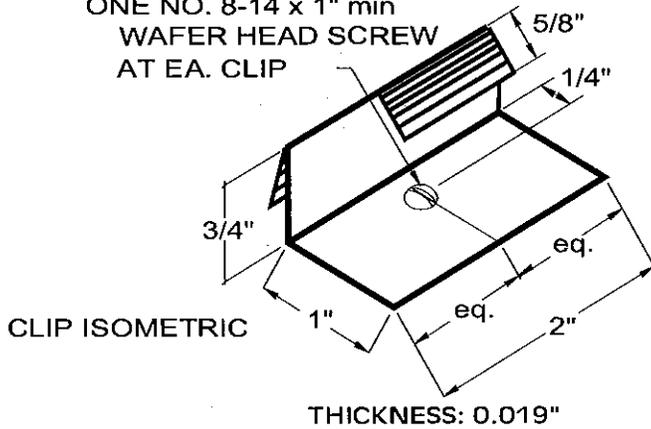

**AEICOR SS-4-16 PANEL AND ATTACHMENT CLIP
END OF THIS ACCEPTANCE**

