



MIAMI-DADE COUNTY
BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION
 11805 SW 26th Street, Room 208
 Miami, Florida 33175-2474
 T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/building

NOTICE OF ACCEPTANCE (NOA)

JELD-WEN, INC. (OR)
3737 Lakeport Boulevard
Klamath Falls, OR 97601

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County BNC-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BNC reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "6500 Premium Atlantic" Aluminum Horizontal Slider Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **JELD0092**, titled "Series 6500 Premium Atlantic Horizontal Slider, LMP", sheets 1 through 10 of 10, prepared by PTC, LLC, dated 04/24/2006 with revision "3" on 07/05/2011, signed and sealed by Roberto J. Amoruso, P. E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series and following statement: "Miami-Dade County Product Control Approved" unless otherwise noted herein.

REVISION of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA No. 09-0916.03** and consists of this page 1, evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
 7/20/11

NOA No. 11-0426.04
Expiration Date: August 10, 2016
Approval Date: July 28, 2011
 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **JELD0092**, titled "Series 6500 Premium Atlantic Horizontal Slider, LMI", sheets 1 through 10 of 10, prepared by PTC, LLC, dated 04/24/2006 with revision "3" on 07/05/2011, signed and sealed by Roberto J. Amoruso, P. E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, Type "C", Grade 10, per ASTM F 842-04 and per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-3588-1**, dated 07/08/09, revised and dated 01/06/10, signed and sealed by Gerard J. Ferrara, P. E.

(Submitted under previous NOA No. 09-0916.03)

2. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, Type "C", Grade 10, per ASTM F 842-04 and per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-3208-1**, dated 10/31/05, signed and sealed by Gerard J. Ferrara, P. E.

(Submitted under previous NOA No. 06-0504.01)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by PTC, LLC, dated 04/20/2011, signed, sealed and dated 07/05/2011 by Roberto J. Amoruso, P. E.

Complies with ASTM E1300-04



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 11-0426.04
Expiration Date: August 10, 2016
Approval Date: July 28, 2011

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. Miami-Dade Building and Neighborhood Compliance Department (BNC).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **10-0413.04** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/26/2010, expiring on 01/14/12.
2. Notice of Acceptance No. **10-0922.09** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite® PVB, Interlayer**" dated 12/24/10, expiring on 12/11/11.

F. STATEMENTS

1. Statement letter of conformance, no financial interest and compliance with the FBC 2007, dated 04/20/2011, signed and sealed by Roberto J. Amoruso, P. E.
2. Laboratory compliance letter for Test Report no. **NCTL-210-3588-1**, issued by National Certified Testing Laboratories, dated July 08, 2009, signed and sealed by Gerard J. Ferrara, P. E.
(Submitted under previous NOA No.09-0916.03)
3. Proposal issued by BCCO, dated November 3, 2008, signed by Jaime D. Gascon, P. E.
(Submitted under previous NOA No.09-0916.03)
4. Laboratory compliance letter for Test Report no. **NCTL-210-3208-1**, issued by National Certified Testing Laboratories, dated October 31, 2005, signed and sealed by Gerard J. Ferrara, P. E.
(Submitted under previous NOA No. 06-0504.01)

G. OTHERS

1. Notice of Acceptance No. **09-0916.03**, issued to Jeld-Wen, Inc (OR) for their Series "**6500 Premium Atlantic**" **Aluminum Horizontal Slider Window - L.M.I.**", approved on 03/10/2010 and expiring on 08/10/2011.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 11-0426.04
Expiration Date: August 10, 2016
Approval Date: July 28, 2011

JELD-WEN

PREMIUM ATLANTIC ALUMINUM 6500 HORIZONTAL SLIDER WINDOW, LMI

INSTALLATION ANCHORAGE DETAILS

GENERAL NOTES:

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE HIGH VELOCITY HURRICANE ZONE (HVHZ) OF THE 2007 FLORIDA BUILDING CODE (FBC) AT THE DESIGN PRESSURE STATED HEREIN. THE PRODUCT DETAILS CONTAINED HEREIN ARE BASED UPON SIGNED AND SEALED TEST REPORT #NCTL-210-3588-1 DATED 06/22/09 AND ASSOCIATED LABORATORY STAMPED DRAWINGS AND WERE TESTED IN ACCORDANCE WITH CURRENT DADE COUNTY PROTOCOLS.
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE STRUCTURE IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
3. 1X BUCKS AND 2X WOOD FRAMING (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
4. IN AREAS WHERE WIND-BORNE DEBRIS PROTECTION REQUIREMENTS EXIST, USE OF AN APPROVED MIAMI DADE IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED.

DESIGN PRESSURE RATING (PSF)	IMPACT RATING
+60.0 / -60.0	LARGE MISSILE IMPACT

TABLE OF CONTENTS		
SHEET	REV.	SHEET DESCRIPTION
1	2	GENERAL NOTES, INSTALLATION NOTES & D.P. CHART
2	2	ELEVATIONS & ANCHOR LAYOUTS
3	2	VERTICAL SECTIONS - FLANGE/CONCRETE & FIN/WOOD
4	2	HORIZ. SECTIONS - FLANGE/CONCRETE & FIN/WOOD
5	2	VERTICAL & HORIZ. SECTIONS - FLANGE/WOOD
6	2	GLAZING DETAIL & BILL OF MATERIALS
7	2	COMPONENTS
8	2	CORNER CONSTRUCTION DETAILS - SASH
9	2	CORNER CONSTRUCTION DETAILS - FRAME
10	2	CORNER CONSTRUCTION DETAILS - FRAME (CONT.)

5. WINDOW FRAME MATERIAL: ALUMINUM ALLOY 6063-T6.
6. GLASS MEETS THE REQUIREMENTS OF ASTM E1300-04.
7. DESIGNATION "X" STANDS FOR THE FOLLOWING:
 - 7.1. X: OPERABLE PANEL
8. A 1/3 INCREASE IN ALLOWABLE STRESS FOR WIND LOADS WAS NOT USED IN THE DESIGN OF THE PRODUCT(S) SHOWN HEREIN. WIND LOAD DURATION FACTOR (Cd = 1.6) HAS BEEN USED FOR WOOD ANCHOR WITHDRAWAL DESIGN ONLY.
9. IN ACCORDANCE WITH THE 2007 FBC, SECTION 2411.3.3.3 WOOD SHALL HAVE BEEN PRESERVATIVE TREATED OR SHALL BE OF A DURABLE SPECIES AS DEFINED IN SECTION 2326.2.
10. IN ACCORDANCE WITH THE 2007 FBC, SECTION 2003.8.4 DISSIMILAR METALS INCLUDING FASTENERS THAT MAY COME INTO CONTACT WITH ALUMINUM WINDOW FRAMING WOOD SHALL HAVE BEEN PROTECTED AS DEFINED IN SECTION 2003.8.4.2.

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM SIZE IS 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
4. FASTENERS FOR INSTALLATION INTO WOOD FRAMING OR THROUGH 1X BUCK TO CONCRETE / MASONRY, OR DIRECTLY INTO CONCRETE / MASONRY SHALL BE AS SHOWN IN "ANCHOR SCHEDULE" THIS SHEET.
5. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER AND SIDING.
6. FOR CONCRETE BLOCK APPLICATIONS DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS.
7. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
8. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIAL PROPERTIES SHOWN IN "ANCHOR SCHEDULE" THIS SHEET.

ANCHOR SCHEDULE							
SUBSTRATE	WINDOW FRAME TYPE	TYPE	SIZE	MANUFACTURER AND/OR SPECIFICATION	EMBEDMENT (IN) (2) (3)	EDGE DISTANCE (IN) (2) (3)	ANCHOR CAPACITIES BASED ON
CONCRETE	THRU-FRAME (FLANGE)	FLAT HEAD	1/4"	ITW TAPCONS(1)	1-1/2"	1-1/2"	MIN. 2000 PSI CONCRETE AND COMPLIES WITH ACI 301, ACI 318 AND ACI 355
MASONRY (BLOCK/CMU)	THRU-FRAME (FLANGE)	FLAT HEAD	1/4"	ITW TAPCONS(1)	1"	2"	STRENGTH CONFORMANCE TO ASTM C-90, MEDIUM WEIGHT
WOOD	THRU-FRAME (FLANGE)	FLAT HEAD, CUT THREADED	NO. 14	ANSI B18.6.1 (WOOD SCREW)	1-1/2"	1"	WOOD WITH A MINIMUM SPECIFIC GRAVITY OF 0.55.
		FLAT HEAD	No. 14 or 1/4" Dia.	ASME B18.6.4 (TAPPING SCREW)			
WOOD	FIN FRAME	PAN HEAD	NO. 10	ANSI B18.6.1 (WOOD SCREW) ASME B18.6.4 (TAPPING SCREW)	1-1/2"	3/8"	WOOD WITH A MINIMUM SPECIFIC GRAVITY OF 0.55.

NOTES:
 1) ITW (ADVANCED THREADFORM TECHNOLOGY) TAPCONS WILL BE USED FOR CONCRETE/MASONRY INSTALLATION.
 2) FOR WOOD SCREWS IF SPLITTING IS A CONCERN, DRILL 5/32" PILOT HOLE FOR NO. 14 OR 3/32" PILOT HOLE FOR NO. 10.
 3) FOR TAPPING SCREWS IF SPLITTING IS A CONCERN, DRILL 11/64" PILOT HOLE FOR NO. 14 & 1/4" DIA. OR 3/32" PILOT HOLE FOR NO. 10.

PROJECT # 411-0111

3	PER DADE LETTER JUNE 29, 2011	07/05/11	TJH
2	NOA RENEWAL	02/15/11	IRJA
1	PER MIAMI DADE COMMENTS 11/23/09	02/10/10	SMC
REV	DESCRIPTION	DATE	BY


JELD-WEN
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR 97601


TITLE: Premium Atlantic Aluminum 6500 Horizontal Slider Window, LMI
GENERAL NOTES, INSTALLATION NOTES & D.P. CHART

DATE:	08/11/09
DRAWN BY:	SMC
SCALE:	N.T.S.
DRAWING NO.:	JELD0092
REV:	3
SHEET:	1 OF 10




PRODUCT RENEWED as complying with the Florida Building Code
 Acceptance No. 11-0426.04
 Expiration Date 08/10/2016
 By: [Signature]
 Miami Dade Product Control

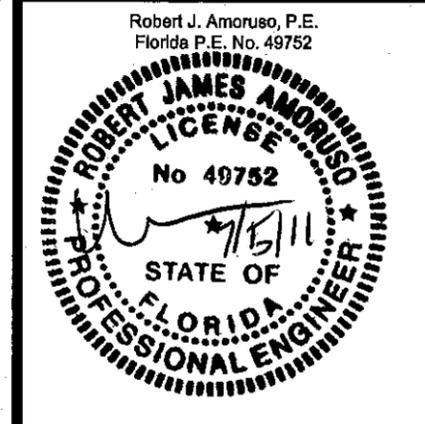

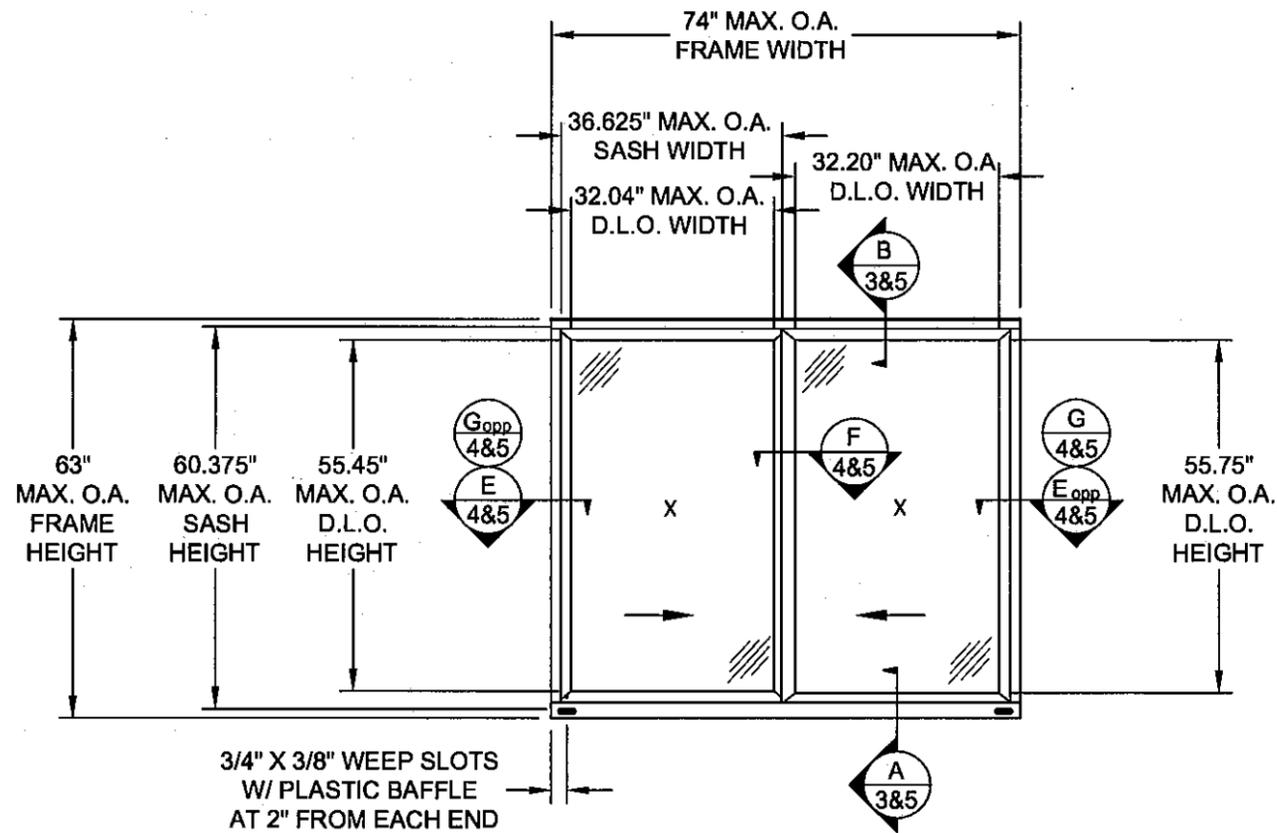


ELEVATION
EXTERIOR VIEW (FLANGE)

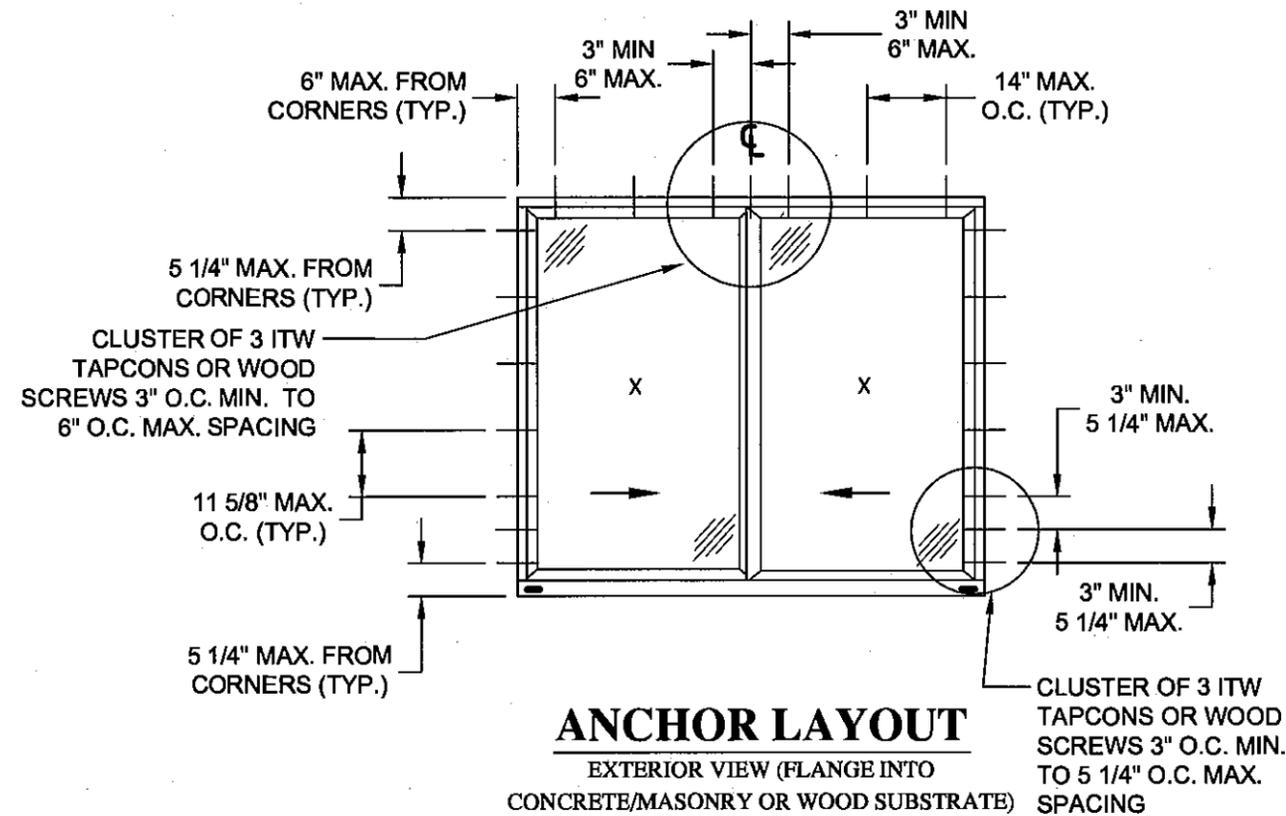


ANCHOR LAYOUT

EXTERIOR VIEW (FLANGE INTO
CONCRETE/MASONRY OR WOOD SUBSTRATE)

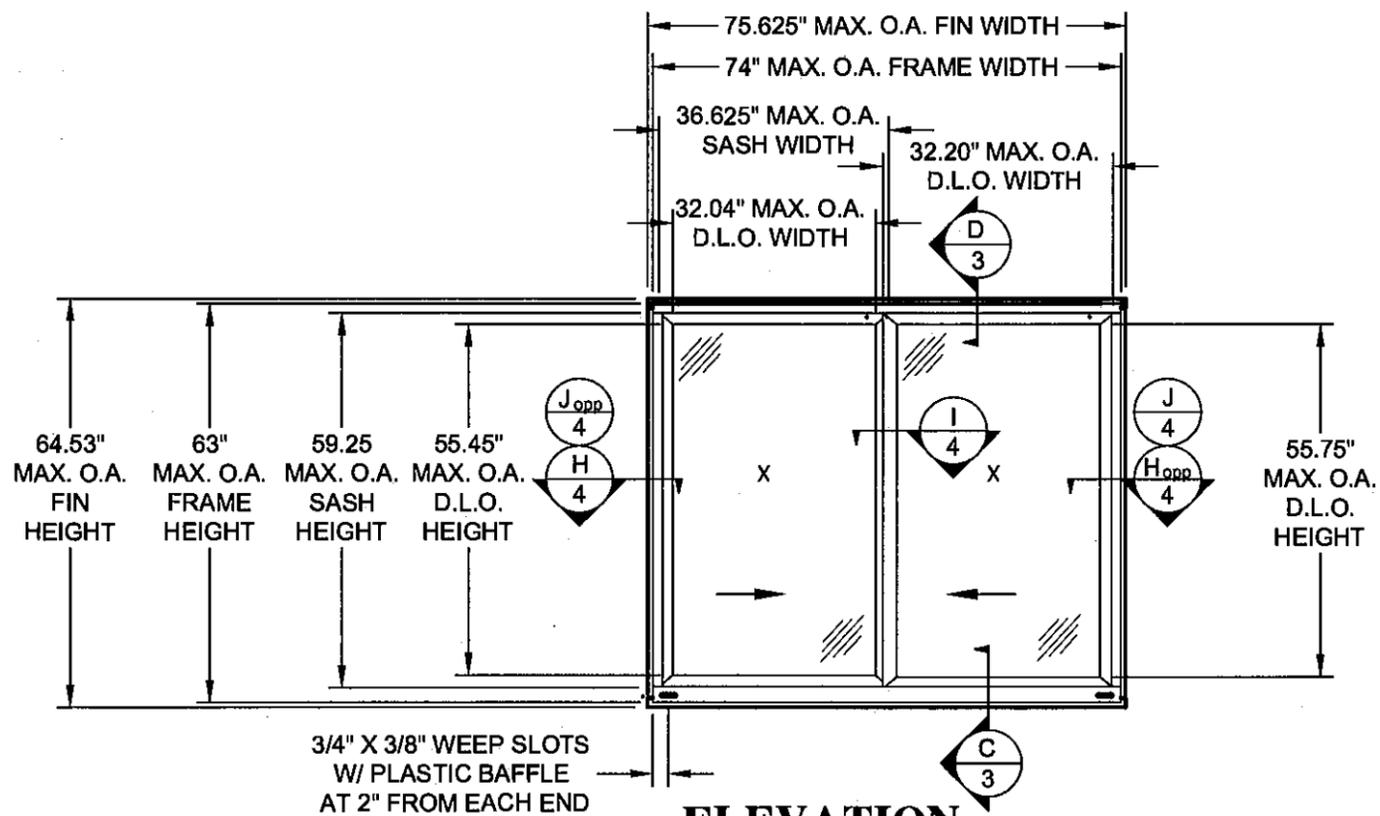

ELEVATION
EXTERIOR VIEW (WITH NAILING FIN)

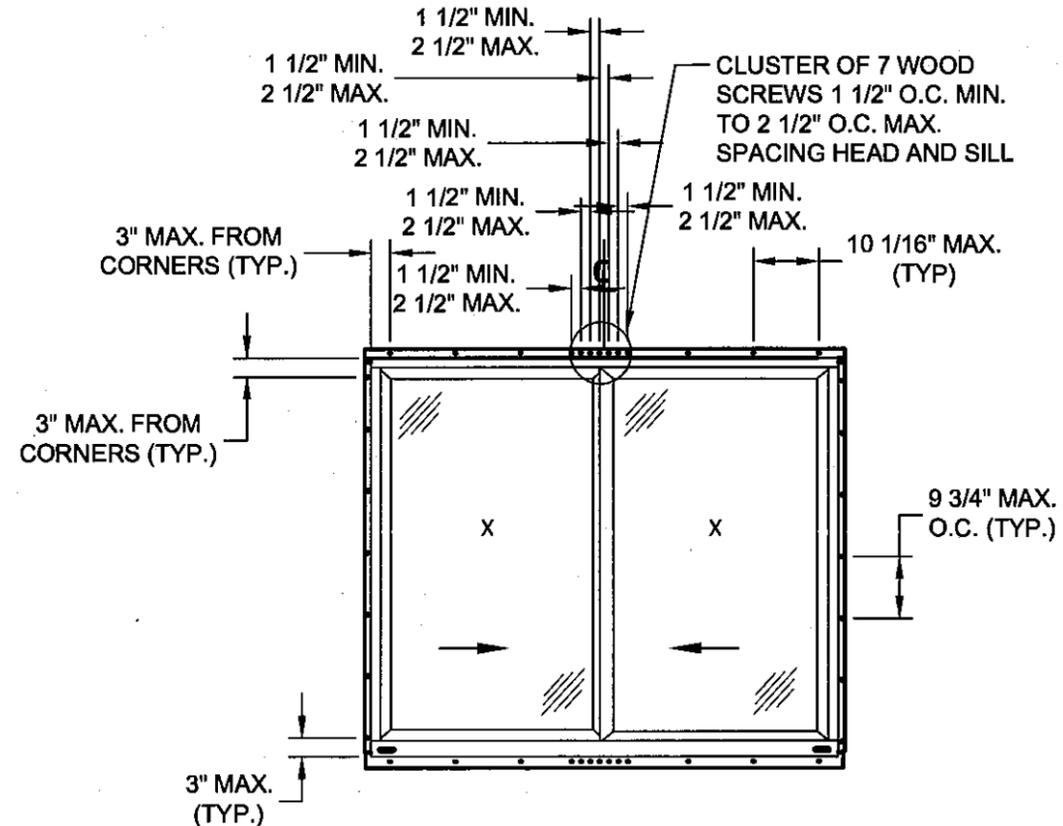

ANCHOR LAYOUT

EXTERIOR VIEW (WITH NAILING FIN)

PROJECT # 411-0111


REV	DATE	DESCRIPTION
3	07/05/11	TJH
2	02/15/11	NOA RENEWAL
1	02/10/10	PER MIAMI DADE COMMENTS 11/23/09


JELD-WEN
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR 97601

TITLE: Premium Atlantic Aluminum 6500 Horizontal Slider Window, LMI ELEVATIONS & ANCHOR LAYOUTS

DATE	DATE	DATE
08/11/09	08/11/09	08/11/09
SMC	SMC	SMC
N.T.S.	N.T.S.	N.T.S.
3	3	3
2 OF 10	2 OF 10	2 OF 10


PRODUCT RENEWED as complying with the Florida Building Code Acceptance No 11-0426-04 Expiration Date 08/19/2016
By Miami Dade Product Control

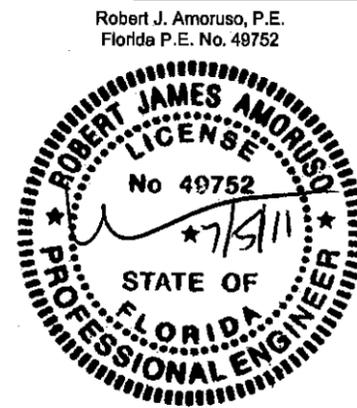

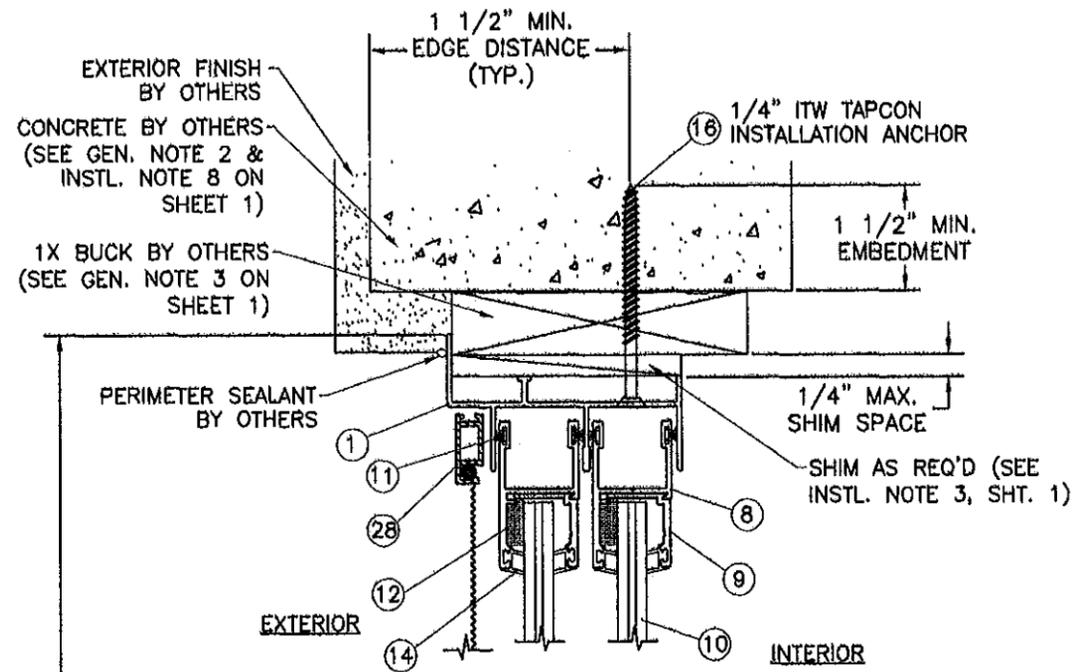


B VERTICAL SECTION
CONCRETE SUBSTRATE

MAX. O.A. WINDOW HEIGHT 63"

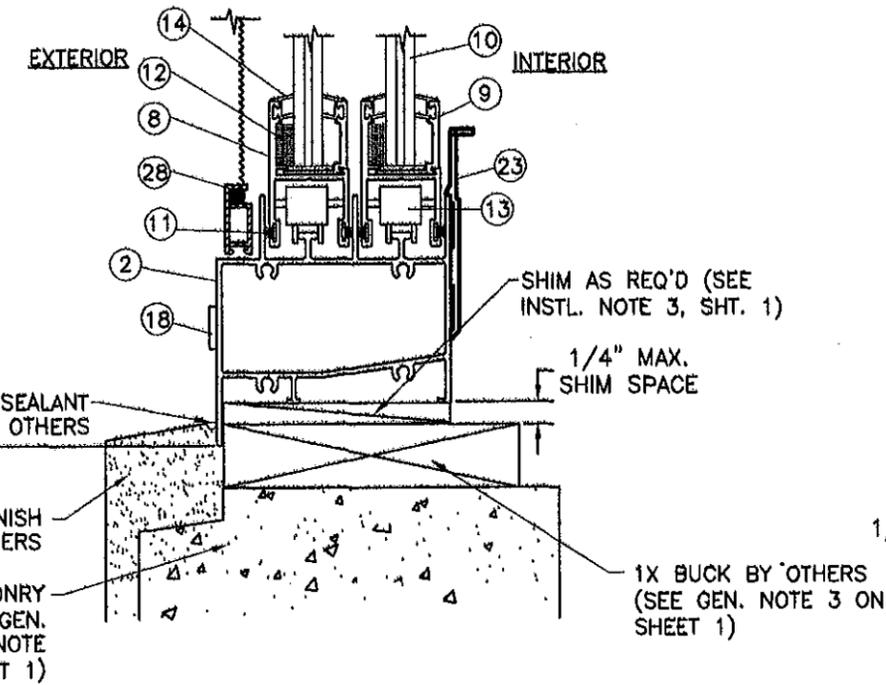


A VERTICAL SECTION
CONCRETE/MASONRY SUBSTRATE

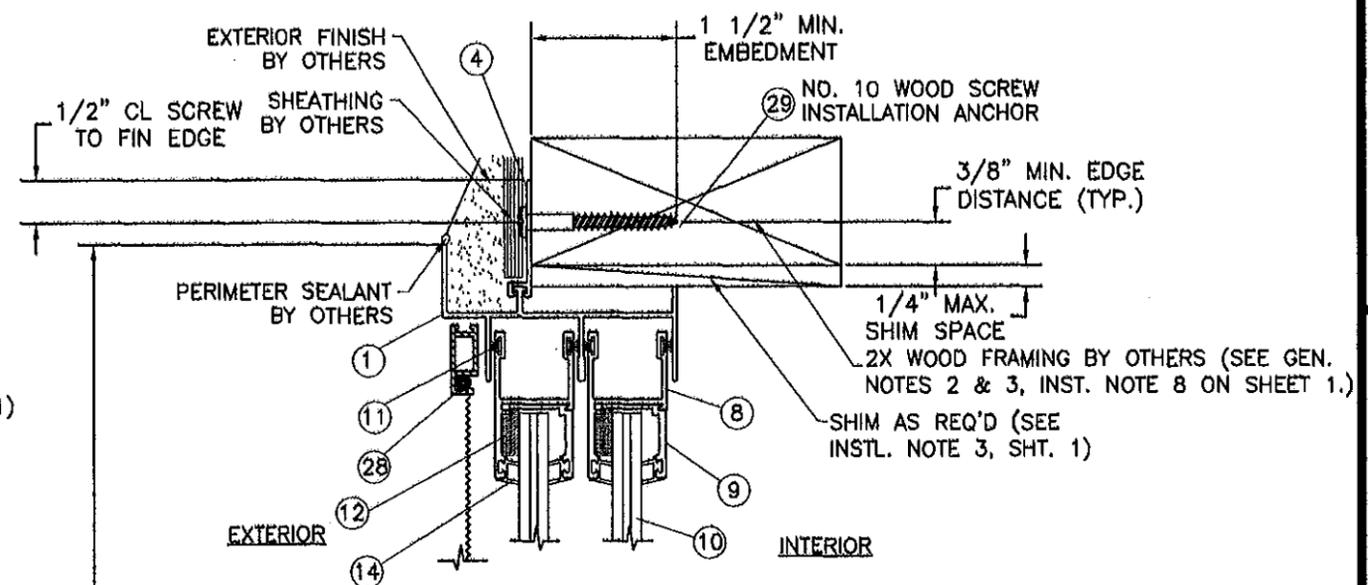

D VERTICAL SECTION
WOOD FRAME SUBSTRATE

O.A. WINDOW HEIGHT 63"

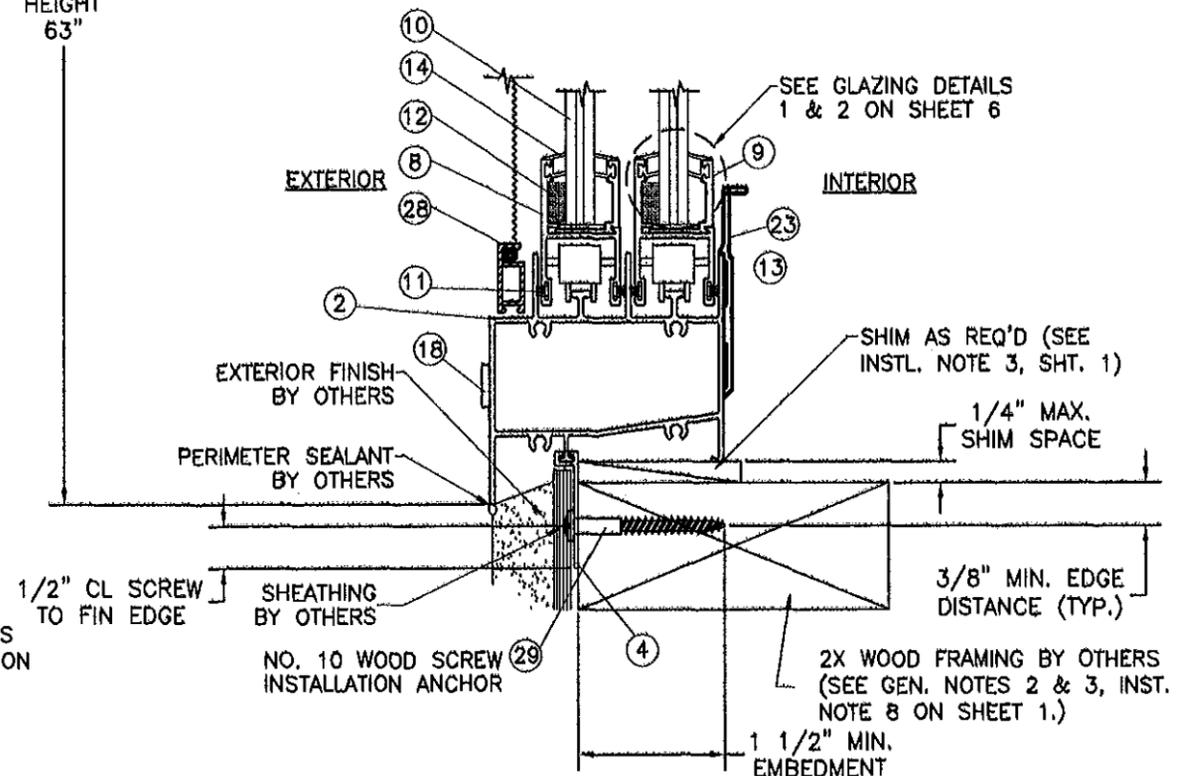

C VERTICAL SECTION
WOOD FRAME SUBSTRATE

PROJECT # 411-0111	
PER DATE LETTER	T.J.H
JUNE 29, 2011	07/05/11
NOA RENEWAL	02/15/11
PER MIAMI DADE COMMENTS 11/23/09	02/10/10
DESCRIPTION	SMC
DATE	BY
REV	REV
3	1
2	2
1	3


JELD-WEN
3737 LAKEPORT BLVD.
KIAMATH FALLS, OR 97601
Premium Atlantic Aluminum 6500 Horizontal Slider Window, LMI
VERTICAL SECTIONS


DATE	08/11/09
DRAWN BY	SMC
SCALE	N.T.S.
DRIVING NO.	JELD0092
REV	3 OF 10

PREPARED BY:

JELD-WEN
P.O. Box 500775
Logansport, IN 46750-0775
Phone: 317.351.7788
Fax: 317.351.7789
Email: info@jeld-wen.com

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. **11-0426.04**
Expiration Date **08/10/2016**
By
Miami Dade Product Control

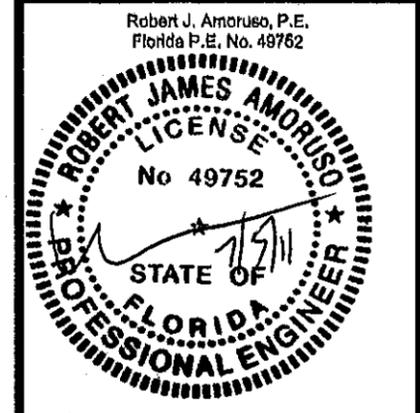


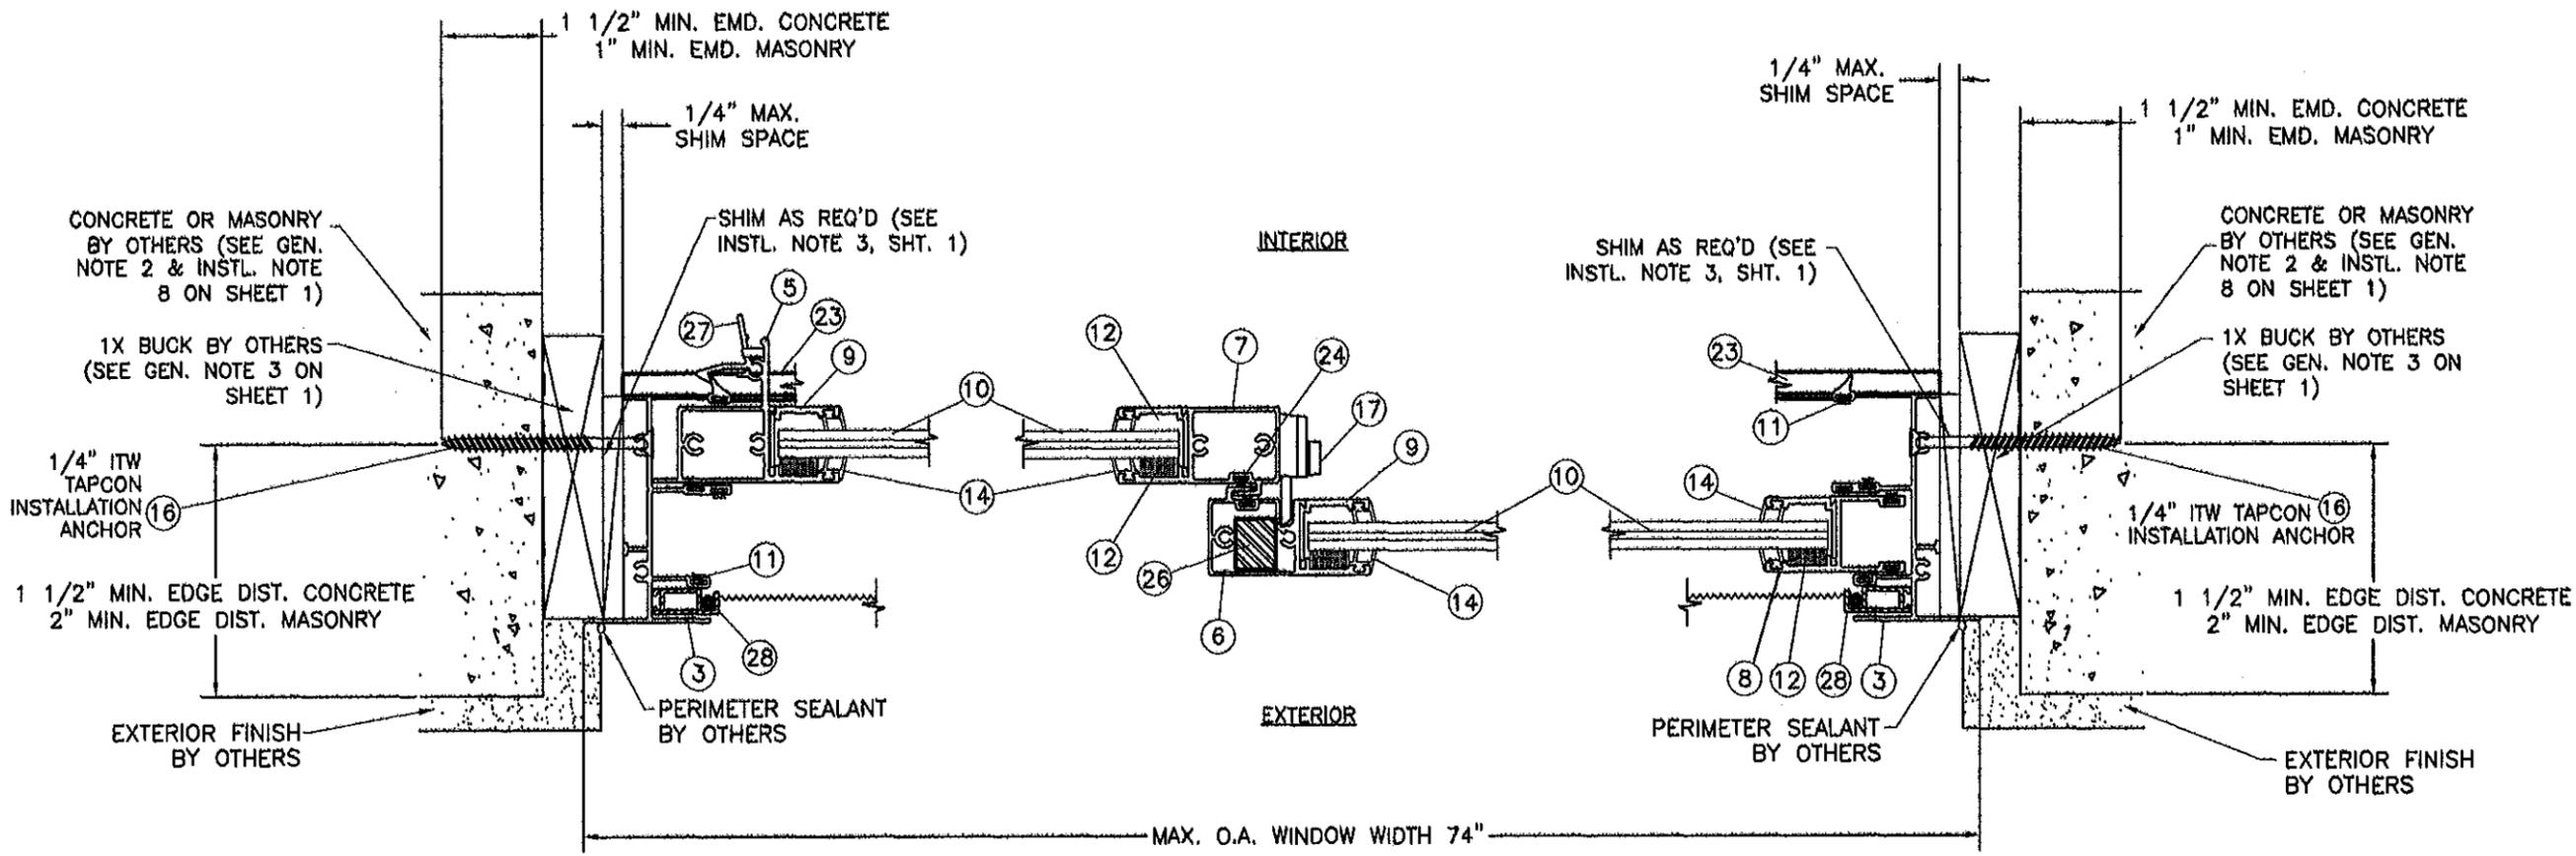

E HORIZONTAL SECTION
CONCRETE/MASONRY SUBSTRATE

F HORIZONTAL SECTION
CONCRETE/MASONRY SUBSTRATE

G HORIZONTAL SECTION
CONCRETE/MASONRY SUBSTRATE

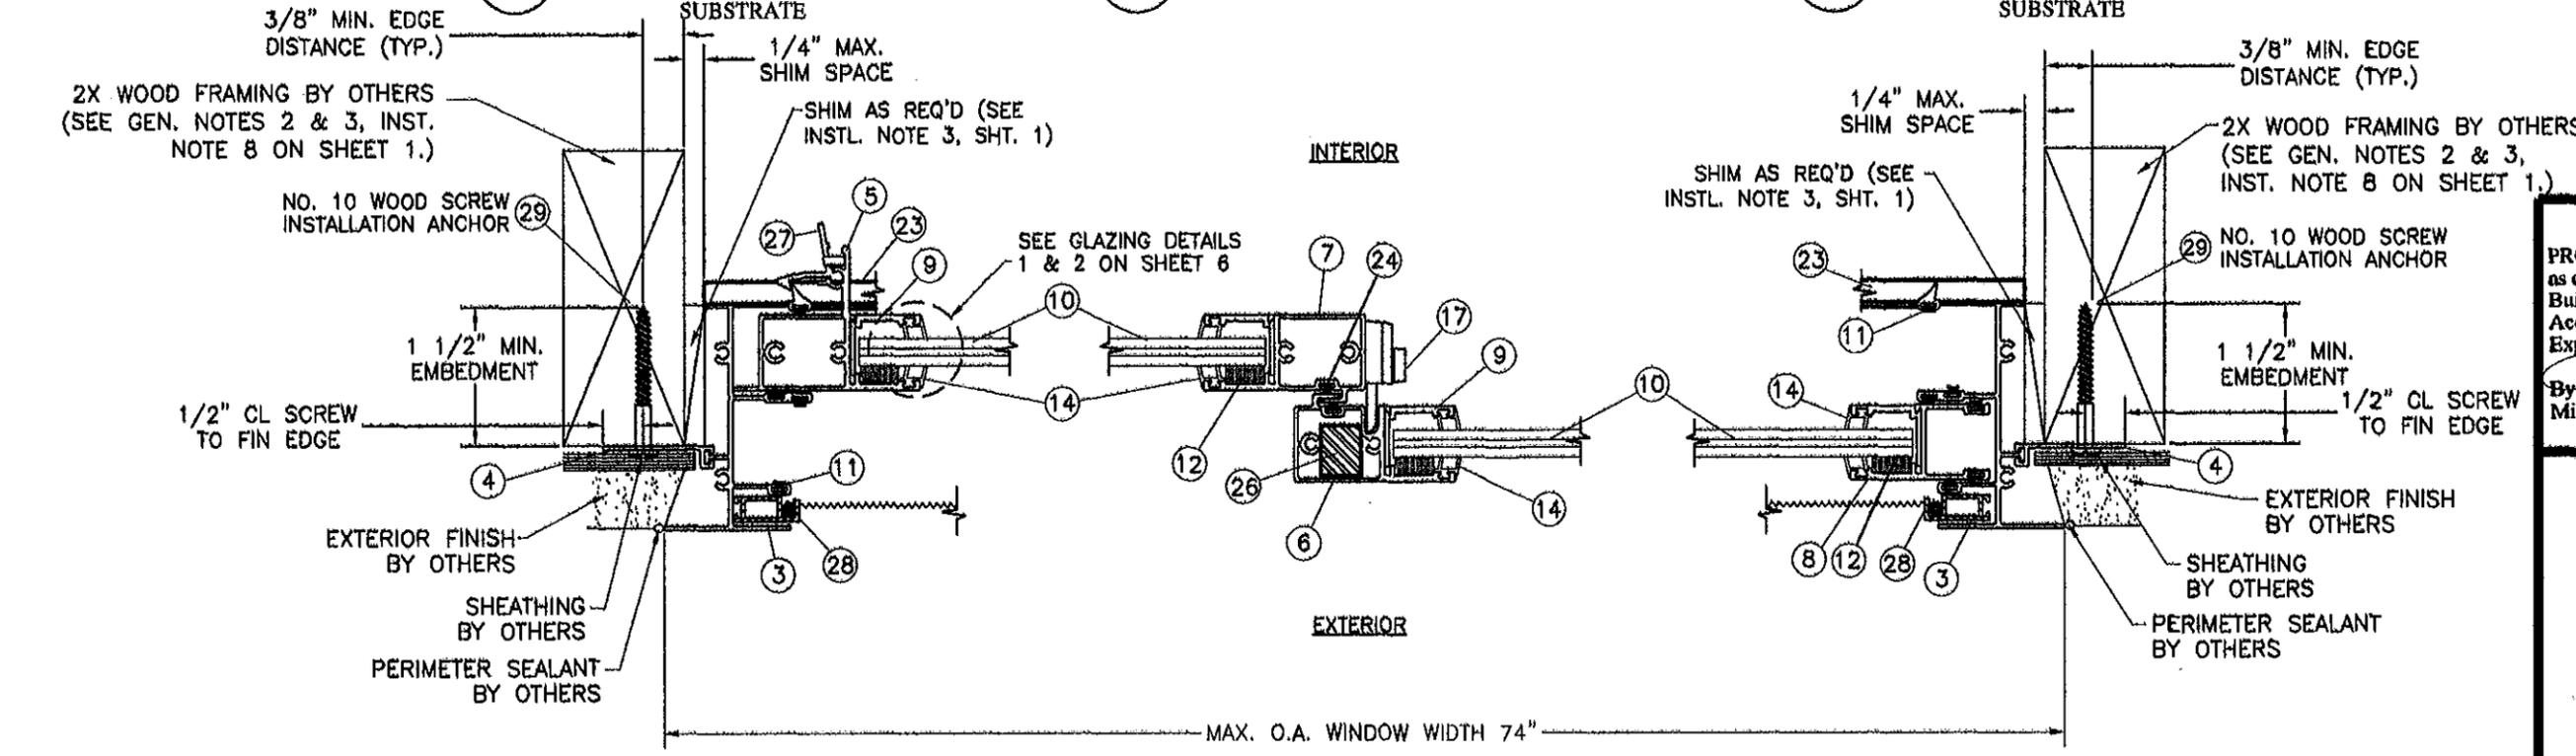

H HORIZONTAL SECTION
WOOD FRAME SUBSTRATE

I HORIZONTAL SECTION
WOOD FRAME SUBSTRATE


J HORIZONTAL SECTION
WOOD FRAME SUBSTRATE

PROJECT # 411-0111	TJH	RJA	SMC	BY
PER DATE LETTER	07/05/11	02/15/11	02/10/10	DATE
3	JUNE 29, 2011	NOA RENEWAL	PER MIAMI DADE COMMENTS 11/23/08	DESCRIPTION
REV				


JELD-WEN	DATE:	08/11/09	DRAWING NO.:	JELD0092	SHEET:	4 OF 10
3737 LAKEPORT BLVD.	DRAWN BY:	SMC	SCALE:	N.T.S.	REV:	3
KLAMATH FALLS, OR 97601	PREPARED BY:	JELD-WEN	PHONE:	503.895.1788	FAX:	503.895.1785
ALUMINUM						
Horizontal Slider Window, LMI						
HORIZONTAL SECTIONS						

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. **11-0426.04**
Expiration Date **08/10/2016**
By *[Signature]*
Miami Dade Product Control


Robert J. Amoroso, P.E.
Florida P.E. No. 49782

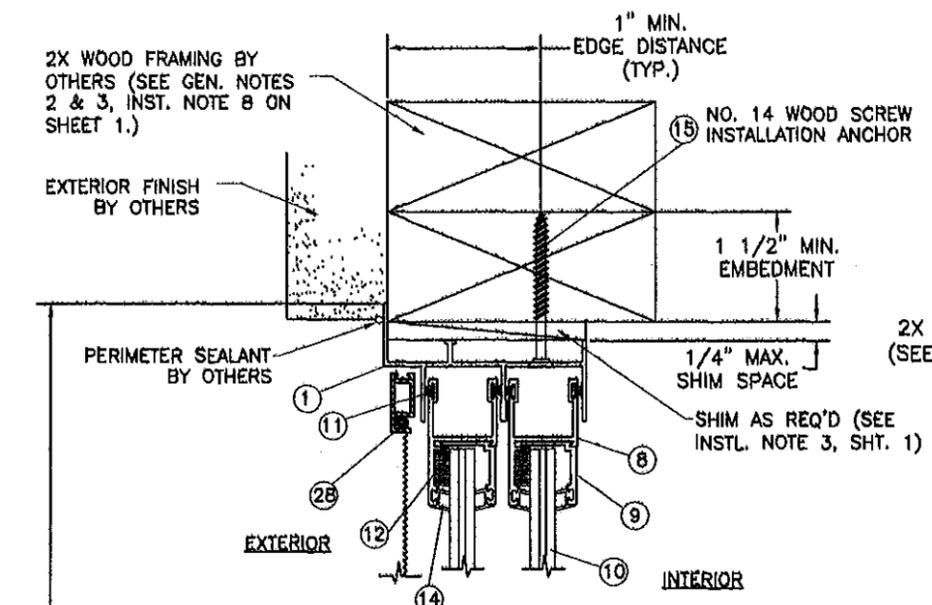

B VERTICAL SECTION
WOOD SUBSTRATE

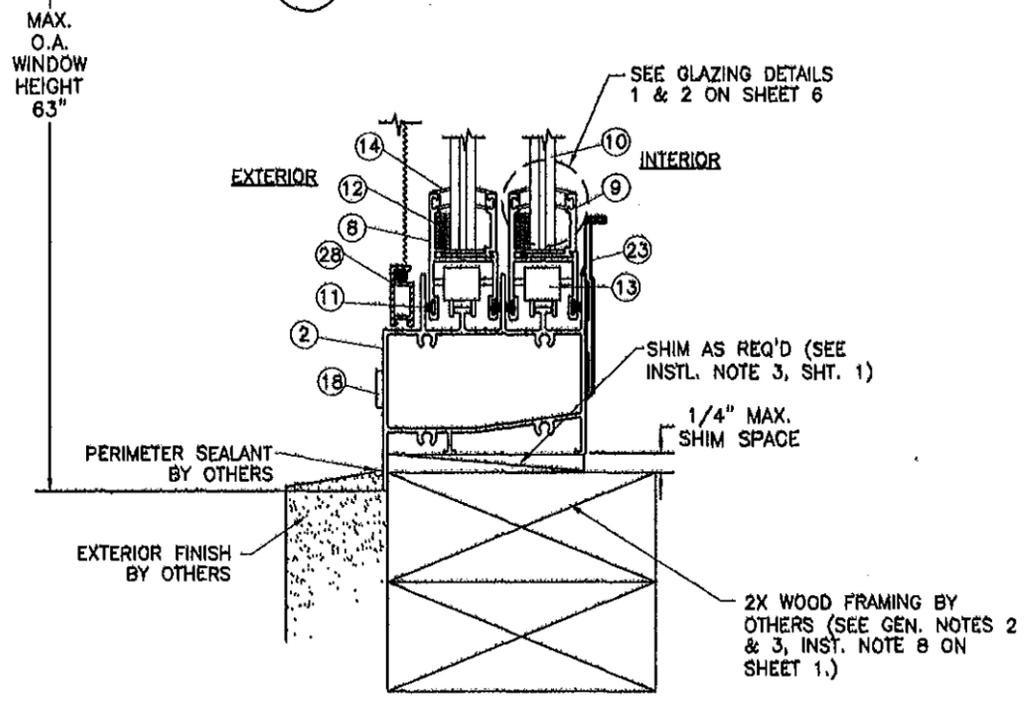


A VERTICAL SECTION
WOOD SUBSTRATE

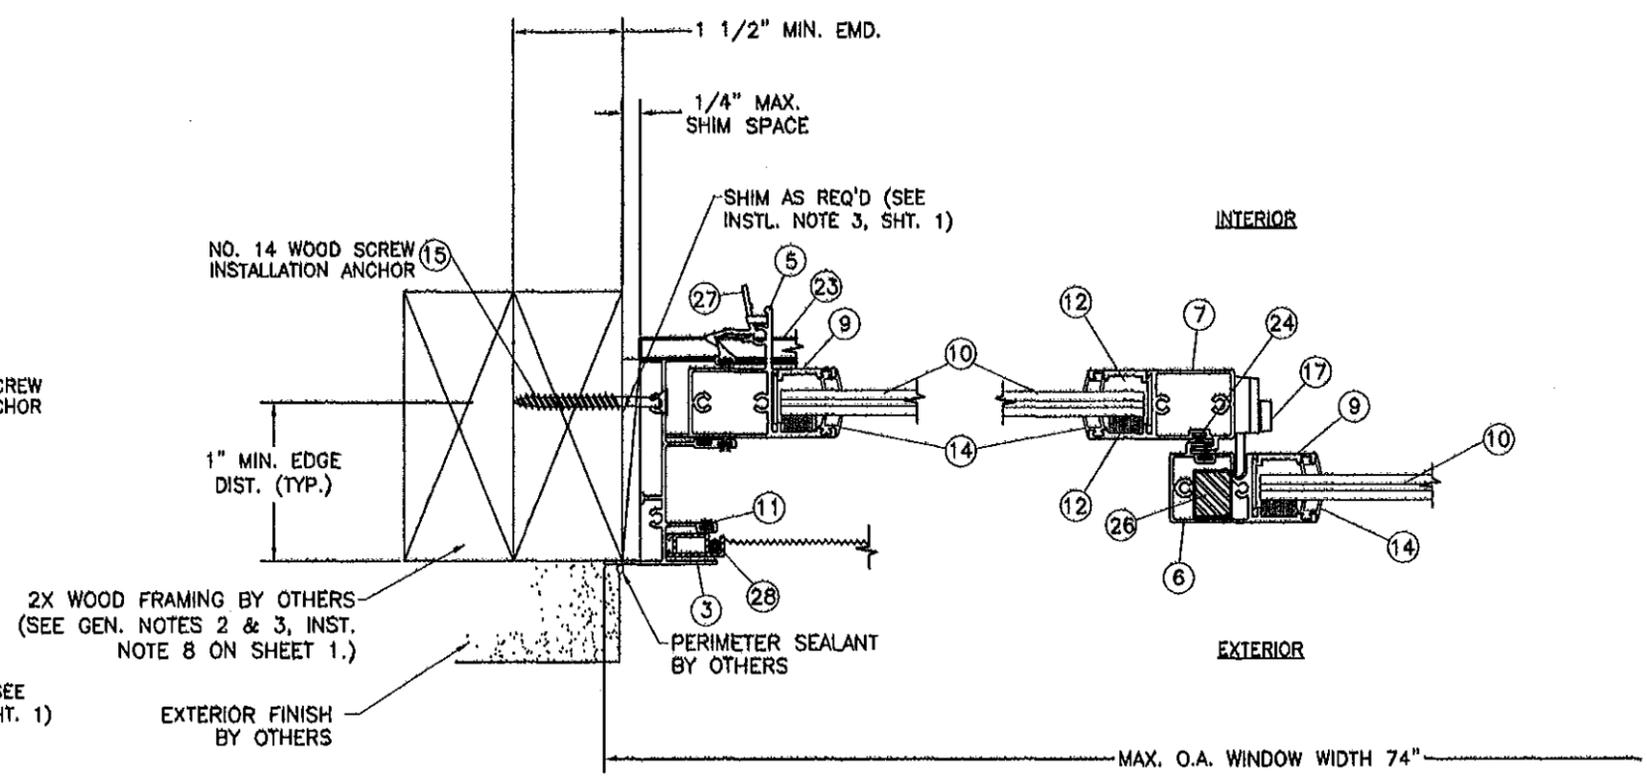

E HORIZONTAL SECTION
WOOD SUBSTRATE

F HORIZONTAL SECTION
WOOD SUBSTRATE

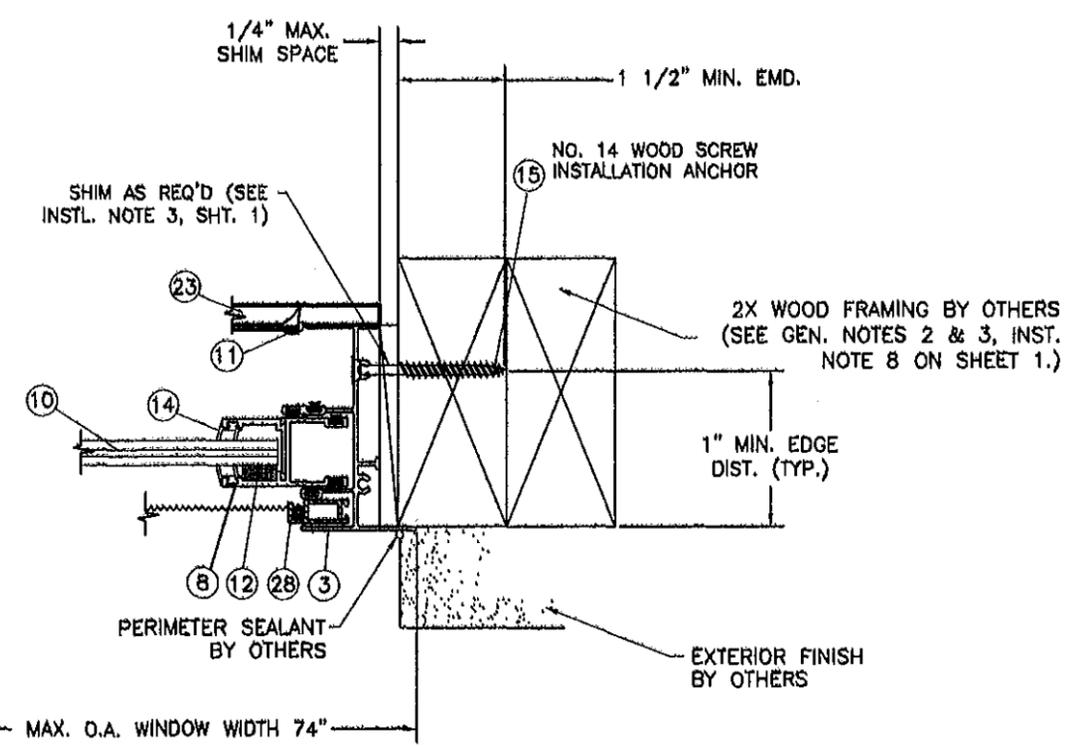

G HORIZONTAL SECTION
WOOD SUBSTRATE


CONTINUED BELOW

CONTINUED ABOVE


PROJECT # 411-0111		TJH	RJA	SMC	BY
PER DATE LETTER	JUNE 29, 2011	07/05/11	02/15/11	02/10/10	DATE
3	2	1	1	1	REV
NOA RENEWAL		PER MIAMI DADE COMMENTS 11/23/09		DESCRIPTION	

JELD-WEN 3737 LAKEPORT BLVD. KLAMATH FALLS, OR 97601		DATE	08/11/09	DRAWING NO.	JELD0092	SHEET	5 OF 10
TITLE: Premium Aluminum 6500 Horizontal Slider Window, LMI VERTICAL AND HORIZONTAL SECTIONS		SCALE	N.T.S.	REV:	3		
PREPARED BY:	SMC	DRAWN BY:	SMC	DATE:	08/11/09		
JTC, LLC P.O. Box 200775 Longwood, FL 32752-0775 Phone: 321.354.1788 Fax: 321.354.1785 Email: info@jtc.com							


PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. **11-0426.0A**
Expiration Date **05/10/2016**
By *[Signature]*
Miami Dade Product Control

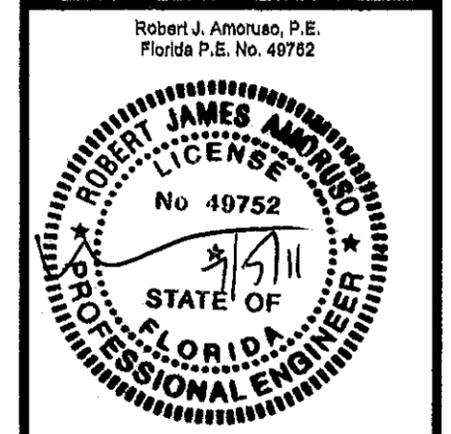

BILL OF MATERIAL				
NO.	PART NO.	DESCRIPTION	MATERIAL	SUPPLIER
1	11343	FRAME HEAD	6063-T6	SAPA
2	11396	FRAME SILL	6063-T6	SAPA
3	11395	FRAME JAMB	6063-T6	SAPA
4	45222	SLIP-ON NAIL FIN	6063-T5	SAPA
5	60IVSL	INTERIOR VENT JAMB STILE	6063-T6	SAPA
6	60ITVI	EXTERIOR VENT INTERLOCK STILE	6063-T6	SAPA
7	60IBVI	INTERIOR VENT INTERLOCK STILE	6063-T6	SAPA
8	60IVJS	TOP & BOTTOM VENT RAIL & EXTERIOR VENT JAMB STILE	6063-T6	SAPA
9	60IGLB	GLAZING BEAD	6063-T6	SAPA
10A/B	----	0.340" OVERALL LAMINATED GLASS (SEE GLAZING DETAILS 1 AND 2 ON THIS SHEET)	GLASS	----
11	----	0.170" HIGH WOOL PILE WITH INTEGRAL PLASTIC FIN	WOOL PILE	----
12	----	DOW CORNING 995 SILICONE BACK BEDDING	SILICONE	----
13	HRWHEL	WHEEL HOUSING ASSEMBLY (NO. 14 DUROMETER = 75)	VINYL/STL	----
14	----	VINYL WEDGE - DUROMETER 75-80 SHORE D	VINYL	----
15	----	#14 WOOD SCREW - INSTALLATION ANCHOR	STEEL	----
16	----	1/4" DIA. ITW ADVANCED THREADFORM TECH. TAPCON	STEEL	ITW
17	3588-1	LOCK ASSEMBLY	DIE CAST ALUM.	----
24	----	0.130" HIGH WOOL PILE W/ INTEGRAL PLASTIC FIN	WOOL PILE	----
25	----	NOT USED	----	----
26	CRS	1/2" X 5/8" STEEL BAR REIN. (70 KSI ULTIMATE STRENGTH)	C1018	----
27	----	INTERIOR VENT SASH LATCH	6063-T6	SAPA
28	10-065	INSECT SCREEN	ALUMINUM	JELD-WEN
29	----	#10 WOOD SCREW - INSTALLATION ANCHOR	STEEL	----

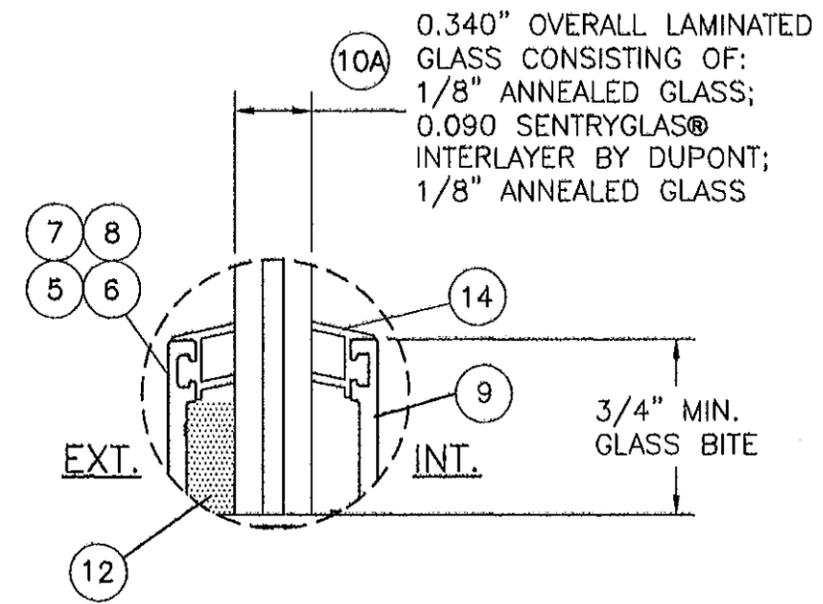

GLAZING DETAIL 1

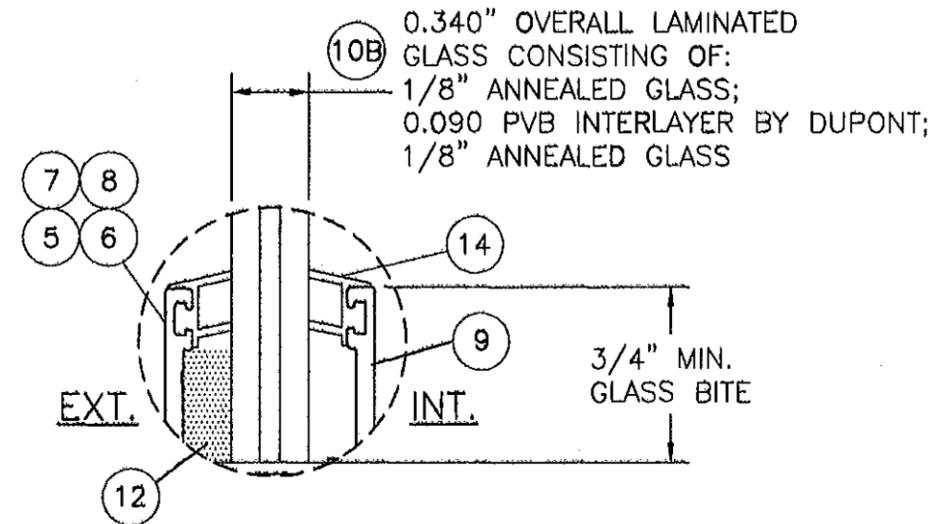

GLAZING DETAIL 2

PROJECT # 411-0111				
PER DATE LETTER	TJH	RJA	SMC	BY
JUNE 29, 2011	07/05/11	02/15/11	02/10/10	DATE
NOA RENEWAL	NOA RENEWAL	PER MIAMI DADE COMMENTS 112309	DESCRIPTION	REV
3	2	1		

JELD-WEN
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR 97601

Atlantic Aluminum 6500 Horizontal Slider Window, LMI
GLAZING DETAIL & BILL OF MATERIALS

DATE: 08/11/09
DRAWING NO: JELD0092
SHEET: 6 OF 10

DATE: 08/11/09
DRAWING NO: JELD0092
SHEET: 6 OF 10

SCALE: N.T.S.
REV: 3

PREPARED BY: SMC
DATE: 08/11/09

JELD-WEN
JELD-WEN, LLC
P.O. Box 384775
Longwood, FL 32752-0775
Phone: 321.860.1788
Fax: 321.860.1789
Email: info@jeld-wen.com


PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 11-0426.04
Expiration Date 08/10/2016

By: *[Signature]*
Miami Dade Product Control


Robert J. Amoruso, P.E.
Florida P.E. No. 49752

ROBERT JAMES AMORUSO
LICENSE
No 49752
7/5/11
STATE OF FLORIDA
PROFESSIONAL ENGINEER


① 11343
FRAME HEAD
TYP. WALL THICKNESS 0.050"

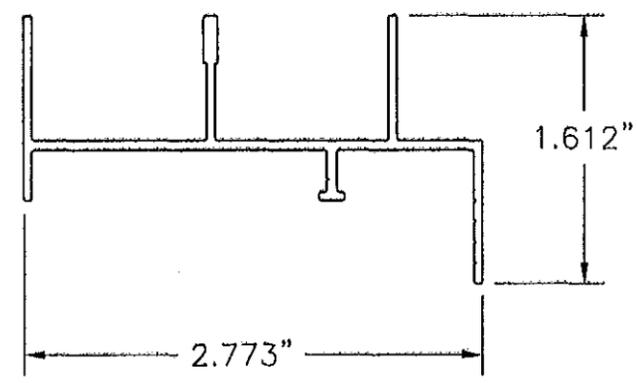


② 11396
FRAME SILL
TYP. WALL THICKNESS 0.060"

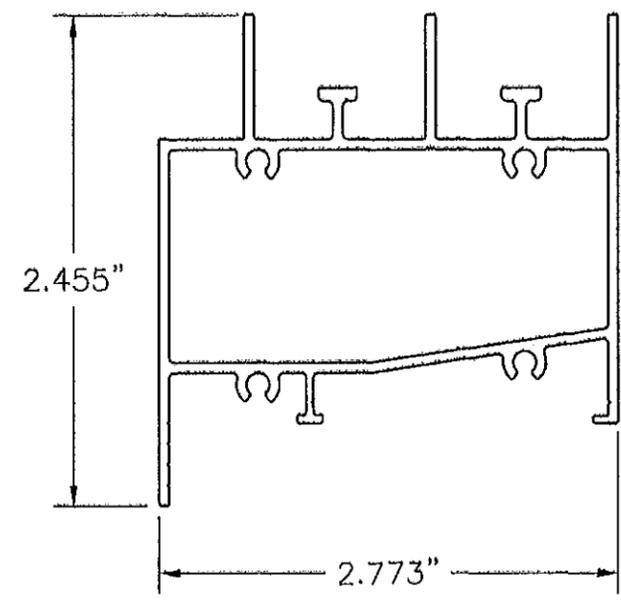


③ DHRMJ
FRAME JAMB
TYP. WALL THICKNESS 0.050"

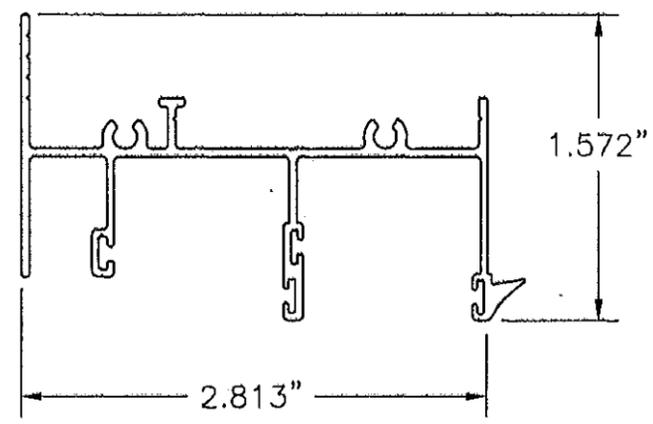


④ 45222
APPLIED FIN
TYP WALL
THICKNESS 0.050"

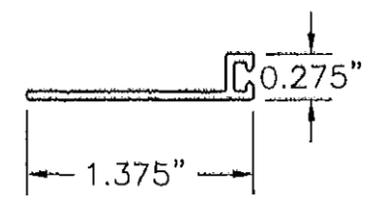


⑤ 60IVSI
INT. VENT JAMB STILE
TYP. WALL THICKNESS 0.050"

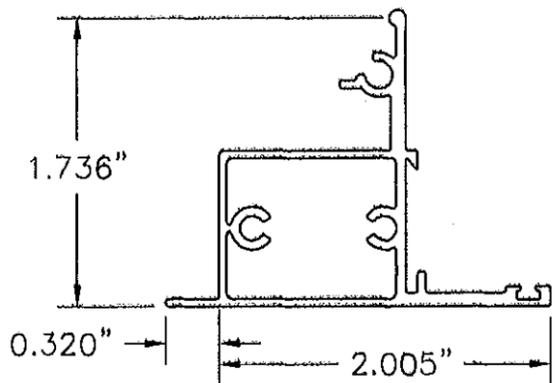


⑥ 60ITVI
EXT. VENT INTERLOCK STILE
TYP. WALL 0.050"

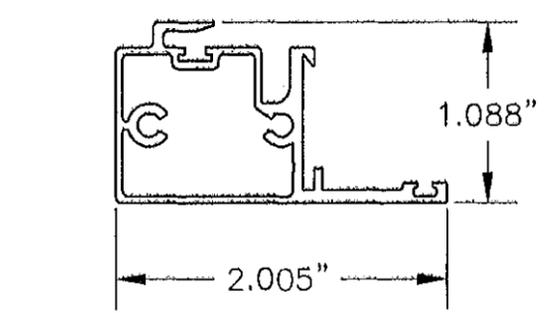


⑦ 60IBVI
INT. VENT INTERLOCK STILE
TYP. WALL 0.050"

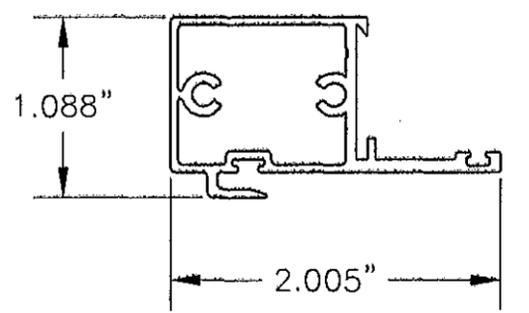


⑧ 60IVJS
TOP & BOTTOM VENT RAIL &
EXT. VENT JAMB STILE
THICKNESS 0.045"

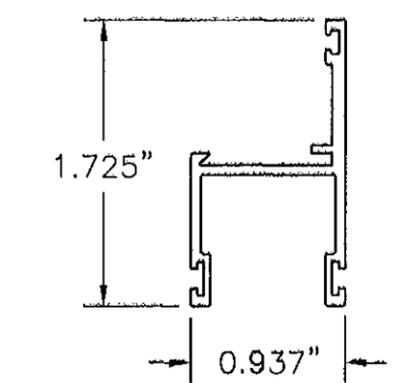


⑨ 60IGLB
GLAZING BEAD
TYP. WALL THICKNESS 0.080"

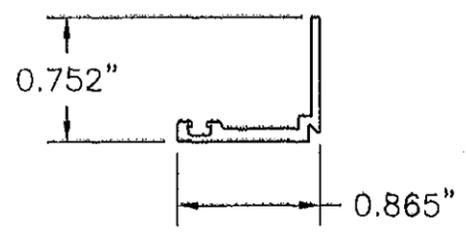


⑳ SILL RISER
TYP. WALL THICKNESS 0.068"

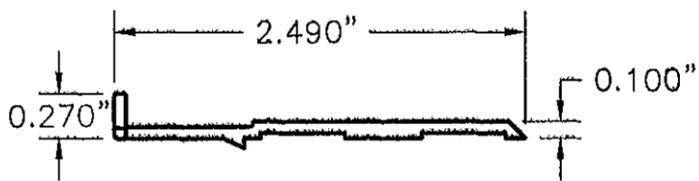

㉑ STEEL BAR REINFORCEMENT
NO TYP. WALL THICKNESS

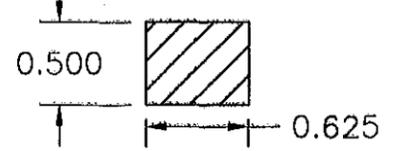

㉒ INSECT SCREEN
ALUMINUM 6063-T5

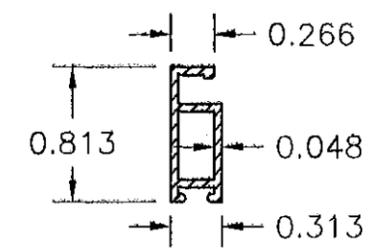

PROJECT # 411-0111		TJH	IRJA	SMC	BY
PER DADE LETTER	JUNE 29, 2011	07/05/11	02/15/11	02/10/10	DATE
3	NOA RENEWAL	2	PER MIAMI DADE COMMENTS 11/23/09	1	REV
DESCRIPTION					DATE

JELD-WEN
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR 97601
TITLE Premium Atlantic Aluminum 6500 Horizontal Slider Window, LMI COMPONENTS

DATE: 08/11/09
DRAWING NO: JELD0092
SCALE: N.T.S.
SHEET: 7 OF 10


DRAWN BY: SMC
PREPARED BY: N.T.S.
REV: 3

JELD-WEN
P.O. BOX 15070
Laguarda, FL 32052-0705
Phone: 321.331.1788
Fax: 321.690.1789
Email: info@jeld-wen.com

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 11-0426.04
Expiration Date _____
By *[Signature]*
Miami Dade Product Control

Robert J. Amoroso, P.E.
Florida P.E. No. 49782


ROBERT JAMES AMOROSO
LICENSE
No 49752
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

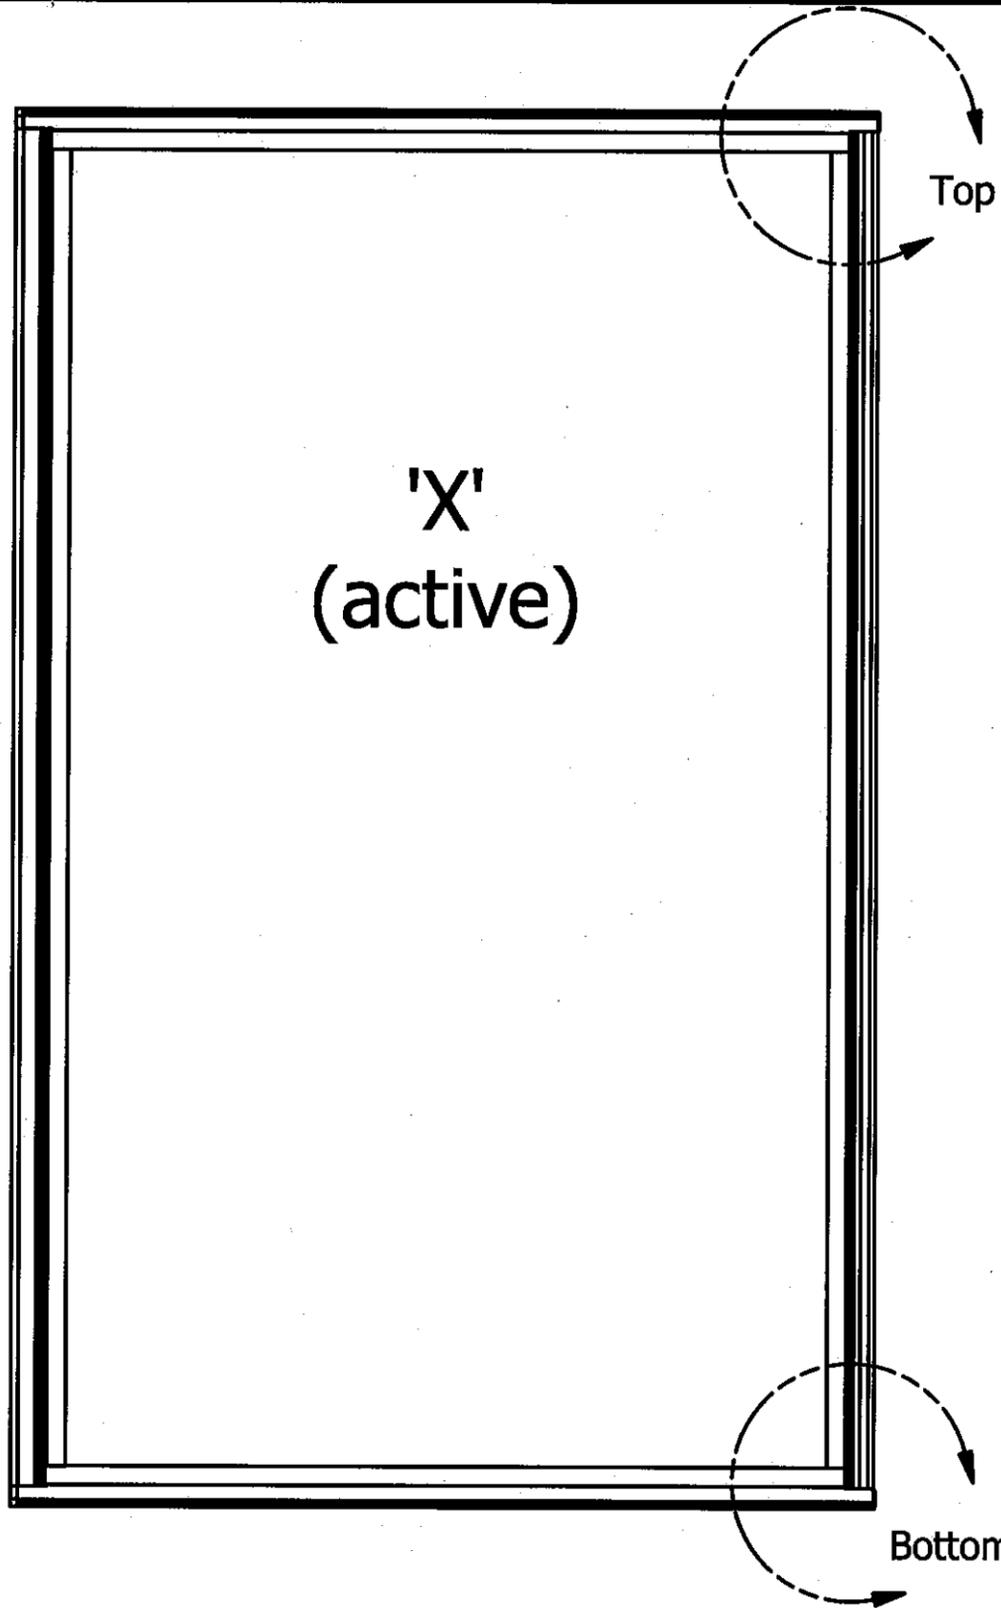

SASH CORNER DETAILS

PARTS LIST			
ITEM	QTY	PART NUMBER	DESCRIPTION
2	2	02303	Roller Shim
3	2	01998	Dust Cover (00539)
4	2	01414	Wheel Assembly
5	2	00631	Vent Rail
11	1	00629	Vent Interlock
12	1	00004	Interlock Reinforcement
13	1	04849	Holds Reinforcement In Place
20	8	00169	#8 x 1.00" PPH SMS S/S

NOTE:
1) BOM applicable to Sheet 8 only.

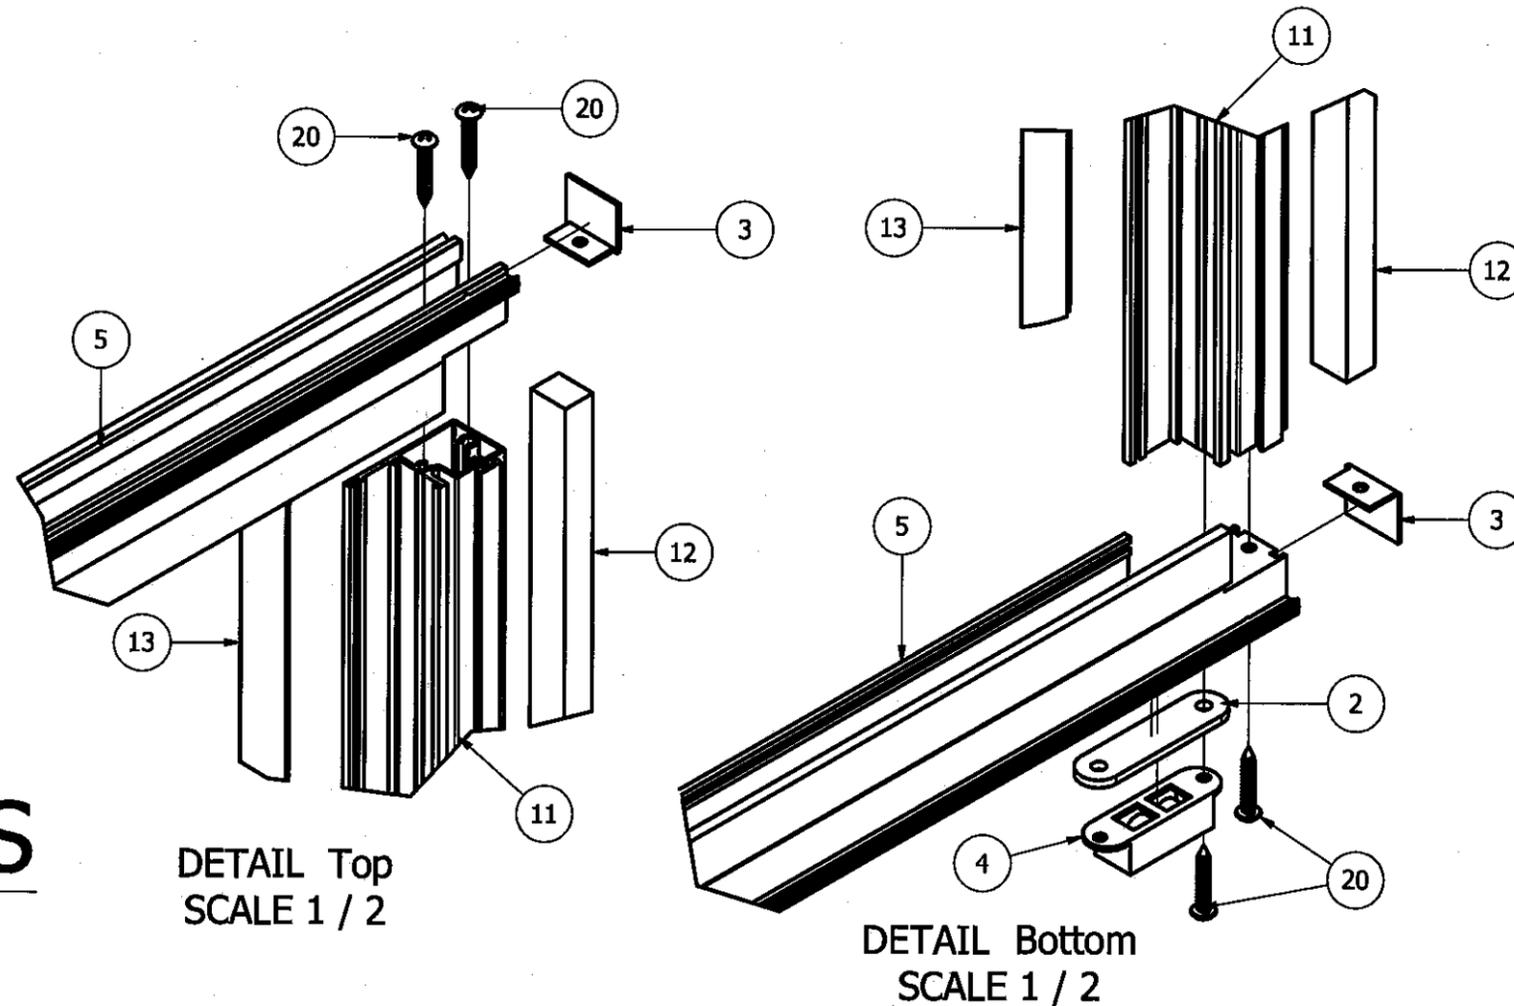

DETAIL Top
SCALE 1 / 2

DETAIL Bottom
SCALE 1 / 2

PROJECT # 411-0111

REV	DESCRIPTION	DATE	BY
3	PER DADE LETTER JUNE 29, 2011	07/05/11	TJH
2	NOA RENEWAL	02/15/11	IRJA
1	PER MIAMI DADE COMMENTS 11/23/09	02/10/10	SMC

JELD-WEN
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR 97601

TITLE: Premium Atlantic Aluminum 6500 Horizontal Slider Window, LMI
CORNER CONSTRUCTION DETAILS



DRAWN BY:	DATE:	DRAWING NO.:	SHEET:
SMC	08/11/09	JELD0092	8 OF 10
SCALE:	N.T.S.		
REV:	3		



PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No **11-0426.04**
Expiration Date **08/19/2016**
By *[Signature]*
Miami Dade Product Control

Robert J. Amoruso, P.E.
Florida P.E. No. 49752



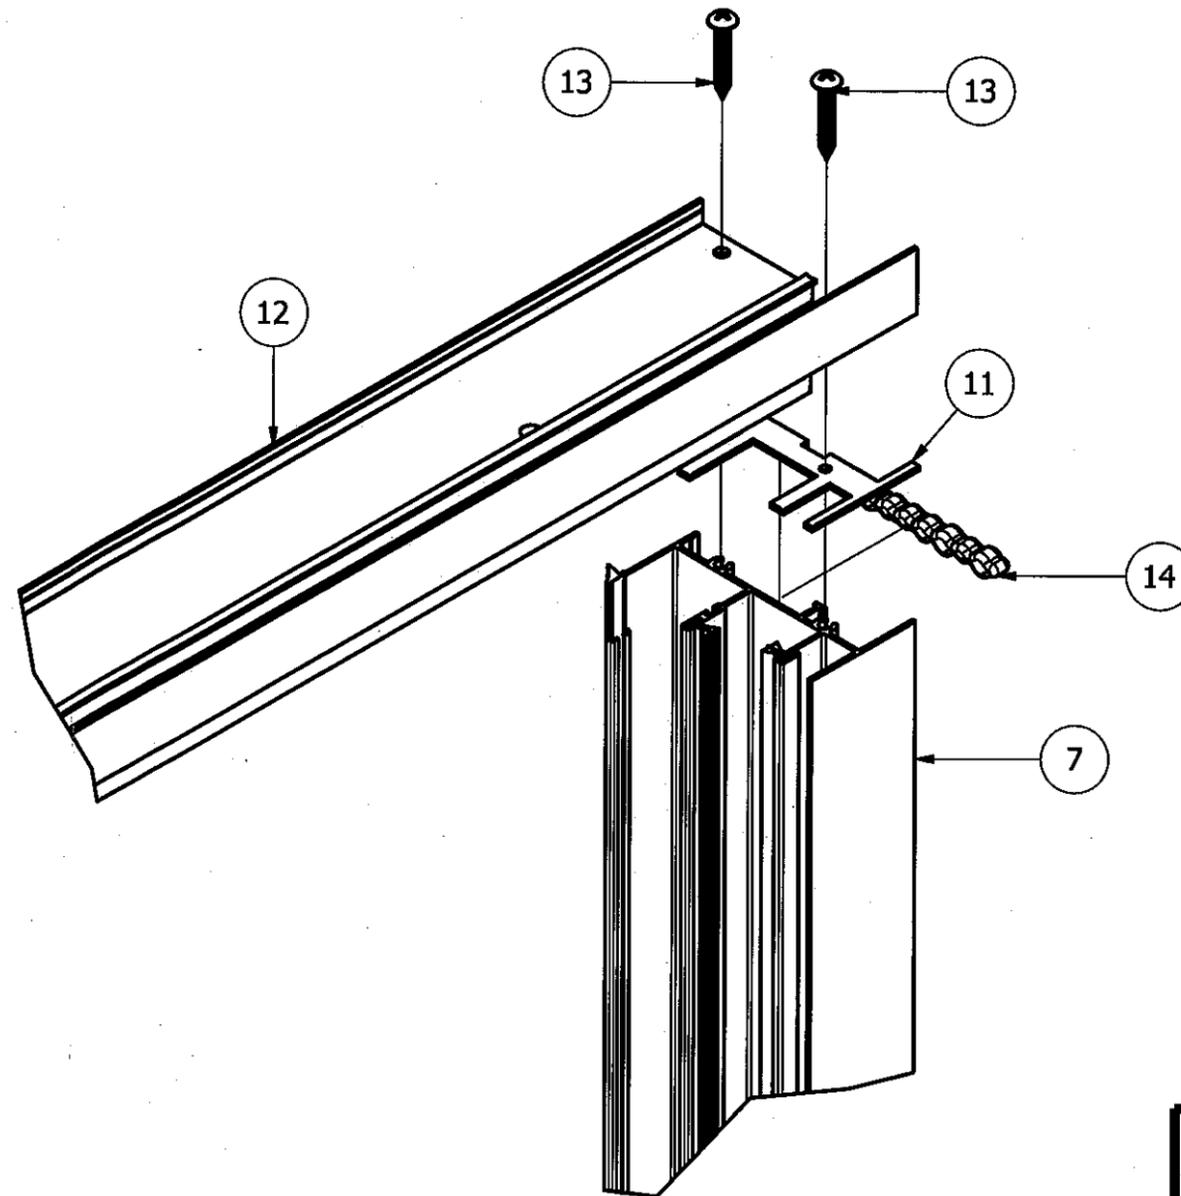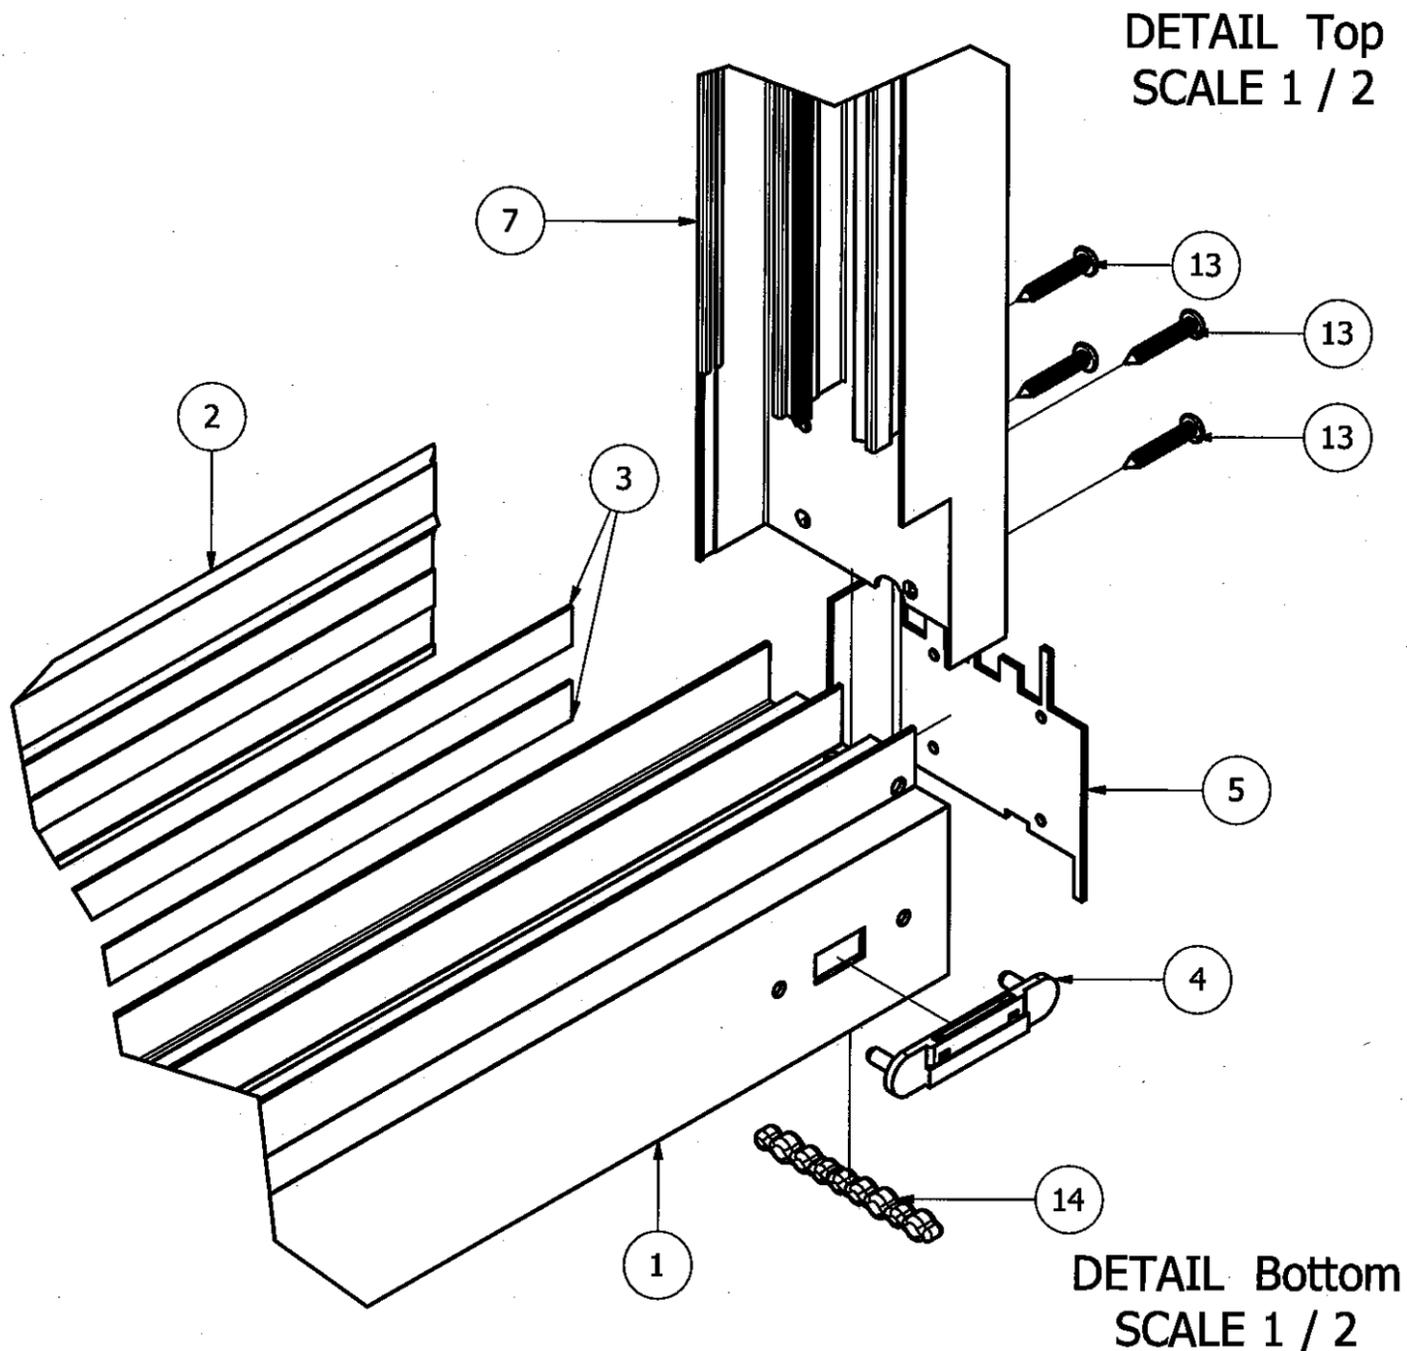


FRAME CORNER DETAILS FROM SHEET 9

PROJECT # 411-0111

REV	DESCRIPTION	DATE	BY
3	PER DADE LETTER JUNE 29, 2011	07/05/11	TJH
2	NOA RENEWAL	02/15/11	RJA
1	PER MIAMI DADE COMMENTS 11/23/09	02/10/10	SMC

JELD-WEN
3737 LAKEPORT BLVD.
KLAMATH FALLS, OR 97601
TITLE: Premium Atlantic Aluminum 6500 Horizontal Slider Window, LMI
CORNER CONSTRUCTION DETAILS

PREPARED BY:	DATE:	08/11/09
DRAWN BY: SMC	SCALE:	N.T.S.
DATE:	DRAWING NO:	JELD0092
REV:	SHEET:	10 OF 10
REV:	3	

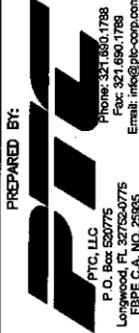

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No **11-0426.04**
Expiration Date **08/10/2016**
By *[Signature]*
Miami Dade Product Control

Robert J. Amoruso, P.E.
Florida P.E. No. 49752

