



MIAMI-DADE COUNTY
BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/building/home/asp

NOTICE OF ACCEPTANCE (NOA)

Tormax Technologies, Inc.
12859 Wetmore Road
San Antonio, TX 78247

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County BNC -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BNC reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 9300 Automatic Aluminum Sliding Glass Door w/ Reinforcements- L.M.I.

APPROVAL DOCUMENT: Drawing No. 11-089, "Series 9300 Impact" Sheets 1 through 4 of 4, prepared by EngCo. Inc., dated 04/29/11 and last revised on 05-27-2011, signed and sealed by Pedro De Figueiredo, P. E. bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and Series/Model and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises & renews** NOA # 06-0202.02 and consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



NOA No 11-0502.05
Expiration Date: June 22, 2016
Approval Date: June 16, 2011
Page 1

11/16/11

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections (transferred from file # **06-0202.02**)
2. Drawing No. **11-089**, "Series 9300 Impact" Sheets 1 thru 4 of 4, prepared by EngCo. Inc., dated 04/29/11 and last revised on 05-27-2011, signed and sealed by Pedro De Figueiredo, P. E.

B. TESTS (transferred from file # **06-0202.02)**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistant Test per FBC, TAS 202-94 (Not Performed)
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with installation diagram of an automatic aluminum sliding glass door, prepared by Hurricane Test Laboratory, LLC Test Report No. **HTL 0368-0807-05** and **HTL 0368-0808-05**, both dated 11/28/05 signed and sealed by Vinu J. Abraham, P.E.

C. CALCULATIONS

1. Statement letters of product conformance to FBC 2007, dated 04/29/11, signed and sealed by Pedro De Figueiredo, P.E.
2. Anchor Calculations and structural analysis, complying with FBC-2004, prepared by Engco, Inc, dated 11/27/05, signed and sealed by Pedro De Figueiredo, P.E. (transferred from file # **06-0202.02**)
3. Glazing Complies with ASTM E1300-02 &-04.

D. QUALITY ASSURANCE

1. Miami Dade Building and Neighborhood Compliance Department (BNC).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **08-1118.07** issued to Oldcastle Glass, Inc for "Storm Glass used for lamination glass", expiring on 12/11/2013.
2. Notice of Acceptance No. **08-0520.08** issued to Solutia, Inc for "Vanceva Composites used for lamination glass", expiring on 12/11/2013.

F. STATEMENTS

1. Statement letters of conformance and "No financial interest", dated 04/29/11, signed and sealed by Pedro De Figueiredo, P.E.
2. Statement of compliance, issued as part of the above referenced test report.

G. OTHER

1. This NOA **revises & renews** NOA # # **06-0202.02**, expired on June 22, 2011.


Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 11-0502.05
Expiration Date: June 22, 2016
Approval Date: June 16, 2011


INDEX:

- SHEET 1 of 4 - GENERAL NOTES, DESIGN RATING AND DOOR COMPONENTS
- SHEET 2 of 4 - TYPICAL DOOR ELEVATION, FRAMING ANCHORAGE
- SHEET 3 of 4 - SECTION 1 DETAIL & BILL OF MATERIALS
- SHEET 4 of 4 - SECTION 2 & 3 DETAILS & GLAZING DETAIL

GENERAL NOTES:

- 1- CODE: THIS PRODUCT HAS BEEN TESTED AND DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2007 ED., INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ).
- 2- DEFINITION: THIS PRODUCT IS AN ALUMINUM LARGE MISSILE IMPACT RESISTANT AUTOMATIC SLIDING GLASS DOOR. PRODUCT CAN BE USED AT ANY ELEVATION WITHOUT HURRICANE PROTECTION SHUTTERS.
- 3- POSTING: '9300' SERIES - LARGE MISSILE IMPACT ALUMINUM AUTOMATIC SLIDING GLASS DOORS
TORMAX TECHNOLOGIES, INC.
SAN ANTONIO, TEXAS
DADE COUNTY PRODUCT CONTROL APPROVED*
- 4- DESIGN LOADS: THE DESIGNED LOADS MUST BE CALCULATED BY A PROFESSIONAL ARCHITECT OR ENGINEER, AS PER ASCE 7, FOR EACH SPECIFIC PROJECT. THE CALCULATED DESIGNED PRESSURE MUST NOT EXCEED THE ALLOWABLE APPROVED PRESSURE.
- 5- MATERIAL: ALL ALUMINUM PARTS TO BE 6063-T5 ALLOY OR AS NOTED AND GLAZING TO BE LAMINATED GLASS AS PER SHEET 4 of 4 AS SPECIFIED ON THIS APPROVAL.
- 6- FASTENERS: ASSEMBLY SCREWS AND ANCHORS SHALL BE AS SPECIFIED IN THE CURRENT SET OF DRAWINGS. INSTALLATION AND LOADS AS PER THIS APPROVAL. ANCHOR SPACING AND LOADS MUST NOT EXCEED THE MAXIMUM LIMITS SPECIFIED BY THIS APPROVAL.
- 7- USE: IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR, ARCHITECT OR ENGINEER OF RECORD TO VERIFY THE FOLLOWING:
 - 7.1- THE STABILITY OF THE STRUCTURE WHERE THE PRODUCT IS TO BE ATTACHED INSURING PROPER ANCHORAGE.
 - 7.2- THE SITE SPECIFIC PROJECT CRITERIA, SUCH AS BUT NOT LIMITED TO, LOCAL CODE REQUIREMENTS, DESIGNED PRESSURES ETC.
 - 7.3- THAT THIS APPROVAL IS ADEQUATE TO THE SPECIFIC PROJECT.
- 8- 33 1/3% INCREASE IN ALLOWABLE LOADS HAVE NOT BEEN USED IN THE DESIGN OF THE ANCHORS FOR THIS PRODUCT APPROVAL, HOWEVER, WOOD SCREWS WITH 1.6 INCREASE FOR WIND LOAD DURATION HAVE BEEN USED.
- 9- THIS SYSTEM COMPLIES W/ ASTM E1300-04
- 10- MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL/ METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FBC SECTION 2003.8.4.

DOOR COMPONENTS

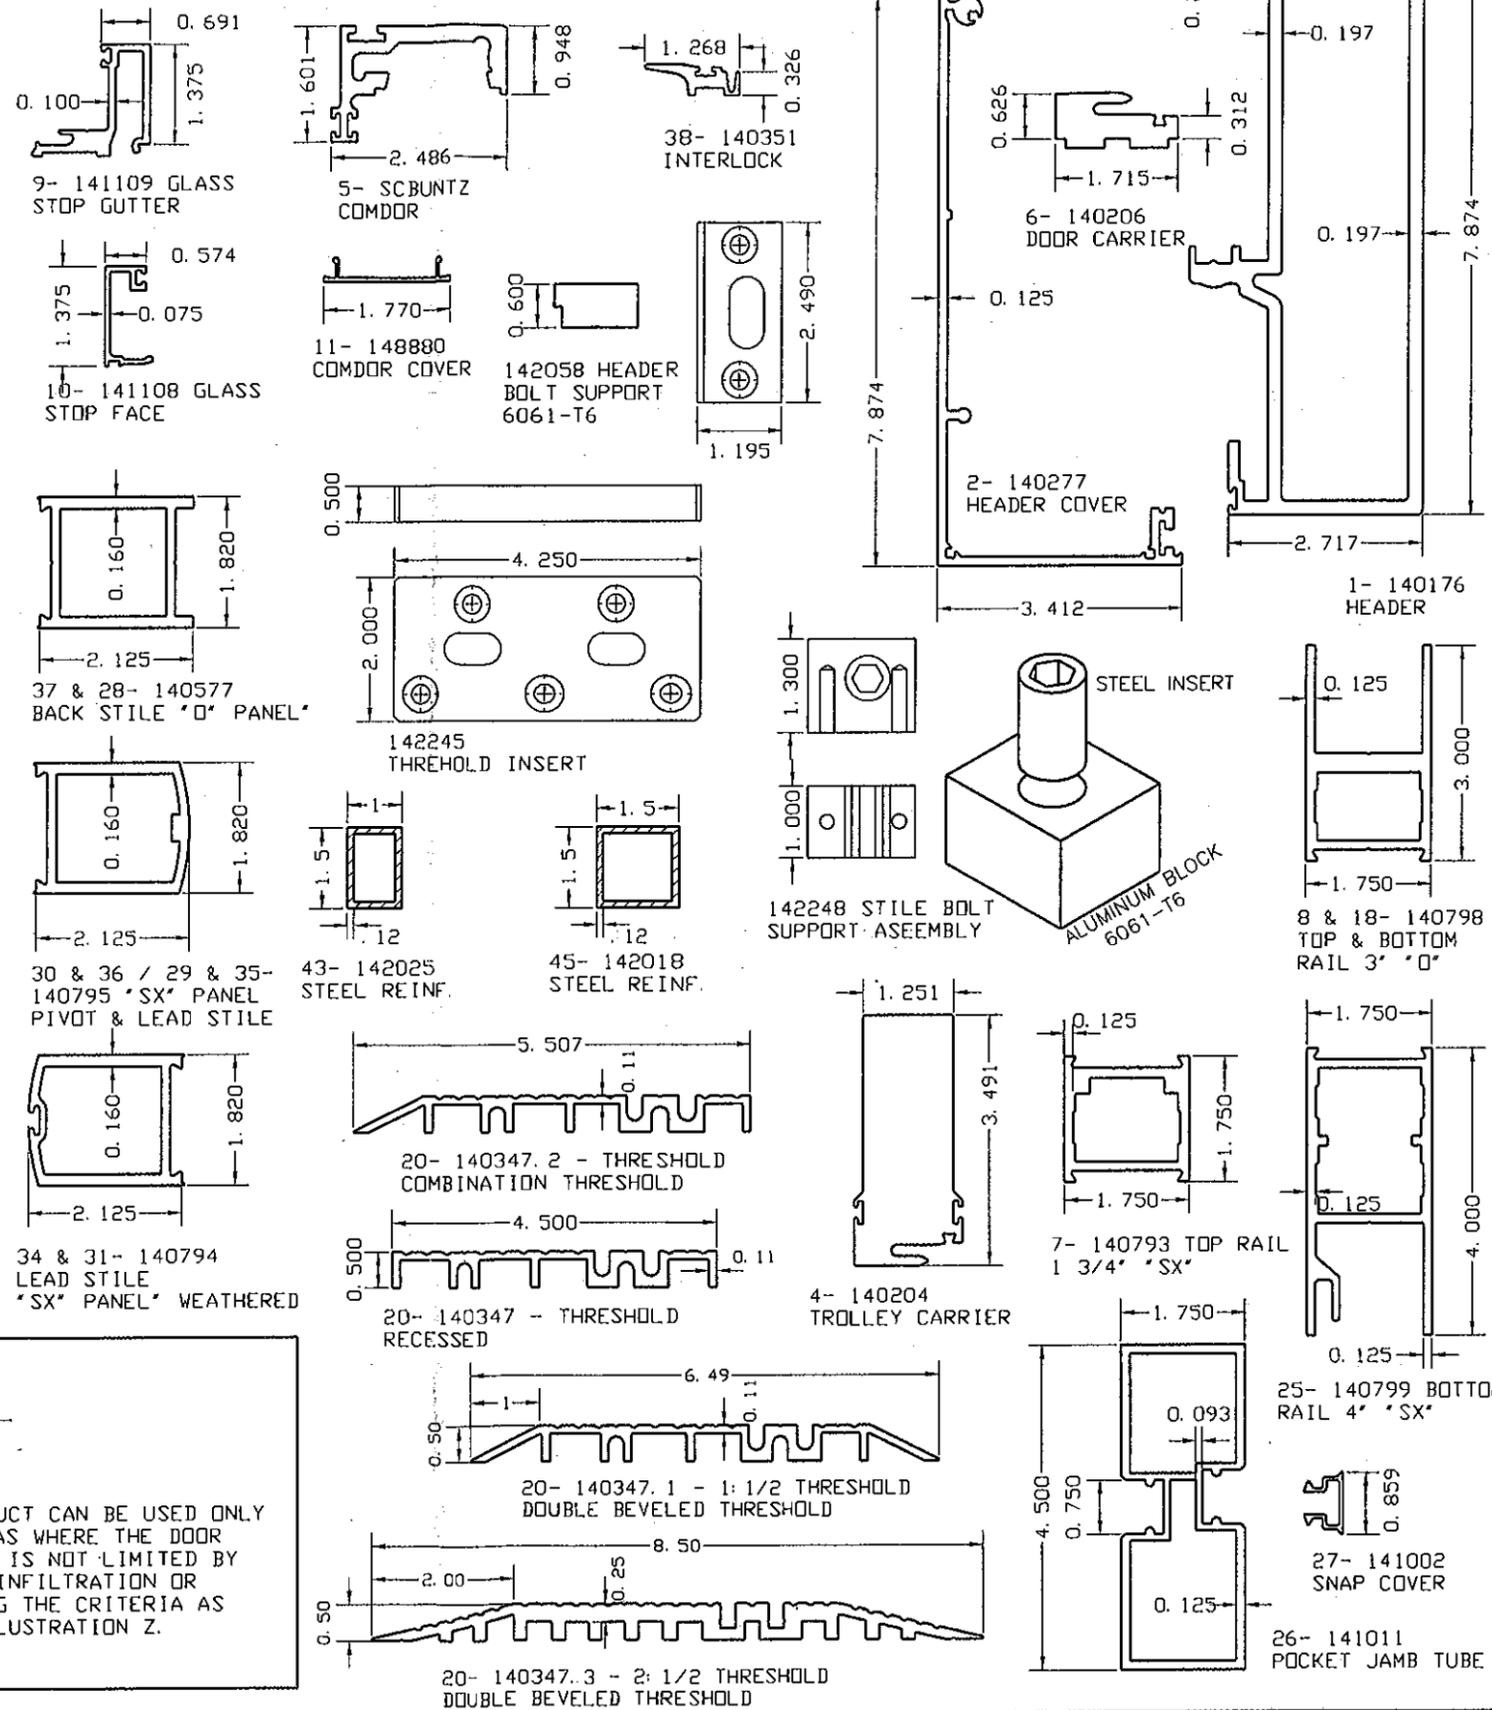

MANUFACTURER:
TORMAX
 TECHNOLOGIES, INC.

12859 WETMORE ROAD
 SAN ANTONIO, TX 78247
 PH: (210) 494-3551
 FAX: (210) 494-5930

PRODUCT:
SERIES 9300 IMPACT
 LARGE MISSILE IMPACT
 AUTOMATIC SLIDING
 GLASS DOOR

ENGINEERING:
EngCo Inc.
 CA 8116
 5595 Orange Dr. 201
 Davie, FL 33314
 ENGCO@AOL.COM




DRAFTING:
PK DRAFTING & MORE

MIAMI-DADE BCCO:
PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 11-0502.05
 Expiration Date JUNE 22, 2016
Shahid I. Khan
 Miami Dade Product Control


Date: 04/29/11
 Scale: NA
 Design by: PPMF

Drawing Number
11-089

SHEET
1 of 4

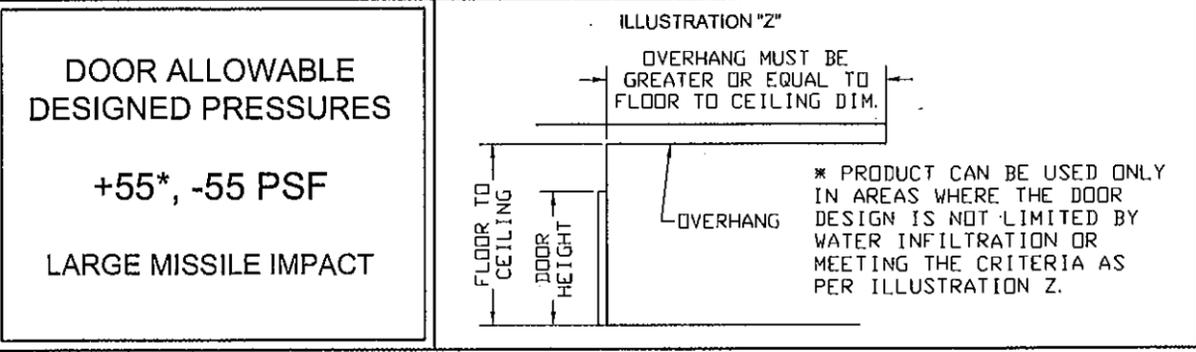

TYPICAL ELEVATION AND ANCHORAGE SPACING

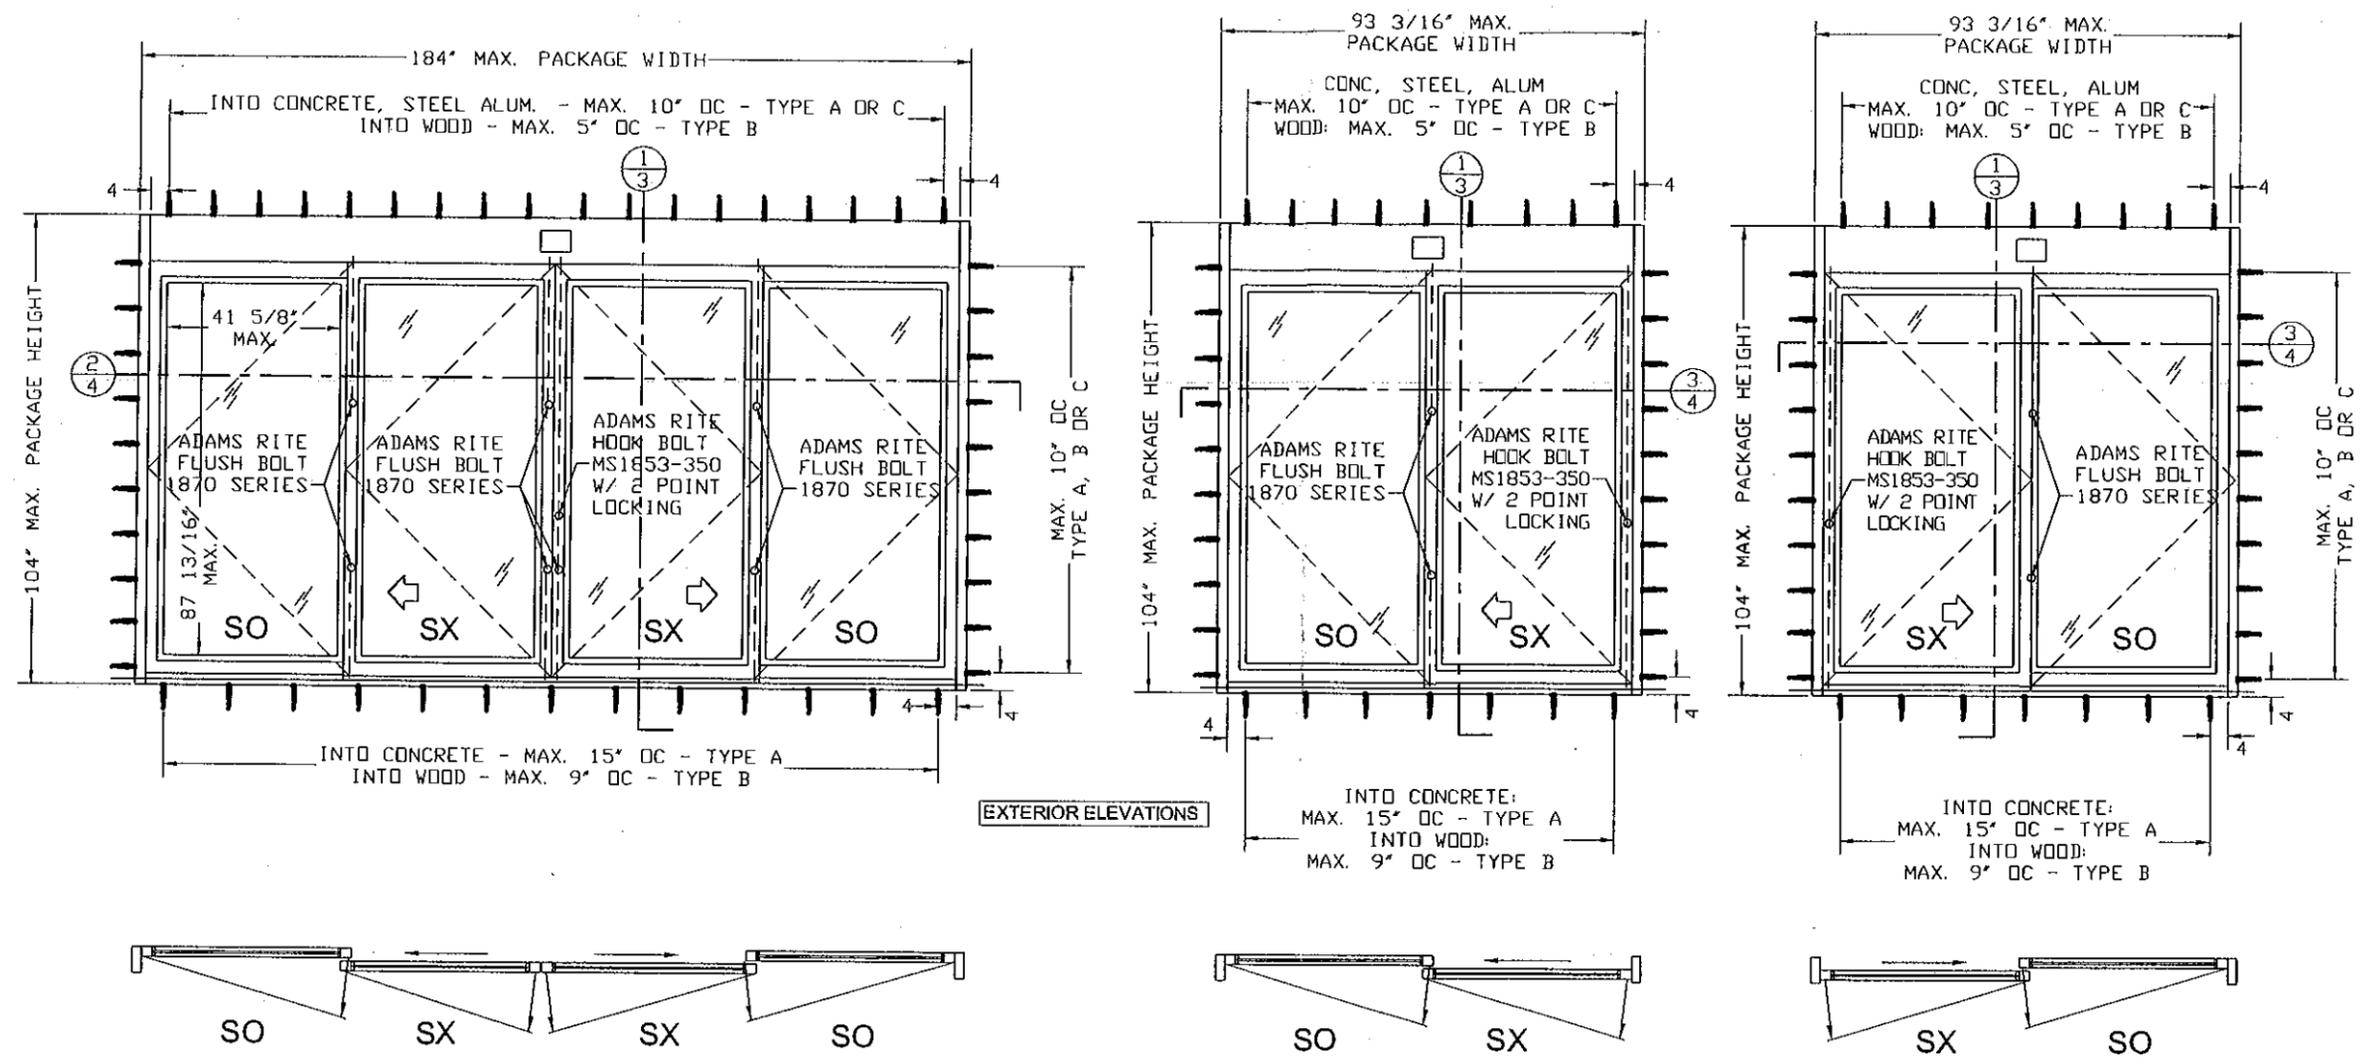

EXTERIOR ELEVATIONS

HARDWARE NOTE:
 LOCK AND FLUSH BOLT HAVE
 3/8" HEX BOLT EXTENDED 1/2"
 INTO HEAD AND THRESHOLD

ANCHOR DATA

MK	DESCRIPTION	BASE MATERIAL	PENETRATION	EDGE DIST.
A	1/4" ITW TAPCON BY BUILDEX	3192 PSI CONCRETE	1 1/2" MIN.	2 1/2" MIN
B	1/4" ITW TAPCON BY BUILDEX	WOOD (SG) = .55	1 1/2" MIN	3/4" MIN
C	1/4-14 HH SMS GRADE 5 GENERIC	1/8" THICK 6063-T5 ALUMINUM		3/4" MIN
	1/4-14 HH SMS GRADE 5 GENERIC	1/8" THICK A36 STEEL		3/4" MIN

ANCHOR NOTES:
 1- SEE SECTION DETAILS FOR ANCHOR SPACING.
 2- MINIMUM PENETRATION IS BEYOND WALL DRESSING.
 3- TYPICAL 2 ROWS OF ANCHORS FOR THRESHOLD INSTALLATION
 4- BASE MATERIAL DESIGNED BY OTHERS TO WITHSTAND IMPOSED LOAD.

PACKAGE HEIGHT INFORMATION

PACKAGE HEIGHT	MASONRY OPENING W/ SHIM
8' - 8" (104")	8' - 8 1/4" (104 1/4")


PACKAGE WIDTH INFORMATION

PKG WIDTH	NOMINAL CLEAR DOOR OPENING	SLIDING DOOR PANEL NOM. WIDTH	EMERGENCY BREAKOUT NOM. WIDTH
15' - 4" (184")	78"	46 25/32"	171"
7' - 9 3/16" (93 3/16")	38 7/8"	46 25/32"	85 1/2"

MANUFACTURER:
 ★★★★★
TORMAX[®]
 TECHNOLOGIES, INC.
 12859 WETMORE ROAD
 SAN ANTONIO, TX 78247
 PH: (210) 494-3551
 FAX: (210) 494-5930

PRODUCT:
SERIES 9300 IMPACT
 LARGE MISSILE IMPACT
 AUTOMATIC SLIDING
 GLASS DOOR

ENGINEERING:
EngCo Inc.
 CA 8116
 5595 Orange Dr. 201
 Davie, FL 33314
 ENGCO@AOL.COM

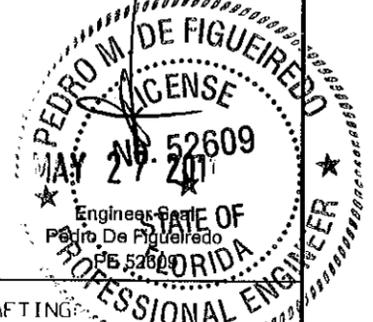

DRAFTING:
PK DRAFTING & MORE

MIAMI-DADE BCCO:

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 11-0502-05
 Expiration Date JUNE 22, 2016
 By Liberal I. Chanda
 Project Title: Project 11-0502-05

Date: 04/29/11
 Scale: NA
 Design by: PPMF

Drawing Number
11-089


SHEET
 2 of 4

SINGLE ROW OF STAGGERED ANCHORS
A & C AT 10" OC (CONC, STEEL, ALUM.)
AND ANCHOR B AT 5" OC (WOOD)
SHEET 2 FOR LAYOUT

TYPICAL VERTICAL SECTION ①/③

EDGE DISTANCE	
INTO CONCRETE	2 1/2"
INTO WOOD	3/4"
INTO ALUMINUM	3/4"
INTO STEEL	3/4"

MAX. 1/4" SHIM

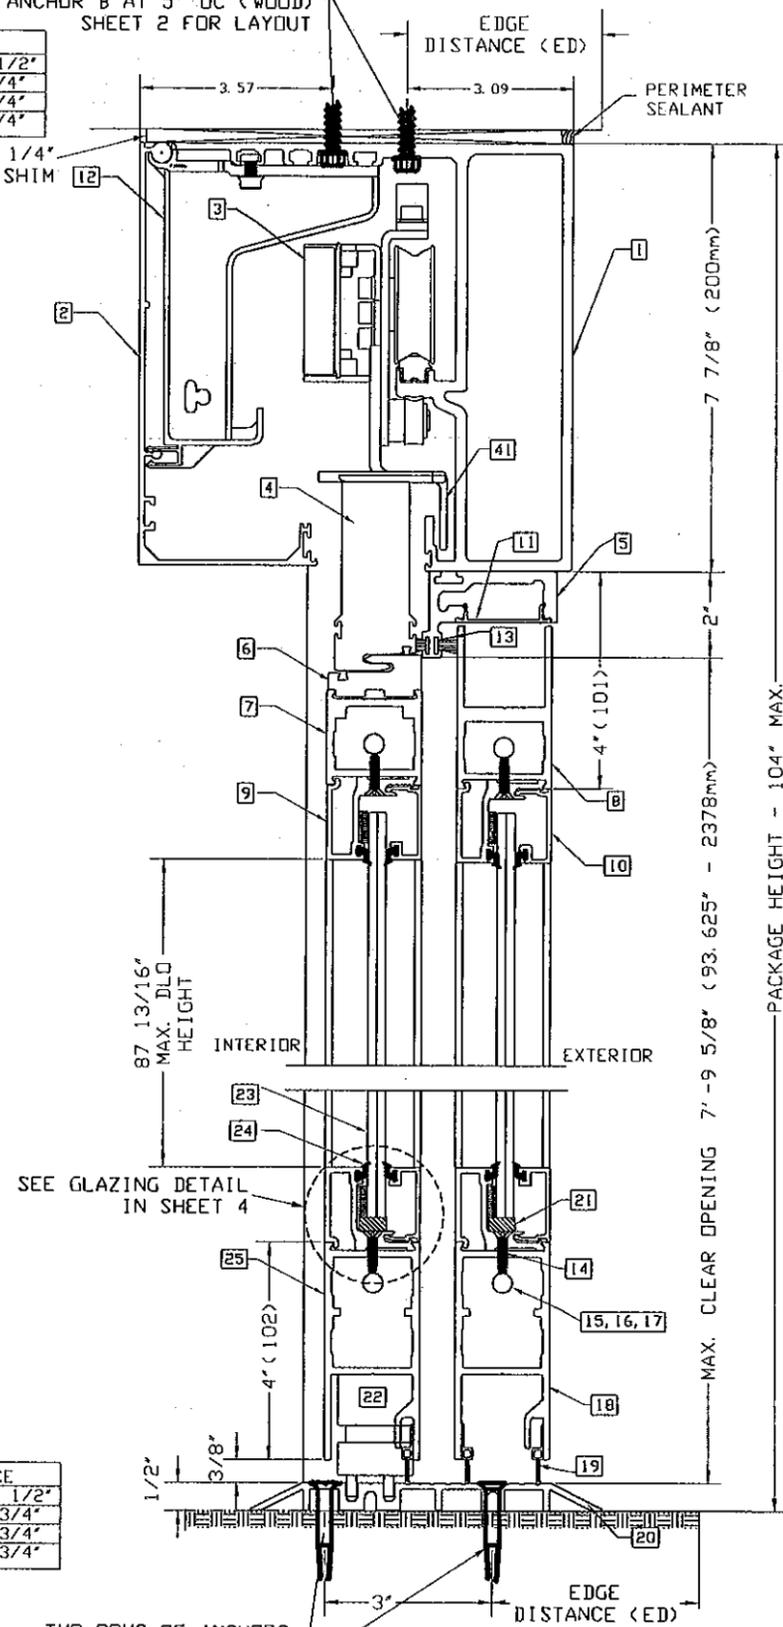


EDGE DISTANCE	
INTO CONCRETE	2 1/2"
INTO WOOD	3/4"
INTO ALUMINUM	3/4"
INTO STEEL	3/4"

TWO ROWS OF ANCHORS
TYPE A SPACED AT 15" OC INTO CONCRETE
OR TYPE B SPACED AT 9" OC INTO WOOD
SEE SHEET 2 FOR LAYOUT

MATERIAL LIST

ITEM #	QTY	DESCRIPTION	PART NUMBER
1	1	HEADER	140176
2	1	COVER, HEADER	140277
3	4	TROLLEY ROLLER ASSEMBLY	110445
4	2	TROLLEY CARRIER	140204
5	1	COMDOR	SCB. UNTZ
6	2	DOOR CARRIER	140206
7	2	1-3/4" TOP RAIL, "SX"	140793
8	2	3" TOP RAIL, "SD"	140798
9	16	1-3/8" GUTTER, GLASS STOP	141109
10	16	1-3/8" FACE, GLASS STOP	141108
11	3	COMDOR COVER	Q14. 8880
12	4	BRACKET, HEADER COVER	140219
13	1	PILE-FIN W. SEAL, HEADER & INTERLOCKS	141148
14	80	10-24 X 3/4" LG. FL HD PH SMS	140245-04
15	8	3/8" DIA ALL THREAD, THRU ROD	140167
16	16	RAIL CLIP, UNIVERSAL	140928
17	16	NUT, SERRATED FLANGE	140421-08
18	2	4" BOTTOM RAIL, "SD"	140799
19	4	FLOOR SWEEPER	140492
20	1	THRESHOLD, DOUBLE BEVELED	140349
21	AN	1/4" RUBBER SETTING BLOCK	
22	2	POP-UP GUIDE, NON-HANDED	142249
23	4	0.325" NOM. LAM. STORMGLASS, HT STR	
24	16	VINYL, GLASS STOPS	140132
25	2	4" BOTTOM RAIL, "SX"	140799
26	2	JAMB TUBE, POCKET	141011
27	2	SNAP COVER, JAMB TUBES	141002
28	1	REAR STILE, "SD" PANEL	140577
29	1	LEAD STILE, "SD" PANEL	140795
30	1	PIVOT STILE, "SX"	140795
31	1	LEAD STILE, WEATHERED, "SX" PANEL	140794
32	8	KEY OPERATED LOCK CYLINDER	
33	8	THUMBTURN LOCK CYLINDER	
34	1	LEAD STILE, WEATHERED, "SX"	140794
35	1	LEAD STILE, "SD" PANEL	140795
36	1	PIVOT STILE, "SX"	140795
37	1	REAR STILE, "SD" PANEL	140577
38	4	INTERLOCKS	140351
39	4	GASKET, INTERLOCKS	Q30. 8877
40	1	PILE-FIN WEATHER STRIP, STILE	141147
41	2	DE-RAILER	142185
42	4	PILE-FIN WSEAL, HEADER & INTERLOCKS	141148
43	2	STEEL TUBE, 1x1.5x0.12 FULL LENGTH	142025
44	6	BUTT HINGES	141115
45	4	STEEL TUBE, 1.5x1.5x0.12 FULL LENGTH	142018
46	2	TYPE P, SPONGE RUBBER, BLACK, WSEAL	142026
47	2	INTERLOCK ADAM RITE FLUSH BOLTS	1870
48	3	LOCK STILE ADAM RITE FLUSH BOLTS	1870
49	1	LOCK STILE ADAM RITE 2 POINTS	MS1853-350

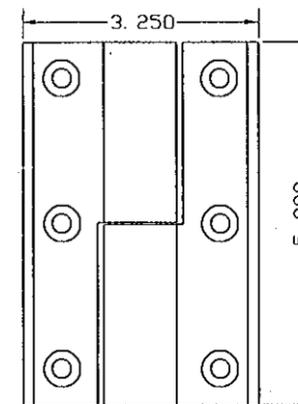

44- 141115
BUTT HINGE SET

HINGE SET, PN 141115


MANUFACTURER:

★★★★★
TORMAX[®]
TECHNOLOGIES, INC.

12859 WETMORE ROAD
SAN ANTONIO, TX 78247
PH: (210) 494-3551
FAX: (210) 494-5930

PRODUCT:
SERIES 9300 IMPACT
LARGE MISSILE IMPACT
AUTOMATIC SLIDING
GLASS DOOR

ENGINEERING:
EngCo Inc.
CA 8116
5595 Orange Dr. 201
Davie, FL 33314
ENGCO@AOL.COM

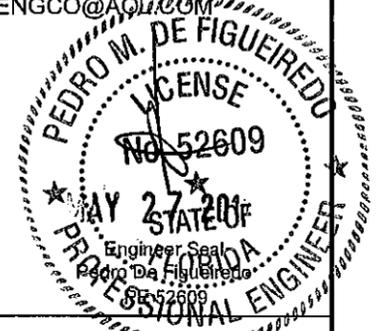

DRAFTING:
PK DRAFTING & MORE

MIAMI-DADE BCCO:


PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No 11-0802-05
Expiration Date JUNE 22, 2011
Ismael B. Duarte
Miami Dade Product Control

Date: 04/29/11
Scale: NA
Design by: PPMF

Drawing Number
11-089

SHEET
3 of 4


TYPICAL HORIZONTAL SECTION ②/④

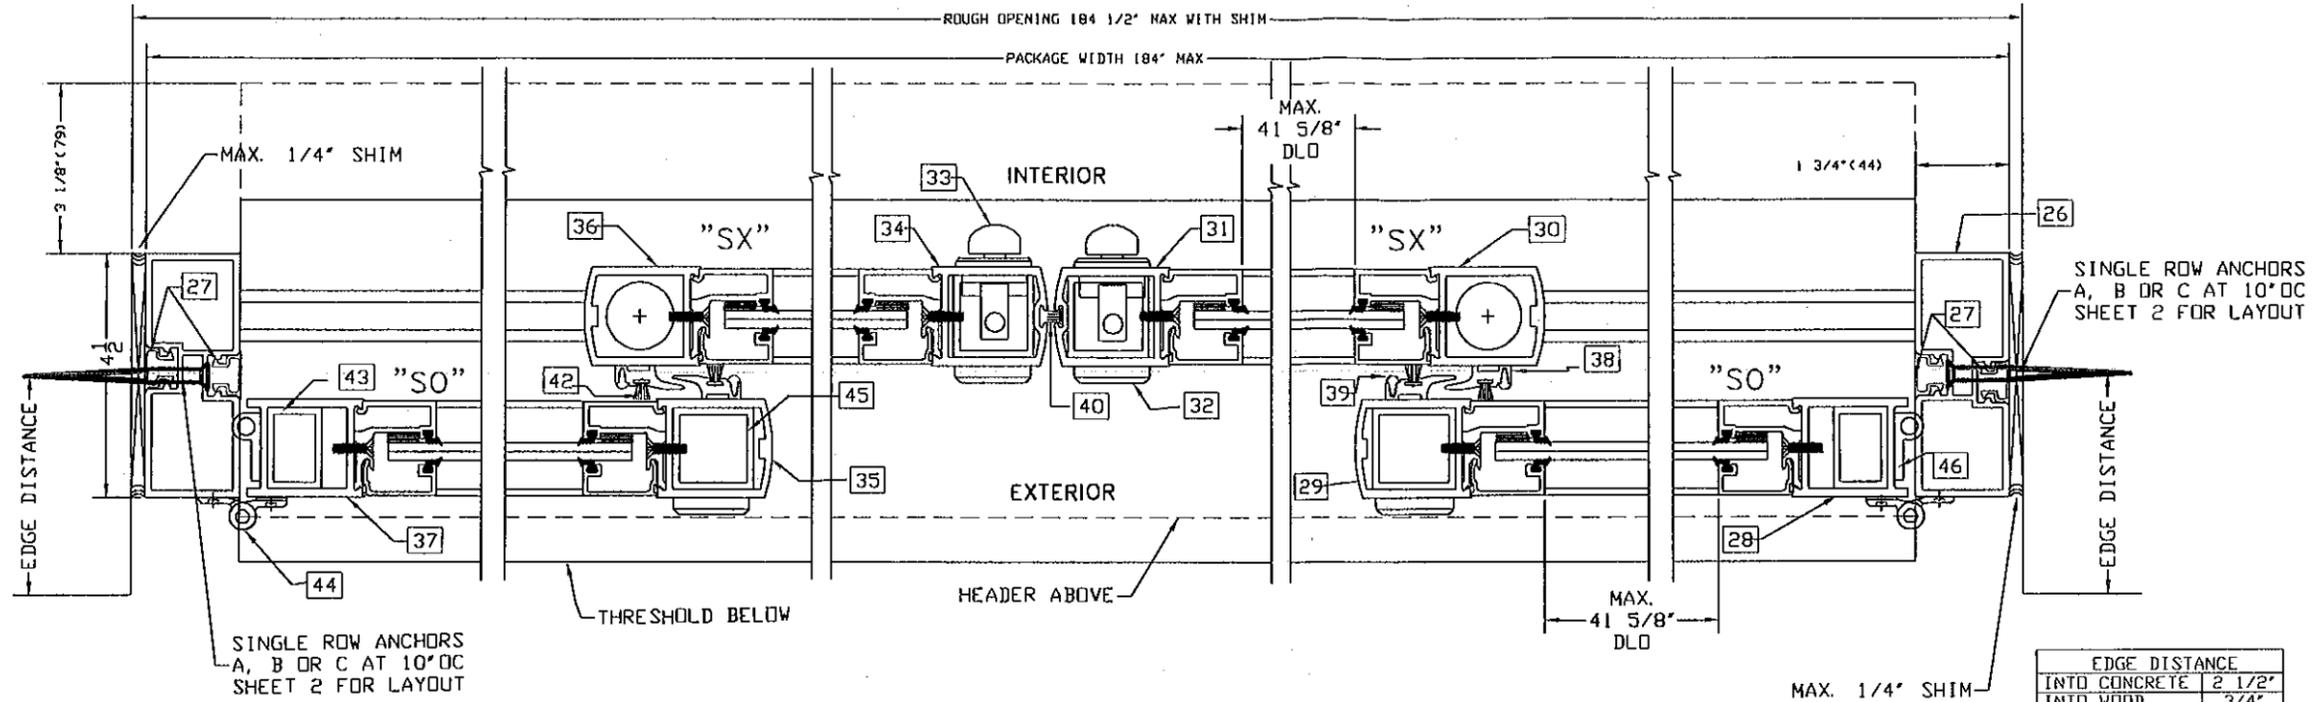

EDGE DISTANCE	
INTO CONCRETE	2 1/2"
INTO WOOD	3/4"
INTO ALUMINUM	3/4"
INTO STEEL	3/4"

EDGE DISTANCE	
INTO CONCRETE	2 1/2"
INTO WOOD	3/4"
INTO ALUMINUM	3/4"
INTO STEEL	3/4"


TYPICAL HORIZONTAL SECTION ③/④

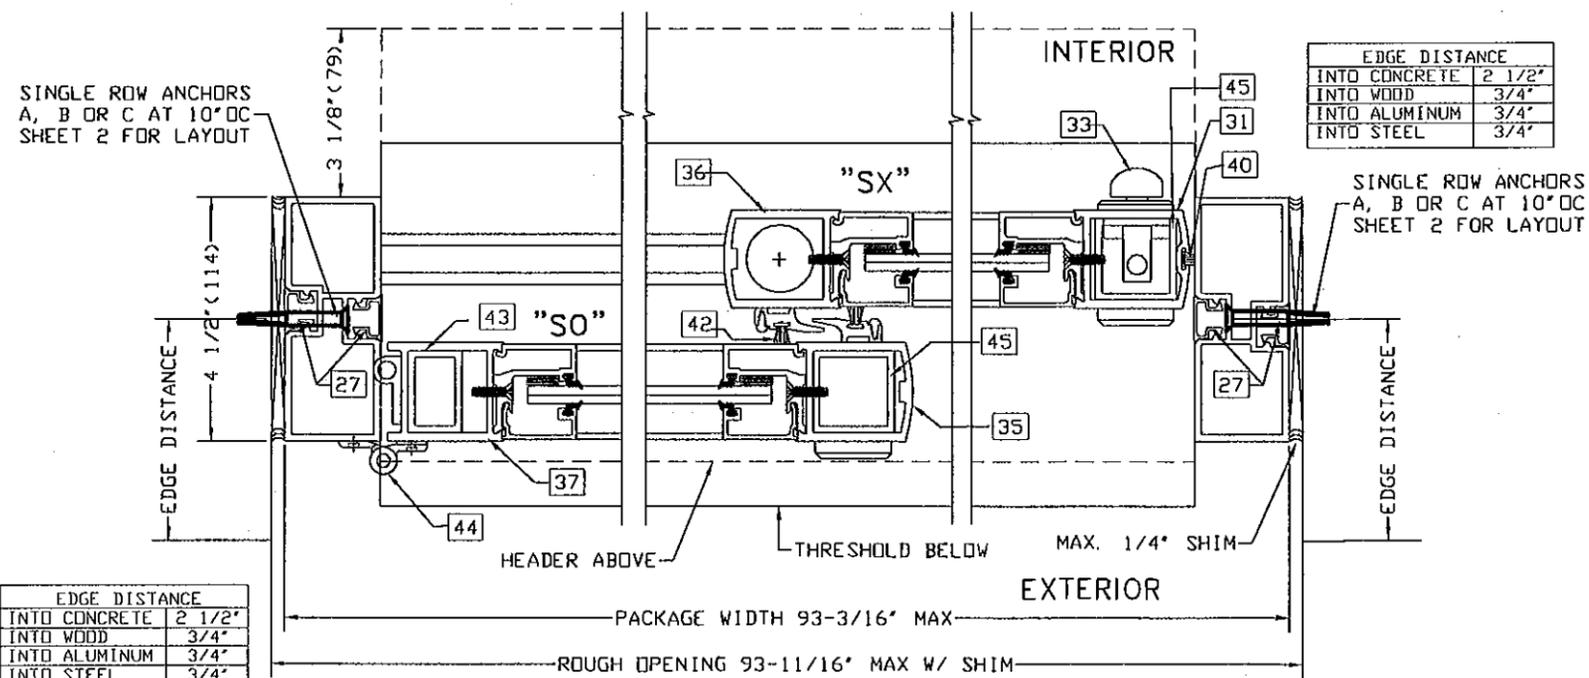

EDGE DISTANCE	
INTO CONCRETE	2 1/2"
INTO WOOD	3/4"
INTO ALUMINUM	3/4"
INTO STEEL	3/4"

EDGE DISTANCE	
INTO CONCRETE	2 1/2"
INTO WOOD	3/4"
INTO ALUMINUM	3/4"
INTO STEEL	3/4"

TYPICAL GLAZING DETAIL
ENTIRE PERIMETER ALL LITES

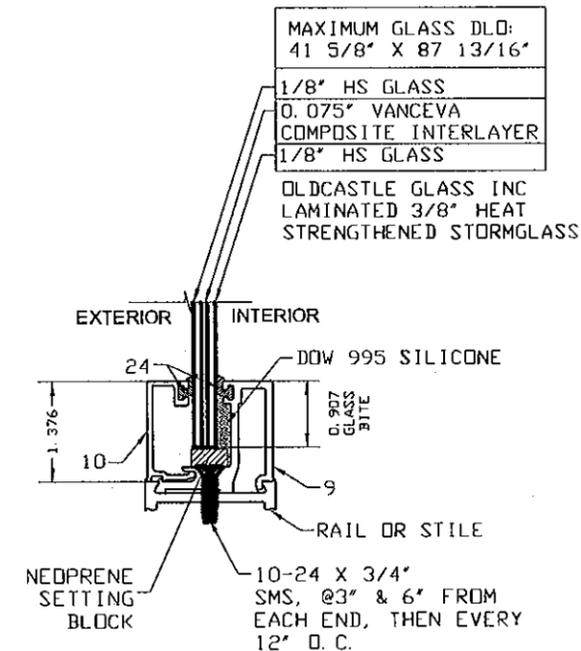

MAXIMUM GLASS DLO:
41 5/8" X 87 13/16"

1/8" HS GLASS
0.075" VANCEVA
COMPOSITE INTERLAYER
1/8" HS GLASS

OLDCASTLE GLASS INC
LAMINATED 3/8" HEAT
STRENGTHENED STORMGLASS

MANUFACTURER:
★★★★★
TORMAX[®]
TECHNOLOGIES, INC.
12859 WETMORE ROAD
SAN ANTONIO, TX 78247
PH: (210) 494-3551
FAX: (210) 494-5930

PRODUCT:
SERIES 9300 IMPACT
LARGE MISSILE IMPACT
AUTOMATIC SLIDING
GLASS DOOR

ENGINEERING:
EngCo Inc.
CA 8116
5595 Orange Dr. 201
Davie, FL 33314
ENGCO@AOL.COM



DRAFTING:
PK DRAFTING & MORE

MIAMI-DADE BCCO:

PRODUCT REVISED
as complying with the Florida
Building Code
Assurance No 11-0502-05
Expiration Date 05/22/2016
John J. ...

Date: 04/29/11
Scale: NA
Design by: PPMF

Drawing Number
11-089

SHEET
4 of 4