



MIAMI-DADE COUNTY
BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION
11805 SW 26th Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/building

Florida Coastal Impact Window, LLC.

940 W 84 Street

Hialeah, FL 33014

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County BNC-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BNC reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "2009" Aluminum Horizontal Sliding Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. AD11-11, titled "2009 Alum. Horizontal Rolling Window-LMI", sheets 1 through 11 of 11, dated 04/20/2011 with the latest revision dated 08/04/2011, prepared by MCY Engineering, Inc., signed and sealed by Yiping Wang, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series and following statement: "Miami-Dade County Product Control Approved" unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. 09-0312.07 and consists of this page 1, evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**

Helmy A. Makar
08/18/2011



NOA No. 11-0513.01
Expiration Date: December 27, 2012
Approval Date: August 18, 2011
Page 1


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **AD11-11**, titled "**2009 Alum. Horizontal Rolling Window-LMI**", sheets 1 through 11 of 11, dated 04/20/2011 with the latest revision dated 08/04/2011, prepared by MCY Engineering, Inc., signed and sealed by Yiping Wang, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Large Missile Impact Test per FBC, TAS 201-94
4) Cyclic Wind Pressure Loading per FBC, TAS 203-94
5) Standard Test Method for Determination of Operating Force of Sliding Windows and Doors per ASTM E2068-00 (2008)
along with marked-up drawings and installation diagram of Aluminum Horizontal Sliding Window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-6234**, dated 04/05/2011, signed and sealed by Marlin D. Brinson, P. E.
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, Type "C" sliding door, Grade 10, per FBC 2411 3.2.1, TAS 202-94 and per ASTM F 842-04
along with marked-up drawings and installation diagram of Aluminum Horizontal Sliding Window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5640**, dated 01/06/2009, signed and sealed by Carlos S. Rionda, P. E.
(Submitted under previous NOA No.09-0312.07)
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, Type "C" sliding door, Grade 10, per FBC 2411 3.2.1, TAS 202-94 and per ASTM F 842-04
along with marked-up drawings and installation diagram of Aluminum Horizontal Sliding Window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5271**, dated 09/05/2007, Carlos S. Rionda, P. E.
(Submitted under previous NOA No.07-1018.07)


Helmy A. Makar, P.E., M.S.
BNC, Product Control Unit Supervisor
NOA No. 11-0513.01
Expiration Date: December 27, 2012
Approval Date: August 18, 2011

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by MCY Engineering, Inc., dated 05/10/2011, signed and sealed by Yiping Wang, P. E.
Complies with ASTM E1300-04

D. QUALITY ASSURANCE

1. Miami-Dade Building and Neighborhood Compliance Department (BNC).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **11-0624.02** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/26/2010, expiring on 01/14/2012.
2. Notice of Acceptance No. **10-0922.09** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite® PVB, Interlayer**" dated 12/24/2010, expiring on 12/11/2011.


F. STATEMENTS

1. Statement letters of no financial interest, conformance and compliance with the FBC-2007, dated 05/02/2011, signed and sealed by Yiping Wang, P. E.
2. Laboratory addendum letter for Test Report No. **FTL-6234**, issued by Fenestration Testing Laboratory, Inc., dated 07/21/2011, signed and sealed by Marlin D. Brinson, P. E.
3. Laboratory compliance letter for Test Report No. **FTL-6234**, issued by Fenestration Testing Laboratory, Inc., dated 04/05/2011, signed and sealed by Marlin D. Brinson, P. E.
Laboratory compliance letter for Test Report No. **FTL-5640**, issued by Fenestration Testing Laboratory, Inc., dated 01/06/2009, signed and sealed by Carlos S. Rionda, P. E.
(Submitted under previous NOA No.09-0312.07)
4. Laboratory compliance letter for Test Report No. **FTL-5271**, issued by Fenestration Testing Laboratory, Inc., dated 09/05/2007, signed and sealed by Carlos S. Rionda, P. E.
(Submitted under previous NOA No.07-1018.07)
5. Letter of *Adoption of as his Own, the Work of another Engineer* per Section 61G15-27 of the FBPE, dated 08/08/2011 signed and sealed by Yiping Wang, P. E.
6. Proposal issued by Product Control, dated 07/07/2009, signed by Manuel Perez, P. E.
(Submitted under previous NOA No.09-0312.07)


G. OTHERS

1. Notice of Acceptance No. **09-0312.07**, issued to Florida Coastal Protective Manufacturing for their Series "2009 Aluminum Horizontal Sliding Window-L.M.I.", approved on 05/27/2009 and expiring on 12/27/12.


Henry A. Makar, P.E., M.S.
BNC, Product Control Unit Supervisor
NOA No. 11-0513.01
Expiration Date: December 27, 2012
Approval Date: August 18, 2011

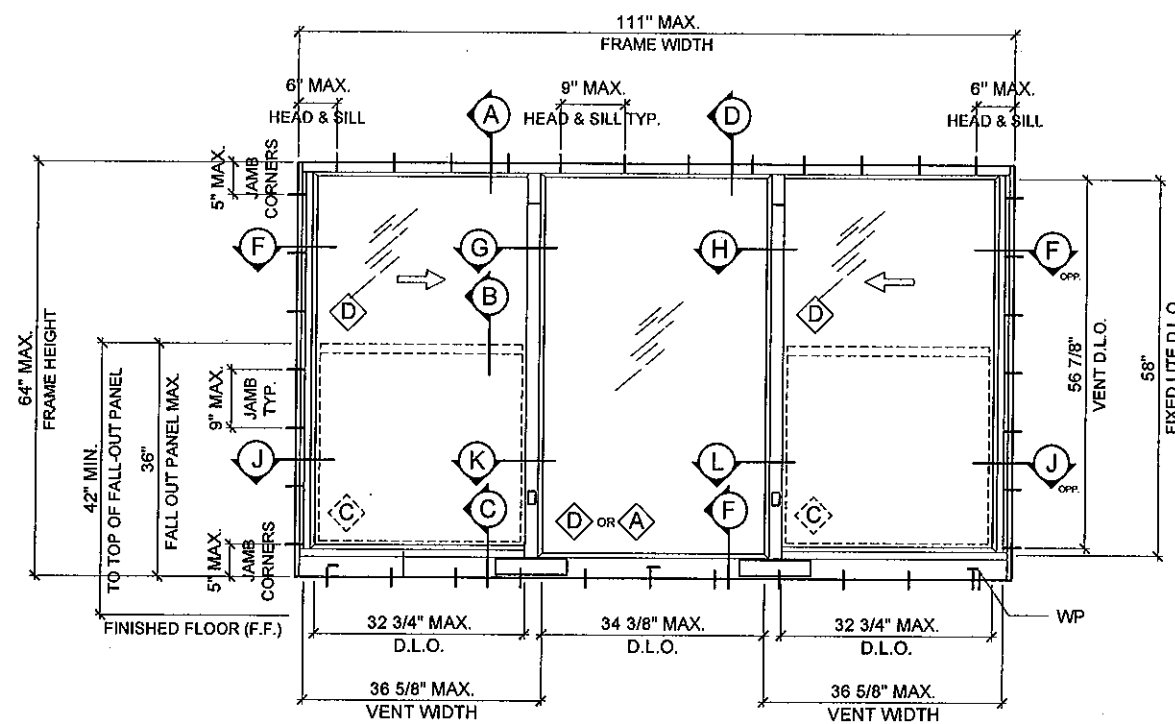

TYPICAL EXTERIOR ELEVATION A (XOX)

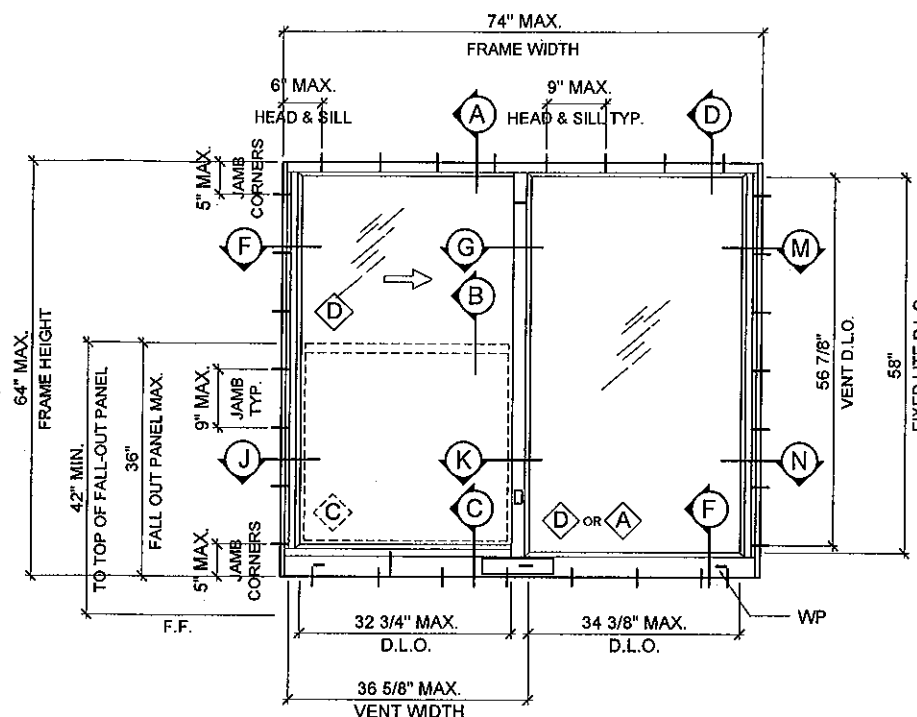

TYPICAL EXTERIOR ELEVATION B (XO)
(ELEVATION APPLY TO OX)

DESIGN LOADS
(FOR SIZE ABOVE OR SMALLER)
+ 80 PSF
- 80 PSF


GENERAL NOTES:

- THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2007 EDITION INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).
- GLASS CALCULATIONS BASED ON ASTM E1300-04.
- WINDOWS RATED FOR LARGE MISSILE IMPACT AND DO NOT REQUIRE SHUTTERS.
- THESE WINDOWS ARE APPROVED FOR AIR AND WATER INFILTRATION.
- ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
- ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.
- WOOD BUCKS BY OTHERS MUST BE SOUTHERN PINE, G = 0.55 AND MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

- A LOAD DURATION FACTOR IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.
- PROVIDE 1/4" MAX. LOAD BEARING SHIM SPACE (TYP.).
- MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2007 FLORIDA BUILDING CODE SECTION 2003.8.4.
- METAL STRUCTURES NOT BY FLORIDA COASTAL IMPACT WINDOWS LLC MUST SUPPORT LOADS IMPOSED BY WINDOW SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.
- FALL-OUT PANEL IS REQ'D WHEN SILL ELEVATION IN RESPECT TO THE NEAR SIDE WALKING SURFACE IS LESS THAN 42". IF FALL-OUT PANELS ARE USED ONLY GLASS TYPE "A" MUST BE USED AT FIXED PANEL.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0513.01
Expiration Date 12/27/2012
By *Heather A. Miller*
Miami Dade Product Control

MIAMI DADE COUNTY

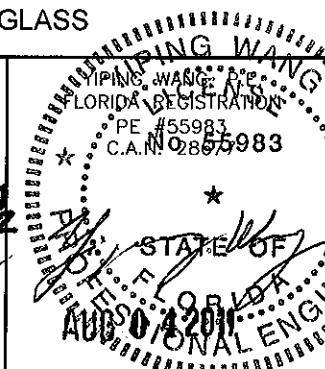

DATE	04/20/11
SCALE	AS SHOWN
DRAWN	S. L.
PROJECT	11-027
DRAWING NO.	AD11-11

1 OF 11

MCY ENGINEERING, INC.

GLAZING CONSULTANTS

9110 SW SUNSET DRIVE
MIAMI, FL 33173
P: 305.271.0117
F: 786.573.5063


www.MCYEngineering.com MCY.Engineering@Att.net


SERIES 2009 ALUM. HORIZONTAL ROLLING WINDOW - LMI

FLORIDA COASTAL IMPACT WINDOW L.L.C.


940 W 84 STREET
HIALEAH, FL 33014
P: (305) 828-8254 F: (305) 828-8255

NO	DATE	DESCRIPTION



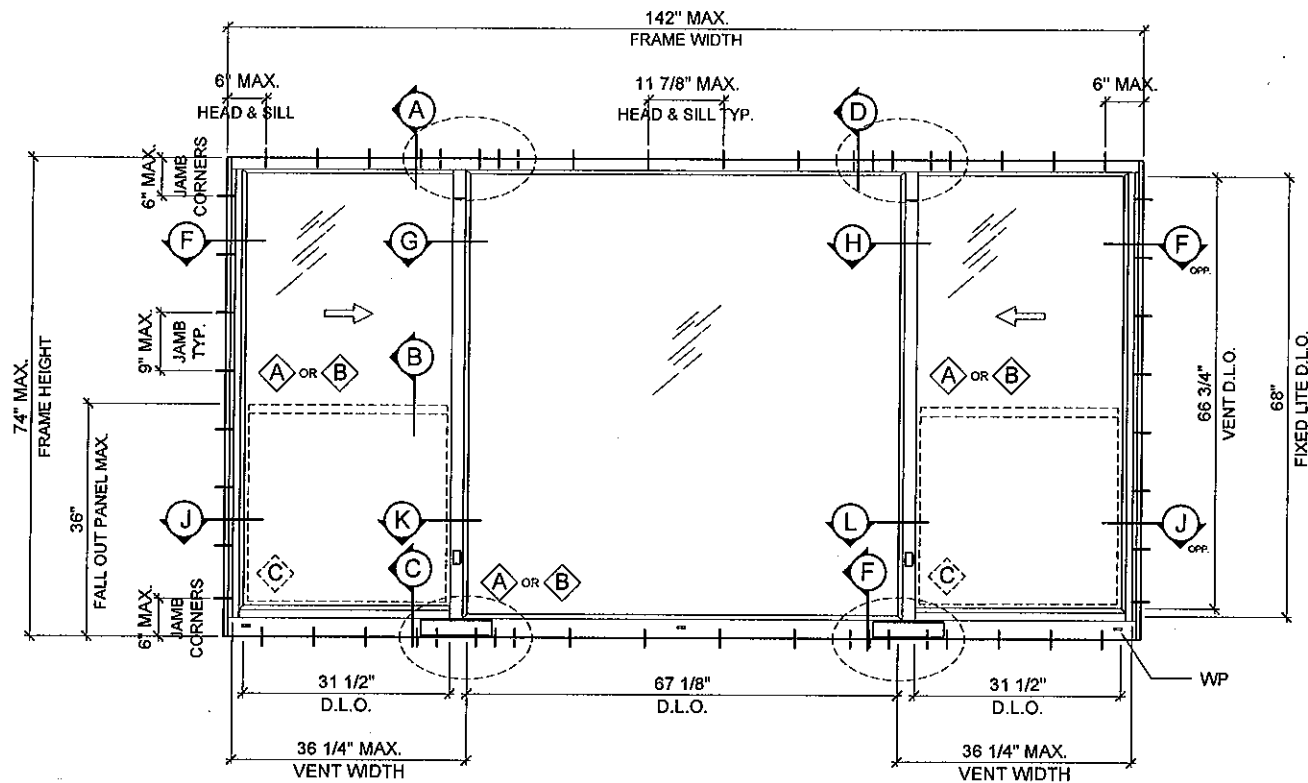



TYPICAL EXTERIOR ELEVATION C (XOX)
(1/4 - 1/2 - 1/4)

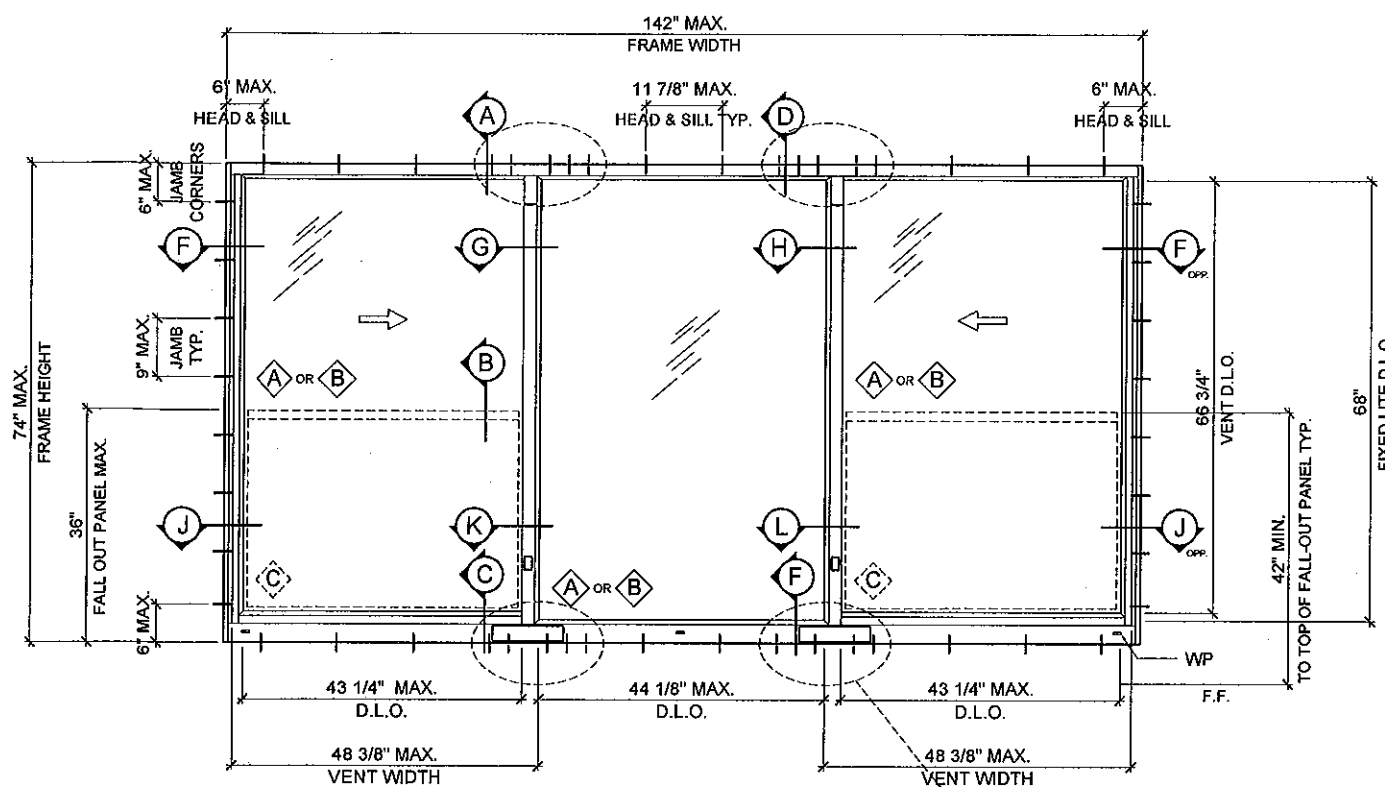

TYPICAL EXTERIOR ELEVATION D (XOX)
(1/3 - 1/3 - 1/3)


DESIGN LOADS
(FOR SIZE ABOVE OR SMALLER)
+ 110 PSF
- 150 PSF

APPLIES WHEN DESIGN LOAD
IS GREATER THAN ±117 PSF

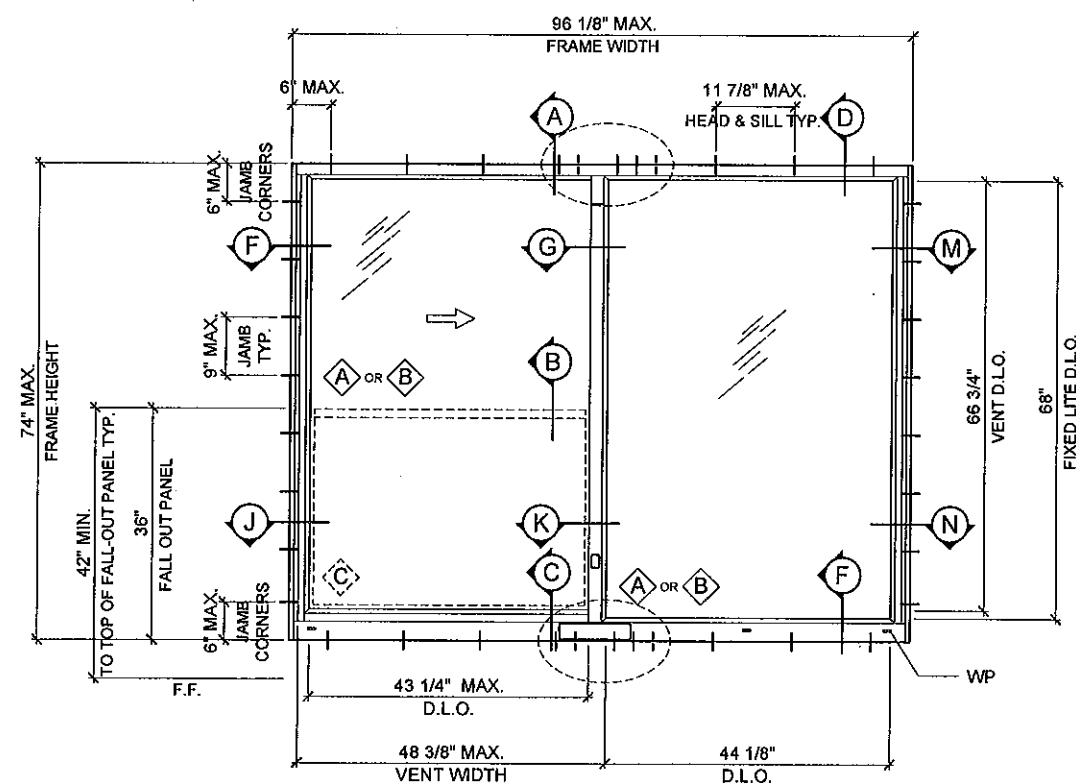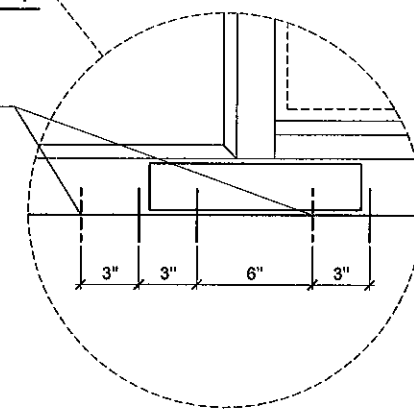

TYPICAL EXTERIOR ELEVATION E (XO)
(ELEVATION APPLY TO XO)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0513.01
Expiration Date 12/27/2012
By *Heather A. Allen*
Miami Dade Product Control
MIAMI DADE COUNTY

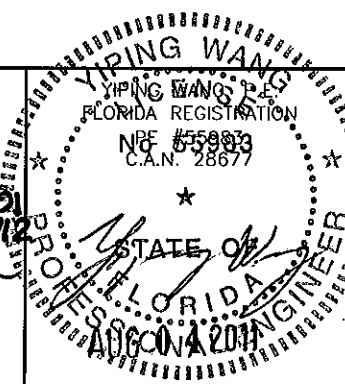


NO.	DATE	DESCRIPTION

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
9110 SW SUNSET DRIVE.
MIAMI, FL 33173
P: 305.271.0117
F: 786.573.5063
www.MCYEngineering.com
MCY.Engineering@Att.net


SERIES 2009 ALUM. HORIZONTAL ROLLING WINDOW - LMI
FLORIDA COASTAL IMPACT WINDOW L.L.C
940 W 84 STREET
HIALEAH, FL 33014
P: (305) 828-8254 F: (305) 828-8255

DATE	04/20/11
SCALE	AS SHOWN
DRAWN	S.L.
PROJECT	11-027


DRAWING NO.
AD11-11
2 OF 11

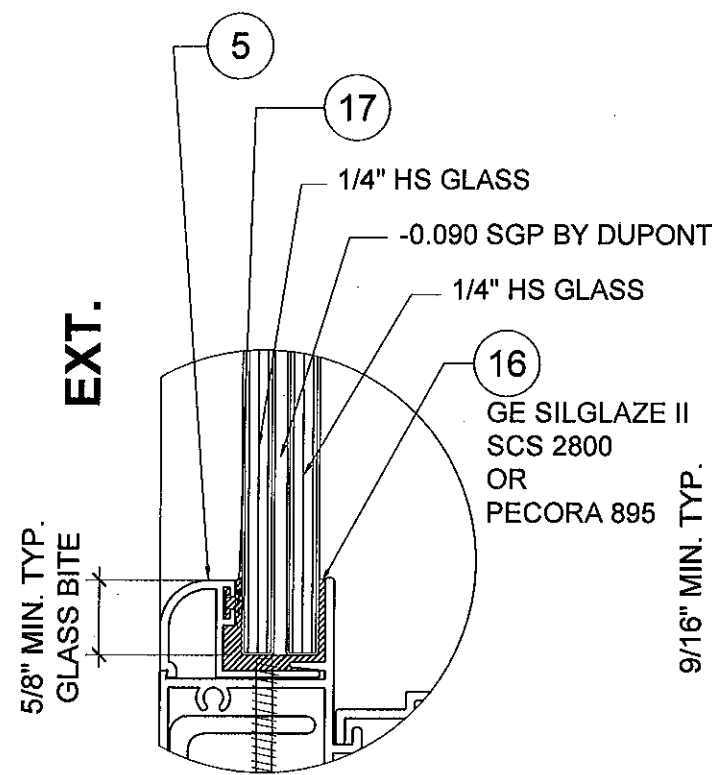


GLASS TYPE "A"
(FIXED PANEL SHOWN)

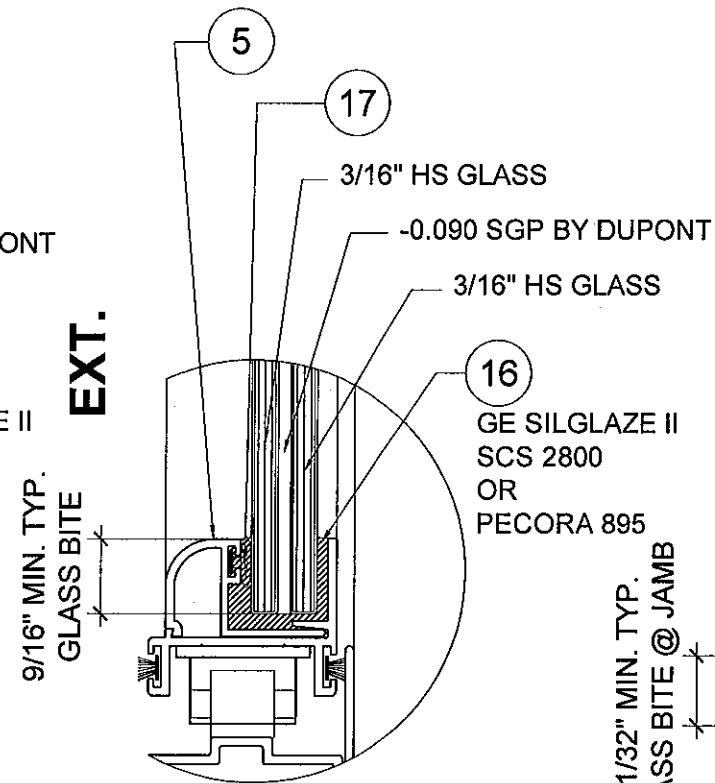

GLASS TYPE "B"
(MOVING PANEL SHOWN)

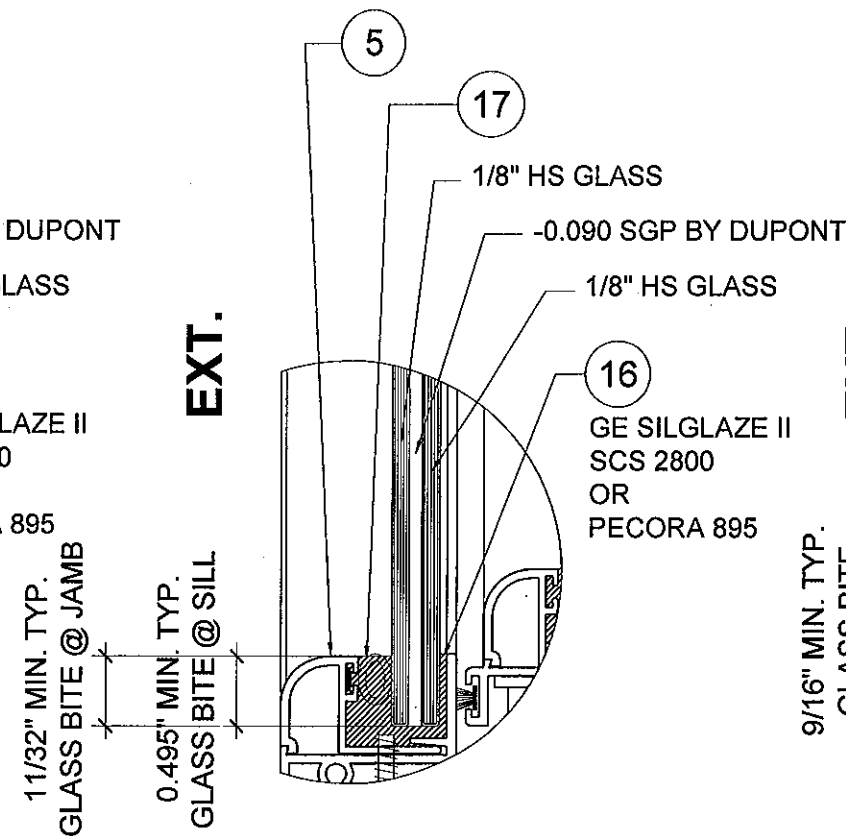

GLASS TYPE "C"
(FALL-OUT PANEL ONLY)

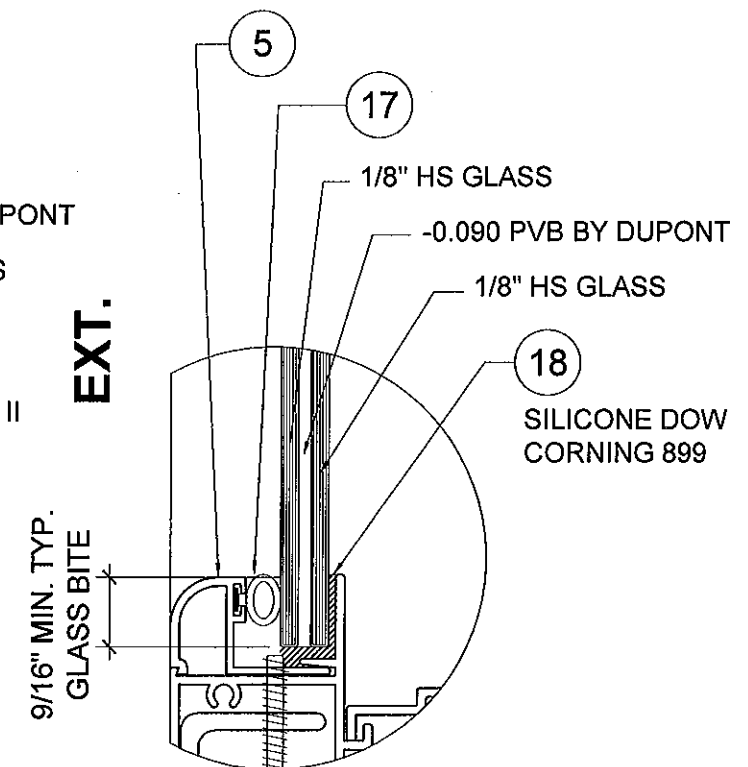

GLASS TYPE "D"
(FIXED PANEL SHOWN)

NOTE:

1. GLASS TYPE "A", "B" & "D" CAN BE USED AT FIXED PANEL OR MOVING PANEL
2. GLASS TYPE "B" MAX. AREA 36.5 FT ² (PANEL WIDTH * FRAME HEIGHT)
3. GLASS TYPE "A", "B" & "D" CANNOT BE USED ON FALLOUT PANELS
4. GLASS CAPACITIES ARE BASED ON ASTM E1300 - 04 (3 SEC. GUSTS)


PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 11-0513.01 Expiration Date 12/27/2012 By <i>Heather A. Miller</i> Miami Dade Product Control		DATE 04/20/11 SCALE AS SHOWN DRAWN S. L. PROJECT 11-027	
MIAMI DADE COUNTY		DRAWING NO. AD11-11	
3 OF 11		3 OF 11	

REVISIONS	NO.	DATE	DESCRIPTION


MCY ENGINEERING, INC.
GLAZING CONSULTANTS
9110 SW SUNSET DRIVE, P: 305.271.0117
MIAMI, FL 33173 F: 786.573.5063
www.MCYEngineering.com MCY.Engineering@Att.net

SERIES 2009 ALUM. HORIZONTAL ROLLING WINDOW - LMI
FLORIDA COASTAL IMPACT WINDOW L.L.C
940 W 84 STREET
HIALEAH, FL 33014
P: (305) 828-8254 F: (305) 828-8255

DATE	04/20/11
SCALE	AS SHOWN
DRAWN	S. L.
PROJECT	11-027
DRAWING NO.	AD11-11
	3 OF 11

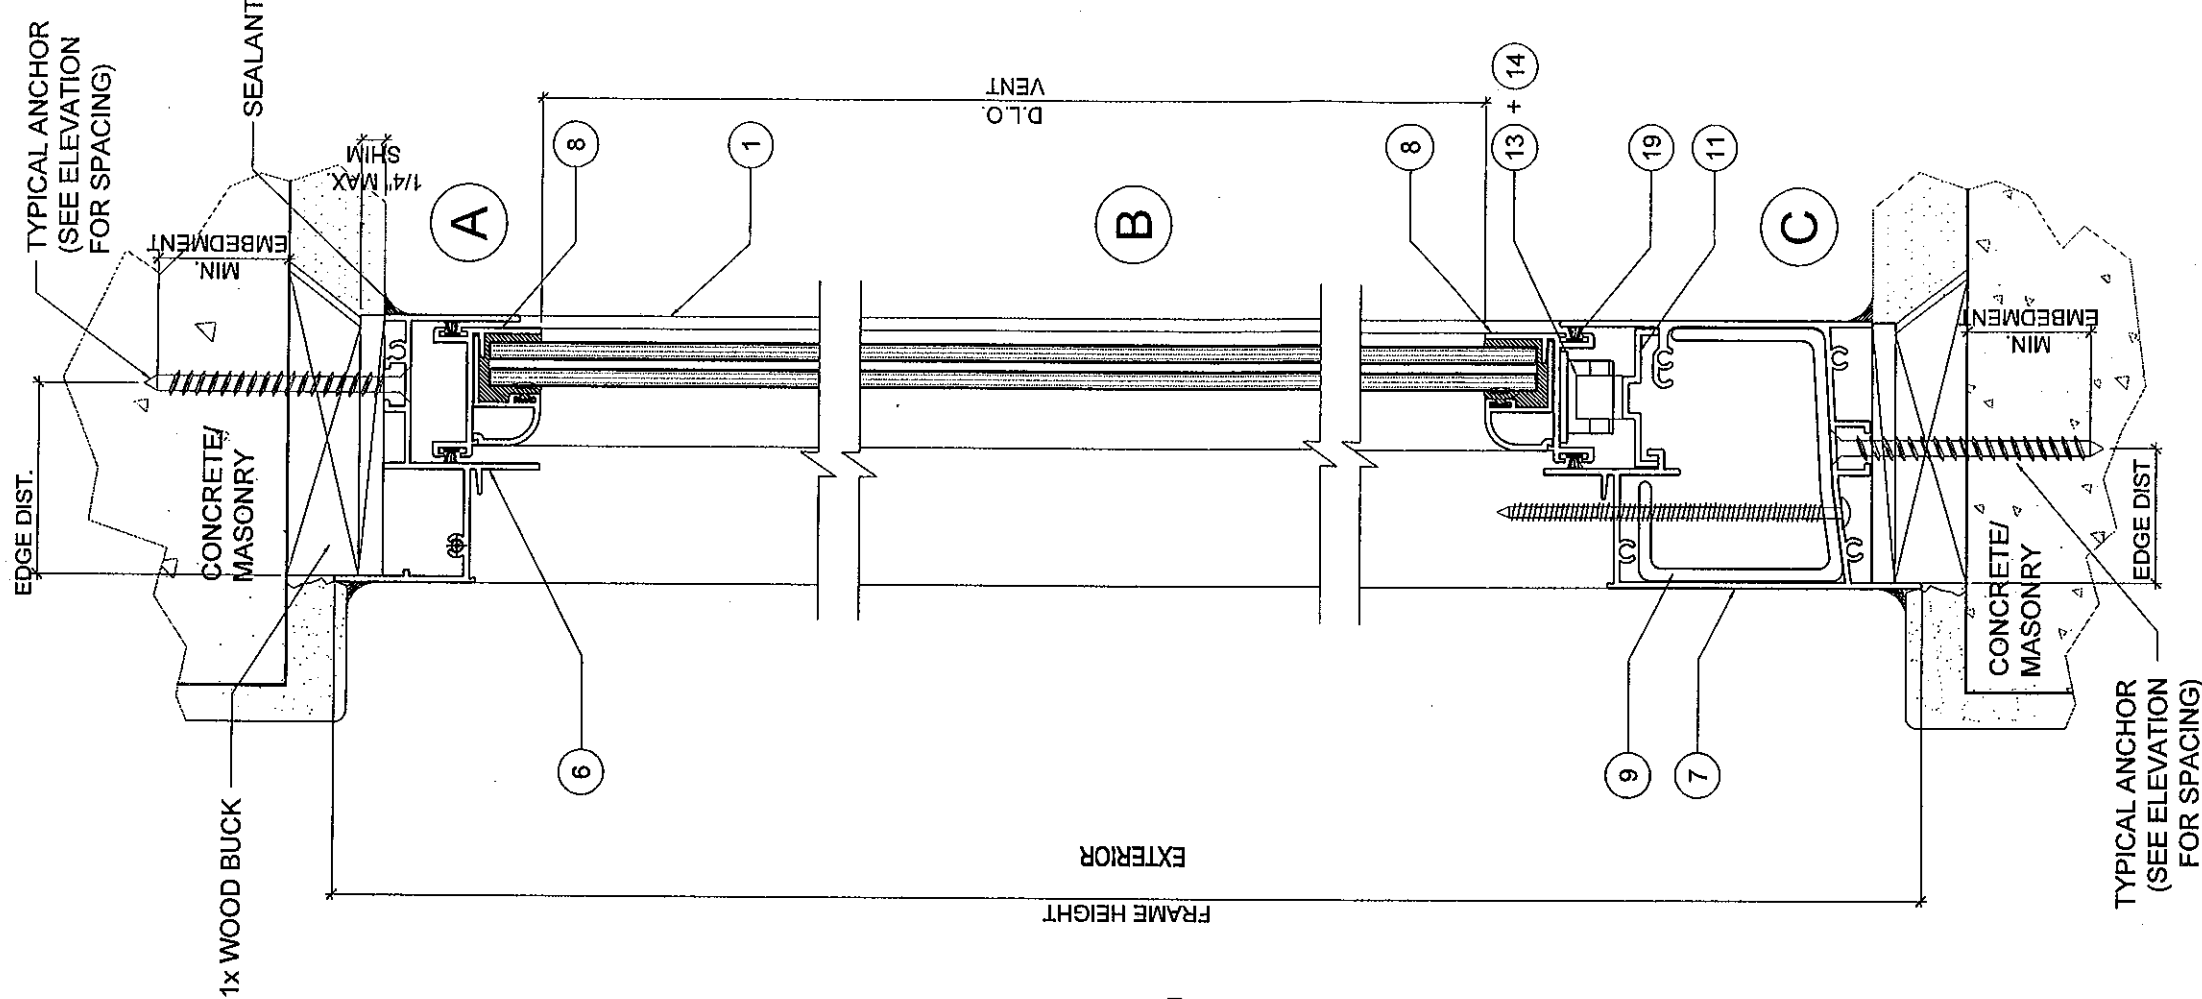

TYPICAL SECTION

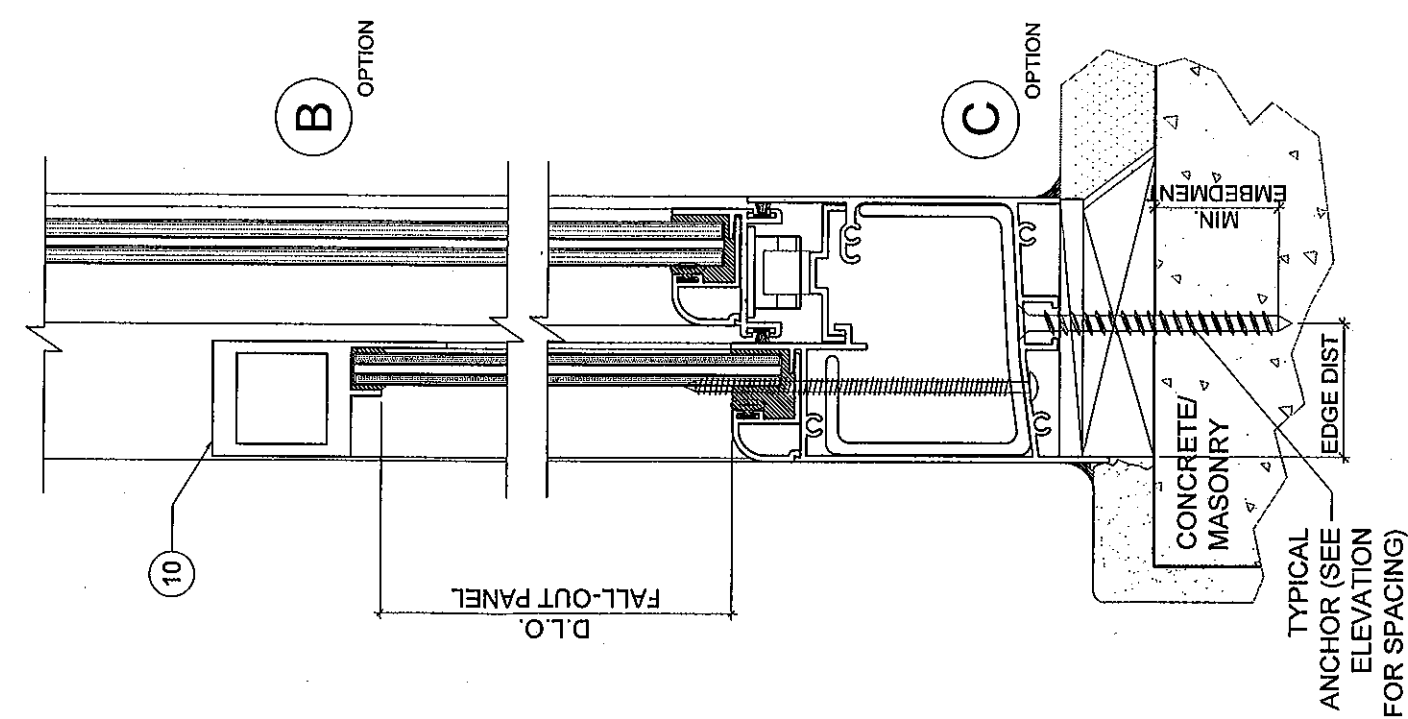

SECTION W. FALL-OUT PANEL
OPTIONAL

PRODUCT REVISED as complying with the Florida Building Code

Acceptance No. 11-0513-91

Expiration Date 12-12-2011

By: *Heidi A. Miller*
Miami Dade Product Control


MIAMI DADE COUNTY

YIPING WANG, P.E.
FLORIDA REGISTRATION
PE #55983
C.A.N. 28677




STATE OF FLORIDA
PROFESSIONAL ENGINEER
AUG 04 2011

REVISIONS		NO. DATE		DESCRIPTION	

MCY ENGINEERING, INC. GLAZING CONSULTANTS 9110 SW SUNSET DRIVE. P: 305.271.0117 MIAMI, FL 33173 F: 786.573.5063 www.MCYEngineering.com MCY.Engineering@Att.net		FLORIDA COASTAL IMPACT WINDOW L.L.C 940 W 84 STREET HIALEAH, FL 33014 P: (305) 828-8254 F: (305) 828-8255	
SERIES 2009 ALUM. HORIZONTAL ROLLING WINDOW - LMI		DRAWING NO. AD11-11	
DATE 04/20/11		SCALE AS SHOWN	
DRAWN S. L.		PROJECT 11-027	
4 OF 11			

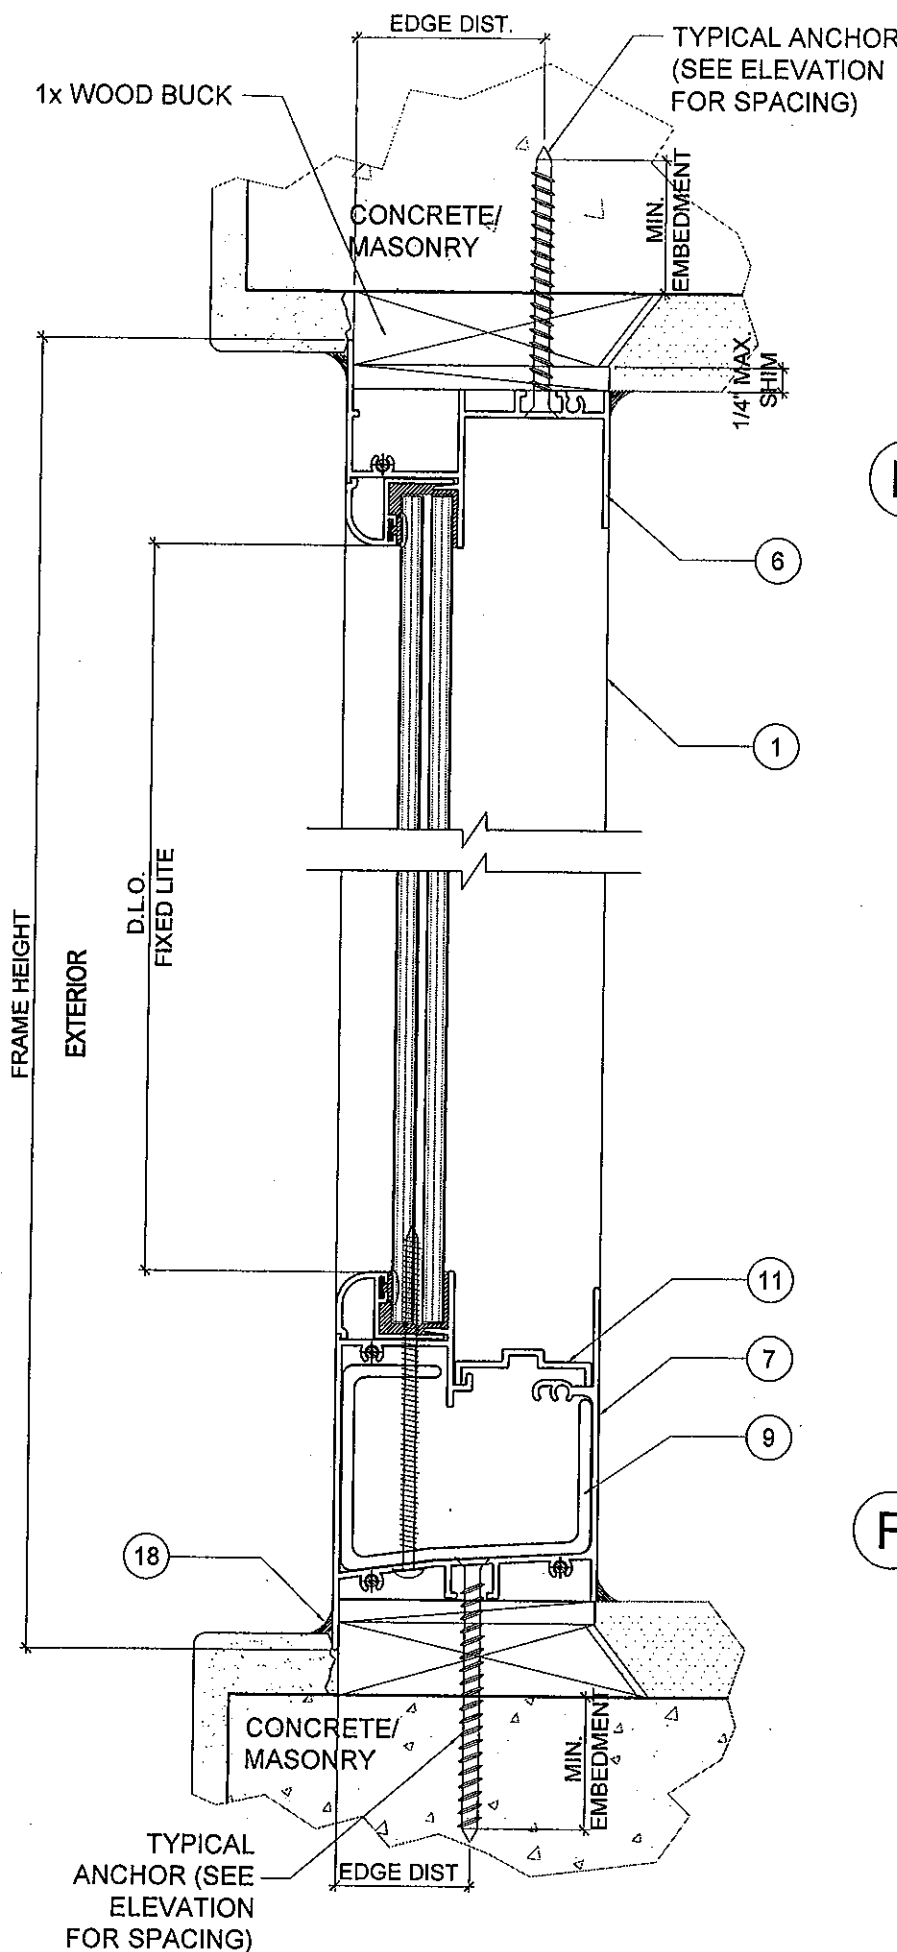

(D)

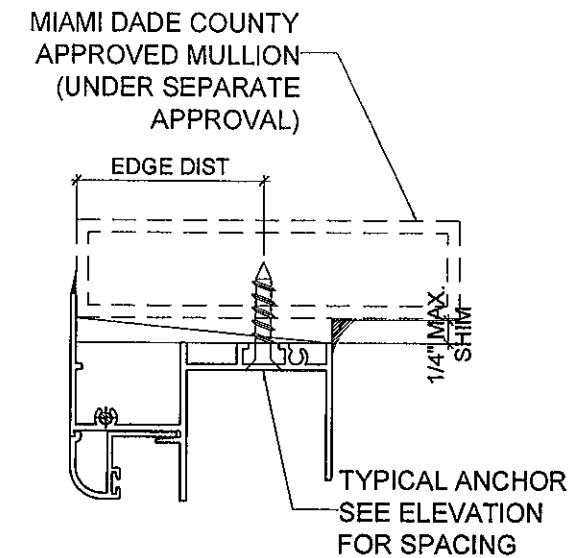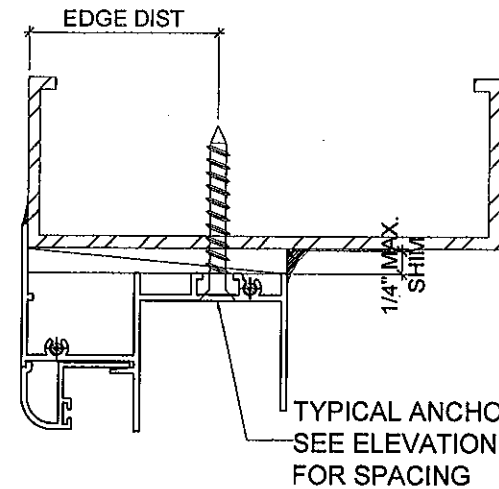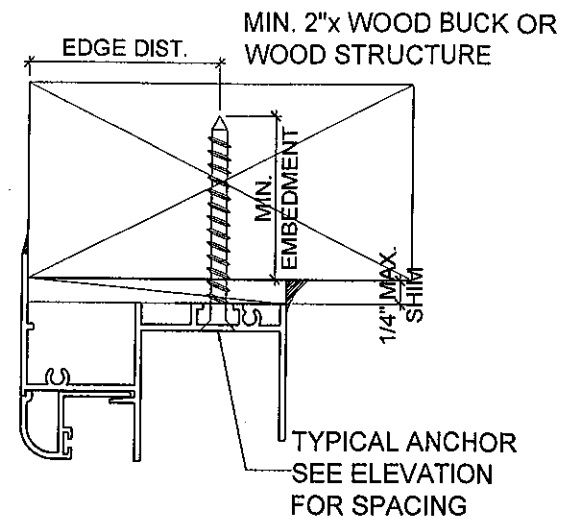

TYPICAL ANCHORS: (SEE ELEV. FOR SPACING)

- TYPE 'A' - **1/4" DIA. HILTI KWIK-CON II** ($F_u = 177 \text{ KSI}$, $F_y = 155 \text{ KSI}$)
- INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
1-1/2" MIN. PENETRATION INTO WOOD
 - THRU 1BY BUCKS INTO CONC. OR MASONRY
1-5/8" MIN. EMBED INTO CONC. OR MASONRY

TYPE 'B' - **1/4" DIA. TEKS OR SELF DRILLING SCREWS**

- INTO METAL STRUCTURES
STEEL : 1/8" MIN. ($F_y = 36 \text{ KSI MIN.}$)
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPE 'C' - **#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)**

- INTO APPROVED ALUMINUM MULLIONS MIN. 1/8" THK.

MASONRY

- ASTM C90 GROUT FILLED CONCRETE BLOCK
- HOLLOW CONCRETE BLOCK

CONCRETE

- $f'_c = 3,000 \text{ PSI MIN.}$

ANCHOR EDGE DISTANCES

- INTO CONCRETE AND MASONRY = 1-3/8" MIN.
- INTO WOOD STRUCTURE = 1" MIN.
- INTO METAL STRUCTURE = 3/4" MIN.

ALL ANCHOR OPTIONS CAN APPLY TO HEAD, SILL AND JAMB ANCHORS.

WEEPHOLES (WP):

1-1/2" x 1/4" WEEPHOLE WITH NYLON BAFFLE @ FRAME SILL ON EXTERIOR 1 PER PANEL. 3-1/4" FROM FRAME CORNER AND ONE AT MIDDLE OF CENTER PANEL.

SEALANT (REFER TO SHEET 8 OF 11):

PERIMETER OF FRAME ON THE INTERIOR, FRAME CORNERS, GLAZING BEAD SEAMS AT EACH END, FIXED MEETING RAIL AT EACH END, INSTALLATION FASTENERS AT FRAME SILL & EACH END OF FRAME SILL TRACK.

HARDWARE:

ELEVATION A & B

(4) SURFACE MOUNT METALLIC CAM LOCKS @ 10 1/4" FROM EACH END LOCATED AT VENT LOCK RAILS


(4) TANDEM METALLIC WHEELS IN PLASTIC HOUSING @ 2 1/4" FROM EACH END LOCATED AT VENT BOTTOM

ELEVATION C, D & E

(2) SURFACE MOUNT METALLIC CAM LOCKS AT VENT MEETING RAIL ONE AT EACH VENT @ 34 1/4" FROM BOTTOM.


(4) TANDEM METALLIC WHEELS IN NYLON HOUSING ONE AT EACH END OF EACH VENT BOTTOM RAILS

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0513-01
Expiration Date 12/27/2012
By *[Signature]*
Miami Dade Product Control

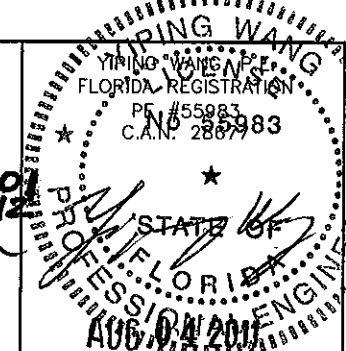

MIAMI DADE COUNTY

NO.	DATE	DESCRIPTION



MCY ENGINEERING, INC.

GLAZING CONSULTANTS

9110 SW SUNSET DRIVE P: 305.271.0117
MIAMI, FL 33173 F: 786.573.5063


www.MCYEngineering.com MCY.Engineering@Att.net

SERIES 2009 ALUM. HORIZONTAL ROLLING WINDOW - LMI

FLORIDA COASTAL IMPACT WINDOW L.L.C

940 W 84 STREET
HIALEAH, FL 33014
P: (305) 828-8254 F: (305) 828-8255


DATE	04/20/11
SCALE	AS SHOWN
DRAWN	S. L.
PROJECT	11-027
DRAWING NO.	AD11-11
5 OF 11	

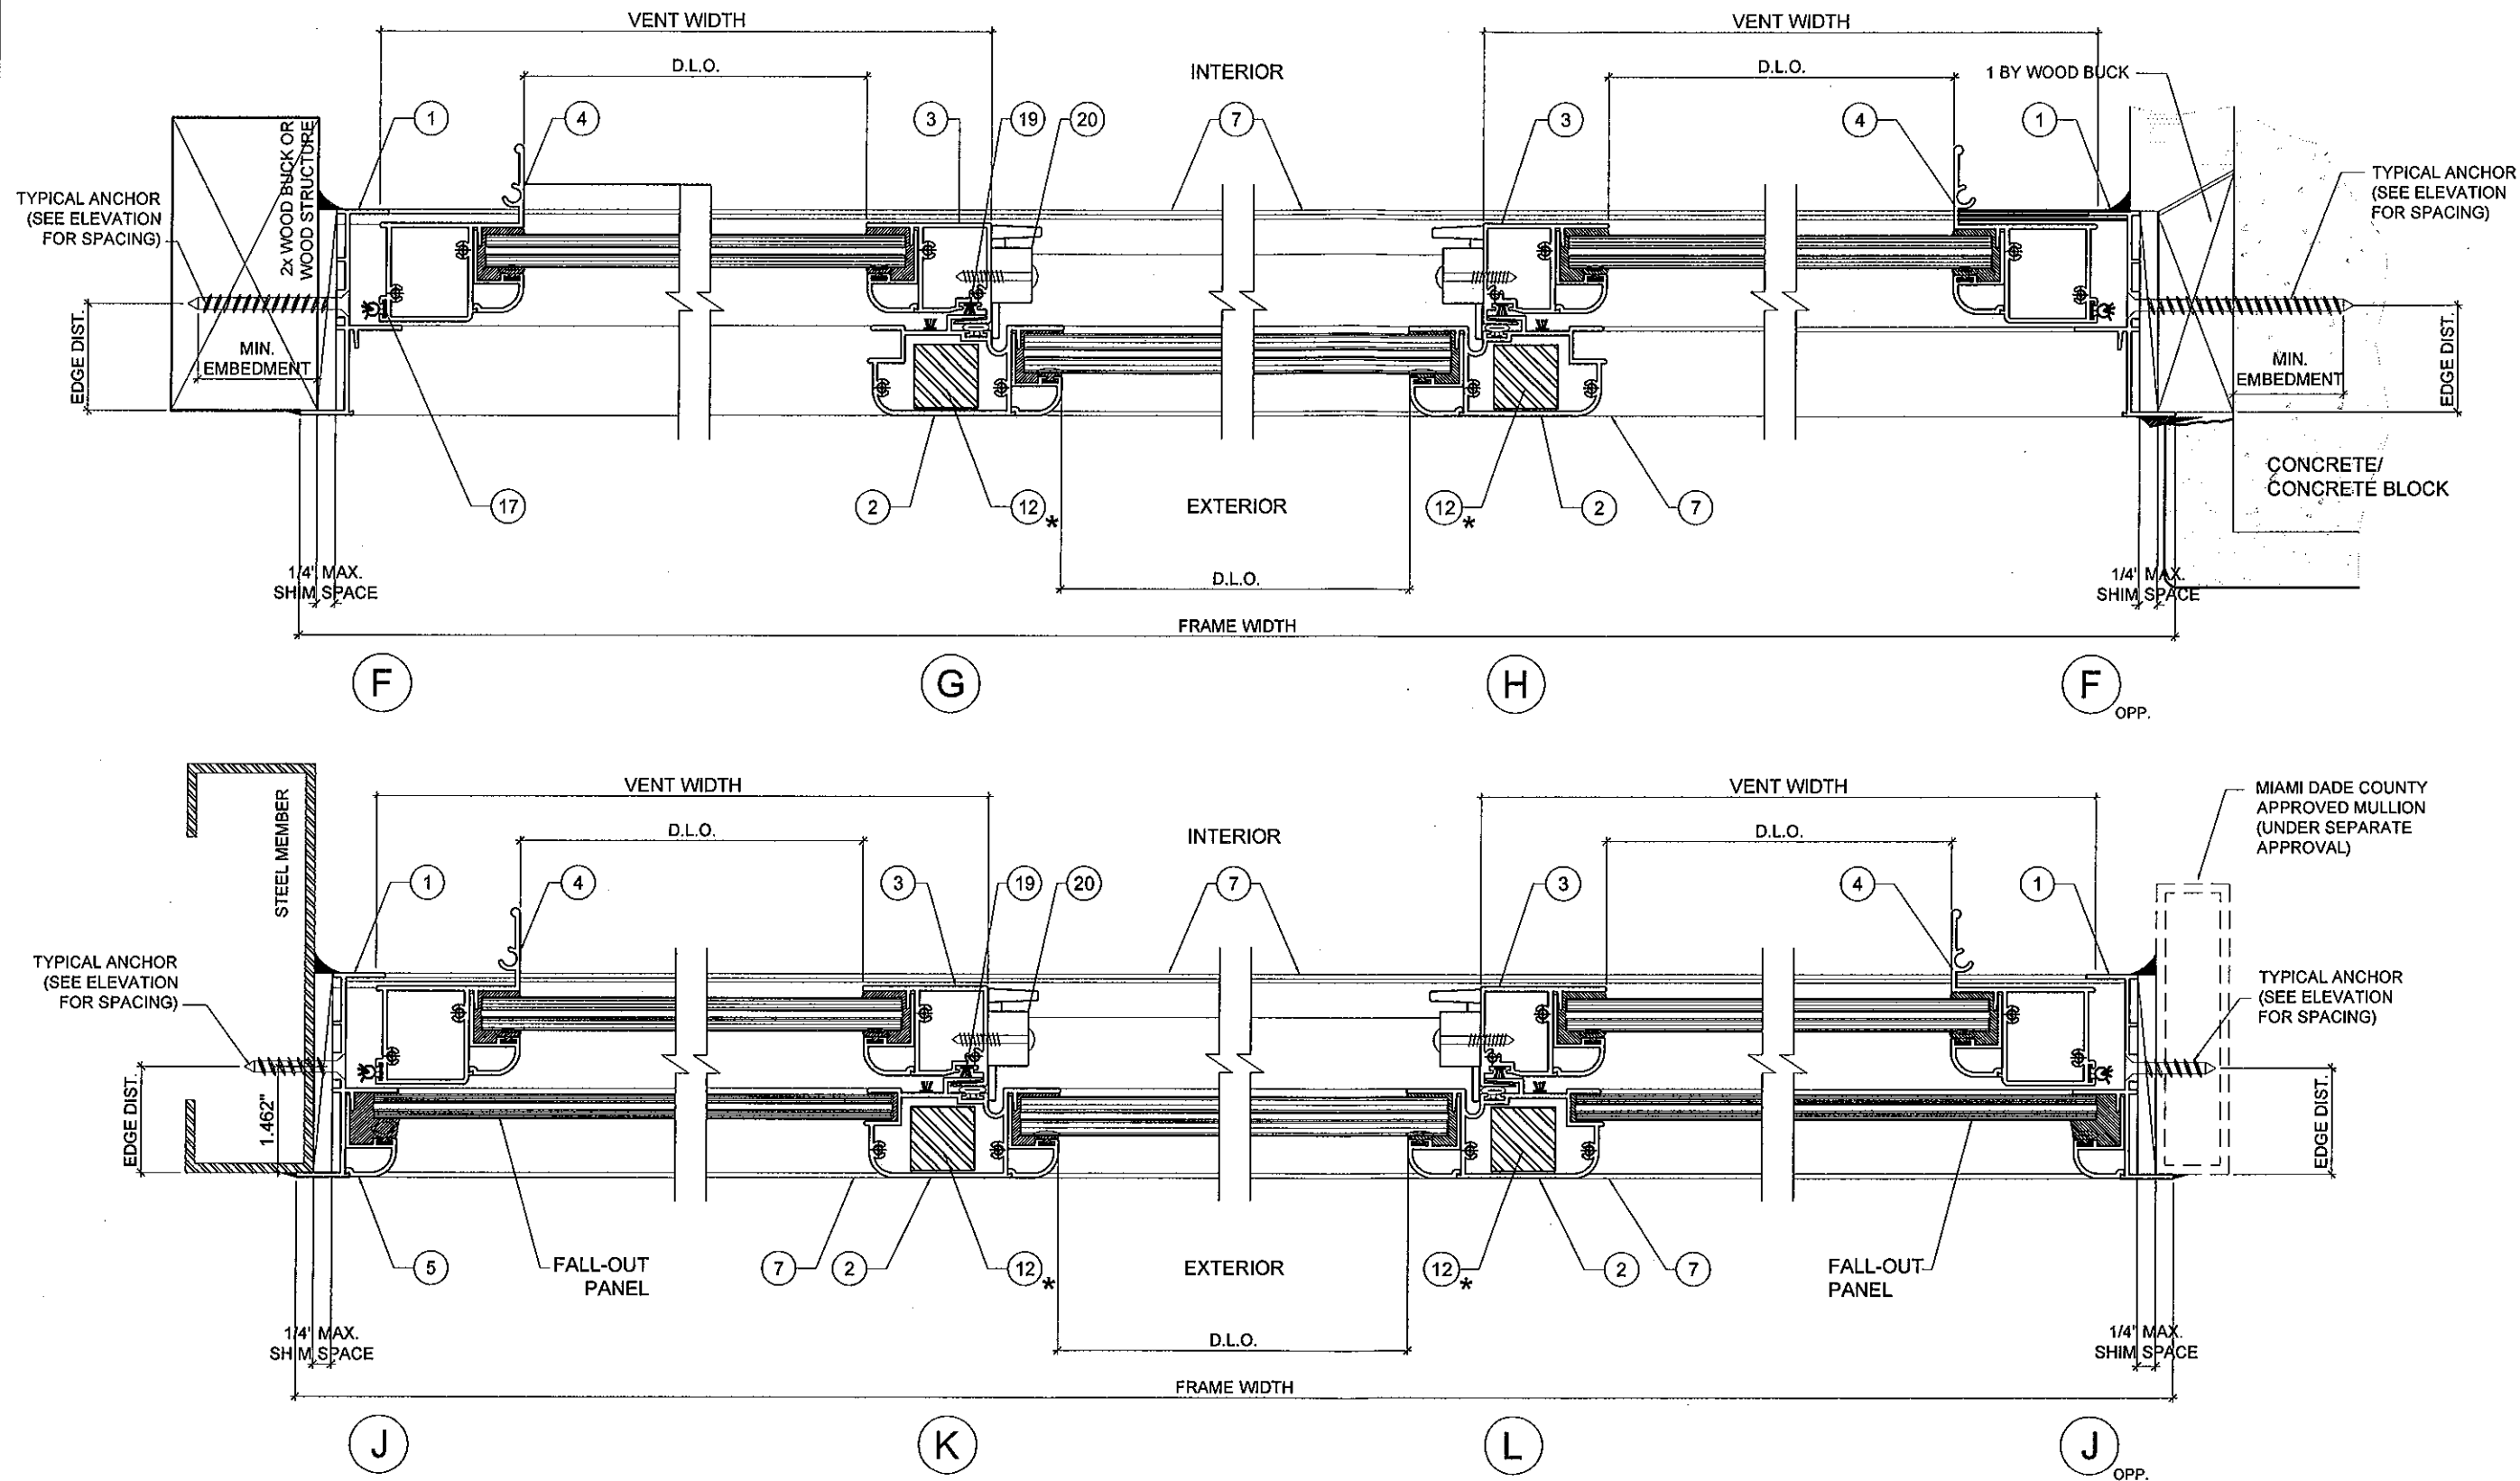

* REINFORCEMENT APPLIED FOR
ELEVATION C, D & E ONLY

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0513.01
Expiration Date 12/27/2012
By *[Signature]*
Miami Dade Product Control

MIAMI DADE COUNTY

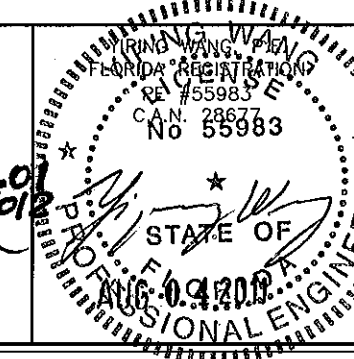

DATE	04/20/11
SCALE	AS SHOWN
DRAWN	S. L.
PROJECT	11-027

DRAWING NO.
AD11-11

6 OF 11


SERIES 2009 ALUM. HORIZONTAL ROLLING WINDOW - LMI
FLORIDA COASTAL IMPACT WINDOW L.L.C

940 W 84 STREET
HIALEAH, FL 33014
P: (305) 828-8254 F: (305) 828-8255



MCY ENGINEERING, INC.
GLAZING CONSULTANTS

9110 SW SUNSET DRIVE.
MIAMI, FL 33173
P: 305.271.0117
F: 786.573.5063



www.MCYEngineering.com MCY.Engineering@Att.net



REVISIONS	DESCRIPTION
NO	DATE

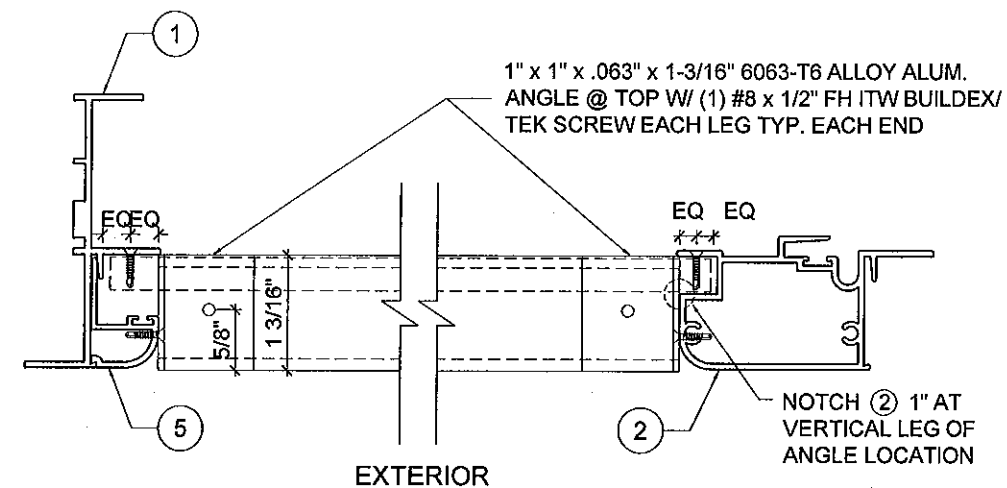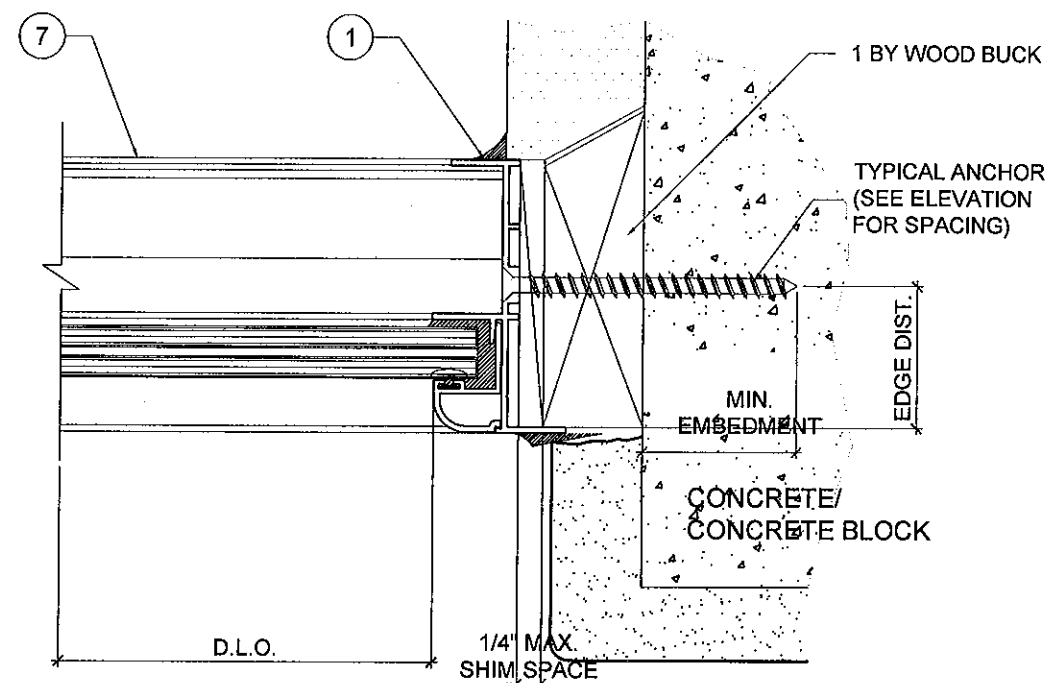

TOP RAIL @ FALL-OUT
PANEL PLAN VIEW

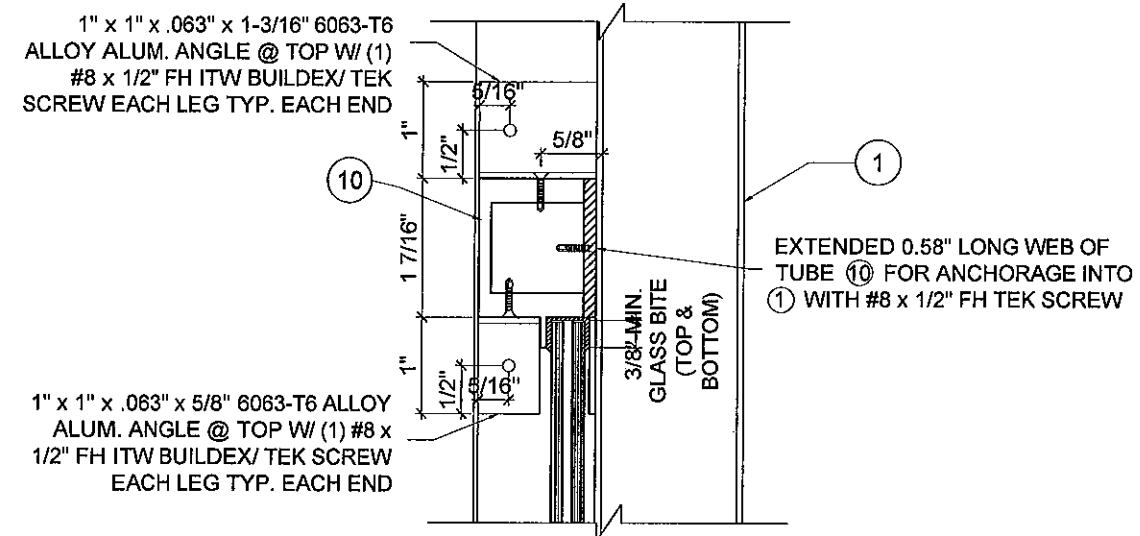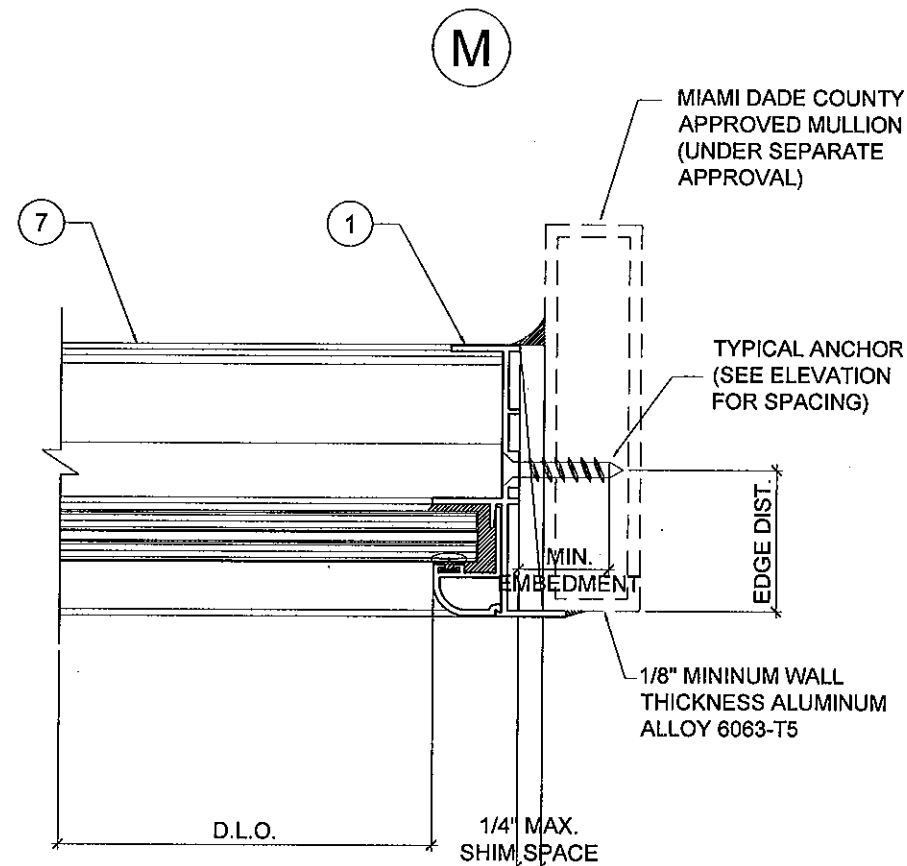

TOP RAIL @ FALL-OUT
PANEL SECTION VIEW

* NOTE: FALL-OUT PANEL IS REQ'D WHEN SILL
ELEVATION IN RESPECT TO THE NEAR SIDE
WALKING SURFACE IS LESS THAN 42".
(SEE DETAIL ON SHEET 9 OF 11)

* REINFORCEMENT APPLIED FOR
ELEVATION C, D & E ONLY

[illegible]

MCY ENGINEERING, INC.
GLAZING CONSULTANTS

9110 SW SUNSET DRIVE. P: 305.271.0117
MIAMI, FL 33173 F: 786.573.5063

 www.MCYEngineering.com MCY.Engineering@Att.net

SERIES 2009 ALUM. HORIZONTAL ROLLING WINDOW - LMI

FLORIDA COASTAL IMPACT WINDOW L.L.C

940 W 84 STREET
HIALEAH, FL 33014

P: (305) 828-8254 F: (305) 828-8255

DATE	04/20/11
SCALE	AS SHOWN
DRAWN	S. L.
PROJECT	11-027
DRAWING NO.	
AD11-11	


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 11-0513.91
Expiration Date 12/27/2012
By *H. L. ...*
Miami Dade Product Control

71
12


WAPPING WANG
FLORIDA REGISTRATION
PE #55983
C.A.N. 28677

★ ★


STATE OF
FLORIDA
AUG 04 2011

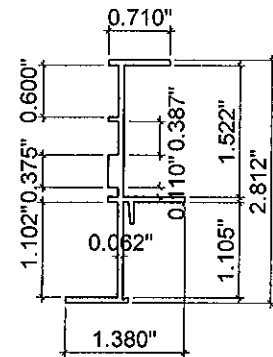


1 FRAME JAMB
FSP 014 6063-T6

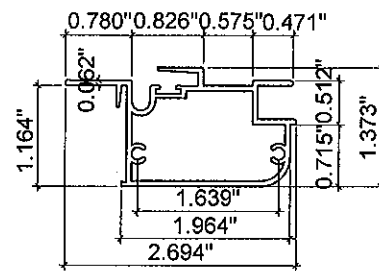


2 FIXED MEETING STILE
FSP 041 6063-T6




3 SASH MEETING STILE
FSP 018 6063-T6

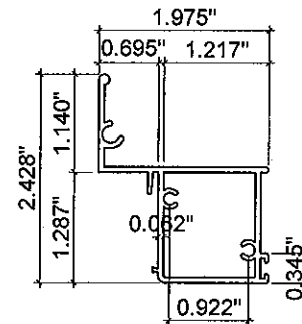


4 SASH TILE
FSP 020 6063-T6




5 GLAZING BEAD
FSP 017 6063-T6

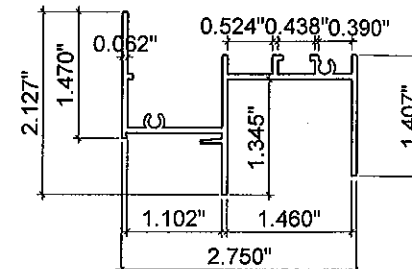


6 FRAME HEAD
FSP 015 6063-T6

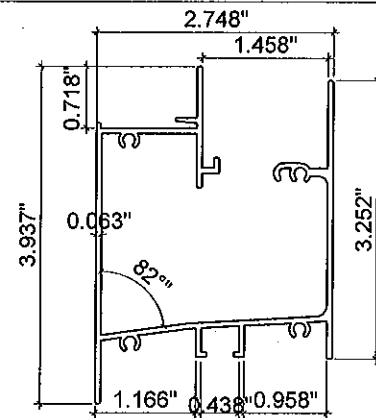


7 FRAME SILL
FSP 039 6063-T6




8 SASH TOP & BOTTOM RAIL
FSP 045 6063-T6

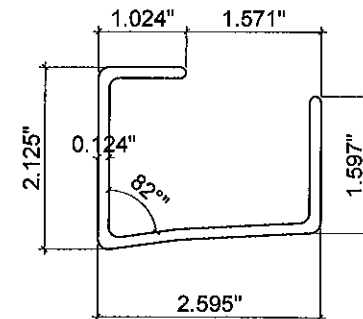


9 ROTATING CLIP, 12" LONG
FSP 055 6063-T6

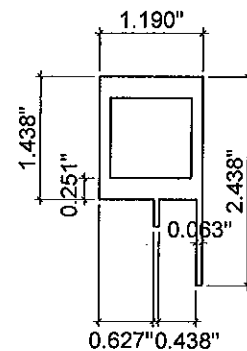

10 FALL OUT PANEL TOP RAIL
FSP 014 6063-T6



11 INSERT TRACK
FSP 017 6063-T6



12 REINFORCEMENT FOR 2" CONT.
STEEL ASTM A-36 ZINC PLATED

BILL OF MATERIALS

ITEM #	QTY.	PROFILE	DESCRIPTION	MATERIAL	MANUFACTURER/ REMARKS
1	2 PER FRAME	FSP 014	FRAME JAMB	ALUM. 6063-T6	--
2	1 PER VENT	FSP 041	FIXED MEETING STILE	ALUM. 6063-T6	--
3	1 PER VENT	FSP 018	SASH MEETING STILE	ALUM. 6063-T6	--
4	1 PER VENT	FSP 020	SASH STILE	ALUM. 6063-T6	--
5	AS REQD.	FSP 017	GLAZING BEAD	ALUM. 6063-T6	--
6	1 PER PANEL	FSP 015	FRAME HEAD	ALUM. 6063-T6	--
7	1 PER PANEL	FSP 039	FRAME SILL	ALUM. 6063-T6	--
8	2 PER PANEL	FSP 045	SASH TOP & BOTTOM RAIL	ALUM. 6063-T6	--
9	1 PER PANEL	FSP 055	ROTATING CLIP (12" LONG)	ALUM. 6063-T6	--
10	1 PER F.O.P.	-	FALL OUT PANEL TOP RAIL	ALUM. 6063-T6	--
11	1 PER VENT	-	INSERT TRACK	ALUM. 6063-T6	--
12	AS REQD.	-	INSERT FOR FIXED MEETING STILE CONT.	STEEL	Fy = 36 ksi
13	AS REQD.	-	ROLLER HOUSING	NYLON	--
14	4 PER SASH	-	WHEELS (7/16" DIAMETER LONG)	--	2 1/4" FROM EACH END OF VENT BOTTOM RAIL WITH #8 PH SDS
15	AS REQD.	FSP 016	LATCH LOCK (CAM LOCK)	ZINC ALLOY	ATTACHED WITH (2) #8 x 1" FH SMS
16	AS REQD.	STRUCTURAL SILICONE	GE SCS2800 OR PECORA 885	SILICONE	--
17	AS REQD.	-	VINYL BULB WITH MULTI FLAP	--	DUROMETER SHORE A 84
18	AS REQD.	STRUCTURAL SILICONE	DOW CORNING 889	SILICONE	DOW CORNING
19	AS REQD.	GASKET	5/16" DIAMETER ADHESIVE SPONGE GASKET	--	--

MCY ENGINEERING, INC.


GLAZING CONSULTANTS
9110 SW SUNSET DRIVE P: 305.271.0117
MIAMI, FL 33173 F: 786.573.5063
www.MCYEngineering.com MCY.Engineering@Att.net

SERIES 2009 ALUM. HORIZONTAL ROLLING WINDOW - LMI


FLORIDA COASTAL IMPACT WINDOW L.L.C.

940 W 84 STREET
HIALEAH, FL 33014
P: (305) 828-8254 F: (305) 828-8255


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 11-0513-01
Expiration Date 12/27/2012
By *Heather A. Allen*
Miami Dade Product Control

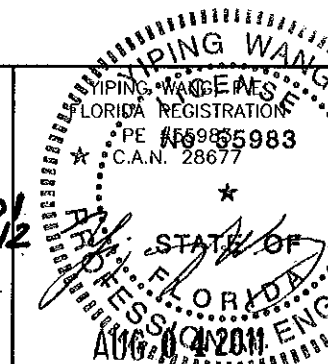

DATE	04/20/11
SCALE	AS SHOWN
DRAWN	S. L.
CHECKED	11-027
DRAWING NO.	AD11-11
SHEET NO.	8 OF 11

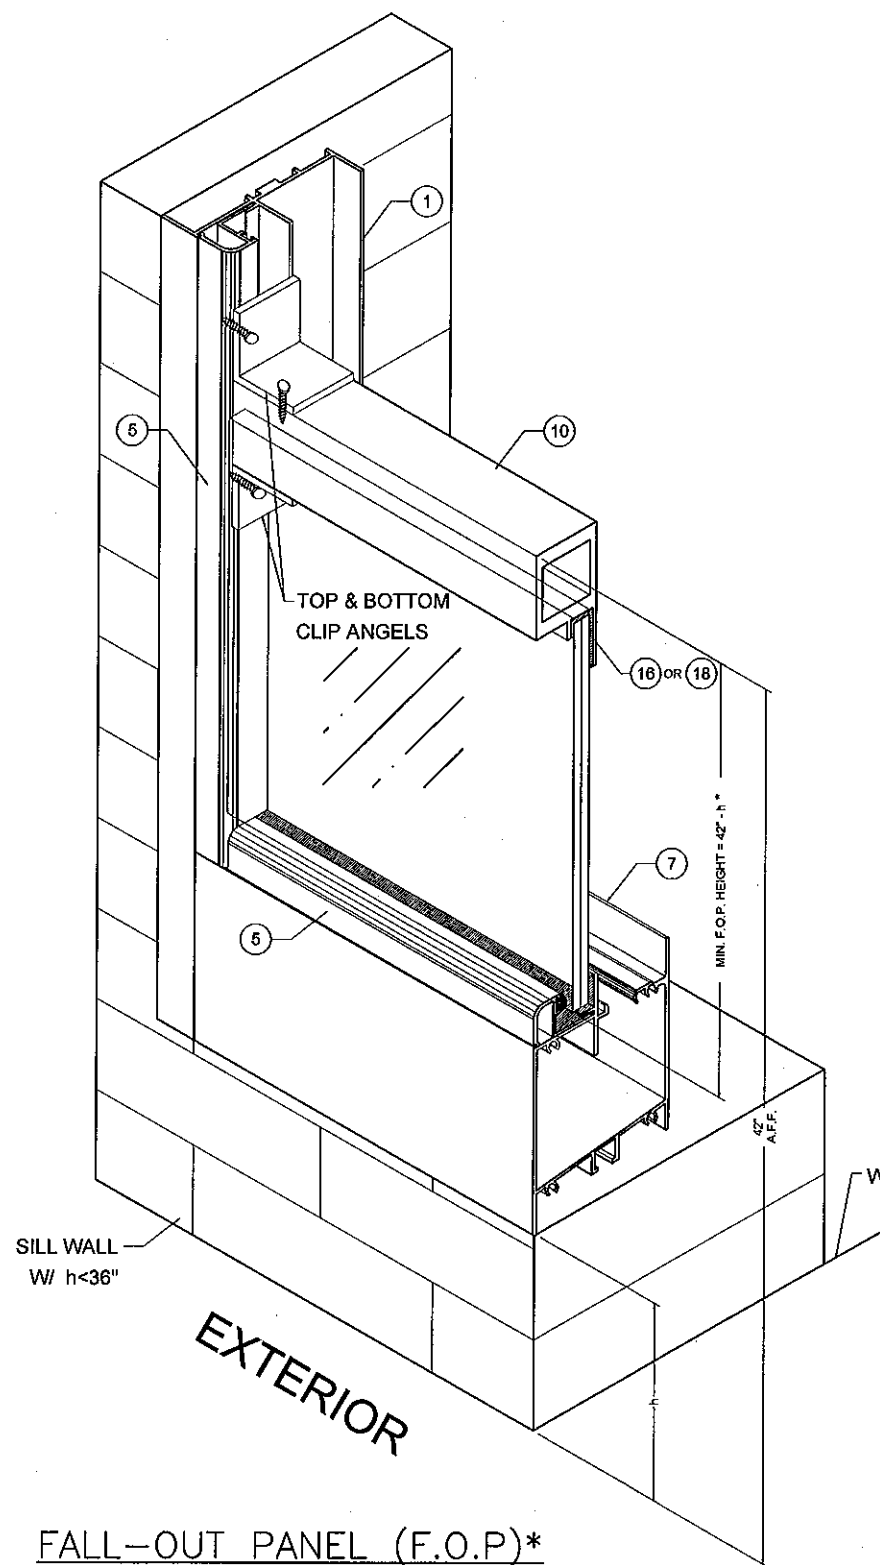

THE NEAR SIDE WALKING SURFACE F.F.

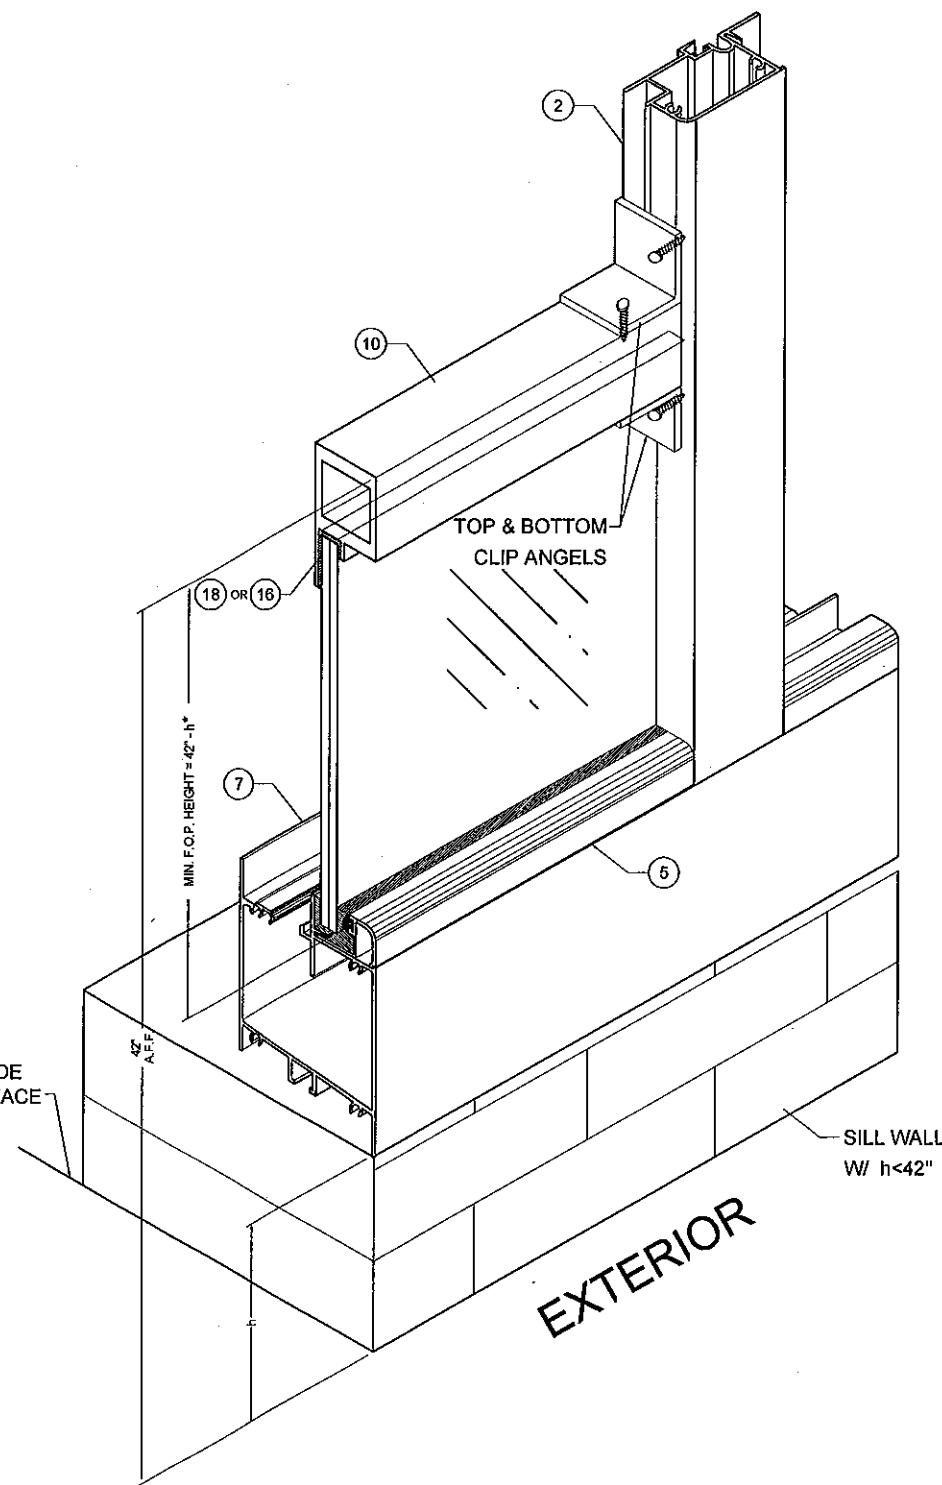


ONLY F.O.P. ASSEMBLY IS SHOWN, REMAINING COMPONENTS OF WINDOW SILL NOT SHOWN FOR CLARITY.

* NOTE: FALL-OUT PANEL IS REQ'D WHEN SILL ELEVATION IN RESPECT TO THE NEAR SIDE WALKING SURFACE IS LESS THAN 42". (SEE DETAIL ON SHEET 7 OF 11)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0513-01
Expiration Date 12/27/2012

MIAMI DADE COUNTY

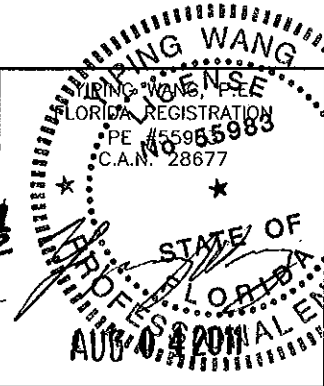

SERIES 2009 ALUM. HORIZONTAL ROLLING WINDOW - LMI
FLORIDA COASTAL IMPACT WINDOW L.L.C.
940 W 84 STREET
HIALEAH, FL 33014
P: (305) 828-8254 F: (305) 828-8255

DATE 04/20/11
SCALE AS SHOWN
BY S. L.
PROJECT 11-027


DRAWING NO. AD11-11

9 OF 11


REVISIONS	NO.	DATE	DESCRIPTION

MCY

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
9110 SW SUNSET DRIVE P: 305.271.0117
MIAMI, FL 33173 F: 786.573.5063
www.MCYEngineering.com MCY.Engineering@Att.net

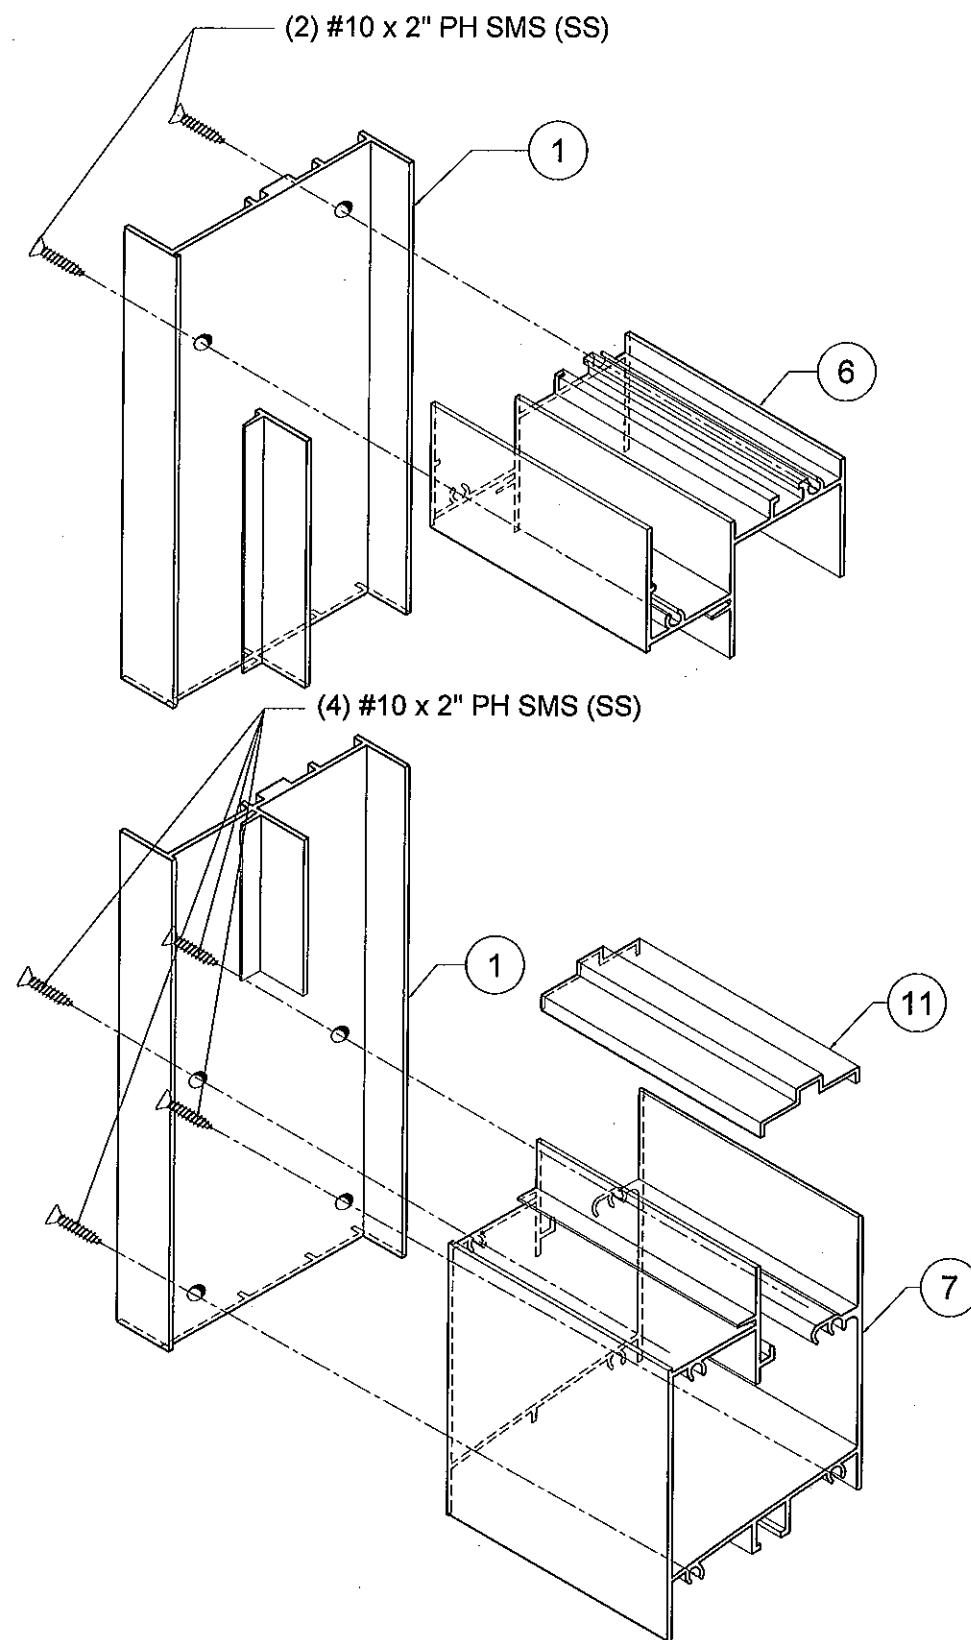

**JAMB CONNECTION
TO FRAME HEAD & SILL**

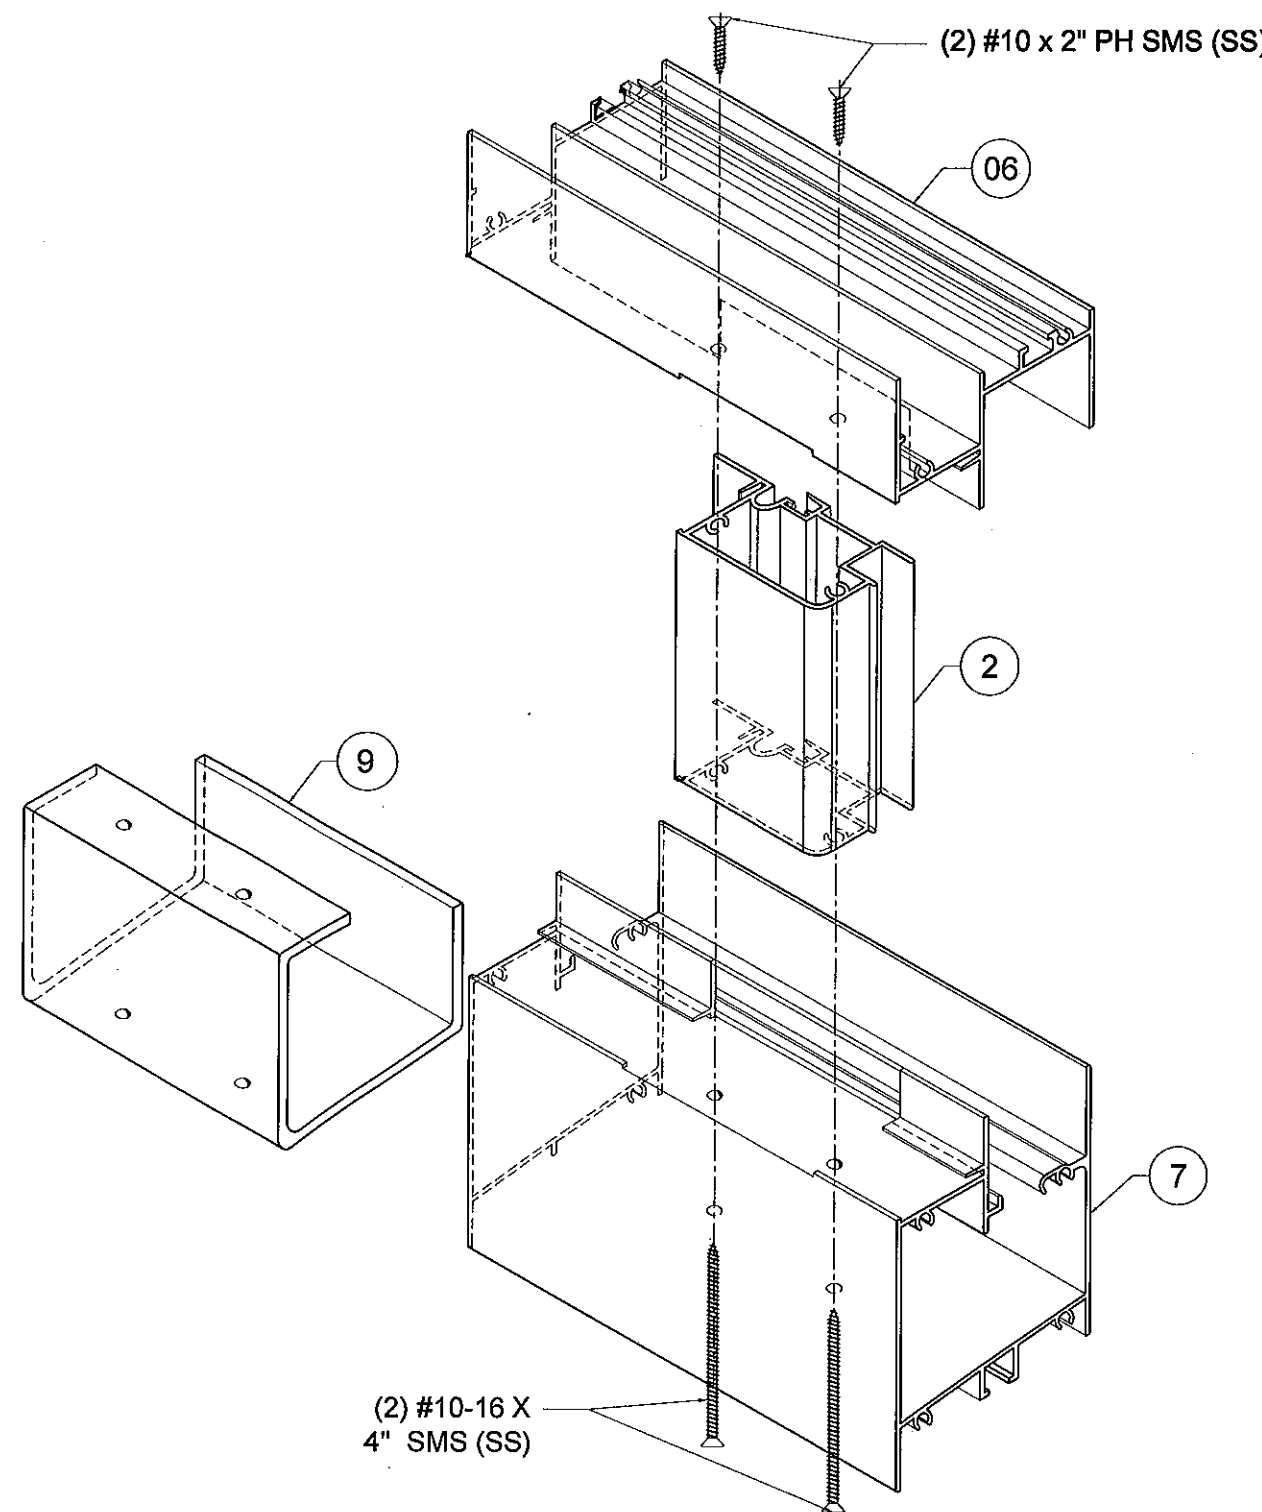


**MEETING RAIL CONNECTION
TO FRAME HEAD & SILL**

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 11-0513.01 Expiration Date 12/27/2012 By <i>[Signature]</i> Miami Dade Product Control		YIPING WANG YIPING WANG, S.P.E. FLORIDA REGISTRATION No. 55883 C.A.N. 28677 STATE OF FLORIDA PROFESSIONAL ENGINEER 04/2011
MIAMI DADE COUNTY		DATE 04/20/11 SCALE AS SHOWN DRAWN S. L. PROJECT 11-027 DRAWING NO. AD11-11 10 OF 11

REVISIONS	
NO.	DATE DESCRIPTION


MCY ENGINEERING, INC. GLAZING CONSULTANTS 9110 SW SUNSET DRIVE MIAMI, FL 33173 P: 305.271.0117 F: 786.573.5063 www.MCYEngineering.com MCY.Engineering@Att.net	
SERIES 2009 ALUM. HORIZONTAL ROLLING WINDOW - LMI FLORIDA COASTAL IMPACT WINDOW L.L.C. 940 W 84 STREET HIALEAH, FL 33014 P: (305) 828-8254 F: (305) 828-8255	

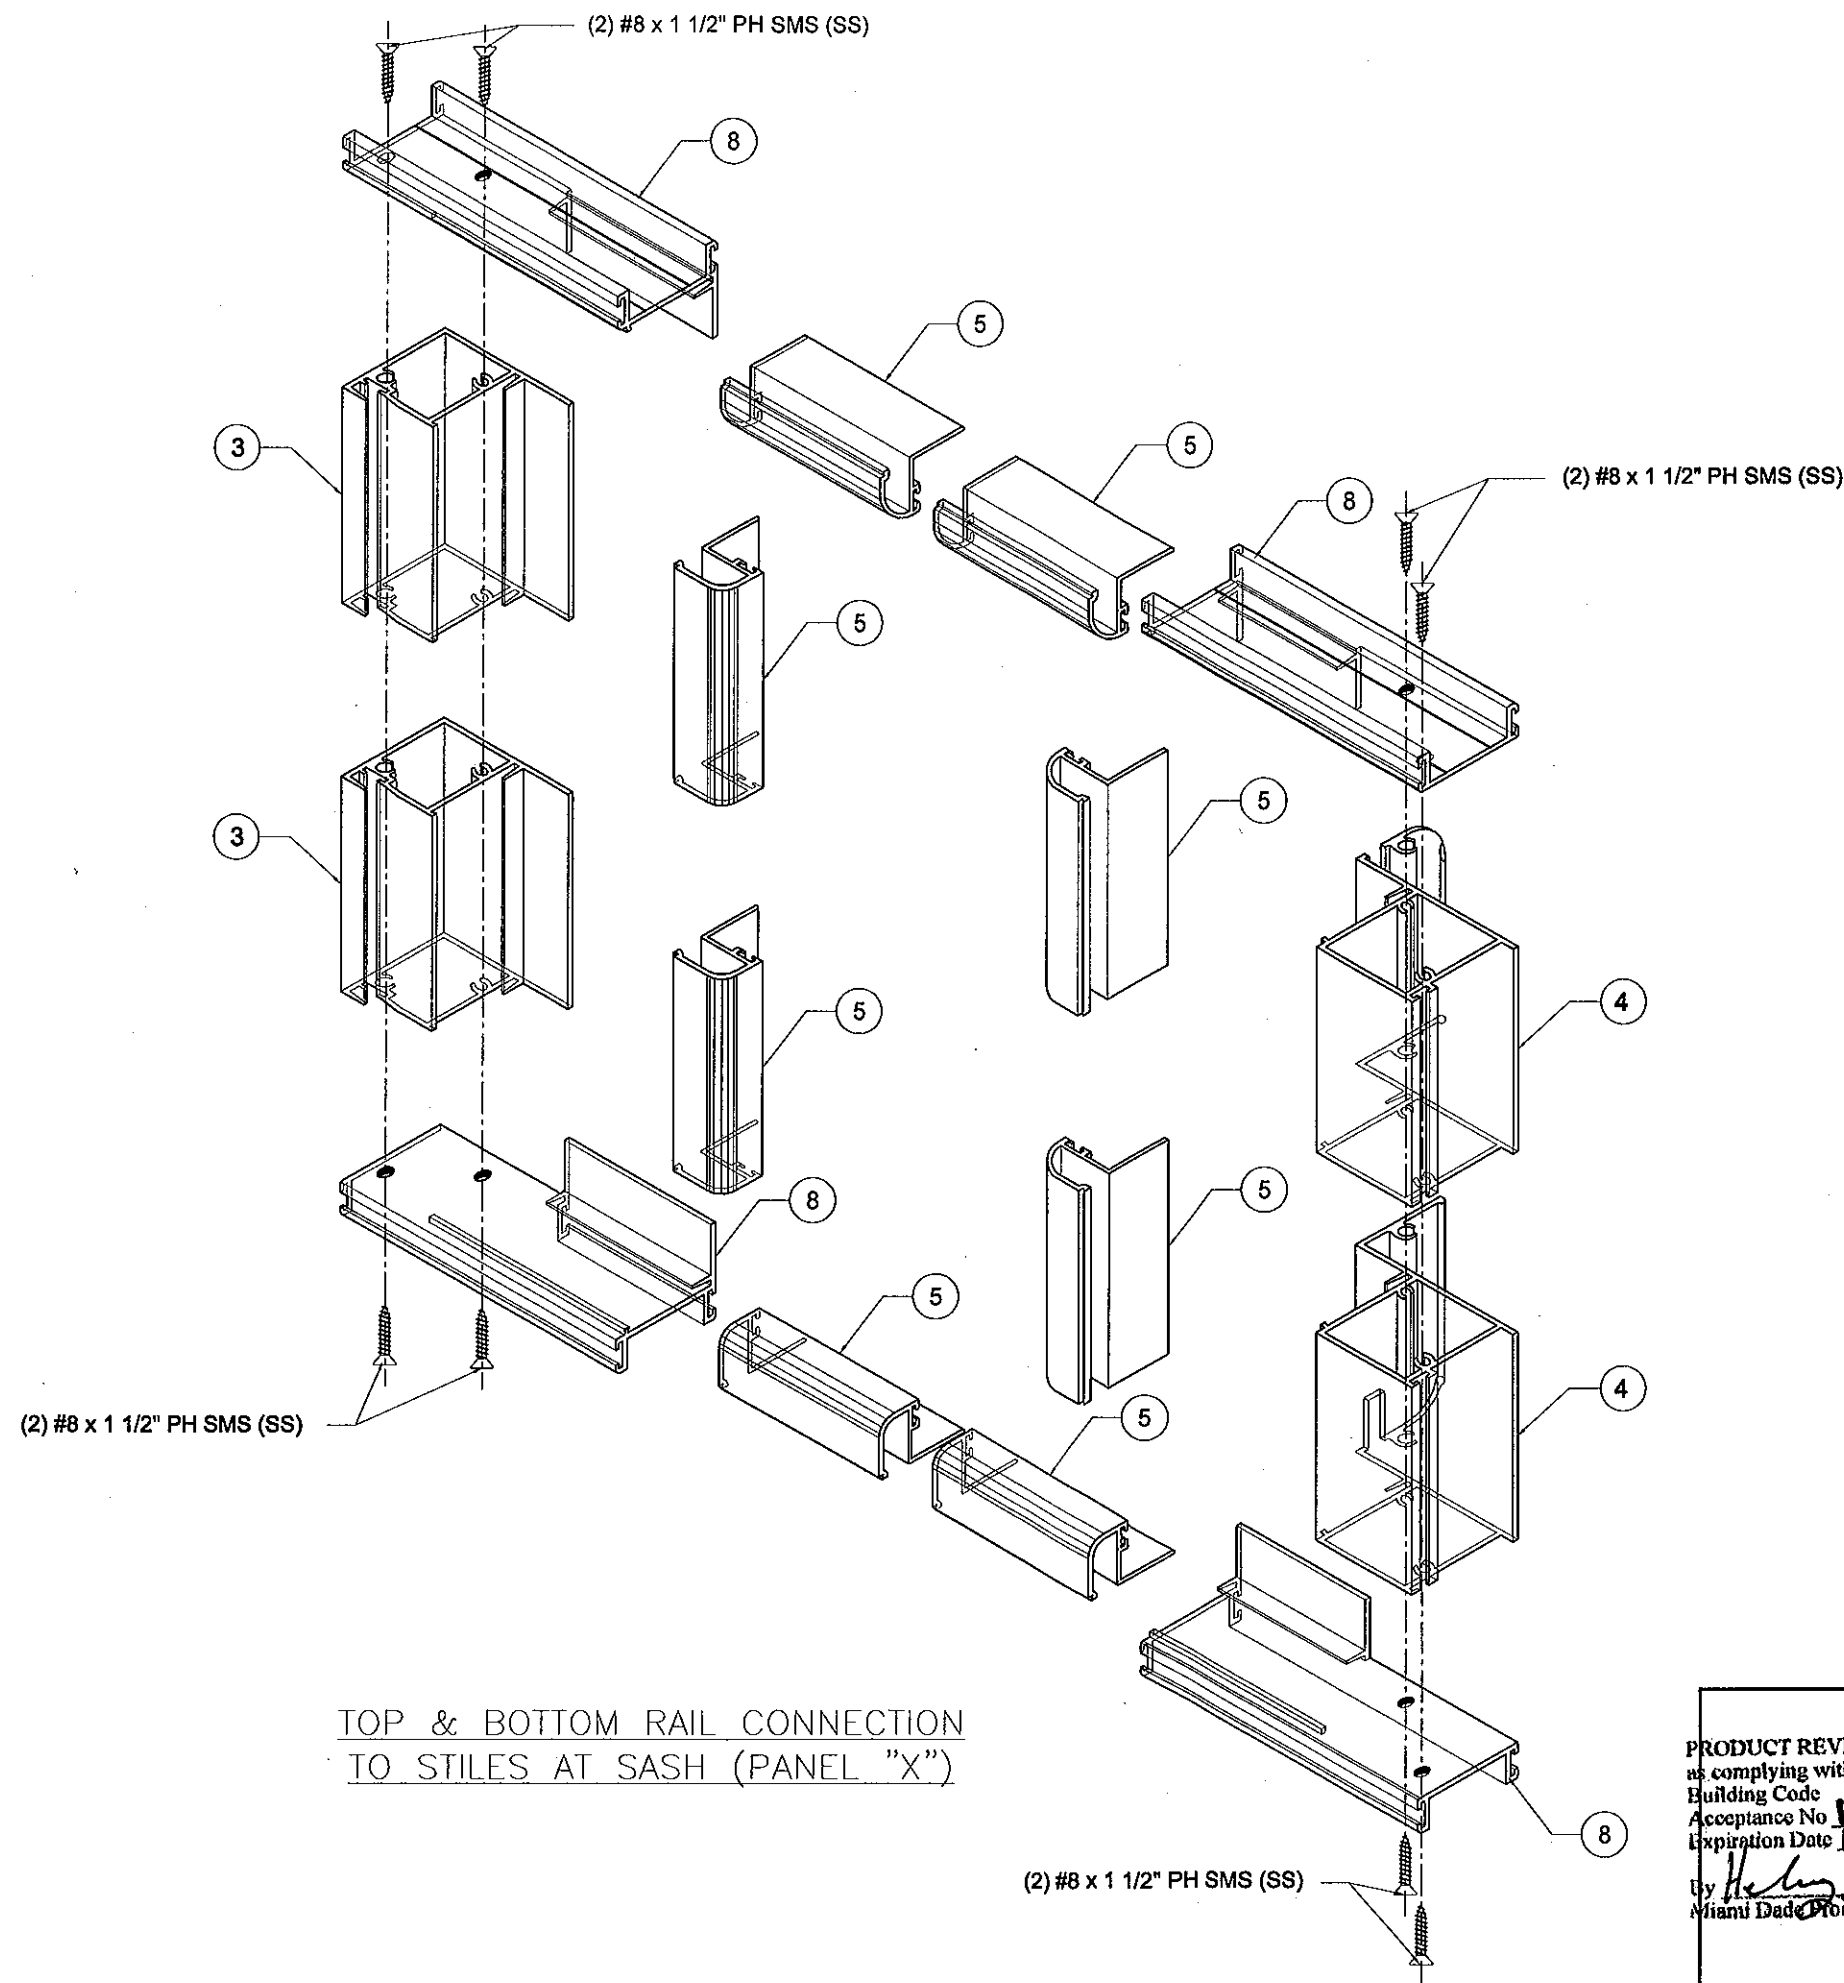

TOP & BOTTOM RAIL CONNECTION
TO STILES AT SASH (PANEL "X")

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-0513.01
Expiration Date 12/27/2012
By *Heather A. Miller*
Miami Dade Product Control

MIAMI DADE COUNTY

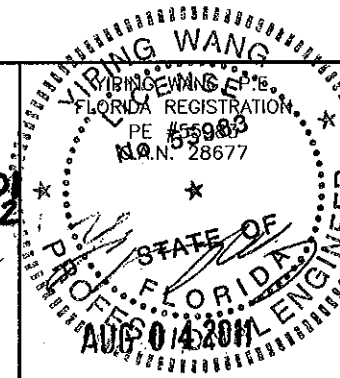

DATE	04/20/11
SCALE	AS SHOWN
DRAWN	S. L.
PROJECT	11-027

DRAWING NO.
AD11-11


11 OF 11

SERIES 2009 ALUM. HORIZONTAL ROLLING WINDOW - LMI
FLORIDA COASTAL IMPACT WINDOW L.L.C.
940 W 84 STREET
HIALEAH, FL 33014
P: (305) 828-8254 F: (305) 828-8255

MCY ENGINEERING, INC.
GLAZING CONSULTANTS

9110 SW SUNSET DRIVE. P: 305.271.0117
MIAMI, FL 33173 F: 786.573.5063

www.MCYEngineering.com MCY.Engineering@Att.net



REVISIONS	
NO.	DATE