



BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/building

NOTICE OF ACCEPTANCE (NOA)

ITW Buildex
1349 West Bryn Mawr Avenue
Itasca, IL 60143

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County BNC - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BNC reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Tapcon Concrete Anchors with Advanced Threadform Technology

APPROVAL DOCUMENT: Drawing No. 06-ITW-0001, Sheets 1 and 2 of 2, titled "Tapcon Concrete Anchors with Advanced Threadform Technology", dated 01/05/09, with last revision dated 12/30/08, prepared by Engineering Express, signed and sealed by Frank L. Bernnardo, P.E., bearing the Miami-Dade County Product Control renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None

LABELING: Each box shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 09-0121.19** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



[Handwritten Signature]
08/04/11

NOA No. 11-0616.05
Expiration Date: August 31, 2012
Approval Date: August 11, 2011
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS


1. Drawing No. **06-ITW-0001**, Sheets 1 and 2 of 2, titled "Tapcon Concrete Anchors with Advanced Threadform Technology", dated 01/05/09, with last revision dated 12/30/08, prepared by Engineering Express, signed and sealed by Frank L. Bernnardo, P.E. **"Submitted under NOA # 09-0121.19"**

B. TESTS

1. Tension and Shear Resistance Test of 3/16" SS Tapcon ATFT with Climashield per ASTM E 488, prepared by C.E.L Consulting, Report No. **71B153**, dated 01/31/07, signed and sealed by Lee W. Mattis, P.E.
2. Corrosion Resistance Test per ASTM G 85 as noted in TAS 114(E), prepared by PRI Construction Materials Technologies, Report No. **ITW-004-02-01**, dated 01/05/07, signed and sealed by Charles L. Thomas, P.E. **"Submitted under NOA # 07-0315.03"**
3. Test report on Tension and Shear Resistance, Report No. **4I131** werc for "Wercs Tapcon Concrete/Masonry Screw Anchors" per ASTM E 488, prepared by Cel Consulting on 04/29/05, signed and sealed by L. W. Mattis, P.E.
4. Test report on Tension and Shear Resistance, Report No. **4I131** werc Supplement 6519 for Tapcon with Advanced Threadform Technology per ASTM E 488 prepared by Cel Consulting on 05/19/05, signed and sealed by L. W. Mattis, P.E.
5. Test report of corrosion resistance for fasteners, Project No. **ITW-003-02-01, 02, 03 & 04**, for fasteners with Tapcon Plus, Silver Climaseal, Silver Ultrashield and White Ultrashield per ASTM G85 as noted on TAS 114(E), prepared by Cel Consulting on 10/22/04 and 05/16/06, signed and sealed by C. L. Thomas, P.E. **"Submitted under NOA # 05-1020.01"**

C. CALCULATIONS

1. Calculations Addendum on new Stainless Steel Anchors, prepared by Engineering Express, dated 03/08/07, signed and sealed by Frank L. Bennardo, P.E. **"Submitted under NOA # 07-0315.03"**
2. Calculations of allowable loads for Tapcon with Advanced Threadform Technology, Project # 06-ITW-0001, prepared by Engineering Express on 06/22/06, signed and sealed by Frank L. Bennardo, P.E. **"Submitted under NOA # 05-1020.01"**



Handwritten signature of Carlos M. Utrera, dated 08/04/11.

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 11-0616.05
Expiration Date: August 31, 2012
Approval Date: August 11, 2011

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE


1. Miami-Dade Building and Neighborhood Compliance Department (BNC)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. No change letter issued by ITW Buildex, dated 06/09/11, signed by Amy Kolczak and Michael Gong.
2. New testing/data contract letter issued by CEL Consulting, dated 07/29/11, signed by Lee Mattis, P.E.
3. Statement letter of code conformance to 2007 FBC issued by Engineering Express, dated 01/05/09, signed and sealed by Frank L. Bennardo, P.E.
"Submitted under NOA # 09-0121.19"
4. No interest letter issued by Engineering Express, dated 06/23/06, signed and signed by Frank L. Bennardo, P.E. *"Submitted under NOA # 05-1020.01"*



08/04/11

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 11-0616.05
Expiration Date: August 31, 2012
Approval Date: August 11, 2011


ITW Buildex TAPCON® with ADVANCED THREADFORM TECHNOLOGY™ CONCRETE & MASONRY ANCHOR

FRANK L. BENNARDO, P.E.
PE0046549

01/05/2009

GENERAL NOTES:

1. THIS PRODUCT HAS BEEN DESIGNED & TESTED IN ACCORDANCE WITH THE 2007 FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE) AND THE FOLLOWING STANDARDS: ASTM E488, ASTM G85, & TAS 114.
2. ANCHORS REPRESENTED IN TABLES 1-4 ARE MANUFACTURED FROM HEAT-TREATED STEEL WITH AN ALTERNATING HIGH-LOW ADVANCED THREADFORM TECHNOLOGY AND SHALL HAVE CORROSION-RESISTANT COATINGS AS DESCRIBED BELOW:
 - SILVER & WHITE ULTRASHIELD
 - BLUE & SILVER CLIMASEAL
3. ANCHORS REPRESENTED IN TABLE 5 ARE OF 410 STAINLESS STEEL ALLOY WITH AN ALTERNATING HIGH-LOW ADVANCED THREADFORM TECHNOLOGY AND SHALL HAVE A CLIMASHIELD CORROSION-RESISTANT COATING.
4. ANCHOR INSTALLATION SHALL BE MADE IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS AND THIS NOTICE OF ACCEPTANCE.
5. CONCRETE SHALL CONFORM TO ACI 301 SPECIFICATIONS, WITH STRENGTH PROPERTIES AS SPECIFIED HEREIN. HOLLOW AND GROUT-FILLED CONCRETE BLOCK SHALL CONFORM TO ASTM C-90.
6. PILOT HOLES FOR ALL INSTALLATIONS SHALL HAVE DEPTH 1/4" LONGER THAN INDICATED EMBEDMENT DEPTH AND DIAMETER AS FOLLOWS:
 - 3/16" ANCHORS: 0.173"Ø
 - 1/4" ANCHORS: 0.204"Ø
7. REFERENCE CEL CONSULTING TEST REPORT #41131werc (4/29/2005), TEST REPORT #41131werc SUPPLEMENT 6519 (5/19/2006) & TEST REPORT #71B153 (01/31/2007), AS WELL AS PRI ASPHALT TECHNOLOGIES, INC. TEST REPORTS #ITW-002-02-01 (12/1/2004), #ITW-003-02-02 (6/15/2006), #ITW-003-02-03 (6/15/2006), & #ITW-003-02-04 (6/15/2006), AND PRI CONSTRUCTION MATERIALS TECHNOLOGIES, INC. TEST REPORT #ITW-004-02-01 (11/14/2006).

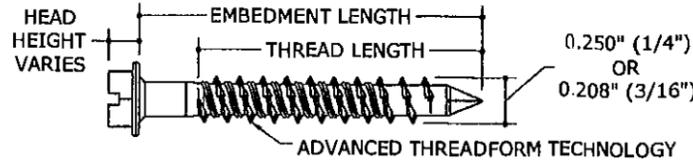


1
**TAPCON WITH ADVANCED
THREADFORM TECHNOLOGY**
1:1 SCALE SIDE VIEW

PART LENGTH	ANCHOR LENGTH	
	THREAD LENGTH	
	3/16" TAPCON	1/4" TAPCON
1-1/4"	FULL THREAD	FULL THREAD
1-3/4"	1-5/8"	1-5/8"
2-1/4"	1-5/8"	1-5/8"
2-3/4"	1-5/8"	1-5/8"
3-1/4"	1-5/8"	1-5/8"
3-3/4"	1-5/8"	1-5/8"
4"	1-5/8"	1-5/8"
5"		1-5/8"
6"		1-5/8"

ANCHOR DIAMETER			
ANCHOR TYPE	THREAD DIAMETER	SHANK DIAMETER	ROOT DIAMETER
3/16" TAPCON	0.208"	0.145"	0.122"
1/4" TAPCON	0.250"	0.190"	0.168"

PART LENGTH	LONG THREAD ANCHOR LENGTH	
	THREAD LENGTH	
	3/16" TAPCON	1/4" TAPCON
1-3/4"	FULL THREAD	FULL THREAD
2-1/4"	2-1/8"	2-1/8"
2-3/4"	2-1/8"	2-1/8"
3-1/4"	2-1/8"	2-1/8"
3-3/4"	2-1/8"	2-1/8"
4"	2-1/8"	2-1/8"
5"		2-1/8"
6"		2-1/8"

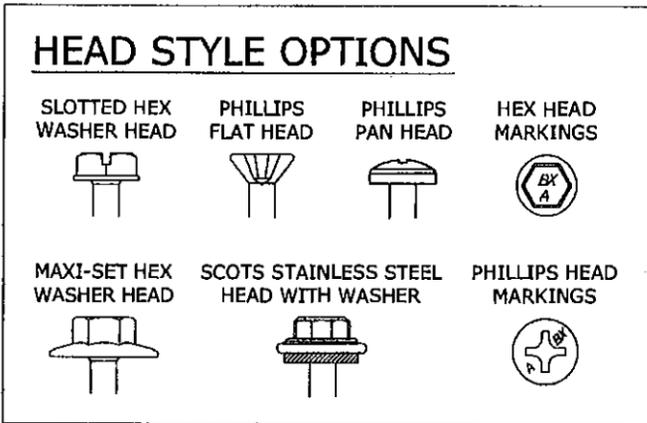

ANCHOR HEAD DIMENSION		
HEAD STYLE	HEAD HEIGHT	HEAD DIAMETER
3/16" PFH	0.120"	0.357"
#12 PFH	0.148"	0.414"
1/4" PFH	0.148"	0.471"

ANCHOR HEAD DIMENSION			
HEAD STYLE	HEAD HEIGHT	ACROSS FLAT	WASHER DIAMETER
3/16" HWH	0.140"	0.246"	0.355"
1/4" HWH	0.180"	0.308"	0.415"
1/4" MAXISET	0.225"	0.308"	0.630"
1/4" SCOTS	0.280"	0.308"	0.587"

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 11-0616.05
Expiration Date 08/31/2012
By *[Signature]*
Miami Dade Product Control

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 09-0121.19
Expiration Date 08/31/2011
By *[Signature]*
Miami Dade Product Control
Division

ENGINEERING EXPRESS®
160 SW 12th AVENUE, # 106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT. OF AUTH. #8885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

ITW Buildex
Buildex Division of Illinois Tool Works, Inc.
1349 West Bryn Mawr Avenue
Itasca, IL 60143
TAPCON CONCRETE ANCHORS WITH
ADVANCED THREADFORM TECHNOLOGY
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT. ISSUE	CL	FLB	6/27/06
REVISE & UPDATE NOTES	CL	FLB	7/5/106
ADD S.S. ANCHORS	KL	CL	02/22/07
ADD PHILLIPS PAN HEAD	KL	CL	04/02/07
REVISE FOR ITW FBC	TSB	CL	12/30/08

06-ITW-0001
SCALE: 1/4"
PAGE DESCRIPTION:
1 OF 2

STEEL ANCHORS TO NORMAL WEIGHT CONCRETE

1a TENSION CAPACITIES

BASED ON EMBEDMENT & EDGE DISTANCE FOR SINGLE ANCHORS

ANCHOR DIAM	EMBED	EDGE DIST	2,000 PSI CONC	4,000 PSI CONC	5,000 PSI CONC
3/16"	1"	1"	125 lb	141 lb	141 lb
		1 7/8"	184 lb	188 lb	210 lb
	1 1/2"	1"	243 lb	279 lb	318 lb
		1 7/8"	278 lb	279 lb	327 lb
	1 3/4"	1"	358 lb	360 lb	390 lb
		1 7/8"	390 lb	401 lb	433 lb
1/4"	1"	1 1/4"	174 lb	194 lb	237 lb
		2 1/2"	188 lb	199 lb	237 lb
	1 1/2"	1 1/4"	313 lb	449 lb	519 lb
		2 1/2"	346 lb	454 lb	545 lb
	1 3/4"	1 1/4"	465 lb	543 lb	543 lb
		2 1/2"	608 lb	594 lb	707 lb

1b SHEAR CAPACITIES

BASED ON EMBEDMENT & EDGE DISTANCE FOR SINGLE ANCHORS

ANCHOR DIAM	EMBED	EDGE DIST	2,000 PSI CONC	4,000 PSI CONC	5,000 PSI CONC
3/16"	1"	1 1/8"	126 lb	150 lb	150 lb
		2 1/4"	181 lb	181 lb	244 lb
	1 1/2"	1 1/8"	186 lb	186 lb	186 lb
		2 1/4"	215 lb	226 lb	226 lb
	1 3/4"	1 1/8"	204 lb	204 lb	204 lb
		2 1/4"	216 lb	251 lb	260 lb
1/4"	1"	1 1/2"	198 lb	310 lb	310 lb
		3"	237 lb	340 lb	359 lb
	1 1/2"	1 1/2"	232 lb	380 lb	416 lb
		3"	368 lb	417 lb	417 lb
	1 3/4"	1 1/2"	303 lb	346 lb	500 lb
		3"	421 lb	492 lb	500 lb

2 TENSION & SHEAR CAPACITIES

BASED ON EMBEDMENT & SPACING FOR PAIRS OF ANCHORS*

ANCHOR DIAM	EMBED	SPACING	2,000 PSI CONCRETE			
			TENSION	REDUCTION FACTOR	SHEAR	REDUCTION FACTOR
3/16"	1"	1 1/2"	220 lb	0.81	352 lb	1.00
		3"	271 lb	1.00	352 lb	1.00
	1 1/2"	1 1/2"	443 lb	0.83	358 lb	0.91
		3"	538 lb	1.00	392 lb	1.00
	1 3/4"	1 1/2"	641 lb	0.98	445 lb	0.94
		3"	653 lb	1.00	474 lb	1.00
1/4"	1"	2"	261 lb	0.76	447 lb	0.89
		4"	343 lb	1.00	500 lb	1.00
	1 1/2"	2"	533 lb	0.72	628 lb	0.89
		4"	740 lb	1.00	703 lb	1.00
	1 3/4"	2"	811 lb	0.92	1117 lb	0.98
		4"	865 lb	1.00	1144 lb	1.00

* REFER TO DETAIL UNDER TABLE 4 FOR DEPICTION OF ANCHOR SPACING & EDGE DISTANCE REQUIREMENTS FOR PAIRS OF ANCHORS

3 TENSION & SHEAR CAPACITIES


BASED ON EMBEDMENT & EDGE DISTANCE

SINGLE ANCHORS			LIGHT-WEIGHT CMU BLOCK		MEDIUM-WEIGHT CMU BLOCK	
ANCHOR DIAM	EMBED	EDGE DIST	TENSION	SHEAR	TENSION	SHEAR
3/16"	1"	2"	54 lb	104 lb	85 lb	169 lb
		4"	56 lb	104 lb	183 lb	183 lb
1/4"	1"	2"	54 lb	135 lb	147 lb	202 lb
		4"	70 lb	166 lb	253 lb	253 lb

4 TENSION & SHEAR CAPACITIES

BASED ON EMBEDMENT & SPACING FOR PAIRS OF ANCHORS*

ANCHOR DIAM	EMBED	SPACING	LIGHT-WEIGHT CMU BLOCK	
			TENSION	SHEAR
3/16"	1"	1 1/2"	128 lb	252 lb
		3"	128 lb	252 lb
1/4"	1"	2"	105 lb	265 lb
		4"	170 lb	280 lb

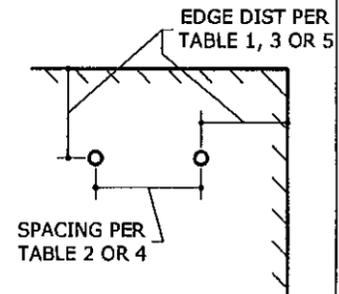

* REFER TO DETAIL AT RIGHT FOR DEPICTION OF ANCHOR SPACING & EDGE DISTANCE REQUIREMENTS FOR PAIRS OF ANCHORS

EDGE DIST & SPACING: "PAIRS OF ANCHORS"

STEEL ANCHORS TO HOLLOW BLOCK

5 TENSION & SHEAR CAPACITIES

BASED ON EMBEDMENT & EDGE DISTANCE

ANCHOR DIAM	EMBED	EDGE DIST	3000 PSI CONCRETE		MEDIUM-WEIGHT CMU BLOCK	
			TENSION	SHEAR	TENSION	SHEAR
3/16"	1"	1"	164 lb	160 lb	67 lb	72 lb
		2 1/2"	164 lb	284 lb	67 lb	124 lb
	1 3/4"	1"	336 lb	169 lb	183 lb	183 lb
		2 1/2"	379 lb	364 lb	183 lb	183 lb
1/4"	1"	1"	187 lb	126 lb	85 lb	64 lb
		2 1/2"	220 lb	301 lb	96 lb	168 lb
	1 3/4"	1"	344 lb	214 lb	183 lb	183 lb
		2 1/2"	473 lb	516 lb	183 lb	183 lb

* REFER TO DETAIL UNDER TABLE 4 FOR DEPICTION OF EDGE DISTANCE REQUIREMENTS

CAPACITY TABLE NOTES:

- ALLOWABLE DESIGN CAPACITIES SHOWN IN TABLES ABOVE HAVE BEEN DETERMINED USING A SAFETY FACTOR OF 4:1
- EDGE DISTANCE AND SPACING DENOTED HEREIN SHALL BE CENTER-TO-EDGE AND CENTER-TO-CENTER DISTANCES, RESPECTIVELY.
- ANCHORS SHALL BE INSTALLED A MINIMUM OF 12 DIAMETERS ON CENTER FOR 100% ANCHOR CAPACITY (AS LISTED IN TABLES). SPACING MAY BE REDUCED TO SPACING SHOWN IN TABLES 2 & 4 PROVIDED THAT ANCHOR CAPACITIES ARE REDUCED TO CORRESPONDING VALUES AS LISTED THEREIN.
- LINEAR INTERPOLATION MAY BE USED FOR EDGE DISTANCE AND SPACING BETWEEN MINIMUM AND MAXIMUM DISTANCES SHOWN IN TABLES.
- THE LESSER OF EDGE DISTANCE AND SPACING IS THE MINIMUM AT WHICH ANCHORS MAY BE INSTALLED.
- "REDUCTION FACTOR" IN TABLE 2 IS THE REDUCTION FACTOR TO BE APPLIED TO ALLOWABLE LOADS FOR REDUCED SPACING. THIS REDUCTION SHALL BE IN ADDITION TO THE REDUCTION IN ALLOWABLE LOAD (IF ANY) DUE TO REDUCED EDGE DISTANCE.
- HOLLOW CONCRETE MASONRY UNITS (CMU) SHALL CONFORM TO ASTM C90 SPECIFICATIONS AND SHALL HAVE DENSITIES AS DEFINED BELOW:
 - "LIGHT WEIGHT" CMU: DENSITY > 95 PCF
 - "MEDIUM WEIGHT" CMU: DENSITY > 117 PCF
- /// DESIGNATES CONDITIONS WHICH ARE NOT ACCEPTABLE FOR USE.

PRODUCT RENEWED
 as complying with the Florida Building Code
 Acceptance No 11-0616,05
 Expiration Date 08/31/2012
 By *[Signature]*
 Miami Dade Product Control

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 09-0121,19
 Expiration Date 08/31/2011
 By *[Signature]*
 Miami Dade Product Control Division

FRANK L. BENNARDO, P.E.
 #PE0046549
 01/05/2009
ENGINEERING EXPRESS
 160 SW 12th AVENUE, #106
 DEERFIELD BEACH, FL 33442
 PH: (954) 354-0660 FAX: (954) 354-0443
 WWW.ENGEXP.COM
 CERT OF AUTH #9885
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

ITW Buildex
 Buildex Division of Illinois Tool Works, Inc.
 1349 West Bryn Mawr Avenue
 Itasca, IL 60143
 TAPCON CONCRETE ANCHORS WITH
 ADVANCED THREADFORM TECHNOLOGY
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CL	FLB	6/21/06
REVISE & UPDATE NOTES	CL	FLB	7/5/10/6
ADD S.S. ANCHORS	KL	CL	02/22/07
ADD PHILIPS PAN HEAD	KL	CL	04/02/07
REVISE FOR 07 FBC	TSB	CL	12/30/08

06-ITW-0001
 SCALE: 1/4"
 PAGE DESCRIPTION: