

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER) BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208 Miami, Florida 33175-2474 T (786) 315-2590 F (786) 315-2599 www.miamidade.gov/pera

NOTICE OF ACCEPTANCE (NOA)

Tejas Cobert, S.A. Crta Villaluenga a Cobeja, km 3,500. 45520 – Villaluenga de la Sagra (Toledo)

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: COBERT Clay Spanish "S" Meridional

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

ALTHU

This renews NOA# 07-0802.06 and consists of pages 1 through 5. The submitted documentation was reviewed by Alex Tigera.



NOA No.: 11-1116.01 Expiration Date: 11/26/16 Approval Date: 05/09/13

Page 1 of 5

ROOFING ASSEMBLY APPROVAL

Category: Roofing **Roofing Tiles Sub Category:**

Material: Clay

1. **SCOPE**

This approves a roofing system using COBERT Clay Spanish "S" Meridional roof tile, as manufactured by Tejas Cobert, S.A. in Alicante, Spain (offices and headquarters in Toledo, Spain) and distributed by All Points Tile & Slate, Inc. as described in Section 2 of this Notice of Acceptance, designed to comply with the High Velocity Hurricane Zone Section of the Florida Building Code. For the locations where the pressure requirements, do not exceed the design pressure values obtain by calculations in compliance with RAS 127 using the values listed in section 4 herein. The attachment calculations shall be done as a moment based system.

2. PRODUCT DESCRIPTION

Manufactured by Applicant	Dimensions	Test Specifications	Product <u>Description</u>
COBERT Clay Spanish 'S' Meridional	l = 17" w = 10.3" ½" thick	ASTM C 1167	High profile Spanish 'S' clay tile
Trim Pieces	Length: varies Width: varies varying thickness	ASTM C 1167	Accessory trim, clay roof pieces for use at hips, rakes, ridges and valley terminations.

2.1 Manufacturing Location

2.1.1. Alicante, Spain

2.2 EVIDENCE SUBMITTED

Test Agency	Test Identifier	Test Name/Report	<u>Date</u>	
American Test Lab of South	RT1109.02-12	TAS 101	11/09/12	
Florida	RT0820.01-12	ASTM C 1167	09/13/12	



NOA No.: 11-1116.01 **Expiration Date: 11/26/16** Approval Date: 05/09/13

Page 2 of 5

3. LIMITATIONS:

- **3.1** Fire classification is not part of this acceptance.
- **3.2** For mortar or adhesive set tile applications, a static field uplift test in accordance with TAS 106 may required, refer to applicable building code.
- 3.3 Applicant shall retain the services of a Miami-Dade County Certified Laboratory to perform quarterly test in accordance with TAS 112, appendix 'A'. Such testing shall be submitted to the Building and Neighborhood Compliance Department Product Control Section for review.
- **3.4** Minimum underlayment shall be in compliance with the applicable Roofing Applications Standards listed section 4.1 herein.
- 3.5 30/90 hot mopped underlayment applications may be installed perpendicular to the roof slope unless stated otherwise by the underlayment material manufacturers published literature.
- **3.6** This acceptance is for wood deck applications. Minimum deck requirements shall be in compliance with applicable building code.
- **3.7** May be installed on slopes 7:12 and greater.

4. Installation

- **4.1** COBERT Clay Spanish "S" Meridional tile and its components shall be installed in strict compliance with Roofing Application Standard RAS 120.
- **4.2** Data For Attachment Calculations.

Table 1: Average Weight (W) and Dimensions (I x w)			
Tile Profile	Weight-W (lbf)	Length-I (ft)	Width-w (ft)
COBERT Clay Spanish 'S' Meridional roof tile	7.0	1.42	0.875

Table 2: Aerodynamic Multipliers - λ (ft³)			
Tile Profile	λ (ft³) Batten Application	λ (ft³) Direct Deck Application	
COBERT Clay Spanish 'S' Meridional roof tile	N/A	0.22	

Table 3: Restoring Moments due to Gravity - M _g (ft-lbf)						
Tile Profile	2":12"	3":12"	4":12"	5":12"	6":12"	7":12" or Greater
COBERT	Direct Deck					
Clay Spanish 'S' Meridional roof tile	6.25	6.19	6.11	6.00	5.91	5.75



NOA No.: 11-1116.01 Expiration Date: 11/26/16 Approval Date: 05/09/13 Page 3 of 5

Table 6: Attachment Resistance Expressed as a Moment - M _f (ft-lbf) for Single Patty Adhesive Set Systems			
Tile Profile	Tile Application	Minimum Attachment Resistance	
COBERT Clay Spanish 'S' Meridional roof tile	3M [™] 2-Component Foam Roof Tile Adhesive AH-160	61.9 ¹	
1 Large paddy placement weight 45 grams of 3M [™] 2-Component Foam Roof Tile Adhesive AH-160.			

5. LABELING

5.1 All tiles shall bear the imprint or identifiable marking of the manufacturer's name or logo as detailed below, or following statement: "Miami-Dade County Product Control Approved".



COBERT CLAY SPANISH "S" MERIDIONAL TILE LABEL (LOCATED ON UNDERSIDE OF TILE)

6. BUILDING PERMIT REQUIREMENTS:


- **6.1** Application for building permit shall be accompanied by copies of the following:
 - **6.1.1** This Notice of Acceptance.
 - **6.1.2** Any other documents required by Building Official or Applicable building code in order to properly evaluate the installation of this system.



NOA No.: 11-1116.01 Expiration Date: 11/26/16 Approval Date: 05/09/13

Page 4 of 5

PROFILE DRAWINGS

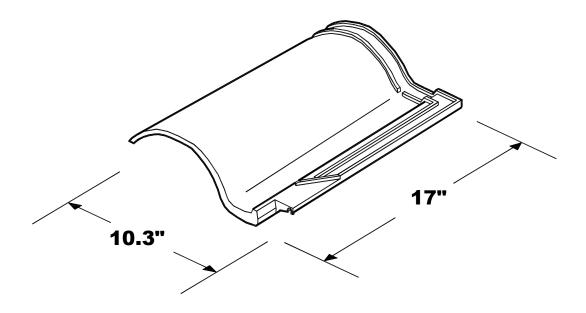

COBERT CLAY SPANISH "S" MERIDIONAL TILE

END OF THIS ACCEPTANCE



NOA No.: 11-1116.01 Expiration Date: 11/26/16 Approval Date: 05/09/13 Page 5 of 5