



DEPARTMENT OF PERMITTING, ENVIRONMENT, AND REGULATORY
AFFAIRS (PERA)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/pera/

Trulite Glass & Aluminum Solution, LLC
800 Fairway Drive, Suite # 200
Deerfield Beach, Fl. 33441

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County PERA-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. PERA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION:

Series "Resistor IFG 5000 Series" Flush Glazed Aluminum Storefront System – L.M.I.

APPROVAL DOCUMENT: Drawing No. 11-186, titled "IFG 5000 Series Storefront Window Large & Small Missile Impact Rated Resistor", sheets 1 through 6 of 6, dated 08/05/04 with the latest revision, dated 12/15/11, prepared by EngCo Inc., signed and sealed by Pedro De Figueiredo, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. 09-0728.02 and consists of this page 1 and evidence pages E-1, and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
3/8/12

NOA No. 11-1227.07
Expiration Date: October 21, 2014
Approval Date: March 15, 2012
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under previous NOA No. 04-0831.03)
2. Drawing No. **11-186**, titled "IFG 5000 Series Storefront Window Large & Small Missile Impact Rated Resistor", sheets 1 through 6 of 6, dated 08/05/04 with the latest revision, dated 12/15/11, prepared by EngCo Inc., signed and sealed by Pedro De Figueiredo, P. E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of an aluminum window wall system, prepared by Fenestration Testing Laboratory, Inc., Test Reports No.'s **FTL-3981** and **FTL-4184**, dated 01/27 and 06/18/04, both signed and sealed by Edmundo Largaespada, P. E.
(Submitted under previous NOA No. 04-0831.03)

C. CALCULATIONS:

1. Anchor verification calculations and structural analysis, complying with FBC-2007, dated 06/01/09, prepared by EngCo, Inc., signed and sealed by Pedro De Figueiredo, P. E.
(Submitted under previous NOA No. 09-07281.02)
2. **Glazing complies with ASTM E1300-04**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Permitting, Environment, and Regulatory Affairs (PERA).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **11-0624.02** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Sentry Glass® Interlayer**" dated 05/26/10, expiring on 01/14/17.
2. Notice of Acceptance No. **08-0520.08** issued to Solutia Inc. for their "**Vanceva Composites used for lamination of glass**" dated 7/17/08, expiring on 12/11/13.
3. Notice of Acceptance No. **08-0206.01** issued to Solutia Inc. for their "**Saflex HP Glass Interlayer**" dated 04/17/08, expiring on 04/17/13.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 11-1227.07
Expiration Date: October 21, 2014
Approval Date: March 15, 2012


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of no financial interest, conformance, complying with FBC-2010, dated 12/14/11, signed and sealed by Pedro De Figueiredo, P. E.
2. Certificate of name change amendment dated 07/27/11, issued by The State of Delaware for Arch Aluminum Glass, LLC to Trulite Glass & Aluminum Solution, LLC, signed by Jeffery W. Bullock, Secretary of State.
3. Florida Dept of State, listing dated 02/03/10 of Trulite Glass & Aluminum Solution, LLC (Foreign Ltd. Liability Co.), managed by Arch Intermediate Holding, LLC, Tamarac, Fl.
4. Laboratory compliance letter for Test Reports No.'s **FTL-3981** and **FTL-4184**, issued by Fenestration Testing Laboratory, Inc., dated 01/27 and 06/18/04, both signed and sealed by Edmundo Largaespada, P. E.
(Submitted Under NOA No. 04-0831.03)

G. OTHERS

1. Notice of Acceptance No. **09-0728.02**, issued to Arch Aluminum & Glass Co., Inc. for their "**Series IFG 5000 Flush Glazed Aluminum Storefront System - L.M.I.**", approved on 10/28/09 and expiring on 10/21/14.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 11-1227.07
Expiration Date: October 21, 2014
Approval Date: March 15, 2012

A. DRAWING INDEX:

SHEET DESCRIPTION

- 1 GENERAL NOTES, INDEX, TYPICAL ELEVATION
- 2 SECTIONS DETAILS
- 3 SECTIONS & GLAZING DETAILS
- 4 FRAMING ANCHORAGE DESIGN TABLES
- 5 FRAMING COMPONENTS & BILL OF MATERIALS
- 6 ASSEMBLY ILLUSTRATION


B. GENERAL NOTES:

1. **CODE:** THIS PRODUCT HAS BEEN TESTED AND DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2007/2010 EDITION - (HIGH VELOCITY HURRICANE ZONES).
2. **DEFINITION:** THIS PRODUCT IS AN ALUMINUM FIXED STOREFRONT TYPE WINDOW WITH LARGE MISSILE IMPACT RESISTANT LAMINATED GLASS.
3. **POSTING:**

"IFG - 5000 SERIES - IMPACT
TRULITE GLASS & ALUMINUM SOLUTION.
DEERFIELD - BROWARD COUNTY - FLORIDA
DADE COUNTY PRODUCT CONTROL APPROVED"
4. **DESIGN LOADS:** LOADS MUST BE CALCULATED BY A PROFESSIONAL ARCHITECT OR ENGINEER FOR EACH SPECIFIC PROJECT. THE CALCULATED DESIGNED PRESSURE MUST NOT EXCEED THE ALLOWABLE APPROVED PRESSURE OF ±85 PSF.
5. **MATERIAL:** ALL ALUMINUM PARTS TO BE 6063-T6 OR AS INDICATED AND GLAZING TO BE LAMINATED IMPACT RESISTANT GLASS AS SPECIFIED ON THIS APPROVAL.
6. **FASTENERS:** ASSEMBLY SCREWS AND ANCHORS SHALL BE AS SPECIFIED IN THIS CURRENT SET OF DRAWINGS.
7. **USE:** IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR, ARCHITECT OR ENGINEER OF RECORD TO VERIFY THE FOLLOWING:
 - 7.1- THE STABILITY OF THE STRUCTURE WHERE THE UNIT IS TO BE ATTACHED INSURING PROPER ANCHORAGE.
 - 7.2- THE SITE SPECIFIC PROJECT CRITERIA, SUCH AS BUT NOT LIMITED TO, LOCAL CODE REQUIREMENTS, DESIGNED PRESSURES ETC.
 - 7.3- THAT THIS APPROVAL IS ADEQUATE TO THE SPECIFIC PROJECT.
8. 33 1/3% INCREASE IN ALLOWABLE LOADS HAVE NOT BEEN USED IN THE DESIGN OF THE ANCHORS FOR THIS PRODUCT APPROVAL, HOWEVER, WOOD ANCHORS WITH 1.6 INCREASE FOR WIND LOAD DURATION HAVE BEEN USED.

C. USER INSTRUCTIONS:

- 1- DETERMINE PROJECT DESIGN WIND LOAD PRESSURES AS PER ITEM 4 OF GENERAL NOTES, SHEET 1.
- 2- CALCULATE QUANTITY AND TYPE OF ANCHOR TO BE USED FOR A GIVEN TRIBUTARY MODULE WIDTH X MODULE HEIGHT AS PER TABLES 1.1 AND 1.2 ON SHEET 4.
- 3- IF DOORS ARE PART OF THE ELEVATION, INCORPORATE A VALID NOTICE OF ACCEPTANCE SHOWING DOOR DETAILS AND SPECIFICATIONS.

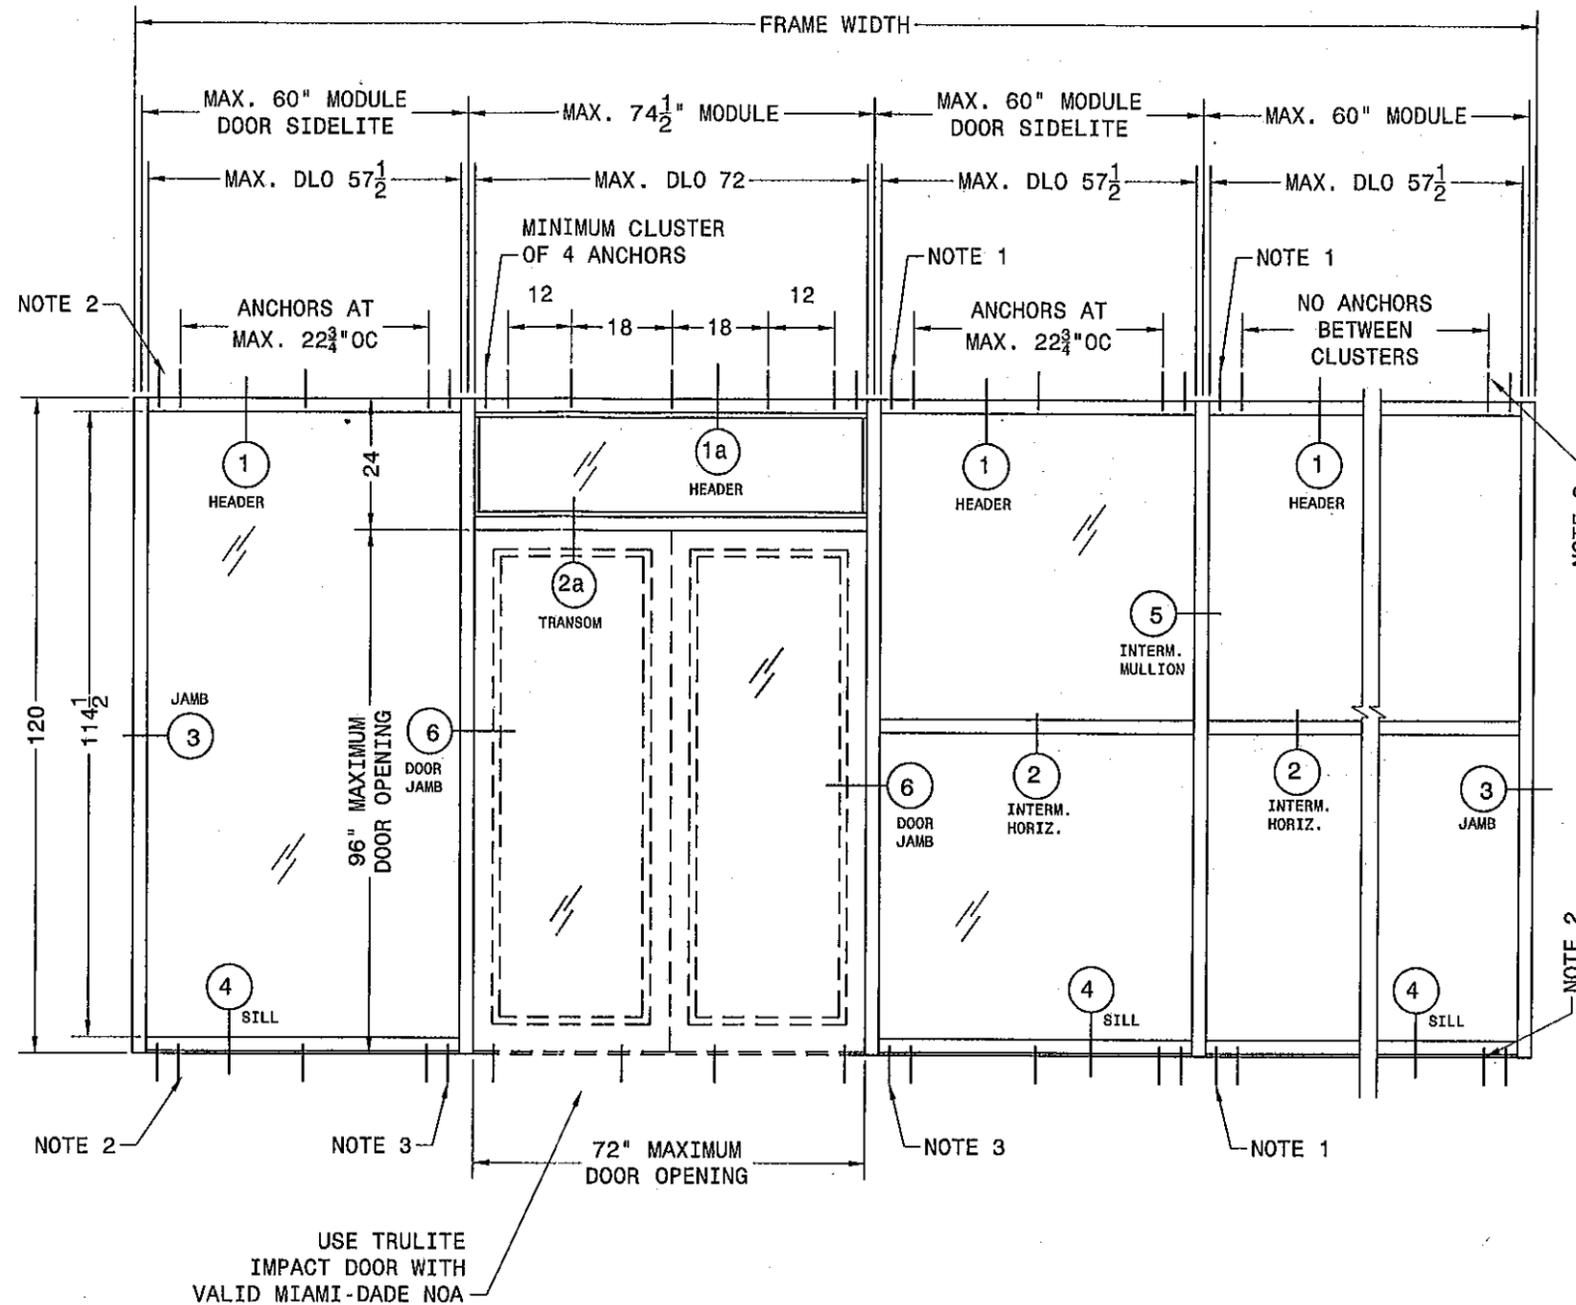

D. ADDITIONAL NOTES:

- NOTE 1 - INTERMEDIATE MULLION AND DOOR MULLION TO USE CLUSTERS OF MINIMUM 4 ANCHORS TO BE SELECTED AS PER TABLE 1.1 ON SHEET 4.
- NOTE 2 - JAMB MULLION TO USE CLUSTER OF MINIMUM 2 ANCHORS TO BE SELECTED AS PER TABLE 1.2 ON SHEET 4.
- NOTE 3 - DOOR MULLION TO USE CLUSTER OF MINIMUM 2 ANCHORS AT SILL TO BE SELECTED AS PER TABLE 1.2 ON SHEET 4.

ALLOWABLE DESIGNED PRESSURE

±85 PSF

LARGE AND SMALL

MISSILE IMPACT RESISTANT



http://www.trulite.com

800 FAIRWAY DRIVE, Suite 200
DEERFIELD BEACH, FL 33441
p. 800-432-8132 | f. 954-724-2083

PRODUCT:

IFG 5000 SERIES
STOREFRONT
LARGE & SMALL MISSILE
IMPACT RATED



REVN	DATE/REMARKS

ENGINEER:

EngCo Inc.
CA 8116
5595 ORANGE DRIVE SUITE 201
DAVIE, FL 33314
ENGCO@AOL.COM

STAMP:



PRODUCT CONTROL APPROVAL:


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **11-122707**
Expiration Date **10/21/2011**
By *[Signature]*
Miami Dade Product Control

DRAWN: TRULITE	DRAWING No:
DATE: 12.15.11	1 OF 6
DWG: 11-186	

E.D. = 1" FOR WOOD
 E.D. = 2 1/4" FOR CONCRETE
 E.D. = 3/4" FOR METAL

USE TABLES 1.1 OR 1.2
 ON SHEET 4 FOR QUANTITY
 AND SELECTION

SECTION DETAILS

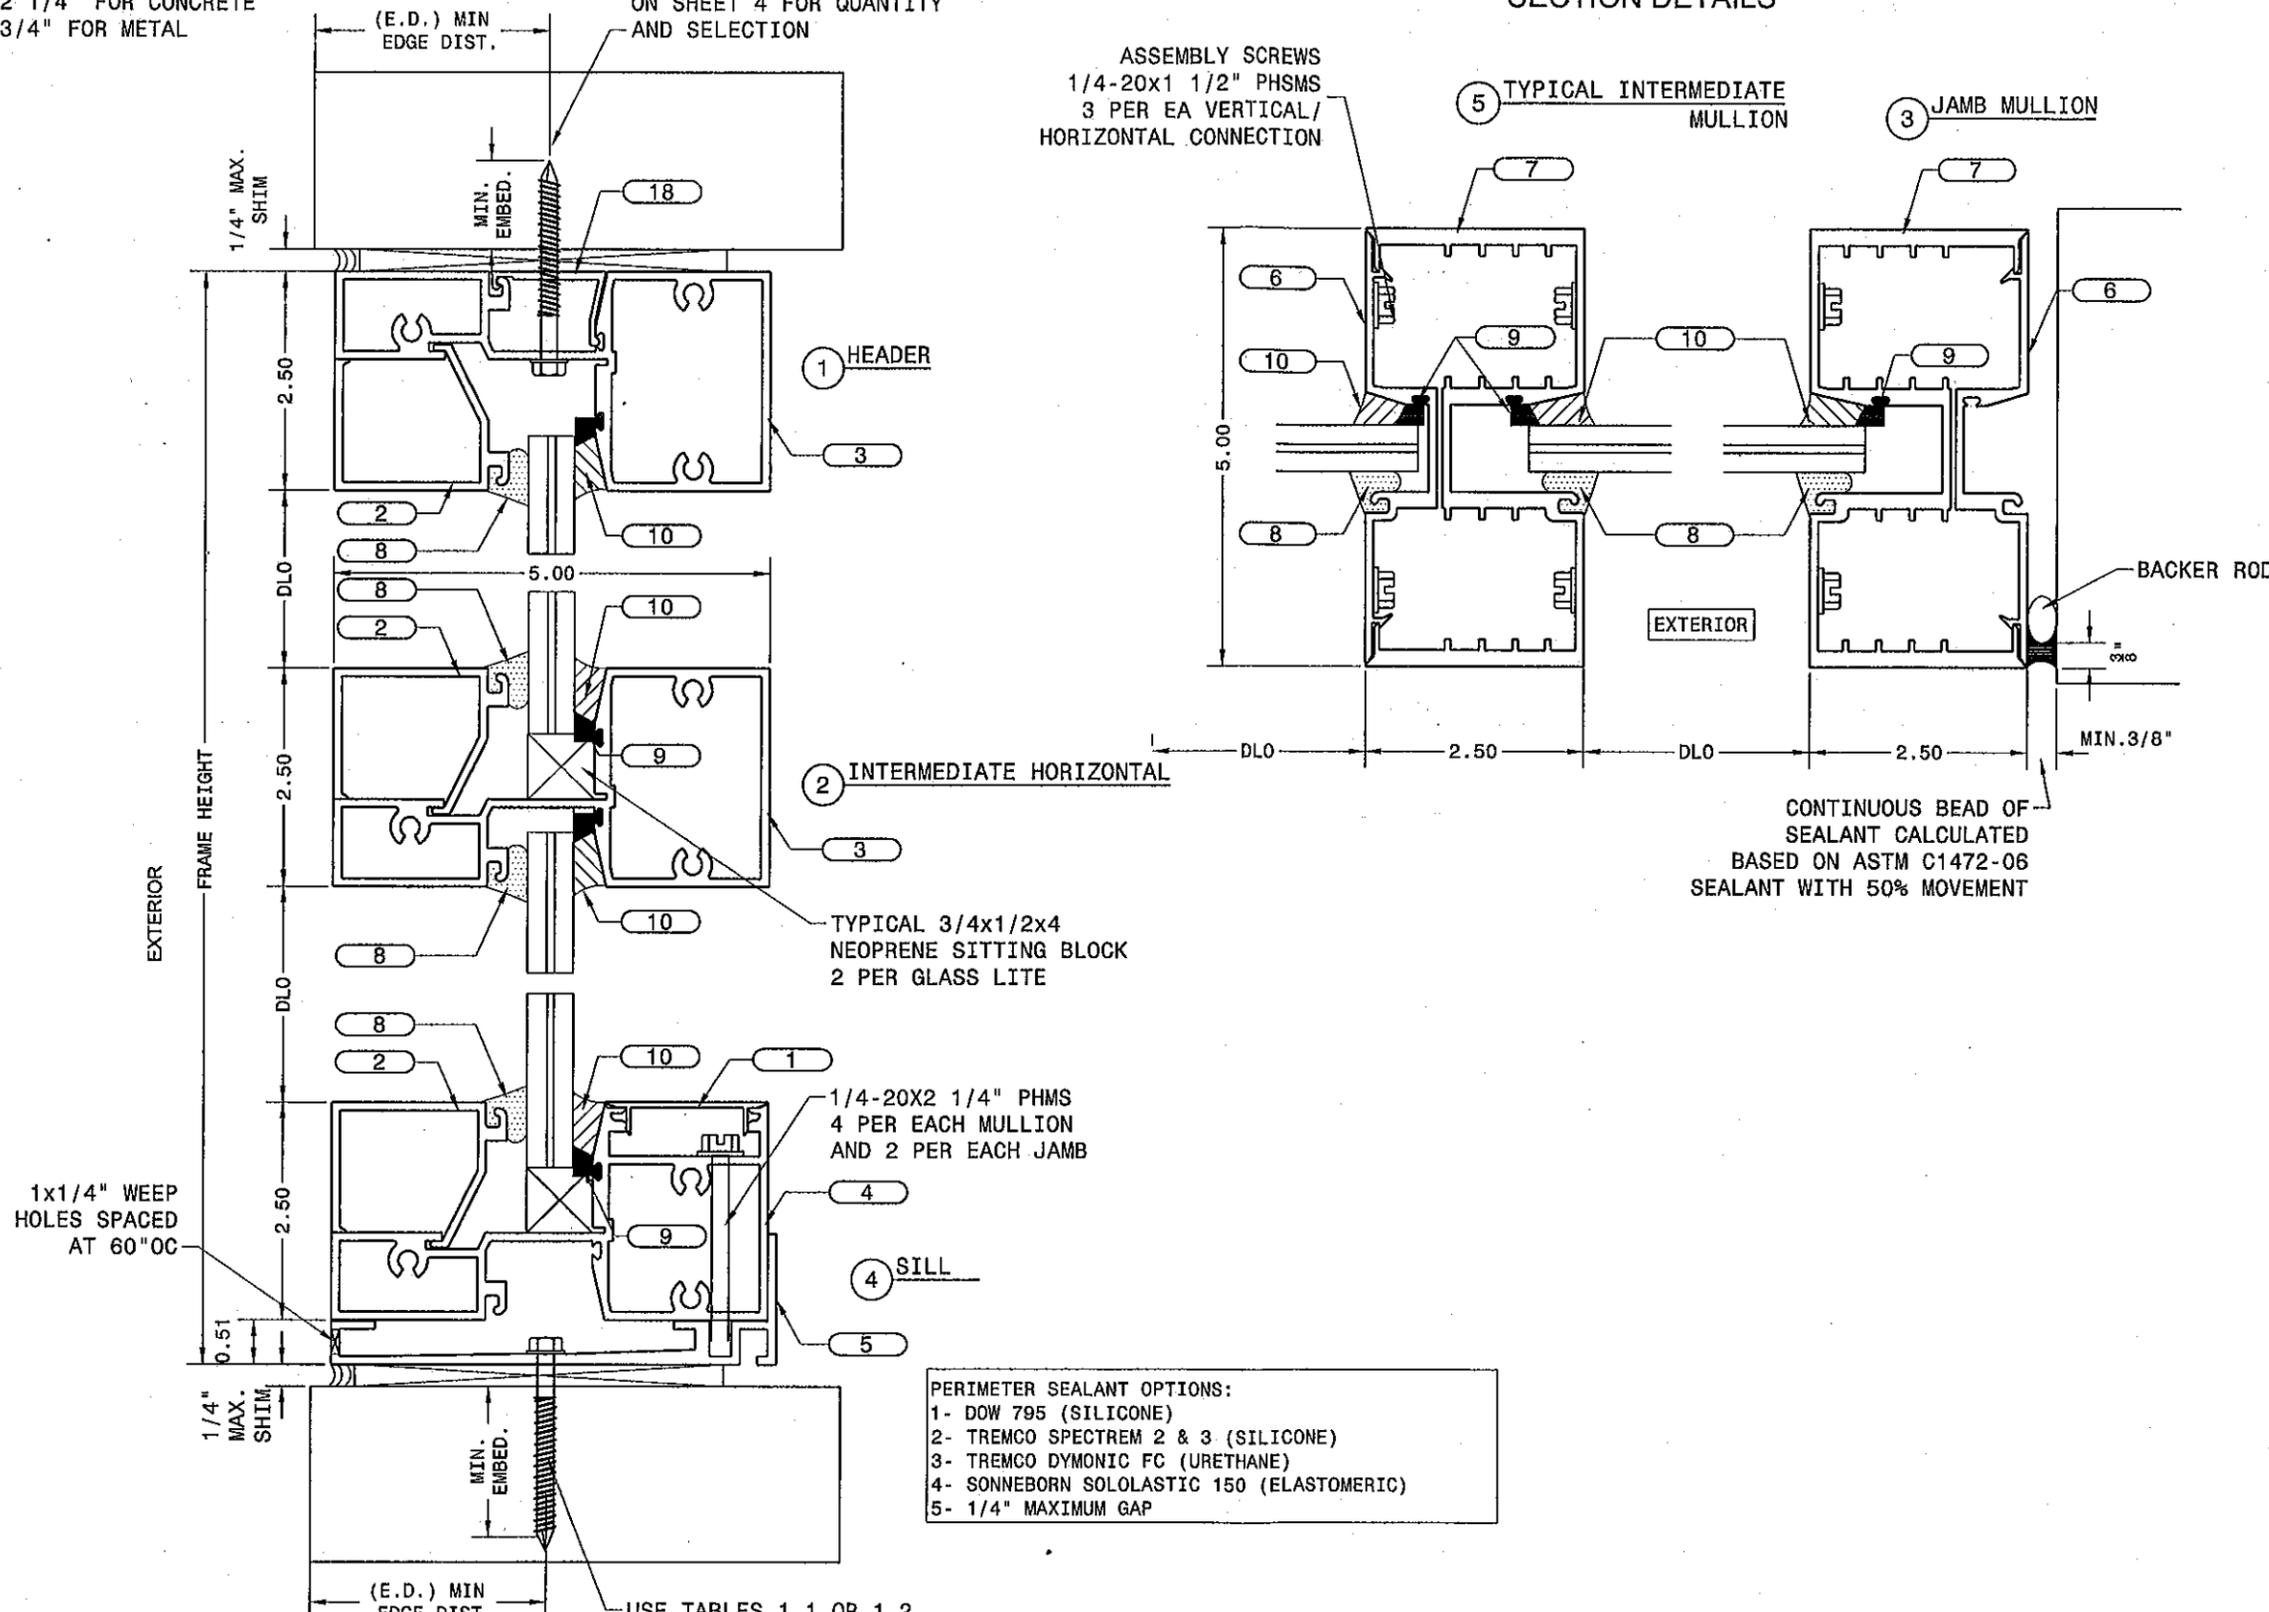

ASSEMBLY SCREWS
 1/4-20x1 1/2" PHMS
 3 PER EA VERTICAL/
 HORIZONTAL CONNECTION

CONTINUOUS BEAD OF
 SEALANT CALCULATED
 BASED ON ASTM C1472-06
 SEALANT WITH 50% MOVEMENT

- PERIMETER SEALANT OPTIONS:
- 1- DOW 795 (SILICONE)
 - 2- TREMCO SPECTREM 2 & 3 (SILICONE)
 - 3- TREMCO DYMONIC FC (URETHANE)
 - 4- SONNEBORN SOLOLASTIC 150 (ELASTOMERIC)
 - 5- 1/4" MAXIMUM GAP

E.D. = 1" FOR WOOD
 E.D. = 2 1/4" FOR CONCRETE
 E.D. = 3/4" FOR METAL

USE TABLES 1.1 OR 1.2
 ON SHEET 4 FOR QUANTITY
 AND SELECTION




GLASS & ALUMINUM SOLUTIONS™
 http://www.trulite.com
 800 FAIRWAY DRIVE, Suite 200
 DEERFIELD BEACH, FL 33441
 p. 800-432-8132 | f. 954-724-2083

PRODUCT:
**IFG 5000 SERIES
 STOREFRONT**
 LARGE & SMALL MISSILE
 IMPACT RATED
Resistor
 PRODUCT SERIES

REVN	DATE/REMARKS




ENGINEER:
EngCo Inc.
 CA 8116
 5595 ORANGE DRIVE SUITE 201
 DAVIE, FL 33314
 ENGCO@AOL.COM

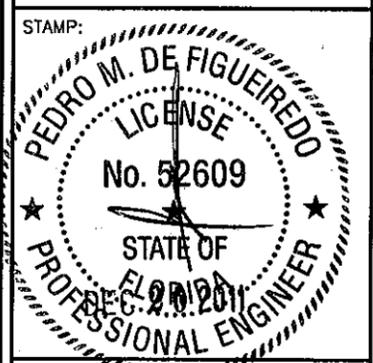

PRODUCT CONTROL APPROVAL:
 PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. **11-1227-07**
 Expiration Date **10/21/2014**
 By *[Signature]*
 Miami Dade Product Control

DRAWN: TRULITE	DRAWING No:
DATE: 12.15.11	2 OF 6
DWG: 11-186	

MULTIPLE MODULE FRAME ANCHORAGE LAY-OUT
 INTERMEDIATE MULLION: 5, DOOR MULLION: 6 AND JAMB MULLION: 3

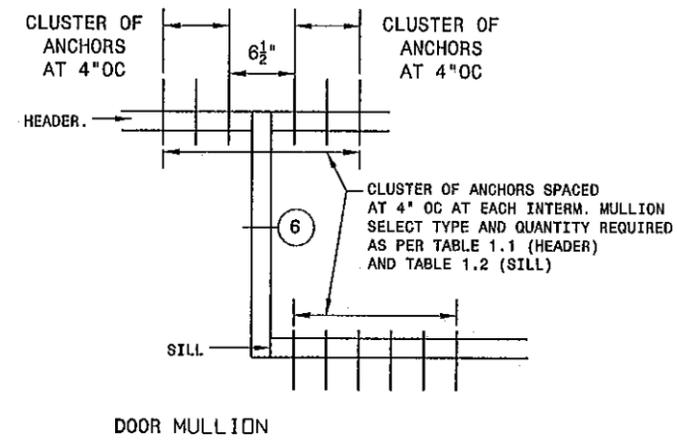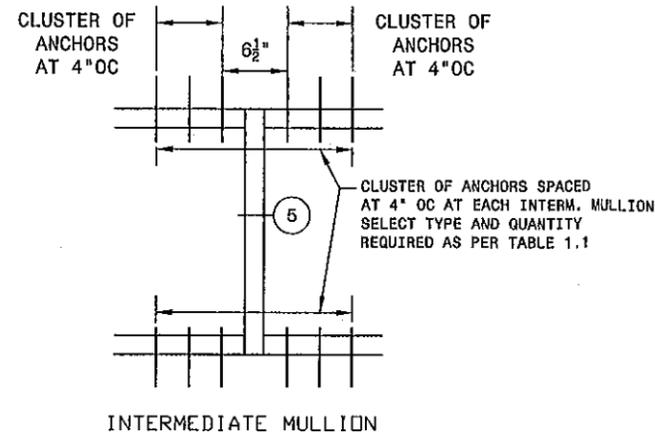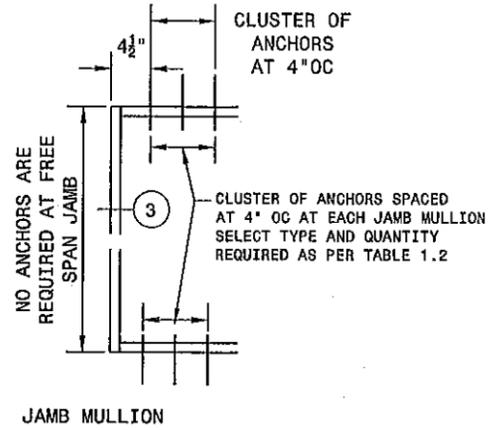

ANCHOR SCHEDULE: (MIN 2 1/2" EDGE DISTANCE)			
TYPE	DESCRIPTION	EMBEDMENT	SUBSTRATE
A	#14 SS WOOD SCREWS	1 1/2"	PT WOOD (SG>=.55)
B	1/4" ULTRACON	1 3/4"	2700 PSI CONCRETE
C	1/4-20 DRIL-FLEX SCREWS	1/8"	6063-T5 ALUMINUM
D	1/4-20 DRIL-FLEX SCREWS	1/8"	ASTM-A36 STEEL
E	5/16" TAPCON	1 3/4"	2899 PSI CONCRETE


- NOTES:
- 1- ANCHORS B, C, AND D ARE MANUFACTURED BY ELCO
 - 2- ANCHORS E IS MANUFACTURED BY ITW BULDEX
 - 3- ANCHOR A IS A GENERIC STAINLESS STEEL 300 SERIES
 - 4- ANCHOR B AND E CAN BE USED INTO WOOD AS AN ALTERNATE
 - 4- ANCHORS ARE REQUIRED ONLY AT SILL AND HEADER LOCATIONS
 - 5- JAMBS ARE NOT ANCHORED TO SIDE STRUCTURE. (SEE TYPICAL ANCHOR LAY-OUT)
 - 6- WHEN REQUIRED DUE TO OVERLAPPING, THE ANCHOR SPACING FOR ANCHOR TYPE A SHALL BE REDUCED FROM 4" OC TO 2" OC.

TABLE 1.1 - NUMBER OF ANCHORS REQUIRED
 HEADER AND SILL INTERM. MULLION DETAIL 5

T.M.W.	ANCHOR TYPE	Pd=85psf				T.M.W.	ANCHOR TYPE	Pd=50psf			
		MODULE HEIGHT						MODULE HEIGHT			
		84	96	108	120			84	96	108	120
24	A	4	4	4	4	24	A	4	4	4	4
	B	4	4	4	4		B	4	4	4	4
	C	4	4	4	4		C	4	4	4	4
	D	4	4	4	4		D	4	4	4	4
	E	4	4	4	4		E	4	4	4	4
30	A	4	4	4	4	30	A	4	4	4	4
	B	4	4	4	4		B	4	4	4	4
	C	4	4	4	4		C	4	4	4	4
	D	4	4	4	4		D	4	4	4	4
	E	4	4	4	4		E	4	4	4	4
48	A	6	6	6	8	48	A	4	4	4	4
	B	4	4	4	4		B	4	4	4	4
	C	4	4	4	6		C	4	4	4	4
	D	4	4	4	4		D	4	4	4	4
	E	4	4	4	4		E	4	4	4	4
67	A	8	8	8	10	67	A	4	6	6	6
	B	4	6	6	6		B	4	4	4	4
	C	6	6	6	6		C	4	4	4	4
	D	4	4	4	4		D	4	4	4	4
	E	4	4	4	6		E	4	4	4	4

TABLE 1.2 - NUMBER OF ANCHORS REQUIRED
 HEADER AND SILL JAMB MULLION DETAIL 3
 AND SILL DOOR MULLION DETAIL 6

T.M.W.	ANCHOR TYPE	Pd=85psf				T.M.W.	ANCHOR TYPE	Pd=50psf			
		MODULE HEIGHT						MODULE HEIGHT			
		84	96	108	120			84	96	108	120
24	A	3	3	3	4	24	A	2	2	2	2
	B	2	2	2	2		B	2	2	2	2
	C	2	2	2	3		C	2	2	2	2
	D	2	2	2	2		D	2	2	2	2
	E	2	2	2	2		E	2	2	2	2
30	A	3	4	4	4	30	A	2	2	3	3
	B	2	2	3	3		B	2	2	2	2
	C	2	3	3	3		C	2	2	2	2
	D	2	2	2	2		D	2	2	2	2
	E	2	2	2	2		E	2	2	2	2
48	A	5	6	6	7	48	A	3	3	4	4
	B	3	4	4	4		B	2	2	3	3
	C	3	4	4	5		C	2	2	3	3
	D	2	3	3	3		D	2	2	2	2
	E	3	3	3	4		E	2	2	2	2
67	A	7	8	8	9	67	A	4	5	5	6
	B	4	5	5	6		B	3	3	3	4
	C	5	5	6	6		C	3	3	4	4
	D	3	4	4	4		D	2	2	2	3
	E	3	4	4	5		E	2	2	3	3

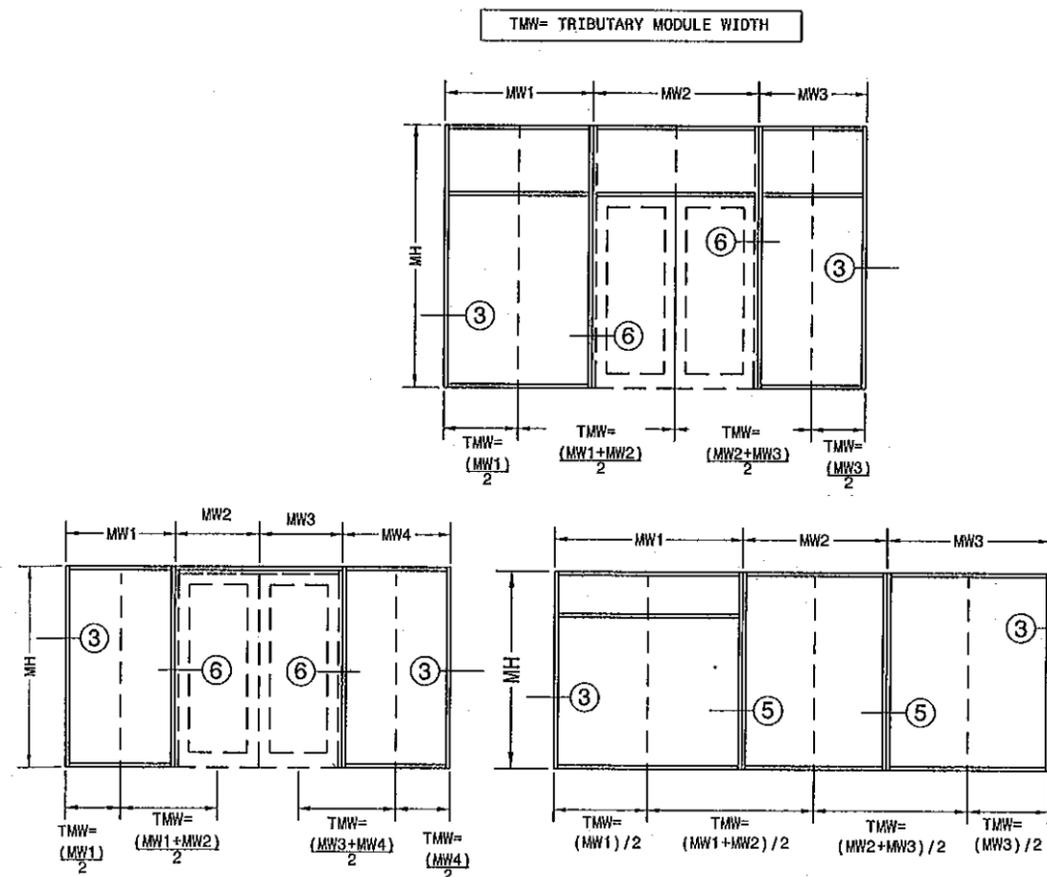

Trulite
 GLASS & ALUMINUM SOLUTIONS™

http://www.trulite.com

800 FAIRWAY DRIVE, Suite 200
 DEERFIELD BEACH, FL 33441
 p. 800-432-8132 | f. 954-724-2083

PRODUCT:

**IFG 5000 SERIES
 STOREFRONT**
 LARGE & SMALL MISSILE
 IMPACT RATED

Resistor
 PRODUCT SERIES

REV# DATE/REMARKS

ENGINEER:

EngCo Inc.

CA 8116
 5595 ORANGE DRIVE SUITE 201
 DAVIE, FL. 33314
 ENGCO@AOL.COM


STAMP:




PRODUCT CONTROL APPROVAL:

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 11-122707
 Expiration Date 10/21/2014
 By: [Signature]
 Miami Dade Product Control


DRAWN: TRULITE DRAWING No:
 DATE: 12.15.11 **4 OF 6**
 DWG: 11-186

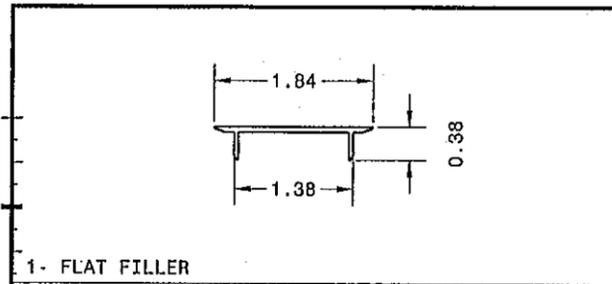


1- FLAT FILLER

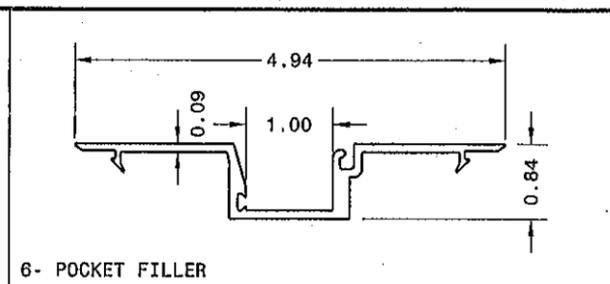


6- POCKET FILLER

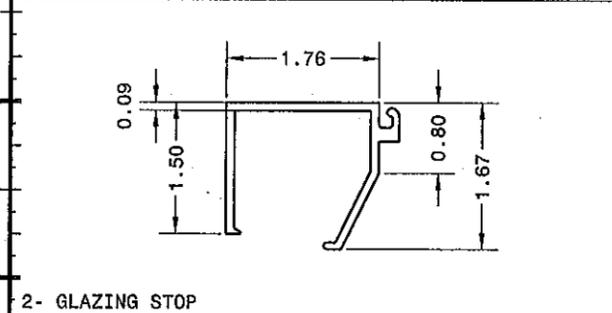

2- GLAZING STOP

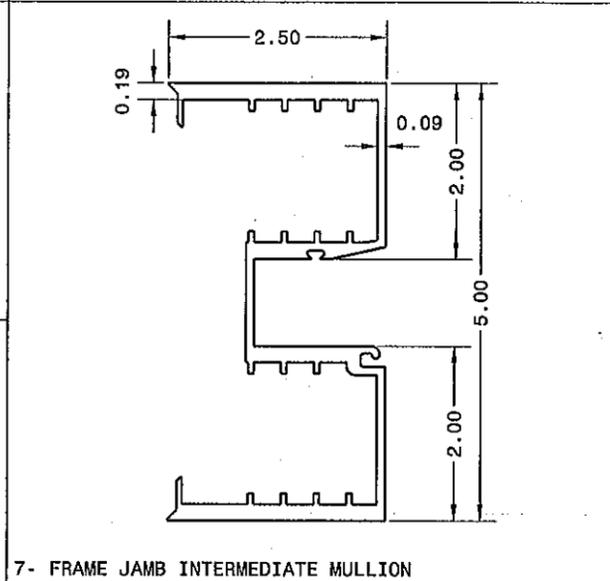


7- FRAME JAMB INTERMEDIATE MULLION

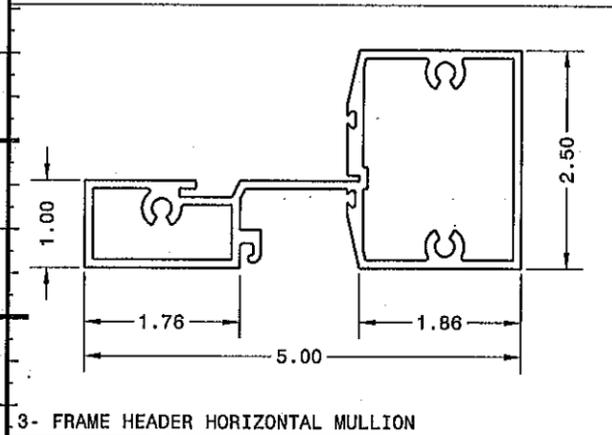


3- FRAME HEADER HORIZONTAL MULLION




8- H-63 WEDGE-IN GASKET

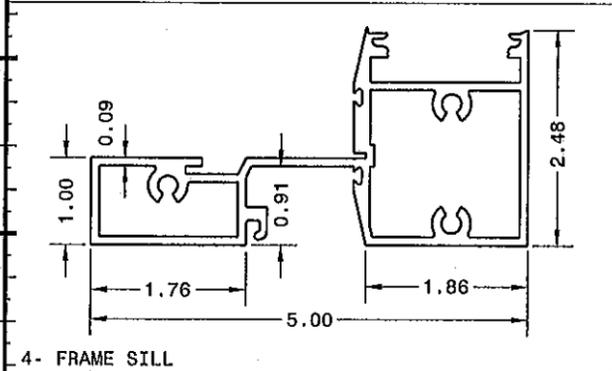


4- FRAME SILL

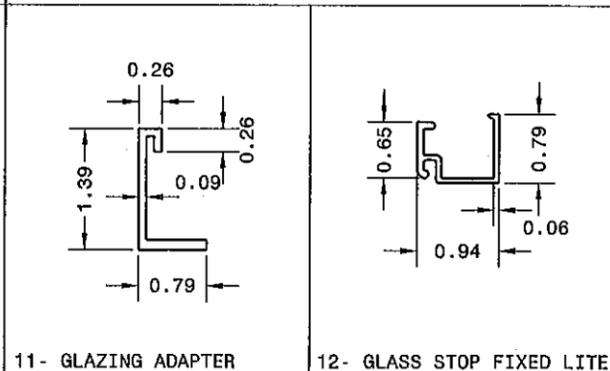


11- GLAZING ADAPTER

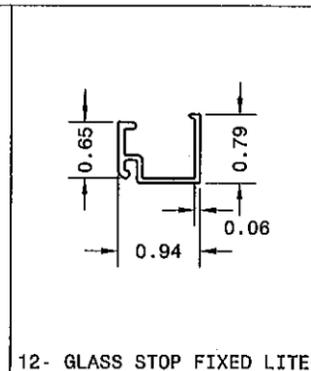

12- GLASS STOP FIXED LITE

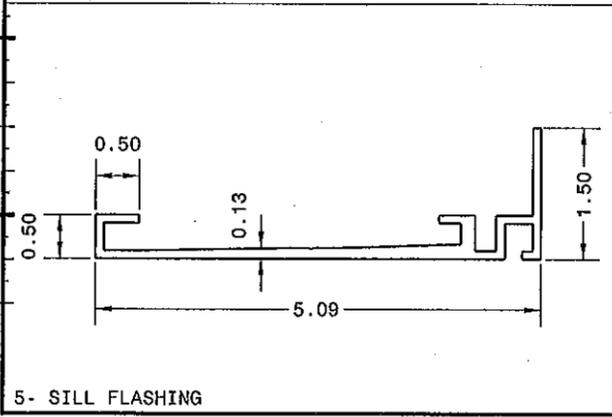

5- SILL FLASHING

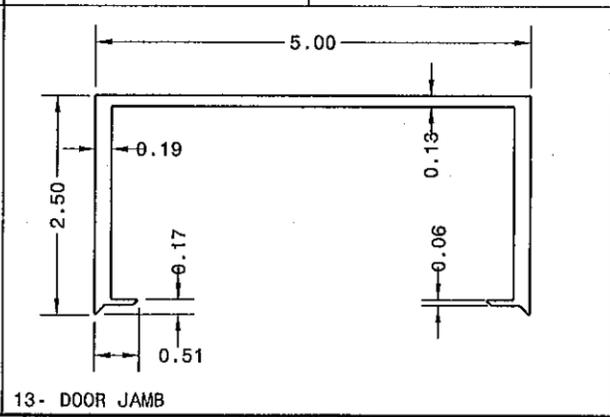


13- DOOR JAMB

FRAMING COMPONENTS & BILL OF MATERIAL				
ITEM #	PART #	DESCRIPTION	MATERIAL	SUPPLIER/REMARKS
1	50507	FLAT FILLER	6063-T6	TRULITE
2	50503	GLAZING STOP	6063-T6	TRULITE
3	50504	HEADER / MULLION	6063-T6	TRULITE
4	50502	SILL	6063-T6	TRULITE
5	50505	SILL FLASHING	6063-T6	TRULITE
6	50506	POCKET FILLER	6063-T6	TRULITE
7	50510	JAMB / MULLION	6063-T6	TRULITE
8	H-63	WEDGE IN GASKET	NEOPRENE	UNIVERSAL RUBBER
9	V2100	TAPE 3/8" X 1/4"	----	NORTON
10	995	STRUCTURAL SILICONE	----	DOW CORNING
11	3008	GLAZING ADAPTER	6063-T6	TRULITE
12	3009	FIXED LITE STOP	6063-T6	TRULITE
13	50512	DOOR JAMB	6063-T6	TRULITE
14	50513	DOOR HEADER / TRANSOM	6063-T6	TRULITE
15		#12-24 X 3/4" PFHMS (UNDERCUT)	SS	
16		1/4"-20 X 5/8" PPHMS	SS	
17	38424	SHEAR BLOCK	6063-T6	TRULITE
18	50508	FLAT POCKET FILLER	6063-T6	TRULITE


RECOMMENDED PERIMETER SEALANTS

ITEM #	DESCRIPTION
1	DOW CORNING 795 SILICONE SEALANT
2	TREMCO SPECTREM 2 SILICONE SEALANT
3	TREMCO SPECTREM 3 SILICONE SEALANT
4	TREMCO DYMERIC 240 POLYURETHANE SEALANT


NOTE: ANY SEALANT WITH JOINT MOVEMENT CAPABILITY (ASTM C719) OF 50% OR GREATER IS ACCEPTABLE FOR USE.

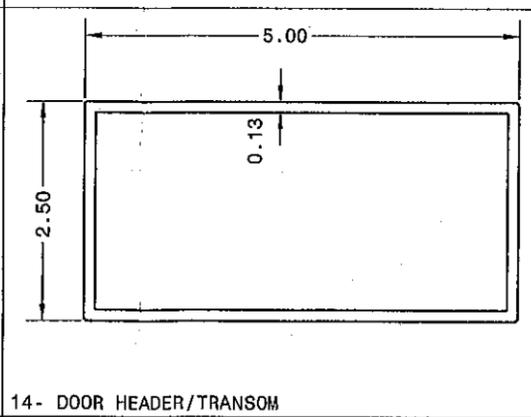

14- DOOR HEADER/TRANSOM

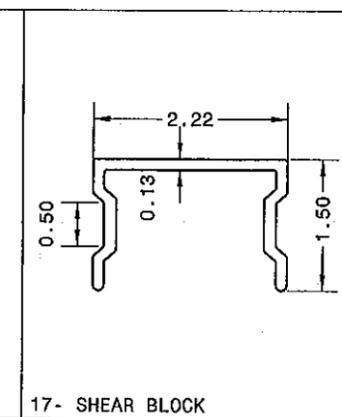

17- SHEAR BLOCK

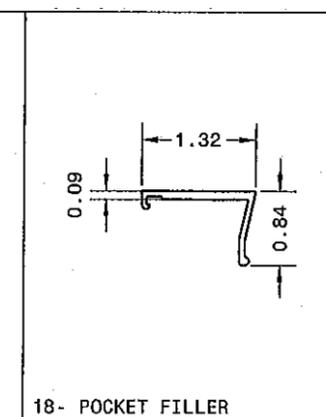

18- POCKET FILLER



http://www.trulite.com

800 FAIRWAY DRIVE, Suite 200
DEERFIELD BEACH, FL 33441
p. 800-432-8132 | f. 954-724-2083

PRODUCT:

**IFG 5000 SERIES
STOREFRONT**
LARGE & SMALL MISSILE
IMPACT RATED



REVN DATE/REMARKS

ENGINEER:

EngCo Inc.

CA 8116
5595 ORANGE DRIVE SUITE 201
DAVIE, FL 33314
ENGCO@AOL.COM

STAMP:



PRODUCT CONTROL APPROVAL:

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 11-1227-07
Expiration Date 10/21/2014
By *[Signature]*
Miami Dade Product Control

DRAWN: TRULITE DRAWING No:
DATE: 12.15.11 **5 OF 6**
DWG: 11-186

PRODUCT:

**IFG 5000 SERIES
STOREFRONT**
LARGE & SMALL MISSILE
IMPACT RATED

Resistor
PRODUCT SERIES

REVN	DATE/REMARKS

ENGINEER:

EngCo Inc.
CA 8116
5595 ORANGE DRIVE SUITE 201
DAVIE, FL. 33314
ENGCO@AOL.COM


STAMP:



PRODUCT CONTROL APPROVAL:

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **11-1227-07**
Expiration Date **10/21/2014**
By *[Signature]*
Miami Dade Product Control

DRAWN: TRULITE	DRAWING No:
DATE: 12.15.11	6 OF 6
DWG: 11-186	

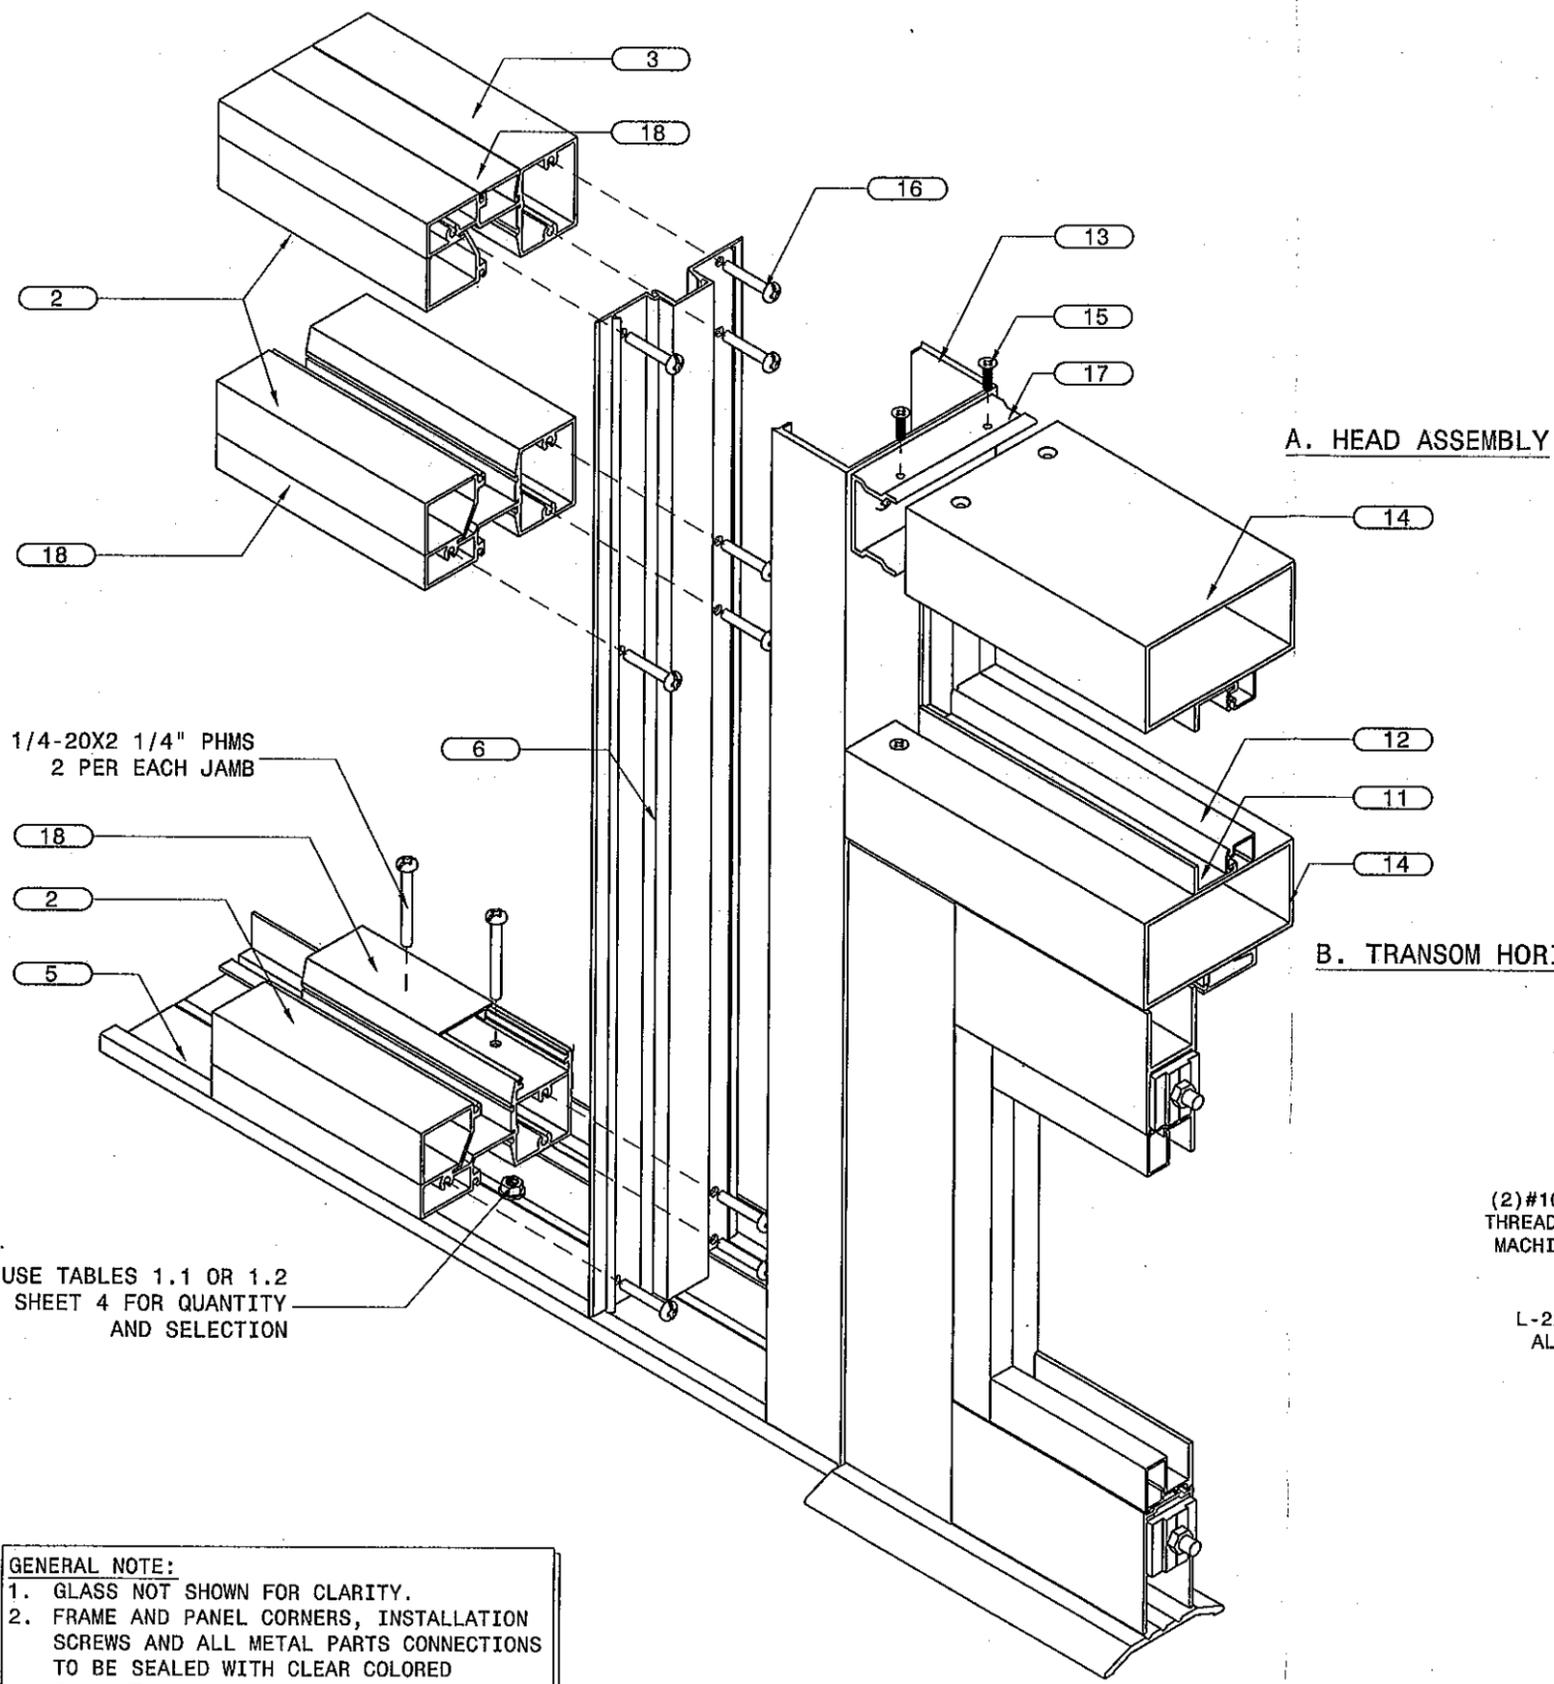

1/4-20x2 1/4" PHMS
2 PER EACH JAMB

USE TABLES 1.1 OR 1.2
ON SHEET 4 FOR QUANTITY
AND SELECTION

GENERAL NOTE:
1. GLASS NOT SHOWN FOR CLARITY.
2. FRAME AND PANEL CORNERS, INSTALLATION
SCREWS AND ALL METAL PARTS CONNECTIONS
TO BE SEALED WITH CLEAR COLORED
SEALANT.

(2) #10-24x3/4" LG
THREAD CUTTING
MACHINE SCREW

L-2x2x1/8" LG
ALUM ANGLE

(2) #10-24x3/4" LG
THREAD CUTTING
MACHINE SCREW

C. DOOR CORNER ASSEMBLY

D. THRESHOLD CONNECTION
AT MULLION DOOR JAMB