



DEPARTMENT OF PERMITTING, ENVIRONMENT, AND REGULATORY  
AFFAIRS (PERA)  
BOARD AND CODE ADMINISTRATION DIVISION  
**NOTICE OF ACCEPTANCE (NOA)**

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/pera/](http://www.miamidade.gov/pera/)

**Clopay Building Products Company**  
8585 Duke Boulevard  
Mason, OH 45040

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County PERA -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. PERA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Gallery/Artistry/Express 2" EPS Ins. Steel Sectional Garage Door up to 16'-2" Wide**

**APPROVAL DOCUMENT:** Drawing No. 104038, titled "Gallery 2" EPS Insulated Garage Door", sheet 1 of 1, dated 12/27/2007, with revision 2 dated 01/06/2012, prepared by Clopay Building Products Company, signed and sealed by Scott Hamilton, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** A permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 08-0701.01 and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by Carlos M. Utrera, P.E.



*Utrera*  
03/27/2012

NOA No 12-0125.10  
Expiration Date: August 7, 2013  
Approval Date: April 5, 2012  
Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawing No. **104038**, titled "Gallery 2" EPS Insulated Garage Door", sheet 1 of 1, dated 12/27/2007, with revision 2 dated 01/06/2012, prepared by Clopay Building Products Company, signed and sealed by Scott Hamilton, P.E.

**B. TESTS "Submitted under NOA # 08-0701.01"**

1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94  
5) Tensile Test per ASTM E8

Along with marked-up drawings and installation diagram of 16'2"x 8', 27ga, Series Gallery, Model GD2SP steel garage door, prepared by American Test Lab, Inc., Test Report No. **ATLNC 0331.01-08**, dated 05/13/2008, signed and sealed by David W. Johnson, P.E.

2. Test report on Salt Spray per ASTM B117 of painted G40 galvanized coated panels, prepared by Stork Materials Technology, Test Report No. **30160-04-63365**, dated 01/26/2005, signed by John D. Lee, P.E.

**C. CALCULATIONS "Submitted under NOA # 08-0701.01"**

1. Jamb anchor calculations, prepared by Clopay Building Products Company, dated 06/26/2008, signed and sealed by Scott Hamilton, P.E.

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Permitting, Environment, and Regulatory Affairs (PERA)

**E. MATERIAL CERTIFICATIONS "Submitted under NOA # 07-0807.14"**


1. Test report on Surface Burning Characteristics, per ASTM E84 of Type I EPS, Report No. **3082960-500**, prepared by Intertek Testing Services, NA, Inc., dated 10/04/2005, signed by Javier Trevino.
2. Test report on Ignition Properties of Plastics per ASTM D1929 of Type I EPS, Report No. **3082959-500**, prepared by Intertek Testing Services, NA, Inc., dated 09/16/2005, signed by C. Anthony Peñafoza.

**F. STATEMENTS**

1. Statement letter of code conformance to 2007 and 2010 FBC, dated 01/19/2012, signed and sealed by Scott Hamilton, P.E.

**"Submitted under NOA # 08-0701.01"**

2. Statement letter of no financial interest issued by Clopay Building Products Company, dated 06/26/2008, signed and sealed by Scott Hamilton, P.E.

  
03/27/2012

Carlos M. Utrera, P.E.

Product Control Examiner



NOA No 12-0125.10

Expiration Date: August 7, 2013




Approval Date: April 5, 2012

BRAND/SERIES	MODEL NUMBERS	
CLOPAY/GALLERY	GD2SP, GR2SP	GD2LP, GR2LP
HOLMES/ARTISTRY	AR2SP	AR2LP
IDEAL/EXPRESSIONS	ED2SP	ED2LP
	SHORT PANEL	LONG PANEL

REV	DATE	DESCRIPTION
00	03/12/2008	INITIAL RELEASE
01	06/25/2008	REVISED FOR M-O.
02	01/06/2012	AFFIRMED COMPLIANCE WITH 2010 FBC

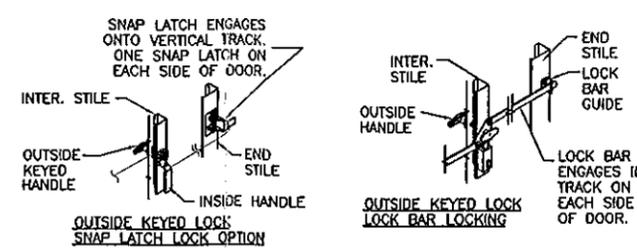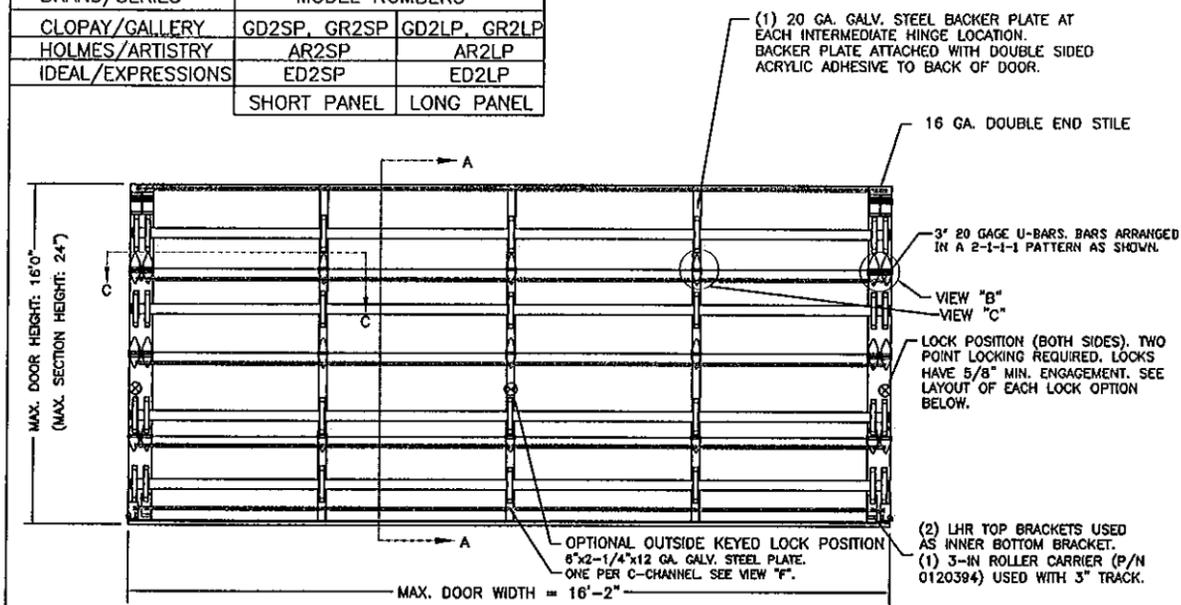

**SECTION C-C (JAMB CONFIGURATION)**

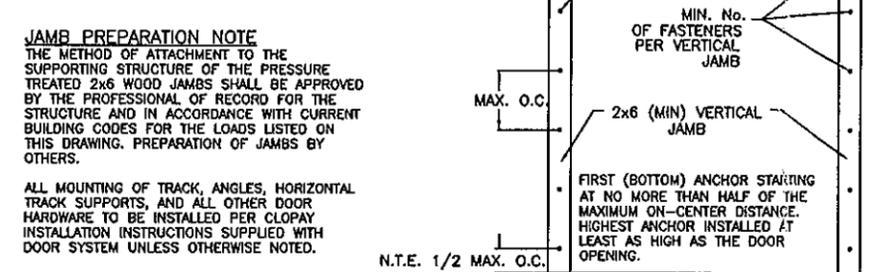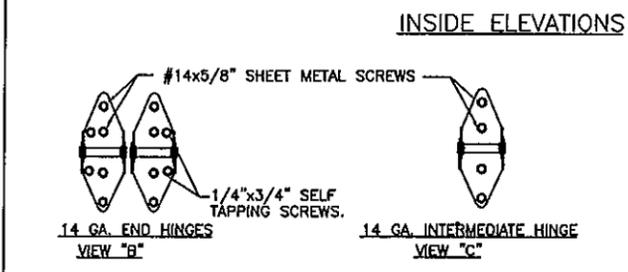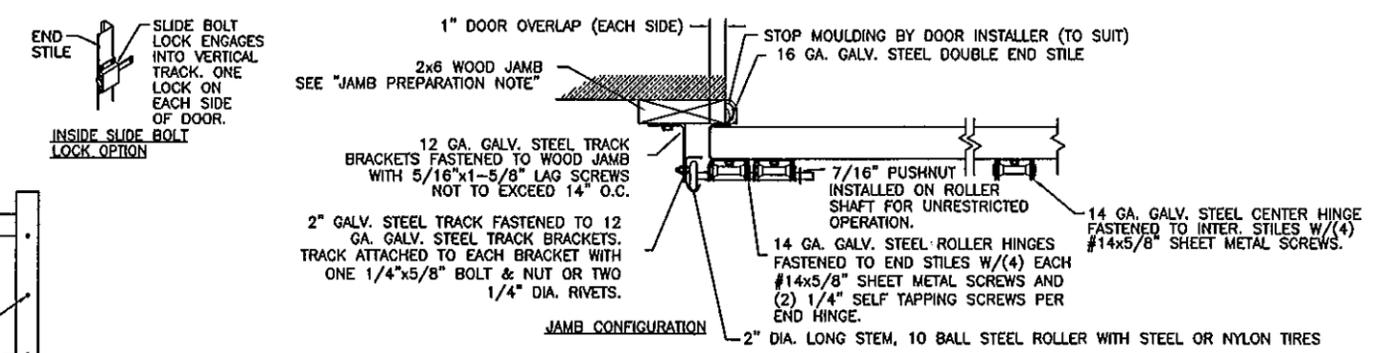


**JAMB TO SUPPORTING STRUCTURE ATTACHMENT**

- NOTES:**
1. ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE TRACK AND THEN FROM THE TRACK TO THE 2x6 VERTICAL SYP (GRADE #2 OR BETTER) JAMBS. NO LOAD FROM THE DOOR IS TRANSFERRED TO THE HORIZONTAL (TOP) JAMB.
  2. EACH VERTICAL JAMB SEES A MAXIMUM DESIGN LOAD OF +372.8 LB & -416 LB. PER LINEAR FOOT OF JAMB.
  3. ALL JAMB FASTENERS MAY BE (BUT ARE NOT REQUIRED TO BE) COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.
  4. A 1/3 STRESS INCREASE FOR WIND LOAD WAS NOT USED IN THE CALCULATION OF ALLOWABLE LOADS FOR ANCHORS AND FASTENERS FOR STEEL, CONCRETE AND MASONRY.
  5. 2x8 JAMBS MAY BE USED WITH 3\"

**WOOD FRAME BUILDINGS**  
 STUD WALLS OF DOOR OPENING SHALL BE FRAMED SOLID BY NOT LESS THAN (3) 2x6 PRESSURE TREATED SYP (GRADE #2 OR BETTER) WOOD STUDS OF A STRESS GRADE NOT LESS THAN 1200 PSI NOMINAL EXTREME FIBER STRESS IN BENDING (F<sub>b</sub>) FOR DOORS UP TO 8'0\"

**BLOCK WALL OR CONCRETE**  
 2x6 SYP (GRADE #2 OR BETTER) WOOD JAMB SHALL BE ANCHORED TO GROUT REINFORCED BLOCK WALL OR CONCRETE COLUMN. BLOCK WALL CELLS SHALL BE FILLED WITH CONCRETE AND REINFORCED WITH REINFORCING BARS EXTENDING INTO THE FOOTING AND INTO THE BEAMS. ALL BARS SHALL BE CONTINUOUS FROM THE TIE BEAMS TO FOOTING PER BLOCK WALL OR CONCRETE COLUMN. BLOCK WALLS AND CONCRETE COLUMNS TO BE DESIGNED BY THE BUILDING ENGINEER OR ARCHITECT OF RECORD AND IN ACCORDANCE WITH THE FLORIDA BUILDING CODE.


**SECTION A-A (SIDE VIEW)**

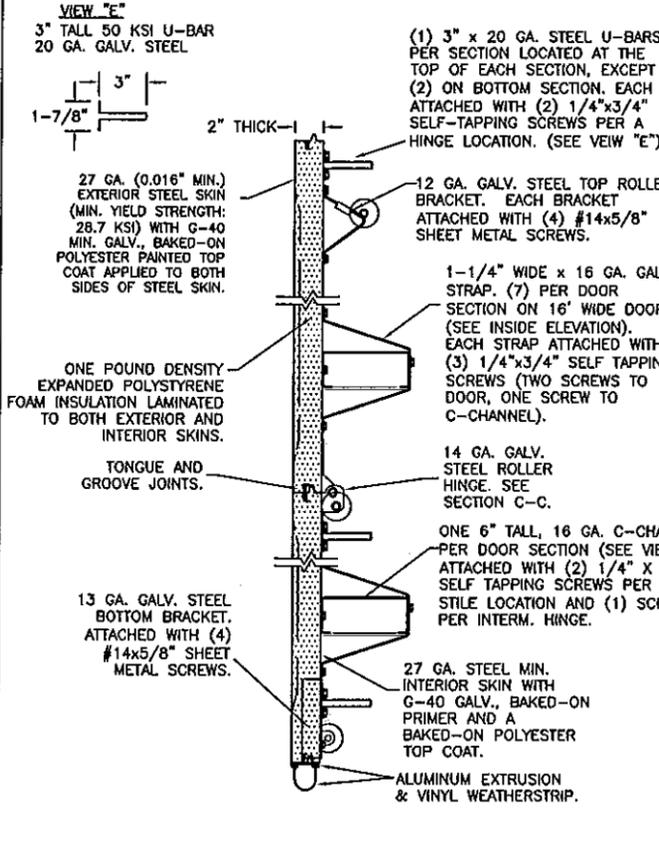


**2x6 JAMB TO SUPPORTING STRUCTURE ATTACHMENT**  
 (NOT TO BE USED FOR ATTACHMENT OF TRACK ANGLE TO 2x6 VERTICAL JAMBS OR SUPPORTING STRUCTURE)

BUILDING TYPE	FASTENER TYPE	MAXIMUM ON-CENTER DISTANCE BETWEEN FASTENERS	STEEL WASHERS REQUIRED?
BLOCK WALL	1/4\"	4-1/2\"	1\" O.D.
3000 PSI MIN. CONCRETE	1/4\" x 1-3/4\" MIN. EMBED TAPCON CONCRETE ANCHOR	12-1/2\"	1\" O.D.
3000 PSI MIN. CONCRETE	1/2\" x 2-1/4\" MIN. EMBED SIMPSON STRONG-TIE WEDGE-ALL WEDGE ANCHOR	12-1/2\"	INCLUDED
2000 PSI MIN. CONCRETE	3/8\" x 1-3/4\" MIN. EMBED SLEEVE ANCHOR	14\"	INCLUDED
WOOD FRAME (SYP 0.55 SG) 1/2\" x 3\" LAG SCREW (ASTM A307, GRADE A) 1-5/8\" EMBED INTO STRUCTURE		14-1/2\"	1\" O.D.


MINIMUM DISTANCE BETWEEN CENTER OF ANCHOR AND EDGE OF CONCRETE BLOCK: 3\", EXCLUDING STUCCO THICKNESS.  
 \* FIRST (BOTTOM) ANCHOR STARTING AT NO MORE THAN HALF OF THE MAXIMUM ON-CENTER DISTANCE. HIGHEST ANCHOR INSTALLED AT LEAST AS HIGH AS THE DOOR OPENING.  
 CLOPAY DOES NOT SUPPLY JAMB ATTACHMENT FASTENERS.

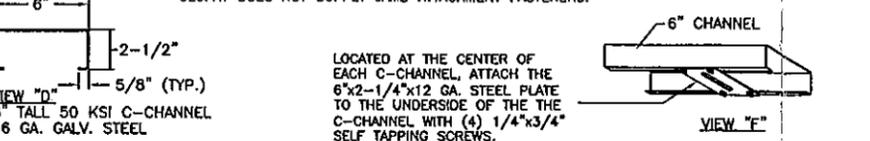

**TRACK CONFIGURATION DOORS UP TO 8'0\"**

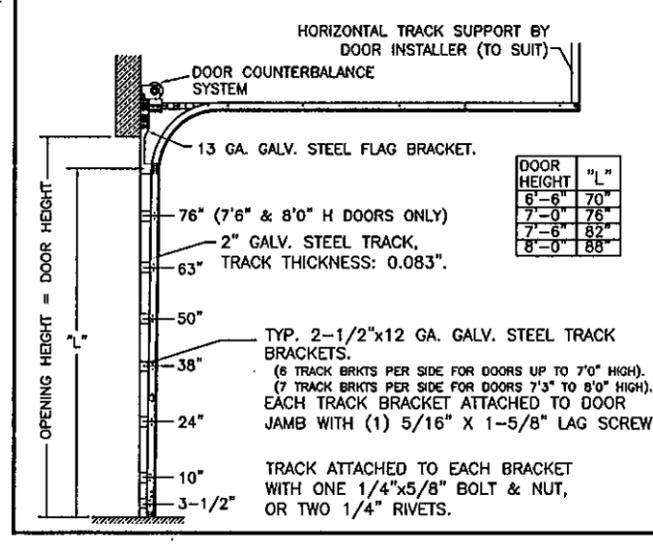

**TRACK CONFIGURATION DOORS 8'3\"**

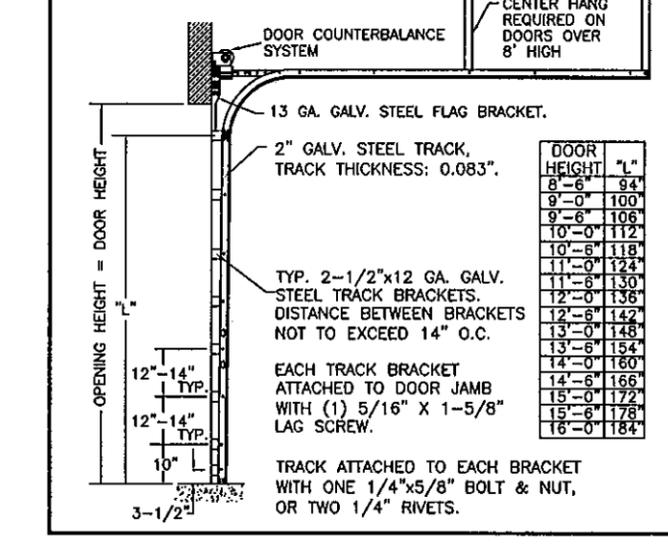

**NOTE:** SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER FOR WIND LOADS SHOWN ON THIS DRAWING.

**PRODUCT REVISED**  
 as complying with the Florida Building Code  
 Acceptance No 12-0125-10  
 Expiration Date 02/07/2013  
 By *[Signature]*  
 Miami Dade Product Control

THIS PRODUCT CONFORMS TO THE REQUIREMENTS OF THE 2007 AND 2010 FBC.  
*[Signature]*  
 SCOTT HAMILTON, P.E.  
 FLORIDA P.E. #63286

**Glopay**  
 Building Products Company

CLOPAY BUILDING PRODUCTS COMPANY  
 8585 DUKE BLVD.  
 MASON, OH 45040  
 (513) 770-4800

MANUFACTURING PRODUCT CODE	DSIE-1F471
DATE	12/27/07
DRAWN BY	BFA
CHECKED BY	

CLOPAY WINDLOAD RATING	W8	MAX DOOR SIZE	16'2\"
DESCRIPTION	GALLERY 2\"		
DRAWING NUMBER	104038	VER	M-D

Clopay Corporation All Rights Reserved.