



DEPARTMENT OF PERMITTING, ENVIRONMENT, AND REGULATORY AFFAIRS (PERA)

BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/pera/

Lawson Industries, Inc.

8501 NW 90th Street

Medley, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County PERA-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. PERA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "SDG-9200" Aluminum Sliding Glass Door - L. M. I.

APPROVAL DOCUMENT: Drawing No. L9200-1101, titled "Series SGD-9200 Aluminum Sliding Glass Door (LMI)", sheets 1 through 5 of 5, prepared by manufacture, dated 10/21/02, with the latest revision "A", dated 03/30/12, signed and sealed by Thomas J. Soto, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LIMITATIONS:

1. Glass lite wider than 36" shall be supported with approved setting blocks or clamps per FBC requirements.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/ series and following statement: "Miami-Dade County Product Control Approved" unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. 11-0518.04 and consists of this page 1, evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
4/5/12

NOA No. 12-0127.24
Expiration Date: February 13, 2013
Approval Date: April 12, 2012
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under previous NOA No. 02-1126.04)
2. Drawing No. L9200-1101, titled "Series SGD-9200 Aluminum Sliding Glass Door (LMI)", sheets 1 through 5 of 5, prepared by manufacture, dated 10/21/02, with the latest revision "A", dated 03/30/12, signed and sealed by Thomas J. Soto, P. E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, Type "C" sliding door, Grade 10, per FBC 2411.3.2.1, TAS 202-94 and per ASTM F 842-04along with marked-up drawings and installation diagram of an Aluminum Sliding Glass Door, prepared by Fenestration Testing Laboratory, Inc., Test Reports No.'s FTL-3525 and FTL-3572, dated 09/09/02, both signed and sealed by Joseph Chan, P. E.
(Submitted under previous NOA No. 02-1126.04)

C. CALCULATIONS


1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Lawson Industries, Inc., dated 04/26/11, signed and sealed by Thomas J. Soto, P. E.
(Submitted under previous NOA No. 11-0518.04)
2. Statement letter of conformance and compliance with the FBC-2010, dated 01/25/12, signed and sealed by Thomas J. Sotos, P. E.
3. **Glazing complies with ASTM E1300-98/ 04**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Permitting, Environment, and Regulatory Affairs (PERA).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. 11-0624.02 issued to E.I. DuPont DeNemours & Co., Inc. for their "DuPont Sentry Glass® Interlayer" dated 05/26/2010, expiring on 01/14/17.
2. Notice of Acceptance No. 11-0624.01 issued to E.I. DuPont DeNemours & Co., Inc. for their "DuPont Butacite® PVB Interlayer" dated 09/08/2011, expiring on 12/11/2016.



Jaime D. Gascon, P. E.

Product Control Section Supervisor
NOA No. 12-0127.24

Expiration Date: February 13, 2013
Approval Date: April 12, 2012

Lawson Industries, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS


1. Statement letter of conformance, no financial interest and compliance with the **FBC-2010**, dated 01/25/12, signed and sealed by Thomas J. Sotos, P. E.
2. Proposal issued by Product Control, dated 03/30/12, signed by Ishaq Chanda, P. E.
3. Testing agreement letter, dated March 30, 2012 between Hurricane Engineering & Testing, Inc. (HETI) and Lawson Industries, Inc., issued by HETI.
4. Letter of *Adoption of as his Own, the Work of another Engineer* per Section 61G15-27 of the FBPE, dated 05/02/11 signed and sealed by Thomas J. Sotos, P. E.
(Submitted under previous NOA No. 11-0581.04)
5. Laboratory compliance letter for Test Reports No.'s **FTL-3525** and **FTL-3572**, issued by Fenestration Testing Laboratory, Inc., dated 09/09/02, both signed and sealed by Joseph Chan, P. E.
(Submitted under previous NOA No. 02-1126.04)

G. OTHERS


1. Notice of Acceptance No. **11-0518.04**, issued to Lawson Industries, Inc. for their Series "**9200 Aluminum Sliding Glass Door - L.M.I.**", approved on 06/30/11 and expiring on 02/13/13.




Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 12-0127.24
Expiration Date: February 13, 2013
Approval Date: April 12, 2012

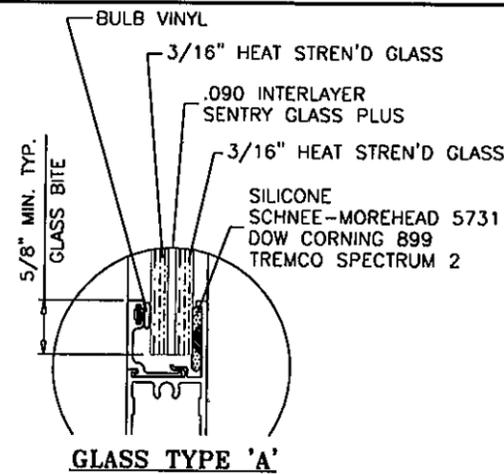

GLASS TYPE 'A'

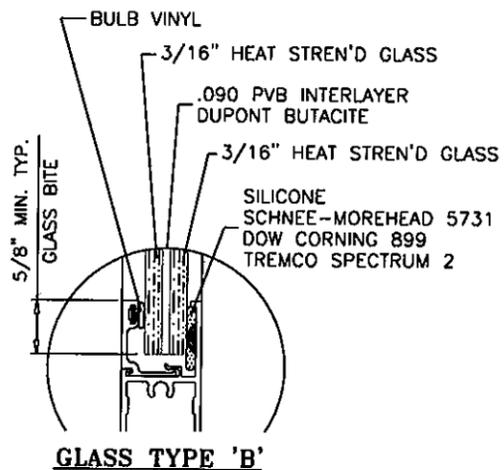

GLASS TYPE 'B'

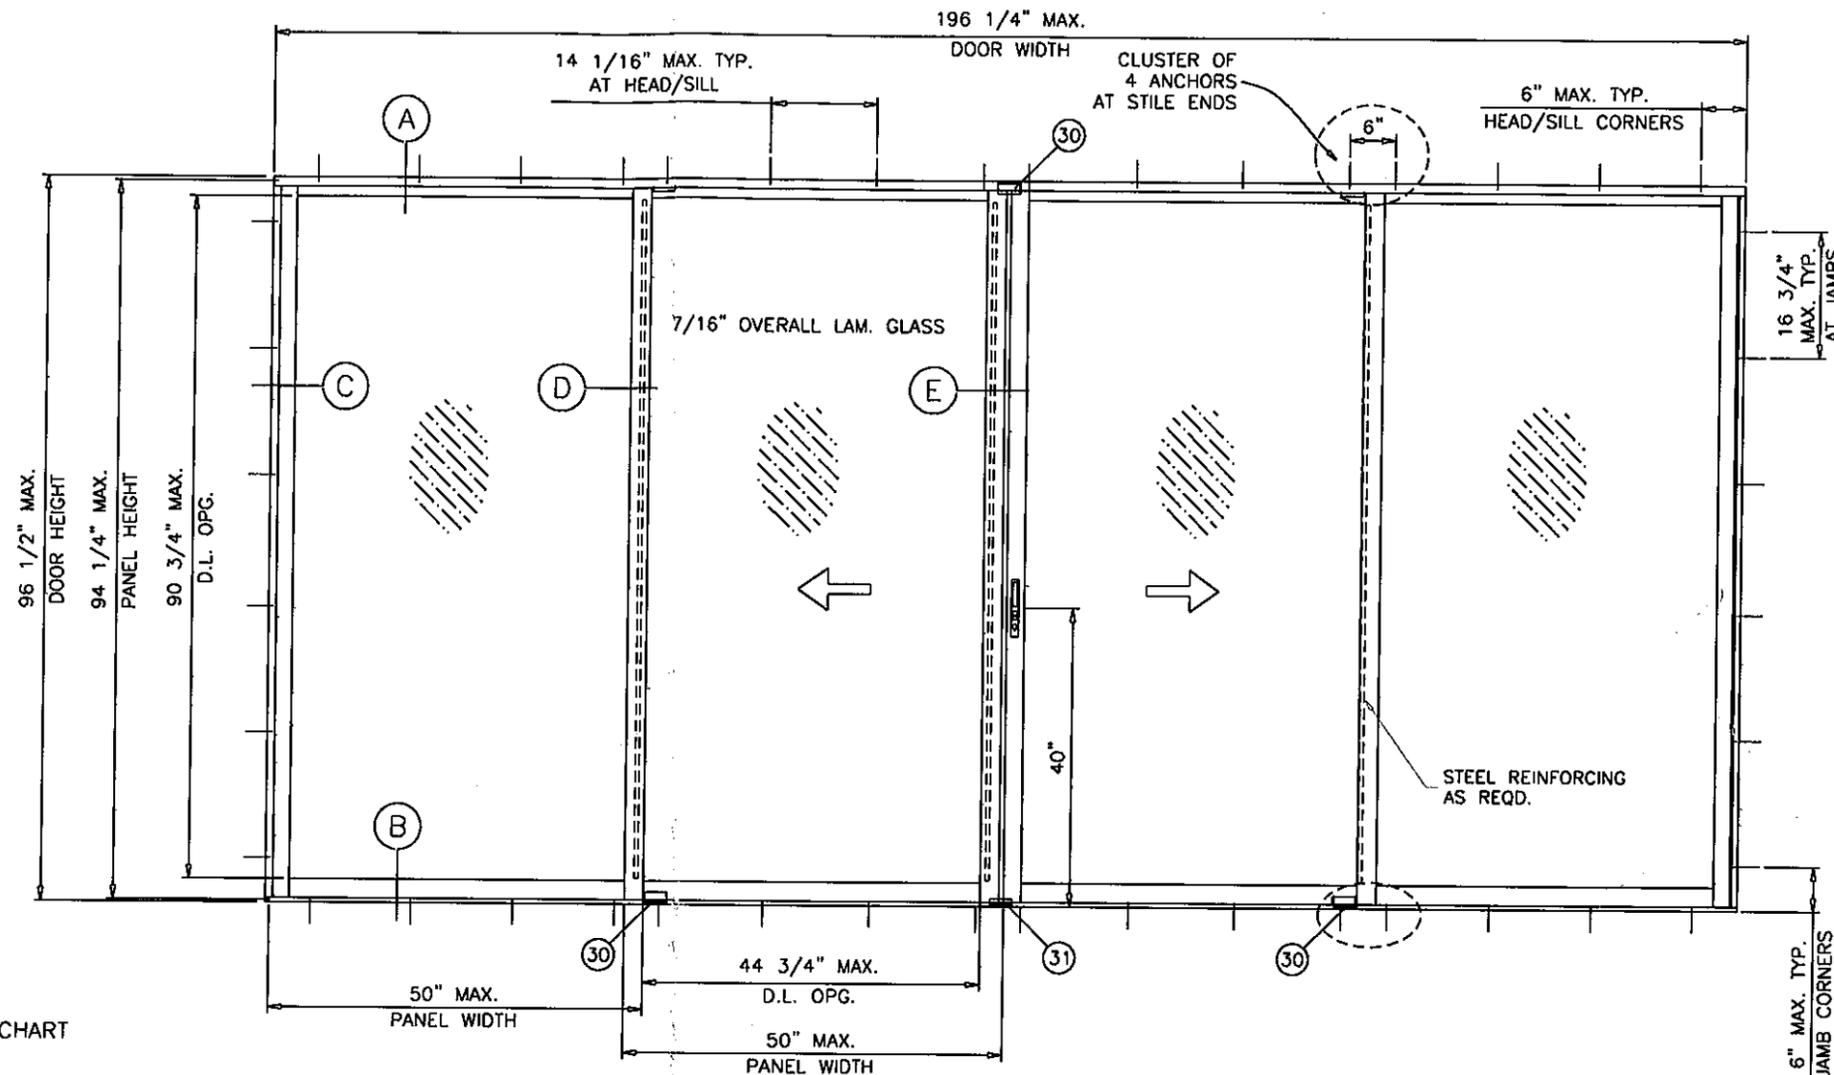

TYPICAL ELEVATION
TESTED UNIT

DOORS GLAZED WITH LAMINATED GLASS RATED FOR LARGE MISSILE IMPACT AND REQUIRE NO SHUTTERS.

SGD-9200 ALUMINUM SLIDING GLASS DOOR

DESIGN LOAD RATING FOR THESE DOORS TO BE AS PER CHART SHOWN.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2010 INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF 2010 FLORIDA BLDG. CODE SECTION 2003.8.4 (SUPPLEMENT 2005).

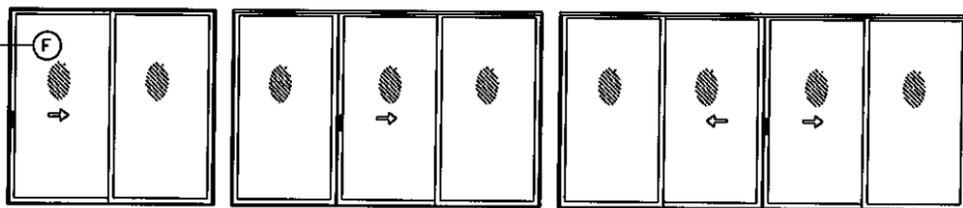

APPROVED CONFIGURATIONS

TWO TRACK FRAME DOOR CONFIGURATIONS OF MORE THAN FOUR PANELS USING STILE COMBINATIONS SHOWN IN THESE DETAILS MAY ALSO BE APPROVED (EXAMPLE OXXXOO).

PANEL MAX. D.L.O.:
 3/0 X 6/8 = 32-3/4" X 74-3/4"
 4/0 X 6/8 = 44-3/4" X 74-3/4"
 4/11 X 6/8 = 55-3/4" X 74-3/4"
 3/0 X 8/0 = 32-3/4" X 90-3/4"
 4/0 X 8/0 = 44-3/4" X 90-3/4"

**DESIGN LOAD CAPACITY - PSF
GLASS TYPES 'A' OR 'B'**

| PANEL WIDTH NOMINAL FT./IN. | DOOR HEIGHT FT./IN. | STANDARD SILL | | 2-1/4" RISER | | 3" RISER | |
|-----------------------------------|------------------------|---------------|----------|--------------|----------|----------|----------|
| | | EXT. (+) | INT. (-) | EXT. (+) | INT. (-) | EXT. (+) | INT. (-) |
| 2/6 | 6/8 | 40.7 | 60.0 | 56.7 | 60.0 | 60.0 | 60.0 |
| 3/0 | | 40.7 | 60.0 | 56.7 | 60.0 | 60.0 | 60.0 |
| 3/6 | | 40.7 | 60.0 | 56.7 | 60.0 | 60.0 | 60.0 |
| 4/0 | | 40.7 | 60.0 | 56.7 | 60.0 | 60.0 | 60.0 |
| 4/6 | | 40.7 | 60.0 | 56.7 | 60.0 | 60.0 | 60.0 |
| 4/11 | 8/0 | 40.7 | 60.0 | 56.7 | 60.0 | 60.0 | 60.0 |
| 2/6 | | 40.7 | 60.0 | 56.7 | 60.0 | 60.0 | 60.0 |
| 3/0 | | 40.7 | 60.0 | 56.7 | 60.0 | 60.0 | 60.0 |
| 3/6 | | 40.7 | 60.0 | 56.7 | 60.0 | 60.0 | 60.0 |
| 4/0 | | 40.7 | 60.0 | 56.7 | 60.0 | 60.0 | 60.0 |

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-98 (60 SEC. WIND)

**LAMINATED GLASS
LARGE MISSILE IMPACT**

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0127.24
Expiration Date 02/13/2013
By [Signature]
Miami Dade Product Control

LAWSON
INDUSTRIES, INC.



8501 N.W. 90 ST.
MEDLEY, FLORIDA 33166
PH No. (305) 696-8660

MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS
SGD-9200 ALUMINUM SLIDING GLASS DOOR (L.M.I.)
APPROVED ELEVATIONS, GENERAL NOTES, GLAZING DETAILS & DP LOAD CHARTS

Revision Notes: A. Revised to Comply w/ 2010 FBC

Date Drawn: 04/28/11
Date Revised: 01/20/12
Drawn By: N. ERAZO
Revised By: N. ERAZO
Scale: A

THOMAS J. SOTOS
PROFESSIONAL ENGINEER
FL LIC. # 11625
Professional Seal
No 55225
STATE OF FLORIDA
Professional Engineer
DATE: MAR 23 2012

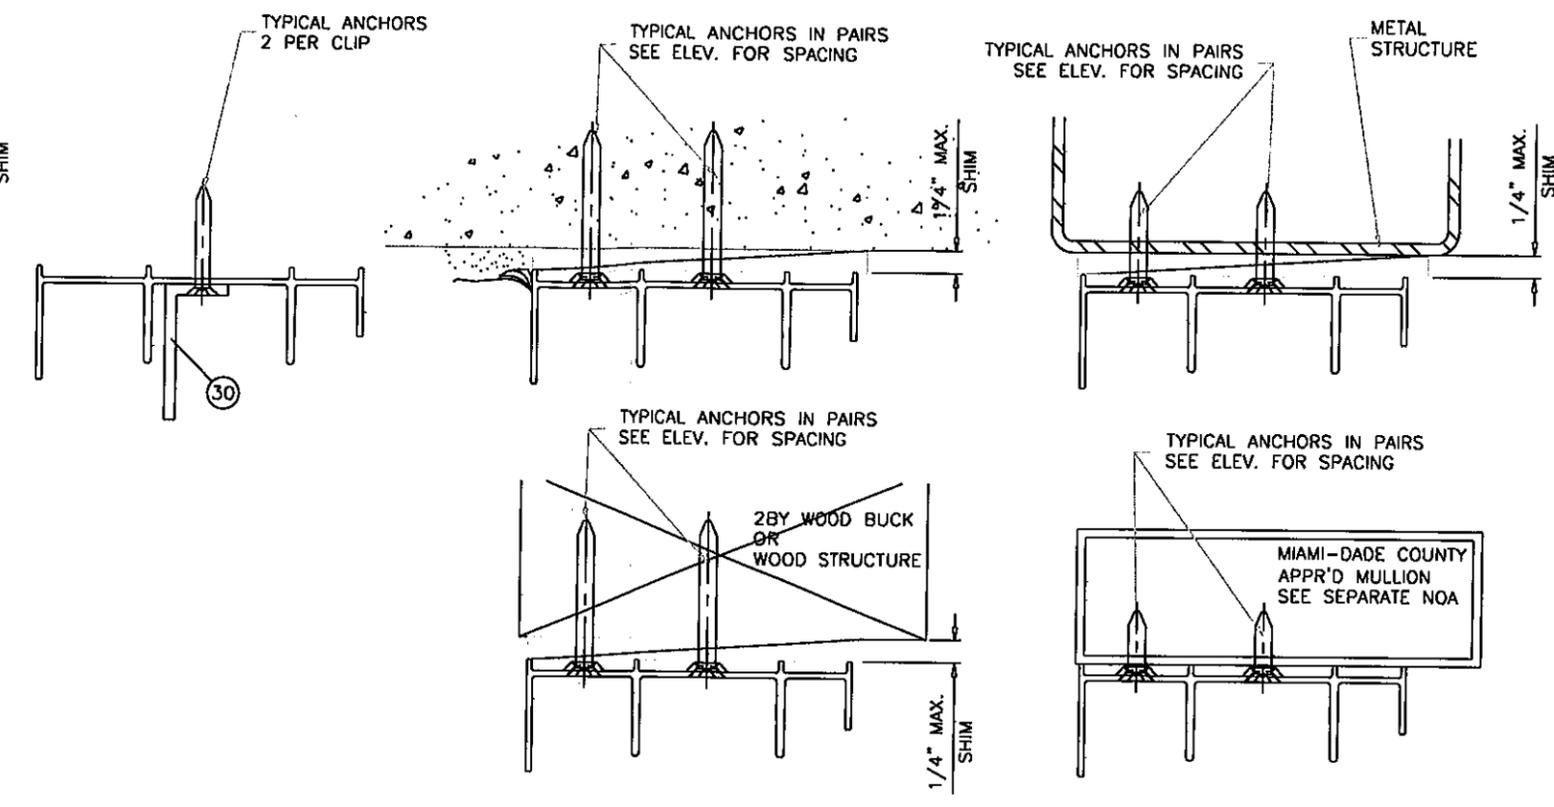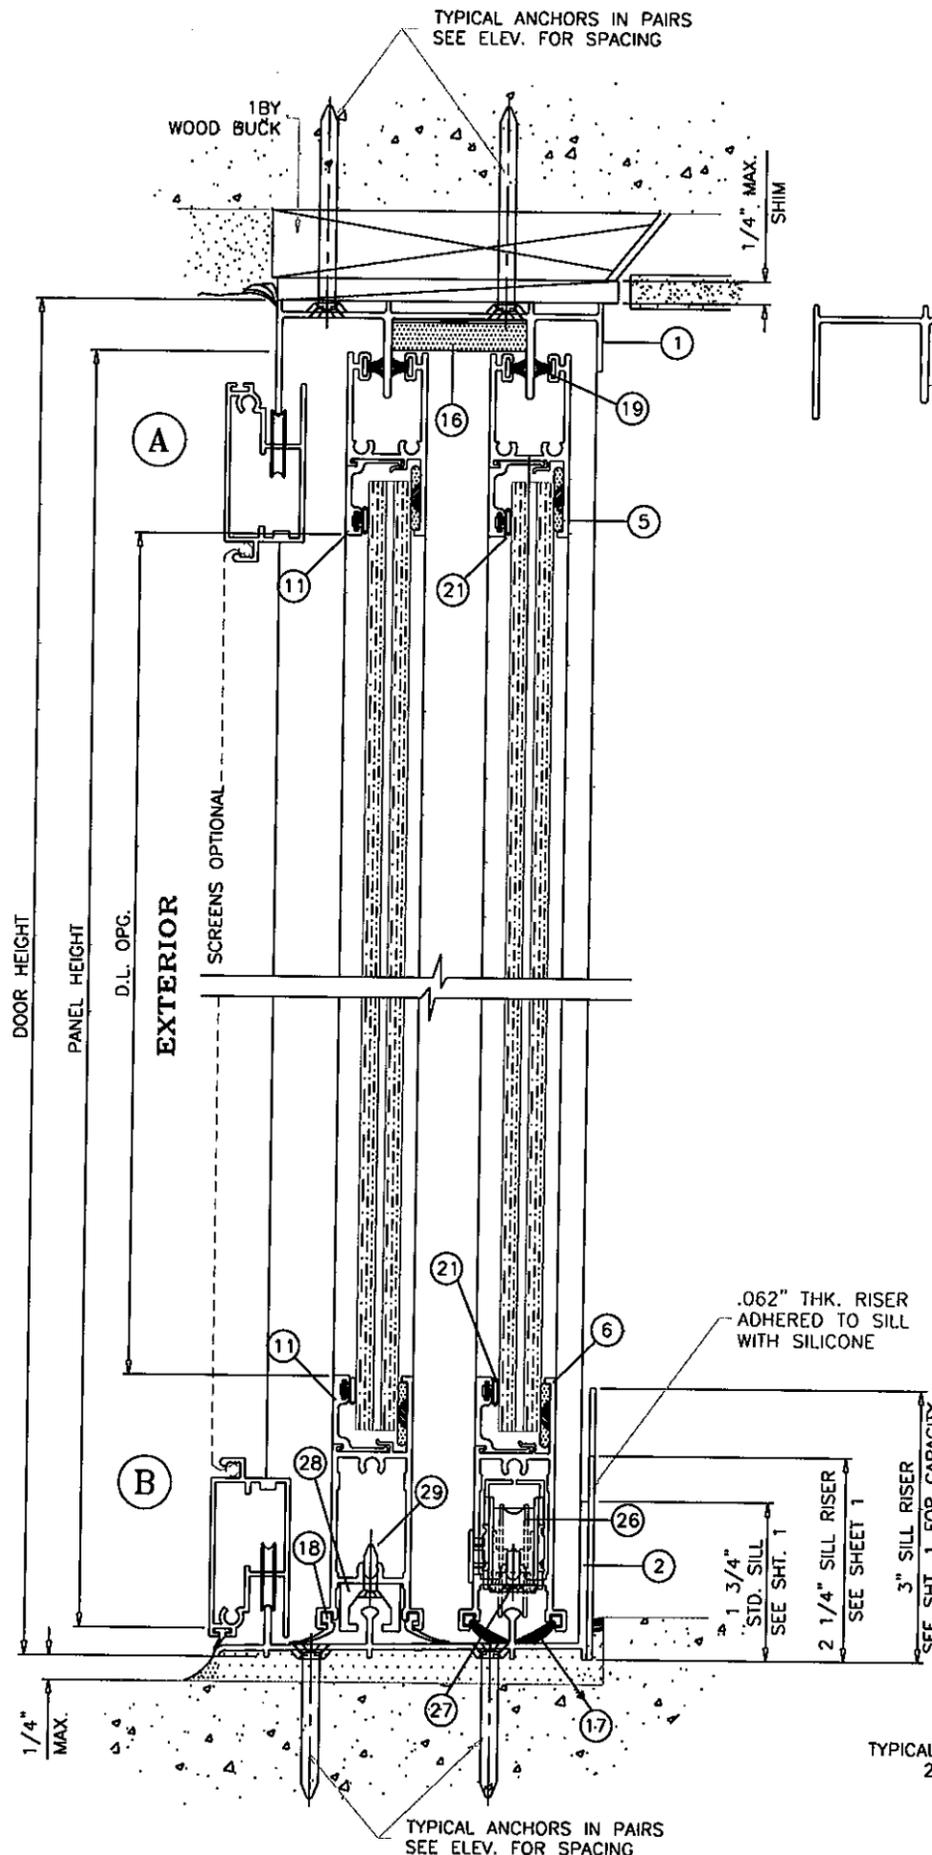

WOOD BUCKS AND METAL STRUCTURES NOT BY LAWSON IND. MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING


1/4" DIA TAPCONS
 INTO 28Y WOOD BUCKS OR WOOD STRUCTURE
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 18Y WOOD BUCKS INTO MASONRY OR CONC.
 1-1/4" MIN. EMBED INTO MASONRY OR CONC.
 DIRECTLY INTO (3 KSI MIN.) CONCRETE OR MASONRY
 1-1/4" MIN. EMBED INTO CONCRETE OR MASONRY

1/4" DRILLFLEX SELF DRILLING SCREWS
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)


#10 SMS
 INTO APPROVED MULLIONS (NO SHIM SPACE)

TYPICAL EDGE DISTANCE
 INTO (3 KSI MIN.) CONCRETE AND MASONRY = 2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

SEALANTS:
 FRAME AND VENT CORNERS AND INSTALLATION SCREWS AT SILL
 SEALED WITH WHITE/ALUMINUM COLORED SEALANT.

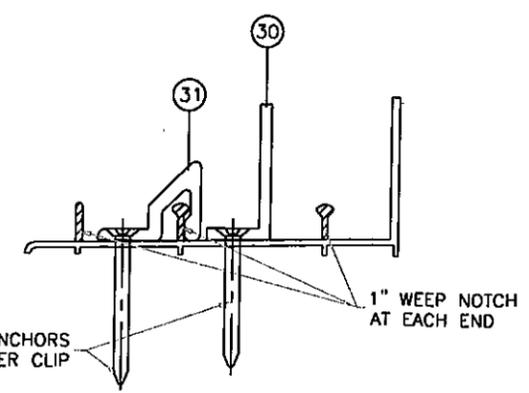

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. 12-0127-24
 Expiration Date 02/13/2013
 By: [Signature]
 Miami Dade Product Control

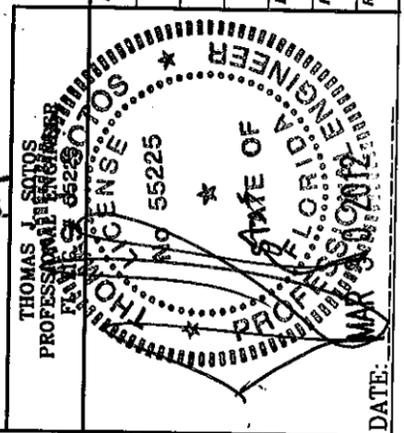


LAWSON INDUSTRIES, INC.
 MANUFACTURER OF QUALITY ALUMINUM SLIDING WINDOWS AND GLASS DOORS
 SGD-9200 ALUMINUM SLIDING GLASS DOOR (L.M.I.)
 VERTICAL CROSS SECTIONS, DETAILS & ANCHOR NOTES

8501 N.W. 90 ST.
 MEDLEY, FLORIDA 33166
 PH No. (305) 696-8660


Revision #: 2 OF 5
 Sheet: L9200-1101
 Drawing Number: L9200-1101
 Product Reference Number:

| | |
|----------------------|-------------------------------|
| Revision Number: A | Revised to Comply w/ 2010 FBC |
| Drawn By: N. ERAZO | Date Drawn: 04/26/11 |
| Revised By: N. ERAZO | Date Revised: 01/20/12 |
| Revision Level: A | Scale: |

DATE:

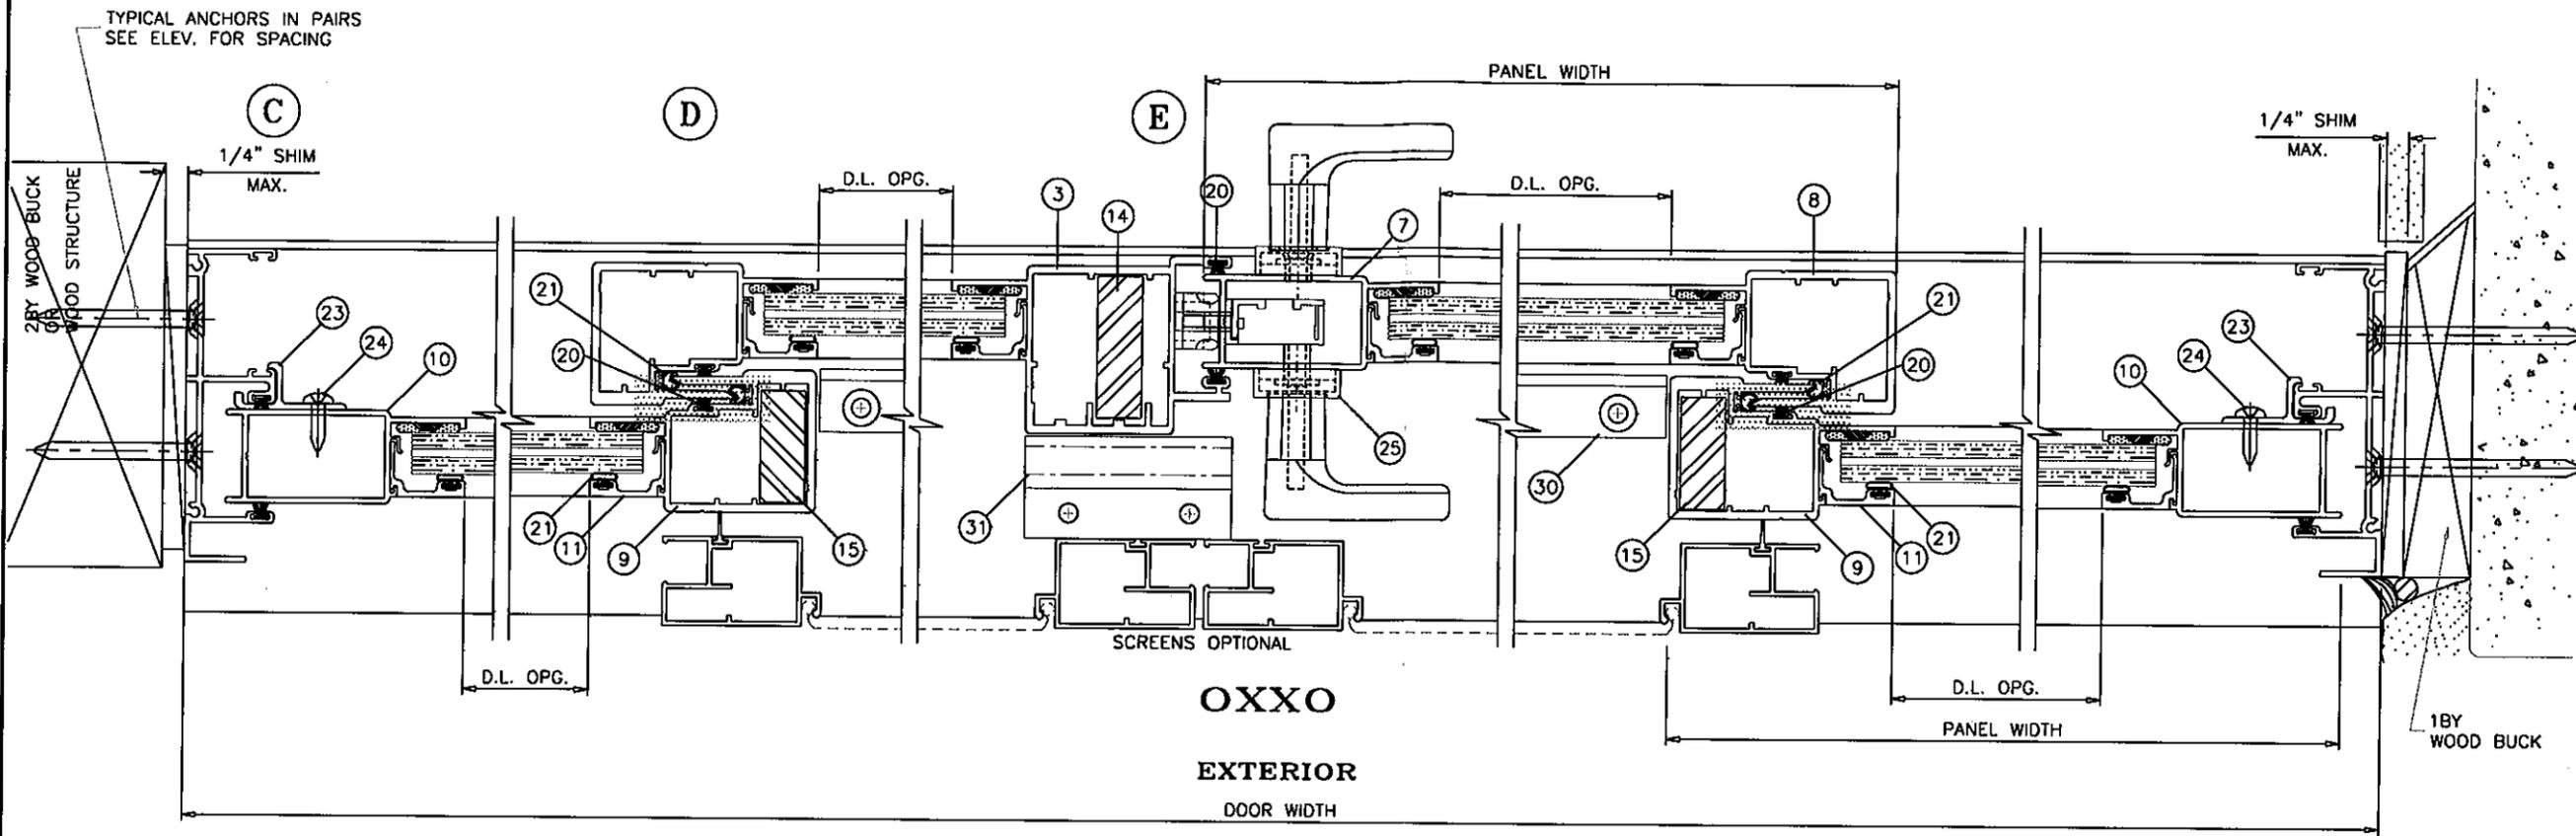

OXO
EXTERIOR
DOOR WIDTH

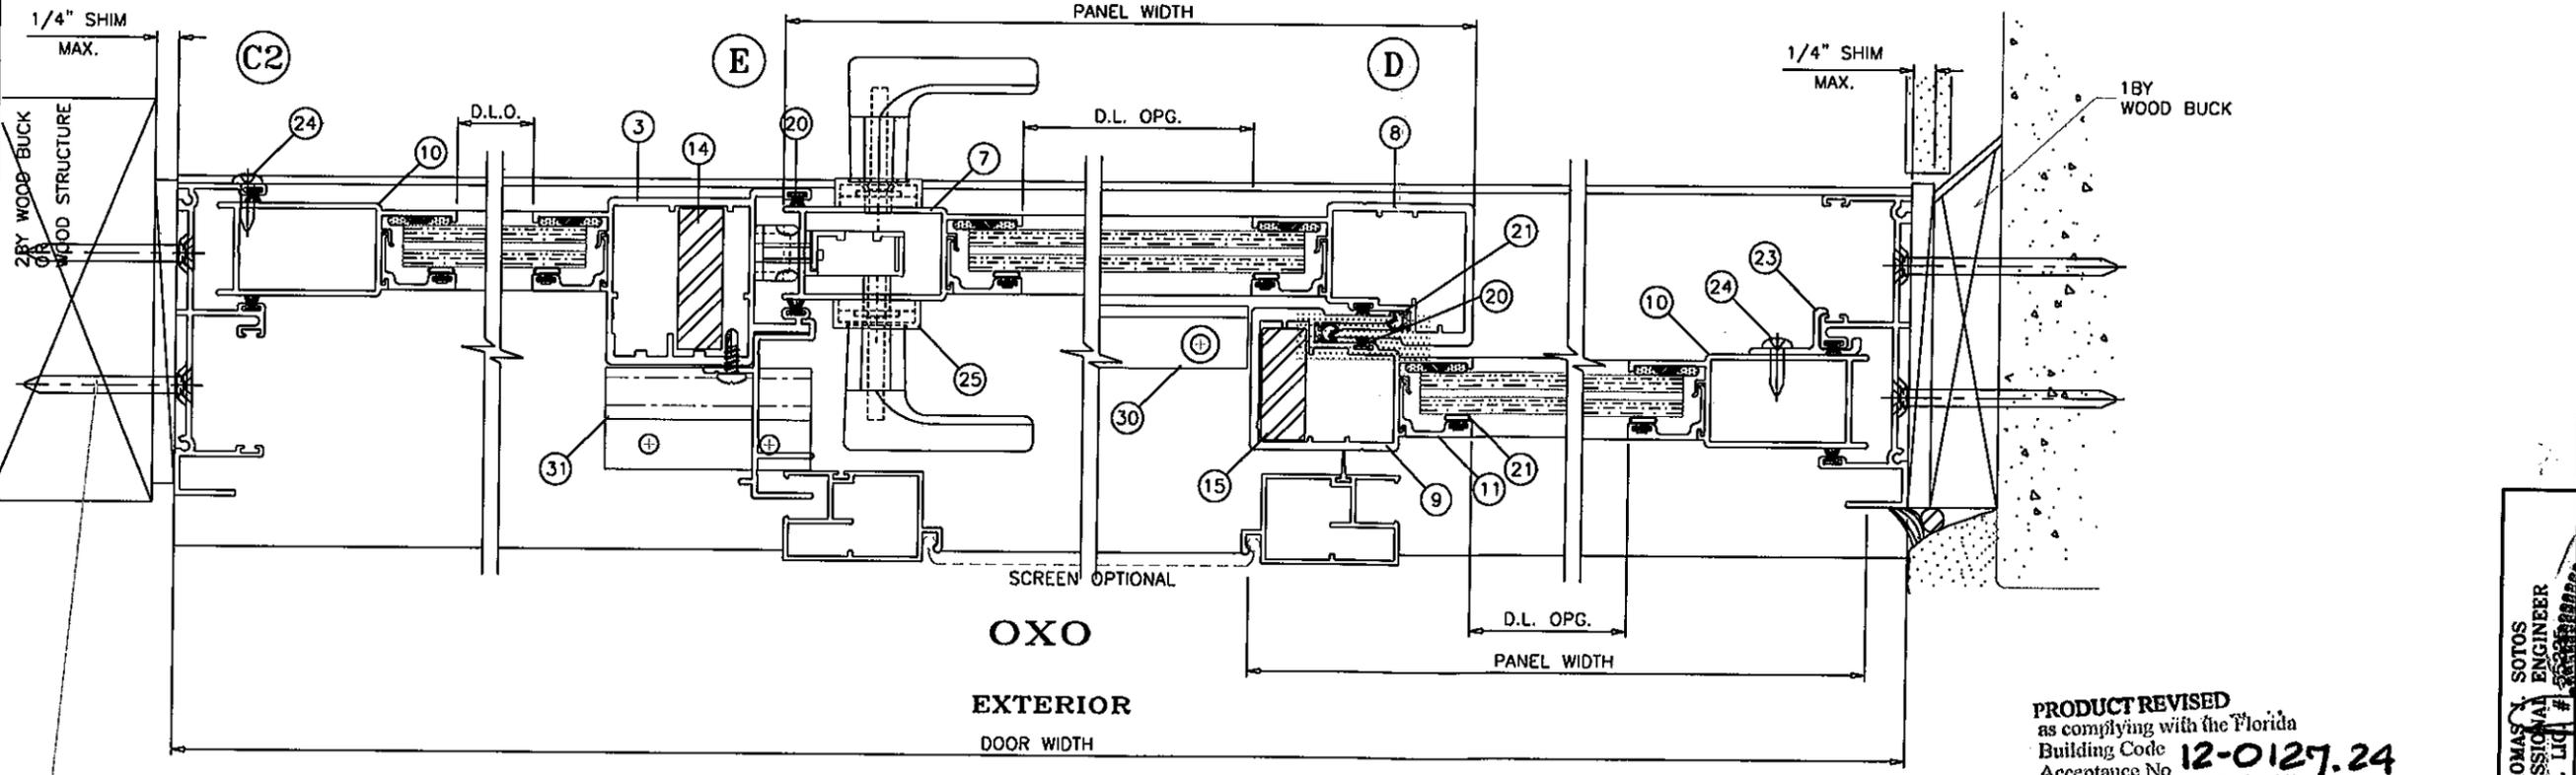

OXO
EXTERIOR
DOOR WIDTH

LAWSON INDUSTRIES, INC.
MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS
SGD-9200 ALUMINUM SLIDING GLASS DOOR (L.M.I.)
THREE DOOR AND FOUR DOOR HORIZONTAL CROSS SECTIONS8501 N.W. 90 ST.
MEDLEY, FLORIDA 33166
PH No. (305) 696-8660

Revision Notes:
A. Revised to Comply w/ 2010 FBC


| | |
|---------------|----------|
| Date Drawn: | 04/26/11 |
| Date Revised: | 01/20/12 |
| Scale: | A |

THOMAS J. SOTOS
PROFESSIONAL ENGINEER
FL LIC # 55225

STATE OF FLORIDA
PROFESSIONAL ENGINEER

DATE: MAR 2013

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 12-0127.24
Expiration Date 02/13/2013
By: *[Signature]*
Miami Dade Product Control

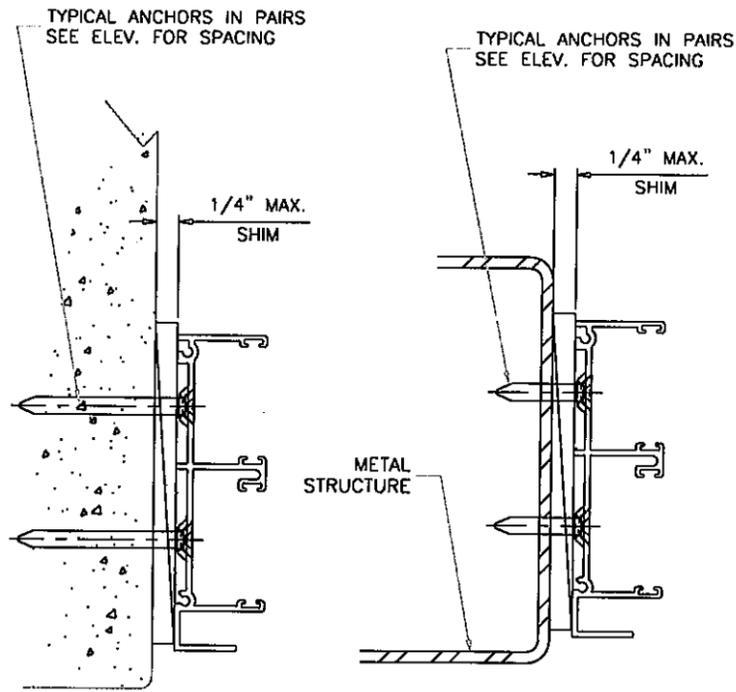


Flexible Vinyl (FPVC) Composition - Team Plastics, Inc.

| *1. FPVC Black: Compound No. 7200-75 | | |
|--------------------------------------|-------|----------|
| PHYSICAL | | ASTM NO. |
| Durometer Hardness "A", 10 sec | 75 | D-2240 |
| Specific Gravity | 1.45 | D-792 |
| Tensile Strength, PSI | 1640 | D-638 |
| Ultimate Elongation, % | 340.0 | D-638 |
| Modulus @ 100% Elongation, PSI | 765.0 | D-638 |
| Impact Brittleness | -31.0 | D-746 |

| *2. FPVC White: Compound No. 7267-75 | | |
|--------------------------------------|-------|----------|
| PHYSICAL | | ASTM NO. |
| Durometer Hardness "A", 10 sec | 75 | D-2240 |
| Specific Gravity | 1.45 | D-792 |
| Tensile Strength, PSI | 1640 | D-638 |
| Ultimate Elongation, % | 325.0 | D-638 |
| Modulus @ 100% Elongation, PSI | 765.0 | D-638 |
| Impact Brittleness | -30.0 | D-746 |

SGD-9200 ALUMINUM SLIDING GLASS DOOR BILL OF MATERIALS

| ITEM # | PART # | QUANTITY | DESCRIPTION | MATERIAL | MANF./SUPPLIER/REMARKS |
|--------|---------|---------------|-------------------------------|---------------|------------------------------------|
| 1 | L-9211 | 1 | FRAME HEAD | 6063-T6 | PROFILE |
| 2 | L-9002 | 1 | FRAME SILL - 1 3/4" HI | 6063-T6 | PROFILE |
| 3 | L-9207 | 1 | ASTRAGAL STILE | 6063-T6 | PROFILE |
| 4 | L-9212 | 2 | FLANGE FRAME JAMB | 6063-T5 | PROFILE |
| 5 | L-9204 | 1 | PANEL TOP RAIL | 6063-T5 | PROFILE |
| 6 | L-9205 | 1 | PANEL BOTTOM RAIL | 6063-T5 | PROFILE |
| 7 | L-9201 | 1 | PANEL LOCK STILE | 6063-T6 | PROFILE |
| 8 | L-9202 | 1 | PANEL INTERIOR INTERLOCK | 6063-T6 | PROFILE |
| 9 | L-9203 | 1 | PANEL EXTERIOR INTERLOCK | 6063-T6 | PROFILE |
| 10 | L-9201 | 1 | PANEL FIXED STILE | 6063-T6 | PROFILE |
| 11 | L-9209 | AS REQ'D. | ALUMINUM GLAZING BEAD | 6063-T5 | PROFILE |
| 12 | FS-005 | AS REQ'D. | FRAME ASSEMBLY SCREWS | - | #8 X 1/2" P.H. PHILLIPS |
| 13 | FS-013 | AS REQ'D. | PANEL ASSEMBLY SCREWS | - | #10 X 1" P.H. PHILLIPS |
| 14 | AR-021 | 1 | COLD ROLLED STEEL BAR | A36 STEEL | 1/2" X 1 1/2" (36 KSI) |
| 15 | AR-020 | AS REQ'D. | COLD ROLLED STEEL BAR | A36 STEEL | 1/2" X 1 1/4" (36 KSI) |
| 16 | L-9016 | 1 | SELF ADHESIVE PILE PAD | - | 13/16" X 1 1/2" |
| 17 | PWS-016 | AS REQ'D. | MVG. BOTTOM RAIL WTS'P | - | ULTRAFAB #QB6757DK |
| 18 | VWS-016 | AS REQ'D. | Fxd. Bottom Rail Vinyl Wts'p. | Team Plastics | See Material Composition @ Sheet 4 |
| 19 | PWS-009 | AS REQ'D. | PANEL TOP RAIL WTS'P | - | .187"x.310" (7830-6001-1) |
| 20 | PWS-003 | AS REQ'D. | FIN SEAL WEATHERSTRIP | - | .187"x.210" (7820-6001-9) |
| 21 | VWS-004 | AS REQ'D. | 1/4" O.D. Bulb Vinyl Wts'p. | Team Plastics | See Material Composition @ Sheet 4 |
| 22 | HC-043 | 2X PANEL | PANEL TOP GUIDE | NYLON 6-6 | SUNCOPLASTICS Rockwell M scale 79 |
| 23 | L-9018 | 7/ FIX. PANEL | FIXED PANEL JAMB CLIP | 6063-T5 | PROFILE |
| 24 | FS-011 | 1 X CLIP | FIXED PANEL CLIP SCREW | - | #10 X 5/8" P.H./PHIL. |
| 25 | HC-047 | 1 | MORTISE LOCK HARDWARE | - | W/ HANDLES & KEEPER |
| 26 | HC-046 | 2 | MVG. PANEL TANDEM ROLLER | - | 2 X EA. MVG. BOT. RAIL |
| 27 | FS-003 | 2 | ROLLER ATTACHMENT SCREW | - | #8 X 1/2" F.H./PHIL. |
| 28 | AR-008 | 2 | FXD. PANEL "C" TRACK CLIP | 6063-T5 | 6" LONG, EA. FXD. BOT. RAIL |
| 29 | FS-042 | AS REQ'D. | "C" TRACK ATTACHMENT SCREW | - | #10 X 1" F.H./PHIL. |
| 30 | AR-009 | 3 | ANGLE CLIP | ALUMINUM | .704" X 1.50" X 125" X 3" |
| 31 | L-9022 | 1 | ASTRAGAL RETAINER CLIP | 6063-T5 | - |

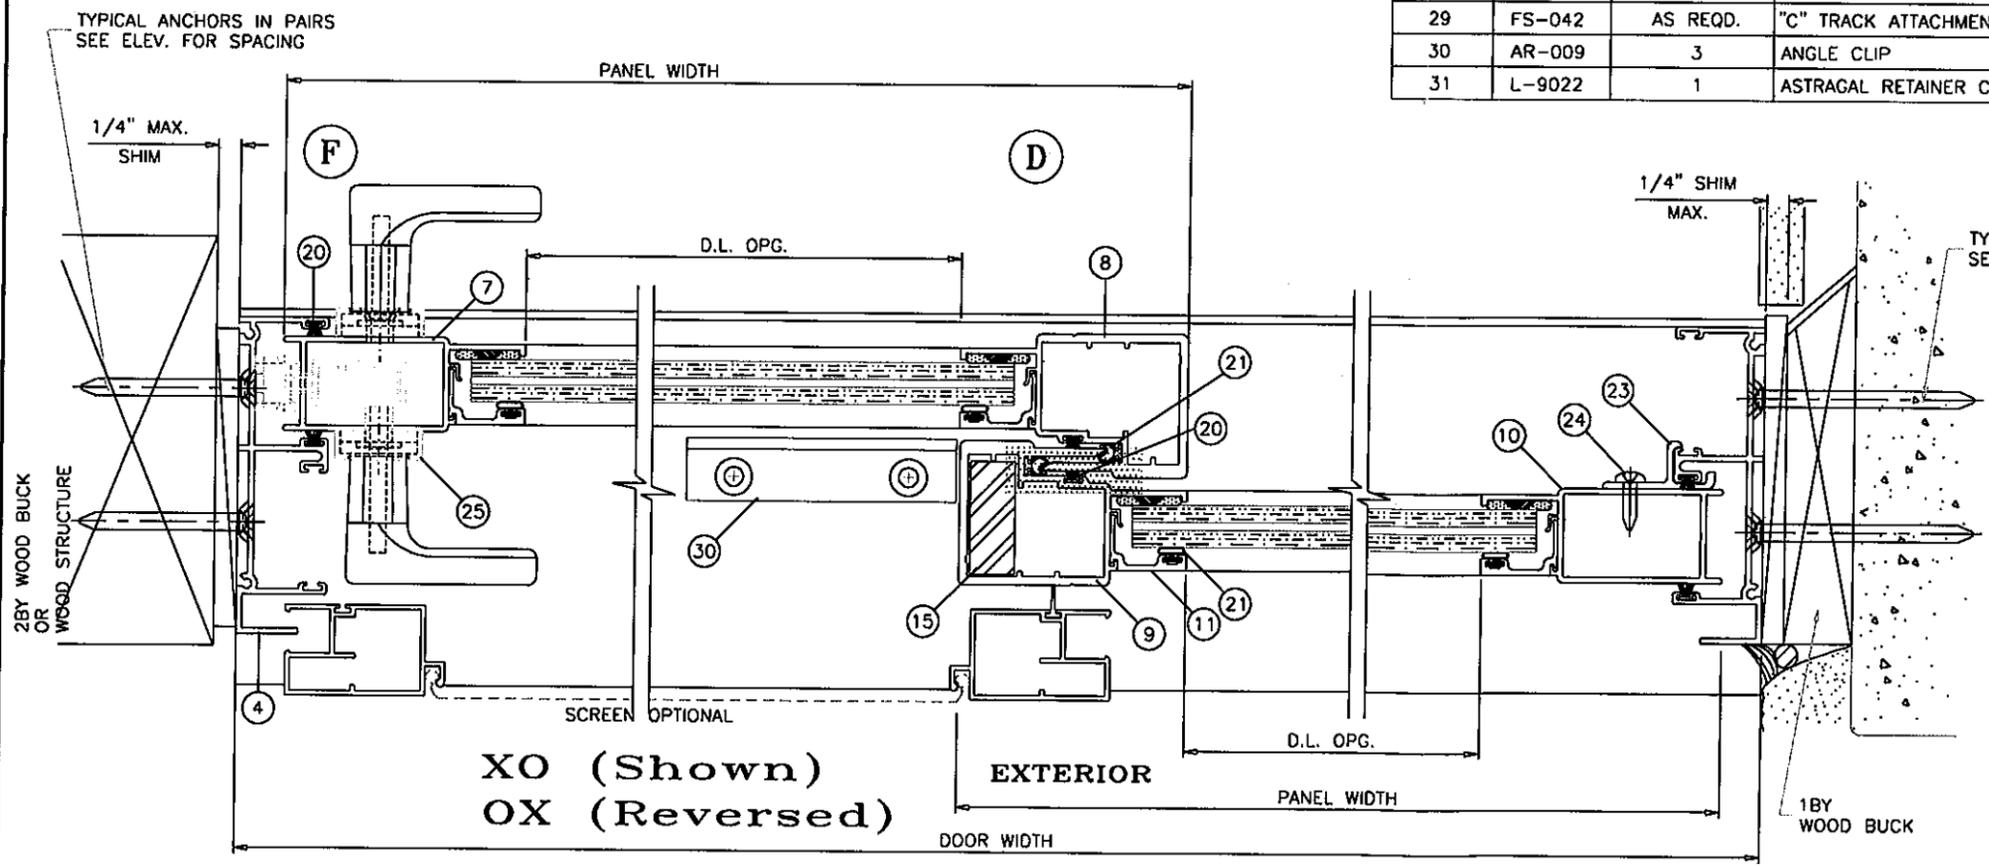

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **12-0127.24**
Expiration Date **02/13/2013**

By *[Signature]*
Miami Trade Product Control

LAWSON INDUSTRIES, INC.

8501 N.W. 90 ST.
MEDLEY, FLORIDA 33166
PH No. (305) 696-8660

MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS

SGD-9200 ALUMINUM SLIDING GLASS DOOR (L.M.I.)

BILL OF MATERIALS, INSTALLATION DETAILS & TWO DOOR HORIZONTAL CROSS SECTION

Revision #: 4 OF 5
Sheet: L9200-1101
Drawing Number: L9200-1101
Product Reference Number:


Revision Notes:
A. Revised to Comply w/ 2010 FBC

| | |
|-----------------|----------|
| Date Drawn: | 04/26/11 |
| Drawn By: | N. ERAZO |
| Date Revised: | 01/20/12 |
| Revised By: | N. ERAZO |
| Revision Level: | A |


THOMAS J. SOTOS
PROFESSIONAL ENGINEER
FL LICENSE NO. 55225

STATE OF FLORIDA
PROFESSIONAL ENGINEER


DATE: _____

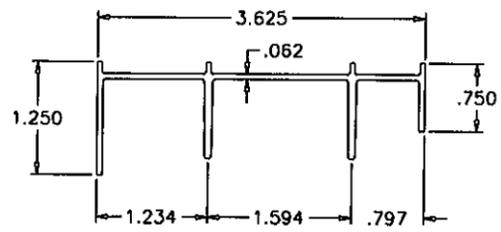


FRAME HEAD

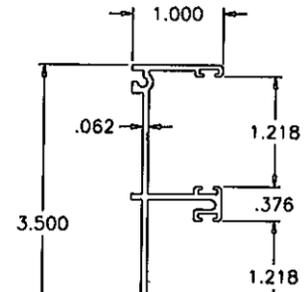


FRAME JAMB

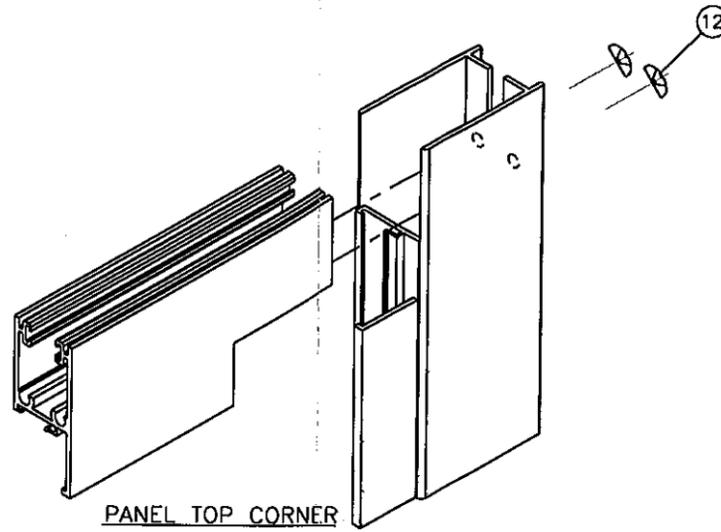


PANEL TOP CORNER

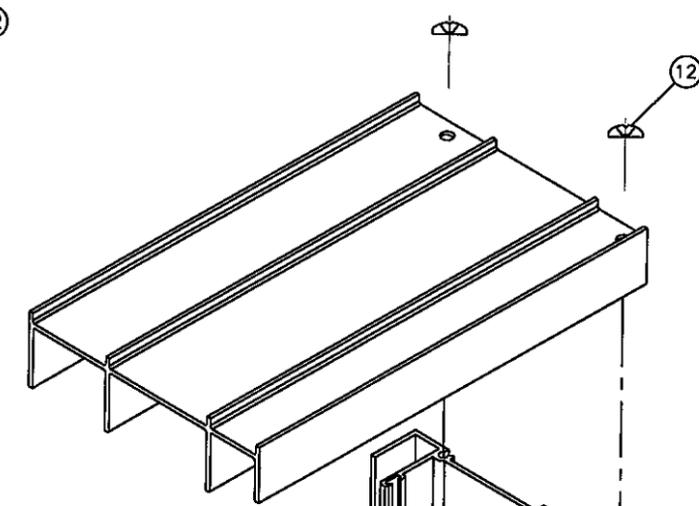


FRAME TOP CORNER




GLASS STOP

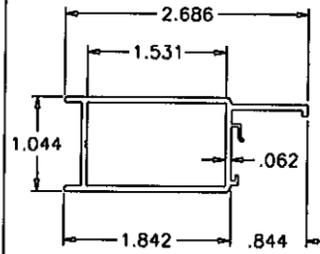


LOCK STILE

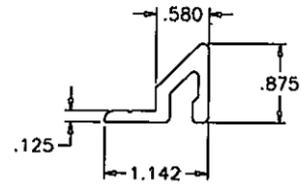


ASTRAGAL RETAINER

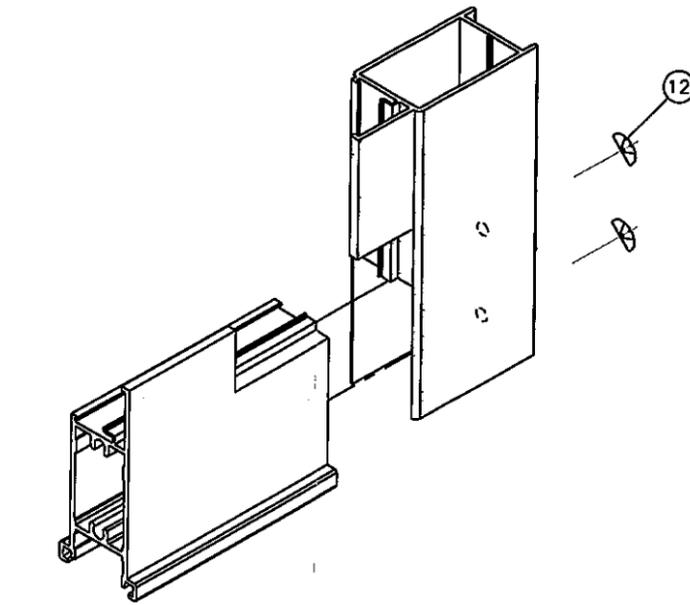


PANEL BOTTOM CORNER

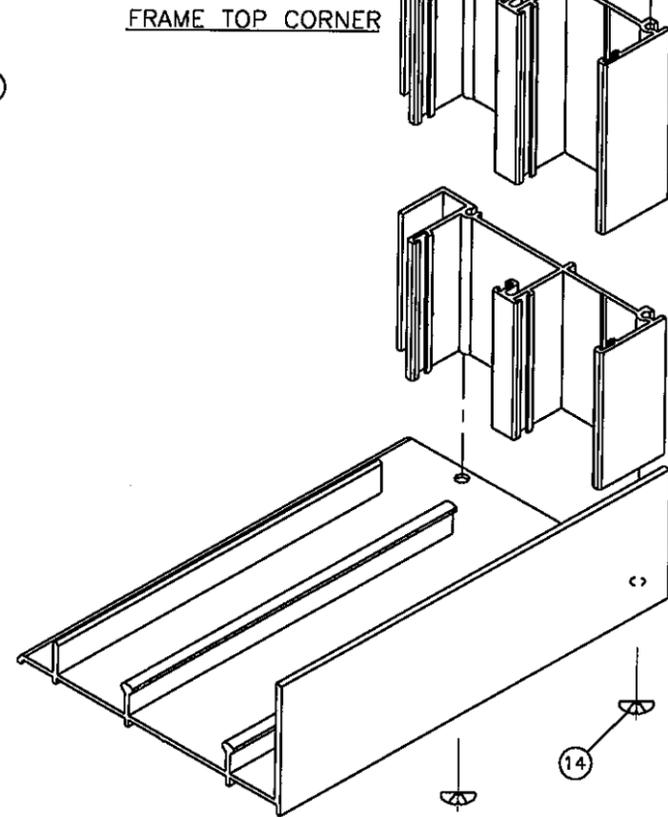


FRAME BOTTOM CORNER




PANEL TOP RAIL

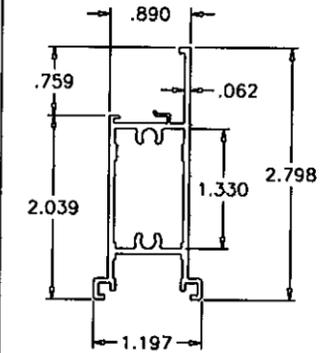


PANEL BOTTOM RAIL

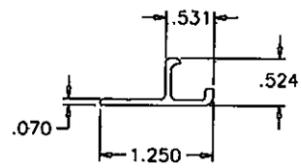


FIXED PANEL CLIP

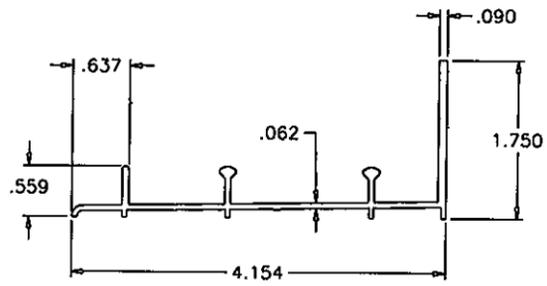


FRAME SILL

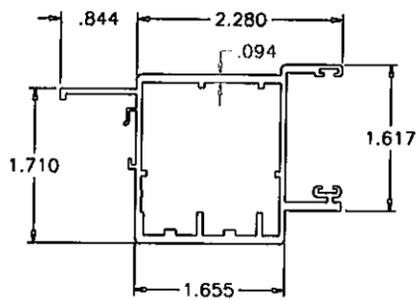


ASTRAGAL STILE

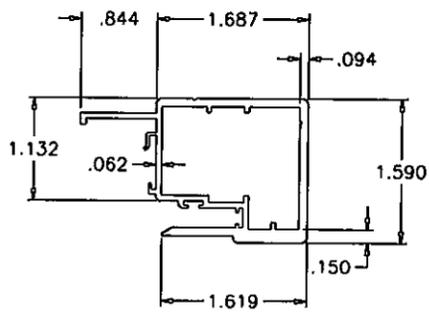


INTERIOR INTERLOCK

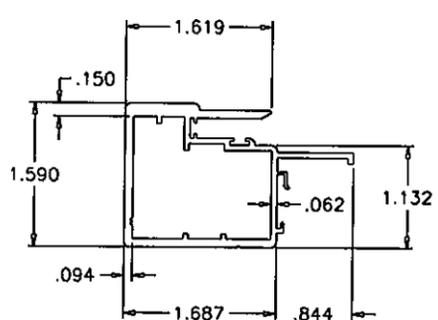

EXTERIOR INTERLOCK

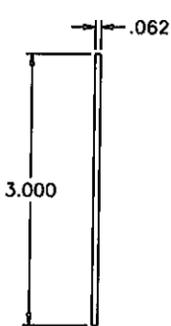

SILL RISER



INTERLOCK REINFORCING


8501 N.W. 90 ST.
MEDLEY, FLORIDA 33166
PH No. (305) 696-8660

LAWSON
INDUSTRIES, INC.

MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS
SGD-9200 ALUMINUM SLIDING GLASS DOOR (L.M.I.)
EXTRUSION DETAILS & CORNER ASSEMBLY DETAILS

Revision Notes:
A. Revised to Comply w/ 2010 FBC

| | |
|-----------------|----------|
| Date Drawn: | 04/26/11 |
| Drawn By: | N. ERAZO |
| Date Revised: | 01/20/12 |
| Revised By: | N. ERAZO |
| Revision Level: | A |
| Scale: | |

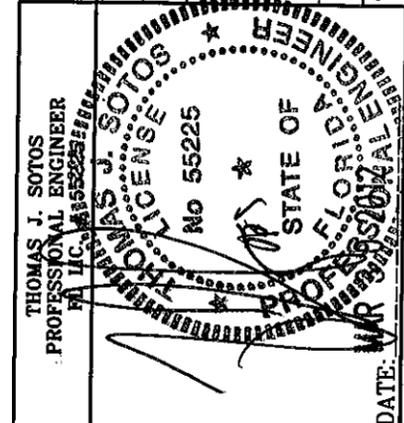

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0127.24
Expiration Date 02/13/2013
By: [Signature]
Miami Dade Product Control