



DEPARTMENT OF PERMITTING, ENVIRONMENT, AND REGULATORY
AFFAIRS (PERA)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidadecounty.gov/pera/

American Aluminum Doors Corp.
1026 East 24 Street
Hialeah, FL 33013

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County PERA -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. PERA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Aluminum Outswing French Door w/wo Sidelites- L.M.I.

APPROVAL DOCUMENT: Drawing No. **W10-43 Rev B**, titled "Aluminum Outswing French Door (L.M.I.)", sheets 1 through 6 of 6, dated 06/08/10 and last revised on APR 26, 2012, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

Limitations:

1. Typical anchors threshold meeting end required are four (4), except Six (6) required when ¼ ITW Tapcon used at threshold meeting ends.
2. Surface applied chair rail and partial alum veneer may be used for decorative purposes.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and Series and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **10-0629.04** and consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**

4
4/26/12



NOA No 12-0214.03
Expiration Date: October 06, 2015
Approval Date: May 03, 2012

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections (transferred from file # **10-0629.04**)
2. **APPROVAL DOCUMENT:** Drawing No. **W10-43 Rev B**, titled "Aluminum Outswing French Door (L.M.I.)", sheets 1 through 6 of 6, dated 06/08/10 and last revised on APR 26, 2012, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, signed and sealed by Javad Ahmad, P.E.

Note: This revision consists of FBC 2010 notes only.

B. TESTS (transferred from file # 10-0629.04)

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

Along with marked-up drawings and installation diagram of aluminum outswing French Door, prepared by Fenestration Testing Lab., Test Report No. **FTL 6188**, dated 05/20/10, signed and sealed by Jorge A. Causo, P. E.

Note: This test report has an addendum anchor location marked drawings dated 01/10/12, issued by Fenestration Testing Lab.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al Farooq Corporation, dated 06-23-10 and last revised on 09/14/10, signed and sealed by Javad Ahmad, P.E. (submitted under file # **10-0629.04**)
2. Glazing complies w/ ASTM-E-1300-02 & -04

D. QUALITY ASSURANCE

1. Miami Dade Department of Permitting, Environment, and Regulatory Affairs (PERA).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **11-0325.05** issued to Solutia Inc. for their "**Saflex Clear or colored interlayer**", expiring on 05/21/16.
2. Notice of Acceptance No. **11-0624.01** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite PVB interlayer**", expiring on 12/11/16.



F. STATEMENTS

1. Statement letter of conformance to FBC 2010 and letter of no financial interest, prepared by Al Farooq Corporation, 01/20/12, signed and sealed by Javad Ahmad, P.E.
2. Statement letter of conformance to FBC 2007 and letter of no financial interest, prepared by Al Farooq Corporation, 06-08-10, signed and sealed by Javad Ahmad, P.E.
3. Lab compliance as part of the above referenced test report.

G. OTHER

1. This NOA revises NOA # **10-0629.04**, expiring on OCT 05, 2015.
2. Test Proposals # 09-1163, dated 08/26/09 approved by BCCO & surface applied chair rails dated March 05, 2012 approved by PERA.


Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 12-0214.03
Expiration Date: October 05, 2015
Approval Date: May 03, 2012

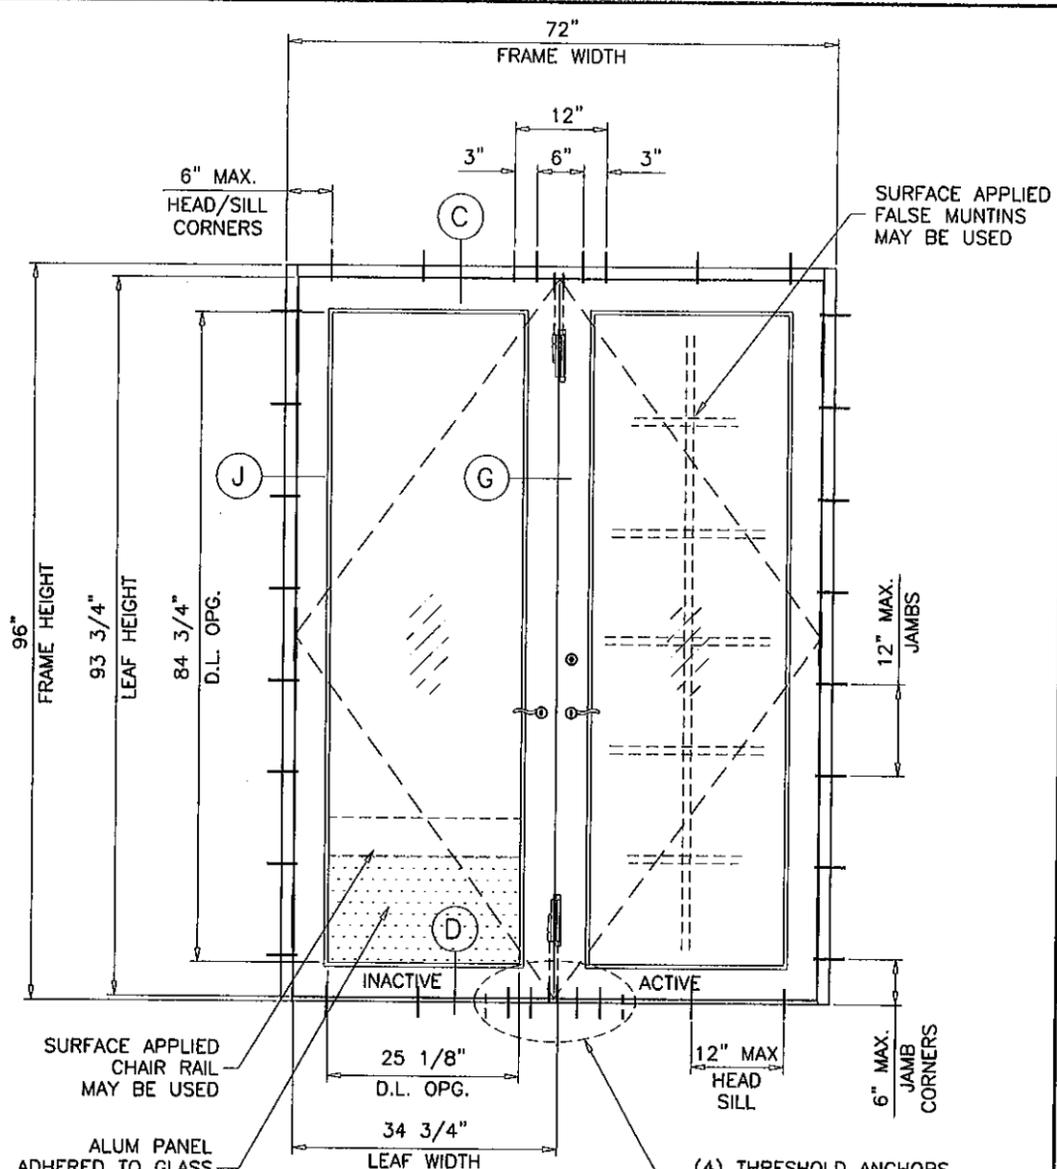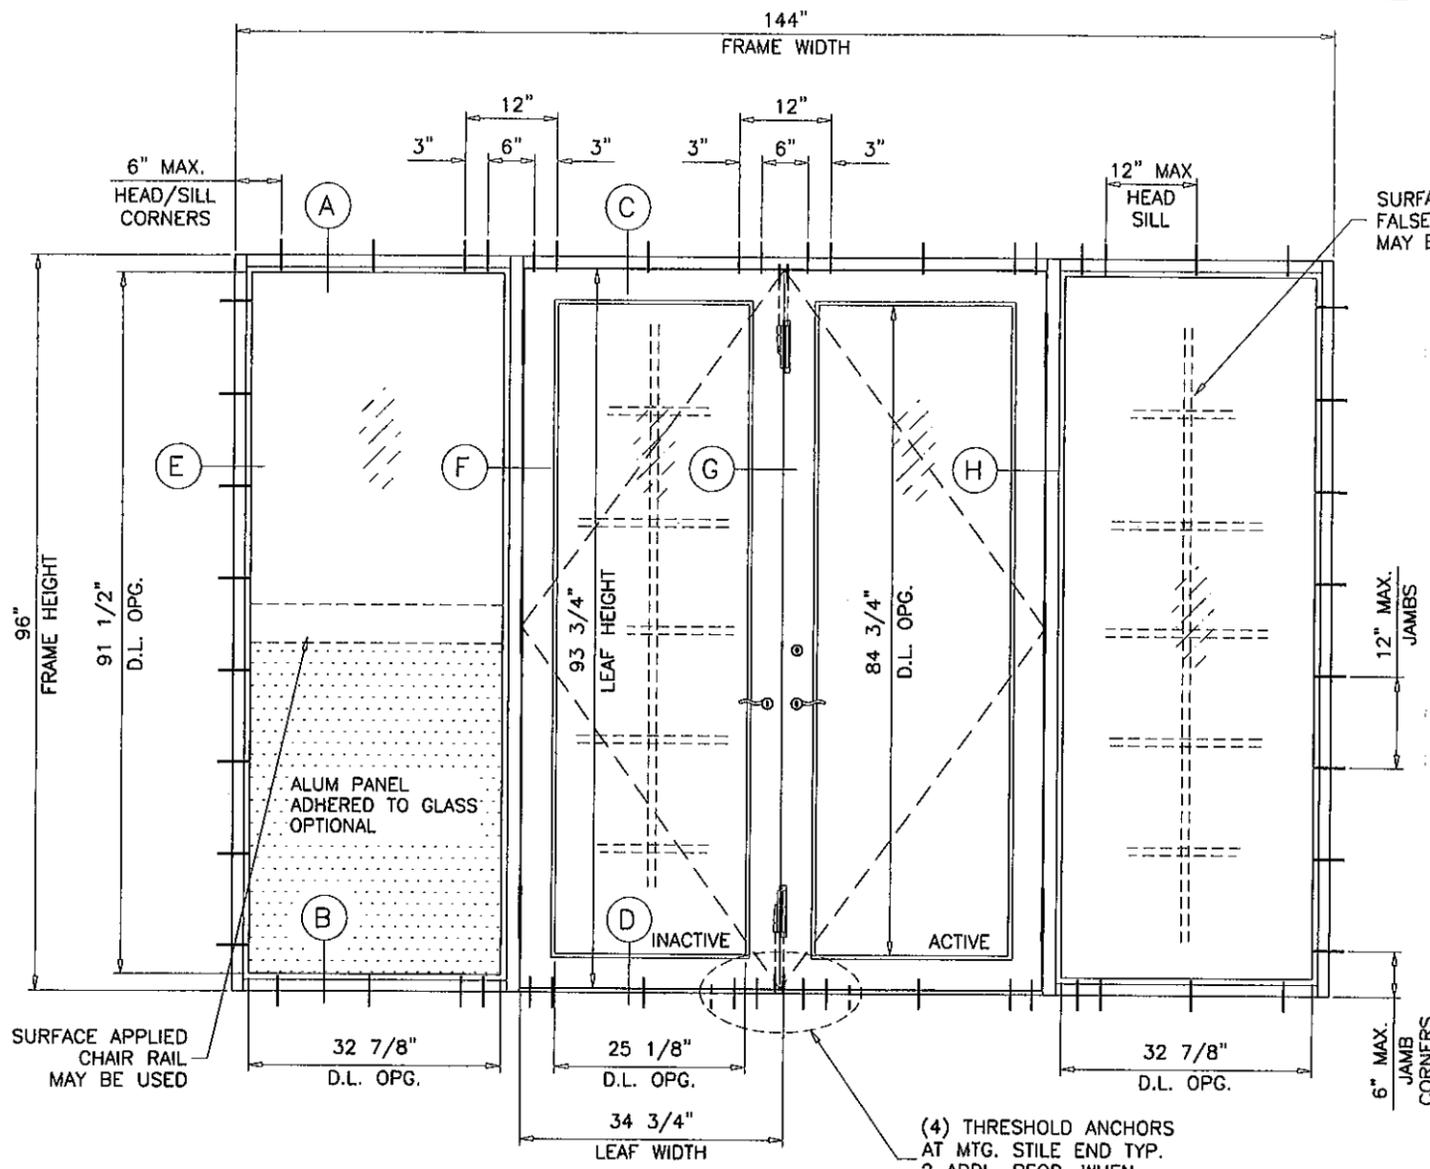

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

ALUMINUM OUTSWING FRENCH DOOR (L.M.I.)

APPROVAL APPLIES TO SINGLE (X) AND DOUBLE (XX) LEAF DOORS WITH OR WITHOUT SIDELITES. SIDE LITES CAN BE ON ONE OR BOTH SIDES OF DOOR. SEE SHEET 2 FOR DESIGN LOAD CAPACITIES.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.


ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BLDG. CODE SECTION 2003.8.4.

TYPICAL ELEVATIONS

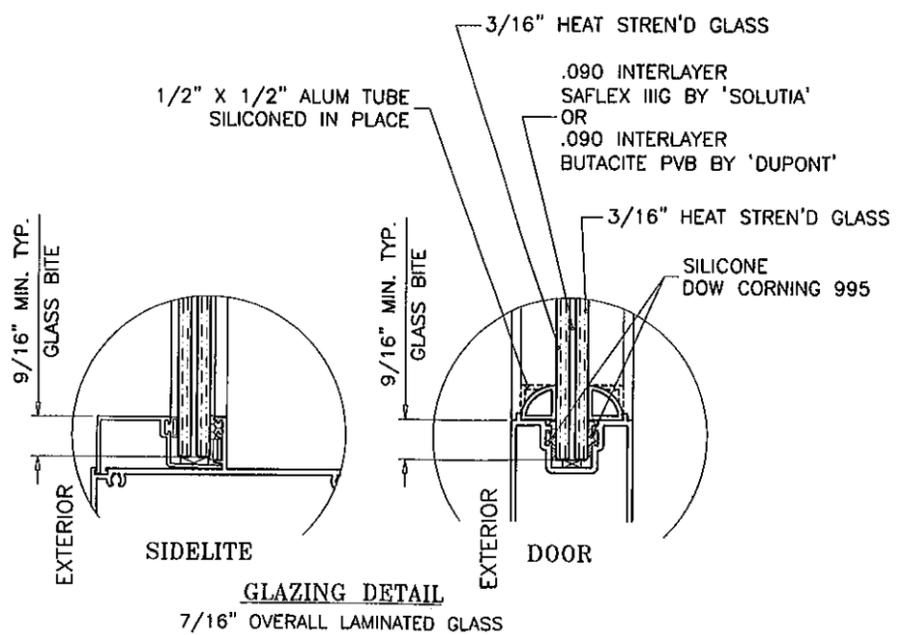

PRODUCT REVISED
 in compliance with the Florida Building Code
 Amendment No. 12-0214.02
 Expiration Date OCTOBER 2015
 By: *Chag L. Chanda*
 Miami Dade Product Control

THIS DOCUMENT IS NOT VALID WITHOUT CORPORATE SEAL OF AMERICAN ALUMINUM DOORS CORP.

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 APR 26 2012

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W10-43AAD


ALUMINUM OUTSWING FRENCH DOOR (L.M.I.)
AMERICAN ALUMINUM DOORS CORP.
 1026 EAST 24TH STREET
 HIALEAH, FL. 33013
 TEL (305) 693-2642 FAX (305) 693-2851

no	date	by	description
A	09.01.10	REV. PER BCCO COMMENTS	
B	01.11.12	UPDATED TO 2010 FBC	

date: 06-18-10
 scale: 1/2"=1'-0"
 dr. by: HAMID
 chk. by:

drawing no.
W10-43
 sheet 1 of 6


DOORS WITHOUT SIDELITES				
DESIGN LOAD CAPACITY - PSF				
FRAME HEIGHT INCHES	DOOR WIDTH INCHES		7/16" LAM. GLASS	
			EXT. (+)	INT. (-)
96	36 (X)	72 (XX)	65.0	75.0

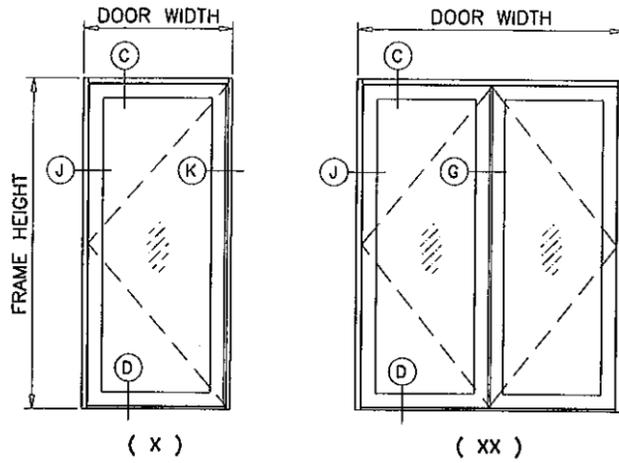



D.L.O. HEIGHT (DOOR) = FRAME HEIGHT - 11.250"
D.L.O. WIDTH (DOOR) = LEAF WIDTH - 9.625"
MAX. DOOR LEAF WIDTH = 34.5"

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219




STATIONARY PANEL (O) OR DOORS WITH SIDELITES						
DESIGN LOAD CAPACITY - PSF						
FRAME HEIGHT INCHES	DOOR WIDTH INCHES	SIDELITE WIDTH INCHES	UN-REINFORCED JAMB		REINFORCED JAMB	
			EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
84	36 (X) 72 (XX)	24	65.0	75.0	65.0	75.0
		28	65.0	75.0	65.0	75.0
		32	65.0	75.0	65.0	75.0
		36	65.0	75.0	65.0	75.0
90	36 (X) 72 (XX)	24	65.0	75.0	65.0	75.0
		28	65.0	75.0	65.0	75.0
		32	65.0	75.0	65.0	75.0
		36	65.0	75.0	65.0	75.0
96	36 (X) 72 (XX)	24	65.0	75.0	65.0	75.0
		28	65.0	71.9	65.0	75.0
		32	65.0	68.0	65.0	75.0
		36	64.6	64.6	65.0	75.0

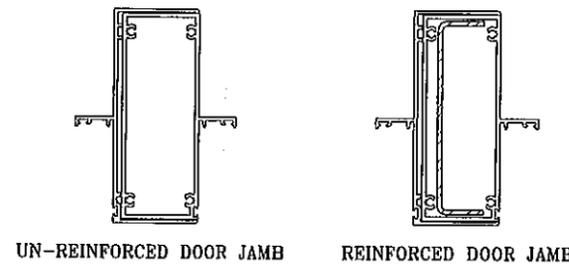

D.L.O. HEIGHT (SIDELITE) = FRAME HEIGHT - 4.500"
D.L.O. WIDTH (SIDELITE) = SIDELITE WIDTH - 3.125"

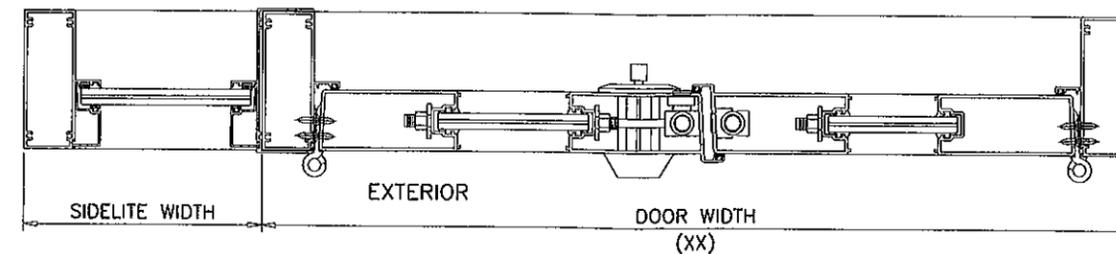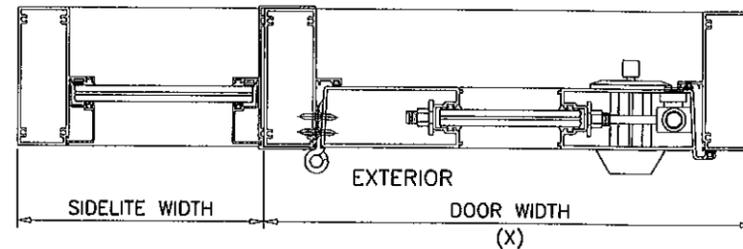

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0214.03
Expiration Date 10/6/15
Ishag, Chaudhry
Member BCCO/Florida Council

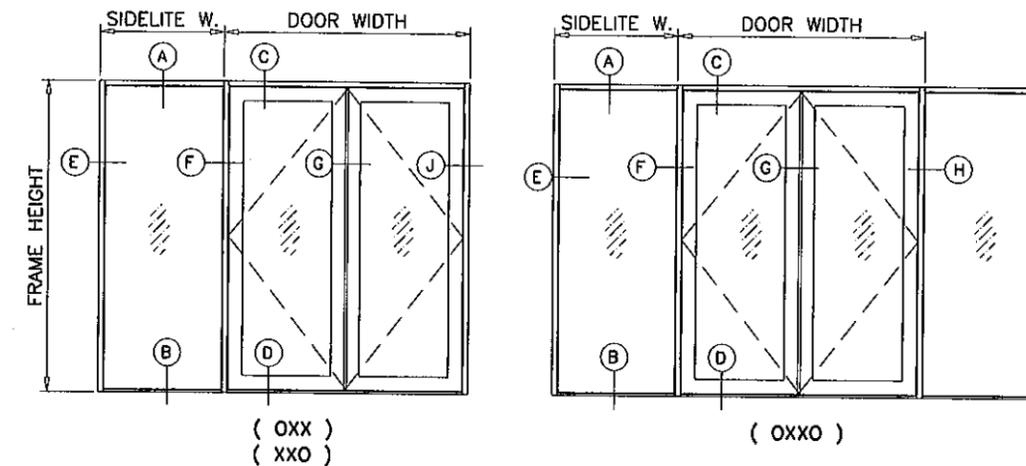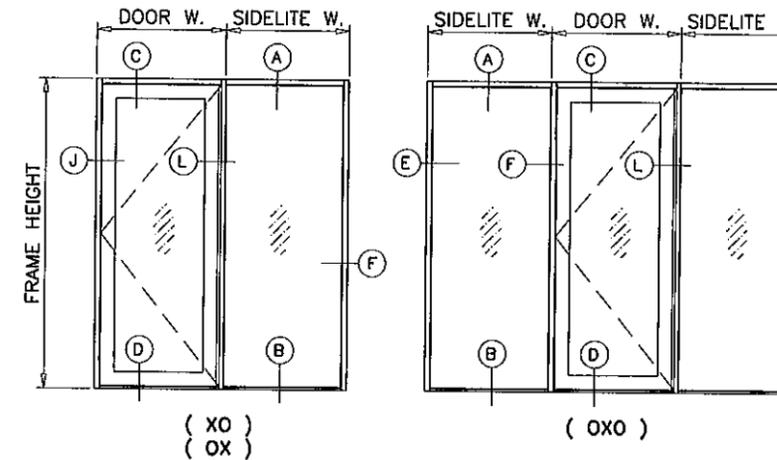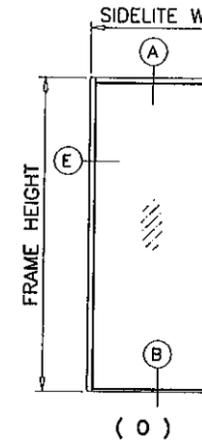

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
APR 26 2012


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W10-43AAD

ALUMINUM OUTSWING FRENCH DOOR (L.M.I.)
AMERICAN ALUMINUM DOORS CORP.
1026 EAST 24TH STREET
HIALEAH, FL. 33013
TEL. (305) 693-2642 FAX. (305) 693-2851


no	date	by	description
A	09.01.10	REV.	PER BCCO COMMENTS
B	01.11.12	NO	CHANGE THIS SHEET

date: 06-18-10
scale: -
dr. by: HAMID
chk. by:




drawing no.
W10-43
sheet 2 of 6

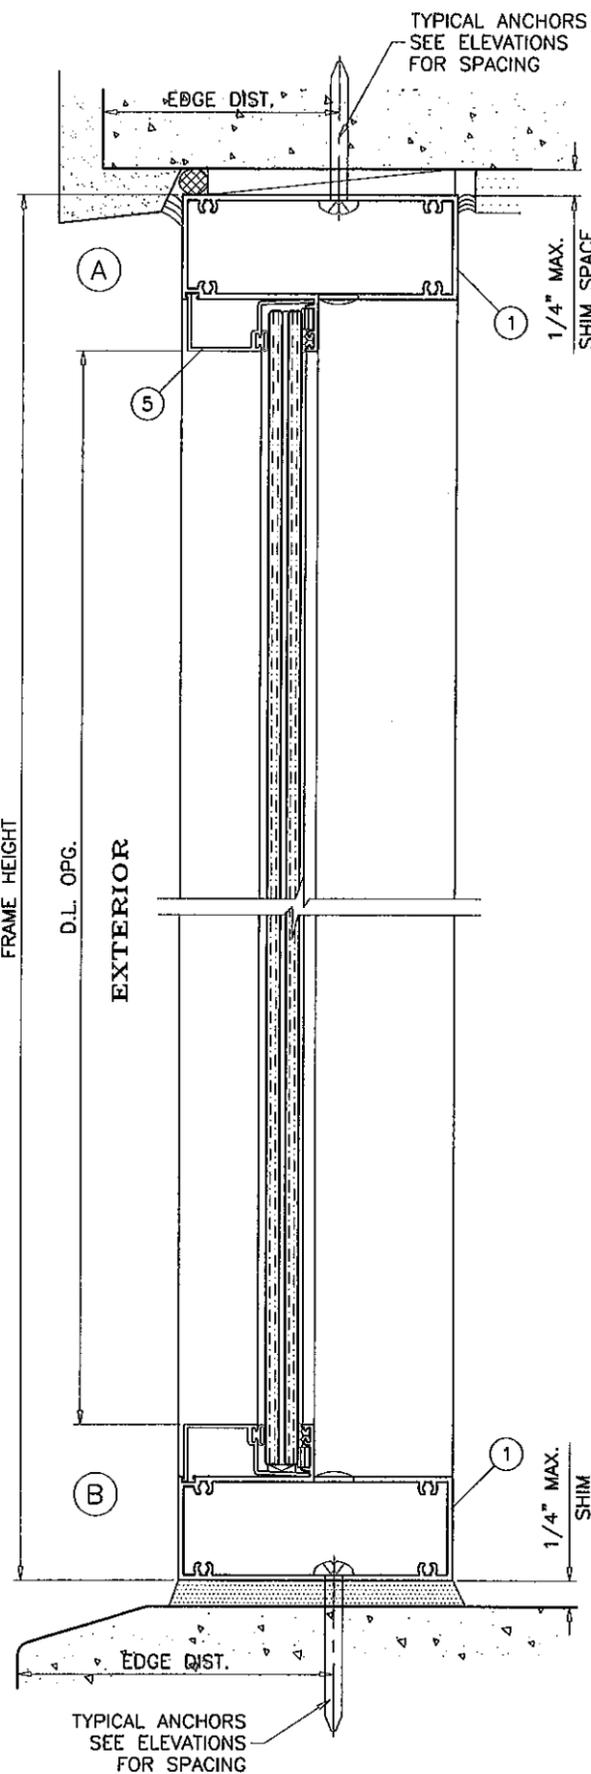

STATIONARY UNITS

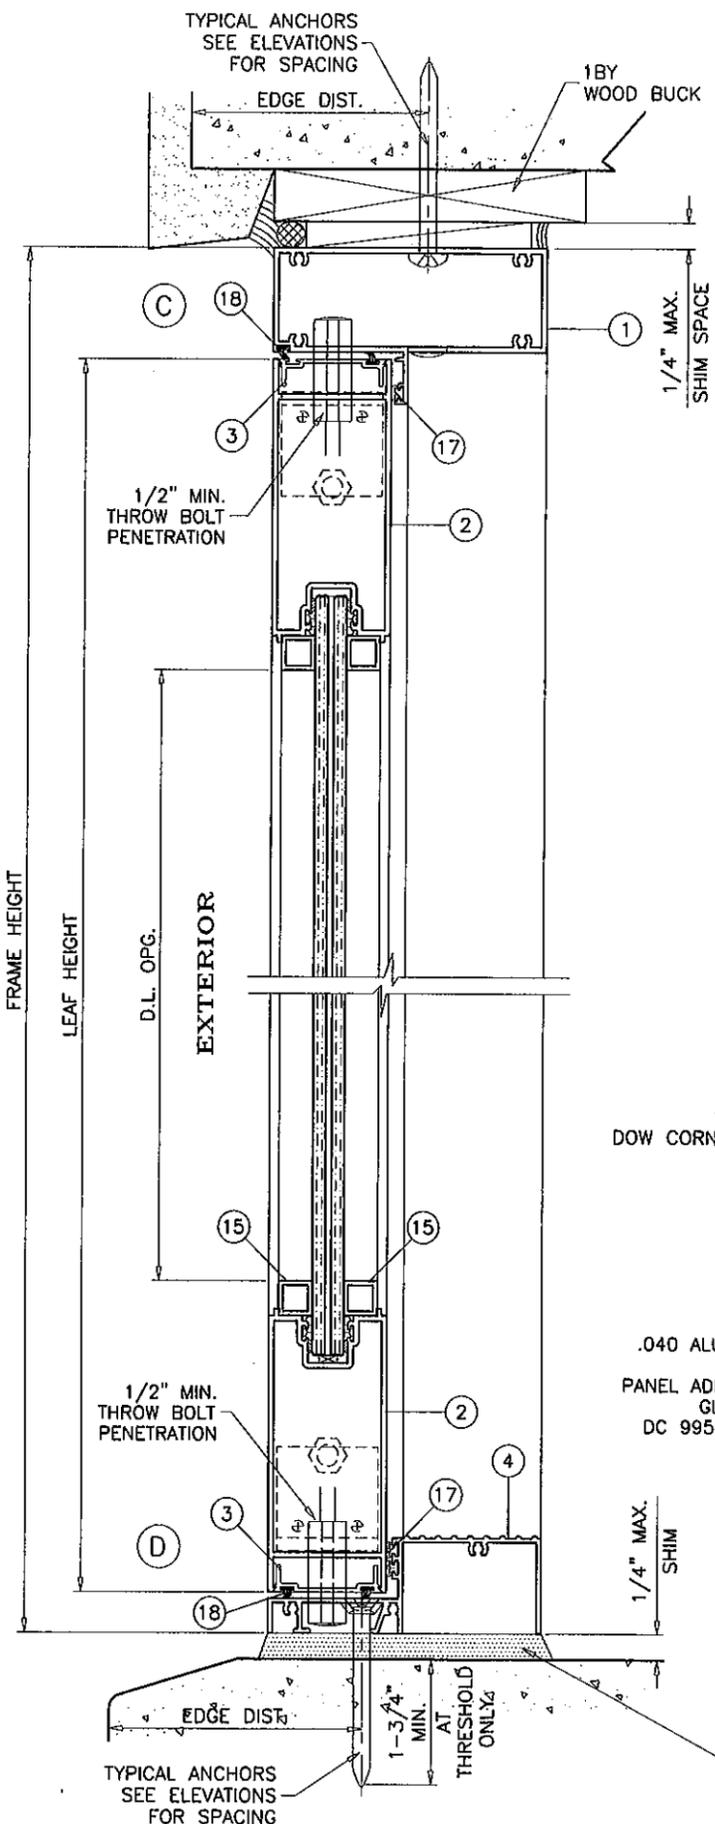

OPERABLE UNITS

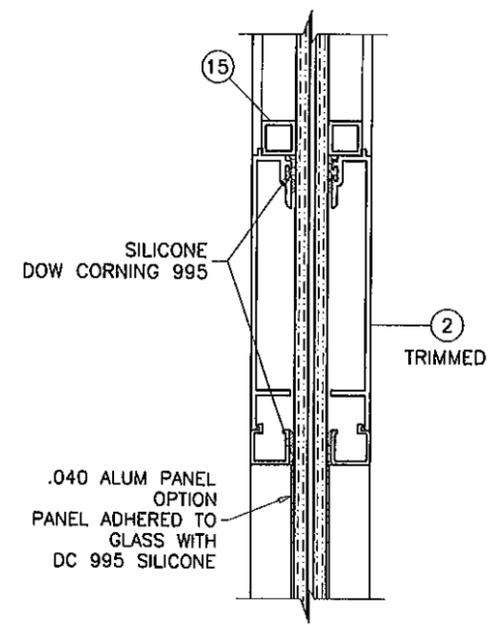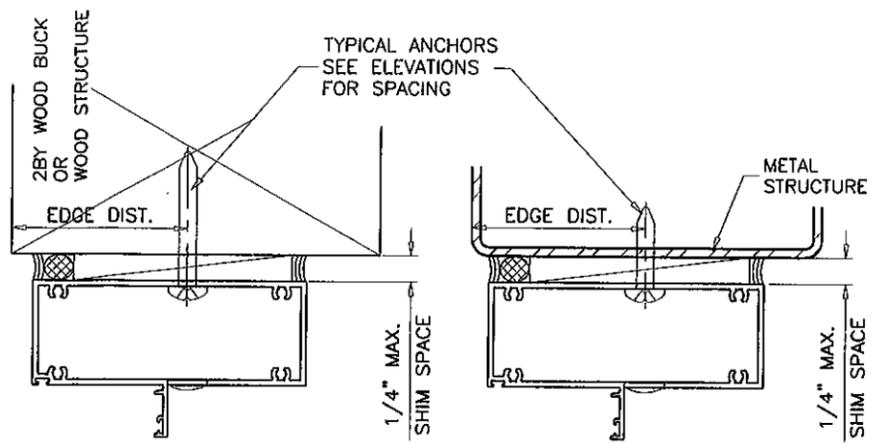

SURFACE APPLIED CHAIR RAIL OPTION

NON METALLIC GROUT
3 KSI MIN.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)

1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-3/8" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SELF DRILLING SCREWS (GRADE 5 CRS)

INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = 1/8")
INTO METAL STRUCTURES

STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)

ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN.

INTO WOOD STRUCTURE = 1" MIN.

INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.

C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

SEALANTS:

ALL FRAME AND PANEL JOINT, INSTALLATION SCREWS AND HEADS OF ANCHOR SCREWS AT SILL TO BE SEALED WITH WHITE/ALUM COLORED SILICONE.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0214-03
Expiration Date 10/6/15
Ishag I. Chank
Miami Dade Permit Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
APR 26 2012


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W10-43AAD

ALUMINUM OUTSWING FRENCH DOOR (L.M.I.)
AMERICAN ALUMINUM DOORS CORP.
1026 EAST 24TH STREET
HIALEAH, FL. 33013
TEL. (305) 693-2642 FAX. (305) 693-2851





no	date	description
A	09.01.10	REV. PER BCCO COMMENTS
B	01.11.12	UPDATED TO 2010 FBC

date: 06-18-10
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W10-43
sheet 3 of 6

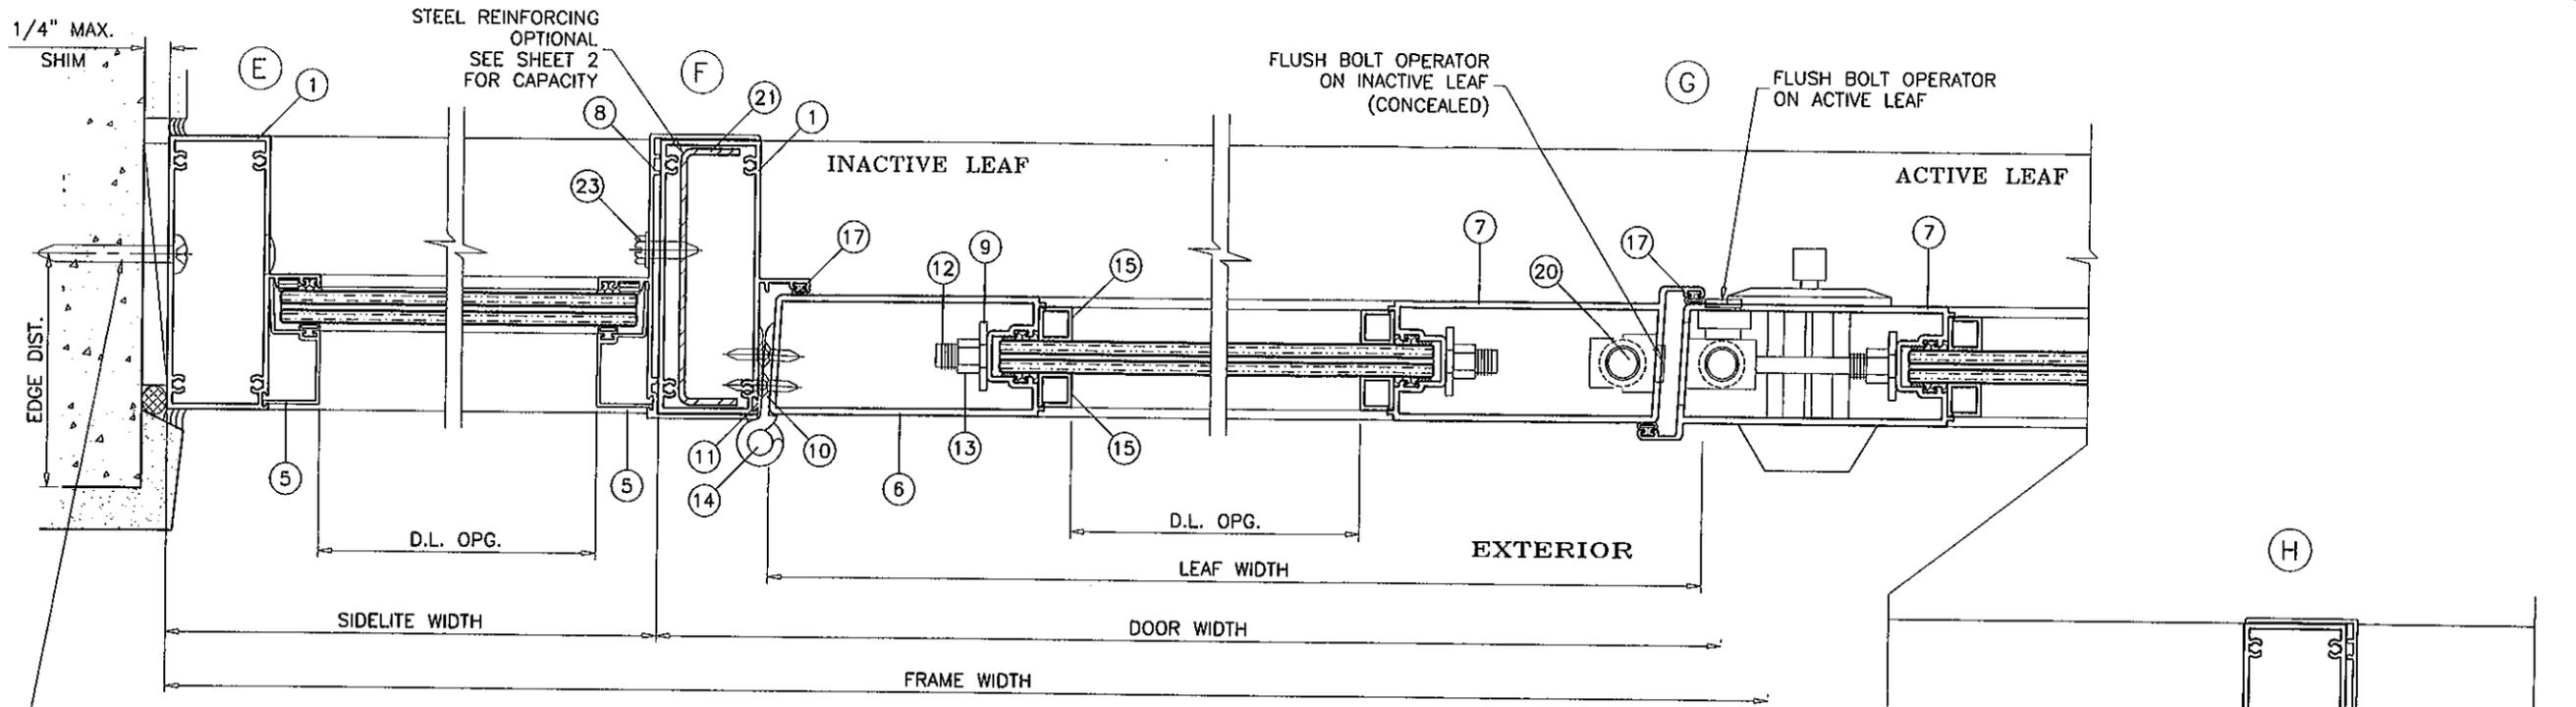

TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

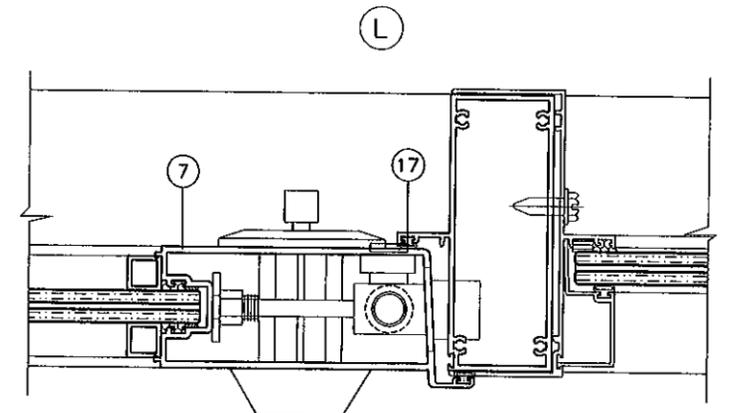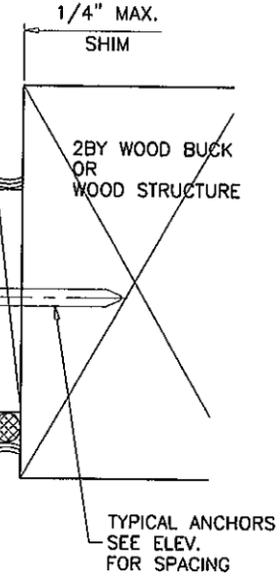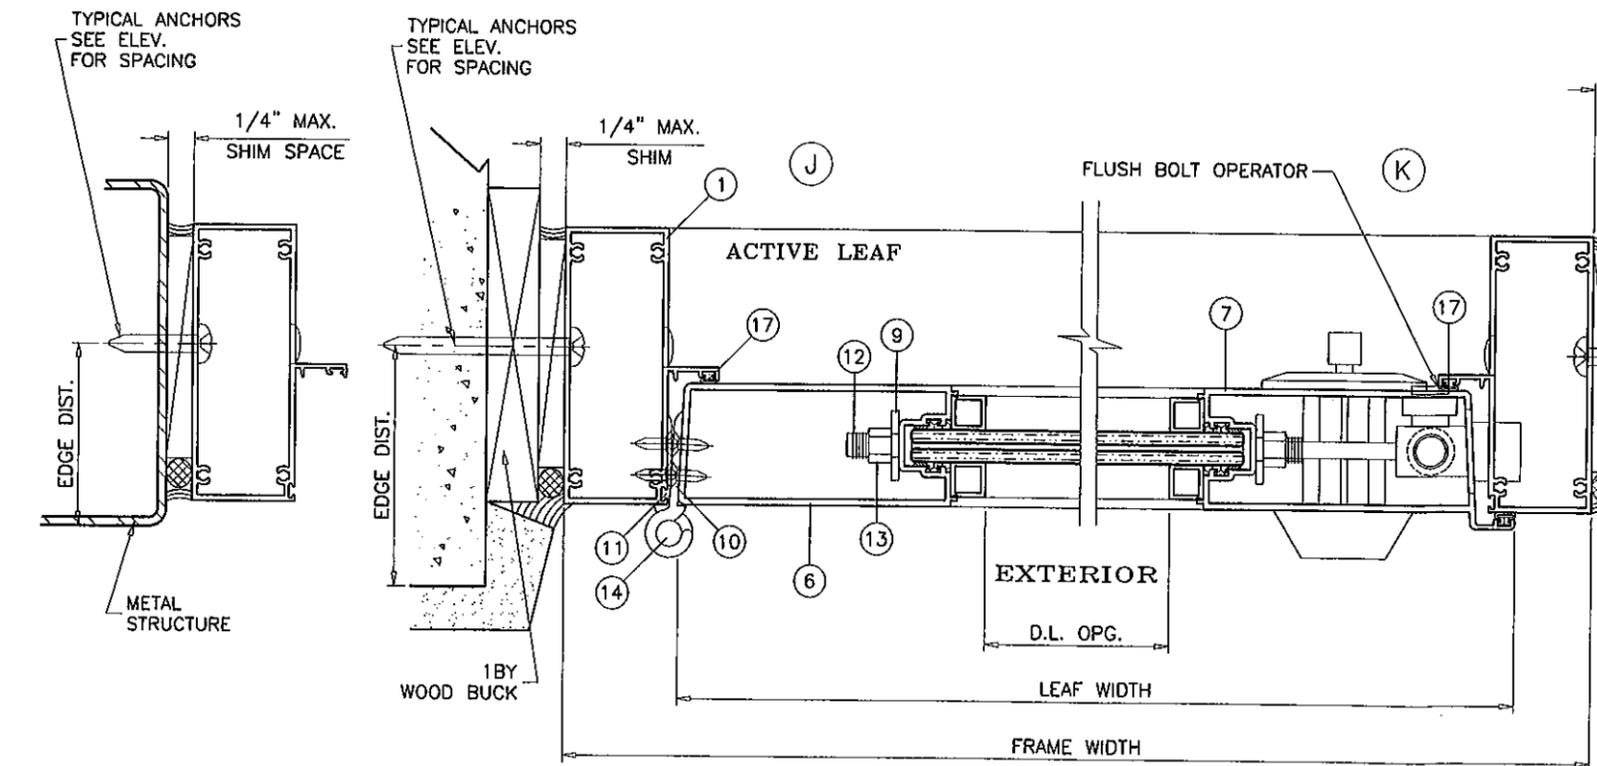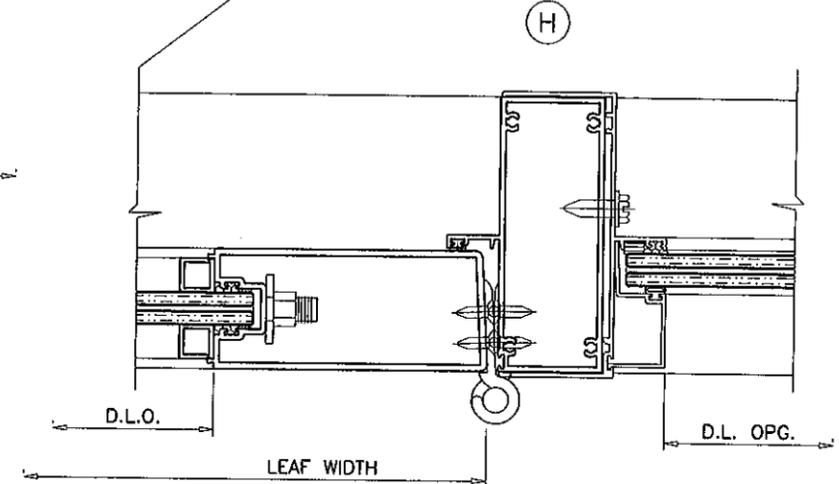

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0214.03
Expiration Date 10/6/15
Ishay I. Chanda
Special Note: Frame Code

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
APR 26 2012

afc
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W10-43AAD

ALUMINUM OUTSWING FRENCH DOOR (L.M.I.)
AMERICAN ALUMINUM DOORS CORP.
1026 EAST 24TH STREET
HIALEAH, FL. 33013
TEL. (305) 693-2642 FAX. (305) 693-2851


revisions:

no	date	by	description
A	09.01.10		REV. PER BCCO COMMENTS
B	01.11.12		NO CHANGE THIS SHEET


date: 06-18-10
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W10-43


sheet 4 of 6

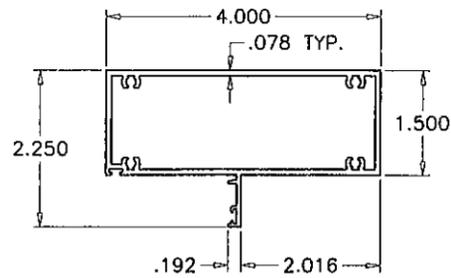


① FRAME HEAD/JAMB




③ WEATHERSTRIP ADAPTER

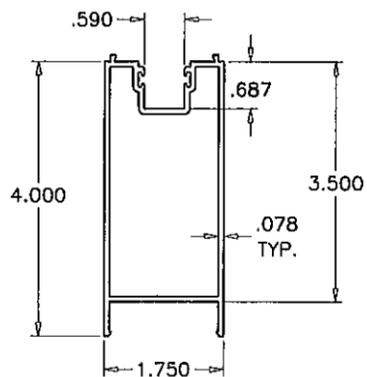



② TOP/BOTTOM RAIL

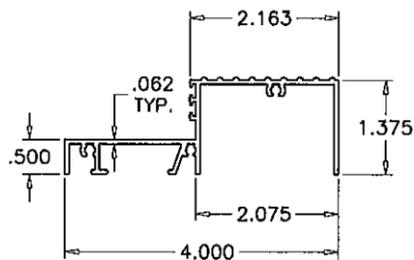


④ THRESHOLD

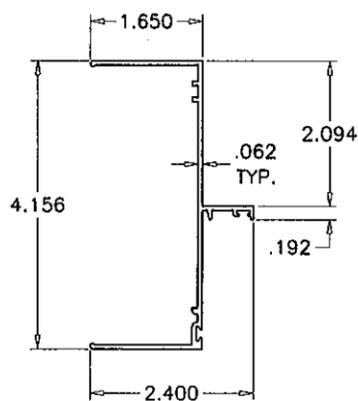


⑧ SIDELITE JAMB

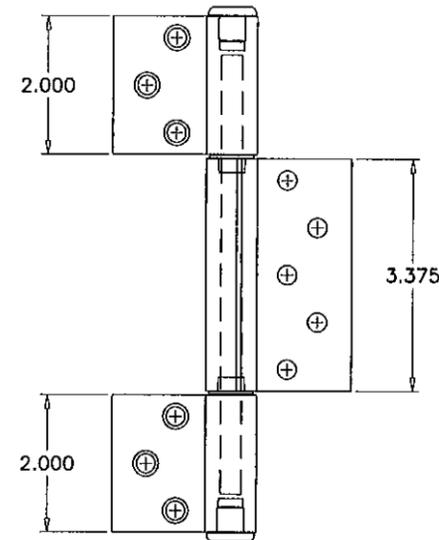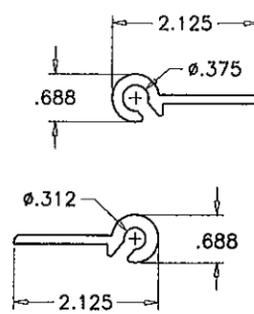


⑩ ⑪ 3 PIECE HINGE

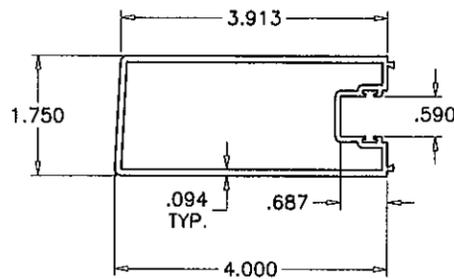


⑥ HINGE STILE

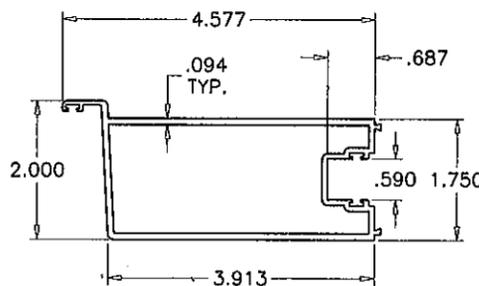


⑦ LOCK STILE

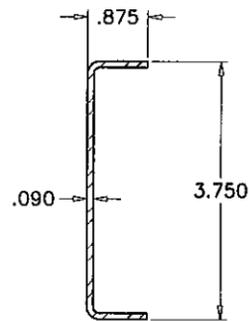


⑫ STEEL REINFORCING
36 KSI MIN.



⑤ SIDELITE GLAZING BEAD

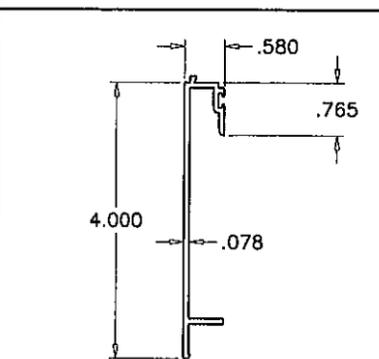

⑫ TOP/BOTTOM RAIL (TRIMMED)
SURFACE APPLIED CHAIR RAIL



⑮ GLAZING TUBES

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	R1-101	3/DOOR	FRAME HEAD/JAMB	6063-T6	-
2	R1-107	2/LEAF	DOOR TOP/BOTTOM RAIL	6061-T6	-
2.1	R1-107	AS REQD.	TOP/BOTTOM RAIL(TRIMMED)/CHAIR RAIL	6061-T6	-
3	R1-104	AS REQD.	WEATHERSTRIP ADAPTER	6063-T5	-
4	R1-102	1/DOOR	THRESHOLD	6063-T5	-
5	R1-111	AS REQD.	GLAZING ADAPTER (SIDELITE)	6063-T5	-
6	R1-108	1/LEAF	HINGE STILE	6063-T5	-
7	R1-109	1/LEAF	LOCK STILE	6063-T5	-
8	R1-103	AS REQD.	SIDELITE JAMB	6063-T6	-
9	-	1/CORNER	ASSEMBLY WASHER	STEEL	1" O.D. X .450 I.D. X .110 THK.
10	R1-105	3/LEAF	HINGE DOOR PORTION	6063-T5	-
11	R1-106	3/LEAF	HINGE FRAME PORTION	6063-T5	-
12	-	2/LEAF	3/8"-16 X 32" LONG THREADED ROD	STEEL	-
13	-	2/LEAF	3/8"-16 NUT	-	-
14	-	1/HINGE	5/16" X 6" ROD	STEEL	PLATED STEEL
15	-	8/ LEAF	GLAZING TUBE	6063-T5	SILICONED IN PLACE
17	3063	AS REQD.	BULB WEATHERSTRIPPING	FLEX. PVC	MELTPOINT PLASTICS, (DUROMETER 78±3)
18	W13331NW	AS REQD.	PILE WEATHERSTRIPPING	-	ULTRAFAB
20	2508	AS REQD.	FLUSH BOLTS	-	REGENT HARDWARE
21	-	OPTIONAL	REINFORCING CHANNEL	STEEL	-
22	#8 X 3/4"	AS REQD.	FRAME ASSEMBLY SCREWS	-	PH SMS
23	#14 X 3/4"	AS REQD.	SIDELITE JAMB SCREWS	-	AT 5" FROM ENDS & 12" O.C.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 12-0214.03
Expiration Date 10/6/15
By 16 Aug 11, Chan
Miami Dade Product Control

LOCKS:

ACTIVE LEAF:

- 1- CONVENTIONAL DOOR LEVER LOCKSET AT 38" FROM BOTTOM FASTENED WITH (2) #8 X 1-3/8" PH MACHINE SCREWS. FLUSH MOUNT STRIKE PLATE AT INACTIVE LEAF FACING LOCK FASTENED WITH (2) #8 X 1/2" FH MACHINE SCREWS.
- 2- SURFACE MOUNT DEAD BOLT LOCK, KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR LOCATED AT 45" FROM BOTTOM FASTENED WITH (2) #10 X 2-1/2" OH MACHINE SCREWS. FLUSH MOUNT STRIKE PLATE AT INACTIVE LEAF FACING LOCK FASTENED WITH #8 X 1/2" FH MACHINE SCREWS.
- 3- CONCEALED FLUSH BOLTS, MANUALLY OPERATED LEVER MOUNTED ON INSIDE FACE OF LEAF STILE LOCATED AT 14" FROM BOTTOM AND 17" FROM TOP. FASTENED WITH (2) #8 X 1/2" PH MACHINE SCREW

INACTIVE LEAF

CONCEALED FLUSH BOLTS, MANUALLY OPERATED LEVER LOCATED AT 14" FROM BOTTOM AND 17" FROM TOP. FASTENED WITH (2) #8 X 1/2" PH MACHINE SCREW

NOTE: TOP AND BOTTOM FLUSH BOLTS MUST BE ENGAGED DURING PERIODS OF HURRICANE WARNING.

Engr: JAVAD AHMAD
CIVIL
FLA. PE. # 70592
C.A.N. 3538

APR 26 2012




AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\W10-43AAD

ALUMINUM OUTSWING FRENCH DOOR (L.M.I.)
AMERICAN ALUMINUM DOORS CORP.
1026 EAST 24TH STREET
HIALEAH, FL. 33013
TEL. (305) 693-2642 FAX. (305) 693-2851


no	date	by	description
A	09.01.10	REV. PER BCCO COMMENTS	
B	01.11.12	NO CHANGE THIS SHEET	

date: 06-18-10
scale: 3/8" = 1"
dr. by: HAMID
chk. by:


drawing no.
W10-43
sheet 5 of 6

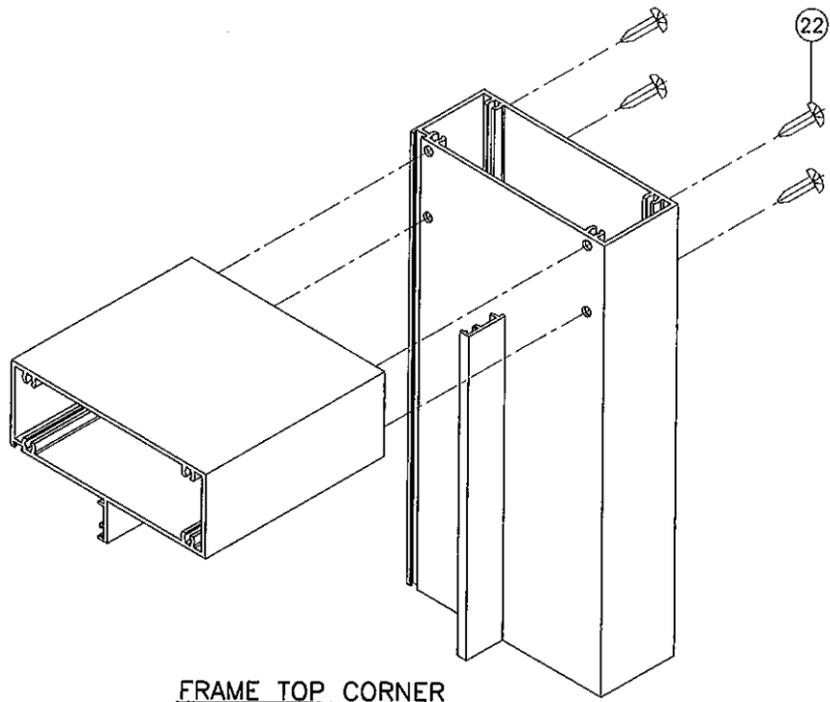

FRAME TOP CORNER

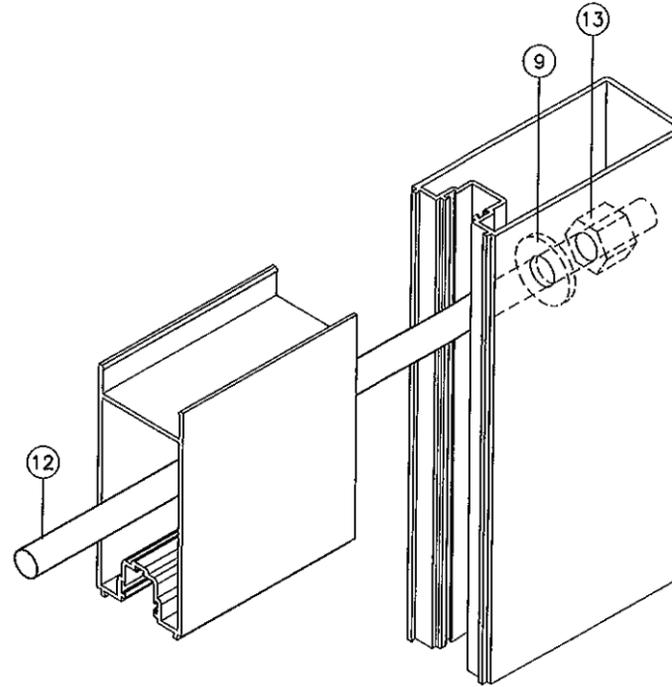

DOOR LEAF CORNER

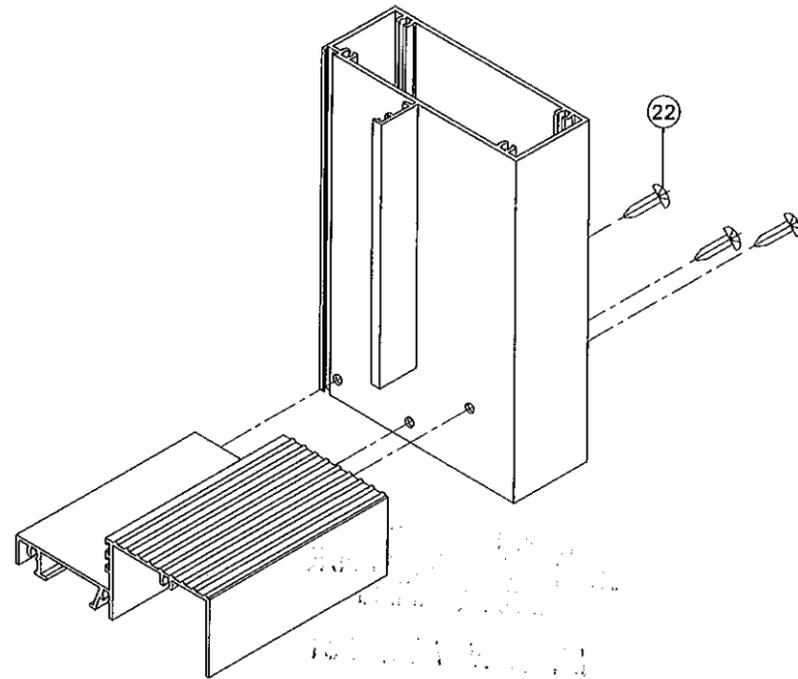

FRAME BOTTOM CORNER

PRODUCT REVISED
 to comply with the Florida
 Building Code
 Acceptance No 12-0214-03
 Expiration Date OCT 26 2015
 By Ishaq I. Chaudhry
 Release Date: Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

[Signature]

APR 26 2012

afc

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP - ANL \ W10 - 43AAD

ALUMINUM OUTSWING FRENCH DOOR (L.M.I.)
AMERICAN ALUMINUM DOORS CORP.
 1026 EAST 24TH STREET
 HIALEAH, FL. 33013
 TEL. (305) 693-2642 FAX. (305) 693-2851

no	date	by	description
A	09.01.10		NO CHANGE THIS SHEET
B	01.11.12		NO CHANGE THIS SHEET

date: 06-18-10
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W10-43
 sheet 6 of 6