



DEPARTMENT OF PERMITTING, ENVIRONMENT, AND REGULATORY
AFFAIRS (PERA)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/pera/

M. Q. Windows
1855 Griffin Road, Suite A-271
Dania, Fl. 33004

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County PERA -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. PERA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: JS Series Outswing Glazed Wood Doors-LMI

APPROVAL DOCUMENT: Drawing No **JS-4-OUT**, titled "JS Outswing Wood Door" Sheets 1 through 13 of 13, dated 01-10-98 and last revised on FEB 15, 2012, prepared by manufacturer, signed and sealed by Scott Wolters, P. E. , bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large & Small Missile Impact Resistant

Limitation:

1. Raised Wood panels are limited to max. area specified, in combination with Glass.
2. Smaller Door sizes must comply as permitted by FBC requirements.

LABELING: Each unit shall bear a permanent label with M.Q. Windows, **Ste-Agathe des Monts, Quebec, Canada** and following statement: "Miami-Dade County Product Control Approved", noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **10-0902.09** and consists of this page 1 and evidence pages E-1 & E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**

5/3/12



NOA No 12-0222.10
Expiration Date: April 20, 2016
Approval Date: May 10, 2012
Page 1

M. Q. Windows

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Anchor verification calculations complying w/ FBC-2010 dated May 01, 2012, prepared by Wolters Engineering Inc., signed and sealed by Scott Wolters, P.E.
2. Glazing complies w/ ASTM E-1300-02 & -04

D. QUALITY ASSURANCE

1. Miami Dade Department of Permitting, Environment, and Regulatory Affairs (PERA).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **11-0325.05**, issued to Solutia Inc, for "Saflex clear & color interlayer", expiring 05/21/2016.

F. STATEMENTS

1. Stateman letter of conformance to FBC 2010, dated 02-15-12, prepared by Wolters Engineering, signed and sealed by Scott Wolters, P. E.
2. Statement letter dated 12-06-10, issued by Wolters Engineering Inc., of Succeeding Engineer adopting another Engineer's work, signed and sealed by Scott Wolters, P.E.(submitted under **10-0902.10**)
3. Stateman letter of conformance to FBC 2007 and "no financial interest", dated 12-06-10, signed and sealed by Scott Wolters, P. E. (submitted under **10-0902.10**).
4. Statement letters of compliance, part of the above test reports.
5. Addendum letter dated 04-27-00 for test reports, **HTL-0118-1103-98 (Sp#1),-0118-1006-98(Sp#2) , 0118-0702-99(Sp#1 (MQ-8)) and 0118-0702-99(Sp#2 (MQ-7))**, prepared by Hurricane Testing Laboratories, , reviewed, signed and sealed by Vinu Abraham, P.E. (Transferred from file # # 99-1228.06)
6. Distribution agreement MQ Windows, Canada and MQ Windows Inc, Dania, Florida dated Nov 30, 201, signed by Gilles Morin, president.

G. OTHER

1. This NOA **revises** NOA # **10-0902.10**, expiring on April 20, 2016.
2. Test proposals dated 3/26/02 thru 09/05/02, approved by BCCO.
3. Test proposal **98-0073** dated August 3, 1998& October 14, 1998, approved by BCCO.



Ishaq I. Chanda, P.E.

Product Control Examiner

NOA No 12-0222.11

Expiration Date: April 20, 2016

Approval Date: May 10, 2012

M. Q. Windows

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections (transferred from file # **10-0902.09**)
2. Drawing No **JS-4-OUT**, titled "JS Outswing Wood Door" Sheets 1 through 13 of 13, dated 01-10-98 and last revised on FEB 15, 2012, prepared by manufacturer, signed and sealed by Scott Wolters, P.E.

Note: This revision consists of FBC 2010 notes only.

B. TESTS (Test reports transferred from file # **10-0902.09/#05-1004.06)**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94.
 - 3) Water Resistance Test, per FBC, TAS 202-94.
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

Along with the manufacturer's parts drawings, installation diagram and marked-up drawings of an outswing wood door prepared by Hurricane Test Laboratory, LLC, Test Report No (s). **HTL-0118-0131.03** (sample #1), **HTL-0118-0507.03**, **HTL-0118-0722.03**, all dated 2/3/03 to 7/30/03, signed and sealed by Vinu J. Abraham, P.E, signed and sealed by Vinu J. Abraham, P.E. &

Also the manufacturer's parts drawings, installation diagram and marked-up drawings of a shaped wood Windows prepared by Hurricane Test Laboratory, LLC, Test Report No **HTL-0118-0204.03**, dated 2/12-13/03, signed and sealed by Vinu J. Abraham, P.E.

3. Additional test reports transferred from file # **99-1228.06**:

3.1 Test Report No. **HTL-0118-1103-98(Sp# 1, 2, 3 & 7)**, **HTL-0118-1006-98 (Sp4 & 7)** **HTL-0118-1218-98 (Sp#1)**, **HTL-0118-0702-99 (Sp#1)**, along with manufacturer's parts and section marked drawings prepared by Hurricane Testing Laboratories, dated 10/15//98 thru 07-06-99, signed and sealed by Timothy S. Marshall, P.E., for the following tests:

- 1) Air Infiltration Test, per PA 202-94
- 2) Uniform Static Air Pressure Test, Loading per PA 202-94
- 3) Water Resistance Test, per PA 202-94.
- 4) Large Missile Impact test, per SFBC and PA201-94
- 5) Cyclic loading test, per SFBC and PA203-94
- 6) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94

3.2. Test report on HTL-0118-0702-99

- 1) Large Missile Impact test, per SFBC and PA201-94
- 2) Cyclic loading test, per SFBC and PA203-94

Along with manufacturer's parts and section drawings marked by Hurricane Testing Laboratory Inc, for specimen #1(MQ-8), signed and sealed by Vinu Abraham, P.E.

3.3. Structural Test reports for HTL-0118-0702-99 (Specimen #1(MQ-8) & Specimen#2(MQ-7) and HTL-0118-1103-98(Specimen #1(MQ1)), along with manufacturer's parts and section marked-up drawings, prepared by Hurricane Testing Laboratory Inc, signed and sealed by Vinu Abraham, P.E

- 1) Air Infiltration Test, per PA 202-94
- 2) Uniform Static Air Pressure Test, Loading per PA 202-94
- 3) Water Resistance Test, per PA 202-94.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.

Product Control Examiner

NOA No 12-0222.10

Expiration Date: April 20, 2016




Approval Date: May 10, 2012

DOORS, OUTSWING
ELEVATION VIEWS
CONFIGURATIONS: x, xx
WOOD: Mahogany
VIEWED FROM THE OUTSIDE

DESIGN PRESSURE APPLYING TO THIS PAGE
Acting inward: +60 psf Acting outward: -70 psf
Note: All sizes noted are maximum sizes. Sizes smaller in width & height are permitted.


GENERAL NOTES:

- 1- THIS PRODUCT IS DESIGNED TO COMPLY WITH THE PROVISIONS OF THE HIGH VELOCITY HURRICANE ZONE (HVHZ) OF THE 2010 EDITION OF THE FLORIDA BUILDING CODE.
- 2- THIS PRODUCT IS LARGE MISSILE IMPACT RESISTANT AND HAS BEEN TESTED IN ACCORDANCE WITH THE HIGH VELOCITY HURRICANE ZONE PROTOCOLS TAS201, 202 AND 203. NO SHUTTERS ARE REQUIRED.
- 3- WOOD BUCKS (BY OTHERS) AND OPENINGS MUST BE DESIGNED BY THE PROFESSIONAL OF RECORD TO PROPERLY TRANSFER WIND LOADS TO THE MAIN STRUCTURE.
- 4- SPECIFIED ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
- 5- IN ORDER TO VERIFY THAT ANCHORS FOR THIS PRODUCT WERE NOT OVERSTRESSED AS TESTED, A 33% ALLOWABLE STRESS INCREASE WAS NOT USED IN THEIR ANALYSIS. HOWEVER, A LOAD DURATION FACTOR OF $C_d = 1.6$ WAS USED TO VERIFY THEIR SPACING IN WOOD SUBSTRATES.

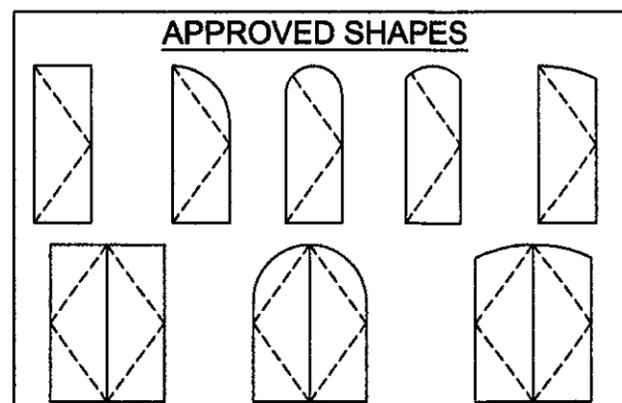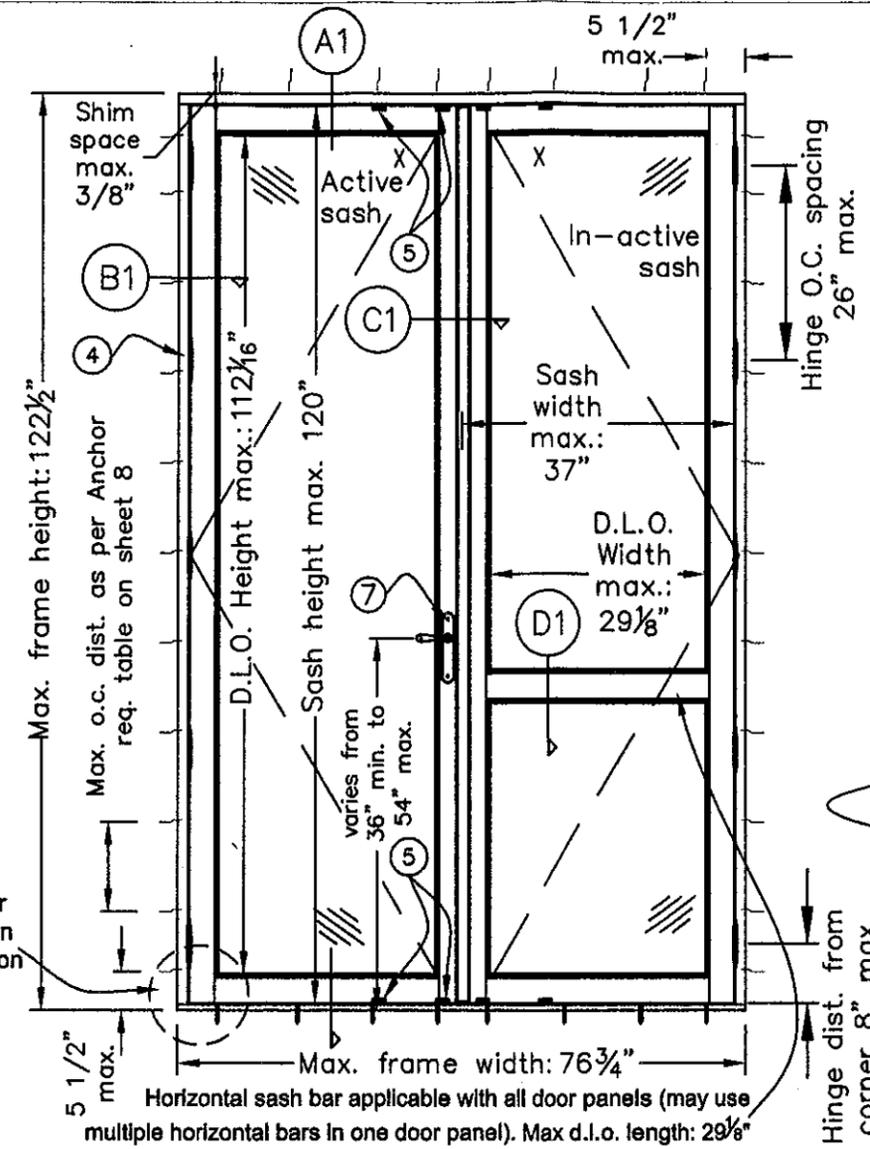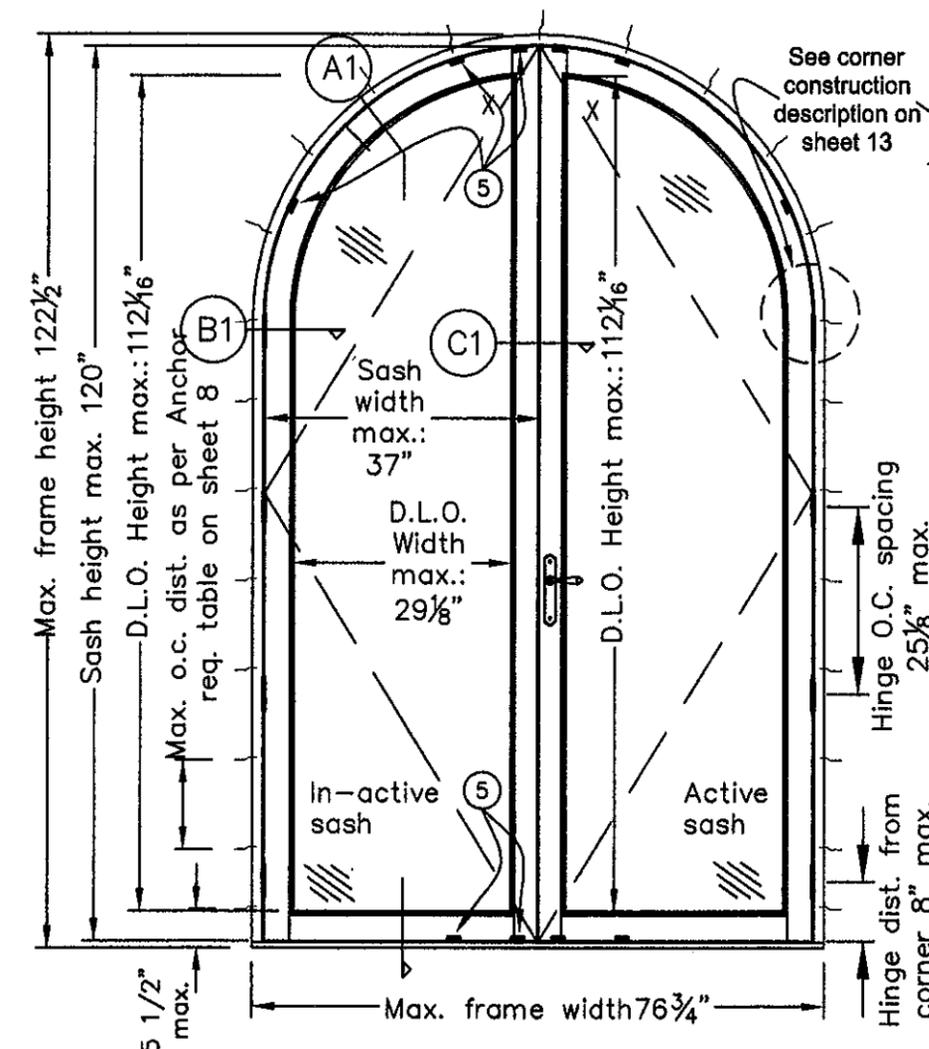

- NOTES:**
1. Other shapes may apply providing they are similar to those shown & have corner construction as described on sheet 13.
 2. All shaped units must fit inscribed into the allowable rectangular units & be governed by the allowable pressure of the respective rectangular unit.
 3. Approved shaped heads on this sheet conform to cross section A1 on sheet 4.
 4. Keepers qty & location identical to shown arched door. For single panel full arched door, keepers at head evenly distributed.

GLAZING TYPE TABLE
GLASS: SINGLE, LAMINATED
Option 1: 15/32" (O.T.) Made of 3/16"(AN)-0.090" PVB interlayer Saflex IIIg by Solutia-3/16"(HS)
Option 2: 15/32" (O.T.) Made of 3/16"(HS)-0.090" PVB interlayer Saflex IIIg by Solutia-3/16"(HS)
GLASS: DOUBLE, INSULATED
1" (O.T.) Made of: 3/16" (AN) - 0.090" PVB plastic film interlayer Saflex IIIg by Solutia - 3/16" (HS) - 7/16" air space - 5/32" full tempered.
RAISED WOOD PANEL:
Max. DLO area: -MDF veneer covered: Max. 18.92 sqf. Min. specific gravity $G = 0.75 = 48 \text{ lb/ft}^3 (0.769 \text{ g/cm}^3)$. -Solid mahogany wood: Max. 7.81 sqf
NOTE: -Aspect Ratio (D.L.O. Height / D.L.O. Width) must be less than or equal to 5.0 for all door sizes. -See Glazing Details on sheet 9

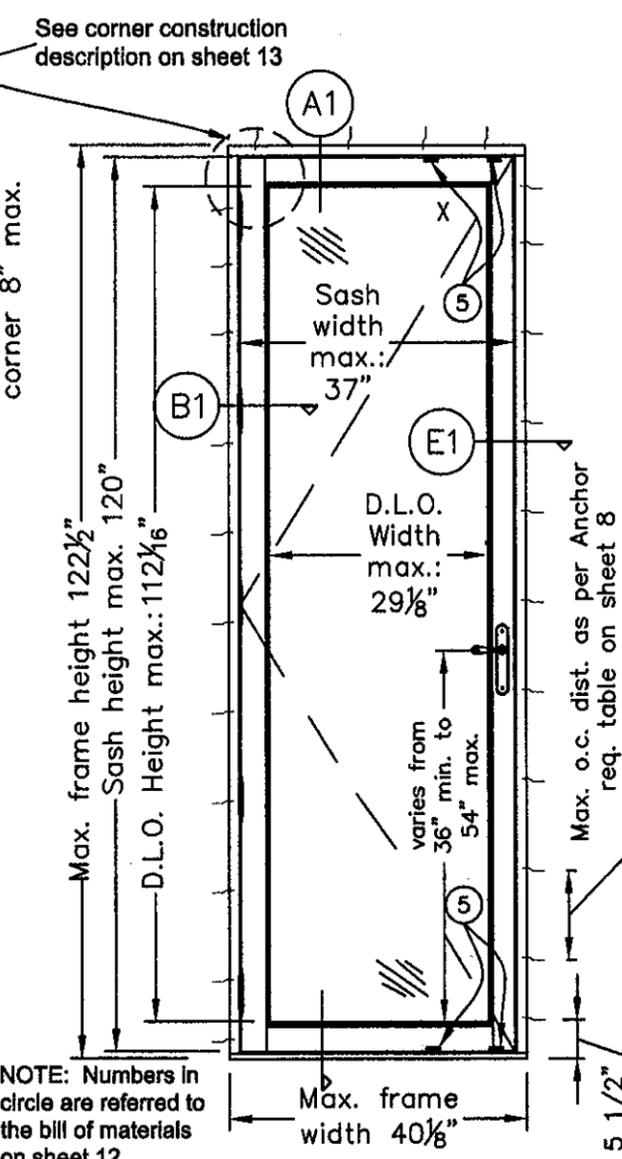

**JS SERIE
OUTSWING
WOOD DOORS
MIAMI DADE COUNTY**

Drawing no.: JS-4-OUT	
Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 07/14/10
File:	Page: 1/13

STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING, INC.
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
FEB 15 2012

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0222-10
Expiration Date APR 20, 2016
Ighas L. Chand
Miami Dade Product Control

NOTE: Numbers in circle are referred to the bill of materials on sheet 12.



**JS SERIE
OUTSWING
WOOD DOORS
MIAMI DADE COUNTY**

Drawing no.: JS-4-OUT

Scale: NONE Drawn by: S. Marcotte

Date drawn: 01/10/98 Date revised: 01/11/06

File: Page: 2/13


STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354


WOLTERS ENGINEERING, INC.
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
FEB 15 2012

DOORS, OUTSWING
NARROW PROFILES
ELEVATION VIEWS
CONFIGURATIONS: X, XX
WOOD: Mahogany
VIEWED FROM THE OUTSIDE


**DESIGN PRESSURE
APPLYING TO THIS PAGE**
As indicated on elevations
Note: All sizes noted are maximum
sizes. Sizes smaller in width &
height are permitted.
Shutters are not required.

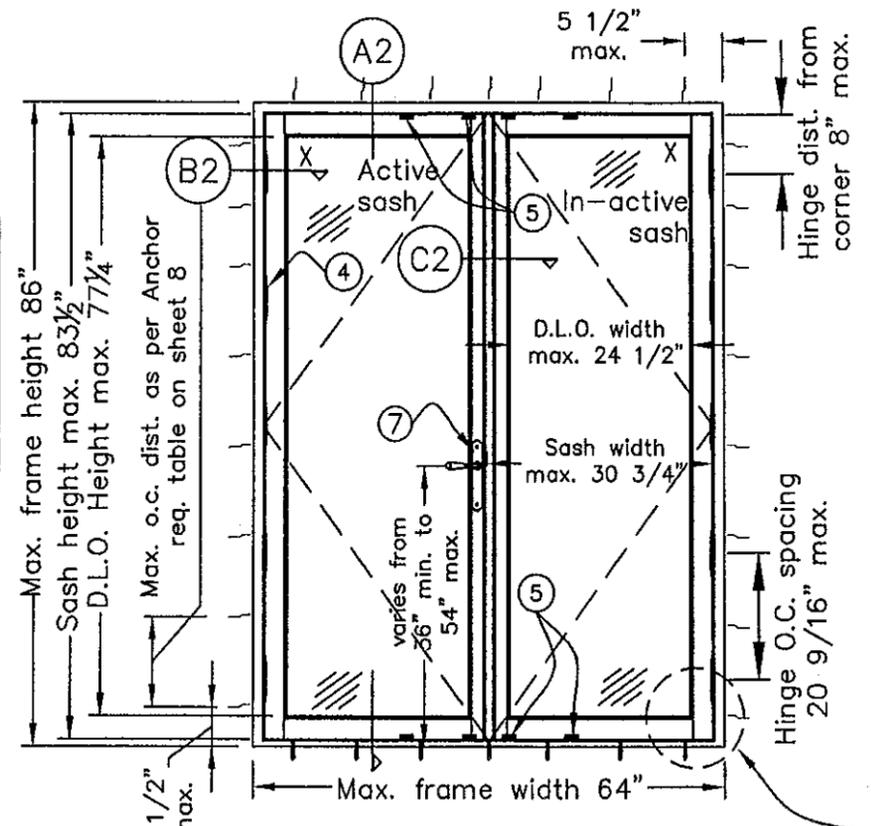


DESIGN PRESSURE RATING
Acting inward: +60.0 psf
Acting outward: -68.0 psf

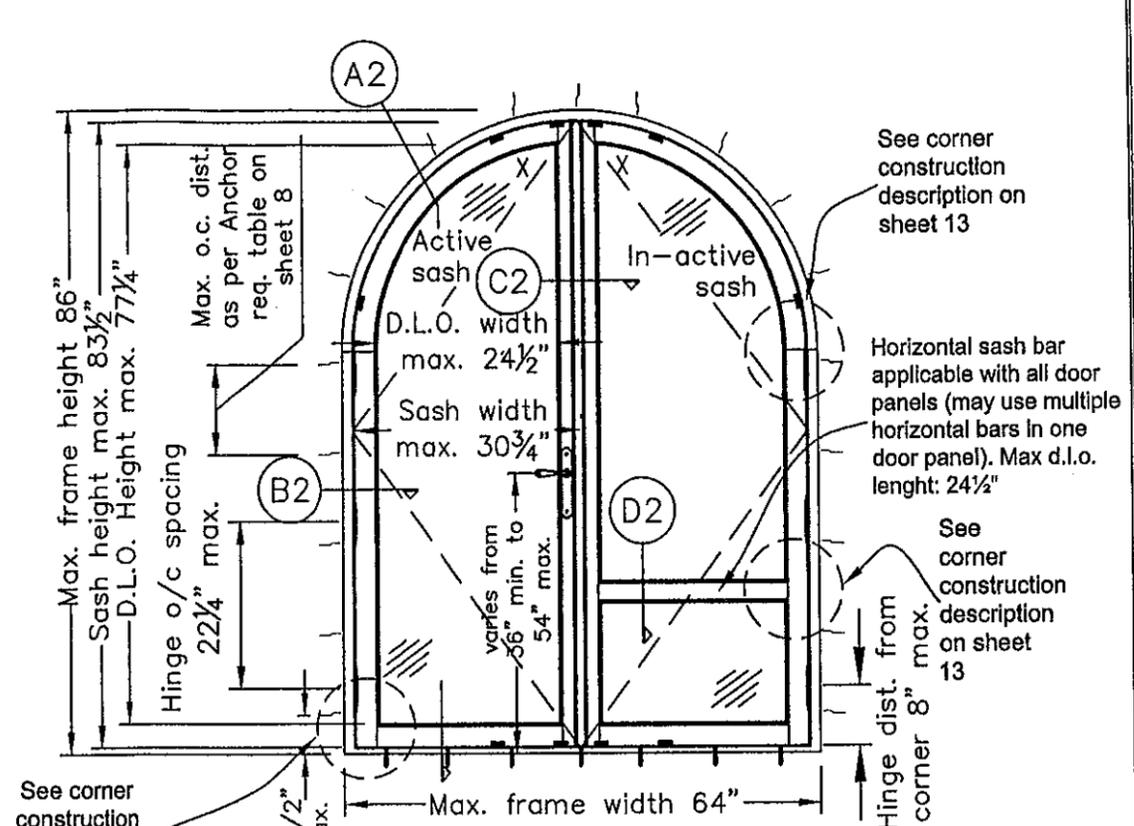

DESIGN PRESSURE RATING
Acting inward: +60.0 psf
Acting outward: -70.0 psf

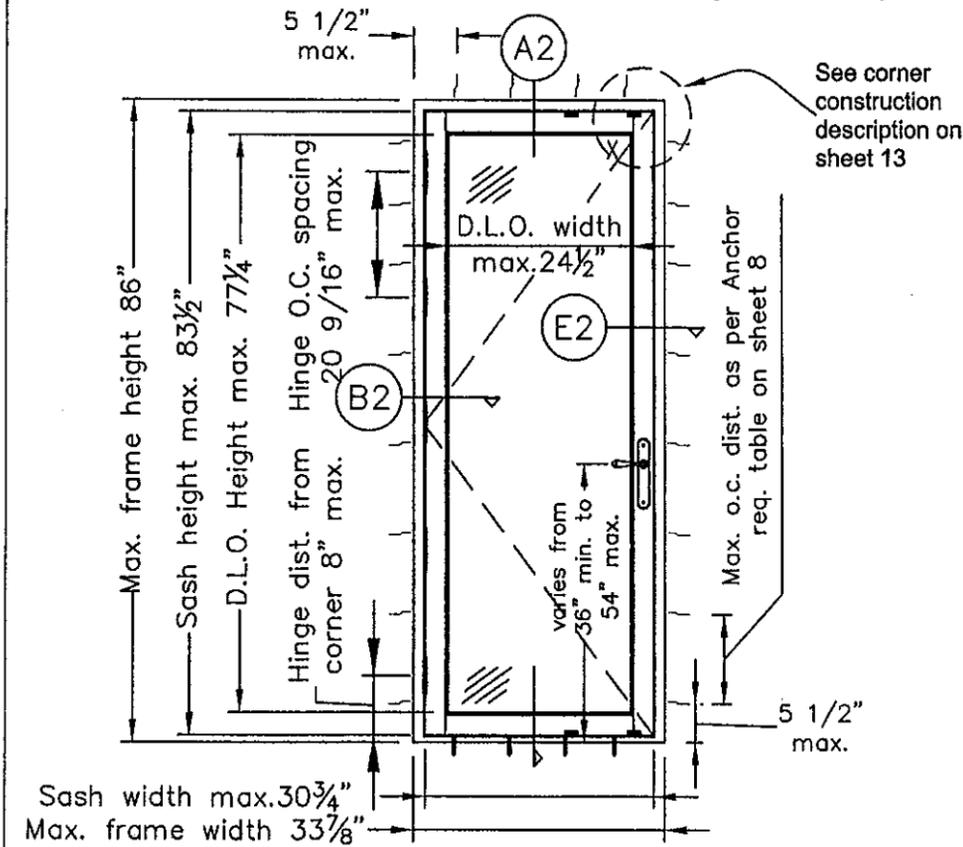

DESIGN PRESSURE RATING: Acting inward: +60.0 psf
Acting outward: -68.0 psf

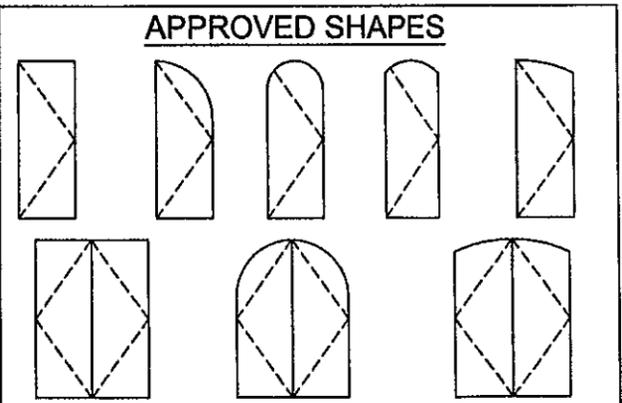

NOTES:
1. Other shapes may apply providing they are similar to those shown & have corner construction as described on sheet 13.
2. All shaped units must fit inscribed into the allowable rectangular units & be governed by the allowable pressure of the respective rectangular unit.
3. Approved shaped heads on this sheet conform to cross section A2 on sheet 4.
4. Keepers qty & location identical to shown arched door. For single panel full arched door, keepers at head evenly distributed.

NOTE: Numbers in circle are referred to the bill of materials on sheet 12.

GLAZING TYPE TABLE
GLASS: SINGLE, LAMINATED
3/16"(AN)-0.090" PVB interlayer Saflex IIIIG by Solutia-3/16"(HS)
GLASS: DOUBLE, INSULATED
1" (O.T.) Made of: 3/16" (AN) - 0.090" PVB interlayer Saflex IIIIG by Solutia - 3/16" (HS) - 7/16" air space - 5/32" full tempered.
RAISED WOOD PANEL:
Max. DLO area: -MDF veneer covered: Max. 18.92 sqf. Min. specific gravity: 48 lb/ft ³ (0.769 g/cm ³). -Solid mahogany wood: Max. 7.81 sqf
NOTE: See Glazing Details on sheet 9

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 12-0222-10
Expiration Date 9/20/16
By: *Shane L. Chanda*
Miami Dade Product Control

DOORS, OUTSWING
 NARROW PROFILES
 ELEVATION VIEWS
 CONFIGURATIONS: x, xx
 WOOD: Mahogany
 VIEWED FROM THE OUTSIDE

DESIGN PRESSURE APPLYING TO THIS PAGE
Acting inward: +58 psf Acting outward: -68 psf
Note: All sizes noted are maximum sizes. Sizes smaller in width & height are permitted.
Shutters are not required.

GLAZING TYPE TABLE
GLASS: SINGLE, LAMINATED
3/16"(AN)-0.090" PVB Interlayer Saflex IIIg by Solutia-3/16"(HS)
RAISED WOOD PANEL:
Max. DLO area: -MDF veneer covered: Max. 18.92 sqf. Min. specific gravity: 48 lb/ft ³ (0.769 g/cm ³). -Solid mahogany wood: Max. 7.81 sqf
NOTE: See Glazing Details on sheet 9

mq
 WINDOWS
 OF EUROPE AND
 THE AMERICAS
 1855 GRIFFIN ROAD,
 SUITE A-271
 DANIA, FL 33004

JS SERIE
 OUTSWING
 WOOD DOORS
 MIAMI DADE COUNTY



Drawing no.: JS-4-OUT

Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 01/11/06
File:	Page: 3/13

STRUCTURALLY REVIEWED BY:

Scott Wolters
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 1271 GRANT STREET
 HOLLYWOOD, FL 33019
 FEB 15 2012


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 12-0222-10
 Expiration Date 4/2016
Shay L. Chavira
 Chief Building Product Control

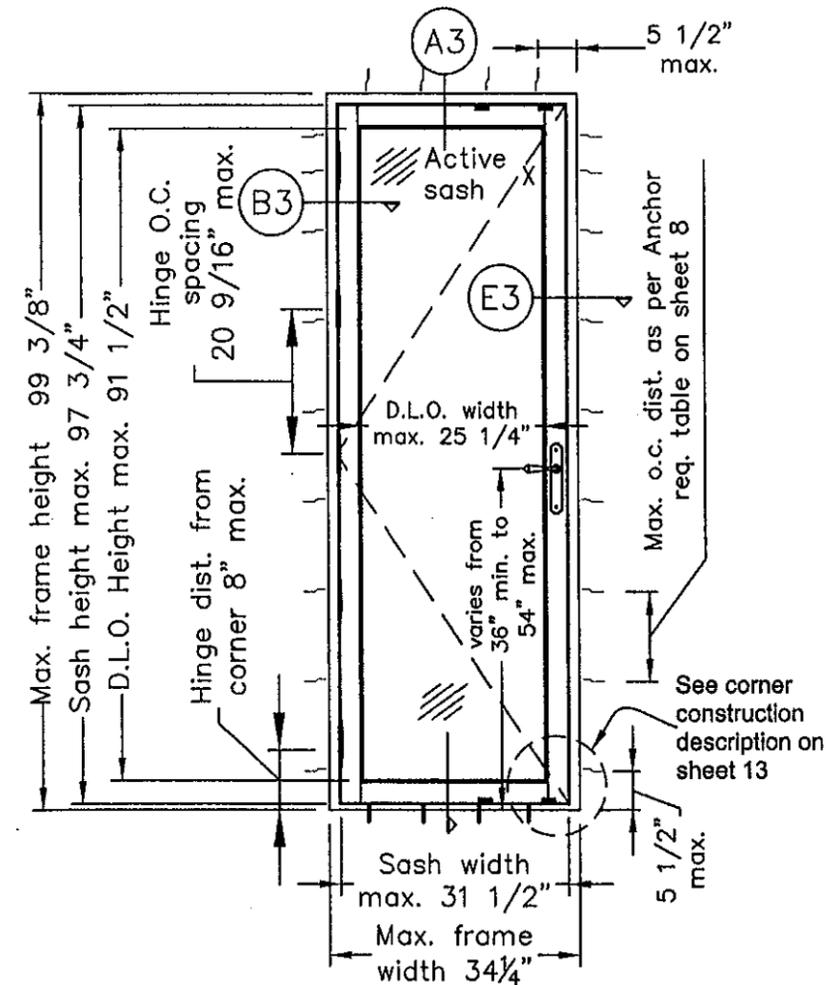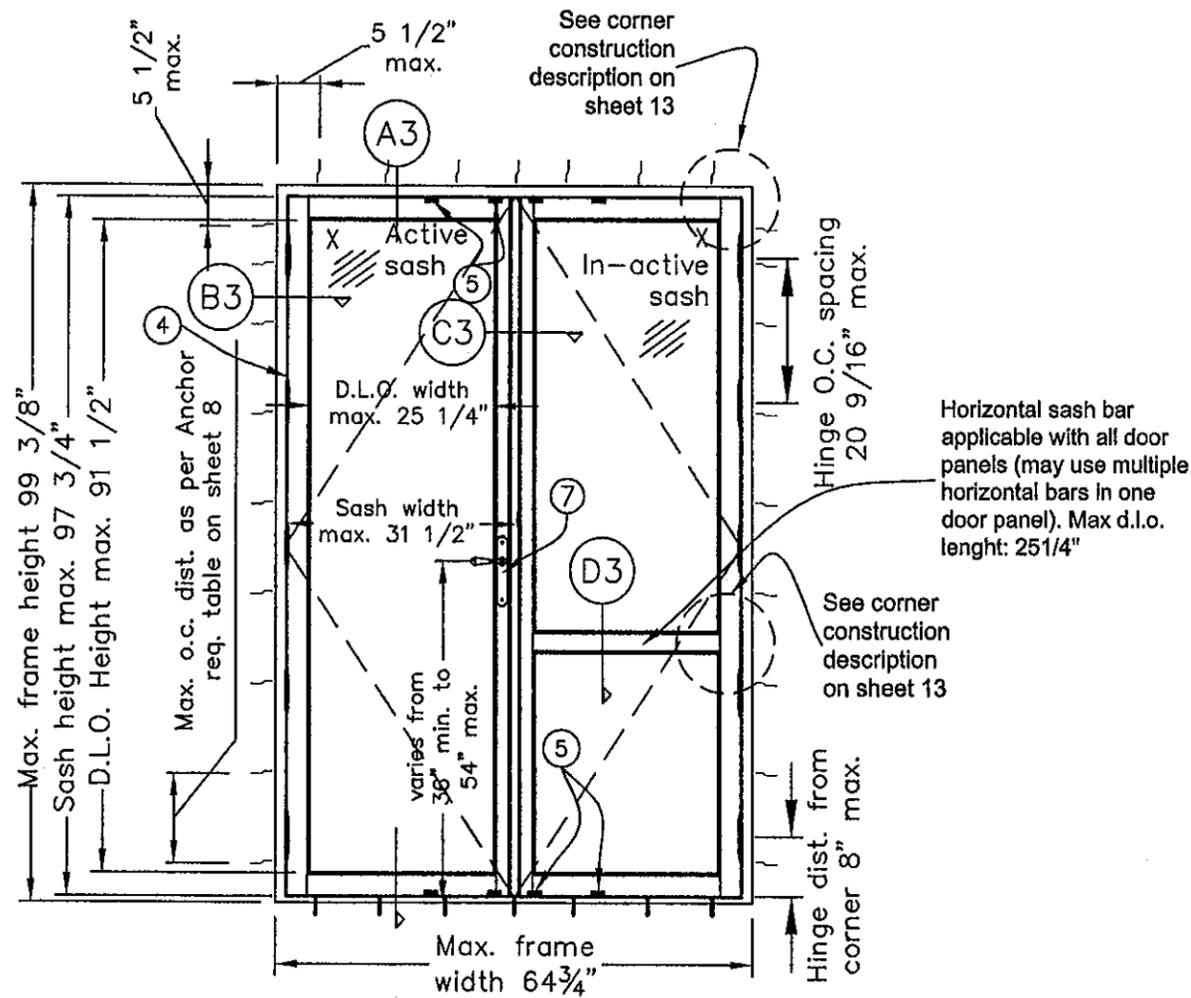

NOTE: Numbers into circle are referring to the bill of materials on sheet 12.


CROSS SECTION VIEWS

A1 HEAD & SILL
OUT-SWING

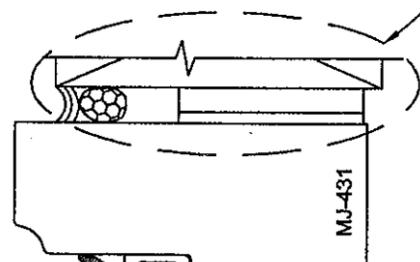

SEE ANCHORING
DETAILS ON sheet 7 & 8


A2 HEAD & SILL
OUT-SWING

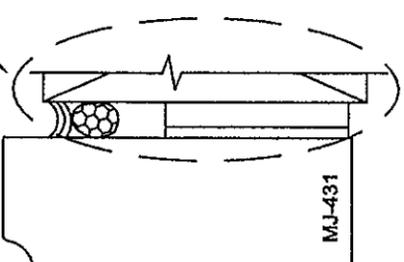

SEE GLAZING
DETAILS &
OPTIONS ON
sheet 9


EXTERIOR

D.L.O.
HEIGHT

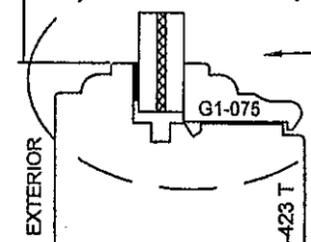

EXTERIOR

OUT-SWING


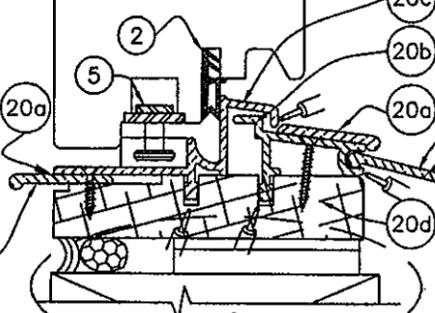


Optional
bronze flap

SEE ANCHORING DETAILS
ON sheet 7 & 8

FRAME HEIGHT



SASH HEIGHT

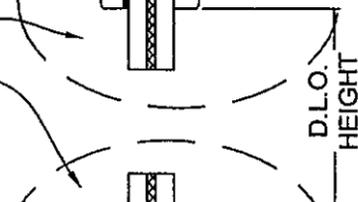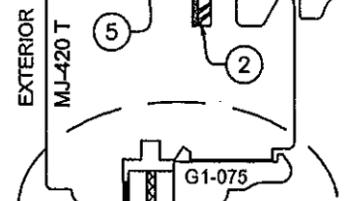

D.L.O.
HEIGHT

FRAME HEIGHT


SASH HEIGHT

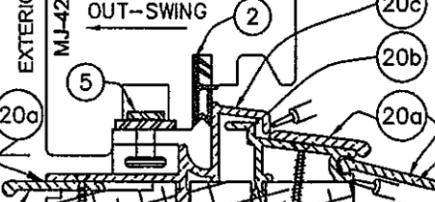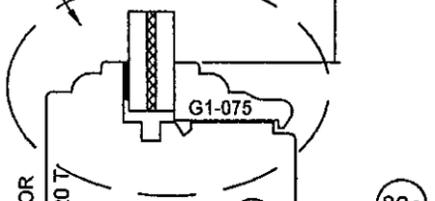

Optional
bronze flap


SEE GLAZING
DETAILS &
OPTIONS ON
sheet 9

E1 JAMB @ Lock style
OUT-SWING

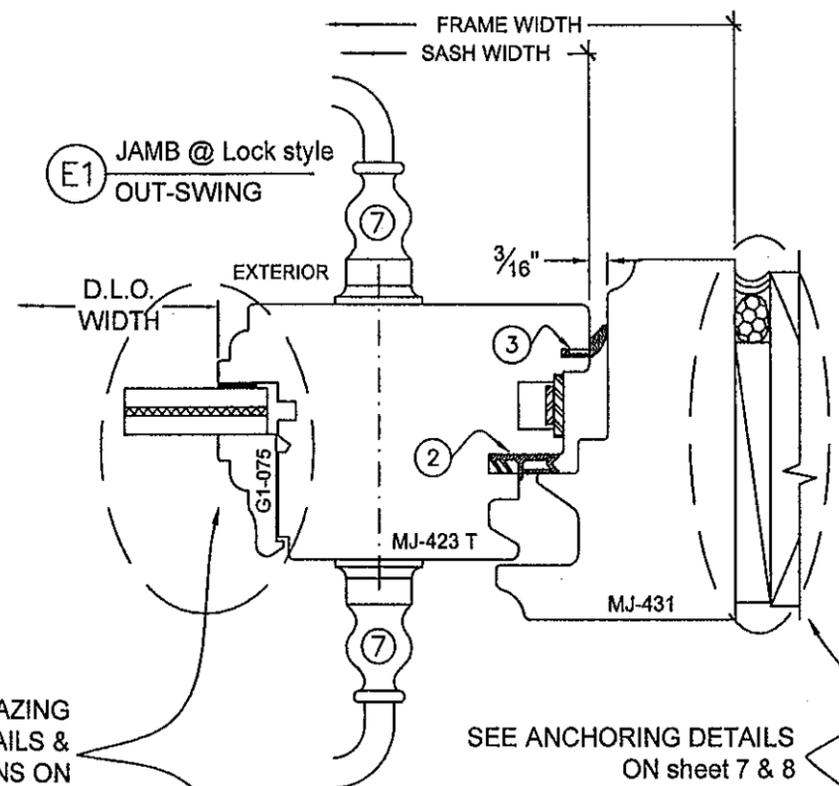

SEE ANCHORING DETAILS
ON sheet 7 & 8

E2 JAMB @ Lock style
OUT-SWING

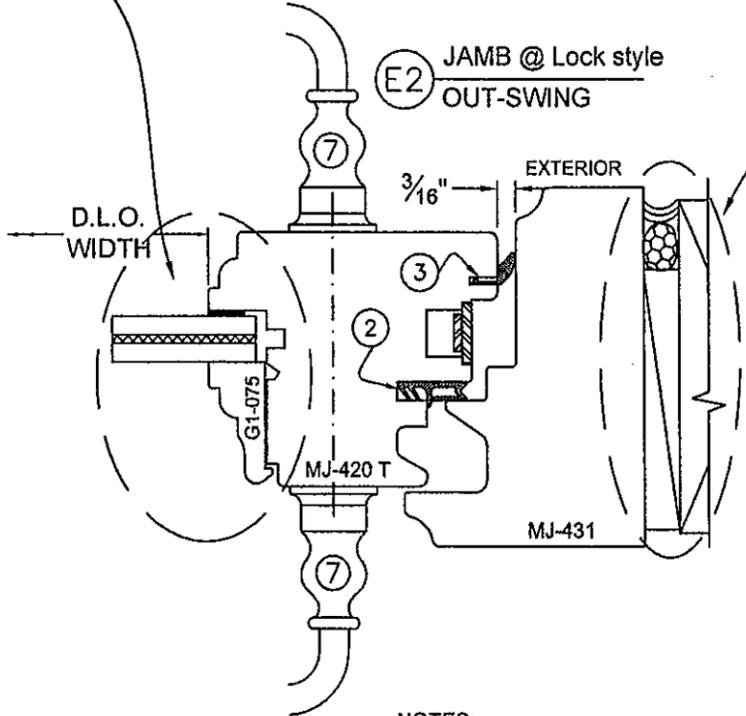

NOTES:

Clear silicone
sealant at shown
interfaces

Backing rod and
sealant as required

Numbers are referring to
bill of materials (sheet 12)

JS SERIE OUTSWING WOOD DOORS MIAMI DADE COUNTY

Drawing no.: JS-4-OUT

Scale: NONE
Drawn by: S. Marcotte

Date drawn: 01/10/98
Date revised: 01/11/06

File: Page: 4/13


STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
FEB 15 2012

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0222-10
Expiration Date 4/20/16
By: *Isaac L. Chandra*
Sound Bldg. Product Control



CROSS SECTION VIEWS

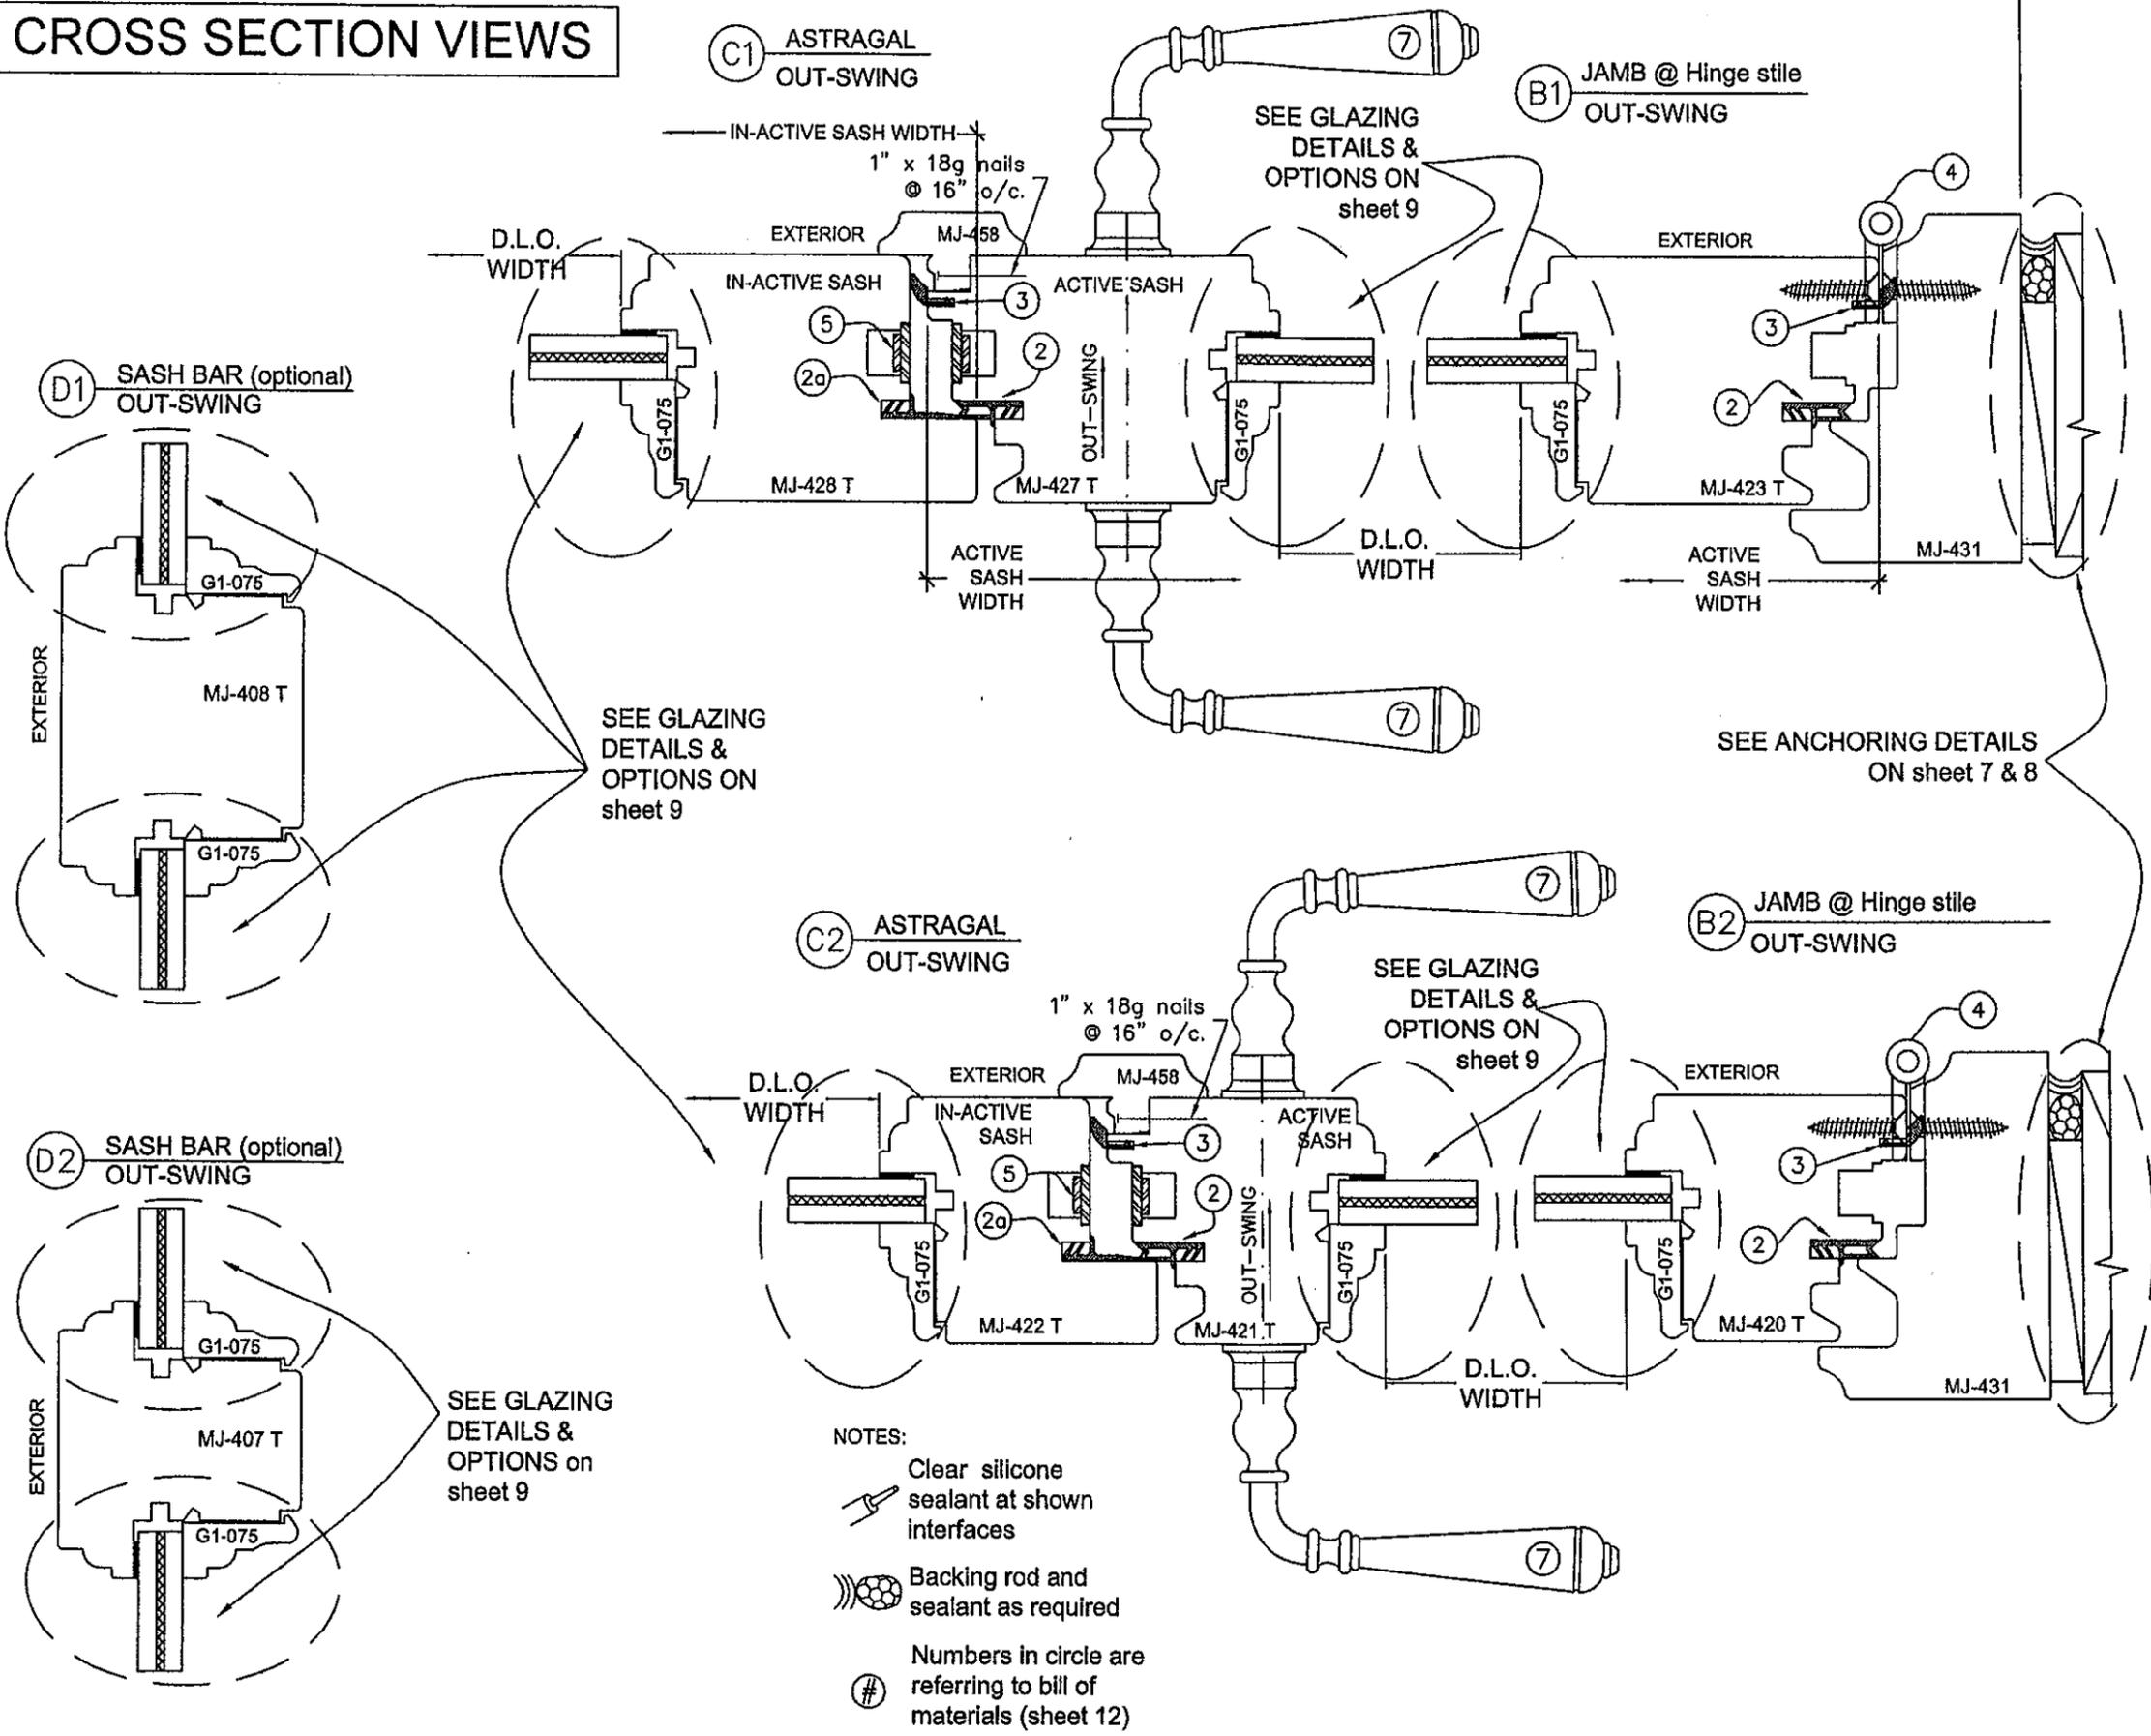

**JS SERIE
OUTSWING
WOOD DOORS
MIAMI DADE COUNTY**

Drawing no.: JS-4-OUT

Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 01/11/06
File:	Page: 5/13

STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING, INC.
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
FEB 15 2012

- NOTES:
- Clear silicone sealant at shown interfaces
 - Backing rod and sealant as required
 - Numbers in circle are referring to bill of materials (sheet 12)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0222-10
Expiration Date 4/2016
Shirley L. Chank
Miami Dade Product Control




CROSS SECTION VIEWS

A3 HEAD & SILL
(@ Head)

Use wood or plastic shims behind as required

See ANCHORING DETAILS on sheet 7 & 8

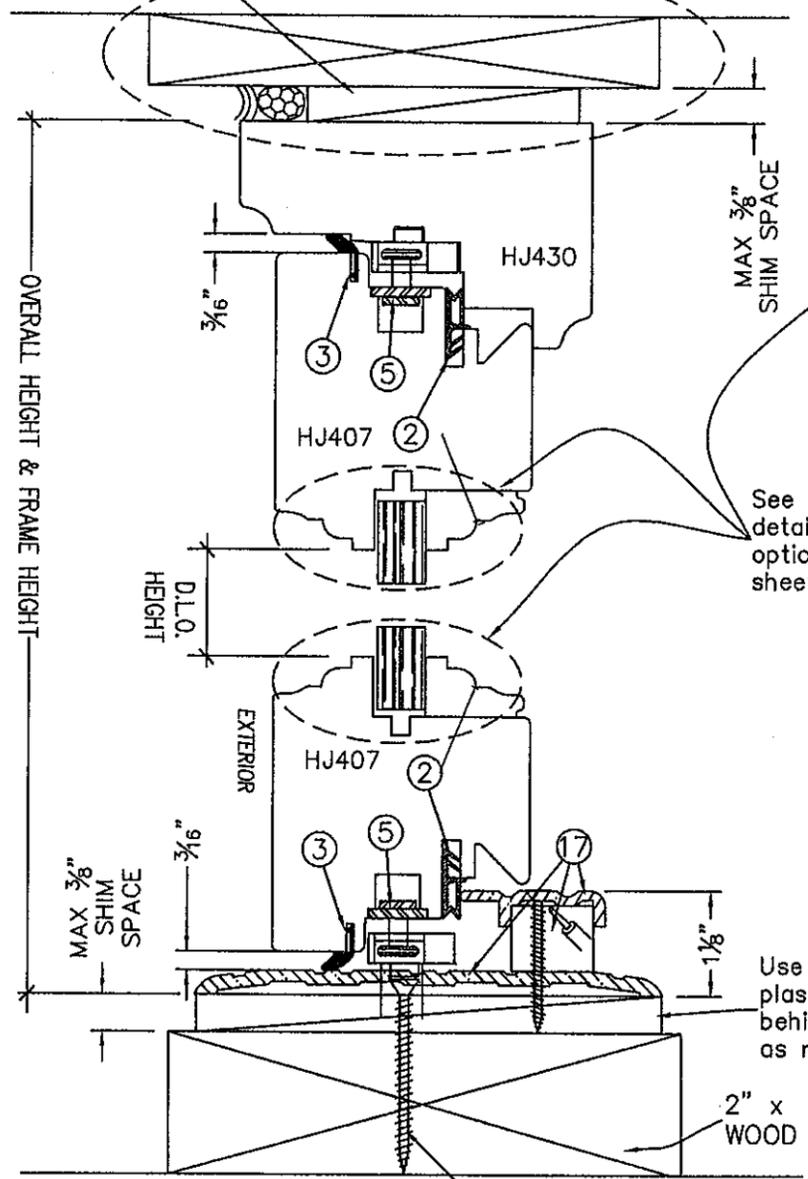

A3 HEAD & SILL
(@ Sill w/ 2x & SCREWED)

See A10 on ANCHOR REQUIREMENT TABLE (sheet 8) for fastener specification


1" x P.T. CONTINUOUS WOOD SHIM

Use wood or plastic shims behind as required

A3 HEAD & SILL
(@ Sill w/ 1x & TAPCON)

See A20 on ANCHOR REQUIREMENT TABLE (sheet 8) for fastener specification


← OVERALL WIDTH & FRAME WIDTH →

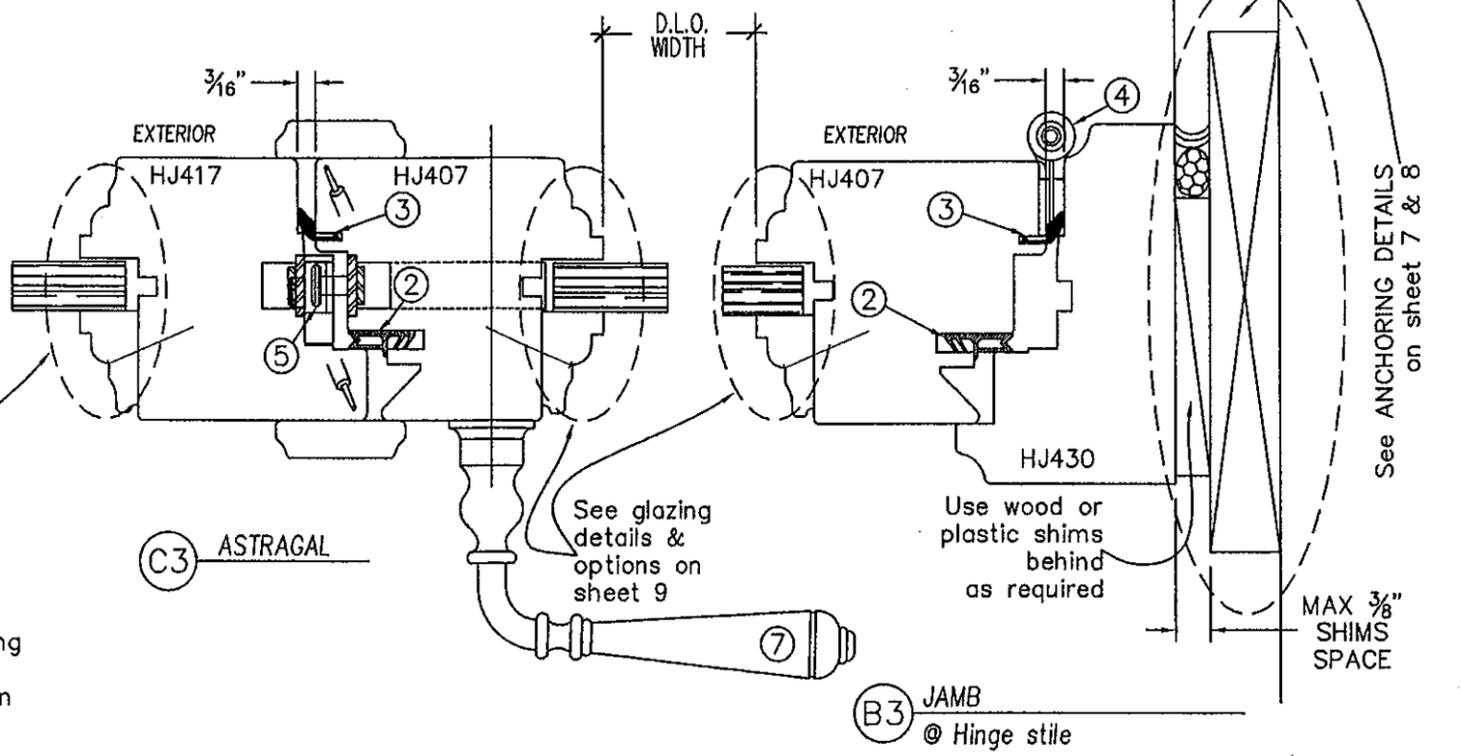

C3 ASTRAGAL

B3 JAMB
@ Hinge stile

D3 SASH BAR
(Optional)

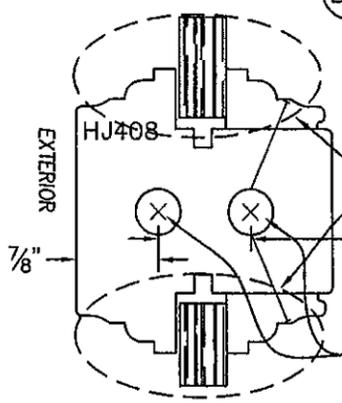


See glazing details & options on sheet 9

2x #12 x 3" flat head wood screw at each end. Min. embedment is 1 1/2"

Use wood or plastic shims behind as required

MAX 3/8" SHIMS SPACE

3/16" EXTERIOR

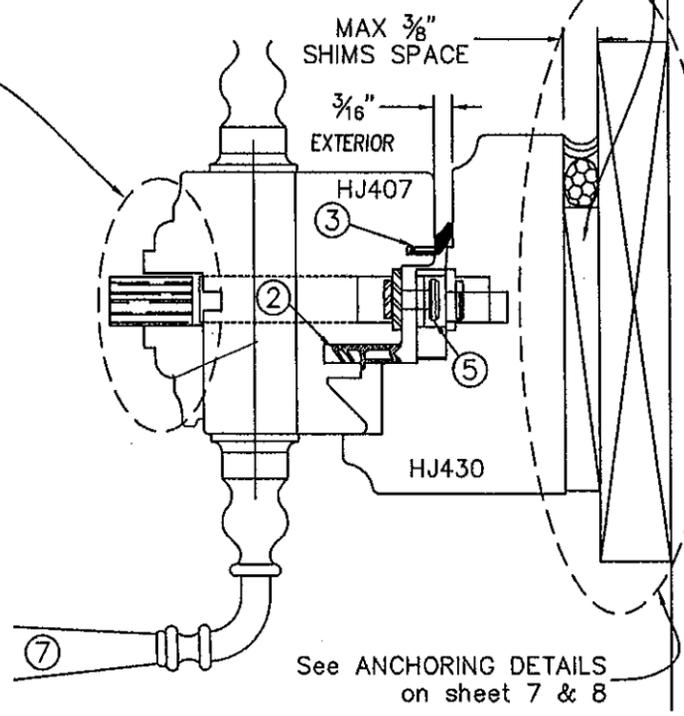

E3 JAMB
@ Lock stile

NOTES:

Clear silicone sealant at shown interfaces

Backing rod and sealant as required

Numbers are referring to bill of materials (sheet 12)

JS SERIE
OUTSWING
WOOD DOORS
MIAMI DADE COUNTY

Drawing no.: JS-4-OUT

Scale: NONE Drawn by: S. Marcotte

Date drawn: 01/10/98 Date revised: 01/11/06

File: Page: 6/13

STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING, INC.
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
FEB 15 2012

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0222-10
Expiration Date 4/20/16
Michael D. ...
Miami Dade Product Council



ANCHORING DETAILS

**JS SERIE
OUTSWING
WOOD DOORS
MIAMI DADE COUNTY**

Drawing no.: JS-4-OUT

Scale: NONE Drawn by: S. Marcotte

Date drawn: 01/10/98 Date revised: 01/11/06


File: Page: 7/13

STRUCTURALLY REVIEWED BY:


Scott Walters
SCOTT WALTERS
FL PE# 62354

WALTERS ENGINEERING, INC.
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
FEB 15 2012

A10 - Typical direct anchor on 2x wood buck using wood screws. Size and spacing as per ANCHOR REQUIREMENTS TABLE on sheet 8.

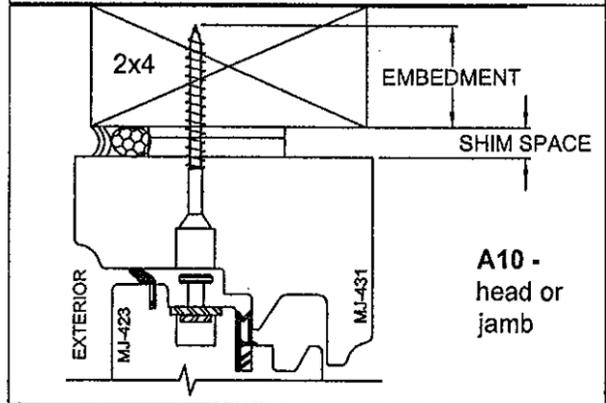


A10 - head or jamb

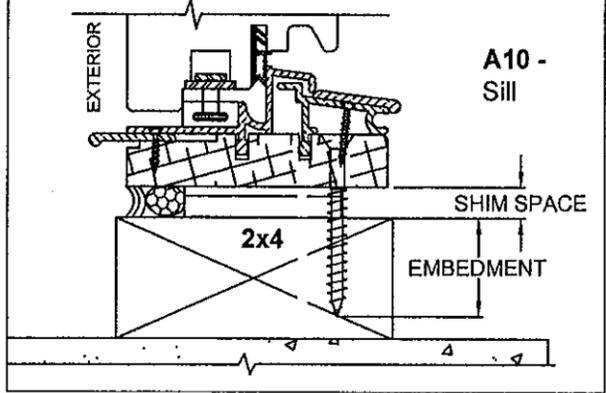


A10 - Sill

A20 - Typical direct anchor through 1x wood buck into concrete or masonry using Tapcon screws. Size and spacing as per ANCHOR REQUIREMENTS TABLE on sheet 8.


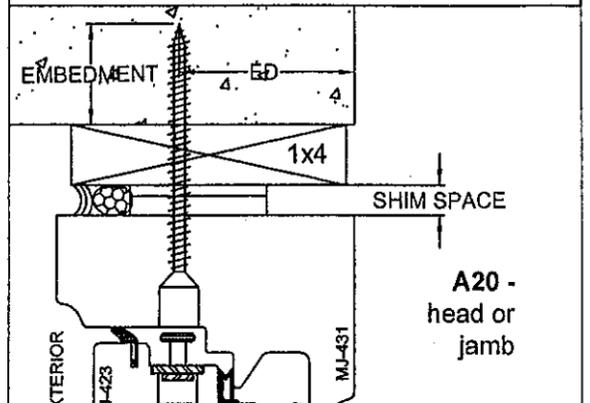


A20 - head or jamb


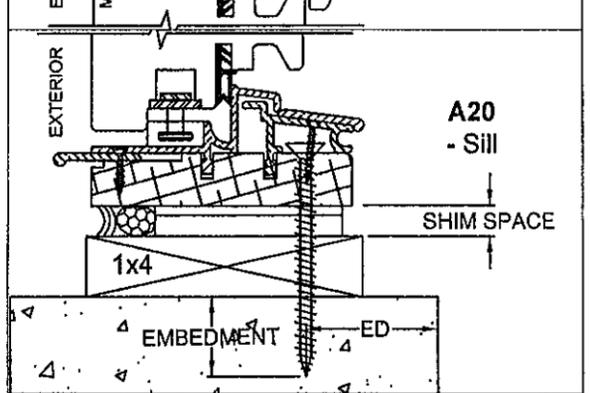


A20 - Sill


B11, B12 - Typical anchor using Installation Bracket (B) on 2x wood buck using wood screws as per ANCHOR REQUIREMENTS TABLE on sheet 8.

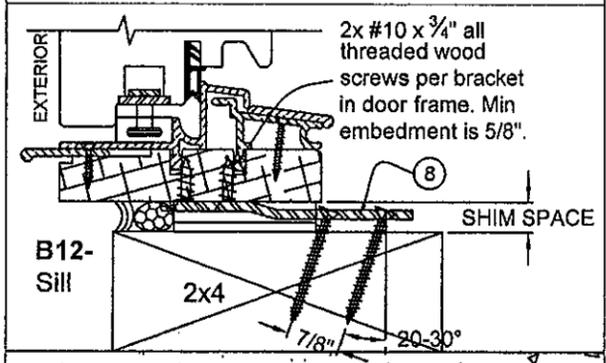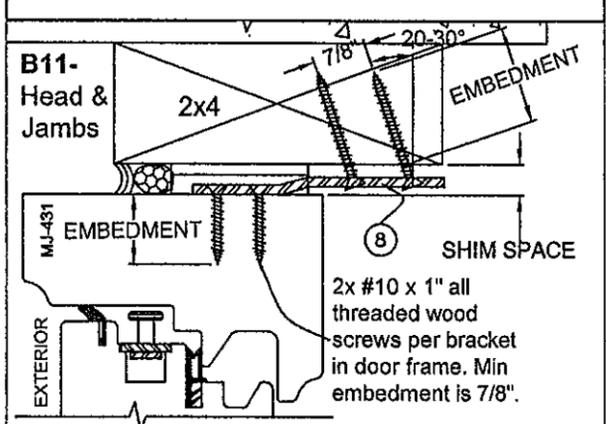

B21, B22 - Typical anchor w/ Installation Bracket (B) using Tapcon screws through 1x wood buck into concrete or masonry as per ANCHOR REQUIREMENTS TABLE on sheet 8.

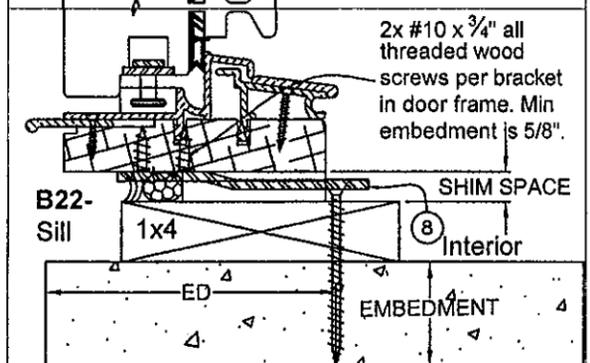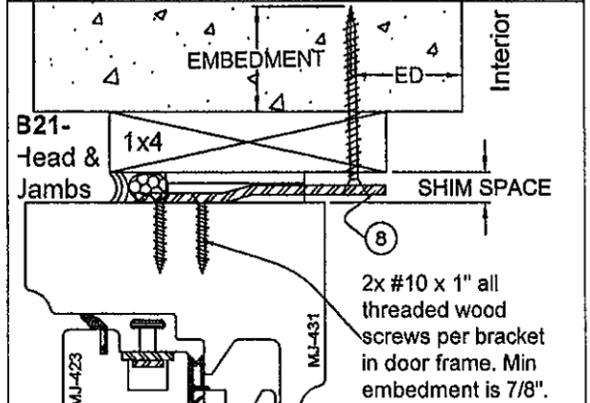


C10 - Typical anchor (@ sill only) w/ Continuous Aluminum Angle (8a) using wood screws in 2x wood buck and door frame. Size and spacing as per ANCHOR REQUIREMENTS TABLE on sheet 8.

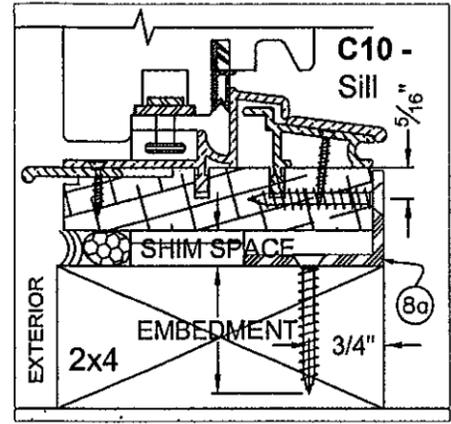


Frame's leg up on the edge of the sill, buck's leg out on the face.

Alternate typical anchor location for the continuous aluminum Angle (8a)

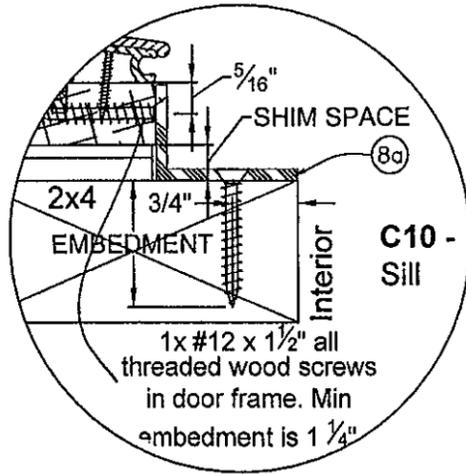


Frame's leg up on the edge of the sill, buck's leg in on the face.

C20 - Typical anchor w/ Continuous Aluminum Angle (8a) using Tapcon screws through 1x wood buck into concrete and wood screw into door frame. Size and spacing as per ANCHOR REQUIREMENTS TABLE on sheet 8.

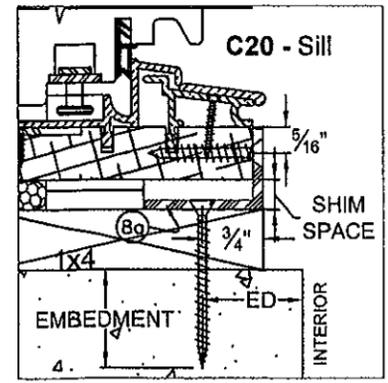

Frame's leg up on the edge of the sill, buck's leg out on the face.

Alternate typical anchor location for the continuous aluminum Angle (8a)

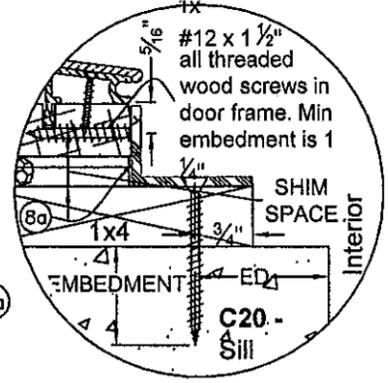

Frame's leg up on the edge of the sill, buck's leg in on the face.

PRODUCT REVIEWED as complying with the Florida Building Code Acceptance No. 12-0222-10 Expiration Date 4/20/16
Glenn J. Chavira
Miami Dade Product Control

ANCHORING DETAILS

**JS SERIE
 OUTSWING
 WOOD DOORS
 MIAMI DADE COUNTY**


Drawing no.: JS-4-OUT
 Scale: NONE
 Drawn by: S. Marcotte
 Date drawn: 01/10/98
 Date revised: 01/11/06
 File: Page: 8/13

STRUCTURALLY REVIEWED BY:

 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 1271 GRANT STREET
 HOLLYWOOD, FL 33019
 FEB 15 2012


ANCHOR REQUIREMENTS TABLE									
Anchoring method	Sub-strate	Inst. Ref. No.	Fasteners type, size & embedment	Spacing		Min. dist. from wood buck edge	Min. dist. from msry edge (ED)	Min. embedment	
				From corner	On center			Into substrate	Into unit frame
Direct anchor (shear screws)	2x_ wood buck	A10 4 sides	Through the unit frame into the buck frame: (1) #14 x 2 3/4" wood screw.	5 1/2"	4 1/2"	3/4"	----	1 1/4"	----
	1x_ wood buck	A20 4 sides	Through the buck frame into the masonry: (1) 1/4" x 2 3/4" Elco / Textron Tapcon screw.	5 1/2"	5 1/2"	3/4"	2 1/2"	1 1/4"	----
PDF-FS-05/D Installation bracket	2x_ wood buck	B11 head jamb	To the buck frame: (2) #12 X 1 1/2" all threaded (a.T.) wood screws. To the unit frame: (2) # 10 x 1" a.T. wood screws.	5 1/2"	11"	----	----	1 1/4"	7/8"
		B12 sill	To the buck frame: (2) #12 X 1 1/2" a.T. wood screws. To the unit frame: (2) # 10 x 3/4" a.T. wood screws.	5 1/2"	6 1/2"	----	----	1 1/4"	5/8"
	1x_ wood buck	B21 head jamb	Through the buck frame into the masonry: (1) 1/4" x 2 3/4" Elco / Textron Tapcon screw. Into the unit frame: (2) #10 x 1" a.T. wood screws.	5 1/2"	10 1/2"	3/4"	2 1/2"	1 1/4"	7/8"
		B22 sill	Through the buck frame into the masonry: (1) 1/4" x 2 3/4" Elco / Textron Tapcon screw. To the unit frame: (2) # 10 x 3/4" a.T. wood screws.	5 1/2"	6 1/2"	3/4"	2 1/2"	1 1/4"	5/8"
Continuous aluminum angle (At sill only)	2x_ wood buck	C10 sill	To the door sill and to the buck frame with (1) #12 x1 1/2" a. T. wood screw.	5 1/2"	7"	3/4"	----	1 1/4"	1 1/4"
	1x_ wood buck	C20 sill	Through the buck frame into the f'c= 3320 psi. concrete: 1/4" x 2 3/4" Elco / Textron Tapcon screw. Into the unit sill: (1) #12 x1 1/2".	5 1/2"	10"	3/4"	2 1/2"	1 1/4"	1 1/4"

NOTES:
 -All shim spaces between door frame and wood buck max. 3/8" @ head, jambs and sill. Use std wood or plastic shims.
 -Jambs anchoring identical to head anchoring shown
 -Wood bucks (by others) and openings must be designed by the professional of record to properly transfer wind loads to the main structure.
 -Installation brackets (B) and aluminum angles (C) may be positioned at the interior or exterior side of the door.
 -Materials, but not limited to steel & steel screws that come in contact with other dissimilar materials shall meet with section 2003.8.4 of the Florida Building Code.
 Backing rod and sealant as required
 Numbers in circle are referring to bill of materials (sheet 12)

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0222.10
 Expiration Date 9/28/16
 By: 
 Miami Dade Product Control

GLAZING DETAILS

Typ. glazing w/ monolithic laminated glass Typ. glazing w/ double insulated glass Typ. glazing w/ raised wood panel

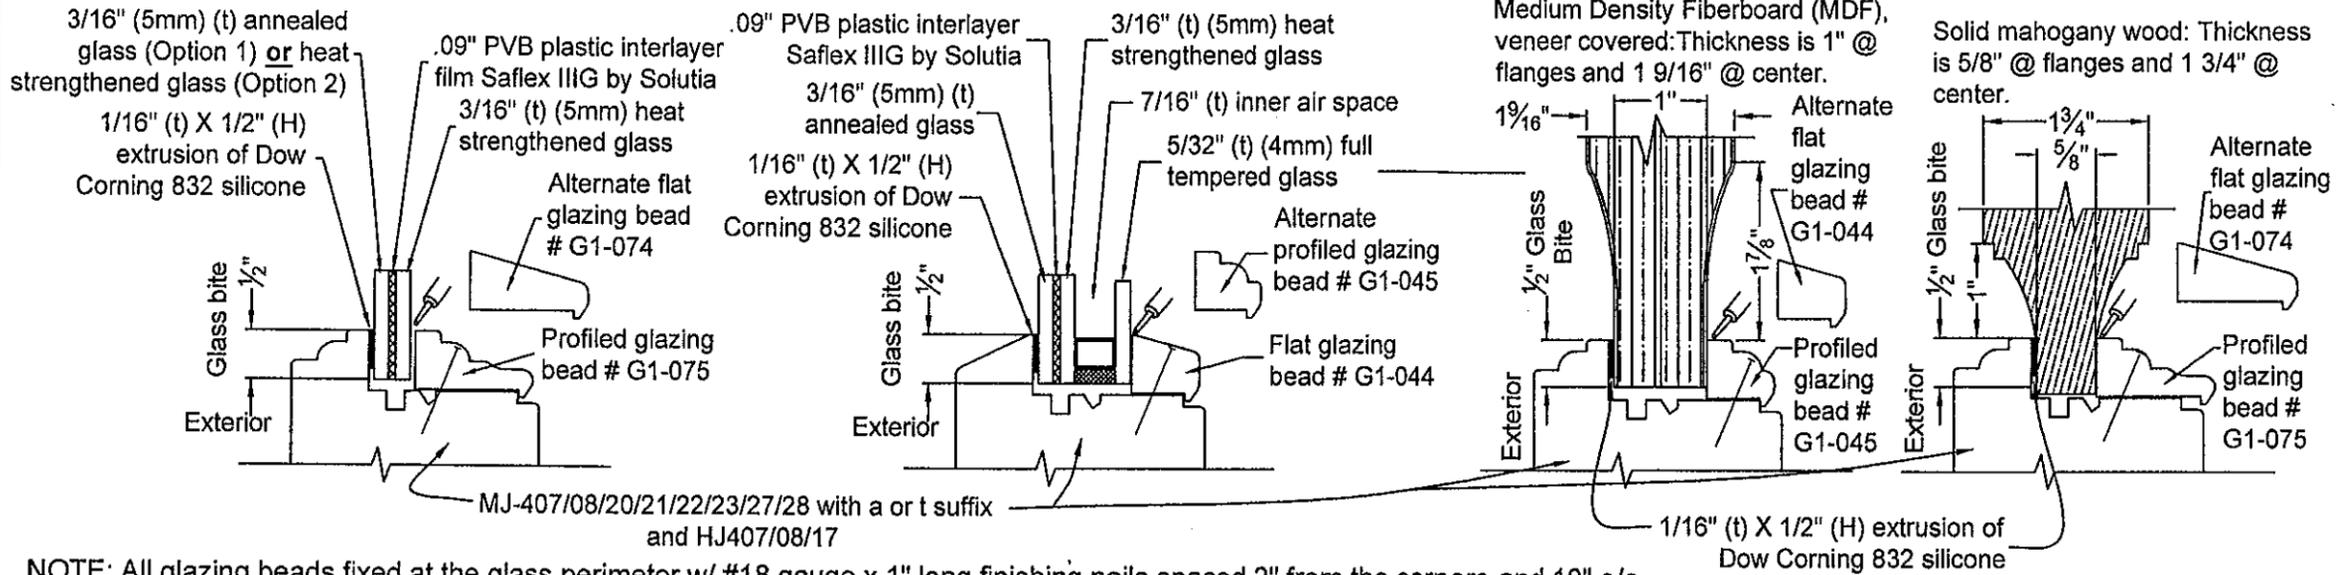

NOTE: All glazing beads fixed at the glass perimeter w/ #18 gauge x 1" long finishing nails spaced 2" from the corners and 10" o/c.


**JS SERIE
OUTSWING
WOOD DOORS
MIAMI DADE COUNTY**

Drawing no.: JS-4-OUT	
Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 01/11/06
File:	Page: 9/13

STRUCTURALLY REVIEWED BY:

Scott Walters
SCOTT WALTERS
 FL PE# 62354
 WALTERS ENGINEERING, INC.
 (COA# 27194)
 1271 GRANT STREET
 HOLLYWOOD, FL 33019
 FEB 15 2012

ACCESSORIES

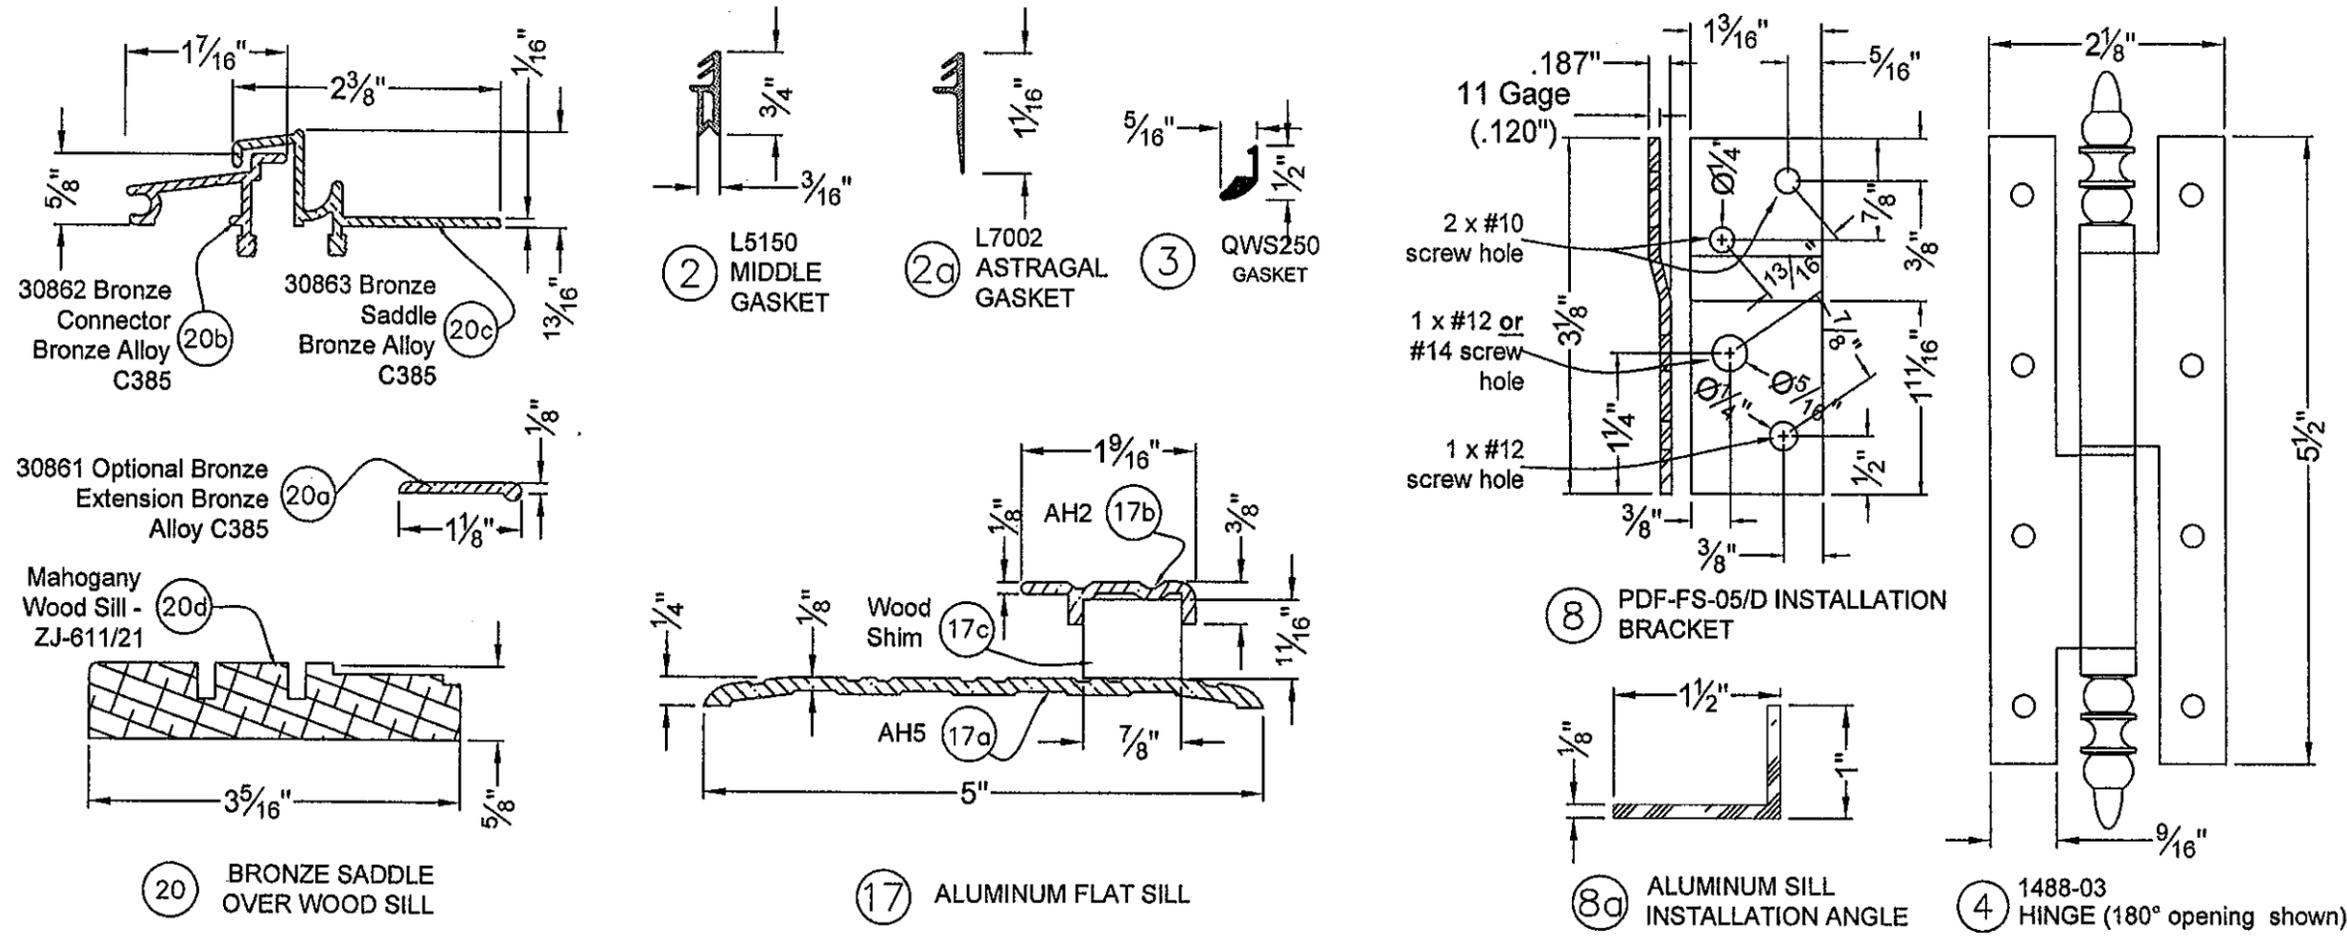



PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0222-10
 Expiration Date 4/22/16
Khag I. Chandra
 Senior Draftsman/Product Control

WOOD PROFILES




NOTE: All profiles dimensions shown are minimum dimensions.

Alternate glazing fence details

Flat glazing fence:
Part number w/ "a"
suffix.



Moulded glazing
fence: Part number
w/ "t" suffix.

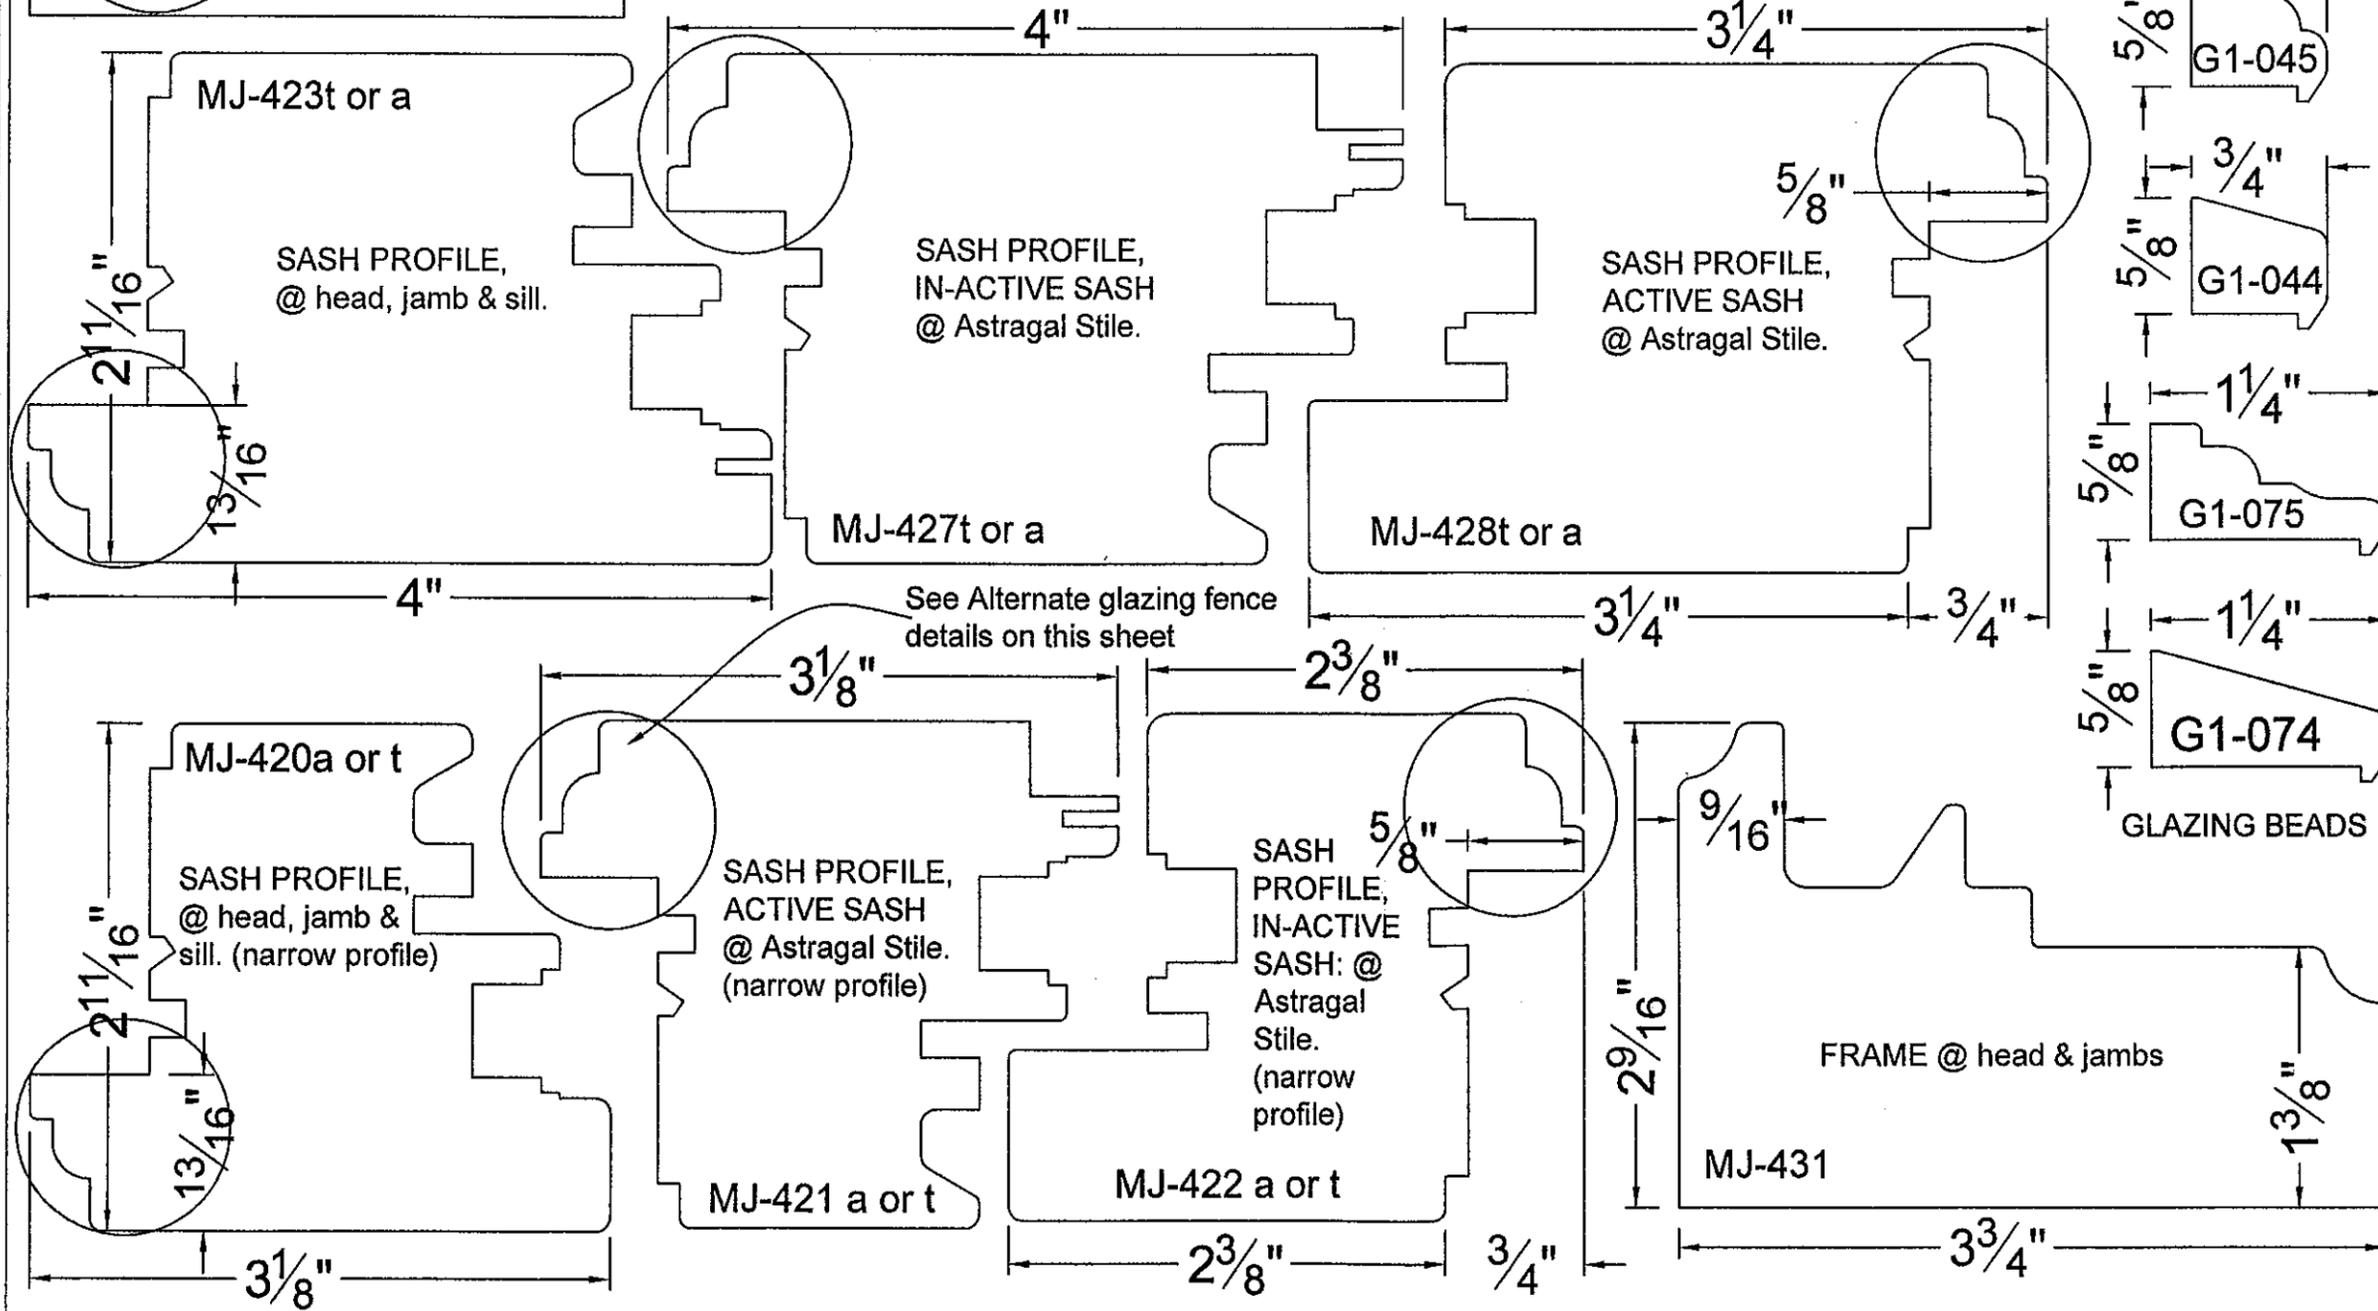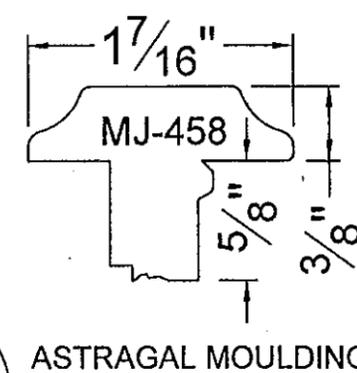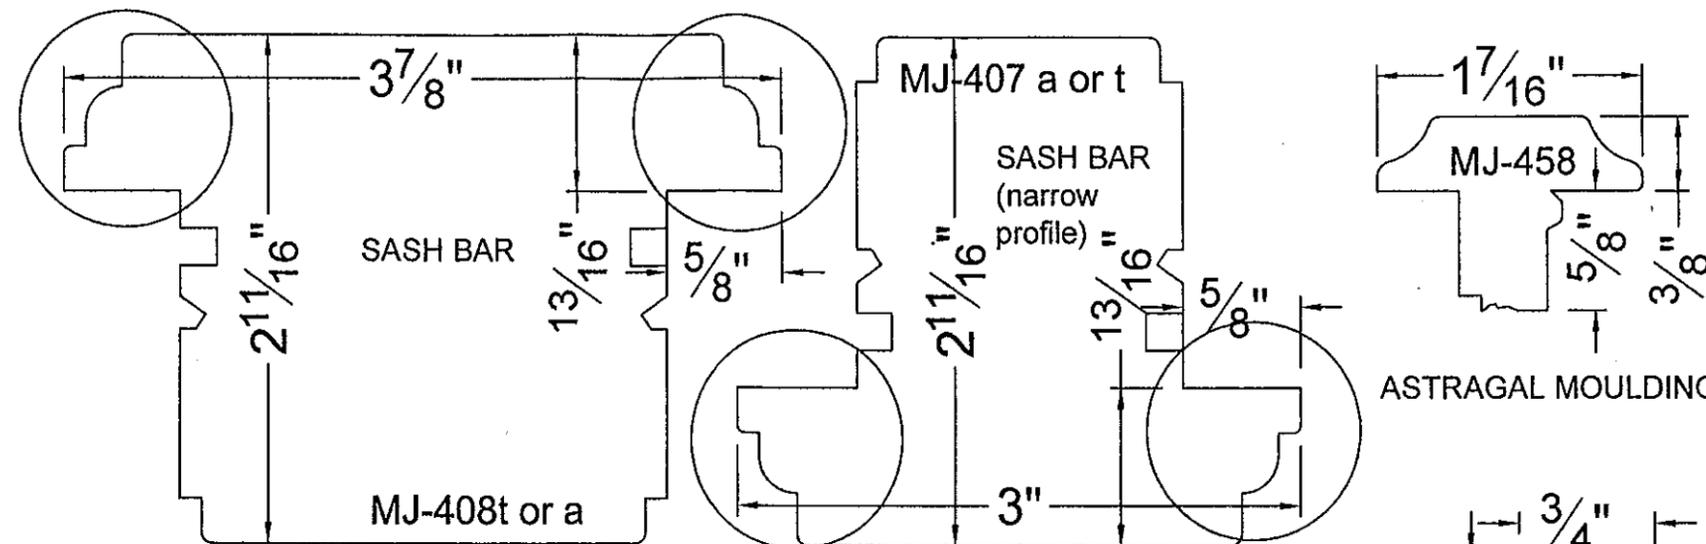

JS SERIE
OUTSWING
WOOD DOORS
MIAMI DADE COUNTY

Drawing no.: JS-4-OUT	
Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 01/11/06
File:	Page: 10/13

STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
FEB 15 2012

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0222-10
Expiration Date 4/20/16
By: Ighas I. C. ...
Product Control

**JS SERIE
 OUTSWING
 WOOD DOORS
 MIAMI DADE COUNTY**

Drawing no.: JS-4-OUT

Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 01/11/06
File:	Page: 11/13







STRUCTURALLY REVIEWED BY:

Scott Walters
SCOTT WALTERS
 FL PE# 62354
WALTERS ENGINEERING, INC.
 (COA# 27194)
 1271 GRANT STREET
 HOLLYWOOD, FL 33019
 FEB 15 2012

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 12-0222-10
 Expiration Date 9/20/16
 By *Ishag I. Chanak*
 Miami Dade Product Control

WOOD PROFILES

NOTE:
 These profiles apply to
 elevations on sheet 3 only

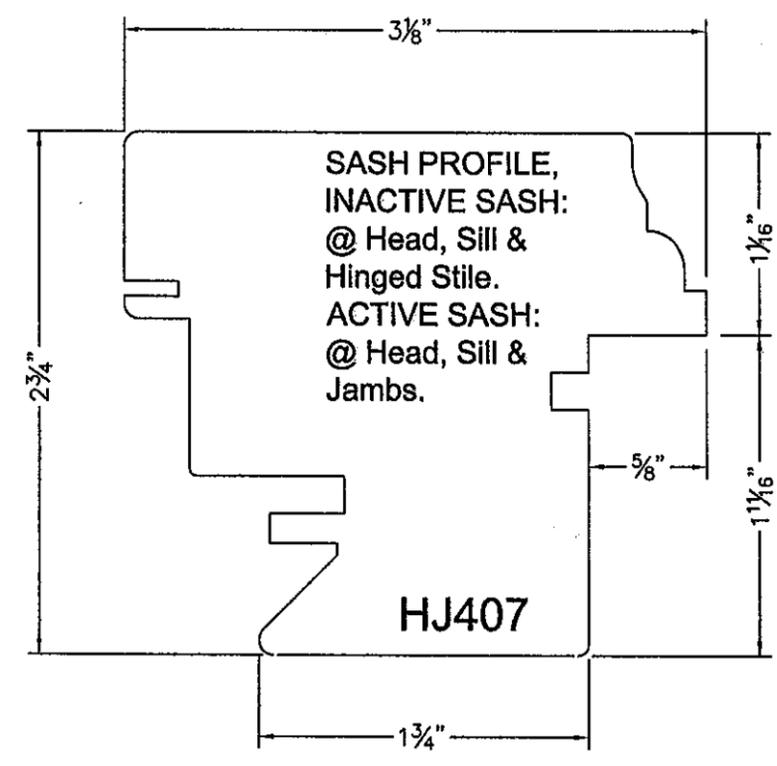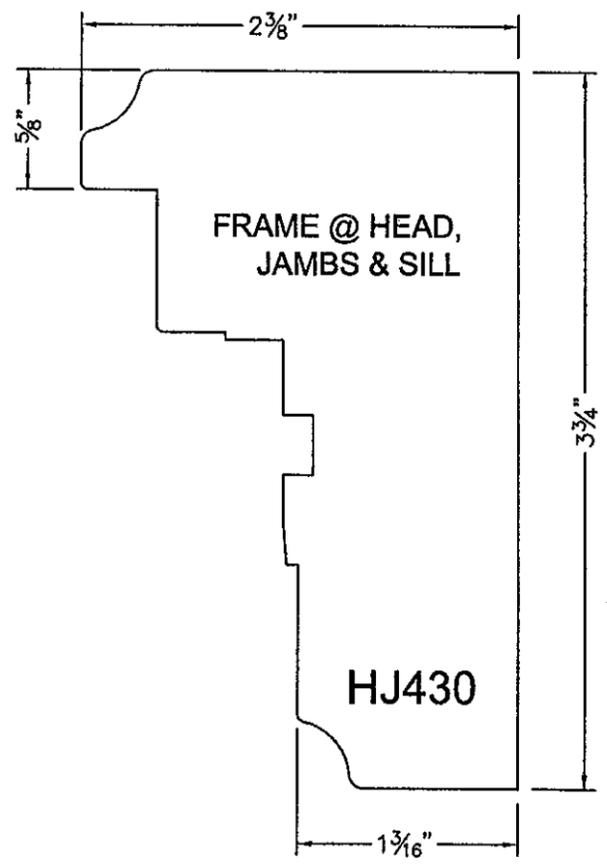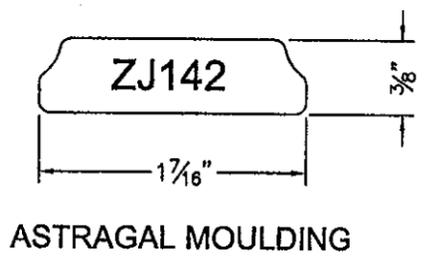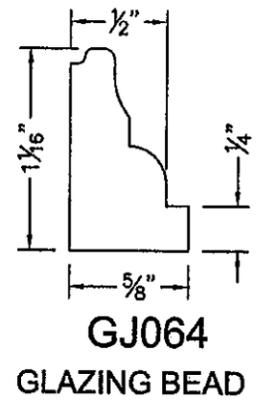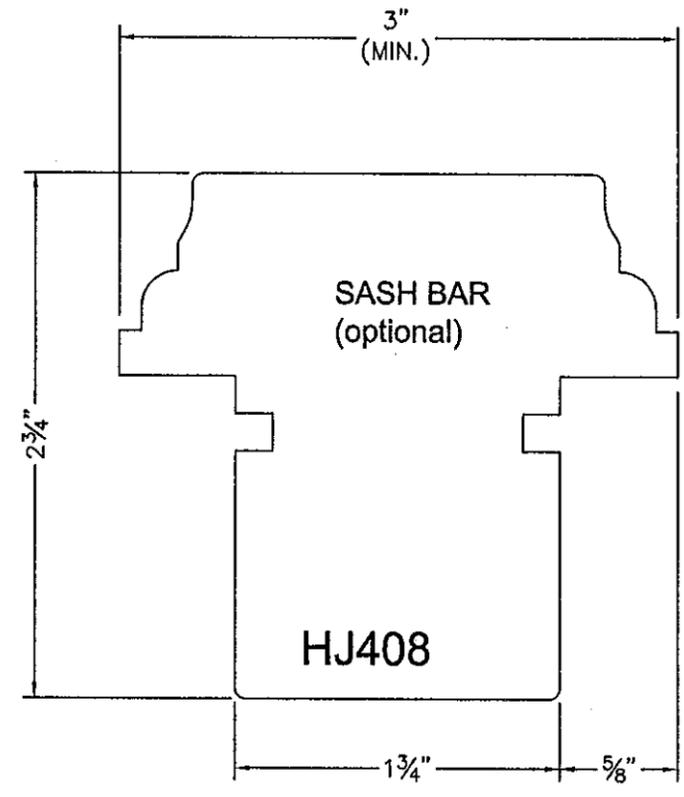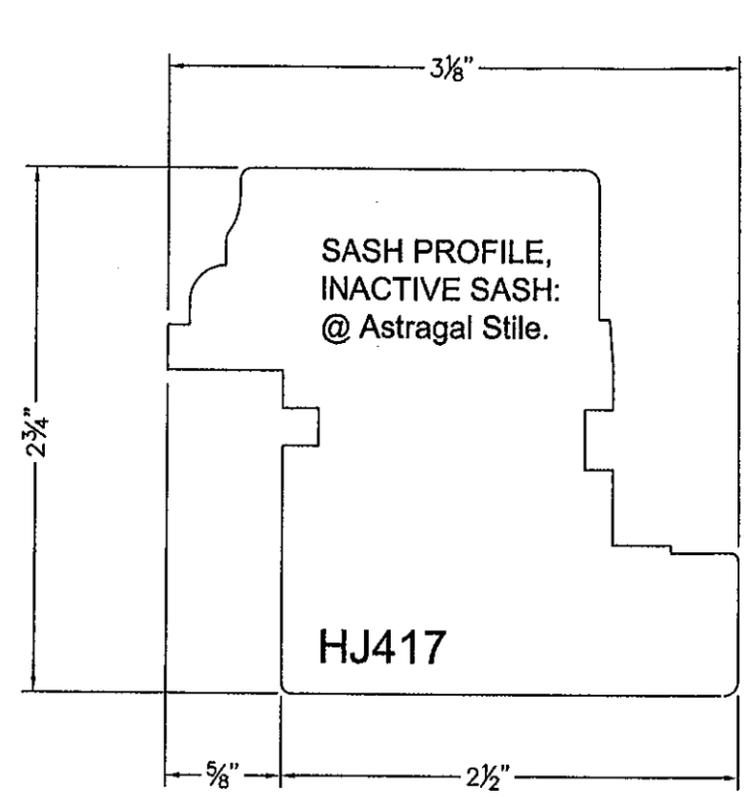

BILL OF MATERIALS

(see also related cross sections details)

Ref.	ITEM DESCRIPTION	MANUFACTURER / NOTES
②	Brügman L5150, Push-in EPDM middle gasket	Push-in gasket, in a continuous groove around the sash.
②a	Brügman L7002, Push-in EPDM In-active astragal meeting stile middle gasket	Push-in gasket in a continuous groove. Ends @ sash's head & sill glued to the L5150 gasket
③	Schlegel QWS250 Polyurethane foam gasket.	Push-in gasket, in a continuous groove around the sash. Mitre cut @ corners.
④	Jardinier Massard S.A. 1488-03 painted steel hinges	5 per hinged stile of sashes, 8" from corners; see elevations for max. o/c spacing. 4 x #7 x 1" flat head screws on sash and frame for each hinge.
⑤	Ferco multi-point lock system.	Ferco G-20755 corner gear Ferco 6-26295 steel intermediate arm Ferco 6-25485 steel mechanism Ferco 6-26076 steel lever. Bronze cast alloy keeper, #833856.
⑦	Lock handle	As required to operate lock.
⑧	PDF-FS-05/D Installation bracket Gage 11 ASTM A653 SQ 33 G90 galvanized steel	To door frame: 2x #10 x 1" a.t. wood screws. Min. embedment is 3/4". To door sill frame: 2 x #10 x 3/4" a.t. wood screws. Min embedment is 5/8". To structure as per ANCHOR REQUIREMENTS TABLE on sheet 8.
⑧a	Installation Aluminum angle (Alloy 6063-T5)	Screwed to wood sill and to structure as per ANCHOR REQUIREMENTS TABLE on sheet 8.
①7a	AH5 flat saddle aluminum profile (Alloy 6063-T5)	Directly screwed to the substrate as per ANCHOR REQUIREMENTS TABLE (configuration A10 or A20) on sheet 8. Square cut @ ends.
①7b	AH2 stopper aluminum profile (Alloy 6063-T5)	Screwed to alum. sill w/ (1) #10 x 1 1/4" F.H. screw @ 14" o/c. Butt joint against the frame jambs @ both ends.
①7c	Continuous wood shim (mahogany)	See AH2 screws. Butt joint against the frame jambs @ both ends.
②0a	30861 1" Bronze extension (Alloy C385)	Brass #7 x (1/2" for 30863, 3/4" for 30862) FH screws @ 16" o/c & continuous line of silicone behind; When 30861 is used to hide screw holes, use with 3M double face acrylic tape. It may be used as an optional in or out extension to link with floor finishing material.
②0b	30862 Bronze connector (Alloy C385)	
②0c	30863 Bronze saddle (Alloy C385)	
②0d	ZJ-611/21 Mahogany wood sill	Square cut @ ea end. Screwed with 2x # 12 x 3" wood Screws to the frame jambs. See sheet 13.

REF. NUMBERS ARE RELATED TO THOSE USED ON CROSS SECTIONS DRAWINGS

JS SERIE
OUTSWING
WOOD DOORS
MIAMI DADE COUNTY

Drawing no.: JS-4-OUT

Scale: NONE
Drawn by: S. Marcotte

Date drawn: 01/10/98
Date revised: 01/11/06

File: Page: 12/13

STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
FEB 15 2012

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 12-0222-10
Expiration Date 11/20/16
By *Isabel L. Chavira*
Miami Dade, Florida County

JS SERIE
OUTSWING
WOOD DOORS
MIAMI DADE COUNTY

Drawing no.: JS-4-OUT	
Scale: NONE	Drawn by: S. Marcotte
Date drawn: 01/10/98	Date revised: 01/11/06
File:	Page: 13/13


STRUCTURALLY REVIEWED BY:

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
1271 GRANT STREET
HOLLYWOOD, FL 33019
FEB 15 2012

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0222.10
Expiration Date APR 29, 2016
By *Ishag I. Chaudhry*
Miami Dade Product Control


Sash rails and sash bar to sash stiles: 4x 7/16" x 2 3/4"
wood dowels, w/ 1 3/8" embedment to each profile
Glue: Rhenocoll 3W-4B type 1 exterior glue for wood.

Finger Joints
assembly for
full arched
members; Glue:
Rhenocoll
3W-4B type 1
exterior glue for
wood.

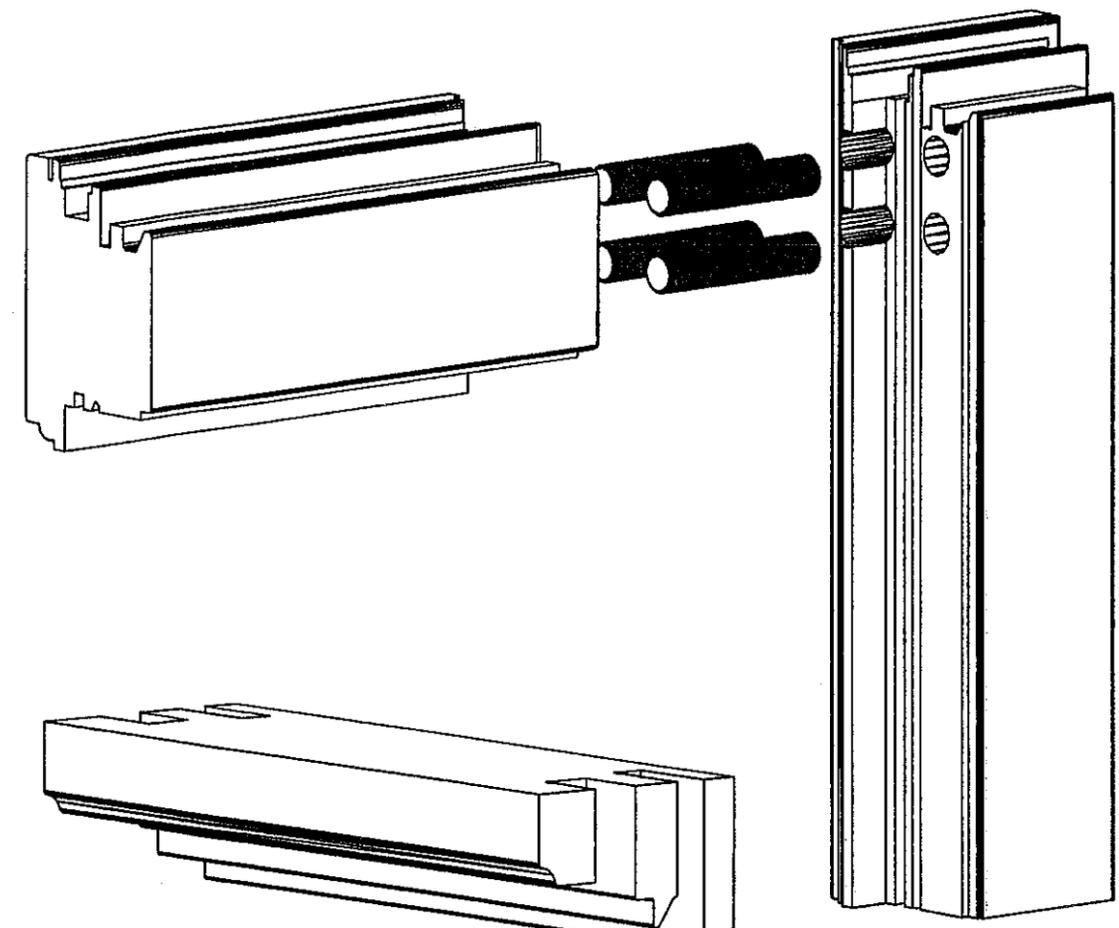

Frame head to frame
jambs: multifork.
Glue: Rhenocoll 3W-4B
type 1 exterior glue for
wood.

Frame sill to frame
Jambs: Screwed w/
2x #12 x 3" FH screws.

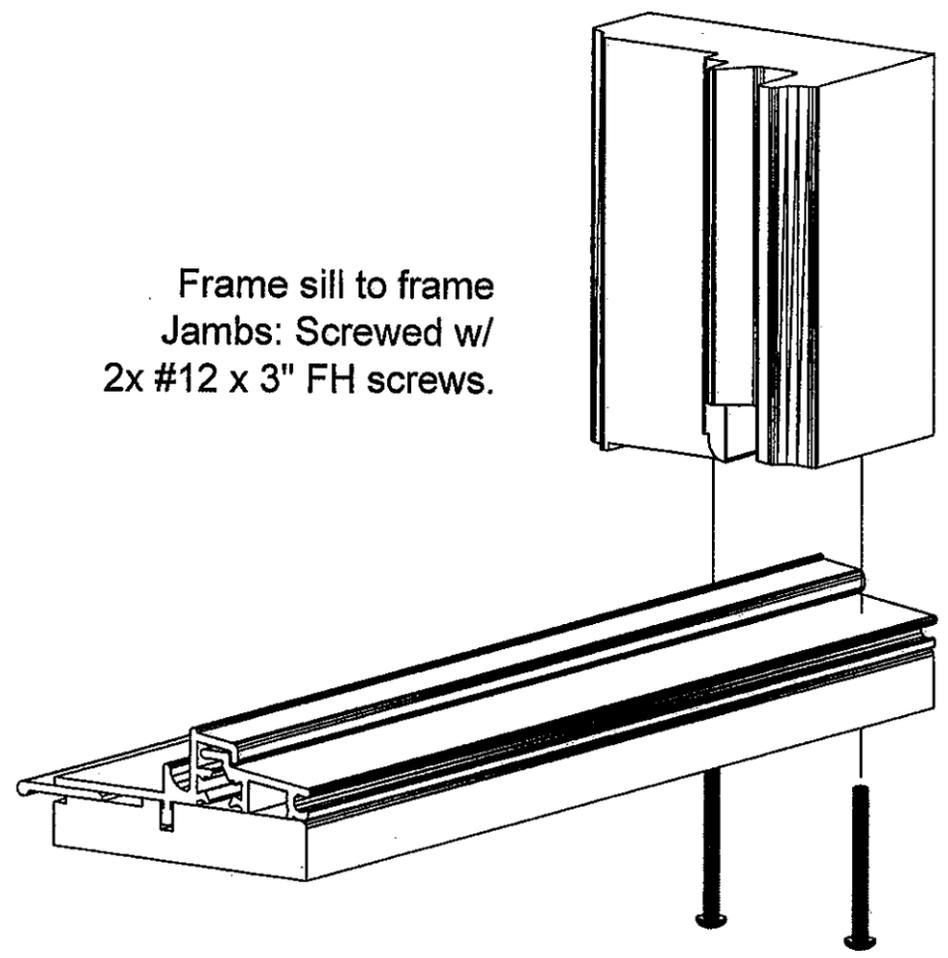

CORNER ASSEMBLY
3D VIEW DETAILS