



DEPARTMENT OF PERMITTING, ENVIRONMENT, AND REGULATORY
AFFAIRS (PERA)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/pera

NOTICE OF ACCEPTANCE (NOA)

Labrador & Fundora Corp. dba V & V Windows
2355 W. 4th Avenue
Hialeah, FL 33010-1454

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County PERA - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. PERA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "1100" Aluminum Single Hung Window – N.I.

APPROVAL DOCUMENT: Drawing No. **W99-23**, titled "Series 1100 Alum Single Hung Wdw. (N.I.)", dated 03/26/99, with revision E dated 02/09/12, sheets 1 through 4 of 4, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA # **10-0621.04** and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



MP
5/1/12

NOA No. 12-0306.05
Expiration Date: January 05, 2016
Approval Date: May 10, 2012
Page 1

Labrador & Fundora Corp. dba V & V Windows

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W99-23**, titled "Series 1100 Alum Single Hung Wdw. (N.I.)", sheets 1 through 4 of 4, dated 03/26/99 with revision E dated 02/09/12, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Resistant test per TAS202-94 & AAMA 1302.5
along with marked-up drawings and installation diagram of aluminum single hung windows, prepared by American Test Lab of South Florida. Test Report No. **ATLSF-0408.01-05**, dated 09/27/05, signed and sealed by William R. Mehner, P.E. and Henry Hattem, P. E. *(Submitted under previous NOA# 05-1021.02)*

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, dated 05/12/10, prepared, signed and sealed by Javad Ahmad, P.E. *(Submitted under previous NOA#10-0621.04)*
2. Glazing complies with ASTM E1300-04

D. QUALITY ASSURANCE

1. Miami-Dade Department of Permitting, Environment, and Regulatory Affairs (PERA)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance, complying with FBC-2010, and of no financial interest, dated February 9, 2012, signed and sealed by Javad Ahmad, P.E.
2. Laboratory compliance letter, issued by American Test Lab of South Florida, Inc., for Test Report No. **ATLSF-0408.01-05**, dated 09/27/05, signed and sealed by William R. Mehner, P.E. and Henry Hattem, P.E. *(Submitted under NOA#05-1021.027)*


G. OTHER

1. Notice of Acceptance No. **10-0621.04**, issued to Labrador & Fundora Corp. dba V & V Windows, for their Series "1100" Aluminum Single Hung Window – N.I., approved on 10/20/10 and expiring on 01/05/16.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 12-0306.05
Expiration Date: January 05, 2016
Approval Date: May 10, 2012

EQUAL LITES WINDOWS DESIGN LOAD CAPACITY - PSF						
WINDOW DIMS.		3/16" ANN. GLASS		3/16" TEMP. GLASS		
WIDTH (W)	HEIGHT (H)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	
19-1/8"	26"	65.0	125.0	65.0	210.0	
26-1/2"		65.0	125.0	65.0	210.0	
37"		65.0	125.0	65.0	210.0	
42"		(3)	65.0	125.0	65.0	180.7
48"		65.0	118.9	65.0	154.6	
53-1/8"		65.0	105.8	65.0	137.6	
19-1/8"	38-3/8"	65.0	125.0	65.0	210.0	
26-1/2"		65.0	125.0	65.0	210.0	
37"		65.0	122.0	65.0	158.6	
42"		(4)	65.0	103.2	65.0	134.1
48"		65.0	87.1	65.0	113.2	
53-1/8"		65.0	76.8	65.0	99.9	
19-1/8"	50-5/8"	65.0	125.0	65.0	210.0	
26-1/2"		65.0	125.0	65.0	210.0	
37"		65.0	104.1	65.0	135.4	
42"		(5)	65.0	86.4	65.0	112.3
48"		65.0	71.7	65.0	93.2	
53-1/8"		62.6	62.6	65.0	81.4	
19-1/8"	60"	65.0	125.0	65.0	210.0	
26-1/2"		65.0	125.0	65.0	210.0	
37"		65.0	97.2	65.0	126.4	
42"		(6)	65.0	79.2	65.0	103.0
48"		64.8	64.8	65.0	84.2	
53-1/8"		56.1	56.1	65.0	72.9	
19-1/8"	63"	65.0	125.0	65.0	210.0	
26-1/2"		65.0	125.0	65.0	210.0	
37"		65.0	95.8	65.0	124.6	
42"		(6)	65.0	77.6	65.0	100.9
48"		63.2	63.2	65.0	82.1	
53-1/8"		54.5	54.5	65.0	70.8	
19-1/8"	74-1/4"	65.0	125.0	65.0	210.0	
26-1/2"		65.0	113.8	65.0	210.0	
37"		65.0	82.0	65.0	121.8	
42"		(7)	65.0	73.7	65.0	95.9
48"		58.7	58.7	65.0	76.3	
53-1/8"		50.0	50.0	65.0	65.0	

* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.




EQUAL LITES

DLO: EQUAL LITES
DLO HT. = WDW. HT/2 - 3.625
DLO W = WDW. W - 3.625

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-04 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

UNEQUAL LITES (ORIEL TYPES) WINDOWS DESIGN LOAD CAPACITY - PSF						
WINDOW DIMS.		3/16" ANN. GLASS		3/16" TEMP. GLASS		
WIDTH (W)	HEIGHT (H)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	
19-1/8"	50-5/8"	65.0	125.0	65.0	210.0	
26-1/2"		65.0	125.0	65.0	210.0	
37"		65.0	97.9	65.0	139.6	
42"		(5)	65.0	85.5	65.0	115.2
48"		65.0	72.3	65.0	95.2	
53-1/8"		63.1	63.1	65.0	82.9	
19-1/8"	60"	65.0	125.0	65.0	210.0	
26-1/2"		65.0	101.1	65.0	210.0	
37"		(6)	65.0	76.8	65.0	137.8
42"		65.0	67.8	65.0	111.0	
48"		61.4	61.4	65.0	89.5	
19-1/8"	63"	65.0	125.0	65.0	210.0	
26-1/2"		65.0	92.3	65.0	210.0	
37"		(6)	65.0	72.2	65.0	137.8
42"		64.0	64.0	65.0	110.9	
19-1/8"		74-1/4"	65.0	125.0	65.0	210.0
26-1/2"	(7)	65.0	70.3	65.0	210.0	

* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.

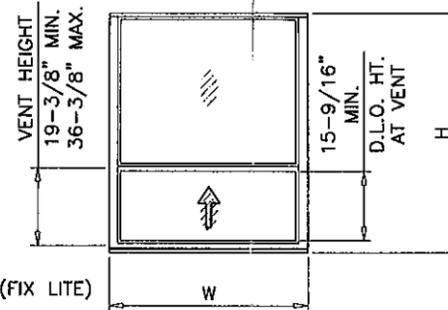

UNEQUAL LITES

DLO: ORIEL SIZES
DLO HT. = WDW. HT-VENT DLO HT-7.250 (FIX LITE)
DLO W = WDW. W - 3.625

SERIES 1100 ALUMINUM SINGLE HUNG WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ABOVE.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF S.H./S.H. OR SINGLE HUNG WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BLDG. CODE SECTION 2003.8.4.

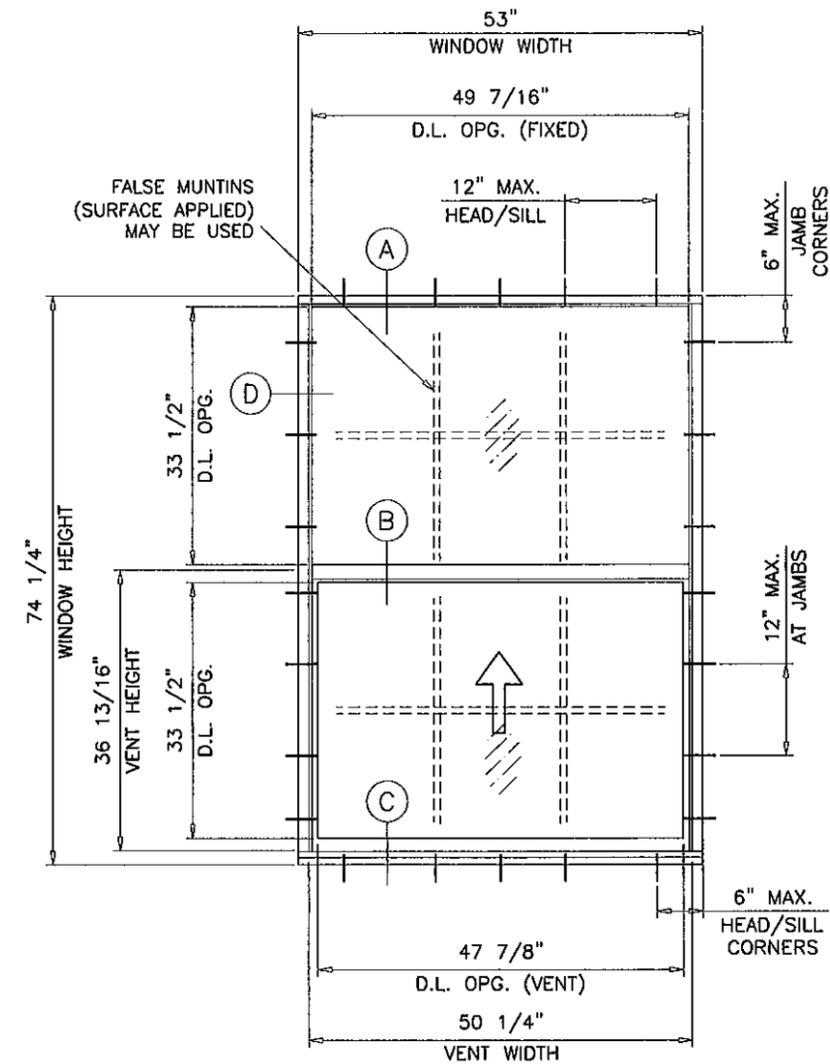

TYPICAL ELEVATION
TESTED UNIT

WINDOWS NOT RATED FOR IMPACT.
INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES COMPLYING WITH HVHZ REQUIREMENTS.
INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3638
FEB 10 2012

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 12-0306.05
Expiration Date JAN 5, 2016
By: *Manuel Perez*
Miami Dade Product Control



af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX (305) 262-6978
COMP-ANL W99-23V

SERIES 1100 ALUM SINGLE HUNG WDW. (N.I.)
Labrador & Fundora Corp.
dba - V & V Windows
2355 West 4th Ave.
Hialeah, FL 33010
TEL. (305) 888-4151 FAX (305) 888-1042




NO	DATE	DESCRIPTION
A	11.15.00	REV. PER BCCO COMMENTS
B	10.13.05	GENERAL REV.
C	12.14.05	REV. PER BCCO COMMENTS
D	05.17.10	UPDATED TO 2007 FBC
E	02.09.12	UPDATED TO 2010 FBC

date: 03-26-99
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:

drawing no.
W99-23
sheet 1 of 4

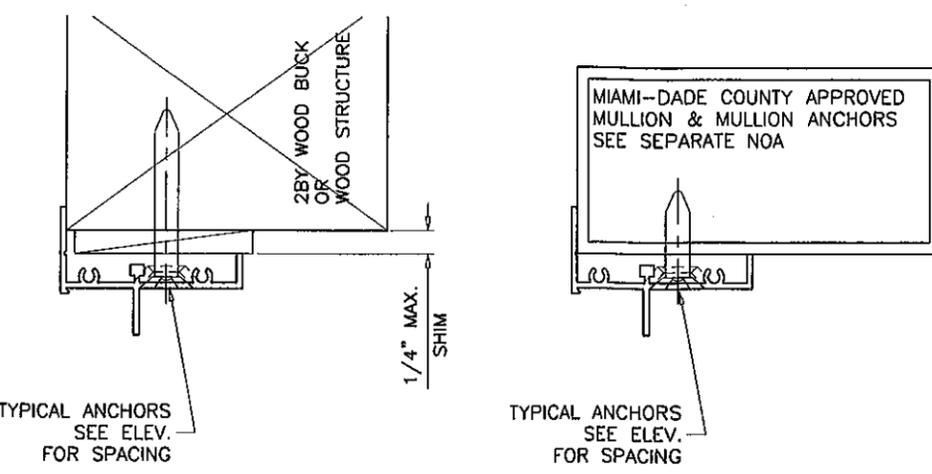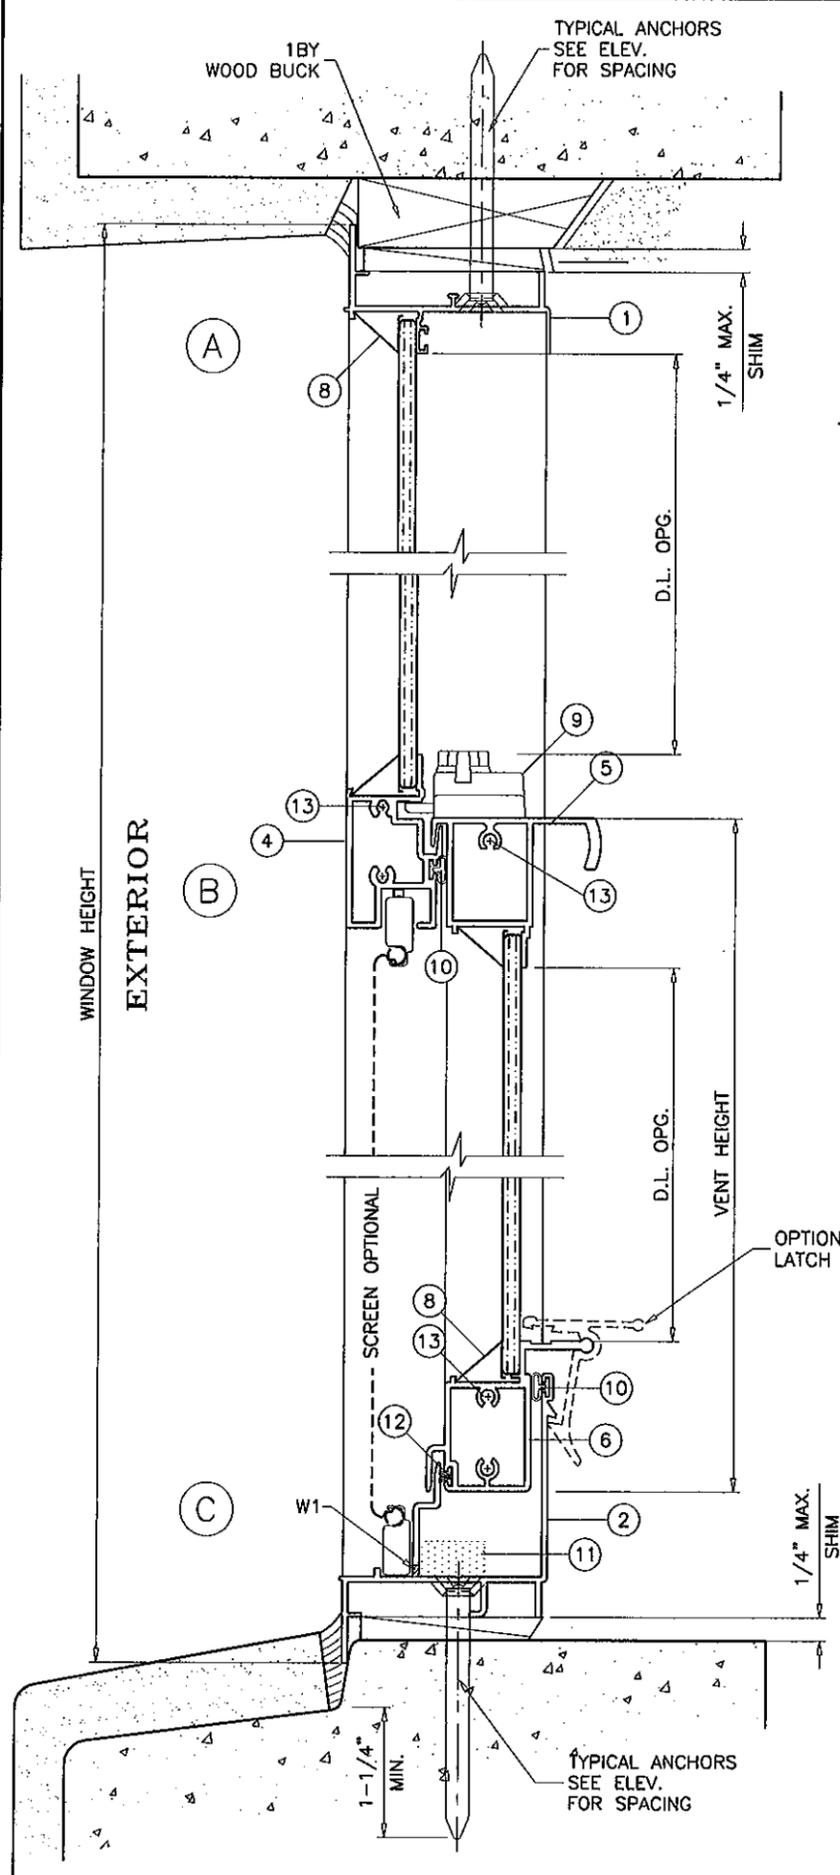

WOOD BUCKS AND METAL STRUCTURE NOT BY V&V WDWS. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

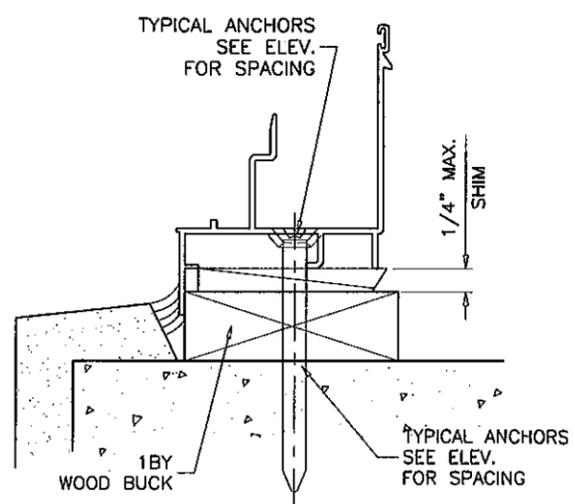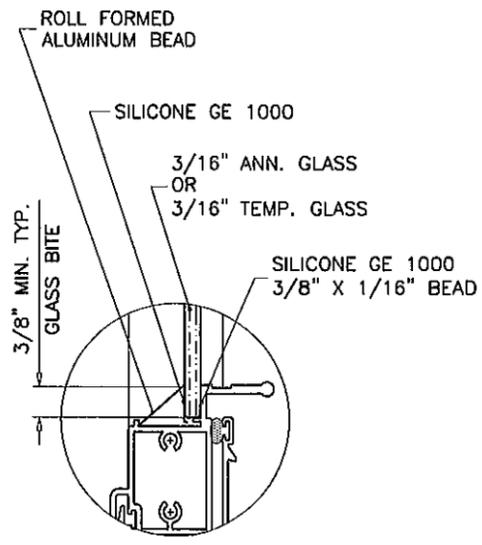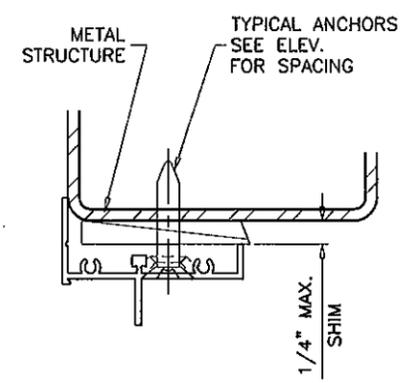

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
 1/4" DIA. TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)
 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

SEALANTS:
 ALL JOINTS AND FRAME CONNECTIONS SEALED WITH PTI SILICONE.

WEEPHOLES:
 W1 = (2) 1/8" X 1/4" WEEP SLOTS AT 1-1/4" FROM EACH END

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 FEB 17 2012

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0306.05
 Expiration Date JAN. 5, 2016
 By *Manuel Perez*
 Miami Dade Product Control

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W99-23W




SERIES 1100 ALUM SINGLE HUNG WDW. (N.I.)
 Labrador & Fundora Corp.
 dba-V & V Windows
 2355 West 4th Ave.
 Hialeah, Fl. 33010
 TEL. (305) 888-4151 FAX. (305) 888-1042

no	date	by	description
B	10.13.05		GENERAL REV.
C	12.14.05		REV. PER BCCO COMMENTS
D	05.17.10		UPDATED TO 2007 FBC
E	02.09.12		NO CHANGE THIS SHEET

date: 03-26-99
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W99-23
 sheet 2 of 4

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	VW-4129A	1	FRAME HEAD	6063-T6	-
2	VW-4135	1	FRAME SILL	6063-T6	-
3	VW-4132	2	FRAME JAMB	6063-T6	-
4	V-1001	1	FIXED MTG. RAIL	6063-T6	-
5	VW-002	1	VENT TOP RAIL	6063-T6	-
6	VW-4136	1	VENT BOTTOM RAIL	6063-T6	-
7	VW-4133	2	VENT JAMB	6063-T6	-
8	-	AS REQD.	GLAZING BEAD	ALUMINUM	ROLL FORMED
9	-	2/VENT	VENT LATCH @ 7 1/4" FROM ENDS	ZINC DIE CAST	SECURED WITH (2) #8 X 3/4" PH SMS
10	-	1	BULB W'STRIPPING	VINYL	-
11	-	1/ WEEP	OPEN CELL FOAM	-	-
12	-	AS REQD.	PILE W'STRIPPING	-	SCHLEGEL FIN SEAL OR EQUIV.
13	-	AS REQD.	ASSEMBLY SCREWS	-	#8 x 1" P.H. CRS SMS
14	-	2	BLOCK & TACKLE BALANCE	-	5/8" BOX, BALANCE SYSTEMS INC. OR EQ.
15	-	2	BALANCE TOP GUIDE (NOT SHOWN)	ALUMINUM	@ VENT TOP SECURED W/ (1) #8 X 1" SMS
16	-	2	VENT STOP (NOT SHOWN)	VINYL	LOCATED AT TOP OF EACH JAMB

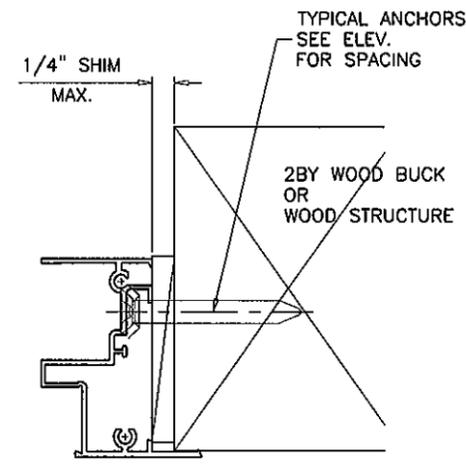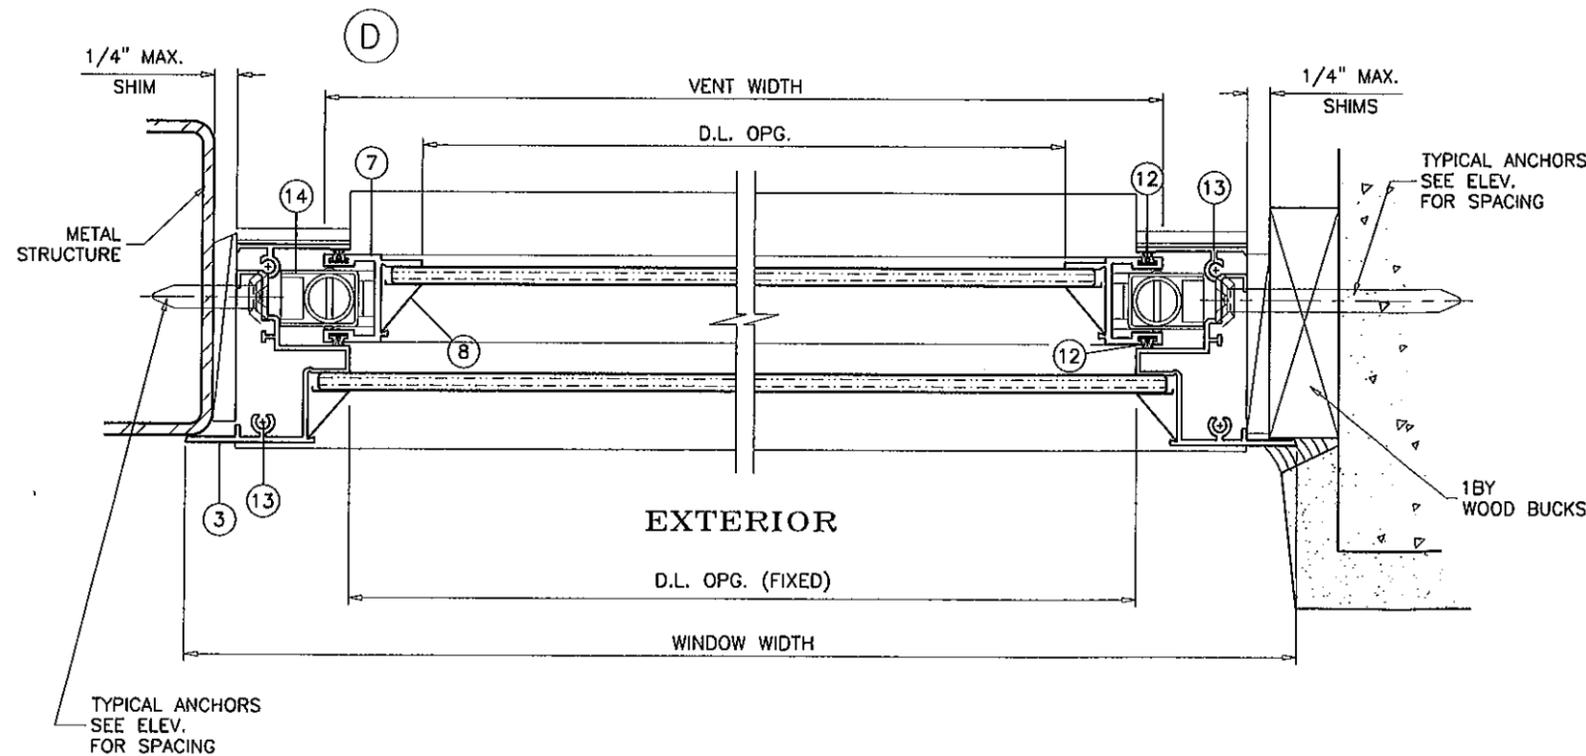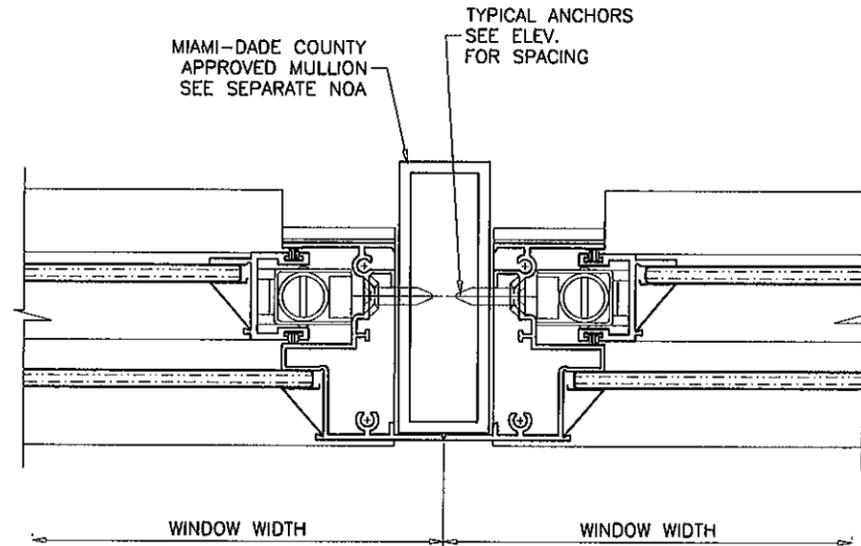

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 FEB 10 2012

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 12-0306-05
 Expiration Date JAN. 5, 2016
 By *Mauro Perez*
 Miami Dade Product Control


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W99-23W

SERIES 1100 ALUM SINGLE HUNG WDW. (N.I.)
 Labrador & Fundora Corp.
 dba - V & V Windows
 2355 West 4th Ave.
 Hialeah, FL 33010
 TEL. (305) 888-4151 FAX. (305) 888-1042


no	date	description
B	10.13.05	GENERAL REV.
C	12.14.05	ALUM. TEMPER REV.
D	05.17.10	UPDATED TO 2007 FBC
E	02.09.12	NO CHANGE THIS SHEET

date: 03-26-99
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W99-23
 sheet 3 of 4

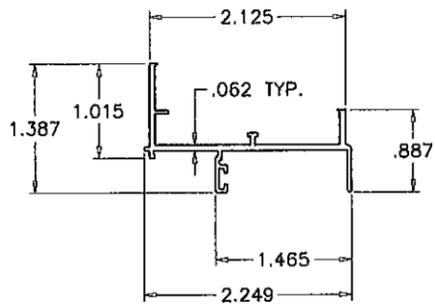


1 FRAME HEAD

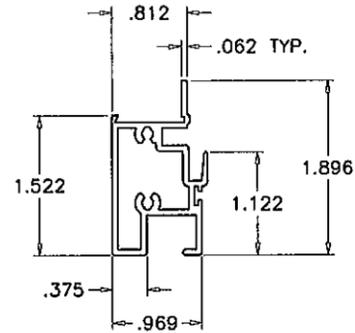


4 FIXED MEETING RAIL

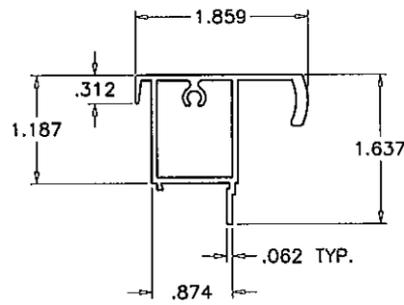


5 VENT TOP RAIL

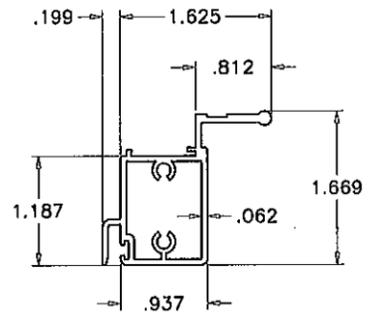


6 VENT BOTTOM RAIL

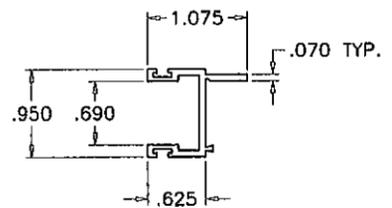


7 SASH SIDE RAIL

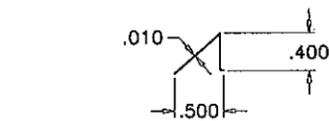


8 GLAZING BEAD

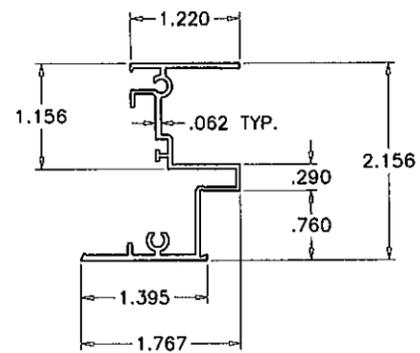


3 FRAME JAMB

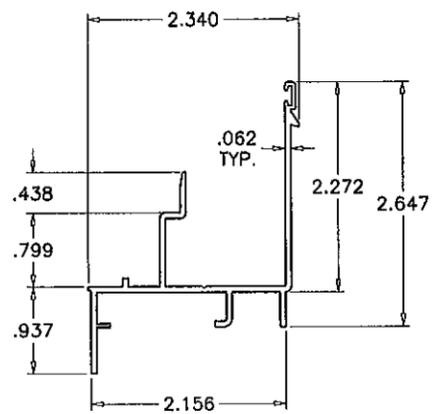


2 FRAME SILL

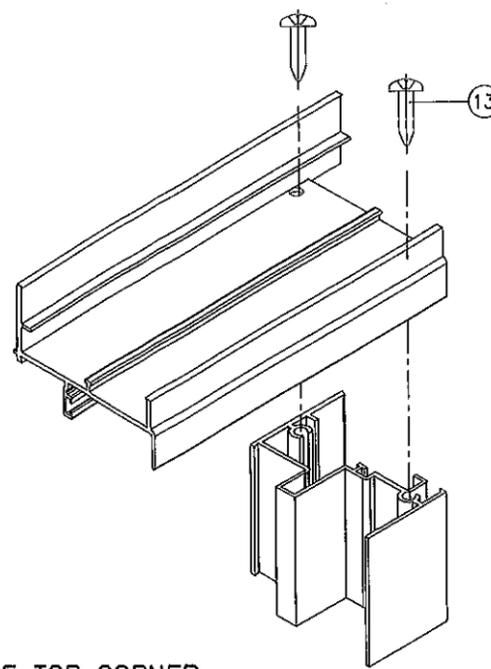


FRAME TOP CORNER

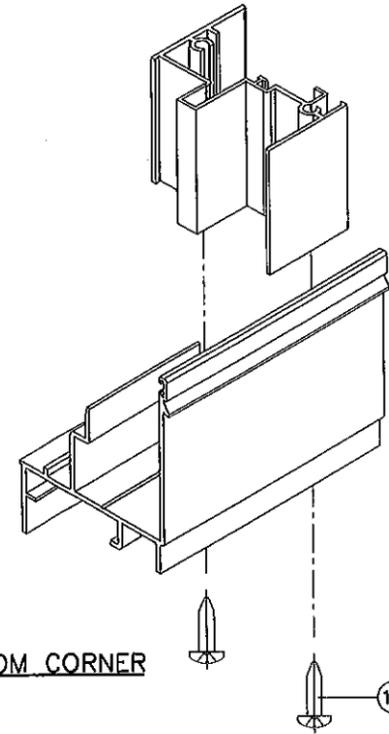

FRAME BOTTOM CORNER

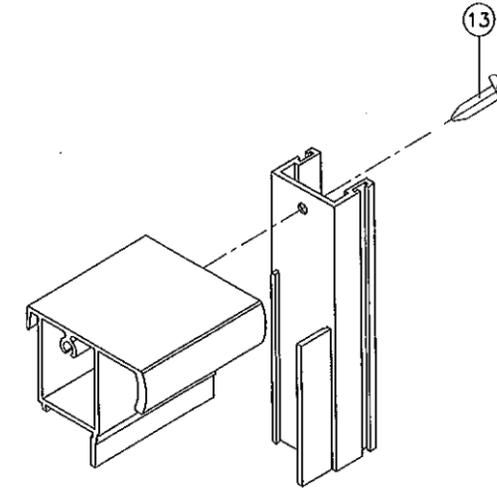


VENT TOP CORNER

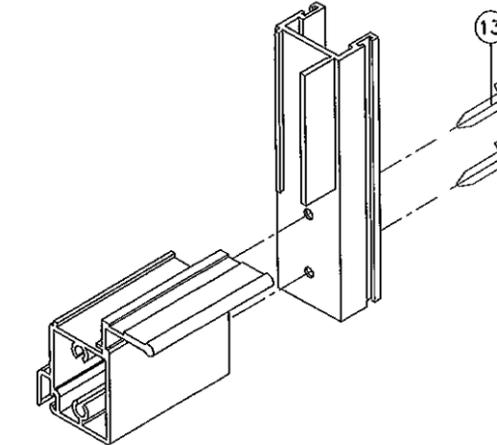

VENT BOTTOM CORNER

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70692
 C.A.N. 39382
 FEB 10 2016

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0306 05
 Expiration Date JAN. 5, 2016
 By *Manuel Perez*
 Miami Dade Product Control



AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W99-23W

SERIES 1100 ALUM SINGLE HUNG WDW. (N.I.)
 Labrador & Fundora Corp.
 dba-V & V Windows
 2355 West 4th Ave.
 Hialeah, Fl. 33010
 TEL. (305) 888-4151 FAX. (305) 888-1042

no	date	by	description
B	10.13.05		GENERAL REV.
C	12.14.05		REV. PER BCCO COMMENTS
D	05.17.10		UPDATED TO 2007 FBC
E	02.09.12		NO CHANGE THIS SHEET

date: 03-26-99
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W99-23
 sheet 4 of 4