



DEPARTMENT OF PERMITTING, ENVIRONMENT, AND REGULATORY
 AFFAIRS (PERA)
 BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY, FLORIDA
 PRODUCT CONTROL SECTION
 11805 S.W. 26th Street, Room 208
 Miami, Florida 33175-2474
 T (786) 315-2590 F (786) 315-2599
<http://www.miamidade.gov/economy/>

Montag Windows & Doors, LLC
 1249 Stirling Road, Suite 14,
 Dania Beach, FL 33004

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County PERA-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. PERA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Lift & Slide" Wood Sliding Glass Door - L.M.I.

APPROVAL DOCUMENT: Drawing No. **W08-84**, titled "Wood Frame Lift & Slide Glass Door - LMI" Sheets 1 through 7 of 7, dated 10/03/08 with the latest revision "C" dated 05/02/12, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E., bearing the Miami-Dade County Product Control Section revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LIMITATION: Refer to Design Load capacity table for design pressure with or without load clip.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, **Biberach-Mettenburg, Baden-Württemberg, Germany**, series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA revises NOA No. **09-0225.09** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
 7/24/12

NOA No. 12-0604.11
 Expiration Date: August 05, 2014
 Approval Date: August 02, 2012
 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under previous NOA No. 09-0225.09)
2. Drawing No. **W08-84**, titled "Wood Frame Lift & Slide Glass Door – LMI" Sheets 1 through 7 of 7, dated 10/03/08 with the latest revision "C", dated 05/02/12, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per SFBC, PA 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94along with marked-up drawings and installation diagram of Steel Outswing Doors w/ & w/o Sidelights & Transoms, prepared by American Testing Lab of South Florida, Test Report No. **ATLSF-1009.01-07**, dated 11/18/08, signed and sealed by William R. Mehner, P. E.
(Submitted under previous NOA No. 09-0225.09)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC-2010**, prepared by Al-Farooq Corporation, dated 05/08/12, signed and sealed by Javad Ahmad, P. E.
2. **Glazing complies with ASTM E 1300-02/04**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Permitting, Environment, and Regulatory Affairs (PERA).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **11-0624.02** issued to **E.I. DuPont DeNemours & Co., Inc.** for their "**DuPont SentryGlas® Interlayer**" dated 08/25/11, expiring on 01/14/17.

F. STATEMENTS

1. Statement letters of no financial interest, conformance and complying with **FBC-2010**, all issued by Al-Farooq Corporation, dated 04/23/12, all signed and sealed by Javad Ahmad, P. E.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 12-0604.11
Expiration Date: August 05, 2014
Approval Date: August 02, 2012

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (CONTINUED)

2. Distribution agreement between Fensterfabrik Montag Fassadenbau GmbH & Co. KG, Germany and Montag Windows & Doors, LLC, U.S.A., dated 04/23/09, signed by Mr. Gerhard Lang and Mr. Mitch Lewandowski, respectively.
(Submitted under previous NOA No. 09-0225.09)
3. Laboratory compliance letter for Test Report No. ATLSF-1009.01-07, dated 11/18/08, issued by American Testing Lab of South Florida, signed and sealed by William R. Mehner, P. E.
(Submitted under previous NOA No. 09-0225.09)
4. Proposal No. 07-2256 issued by Product Control, dated 04/04/07, signed by Narciso Renzo.
(Submitted under previous NOA No. 09-0225.09)



G. OTHERS

1. Notice of Acceptance No. 09-0225.09, issued to Montag Windows & Doors, LLC for their Series "Lift & Slide Wood Sliding Glass Door - L.M.I.", approved on 08/05/09 and expiring on 08/05/14.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 12-0604.11
Expiration Date: August 05, 2014
Approval Date: August 02, 2012

DESIGN LOAD CAPACITY - PSF							
PANEL WIDTH NOMINAL INCHES	FRAME HEIGHT INCHES	WITHOUT NEGATIVE LOAD CLIP				WITH NEGATIVE LOAD CLIP	
		STD. SILL		ALT. SILL		ALT. SILL	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24	84	65.0	85.0	65.0	70.0	65.0	77.0
30		65.0	85.0	65.0	70.0	65.0	77.0
36		65.0	85.0	65.0	70.0	65.0	77.0
42		65.0	85.0	65.0	70.0	65.0	77.0
48		65.0	85.0	65.0	70.0	65.0	77.0
54	97-1/4	65.0	85.0	65.0	70.0	65.0	77.0
24		65.0	85.0	65.0	70.0	65.0	77.0
30		65.0	85.0	65.0	70.0	65.0	77.0
36		65.0	85.0	65.0	70.0	65.0	77.0
42		65.0	85.0	65.0	70.0	65.0	77.0
48	65.0	85.0	65.0	70.0	65.0	77.0	

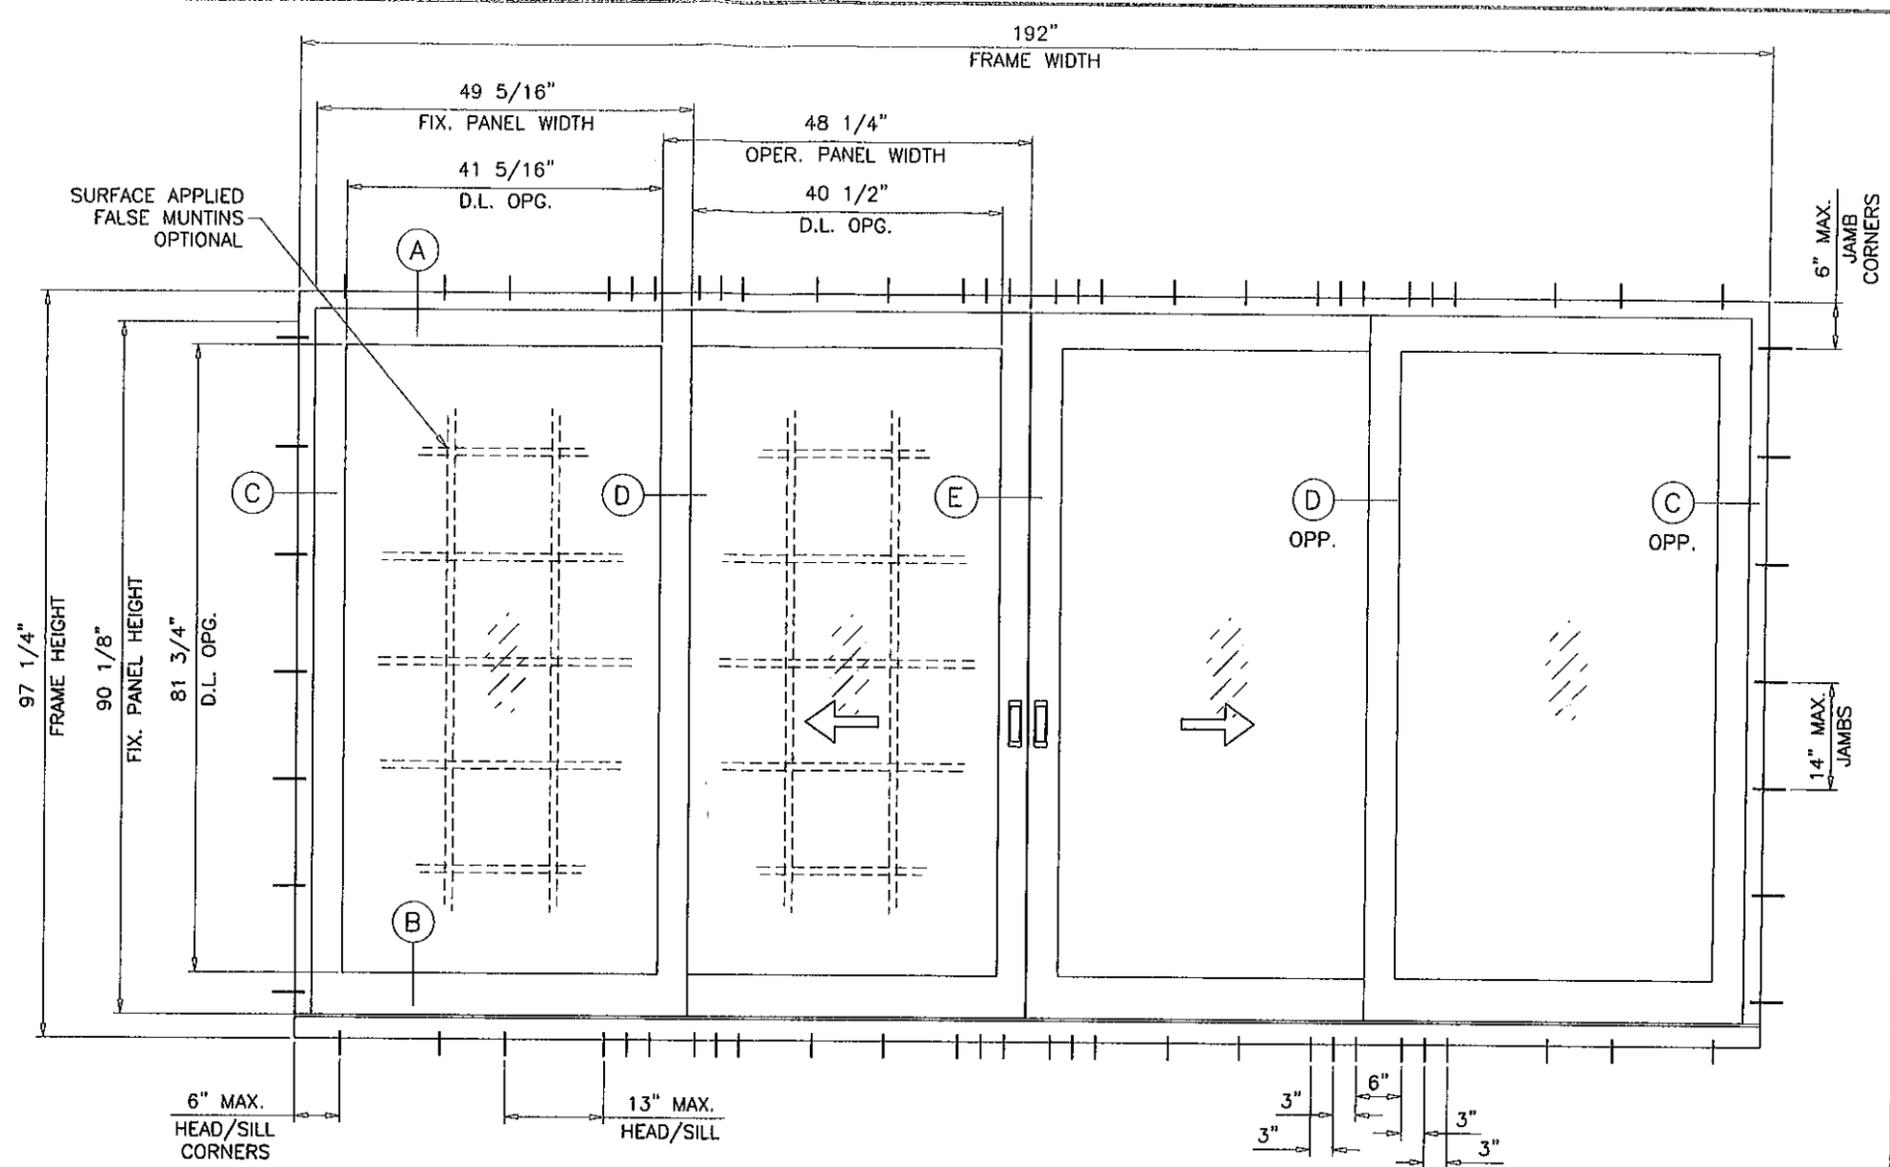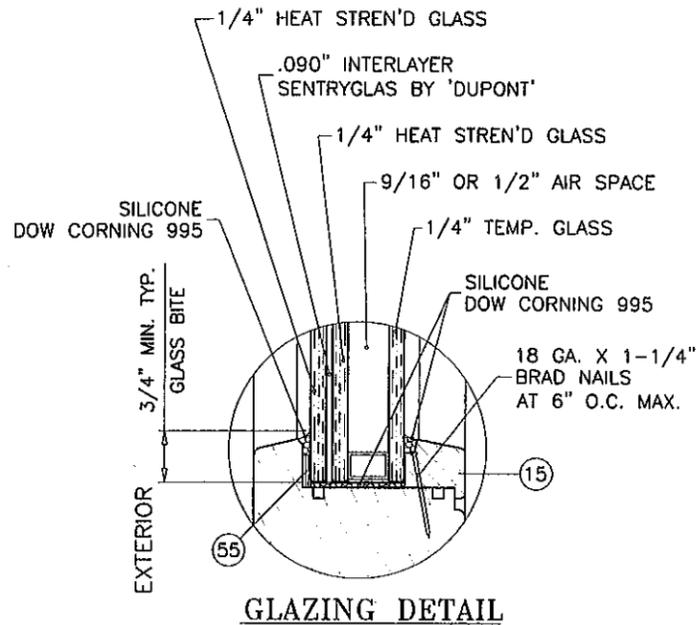

TYPICAL ELEVATION

WOOD FRAME LIFT & SLIDE GLASS DOOR

DESIGN LOAD RATING FOR THESE DOORS TO BE AS PER CHART SHOWN ABOVE.

THESE DOORS CAN BE INSTALLED AS SINGLE UNITS OR IN COMBINATION WITH MIAMI-DADE COUNTY APPROVED PRODUCTS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURES FROM WINDOWS, DOORS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BLDG. CODE SECTION 2003.8.4.

DAYLITE OPENINGS:

D.L.O. HEIGHT (FIX./OPER. PANEL) = PANEL HEIGHT - 8.375"
D.L.O. WIDTH (FIX. PANEL) = PANEL WIDTH - 8.000"
D.L.O. WIDTH (OPER. PANEL) = PANEL WIDTH - 7.750"

(OXXO)
(TESTED)


PRODUCT REVISED

as complying with the Florida Building Code
Acceptance No. 12-0604.11
Expiration Date 08/05/2014
By [Signature]
Miami Dade Product Control

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

NOTE:

GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-04 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

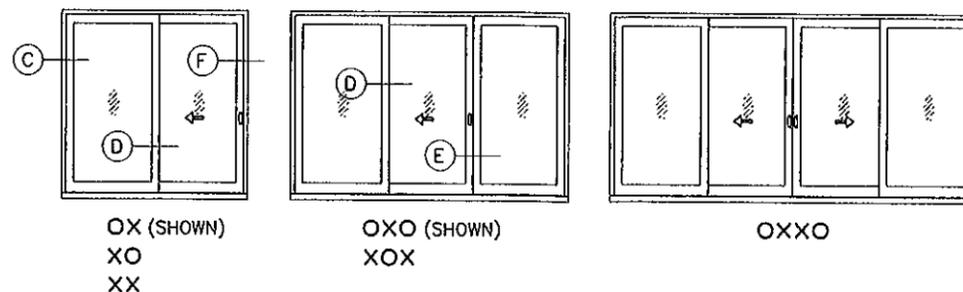

APPROVED CONFIGURATIONS

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

[Signature]

MAY 08 2012

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\W08-84MNA





WOOD FRAME LIFT & SLIDE GLASS DOOR (L.M.I.)
MONTAG WINDOWS & DOORS, LLC.
1249 STIRLING ROAD, STE. 14
DANIA BEACH, FL 33004
TEL. (866) 562-1728 FAX. (866) 563-1728

no	date	description
A	03.31.09	REV. PER BCCO COMMENTS
B	06.23.09	REV. PER BCCO COMMENTS
C	05.02.12	UPDATED TO 2010 FBC


date: 10-03-08
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:

drawing no.
W08-84

sheet 1 of 7

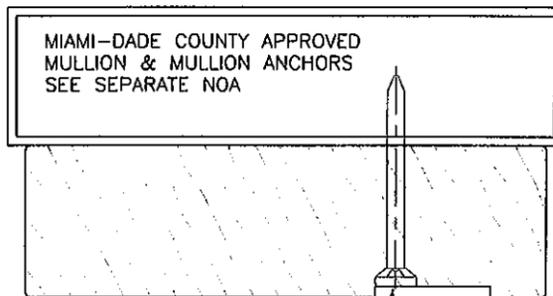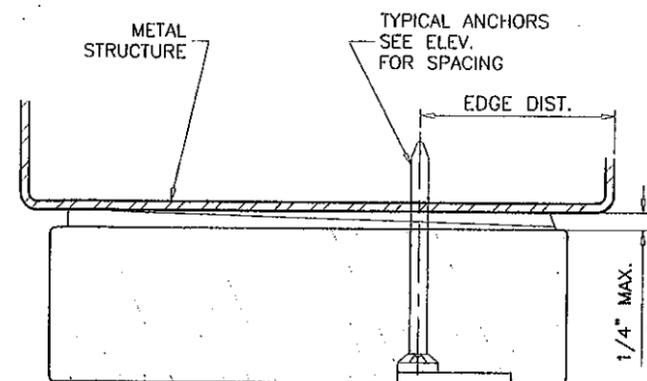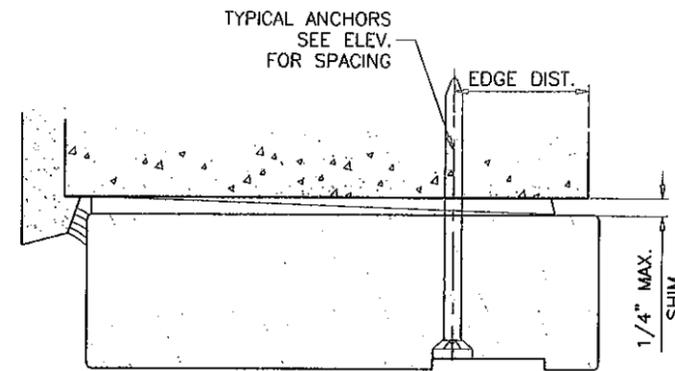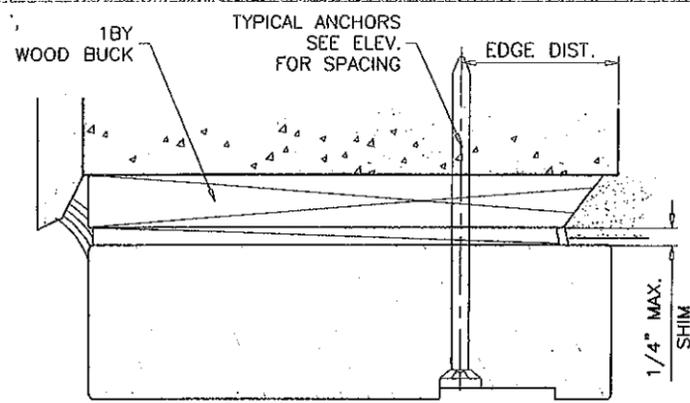

TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

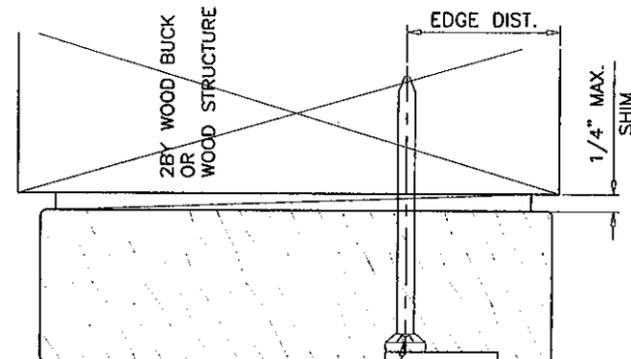

TYPICAL ANCHORS
SEE ELEV.
FOR SPACING

WOOD BUCKS AND METAL STRUCTURE NOT BY MONTAG
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
5/16" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

5/16 SMS (GRADE 2 CRS)
5/16" DIA. SELF DRILLING SCREWS (GRADE 5 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (1/8" THK. MIN.)
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE f'c = 3000 PSI MIN.
 MASONRY f'm = 1500 PSI MIN.

PRODUCT REVISED
 is complying with the Florida
 Building Code
 Acceptance No. **12-0604.11**
 Expiration Date **08/05/2014**
 By *[Signature]*
 Miami Dade Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
[Signature]

MAY 08 2012




afC
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W08-84MNA

WOOD FRAME LIFT & SLIDE GLASS DOOR (L.M.I.)
MONTAG WINDOWS & DOORS, LLC.
 1249 STIRLING ROAD, STE. 14
 DANIA BEACH, FL 33004
 TEL. (866) 562-1728 FAX. (866) 563-1728

no	date	by	description
A	03.31.09	REV. PER BOCO COMMENTS	
B	06.23.09	NO CHANGE THIS SHEET	
C	05.02.12	NO CHANGE THIS SHEET	

date: 10-03-08
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W08-84
 sheet 3 of 7

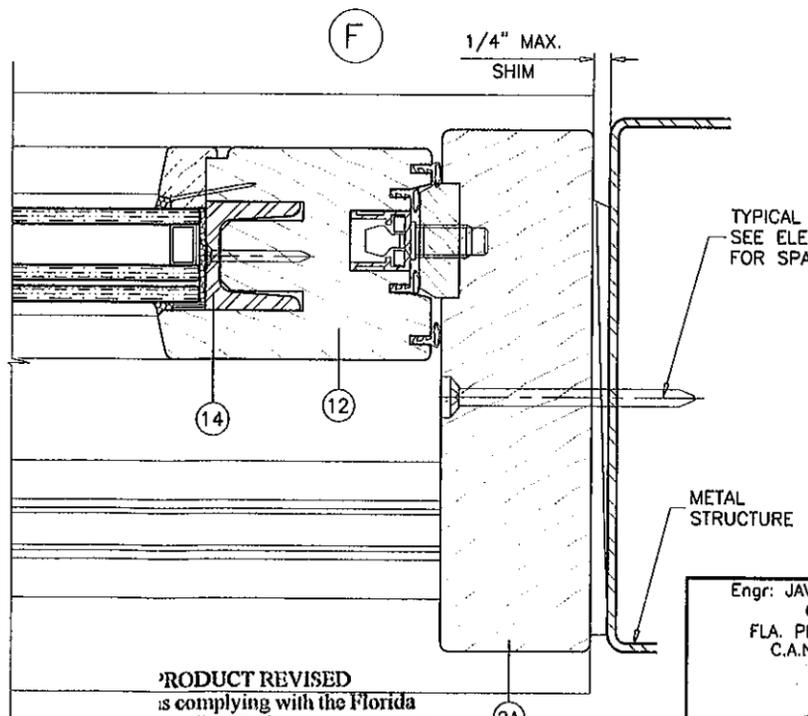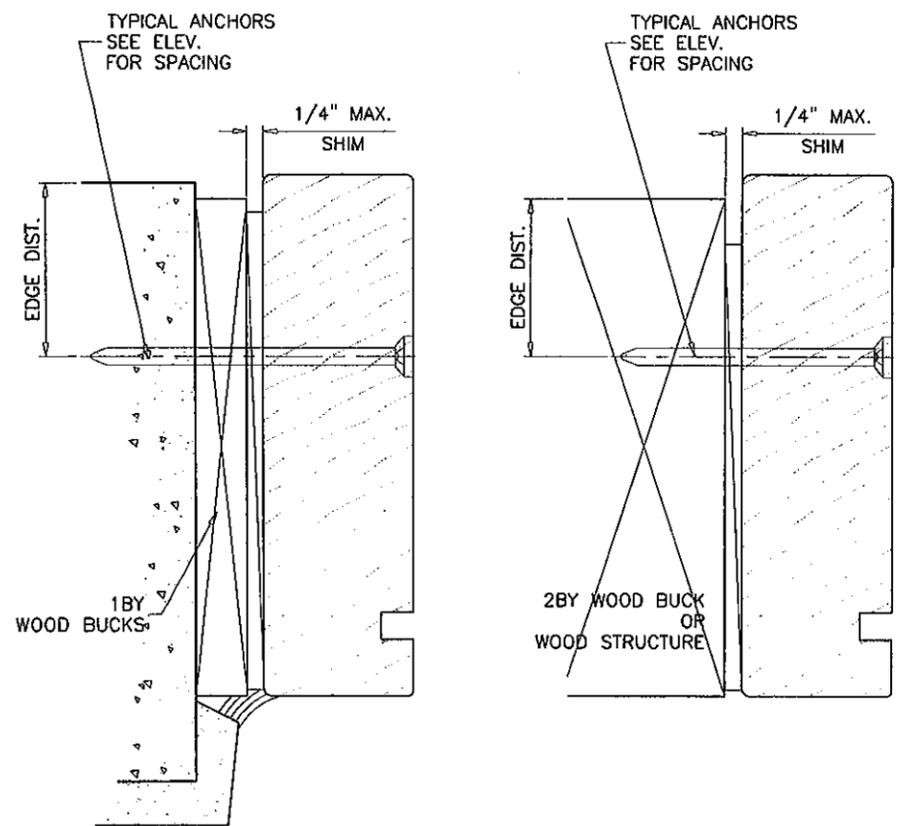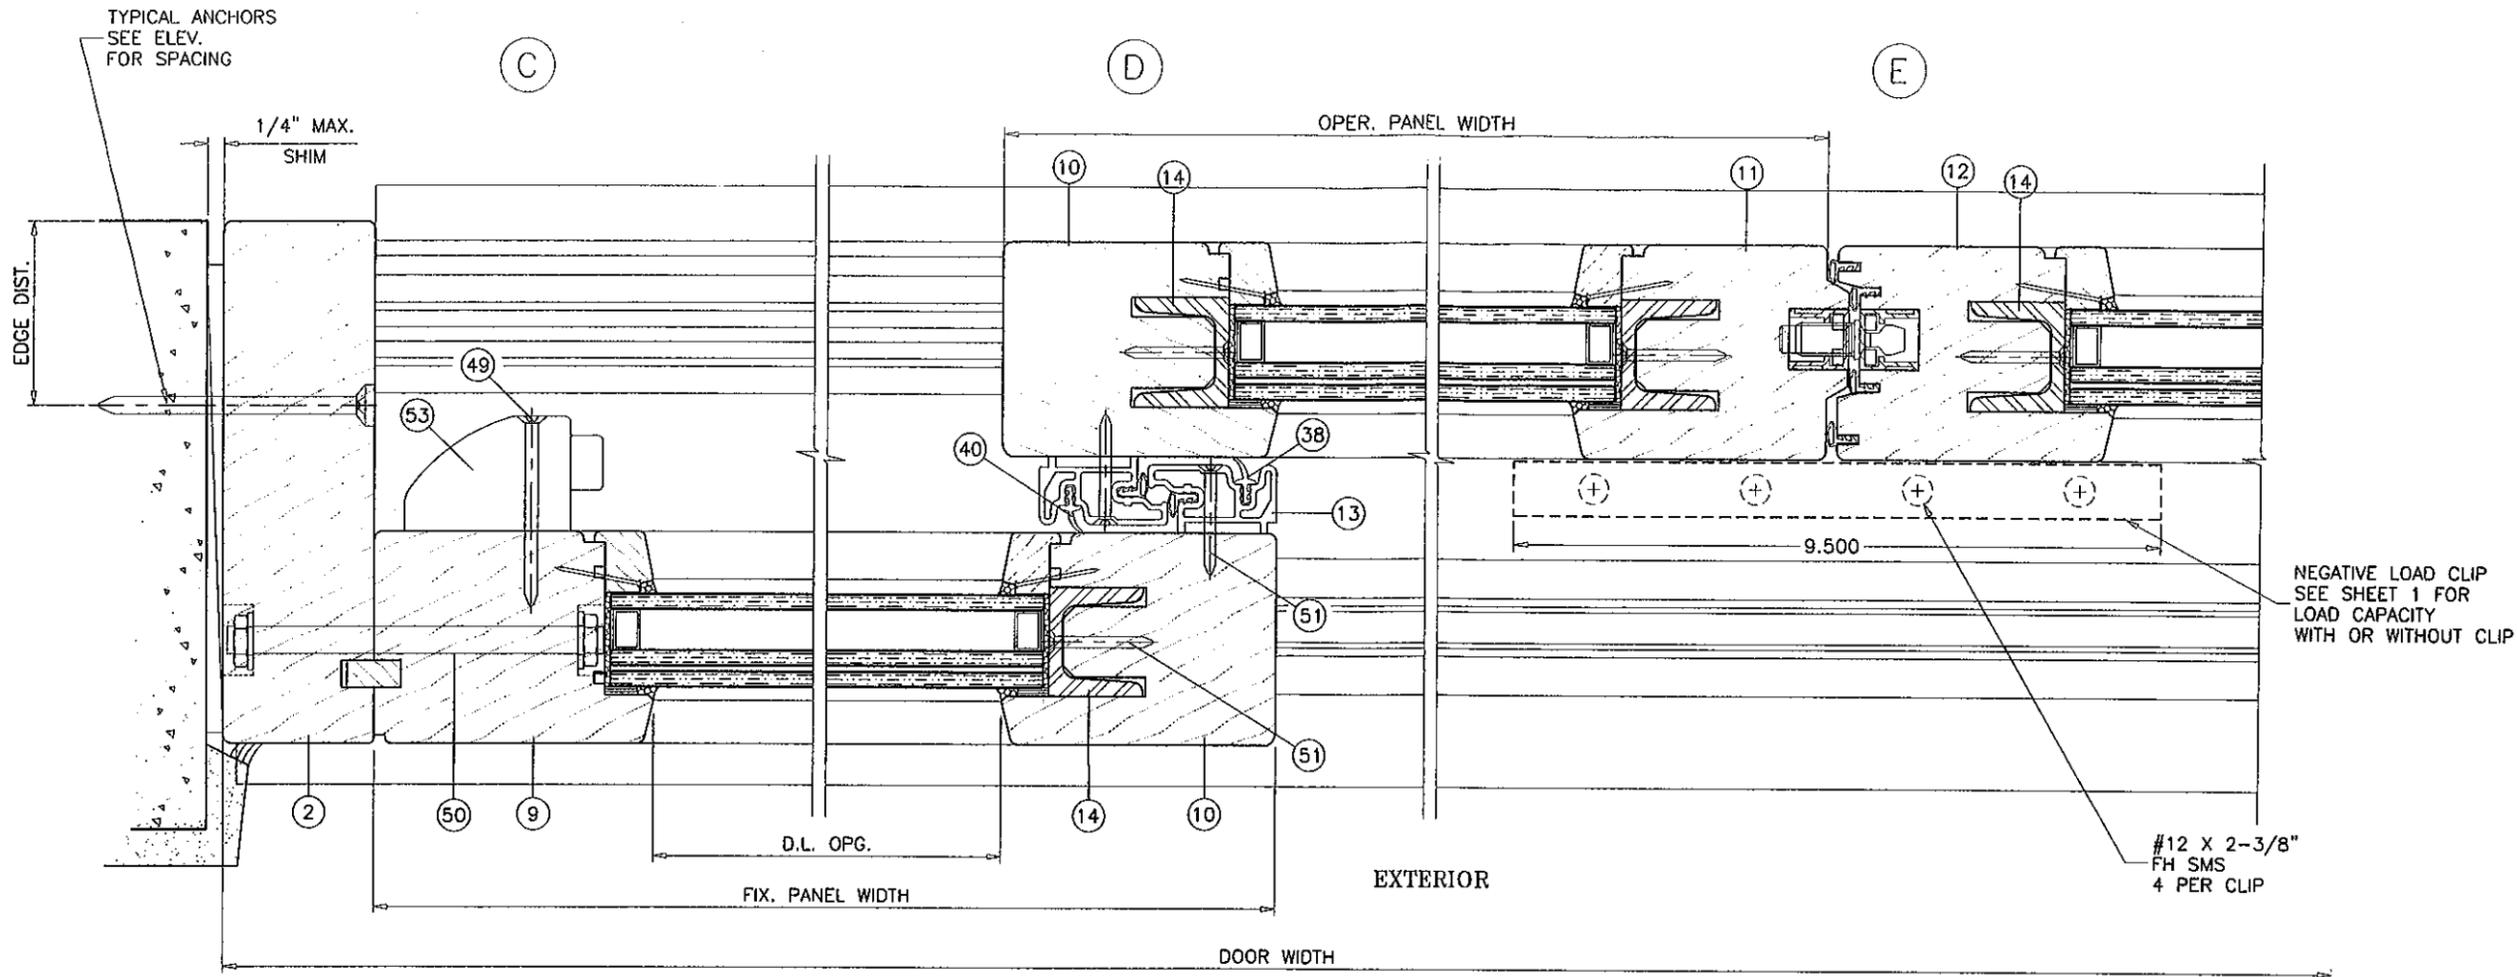

PRODUCT REVISED
 is complying with the Florida
 Building Code
 Acceptance No. 12-0604.11
 Expiration Date 08/05/2014
 Miami Dade Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

MAY 08 2012



AL-FAROQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP - ANL \ W08 - 84MNA


WOOD FRAME LIFT & SLIDE GLASS DOOR (L.M.I.)
MONTAG WINDOWS & DOORS, LLC.
 1249 STIRLING ROAD, STE. 14
 DANIA BEACH, FL 33004
 TEL. (866) 562-1728 FAX. (866) 563-1728

revisions:


no.	date	by	description
A	03.31.09	REV. PER BCCO COMMENTS	
B	06.23.09	REV. PER BCCO COMMENTS	
C	05.02.12	NO CHANGE THIS SHEET	

date: 10-03-08
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W08-84
 sheet 4 of 7

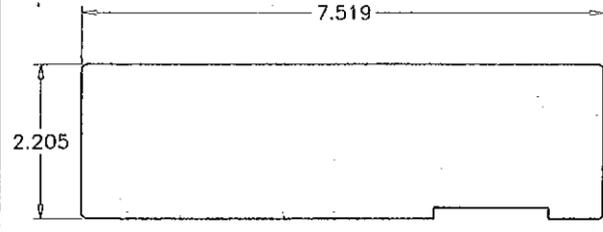


① FRAME HEAD

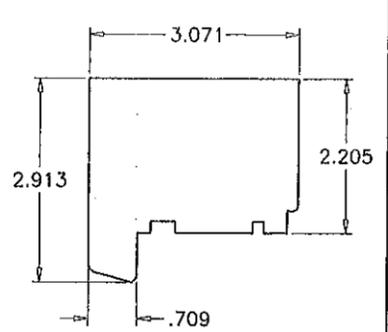


⑤ FIX. PANEL TOP RAIL

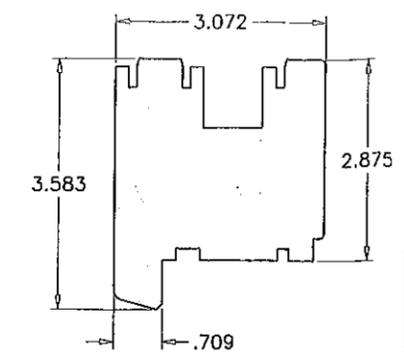


⑥ OPER. PANEL TOP RAIL

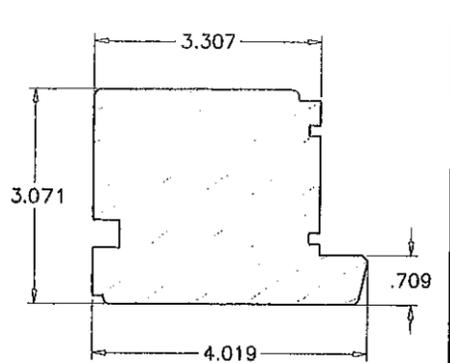


⑨ JAMB STILE

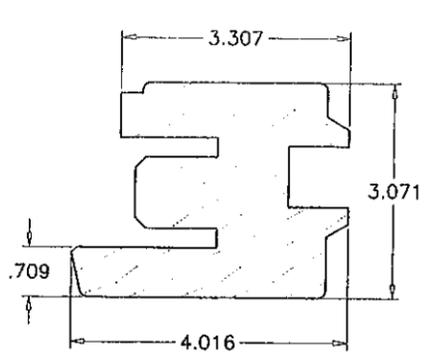


⑪ LOCK STILE 1

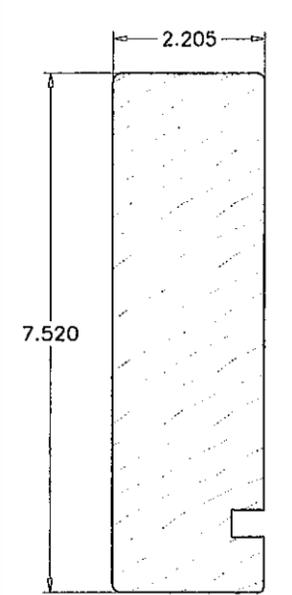


② FRAME JAMB (FIXED PANEL)

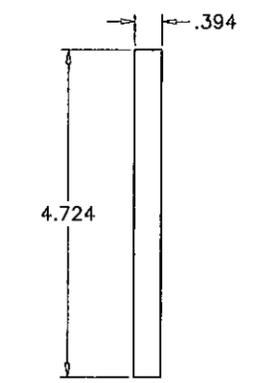


④ INTERIOR STOP

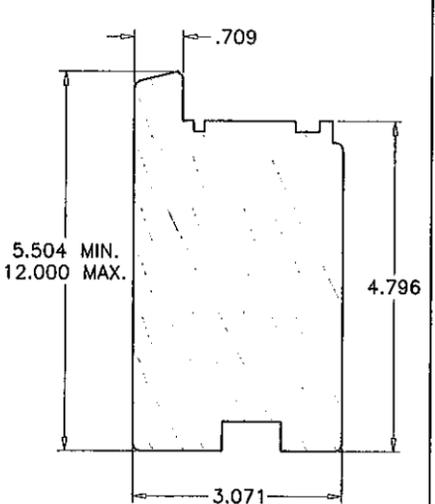


⑦ FIX. PANEL BOTTOM RAIL

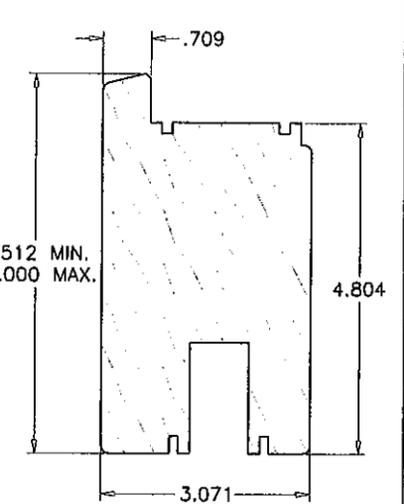


⑧ OPER. PANEL BOTTOM RAIL

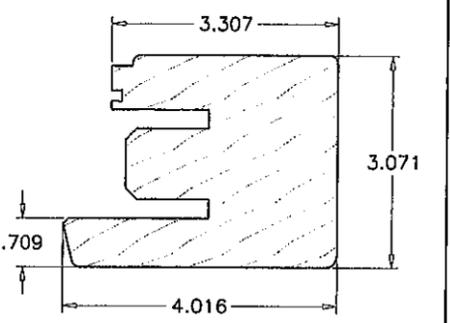


⑩ INTERLOCK STILE

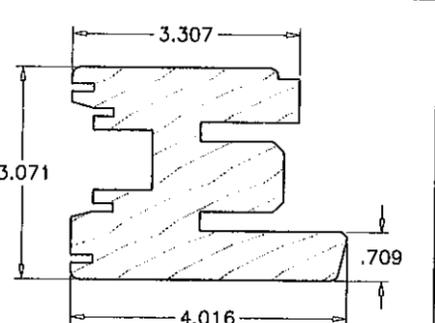


⑫ LOCK STILE 2




⑮ GLAZING BEAD

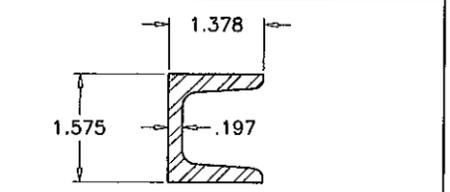


⑭ STILE REINFORCING

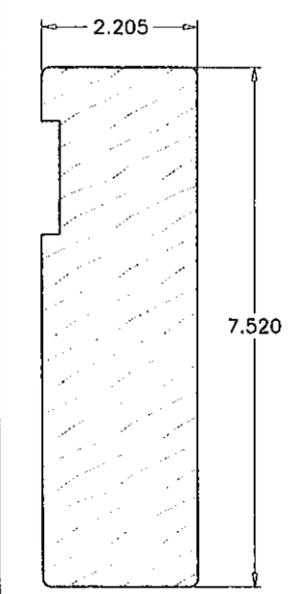

②A FRAME JAMB (OPERATING PANEL)

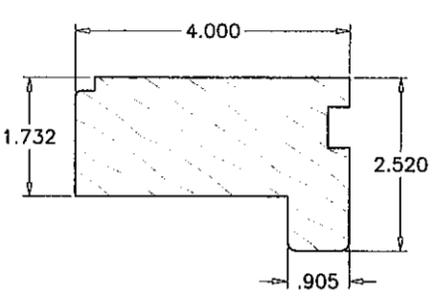

③ FIX. PANEL EXTENSION

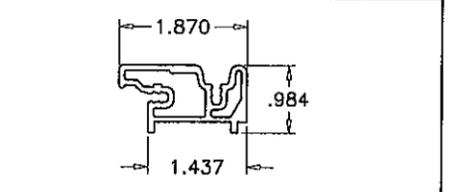

⑬ INTERLOCK HOOK



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

WOOD FRAME LIFT & SLIDE GLASS DOOR (L.M.I.)
MONTAG WINDOWS & DOORS, LLC.
1249 STIRLING ROAD, STE. 14
DANIA BEACH, FL 33004
TEL. (866) 562-1728 FAX. (866) 563-1728

no.	date	description	by
A	03.31.09	REV. PER BCCO COMMENTS	
B	06.23.09	REV. PER BCCO COMMENTS	
C	05.02.12	NO CHANGE THIS SHEET	

date: 10-03-08
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-84


sheet 5 of 7

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **12-0604.11**
Expiration Date **08/05/2014**
By *[Signature]*
Miami Dade Product Control


Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538




MAY 08 2012

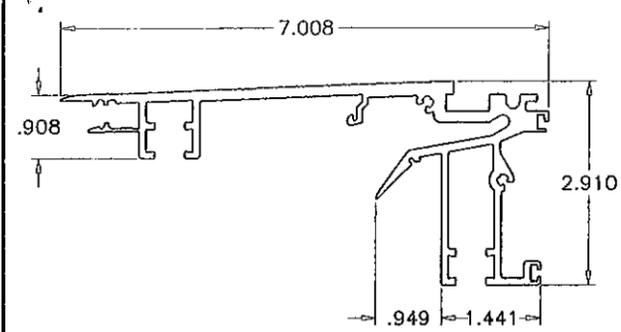


16 SILL OUTSIDE PIECE

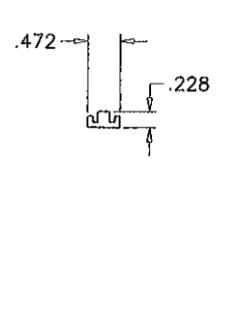


17 SILL CONNECTOR

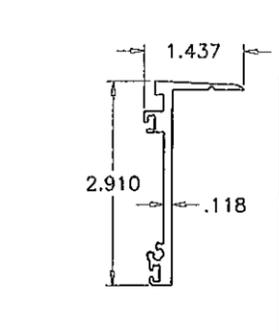


18 SILL INSIDE PIECE

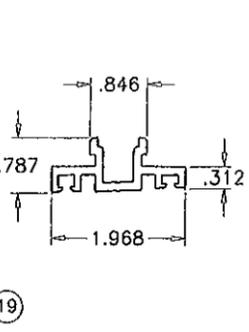


19 FIX. PANEL BASE

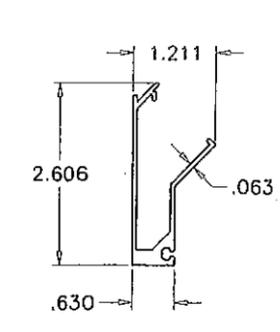


20 SILL BOTTOM PIECE

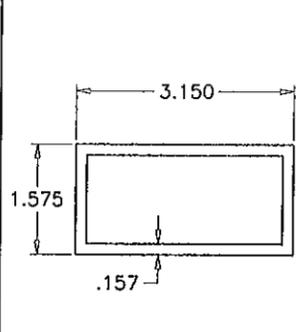


21 BASE TUBE

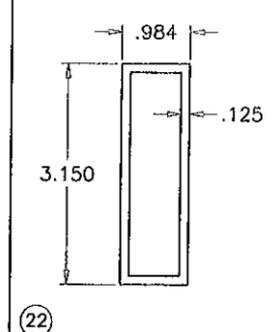


22 SILL INTERIOR TUBE

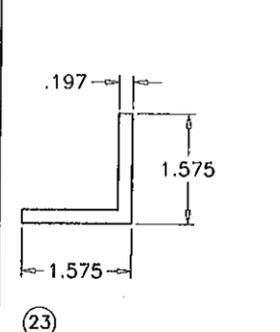


23 SILL ANGLE




24 SILL INTERIOR BLOCK




25 GUIDE TRACK PANEL

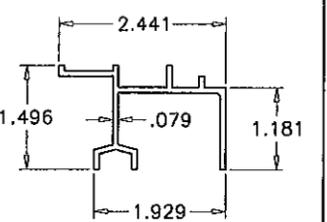


26 GUIDE TRACK FRAME




27 GUIDE TRACK ANGLE




28 NEGATIVE LOAD CLIP

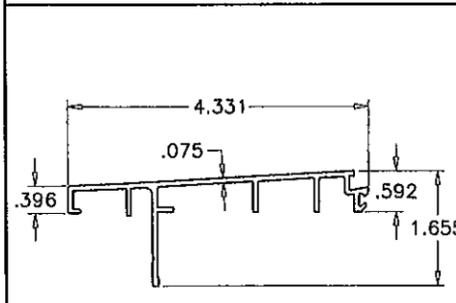


29 SILL OUTSIDE PIECE

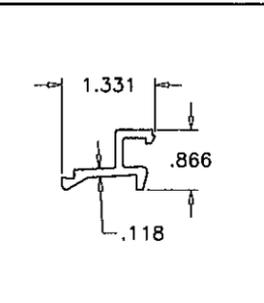


30 SILL CONNECTOR

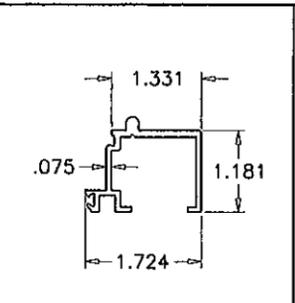


31 SILL INSIDE PIECE

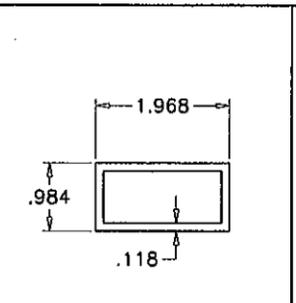


32 FIX. PANEL BASE TUBE

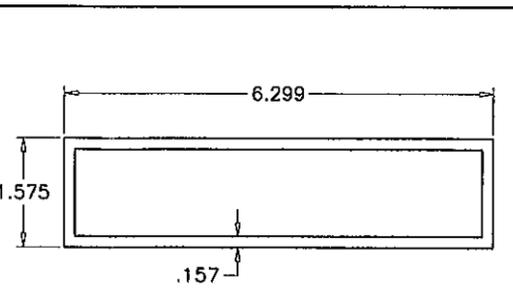


33 SILL BASE TUBE

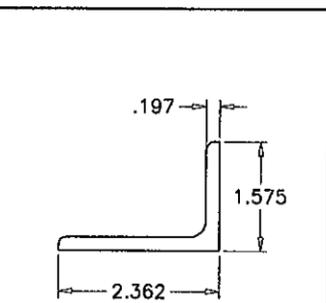

34 SILL ANGLE

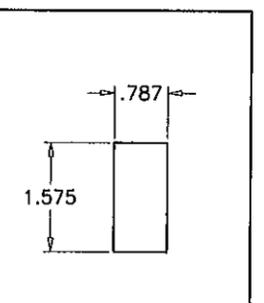

35 SILL INTERIOR BLOCK

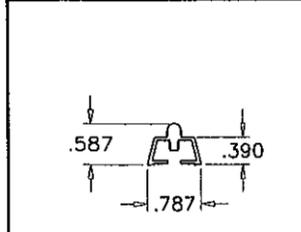

36 ROLLER TRACK

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0604.11
 Expiration Date 08/05/2014
 By: *[Signature]*
 Miami Dade Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
[Signature]
 MAY 08 2012

af
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6975
 COMP-ANL\W08-84MNA

WOOD FRAME LIFT & SLIDE GLASS DOOR (L.M.I.)
MONTAG WINDOWS & DOORS, LLC.
 1249 STIRLING ROAD, STE. 14
 DANIA BEACH, FL 33004
 TEL. (866) 562-1728 FAX. (866) 563-1728

no.	date	by	description
A	03.31.09		REV. PER BCCO COMMENTS
B	06.23.09		NO CHANGE THIS SHEET
C	05.02.12		NO CHANGE THIS SHEET

date: 10-03-08
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W08-84
 sheet 6 of 7

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	-	1	FRAME HEAD	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
2	-	AS REQD.	FRAME JAMB (FIXED PANEL)	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
2A	-	AS REQD.	FRAME JAMB (OPERATING PANEL)	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
3	-	1/ FIX. PANEL	FIX. PANEL EXTENSION	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
4	-	1	INTERIOR STOP	6063-T6	-
5	-	1/FIX. PANEL	FIXED PANEL TOP RAIL	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
6	-	1/ MOV. PANEL	OPERATING PANEL TOP RAIL	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
7	-	1/FIX. PANEL	FIXED PANEL BOTTOM RAIL	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
8	-	1/ MOV. PANEL	OPERATING PANEL BOTTOM RAIL	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
9	-	1/ PANEL	JAMB STILE	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
10	-	1/ PANEL	INTERLOCK STILE	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
11	-	1/ PANEL	LOCK STILE 1	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
12	-	1/ PANEL	LOCK STILE 2	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
13	-	1/ PANEL	INTERLOCK HOOK	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
14	-	AS REQD.	STILE REINFORCING	GALV. STEEL	-
15	-	AS REQD.	GLAZING BEAD	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
16	-	1	SILL OUTSIDE PIECE	6063-T6	ALUMAT-FREY GMBH
17	-	1	SILL CONNECTOR	6063-T6	-
18	-	1	SILL INSIDE PIECE	6063-T6	-
19	-	1/ FIX. PANEL	FIXED PANEL BASE	6063-T6	-
20	-	1	SILL BOTTOM PIECE	6063-T6	-
21	-	1	BASE TUBE EXTERIOR	6063-T6	-
22	-	1	SILL INTERIOR TUBE	6063-T6	-
23	-	2	SILL ANGLE	STEEL	-
24	-	1	SILL INTERIOR BLOCK	6063-T6	-
25	-	1/ MOV. PANEL	GUIDE TRACK PANEL	PVC	-
26	-	1	GUIDE TRACK FRAME	6063-T6	SIEGENIA, AUBI KG TYPE HHO-130-02
27	-	1	GUIDE TRACK ANGLE	GALV. STEEL	-
28	-	AS REQD.	NEGATIVE LOAD CLIP	6063-T6	-
29	-	1	SILL OUTSIDE PIECE	6063-T6	-
30	-	1	SILL CONNECTOR	6063-T6	-
31	-	1	SILL INSIDE PIECE	6063-T6	-
32	-	1/ FIX. PANEL	FIX. PANEL BASE TUBE	6063-T6	-
33	-	1	BASE TUBE	6063-T6	-
34	-	2/ DOOR	SILL ANGLE	STEEL	-
35	-	1	SILL INTERIOR BLOCK	6063-T6	-
36	-	1	ROLLER TRACK	6063-T6	-
38	-	AS REQD.	TOP RAIL W'STRIPPING	-	SIEGENIA-AUBI KG TYPE HHO-134-01
39	-	AS REQD.	BOTTOM RAIL W'STRIPPING	-	ALUMAT-FREY GMBH
40	-	AS REQD.	BOTTOM RAIL W'STRIPPING	-	SIEGENIA-AUBI KG TYPE HHO-134-02
41	-	AS REQD.	INTERLOCK HOOK W'STRIPPING	-	SIEGENIA-AUBI KG TYPE HHO-134-06
43	4.5 MM	-	FH ASSEMBLY SCREWS	-	-
44	4.5 MM	-	FH ASSEMBLY SCREWS	-	-
45	M10	4/ FIX. PANEL	THREADED BOLT WITH NUT & WASHER	-	AT EACH END & 3 EQUAL SPACES
46	M10	4/ FIX. PANEL	THREADED BOLT WITH NUT & WASHER	-	AT EACH END & 3 EQUAL SPACES
47	4.5 MM	-	FH ASSEMBLY SCREWS	-	-
48	4.5 MM	-	FH ASSEMBLY SCREWS	-	-
49	4.5 MM	-	FH ASSEMBLY SCREWS	-	-
50	M10	-	THREADED BOLT WITH NUT & WASHER	-	-
51	4.5 MM	-	FH ASSEMBLY SCREWS	-	AT 4" FROM ENDS AND 13" O.C.
53	-	AS REQD.	DOOR STOP	-	SIEGENIA
54	-	-	TONGUE AND GROOVE MOULDING	WHITE MERANTI WOOD	SG = 0.55 (E = 1,600,000 PSI)
55	-	4/ PANEL	GLAZING TAPE	FOAM	-
56	-	1/ MOV. PANEL	LIFT & SLIDE HARDWARE	-	SIEGENIA-AUBI

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0604.11
Expiration Date 08/05/2014
By: *[Signature]*
Miami Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
[Signature]

af c
AL-FAROQQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W08-84MNA

WOOD FRAME LIFT & SLIDE GLASS DOOR (L.M.I.)
MONTAG WINDOWS & DOORS, LLC.
1249 STIRLING ROAD, STE. 14
DANIA BEACH, FL 33004
TEL. (866) 562-1728 FAX. (866) 563-1728

revisions:

no.	date	description	by
A	03.31.09	REV. PER BCCO COMMENTS	
B	06.23.09	REV. PER BCCO COMMENTS	
C	05.02.12	NO CHANGE THIS SHEET	

date: 10-03-08
scale: 3/8" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-84
sheet 7 of 7

MAY 08 2012