



MIAMI-DADE COUNTY  
 PRODUCT CONTROL SECTION  
 11805 SW 26 Street, Room 208  
 Miami, Florida 33175-2474  
 T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
 BOARD AND CODE ADMINISTRATION DIVISION  
**NOTICE OF ACCEPTANCE (NOA)**

**BP-Glass Garage Doors & Entry Systems, Inc.**  
 9412 Gidley Street  
 Temple City, CA 91780

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Models BP-450 HD/BP-550 SHD Aluminum and Glass Sectional Garage Door up to 24'-2" Wide**

**APPROVAL DOCUMENT:** Drawing No. **BPC005**, titled "BP-450 HD/BP-550 SHD Glass Garage Door" sheets 1 through 7 of 7, dated 01/13/2012, prepared by Building Drops, Inc, signed and sealed by Hermes F. Norero, P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** A permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



*Signature*  
 01/10/2013

NOA No. 12-0620.15  
 Expiration Date: January 17, 2018  
 Approval Date: January 17, 2013  
 Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawing No. **BPC005**, titled "BP-450 HD/BP-550 SHD Glass Garage Door" sheets 1 through 7 of 7, dated 01/13/2012, prepared by Building Drops, Inc, signed and sealed by Hermes F. Norero, P.E.

**B. TESTS**

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94  
along with installation diagram on three Series/Model BP-450/ BP-550 SHD Hurricane Line, glazed sectional garage doors, prepared by Architectural Testing, Inc, Test Report No. **A6707.01-301-18**, dated 11/22/2011, with Revision 2 dated 06/01/2012, signed and sealed by Tyler Westerling, P.E.

**C. CALCULATIONS**

1. Product evaluation report complying with FBC 2010, prepared by Building Drops, Inc, dated 05/11/2012, signed and sealed by Hermes F. Norero, P.E.

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

**E. MATERIAL CERTIFICATIONS**

1. None.

**F. STATEMENTS**

1. Statement letter of code conformance to 2010 FBC and no financial interest issued by Building Drops, Inc, dated 05/11/2012, signed and sealed by Hermes F. Norero, P.E.
2. Laboratory compliance letter for Test Report No. **A6707.01-301-18**, issued by Architectural Testing, Inc., dated 11/22/2011, with Revision 2 dated 06/01/2012, signed and sealed by Tyler Westerling, P.E.



---

Carlos M. Utrera, P.E.  
Product Control Examiner  
NOA No. 12-0620.15  
Expiration Date: January 17, 2018  
Approval Date: January 17, 2013



BP-GLASS GARAGE DOORS & ENTRY SYSTEMS, INC.  
9412 GIDLEY STREET  
TEMPLE CITY, CA 91780

PH: (626) 442-1716 FX: (626) 579-5320

# BP-GLASS GARAGE DOORS & ENTRY SYSTEMS, INC.

## BP-450 HD/BP-550 SHD HURRICANE LINE GLASS GARAGE DOOR

### INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN UNLESS OTHERWISE STATED.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR INSTALLATION INTO WOOD FRAMING USE 3/8 INCH LAG SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 3 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- FOR INSTALLATION DIRECTLY INTO CONCRETE/MASONRY, USE 3/8 INCH DIAMETER CONCRETE FASTENERS OF SUFFICIENT LENGTH TO ACHIEVE 2 1/2 INCH MINIMUM EMBEDMENT.
- FOR INSTALLATION THROUGH STEEL STUD, USE 3/8 INCH DIAMETER STEEL BOLTS OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF THREE (3) THREADS OF PENETRATION BEYOND STEEL STRUCTURE.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
  - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
  - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 2700 PSI.
  - GROUT-FILLED CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 & GROUT CONFORMS TO ASTM C 476. GROUT SHALL HAVE MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI. SEE FBC SECTION 2105.2.2.1.2 (3) FOR GROUTED MASONRY REQUIREMENTS.
  - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 118 MILS (11 GAUGE)

### GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2010 FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
  - TAS 201-94
  - TAS 202-94
  - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 4X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 4X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREA. IN HVHZ AREA, ONE TIME PRODUCT APPROVAL TO BE OBTAINED FROM MIAMI-DADE PERA.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- DOOR FRAME MATERIAL: ALUMINUM 6063-T5
- IN ACCORDANCE WITH THE 2010 FBC SEC. 2003.8.4 DISSIMILAR METALS INCLUDING FASTENERS THAT MAY COME INTO CONTACT WITH ALUMINUM UNIT FRAMING SHALL BE PROTECTED AS DEFINED IN SEC 2003.8.4.2.
- GLASS MEETS THE REQUIREMENTS OF ASTM E 1300-04 GLASS CHARTS. SEE SHEET 3 FOR GLAZING DETAILS.
- EPDM GLAZING GASKET HAS BEEN TESTED IN ACCORDANCE WITH FBC 2411.3.4.

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	-	INSTALLATION & GENERAL NOTES
2	-	ELEVATION & ANCHOR LAYOUT
3	-	ASSEMBLY DETAILS & GLAZING DETAILS
4	-	VERTICAL & HORIZONTAL SECTIONS
5	-	HORIZONTAL SECTIONS
6	-	COMPONENTS & BILL OF MATERIALS
7	-	COMPONENTS

DESIGN PRESSURE RATING	
DESIGN PRESSURE - ALL SIZES	MISSILE IMPACT RATING
+50.0 / -50.0 PSF*	LARGE AND SMALL MISSILE IMPACT RATED

\*REMOVABLE REINFORCEMENT REQUIRED (NOT RATED FOR WATER INFILTRATION)

TITLE: BP-450 HD/BP-550 SHD GLASS GARAGE DOOR INSTALLATION & GENERAL NOTES

PREPARED BY:  
— BUILDING DROPS INC.  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366

### REVISIONS

NO.	DESCRIPTION	BY	DATE


*[Signature]*  
HERMES F. NORRIS, P.E.  
FLORIDA REG. NO. 73778  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
EPDPE CERT. OF AUTHORIZATION NO. 29578

Approved as complying with the Florida Building Code  
Date 01/17/2013  
NOA# 12-0620.15  
Miami Dade Product Control  
By *[Signature]*

DATE: 01.13.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS

DWG #: **BPC005**  
SHEET: **1 OF 7**

NOTE: HANGER BRACKETS AND OTHER COMPONENTS SHALL BE DESIGNED TO SUPPORT A 5 LB/IN. LINEAR LOAD WHEN THE DOOR IS IN THE OVERHEAD POSITION

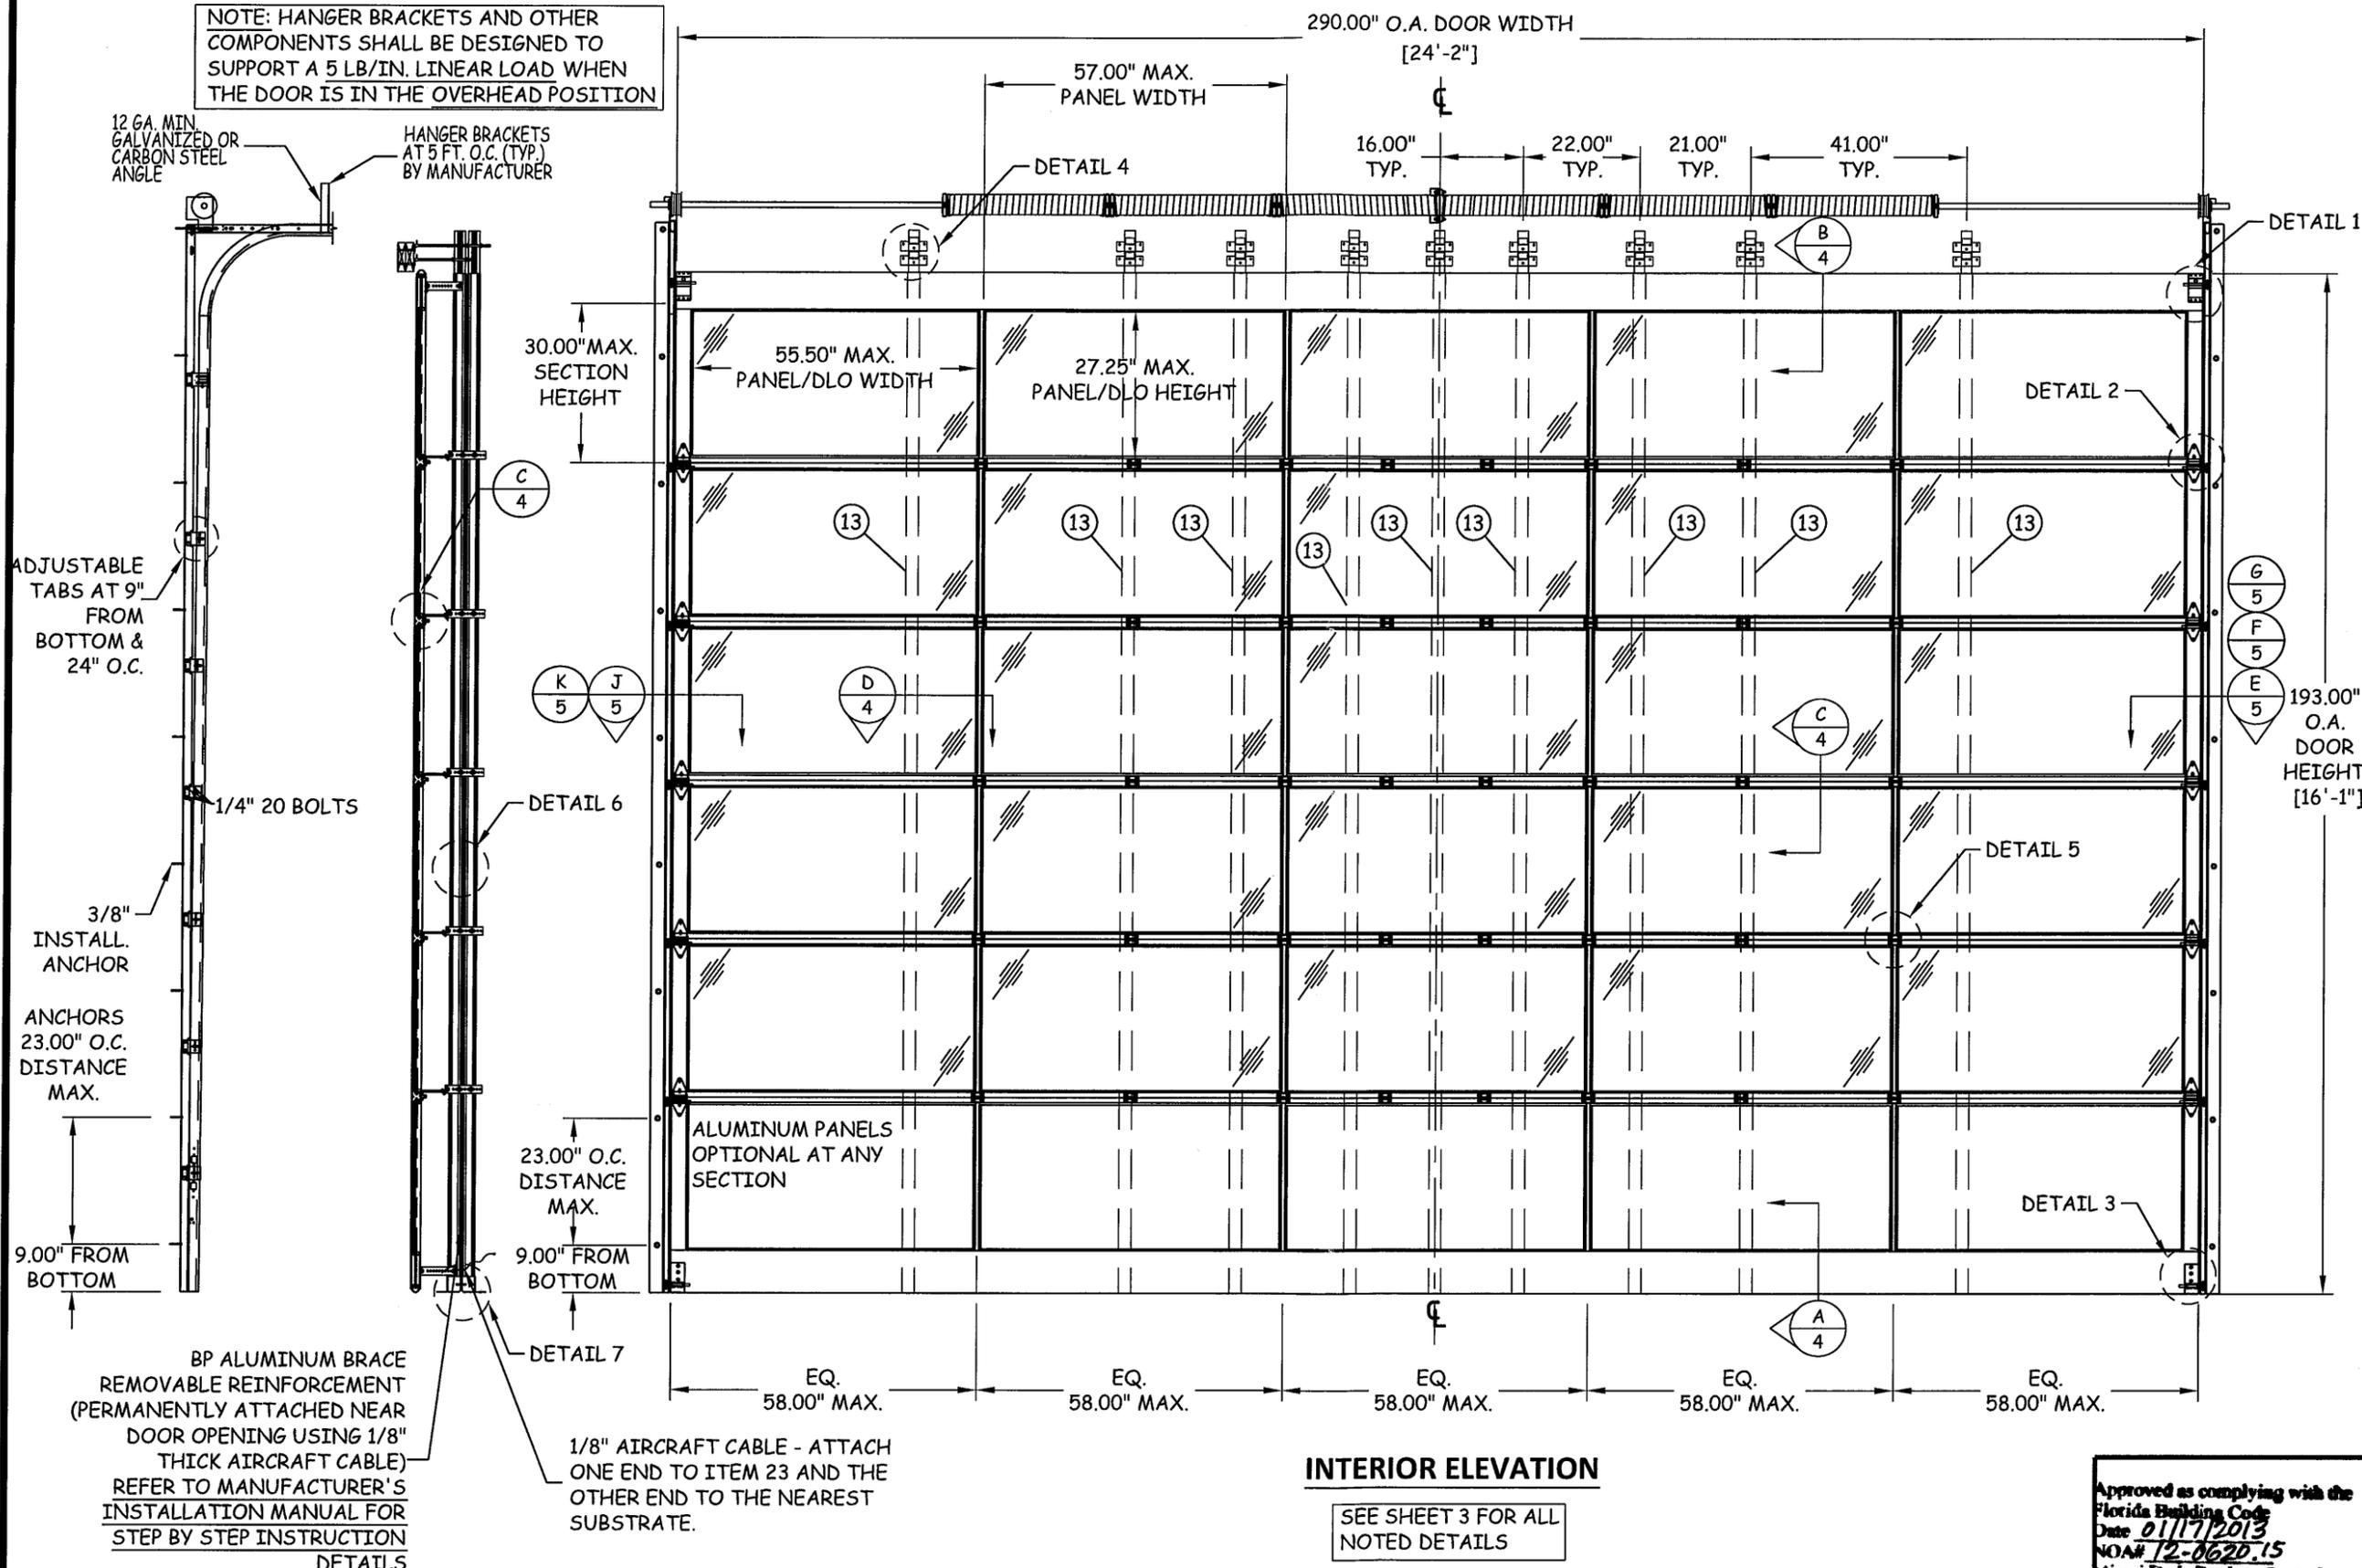

**ANCHOR LAYOUT**

**INTERIOR ELEVATION**

SEE SHEET 3 FOR ALL NOTED DETAILS



BP-GLASS GARAGE DOORS & ENTRY SYSTEMS, INC.  
9412 GIDLEY STREET  
TEMPLE CITY, CA 91780  
PH: (626) 442-1716 FX: (626) 579-5320

TITLE: BP-450 HD/BP-550 SHD  
GLASS GARAGE DOOR  
ELEVATION &  
ANCHOR LAYOUT

PREPARED BY:  
BUILDING DROPS INC.  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366

REVISIONS	
NO.	DESCRIPTION




*[Signature]*  
11-9-2012  
HERNAN F. NORERO, P.E.  
FLORIDA P. E. NO. 73775  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
FBPE CERT. OF AUTHORIZATION NO. 25578

Approved as complying with the Florida Building Code  
Date: 01/17/2013  
NOA# 12-0620.15  
Miami Dad: Product Control  
By: *[Signature]*

DATE: 01.13.12	DWN BY: JLA	CHK BY: HFN	SCALE: NTS
DWG #: BPC005			
SHEET: 2 OF 7			



BP-GLASS GARAGE DOORS & ENTRY SYSTEMS, INC.  
9412 GIDLEY STREET  
TEMPLE CITY, CA 91780  
PH: (626) 442-1716 FX: (626) 579-5320

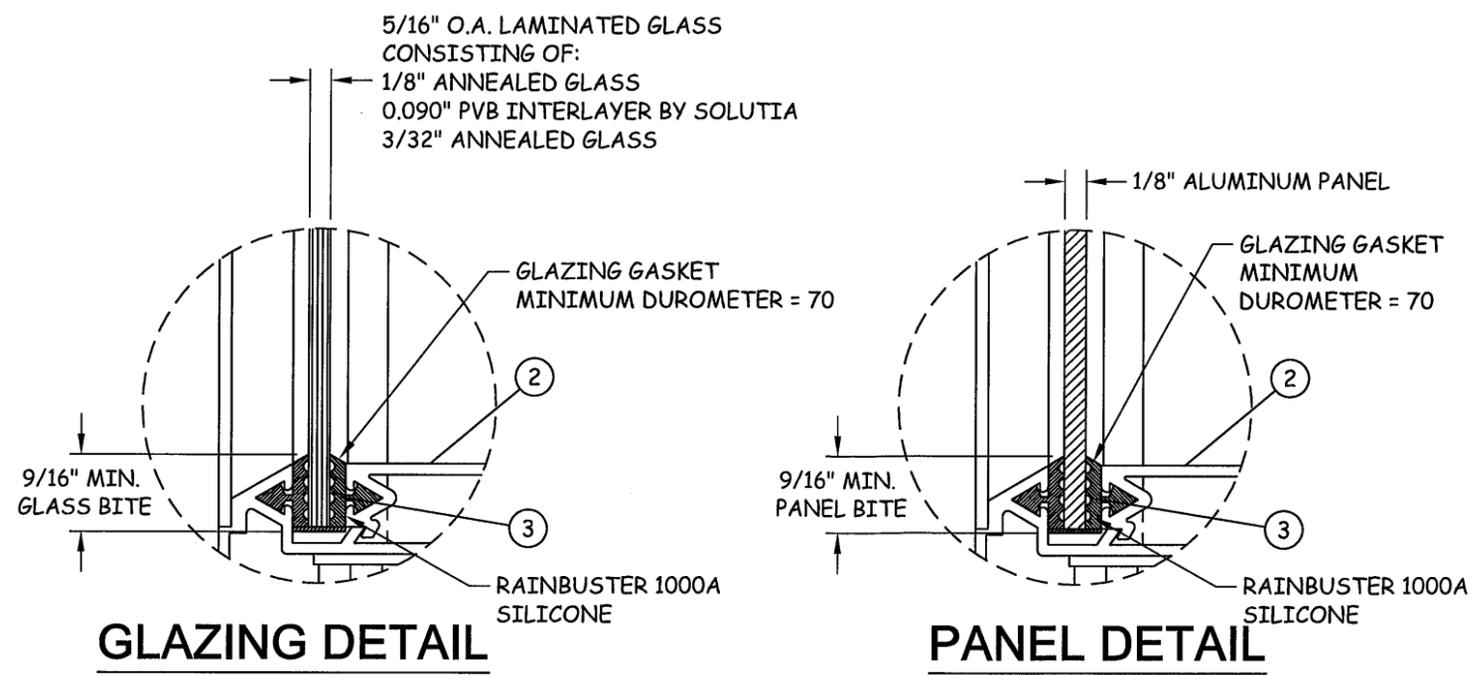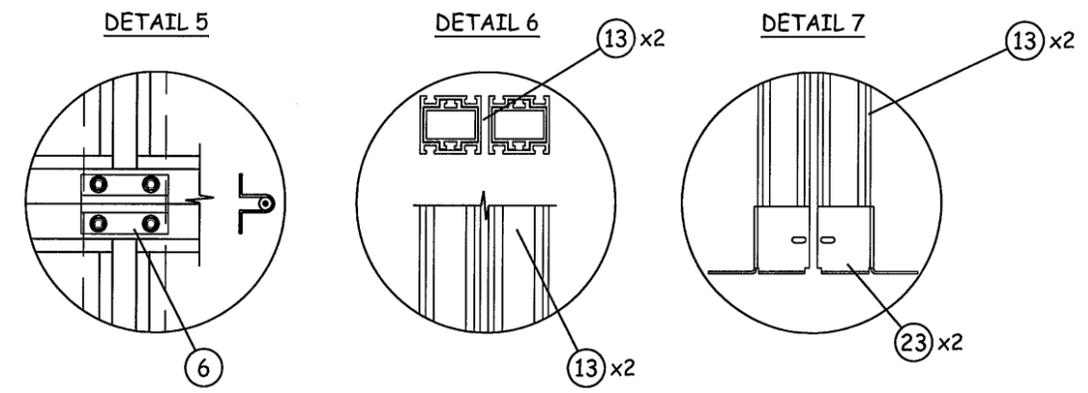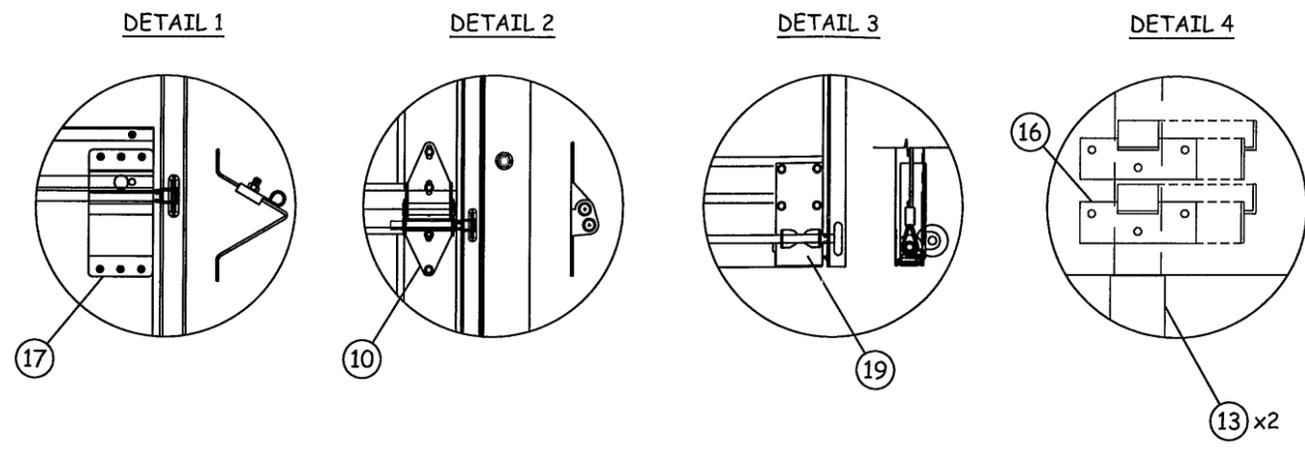

**GLAZING DETAIL**

**PANEL DETAIL**

TITLE: BP-450 HD/BP-550 SHD  
GLASS GARAGE DOOR  
ASSEMBLY DETAILS &  
GLAZING DETAILS

PREPARED BY:  
BUILDING DROPS INC.  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366

**REVISIONS**

NO.	DESCRIPTION	BY	DATE

*[Signature]*  
11-9-2012  
HERMES F. NORERO, P.E.  
FLORIDA P. E. NO. 73773 438  
127 W. FAIRBANKS AVE., STE.  
WINTER PARK, FL 32789  
FBPE CERT. OF AUTHORIZATION NO. 28578


Approved as complying with the  
Florida Building Code  
Date 01/17/2013  
NOA# 12-0620-15  
Miami Dade Product Control  
By *[Signature]*

DATE: 01.13.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS  
DWG #: **BPC005**  
SHEET: **3 OF 7**




BP-GLASS GARAGE DOORS & ENTRY SYSTEMS, INC.  
9412 GIDLEY STREET  
TEMPLE CITY, CA 91780  
PH: (626) 442-1716 FX: (626) 579-5320

TITLE: BP-450 HD/BP-550 SHD GLASS GARAGE DOOR  
VERTICAL & HORIZONTAL SECTIONS  
PREPARED BY:  
BUILDING DROPS INC.  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366

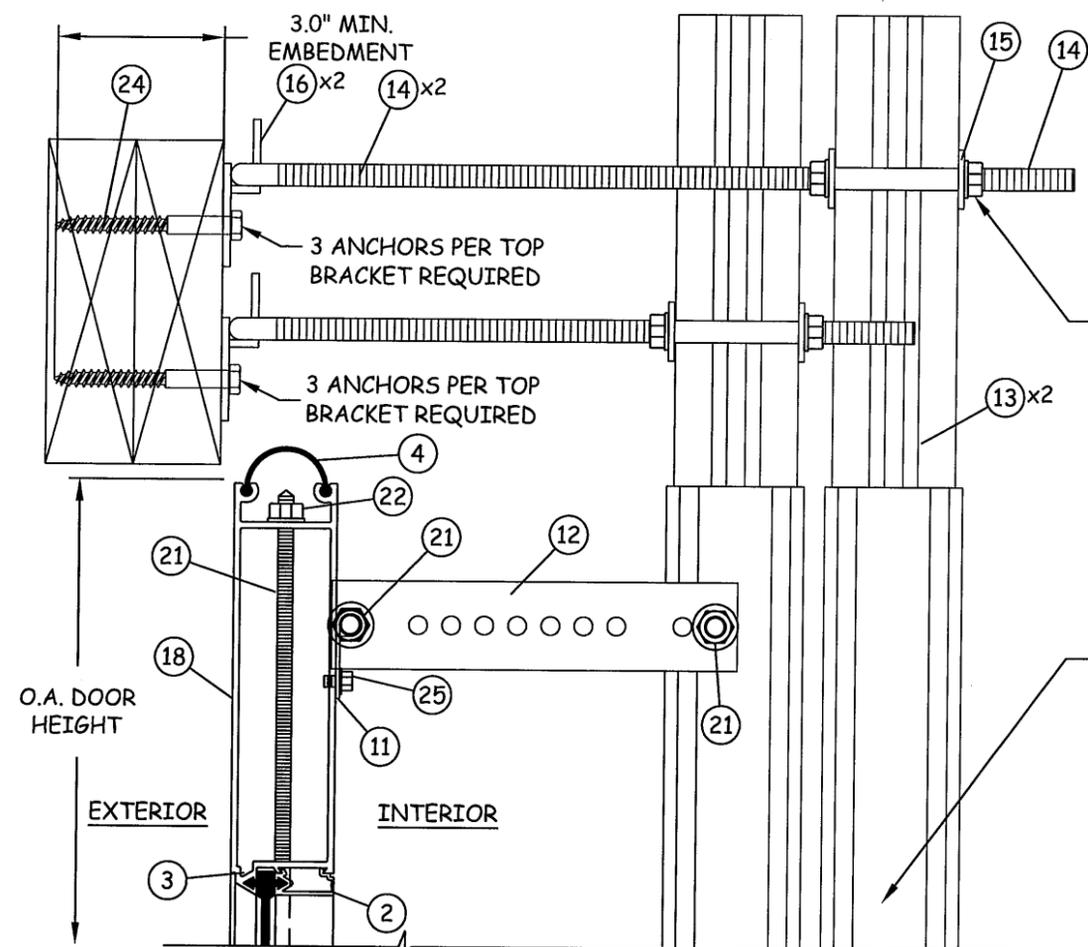


**B**  
4 VERTICAL SECTION  
TOP RAIL

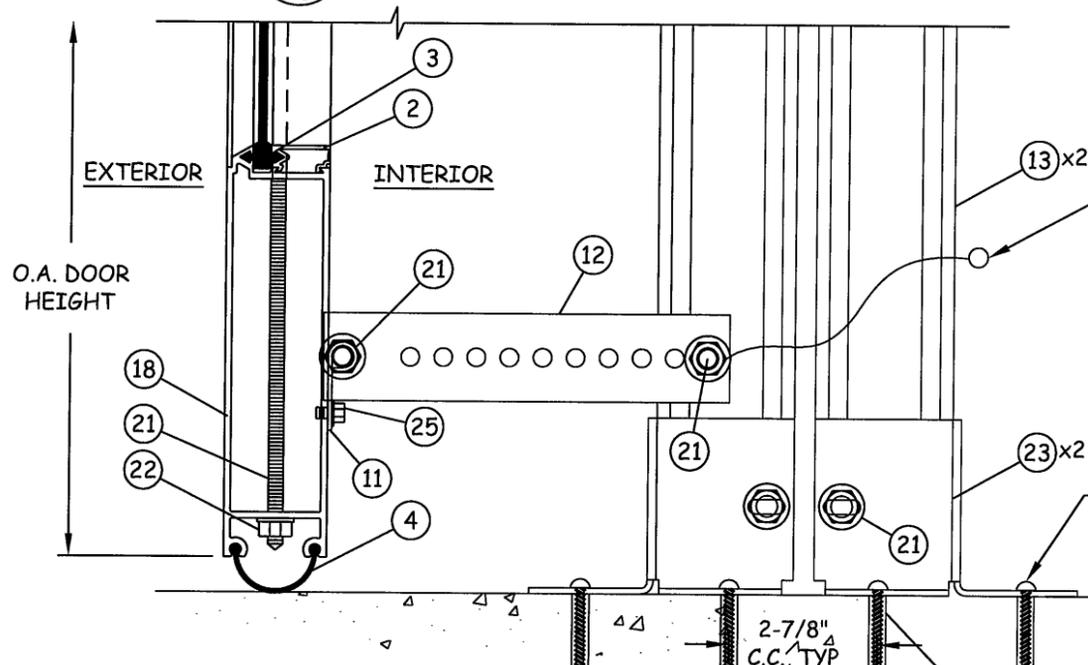


**A**  
4 VERTICAL SECTION  
BOTTOM RAIL

ITEM 21 - THROUGH BOLT WITH WING NUT (SCREW IN FINGER TIGHT AND KEEP ATTACHED TO ITEM 12 DEFLECTION BRACKETS WHEN REMOVABLE REINFORCEMENT IS NOT IN USE)

REFER TO MANUFACTURER'S INSTALLATION MANUAL FOR STEP BY STEP INSTRUCTION DETAILS ON REMOVABLE REINFORCEMENT

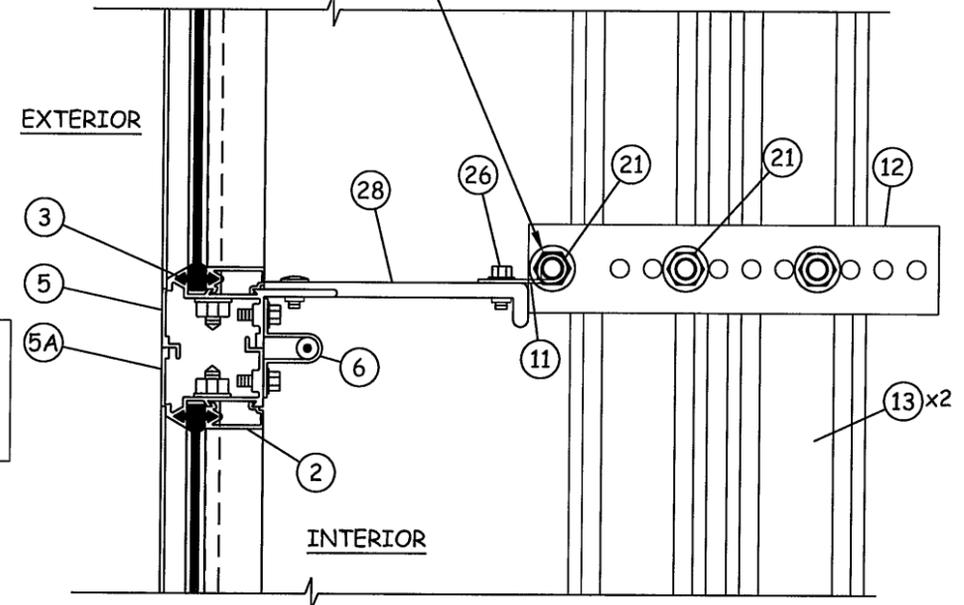

**C**  
4 VERTICAL SECTION  
INTERMEDIATE RAIL

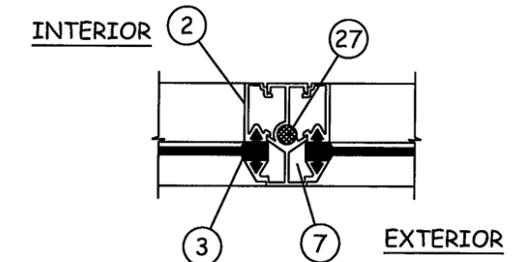

**D**  
4 HORIZONTAL SECTION  
VERTICAL MULLION

REVISIONS

NO.	DESCRIPTION	BY	DATE

Approved as complying with the Florida Building Code  
Date 01/17/2013  
NOA# 12-0620.15  
Miami Dade Product Control  
By *[Signature]*

*[Signature]*  
11-9-2012  
HERMES F. NORERO, P.E.  
FLORIDA B.C. NO. 73776  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
FBPE CERT. OF AUTHORIZATION NO. 29578


DATE: 01.13.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS  
DWG #: BPC005  
SHEET: 4 OF 7




BP-GLASS GARAGE DOORS & ENTRY SYSTEMS, INC.  
9412 GIDLEY STREET  
TEMPLE CITY, CA 91780  
PH: (626) 442-1716 FX: (626) 579-5320

TITLE: BP-450 HD/BP-550 SHD  
GLASS GARAGE DOOR  
HORIZONTAL SECTIONS


PREPARED BY:  
BUILDING DROPS INC.  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366

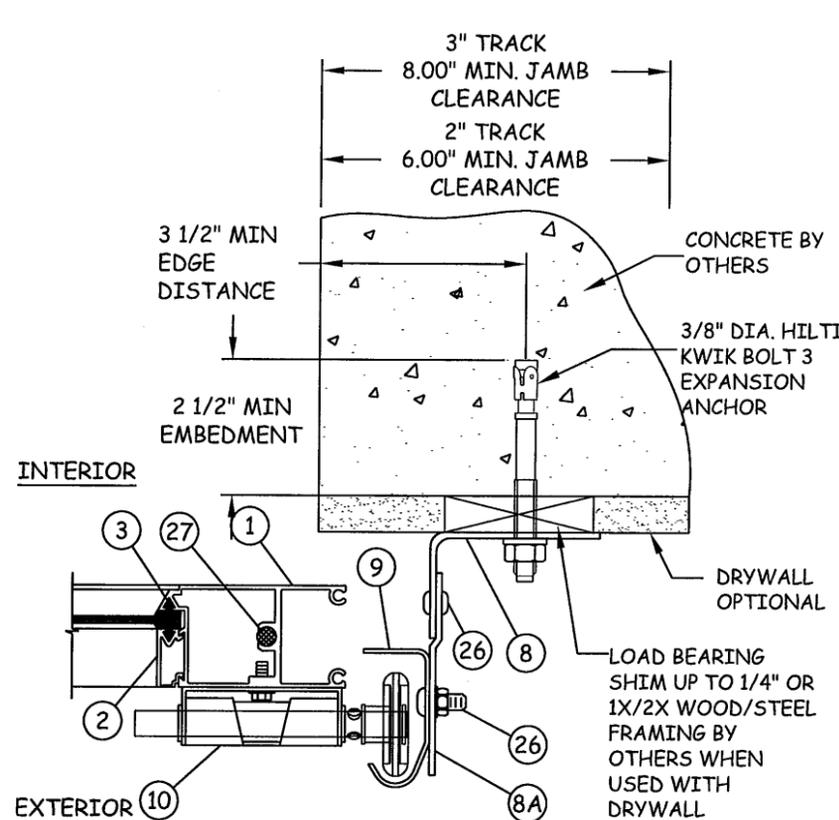


**E** HORIZONTAL SECTION  
**5** JAMBS - DRYWALL OVER CONCRETE ANGLE MOUNTED

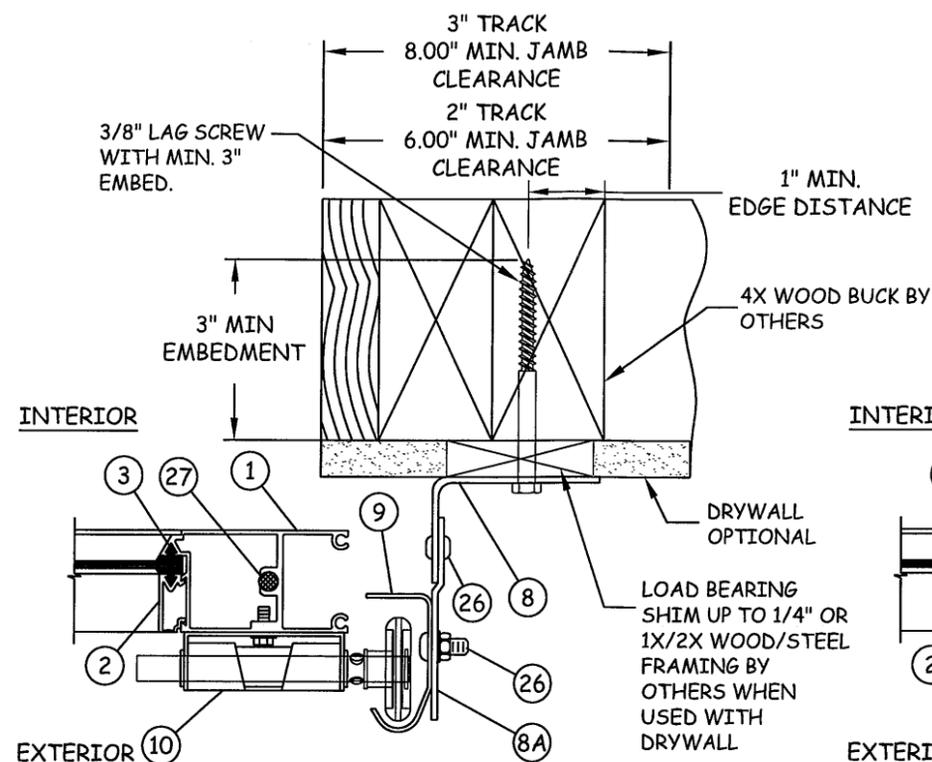


**F** HORIZONTAL SECTION  
**5** JAMBS - DRYWALL OVER 4X WOOD FRAME ANGLE MOUNTED

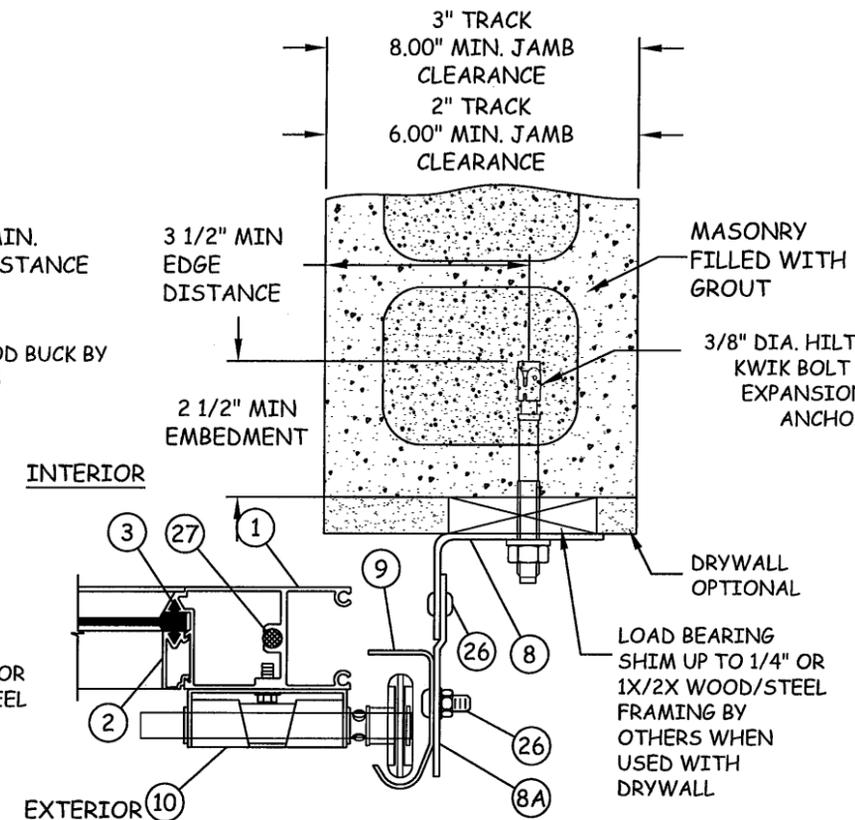

**G** HORIZONTAL SECTION  
**5** JAMBS - DRYWALL OVER CMU ANGLE MOUNTED

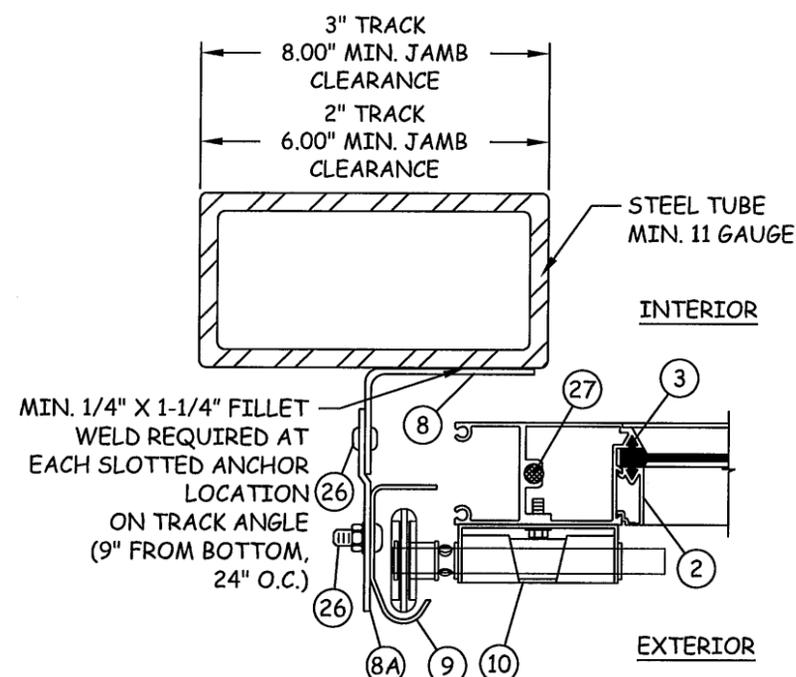

**J** HORIZONTAL SECTION  
**5** JAMBS - STEEL REVERSE ANGLE MOUNTED

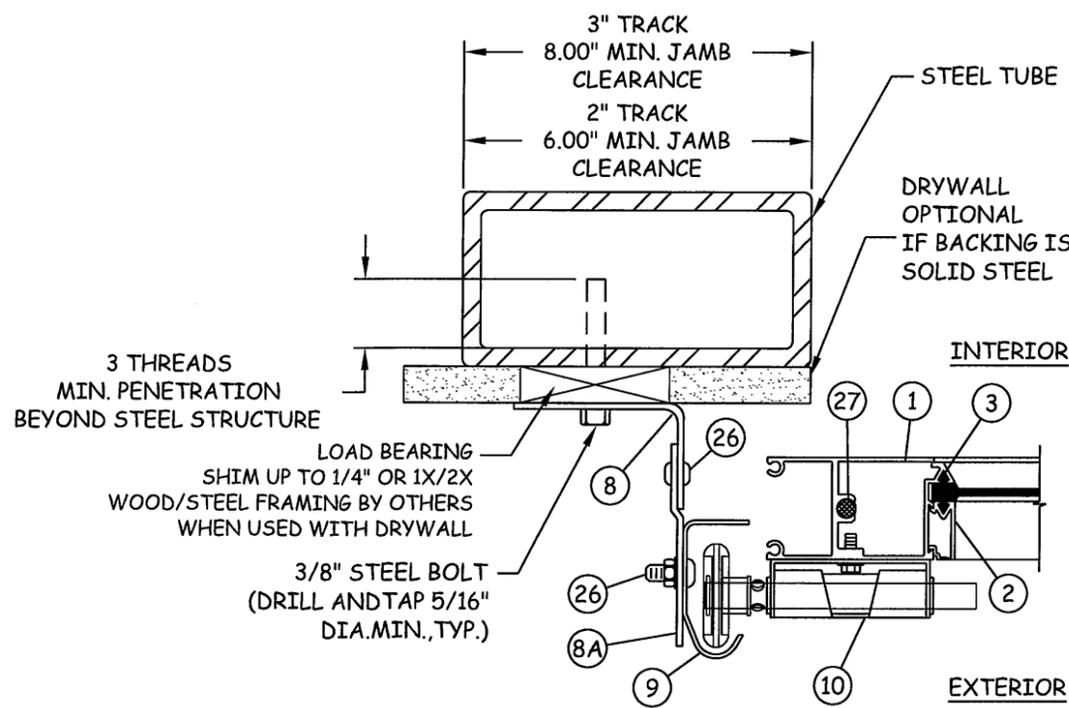

**K** HORIZONTAL SECTION  
**5** JAMBS - STEEL W/ DRYWALL ANGLE MOUNTED

REVISIONS

NO.	DESCRIPTION	BY	DATE








Approved as complying with the Florida Building Code  
Date 01/17/2013  
NOA# 12-0620.15  
Miami Dade Product Control  
By *[Signature]*

11-9-2012  
HERMES F. NORRERO, P.E.  
FLORIDA REG. NO. 73778  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
FPE CERT. OF AUTHORIZATION NO. 29578

DATE: 01.13.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS  
DWG #: BPC005  
SHEET: 5 OF 7

**BILL OF MATERIALS**

ITEM NO.	DESCRIPTION	MATERIAL	MANUFACTURER
1	350 SIDE PANEL FRAME	ALUMINUM	BP GLASS DOORS
2	GLASS STOP	ALUMINUM	BP GLASS DOORS
3	GLAZING GASKET	EPDM	GLS
4	WEATHERSTRIPPING	EPDM	GLS
5	INTERMEDIATE RAIL (TOP)	ALUMINUM	BP GLASS DOORS
5A	INTERMEDIATE RAIL (BOTTOM)	ALUMINUM	BP GLASS DOORS
6	INTERMEDIATE HINGE	0.083" THK. STAINLESS STEEL	BP GLASS DOORS
7	VERTICAL MULLION	ALUMINUM	BP GLASS DOORS
8	ANGLE	12 GA. STEEL	BP GLASS DOORS
8A	ADJUSTABLE TAB	12 GA. STEEL	BP GLASS DOORS
9	TRACK 2"	15 GA. STEEL	BP GLASS DOORS
10	UNIVERSAL HINGES	12 GA. STAINLESS STEEL	BP GLASS DOORS
11	HF-PIN BRACKET	12 GA. STAINLESS STEEL	BP GLASS DOORS
12	DEFLECTION BRACKET	11 GA. G-90 GALV. STEEL	BP GLASS DOORS
13	REMOVABLE REINFORCEMENT	1/8" THK. ALUMINUM	BP GLASS DOORS
14	3/8" U-BOLT & LOCK NUTS	STEEL	BP GLASS DOORS
15	U-BOLT PLATES	12 GA. GALV. STEEL	BP GLASS DOORS
16	TOP BRACKET	1/4" STEEL	BP GLASS DOORS
17	TOP FIXTURE	1/8" THK. STAINLESS STEEL	BP GLASS DOORS
18	550 TOP AND BOTTOM PANEL	ALUMINUM	BP GLASS DOORS
19	BOTTOM FIXTURE	1/8" THK. STAINLESS STEEL	BP GLASS DOORS
20	3/8" DROP IN CONCRETE ANCHOR	STEEL	BP GLASS DOORS
21	1/4" - 20 HEX BOLT & NUTS	STEEL	BP GLASS DOORS
22	1/4" NUT	STEEL	BP GLASS DOORS
23	FLOOR FLANGE	0.134" THK. G-90 GALV. STEEL	BP GLASS DOORS
24	3/8" X 3" LAG BOLT	STEEL	BP GLASS DOORS
25	1/4" X 1/2" SELF THREADING SCREW	STEEL	BP GLASS DOORS
26	1/4" X 1/2" CARRIAGE BOLT	STEEL	BP GLASS DOORS
27	1/4" X 20 GALV. THRU BOLT W/ NUT	STEEL	BP GLASS DOORS
28	REINFORCING STRUT	1/4" THK. ALUMINUM	BP GLASS DOORS

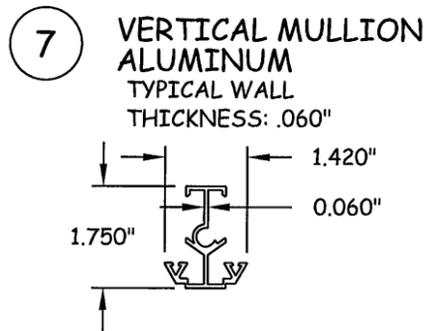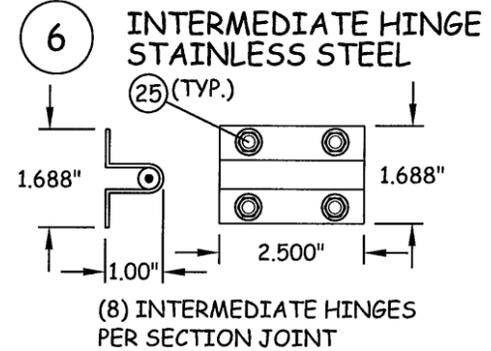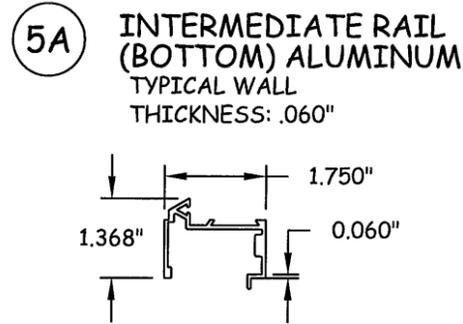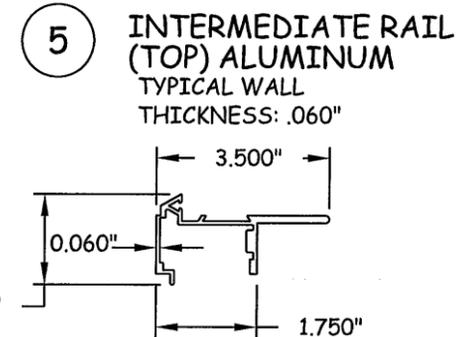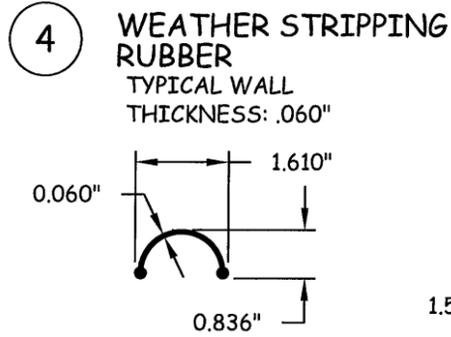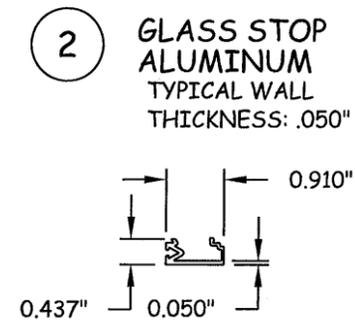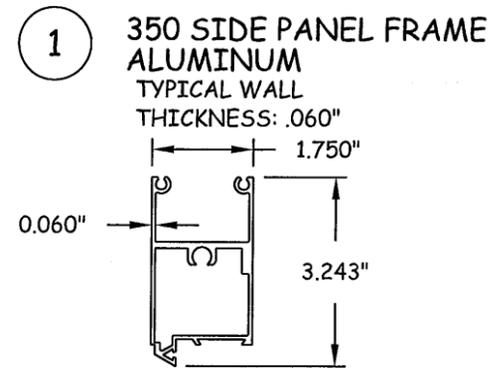

BP-GLASS GARAGE DOORS & ENTRY SYSTEMS, INC.  
9412 GIDLEY STREET  
TEMPLE CITY, CA 91780  
PH: (626) 442-1716 FX: (626) 579-5320

TITLE: BP-450 HD/BP-550 SHD  
GLASS GARAGE DOOR  
COMPONENTS &  
BILL OF MATERIALS

PREPARED BY:  
BUILDING DROPS INC.  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366


















**REVISIONS**

NO.	DESCRIPTION	BY	DATE

*[Signature]*  
11-9-2012  
HERNAN F. NORRERO, P.E.  
FLORIDA P. E. NO. 73379  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
FEBRE CERT. OF AUTHORIZATION NO. 29578

Approved as complying with the Florida Building Code  
Date 01/17/2013  
NOA# 12-0620.15  
Miami Dade Product Control  
By *[Signature]*

DATE: 01.13.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS  
DWG #: BPC005  
SHEET: 6 OF 7

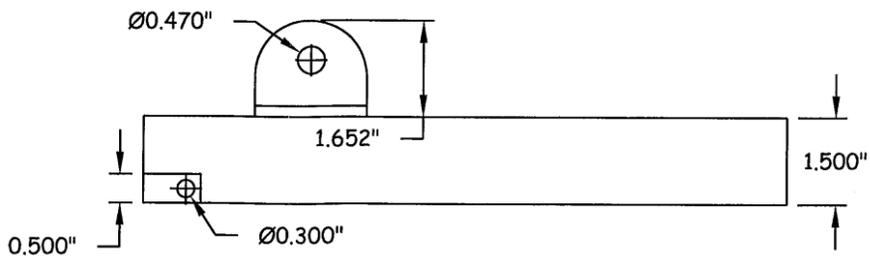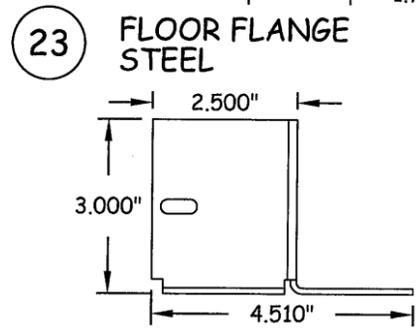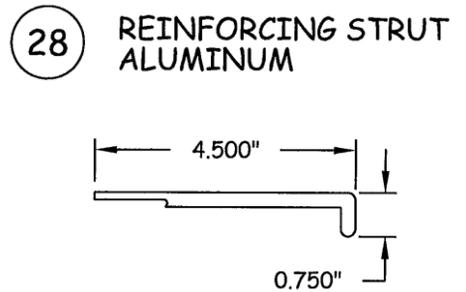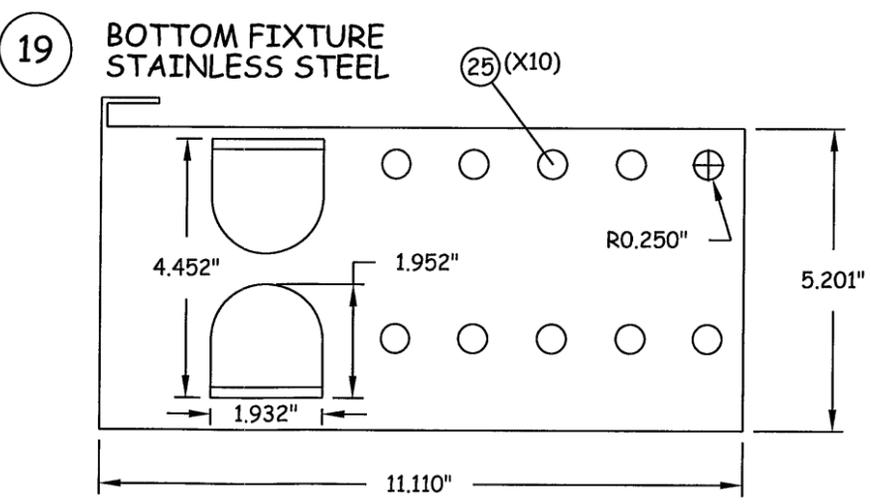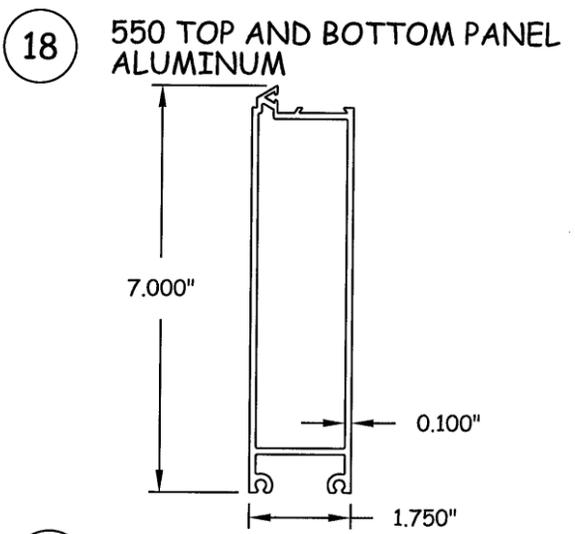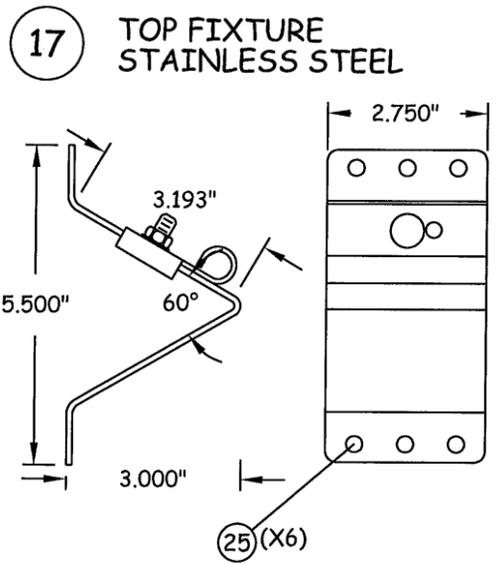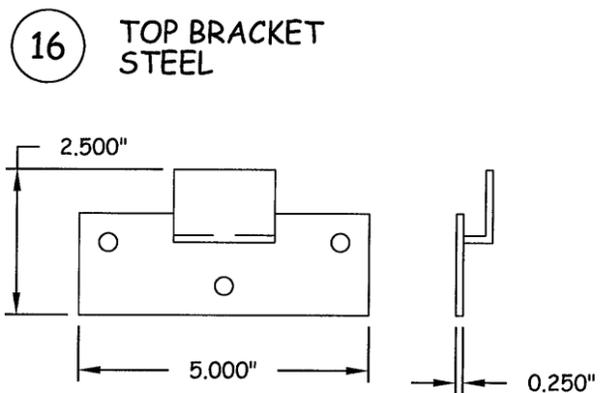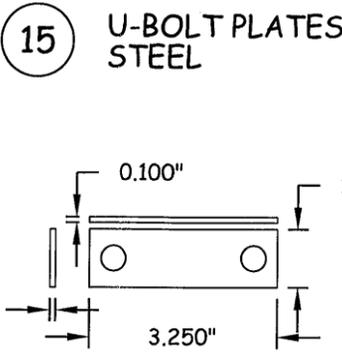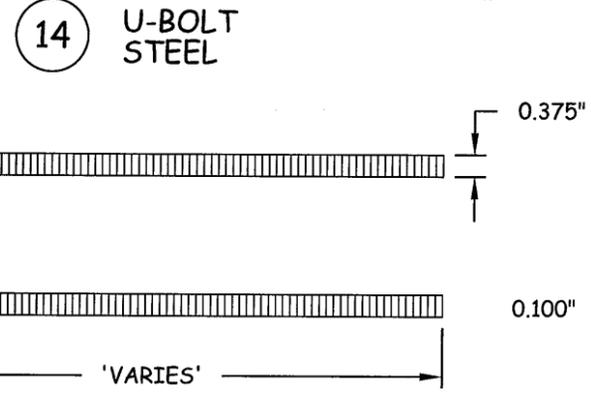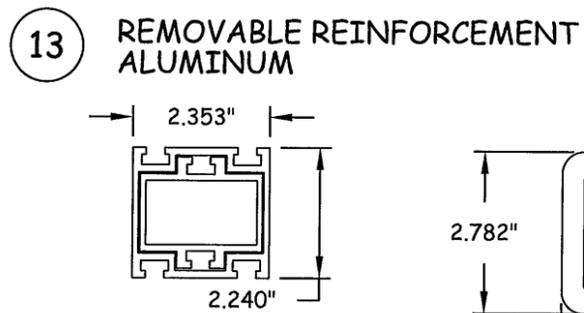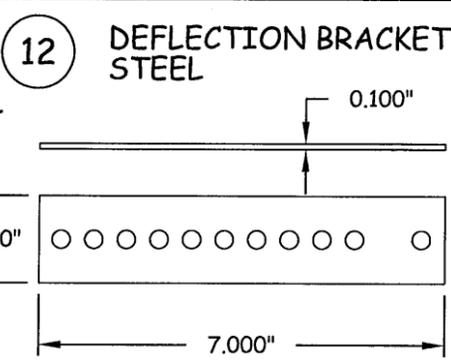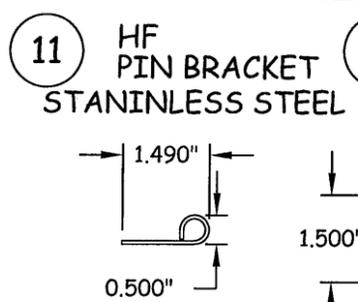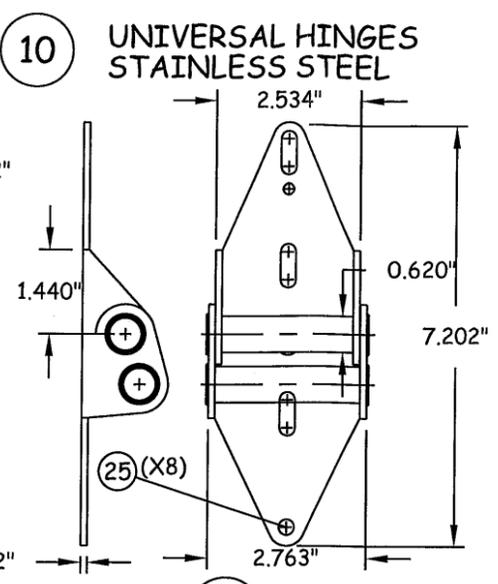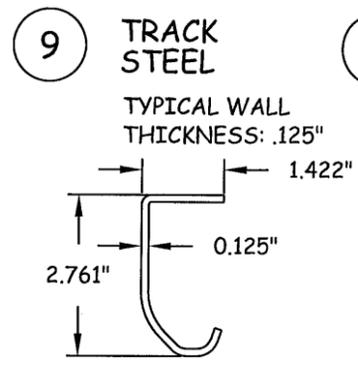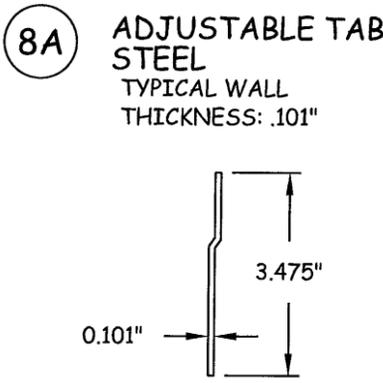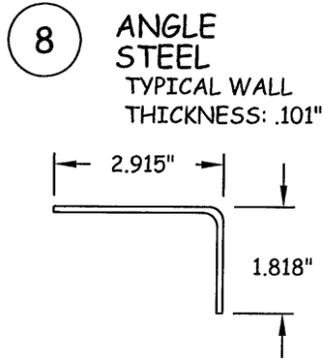

BP-GLASS GARAGE DOORS & ENTRY SYSTEMS, INC.  
9412 GIDLEY STREET  
TEMPLE CITY, CA 91780  
PH: (626) 442-1716 FX: (626) 579-5320

TITLE: BP-450 HD/BP-550 SHD GLASS GARAGE DOOR COMPONENTS  
PREPARED BY:  
BUILDING DROPS INC.  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
PH: (407) 644-6957 FX: (407) 644-2366

REVISIONS	
NO.	DESCRIPTION

*[Signature]*  
1-9-2012  
HERNAN F. NORRIG, P.E.  
FLORIDA P. E. NO. 73778  
127 W. FAIRBANKS AVE., STE. 438  
WINTER PARK, FL 32789  
FBPE CERT. OF AUTHORIZATION NO. 29578

Approved as complying with the Florida Building Code  
Date 01/17/2013  
NOA# 12-10620.15  
Miami Dade Product Control  
By *[Signature]*

DATE: 01.13.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS  
DWG #: **BPC005**  
SHEET: 7 OF 7