



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Trane US, Inc.
1515 Mercer Road
Lexington, KY 40511

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER- Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Trane Performance Climate Changer Air Handler – Size 3-30 Stacked Unit

APPROVAL DOCUMENT: Drawing No. AIRS0705, titled “Trane Performance Climate Changer Air Handler – Size 3-30 Stacked Unit”, sheets 1 through 46 of 46, prepared by Wolters Engineering, Inc., dated September 16, 2013, signed and sealed by Scott Wolters, P.E., on November 25, 2013, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and the approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA #11-0926.08 and consists of this page 1, evidence submitted pages E-1 & E-2 as well as approval document mentioned above.

The submitted documentation was reviewed by Helmy A. Makar, P.E., M.S.



Helmy A. Makar
12/12/2013

NOA No. 12-0629.01
Expiration Date: 01/05/2017
Approval Date: 12/12/2013

Trane US, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 11-0926.08

A. DRAWINGS

1. *Drawing No. H254-0603-11, titled " Performance Climate Change Air Handler Unit Size 3-30 ", sheets 1 through 25 of 25, prepared by Wolters Engineering, last revision #1 dated November 29, 2011, signed and sealed by Scott Wolters, P.E., on December 12, 2011.*

B. TESTS

1. *Test reports on 1) Uniform Static Air Pressure Test, Loading per TAS-202,
2) Large Missile Impact Test per TAS-201,
3) Cyclic Wind Pressure Loading per TAS-203,
along with marked-up drawings and installation diagram of Trane Air Handling, prepared by Hurricane Test Laboratory, LLC, Test Report No. 0254-0506-11, dated 08/24/11, signed and sealed by Vinu J. Abraham, P.E.*

C. CALCULATIONS

1. *Calculation of Trane Custom Air Handling Unit-Size 30, sheets 1 through 13 of 13, prepared by Scott Wolters, P.E., dated 09/23/11, signed and sealed by Scott Wolters, P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Permitting, Environment, and Regulatory Affairs (PERA).*

E. MATERIAL CERTIFICATIONS

1. *Tensile test Report # QCM Job # 11FM-662, prepared by QC Metallurgical, Inc., dated August 22, 2011.*

F. STATEMENTS

1. *Statement letter of conformance with The Florida Building Code 2007 Edition, dated 09/23/11, signed & sealed by Scott Wolters, P.E.*

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS:

1. *Drawing No. AIRS0705, titled "Trane Performance Climate Changer Air Handler – Size 3-30 Stacked Unit", sheets 1 through 46 of 46, prepared by Wolters Engineering, Inc., dated September 16, 2013, signed and sealed by Scott Wolters, P.E., on November 25, 2013.*



Helmy A. Makar, P.E., M.S.
Product Control Unit Supervisor
NOA No. 12-0629.01
Expiration Date: 01/05/2017
Approval Date: 12/12/2013

Trane US, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS:

1. *Test report on Large Missile Impact Test, Cyclic Wind Pressure Test and Uniform Static Air Pressure Test of Trane Performance Climate Changer Air Handler Size 3-30 Stacked Unit, prepared by Hurricane Test Laboratory, Inc., Report No. 0254-0607-11, dated 04/09/2012, signed and sealed by Vinu J. Abraham, P.E.*

C. CALCULATIONS:

1. *Panel and fasteners analysis prepared by Wolters Engineering, Inc., 14 sheets, dated July 23, 2012, signed and sealed by Scott Wolters, P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *Tape properties by Butly.*
2. *Rigid Froth-Foam properties.*
3. *Industrial Polyurethane Adhesive/Sealant properties by Sikaflex.*

F. STATEMENTS

1. *FBC, 2010 conformance letter, dated July 23, 2012, signed and sealed by Scott Wolters, P.E.*



Helmy A. Makar, P.E., M.S.
Product Control Unit Supervisor
NOA No. 12-0629.01
Expiration Date: 01/05/2017
Approval Date: 12/12/2013

GENERAL NOTES, TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 30 STACKED UNIT.

1. THIS PRODUCT, FABRICATED AND ANCHORED AS DETAILED IN THIS DRAWING, IS LARGE MISSILE IMPACT RESISTANT AND DOES NOT REQUIRE THE USE OF IMPACT PROTECTIVE DEVICES. ALLOWABLE UNIT WALL DESIGN PRESSURE IS +/- 75 PSF, AND THE ROOF DESIGN PRESSURE IS +/- 56.25 PSF. THIS PRODUCT APPROVAL IS APPLICABLE TO UNIT SIZES 3 THROUGH 30; THE SIZE 30 IS SHOWN IN THIS APPROVAL.
2. THIS PRODUCT HAS BEEN TESTED TO TAS 201-94, TAS 202-94 STRUCTURAL LOADS, AND TAS 203-94 (REF. TEST REPORT HTL-0254-0506-11), AND MEETS THE HIGH VELOCITY HURRICANE ZONE REQUIREMENTS OF THE FLORIDA BUILDING CODE, 2010 EDITION. THIS PRODUCT IS NOT RATED FOR WATER INFILTRATION RESISTANCE AND HAS NOT BEEN TESTED FOR WIND DRIVEN RAIN. THE TESTED PRODUCT REMAINED OPERABLE AFTER IMPACT/CYCLIC TESTS WERE COMPLETED.
3. THIS PRODUCT APPROVAL IS GENERIC IN NATURE AND DOES NOT PROVIDE INFORMATION FOR SPECIFIC PROJECTS WHERE THE CONDITIONS VARY FROM THIS DOCUMENT. THE FLORIDA LICENSED ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT SHALL BE RESPONSIBLE FOR THE DESIGN, SIZING, AND STRUCTURAL ADEQUACY OF THE PRODUCT FRAMEWORK AS WELL AS CURBING AND ATTACHMENT TO THE ROOF, OR AS ACCEPTED BY THE CORRESPONDING BUILDING DEPARTMENTS.
4. THE STRUCTURAL ADEQUACY OF THE ROOF TO SUPPORT THIS EQUIPMENT IS NOT PART OF THE SCOPE OF THIS PRODUCT APPROVAL AND SHALL BE REVIEWED BY THE CORRESPONDING BUILDING DEPARTMENTS. ANCHORAGE SHOWN HEREIN HAS BEEN ANALYZED FOR SLIDING AND OVERTURNING LOADS FOR THE CONFIGURATION INDICATED, AND SMALLER CONFIGURATIONS ASSUMING THE HEIGHT IS NO MORE THAN TWICE THE WIDTH. OTHER CONFIGURATIONS NOT INDICATED HERE SHALL BE ANALYZED BY THE DESIGN PROFESSIONAL OF RECORD TO PREVENT SLIDING AND OVERTURNING OF THE EQUIPMENT, AND SHALL BE REVIEWED BY THE CORRESPONDING BUILDING DEPARTMENTS. SEE PAGE 40.
5. THIS PRODUCT APPROVAL IS FOR THE STRUCTURAL AND IMPACT/CYCLIC PERFORMANCE OF THE AIR HANDLER, INCLUDING OPTIONAL ENERGY WHEEL AND PIPE CABINET, ENCLOSURES. THESE ENCLOSURES INCLUDE THE OPTIONAL EXTERNALLY MOUNTED COMPONENTS AS SHOWN IN THE DRAWINGS, FOR EXAMPLE HOODS ATTACHED TO AIR INTAKES AND EXHAUST OPENINGS, WINDOWS/VIEWPORTS, AND DOORS, AS WELL AS THE STRUCTURAL ELEMENTS / HOUSINGS FOR MINIHELIC GAUGES, JUNCTION BOXES, UV INTENSITY METERS, DISCONNECT SWITCHES, RACEWAYS, AND GFCI INTERFACES. THIS PRODUCT APPROVAL DOES NOT INCLUDE INTERNALLY MOUNTED COMPONENTS OR ANY ELECTRICAL DEVICES OR CIRCUITRY.
6. THE PRODUCT IS CONSTRUCTED IN BUILD GROUPS. BUILD GROUPS MAY BE ASSEMBLED INTO SHIPPING SECTIONS; ASSEMBLY SHALL BE WITH SPLICE PLATES AS SHOWN HEREIN. BUILD GROUPS OR SHIPPING SECTIONS MAY BE FURTHER ASSEMBLED INTO INSTALLED UNIT; ASSEMBLY SHALL BE WITH THREADED ROD BETWEEN LIFTING LUGS AS SHOWN HEREIN. THE UNITS MAY BE STACKED UP TO TWO HIGH AS SHOWN IN THESE DRAWINGS. IF STACKED, THE UPPER AND LOWER LEVELS SHALL BE THE SAME OVERALL WIDTH AND LENGTH, DIFFERING FOOTPRINTS BETWEEN UPPER AND LOWER LEVEL ARE NOT ALLOWED.
7. OPTIONAL ENERGY WHEEL AND PIPE CABINET (PC) SECTIONS MAY BE ADDED INTO THE ASSEMBLY. IF USED, ASSEMBLY WITH OTHER BUILD UNITS OR SHIPPING SECTIONS SHALL BE WITH THREADED ROD BETWEEN LIFTING LUGS AS SHOWN HEREIN.
8. THE 4/3 ALLOWABLE STRESS INCREASE HAS NOT BEEN USED IN THE ANCHOR ANALYSIS FOR THIS SYSTEM.
9. DISSIMILAR MATERIALS THAT COME INTO CONTACT SHALL BE COATED OR OTHERWISE PROTECTED PER FBC TO PREVENT GALVANIC REACTIONS.
10. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & MAY NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND ALL FINISHES.
11. ACRONYMS USED IN THIS APPROVAL ARE AS FOLLOWS: EOU IS END OF UNIT, DOAF IS DIRECTION OF AIR FLOW, SS IS SHIPPING SPLIT, PC IS PIPE CABINET AND BG IS BUILD GROUP.
12. ALL UNITS OF MEASURE ARE IN INCHES UNLESS OTHERWISE SPECIFIED.
13. 2" MAX. DIAMETER CIRCULAR HOLES MAY BE FIELD DRILLED THROUGH THE EXTERIOR WALLS FOR INSTALLATION OF CONDUIT OR COMPONENTS. HOLES SHALL BE PROTECTED FROM WIND BY CONNECTED EQUIPMENT OR CONDUIT, BY OTHERS, AND PROPER SEALING TO PREVENT AIR EXCHANGE SHALL BE BY OTHERS. HOLES SHALL BE 3" MAX. FROM ANY PANEL EDGE, SEE DETAIL B, SHEET 17. MAX. 4 FIELD-DRILLED HOLES PER PANEL, 12" ON CENTER MINIMUM.

Approved as complying with the
 Florida Building Code
 Date 12/12/2013
 NOA# 12-0629-01
 Miami Dade Product Control
 By *[Signature]*


[Signature]
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	---	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	1 OF 46	SECTION			MOCK UPDWG SHEET REF:	---	SCALE:	NTS	DATE	16-SEP-2013

GENERIC FOAM PANEL CROSS SECTION DETAILS

COMPONENTS	DETAILS ON PAGE
BACK/FRONT HOOD	22-24
ENERGY WHEEL SECTION	30-39
COMPONENTS ON THE DOOR	10
RACEWAY BOX	16-17

CROSS SECTION	REFERENCE PAGE
A-A	6
B-B	5
C-C	7

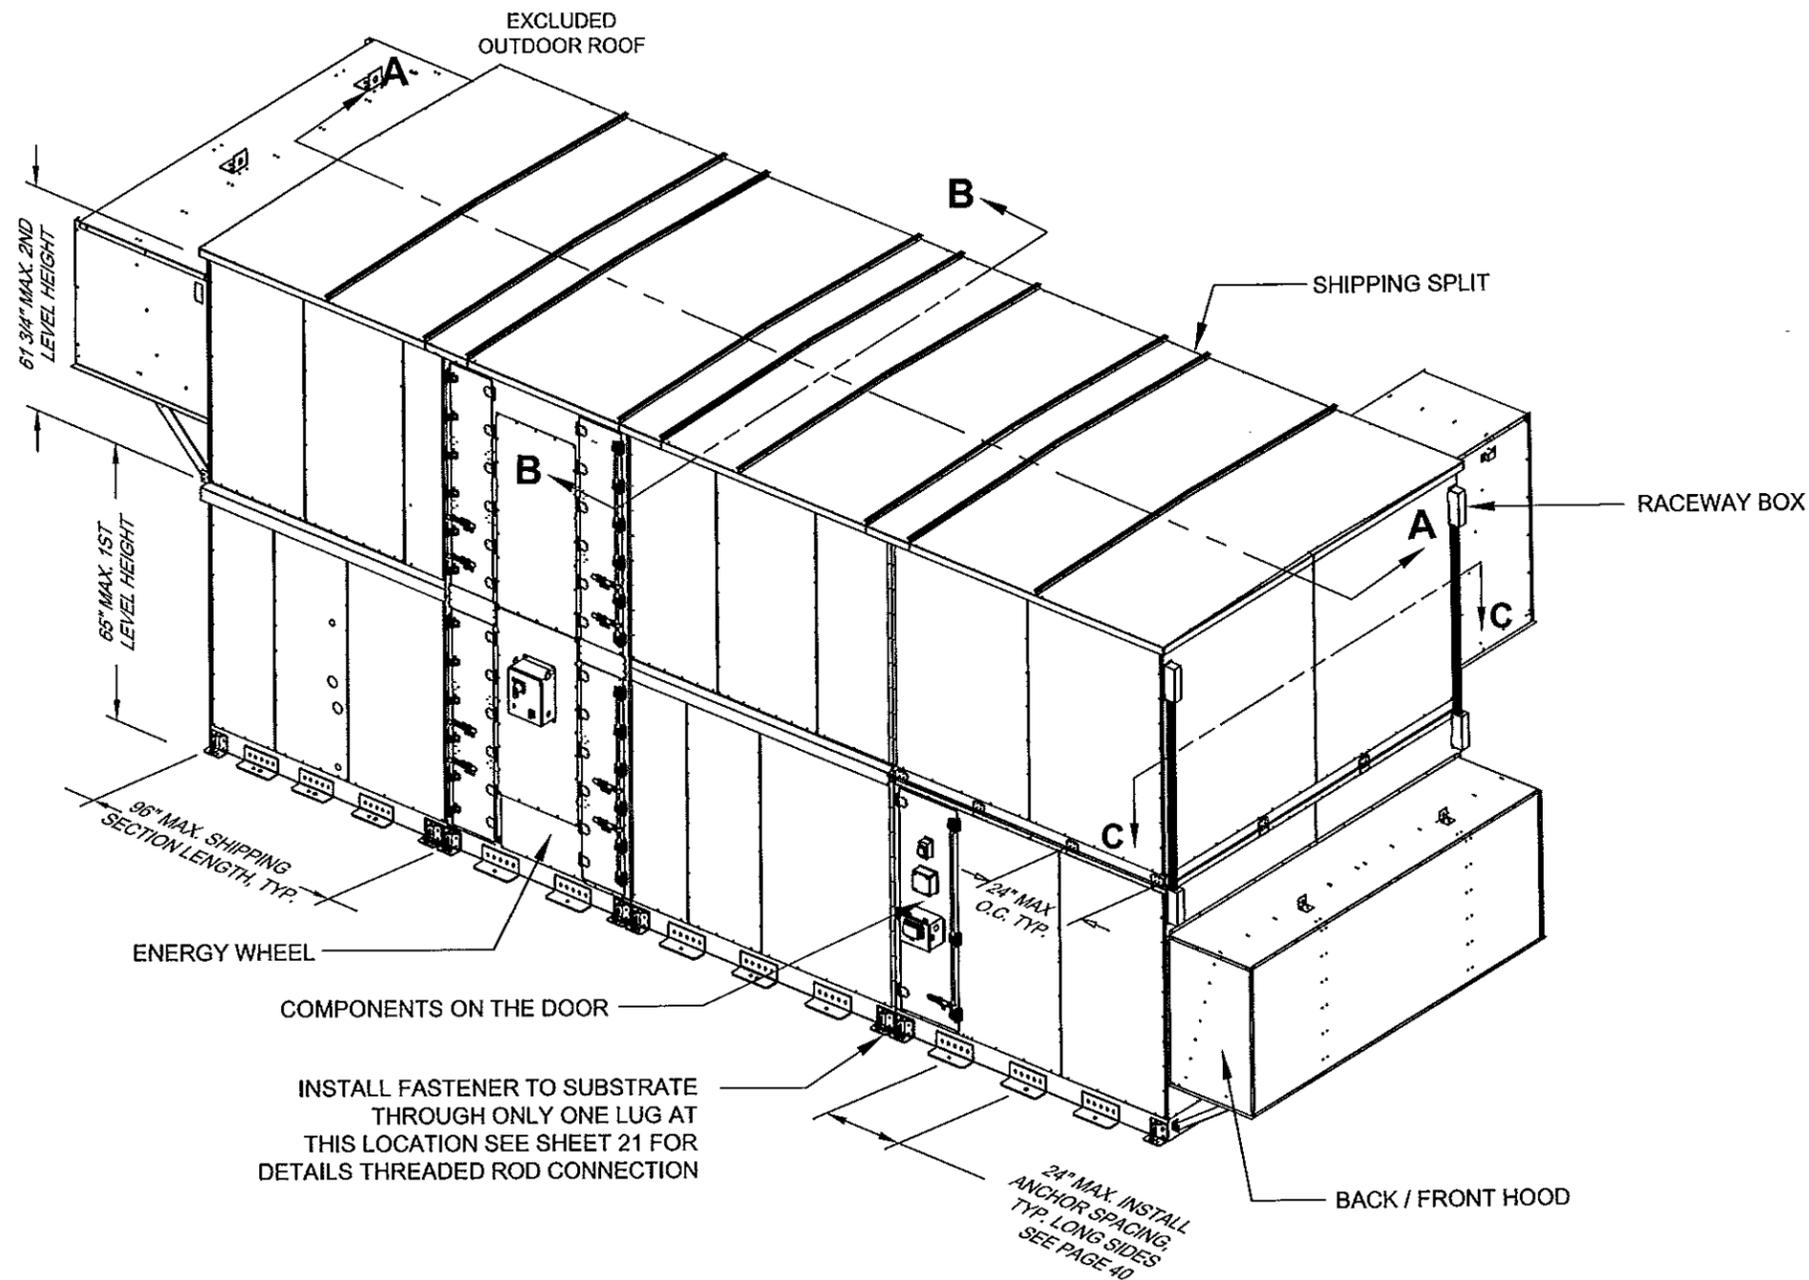

THE LIFTING LUG AND ANCHOR SIDE OF THE UNIT IS REFERED TO AS THE UNIT SIDES.

Approved as complying with the Florida Building Code
 Date 12/12/2013
 NOA#12-0629.01
 Miami Dade Product Control
 By *[Signature]*


[Signature]
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 27 2013

DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	REV. HISTORY	---	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	2 OF 46	SECTION		MOCK UPDWG SHEET REF:	---	SCALE:	NTS	DATE	16-SEP-2013
TRANE US Inc.									

GENERIC FOAM PANEL CROSS SECTION DETAILS

COMPONENTS	DETAILS ON PAGE
PIPE CABINET	25-28
SIDE HOOD	22-24
GAS HEAT INLET HOOD	22-24
GAS HEAT FLUE DUCT	29
JUNCTION BOX	17
PLUG PANEL	14

CROSS SECTION	REFERENCE PAGE
D-D	8
E-E	8

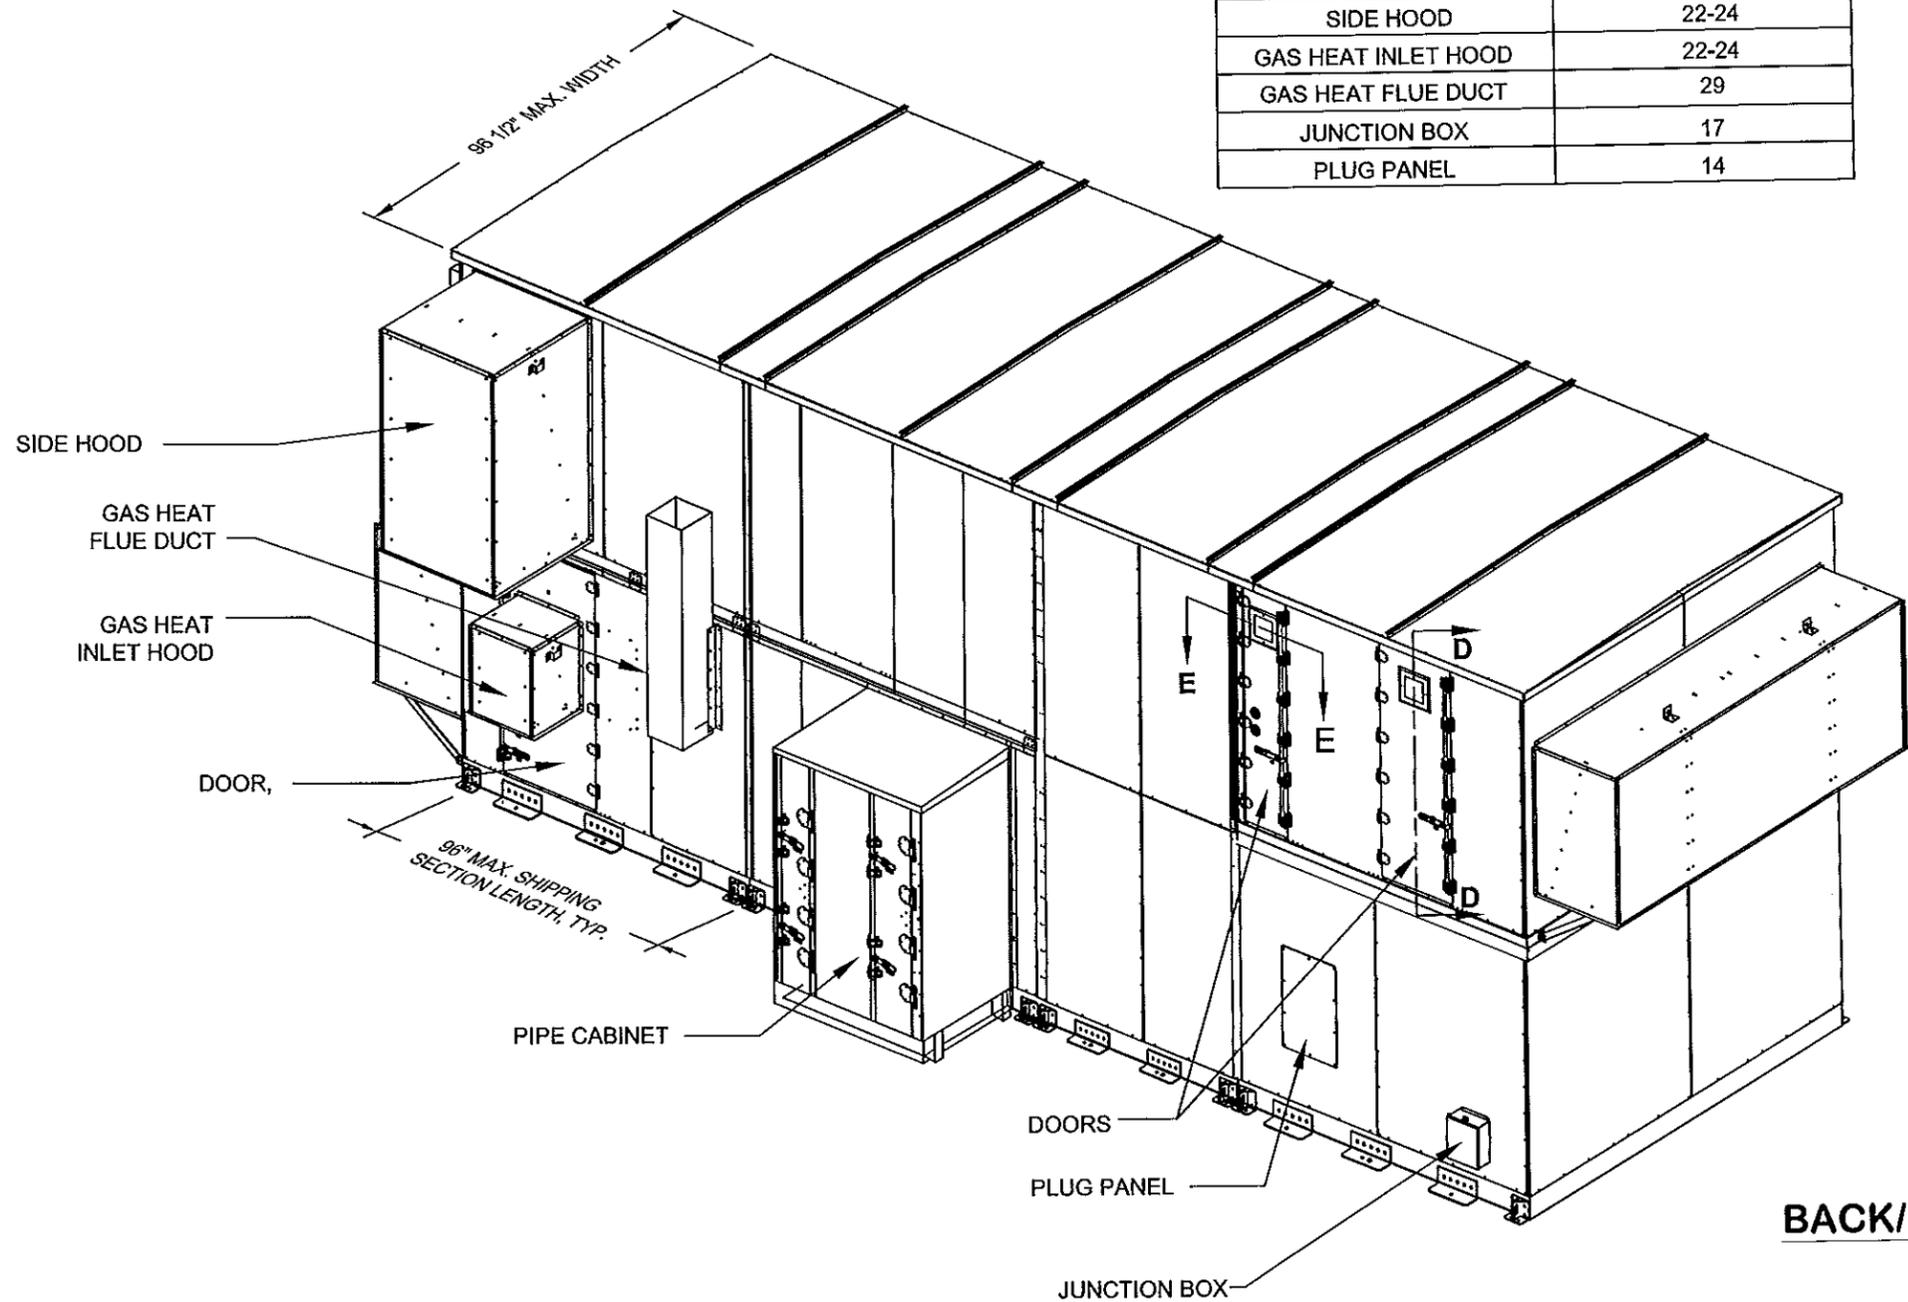

BACK/FRONT VIEW

NOTE:
1. THE LIFTING LUGS ARE ATTACHED TO THE SIDES OF THE UNIT.

Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control

By *[Signature]*

[Signature]
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013

DRAWING # AIRS0705	DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	REV. HISTORY ---	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 3 OF 46	SECTION	MOCK UPDWG SHEET REF: ---	SCALE: NTS	DATE 16-SEP-2013

TRANE
US Inc.

BILL OF MATERIALS		
1	10-16 x .75" SELF-DRILLING SCREW	GRADE 5 STEEL
2	.125" THICK x 2" WIDE TAPE	BUTYL
3	.188 (.06" COMPRESSED) x .625" GASKET	PVC/NBR
4	10-16 x 1.75" SELF-DRILLING SCREW	GRADE 5 STEEL
5	DECORATIVE COVER	GALV. STEEL
6		
7	.120" THICK x 1" WIDE TAPE	BUTYL
8	.375" THICK x .750" WIDE GASKET	PORON
9	HAT CHANNEL	GALV. STEEL
10	DOOR HINGE	GALV. STEEL
11	DOOR CAM BRACKET	GALV. STEEL
12	STRIKER PLATE	GALV. STEEL
13	.06" THICK x .5" WIDE TAPE	BUTYL
14	WINDOW 3/16" PLEXIGLASS 8 3/4" x 8 3/4"	PLEXIGLASS
15	WINDOW FRAME	GALV. STEEL
16	STRUCT. ADHESIVE SIKAFLEX 552	POLYMER
17	1/4"-14 x 3/4" SELF-DRILLING SCREW	GRADE 5 STEEL
18	UV DISCONNECT SWITCH	VARIES
19	INTENSITY MEASUREMENT METER	VARIES
20	GFCI JUNCTION BOX	GALV. STEEL
21	CONDUIT 1" RUNNING THREAD	GALV. STEEL
22	1" CONDUIT NUT	GALV. STEEL
23	1" CONDUIT BUSHING	GALV. STEEL
24	CONDUIT 1/2" RUNNING THREAD	GALV. STEEL
25	1/2" CONDUIT NUT	GALV. STEEL
26	1/2" CONDUIT BUSHING	GALV. STEEL
27	MINIHELIC GAUGE	VARIES
28	4-40 x 1 1/4" PHILLIPS PAN HEAD SCREW	GRADE 5 STEEL
29	ELBOW	GALV. STEEL
30	.06" THICK x 0.38" WIDE TAPE	BUTYL
31	FOAM RETAINER	GALV. STEEL
32	GANGED DOOR HANDLE ASSEMBLY	GALV. STEEL
33	DOOR VIEWER	VARIES
34		
35	PADLOCK BRACKET	GALV. STEEL
36	1/4-20 x 1/4" SET SCREW	GRADE 5 STEEL
37	10-16 x 1/2" SELF-DRILLING SCREW	GRADE 5 STEEL
38	.5" x 2.5" x 2.5" SPECIALTY GASKET	PVB/NBR
39	5/16"-18 x 7/8" SHEET METAL SCREW	GRADE 5 STEEL
40	SECOND LEVEL BASE RAIL	GALV. STEEL
41	STACKED UNIT BRACKET	GALV. STEEL
42	1" (.25" COMPR.) x 4" STACKED UNIT GASKET	PVC/NBR
43	STACKED UNIT SKIRT	GALV. STEEL
44	FIRST LEVEL BASE RAIL	GALV. STEEL
45		
46	FOAM COVER	GALV. STEEL
47	FOAM COVER CORNER	GALV. STEEL
48	MULLION	GALV. STEEL
49	JUNCTION BOX	GALV. STEEL
50	SEALANT, SIKAFLEX 221 CAULK	POLYMER
51	RACEWAY BOX	GALV. STEEL
52	DISCONNECT SWITCH ASSEMBLY	VARIES
53	DISCONNECT SWITCH BLOCKOFF	GALV. STEEL
54	.0325" THICK x 1.88" x 15.88" GASKET	POLYOLEFIN
55	.0325" THICK x 3" x 17" GASKET	POLYOLEFIN
56	DISCONNECT HANDLE KIT	VARIES
57	THREADED ROD 1/2"-13 x 10.5"	GALV. STEEL
58	NUT 1/2"-13 HEX MACHINE	GALV. STEEL
59	WASHER .563" ID x 1.375" OD	GALV. STEEL
60	SCREW 1/2"-13 x 1.2 HEX CAP HEAD	GALV. STEEL
61	LIFTING LUG (1ST LEVEL)	GALV. STEEL
62	0.06" THICK LUG GASKET	PVC/NBR
63	BASE RAIL SPLICE PLATE	GALV. STEEL
64	0.06" THICK PLATE GASKET	PVC/NBR
65	BOLT 5/16"-18 x 6" HEX MACHINE	GALV. STEEL
66	WASHER .375" ID x .875 OD	GALV. STEEL
67	NUT 5/16"-18 HEX FLANGE (HW)	GALV. STEEL
68	LIFTING LUG (2ND LEVEL)	GALV. STEEL
69	ROOF KEEL	GALV. STEEL
70	STRUCT. ADHESIVE SIKAFLEX 3131S	POLYMER
71	ROOF BACKING PLATE	GALV. STEEL
72	.188" (.06" COMPRESSED) x 1.25" GASKET	PVC/NBR
73	DOOR FOOTER	GALV. STEEL
74	SUPPORT MULLION ASSEMBLY	GALV. STEEL
75	BASE SUPPORT CHANNEL / PC BASE L ANGLE	GALV. STEEL
76	DRIP LIP	GALV. STEEL
77	PC SHIPPING BRACKET	GALV. STEEL
78	3/8"-16 x 1 1/4" HEX CAP SCREW	GRADE 5 STEEL
79	3/8"-16 HEX NUT	GRADE 5 STEEL
80	PC BASE RAIL	GALV. STEEL
81	CHAIN GUIDE	GALV. STEEL
82	3/8"-16 x 3" BOLT	GRADE 5 STEEL
83	.03" THICK x 2" WIDE ALUMINUM CLAD TAPE	VARIES
84	UNIT WELD BRACKET	GALV. STEEL
85	INTERNAL WALL SPLICE PLATE	GALV. STEEL
86	PC ROOF ANGLE	GALV. STEEL
87	EXTERNAL WALL SPLICE PLATE	GALV. STEEL
88	1/2"-13 x 1.2" HEX CAP BOLT	GRADE 5
89	Z-BRACKET	GALV. STEEL
90	CROSS BEAM	GALV. STEEL
91	SHIPPING SPLIT SUPPORT ANGLE PTAFF	GALV. STEEL
92	SHIPPING SPLIT VERTICAL CHANNEL	GALV. STEEL
93	SLIP FIT CHANNEL	GALV. STEEL
94	VERTICAL CHANNEL	GALV. STEEL
95	TRANSITION HAT CHANNEL	GALV. STEEL
96	TOP L ANGLE / SEPTUM L ANGLE	GALV. STEEL
97	VERTICAL CHANNEL BRACKET	GALV. STEEL
98	.38" THICK x .35" WIDE ROLL	BUTYL
99	SEAM CAP	GALV. STEEL
100	.38" THICK x 2" WIDE ROLL	BUTYL
101	SEAM CAP	GALV. STEEL
102	ROOF STRIP	GALV. STEEL
103	OVERHANG	GALV. STEEL
104	A-FRAME HORIZONTAL	GALV. STEEL
105	A-FRAME VERTICAL	GALV. STEEL
106	HOOD LIFTING LUG ANGLE	GALV. STEEL
107	HOOD LIFTING LUG HAT	GALV. STEEL
108	HOOD SUPPORT	GALV. STEEL
109	HOOD BRACKET	GALV. STEEL
110	HOOD L-ANGLE	GALV. STEEL
111	HOOD SUPPORT TOP CHANNEL	GALV. STEEL
112	HOOD BACKING PLATE	GALV. STEEL
113	WALL ANCHOR	GALV. STEEL
114	DOUBLE SIDED TAPE 1/16 (COMPR.) x 3/4 x 216	PVC/NBR
115	PC ROOF KEEL	ALUMINUM 6063-T6
116	KEEPER/DOOR CAM	ZAMAK#3
117	DOOR CAM BRACKET	STEEL 0.060
118	CROSS BEAM BRACKET	GALV. STEEL
119	EOU WALL SUPPORT CHANNEL	GALV. STEEL
120	FLUE DUCT L ANGLE	GALV. STEEL
121	SHIP SPLIT SPLICE PLATE	GALV. STEEL
122	ROOF BACKING PLATE	GALV. STEEL
123	NEW DOOR HEADER - NEW STYLE	GALV. STEEL
124	FLAT BACKING PLATE	GALV. STEEL
125	BOTTOM SMALL ANGLE	GALV. STEEL
126	BOTTOM CAP	STAINLESS STEEL
127	FLUE DUCT	STAINLESS STEEL
128		
129		
130	0.125 X 5/16" RIVETS	STAINLESS STEEL
131	CASSETTE TRACK VERTICAL	STAINLESS STEEL
132	BOLT; 1/2-13 X 1 1/4 CARRIAGE	STAINLESS STEEL
133	DOOR HEADER - OLDER STYLE	GALV. STEEL
134	CORNER SEAM CAP	GALV. STEEL
135	UV VIEW PORT	GALV. STEEL
136	DOAF ROOF SUPPORT CHANNEL	GALV. STEEL
137	HAT CHANNEL BRACKET	GALV. STEEL
138	COLUMN SPACER	GALV. STEEL
139	TRACK SUPPORT DOAF	GALV. STEEL
140	HORIZONTAL SUPPORT CHANNEL	GALV. STEEL
141	CASSETTE TRACK	GALV. STEEL
142	TOP CASSETTE TRACK	GALV. STEEL
143	CASSETTE/SEPTUM L ANGLE	GALV. STEEL
144	PC LIFTING LUG	GALV. STEEL
145	DOAF BASE SUPPORT CHANNEL	GALV. STEEL
146		
147	CORNER BLOCK SECOND LEVEL	GALV. STEEL
148	CORNER BLOCK FIRST LEVEL	GALV. STEEL
149	DOOR TUBE	STEEL

NOTE: PVC/NBR IN BOM TO THE LEFT INDICATES POLYVINYL CHLORIDE / ACRYLONITRILE BUTADIENE RUBBER, SINGLE-SIDED EXCEPT ITEM 114.

Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA#12-0629-01
Miami Dade Product Control




By *[Signature]*

[Signature]
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013




DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	---	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	4 OF 46	SECTION			MOCK UPDWG SHEET REF:	---	SCALE:	NTS	DATE	16-SEP-2013

TYPICAL STACKED UNIT FOAMED PANEL JOINTS AND CROSS SECTIONS
(SUPPORT STRUCTURE IS NOT SHOWN FOR CLARITY.)

(REFER TO PAGES 11-20 FOR SUPPORT DETAILS)

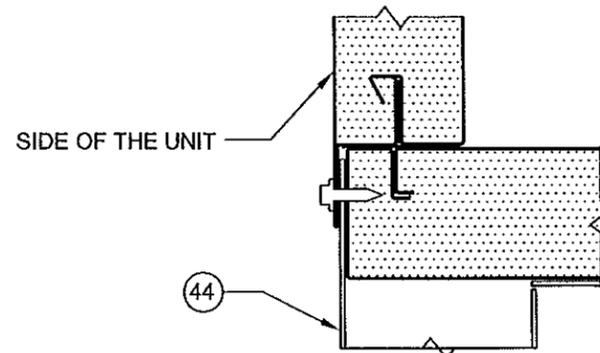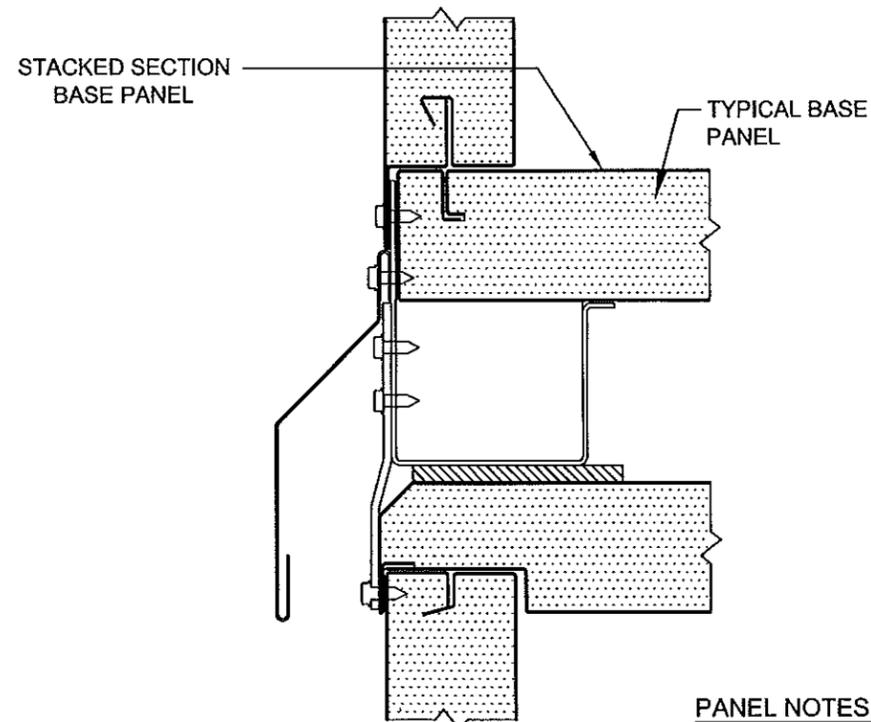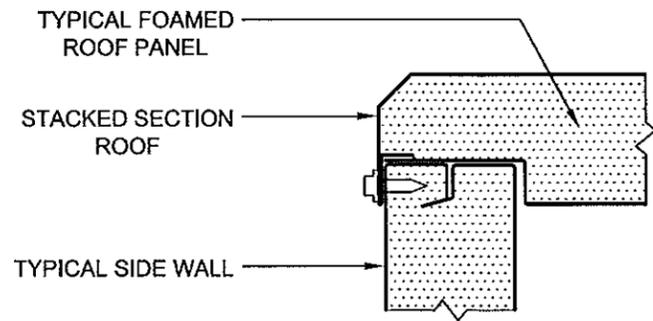

STACKED SECTION

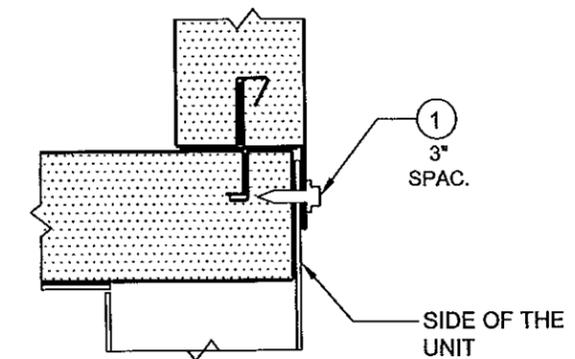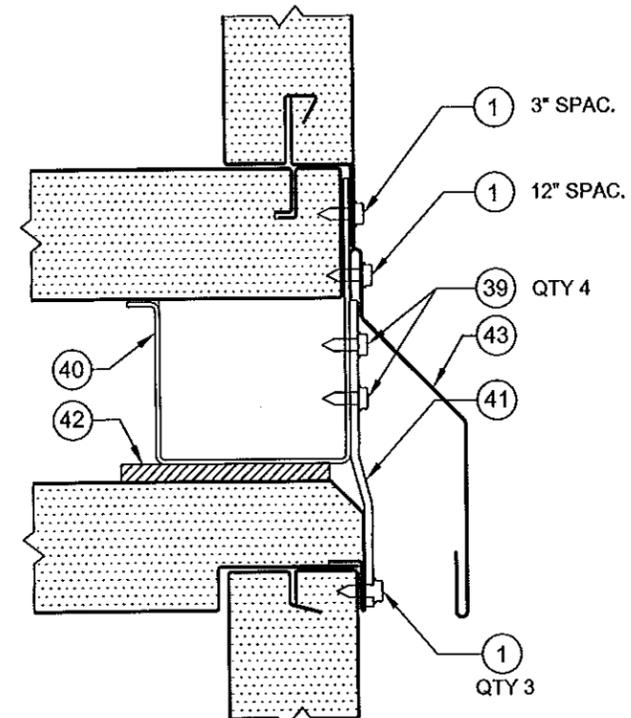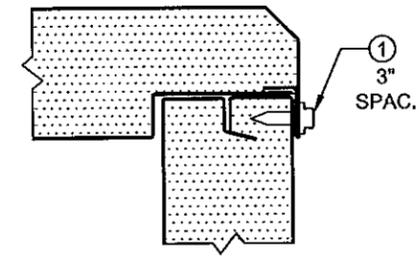

PANEL NOTES:

1. OVERALL PANEL THICKNESS IS 2".
2. CORE MATERIAL IS RIGID FROTH-FOAM INSULATION.
3. INNER AND OUTER CASING PANEL SKINS ARE 0.028" GALVANIZED STEEL.
4. GASKET ITEM 3 IS PLACED AS A THERMAL BREAK BETWEEN ALL INNER AND OUTER CASING PANELS.

CROSS SECTION B-B

Approved as complying with the
 Florida Building Code
 Date 12/12/2013
 NOA# 12-0629.01
 Miami Dade Product Control
 By *Handwritten Signature*

Handwritten Signature
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 5 OF 46	SECTION			MOCK UP/DWG SHEET REF: 25, 26, 29, 35, 36 OF 63	SCALE: NTS	DATE 16-SEP-2013

TYPICAL STACKED UNIT FOAMED PANEL JOINTS AND CROSS SECTIONS
(SUPPORT STRUCTURE IS NOT SHOWN FOR CLARITY)

(REFER TO PAGES 11-20 FOR SUPPORT DETAILS)


STACKED SECTION
ROOF
(Typ. Foamed Roof)

TYPICAL SIDE WALL


STACKED SECTION
BASE PANEL
(Typ. Foamed Base)

FRONT OR BACK
OF THE UNIT


44

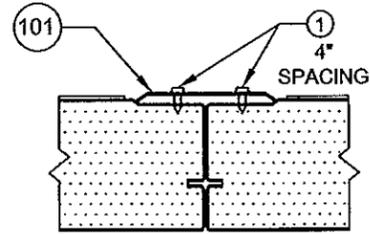

TYP. ROOF JOINT AT SHIPPING SPLIT



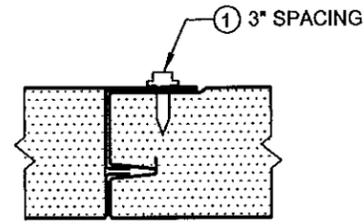


TYP. ROOF PANEL JOIN

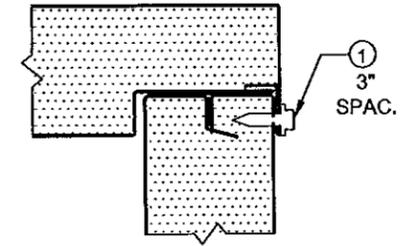


1
3" SPAC.

TYP. BASE JOINT AT SHIPPING SPLIT

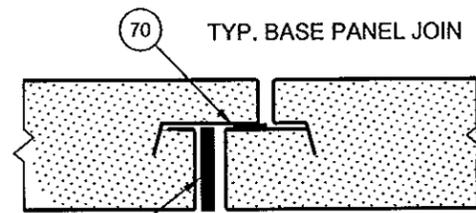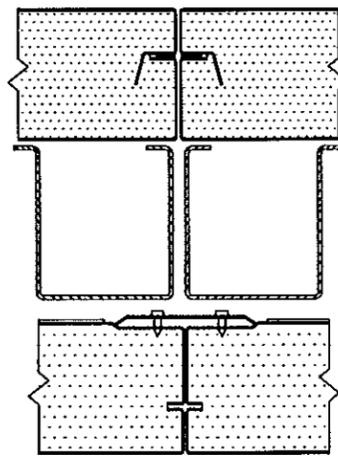

1
3" SPACING

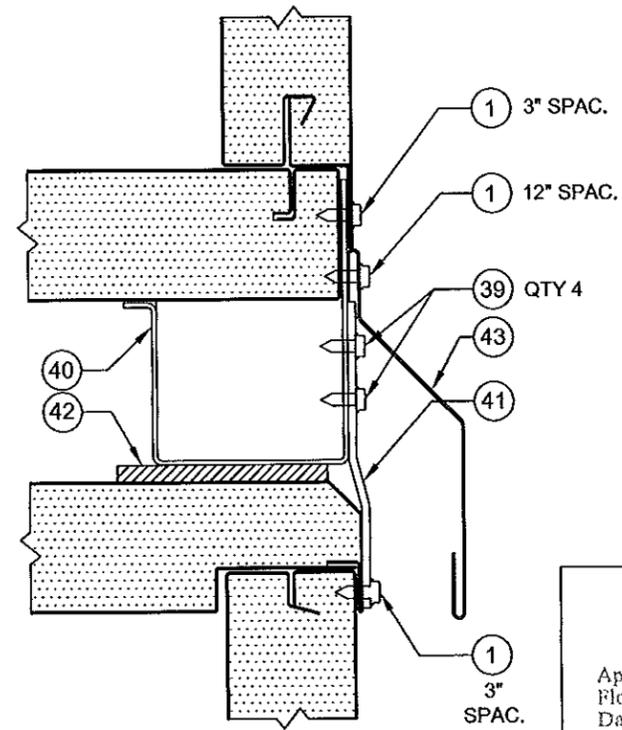

1
3" SPAC.

1
12" SPAC.

39 QTY 4




43

41

1
3" SPAC.

PANEL NOTES:

1. OVERALL PANEL THICKNESS IS 2"
2. CORE MATERIAL IS RIGID FROTH-FOAM INSULATION
3. INNER AND OUTER CASING PANEL SKINS ARE 0.028" GALVANIZED STEEL
4. GASKET ITME 3 IS PLACED AS A THERMAL BREAK BETWEEN ALL INNER AND OUTER CASING PANELS

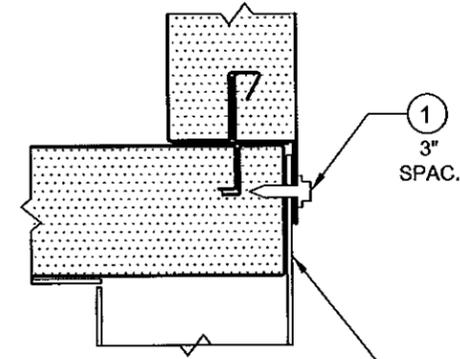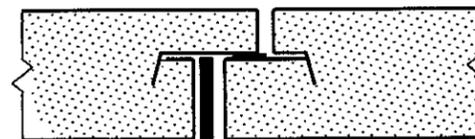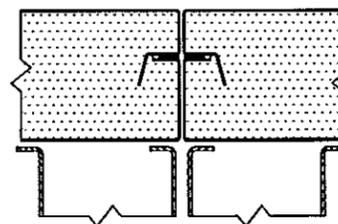

1
3" SPAC.

FRONT OR BACK
OF THE UNIT

CROSS SECTION A-A

Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629-01
Miami Dade Product Control

By *Scott Walters*



Scott Walters
SCOTT WALTERS
FL PE# 62354
WALTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312

NOV 25 2013

DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	---	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	6 OF 46	SECTION			MOCK UPDWG SHEET REF:	25, 26, 29, 35, 36 OF 63	SCALE:	NTS	DATE	16-SEP-2013


TYPICAL UNIT CROSS SECTIONS OF FOAMED PANEL AND UNIT SPLIT JOINTS
(SUPPORT STRUCTURE IS NOT SHOWN FOR CLARITY)

(REFER TO PAGES 11-20 FOR SUPPORT DETAILS)

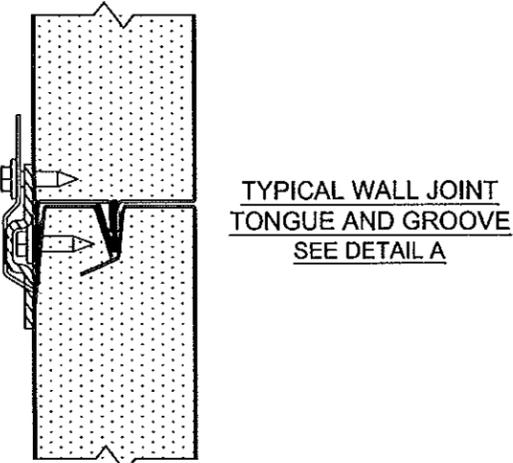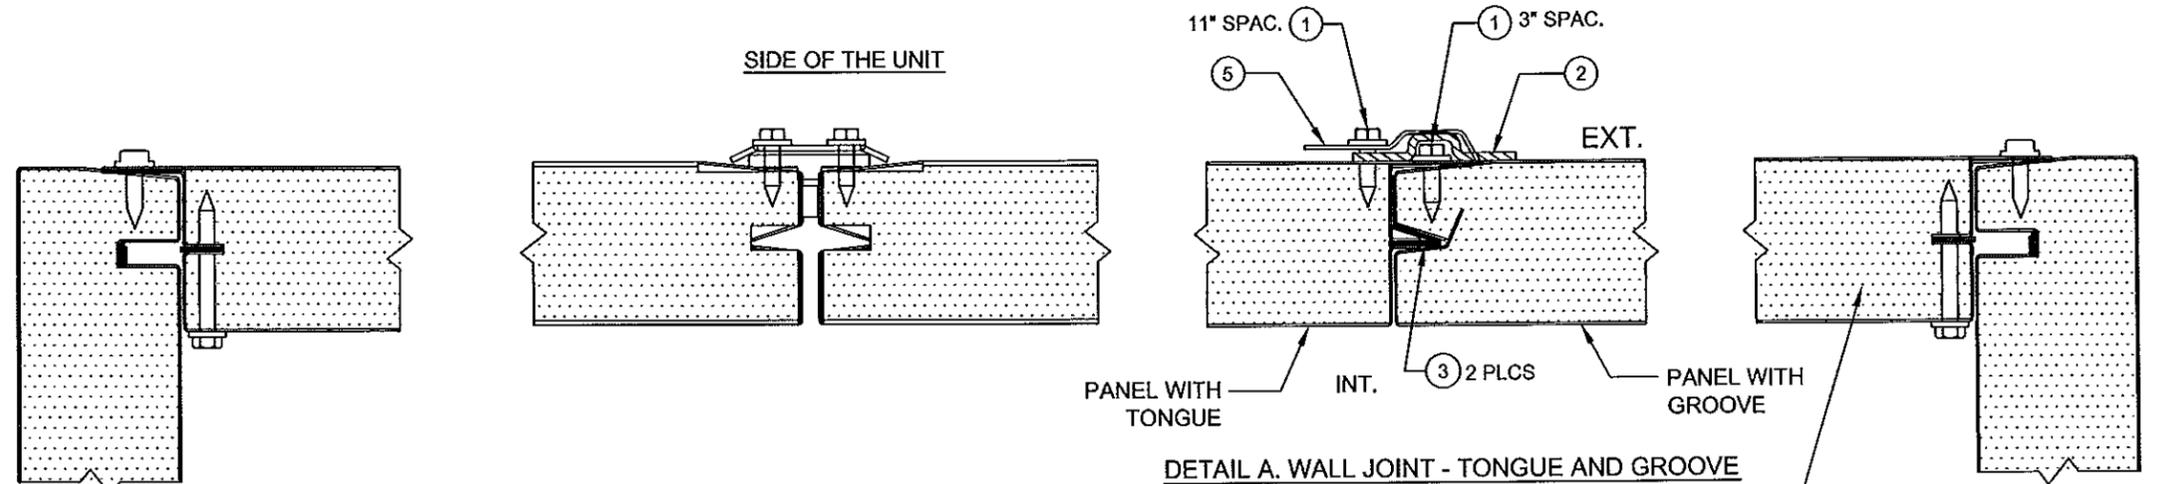

NOTES:
 1. DOOR CROSS SECTION SHOWN ON PAGE 8.
 2. PLUG PANEL CROSS SECTION SHOWN ON PAGE 14.

CROSS SECTION C-C

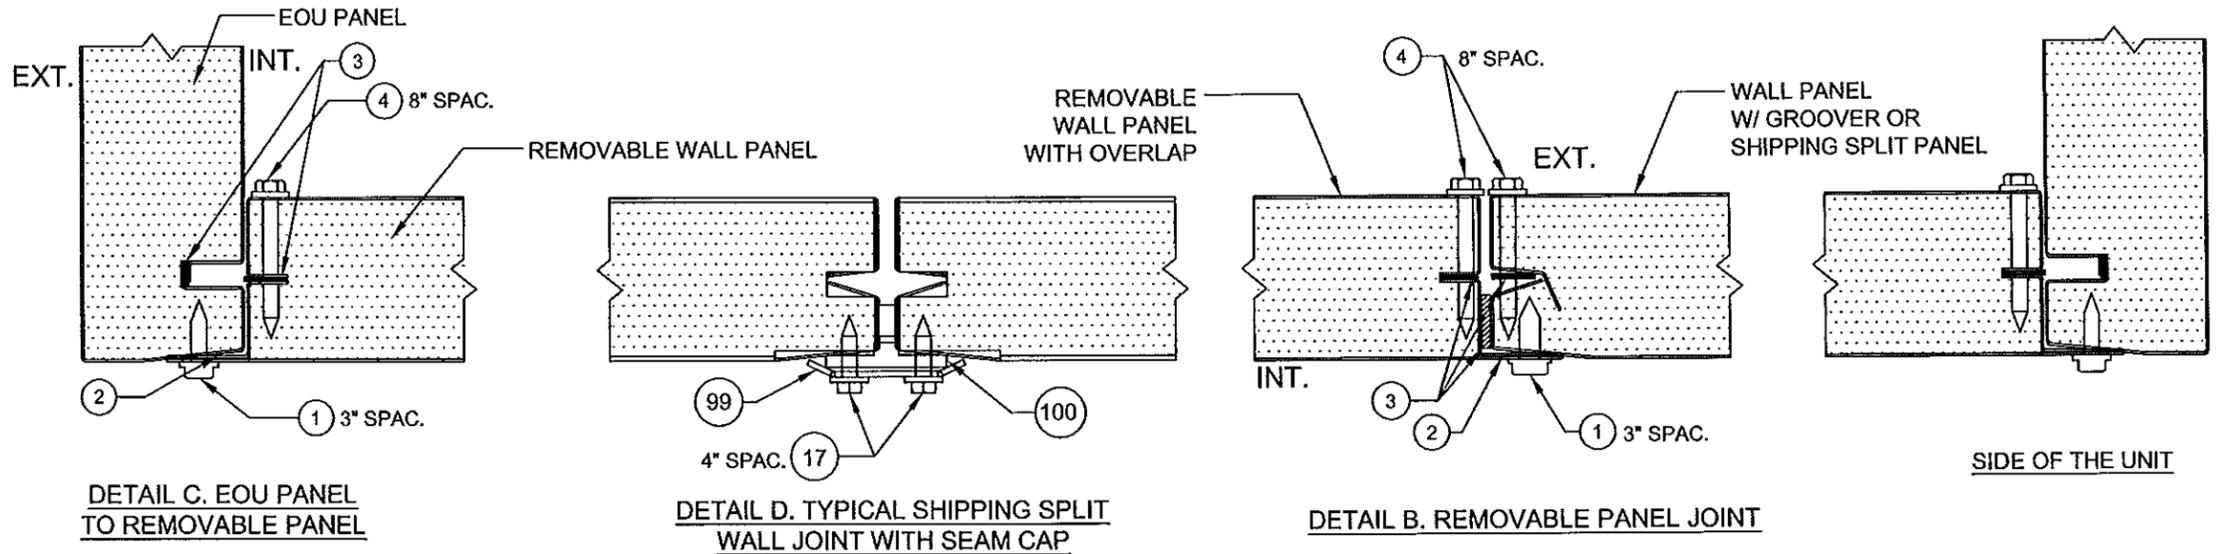




Approved as complying with the
 Florida Building Code
 Date 12/12/2013
 NOA# 12-0629.01
 Miami Dade Product Control
 By *[Signature]*

[Signature]
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 23 2013

DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	---	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	7 OF 46	SECTION			MOCK UPDWG SHEET REF:	7, 13, 20, 34 OF 63	SCALE:	NTS	DATE	16-SEP-2013

DOOR CROSS SECTION E-E


SEE PANEL NOTES SHEET 5

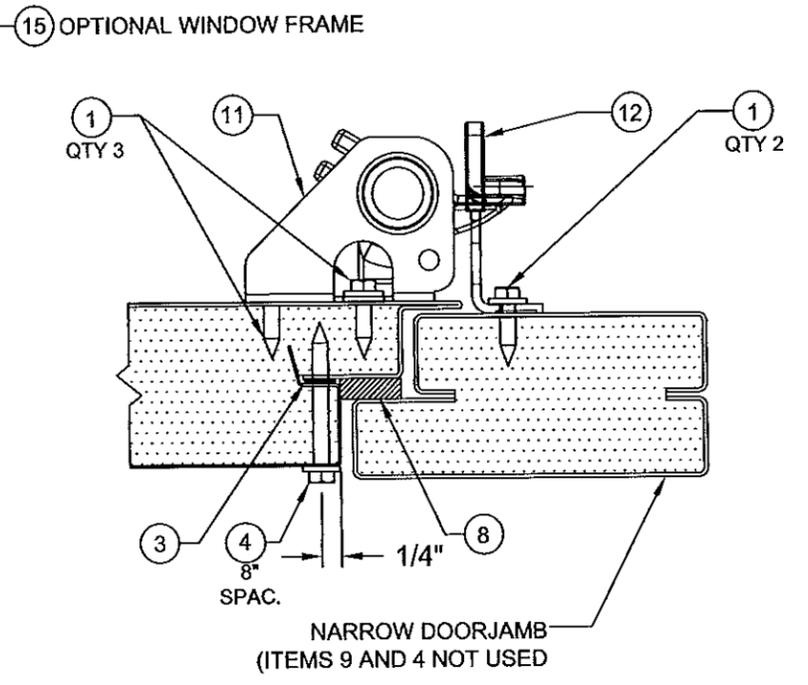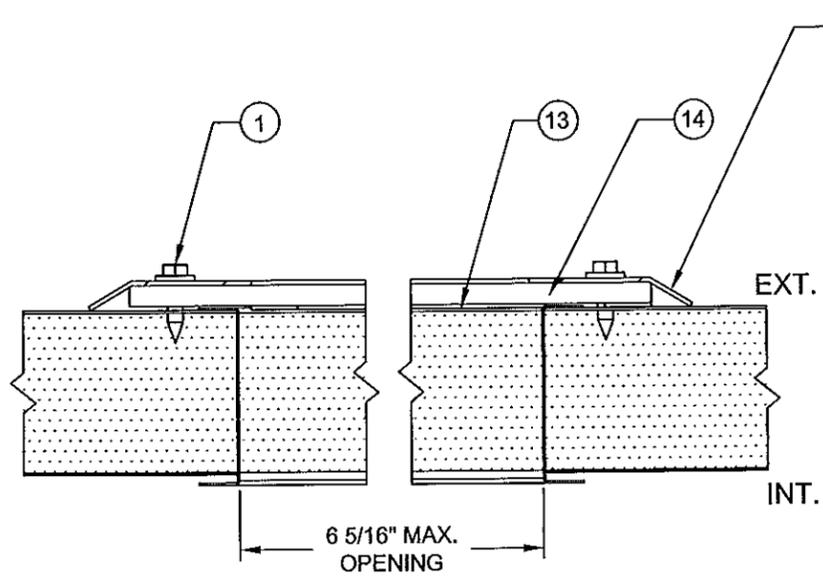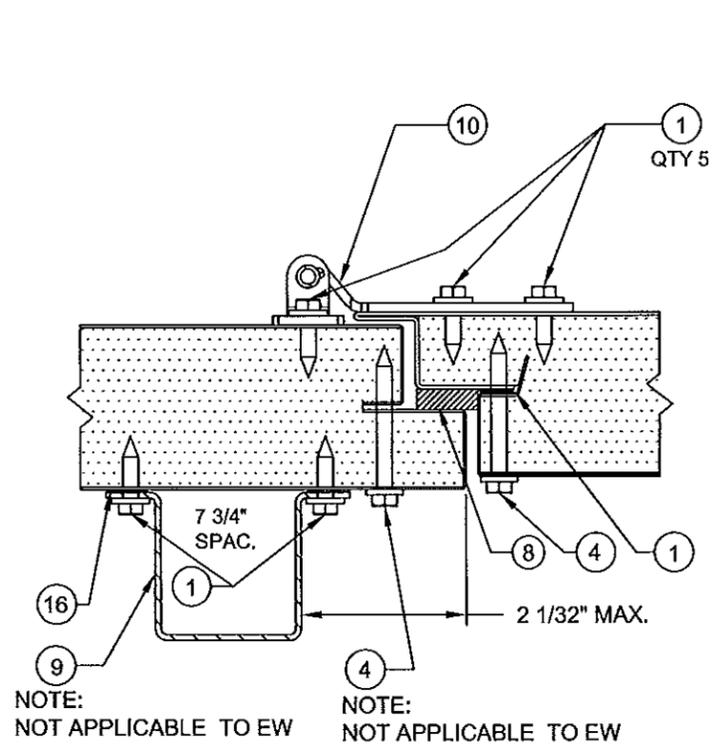


DETAIL A. DOOR HORIZONTAL CROSS-SECTION

NOTE:
1. THIS DETAILS SHALL BE APPLICABLE TO ALL DOORS IN UNIT, PIPE CABINET, AND ENERGY WHEEL SECTION (2 LEVEL SECTION).

DOOR CROSS SECTION D-D

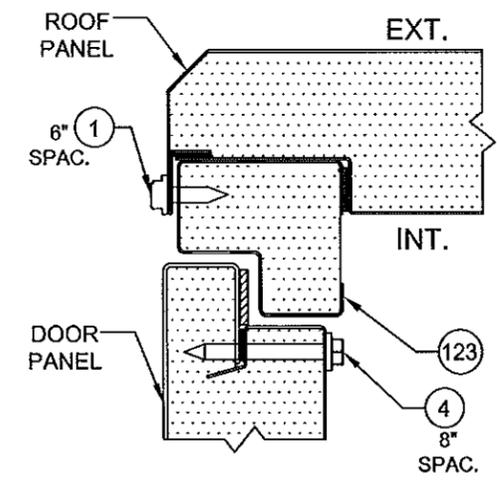


DETAIL B1. DOOR TO ROOF (TOP)
NEW-STYLE HEADER
(TESTED WITH SIZE 50)

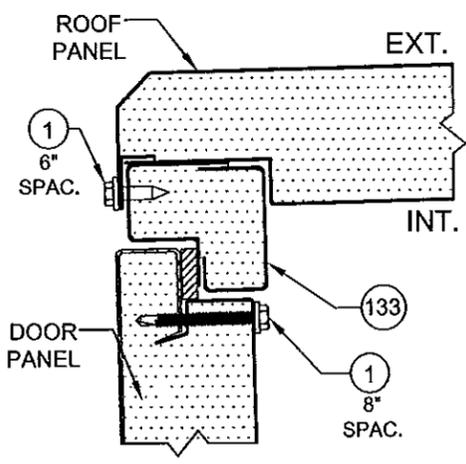

DETAIL B2. DOOR TO ROOF (TOP)
OLD-STYLE HEADER

NOTE:
1. ONLY SHOWING TOP AND BOTTOM OF THE CROSS SECTION.

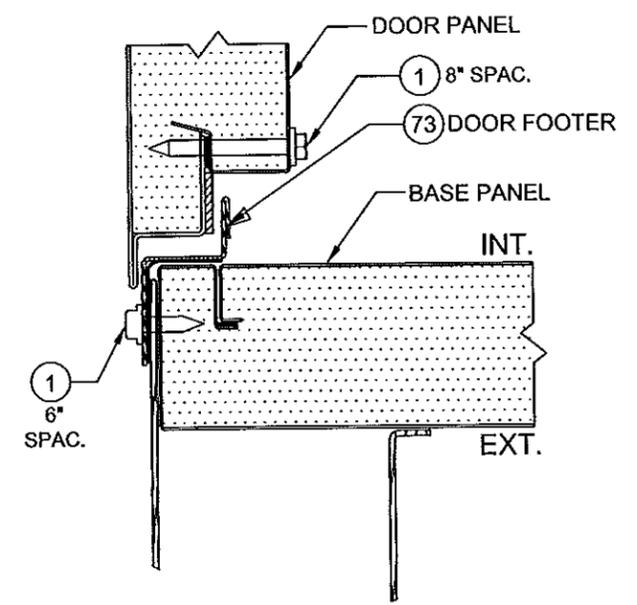




DETAIL C. DOOR TO BASE (BOTTOM)

Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-2629-01
Miami Dade Product Control
By *Heather A. ...*

Scott Walters
SCOTT WALTERS
FL PE# 62354
WALTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013

DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	---	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	8 OF 46	SECTION			MOCK UPDWG SHEET REF:	7, 14, 15, 39 OF 63 AND 20 OF 35	SCALE:	NTS	DATE	16-SEP-2013

DOOR HARDWARE LAYOUT

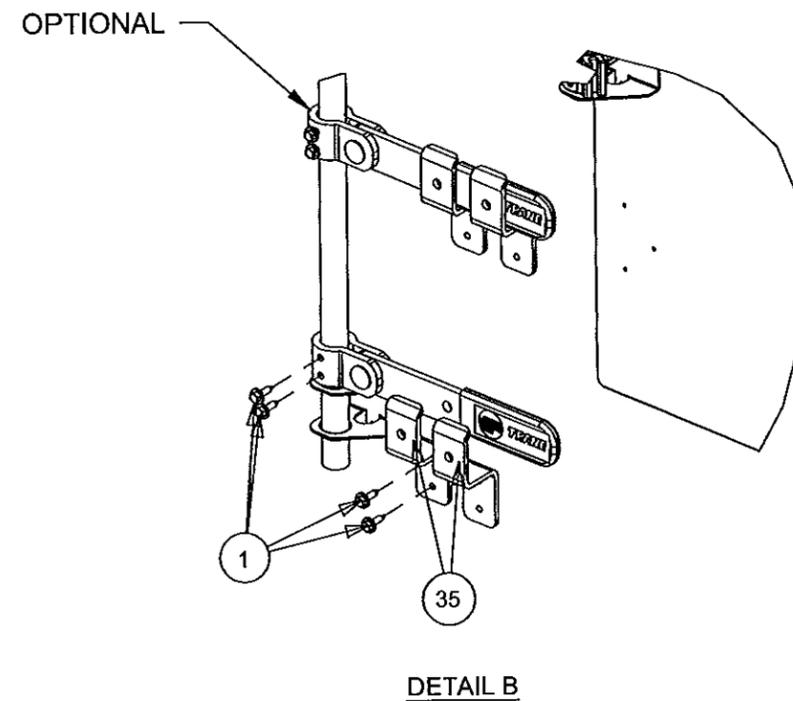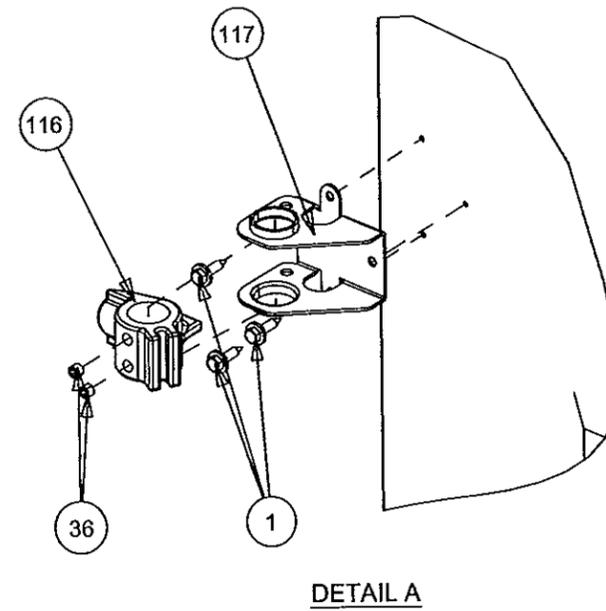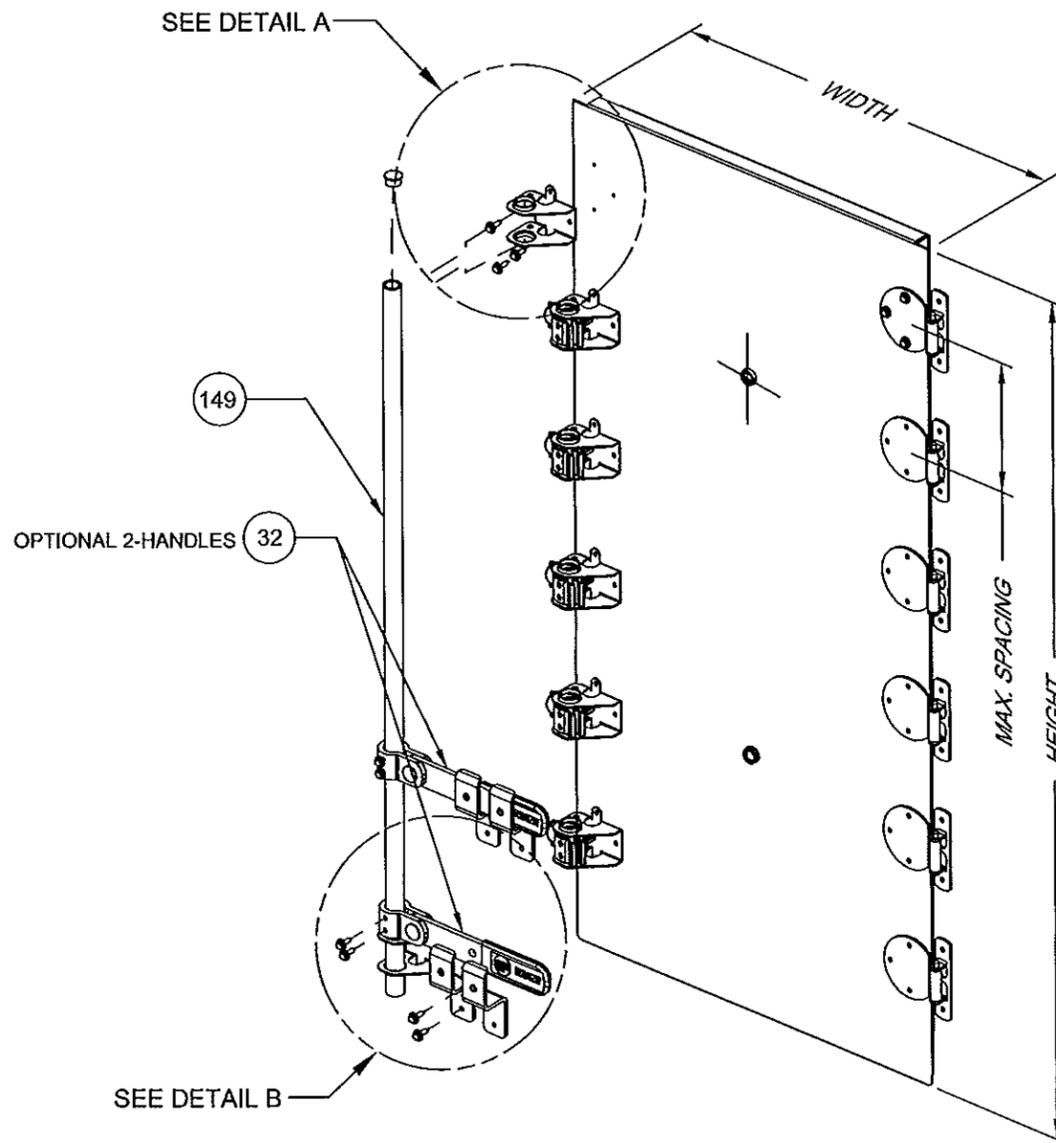

MAXIMUM DOOR SIZE WIDTH x HEIGHT	HINGE MAX. SPACING	PADLOCK BRACKETS PER HANDLE	HANDLE QTY	WINDOW FRAME
AHU 30 27/32" x 54 11/16"	22 17/32"	2	1	Y
AHU 20 11/32" x 54 11/16"	22 17/32"	1	1	N
PC 30 7/8" x 68 15/16"	11 19/32"	2	2	N
2L 14 7/8" x 98 15/16"	17 27/32"	2	1	N


Approved as complying with the
Florida Building Code
Date 12/12/2013
NOAH 12-0629.01
Miami Dade Product Control
By *[Signature]*

[Signature]
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013



DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET	9 OF 46	SECTION			MOCK UPDWG SHEET REF: 9 OF 19, 16 OF 63, 19 OF 35	SCALE: NTS	DATE 16-SEP-2013

COMPONENTS ON DOOR (TESTED WITH SIZE 50)


- NOTES:
 1. THIS PAGE IS SHOWING ALL THE COMPENTS ATTACHED AND TESTED WITH DOORS.
 2. THESE COMPONENTS APPLICABLE TO ALL DOORS.

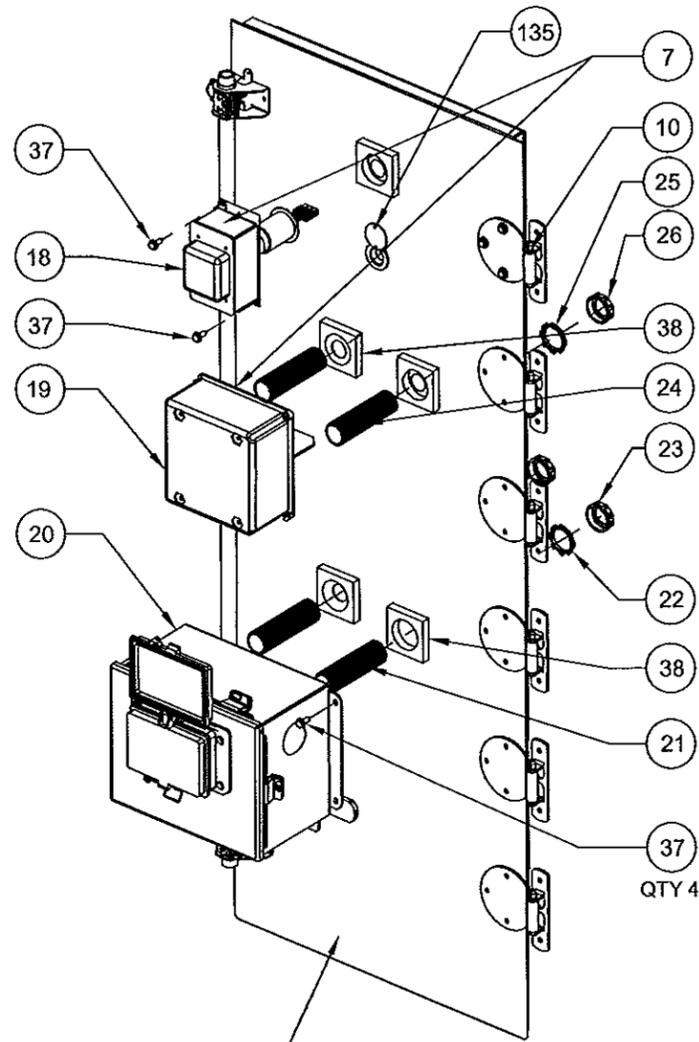

DOOR PANEL

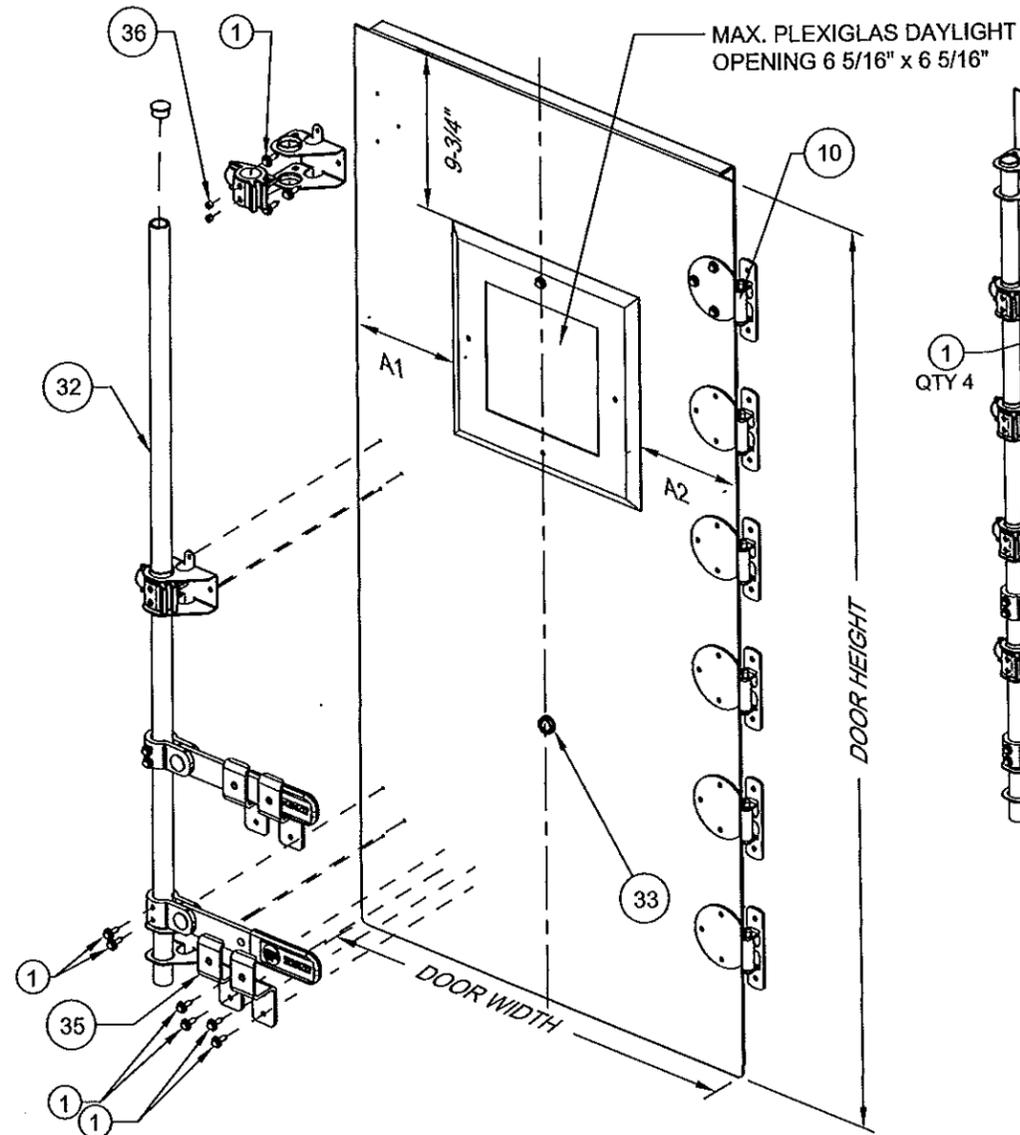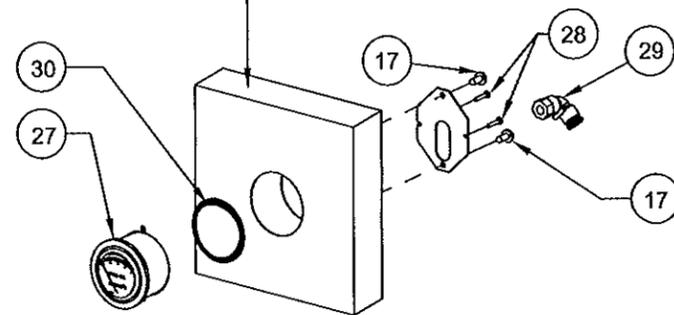

DOOR HARDWARE AND
OPTIONAL COMPONENTS

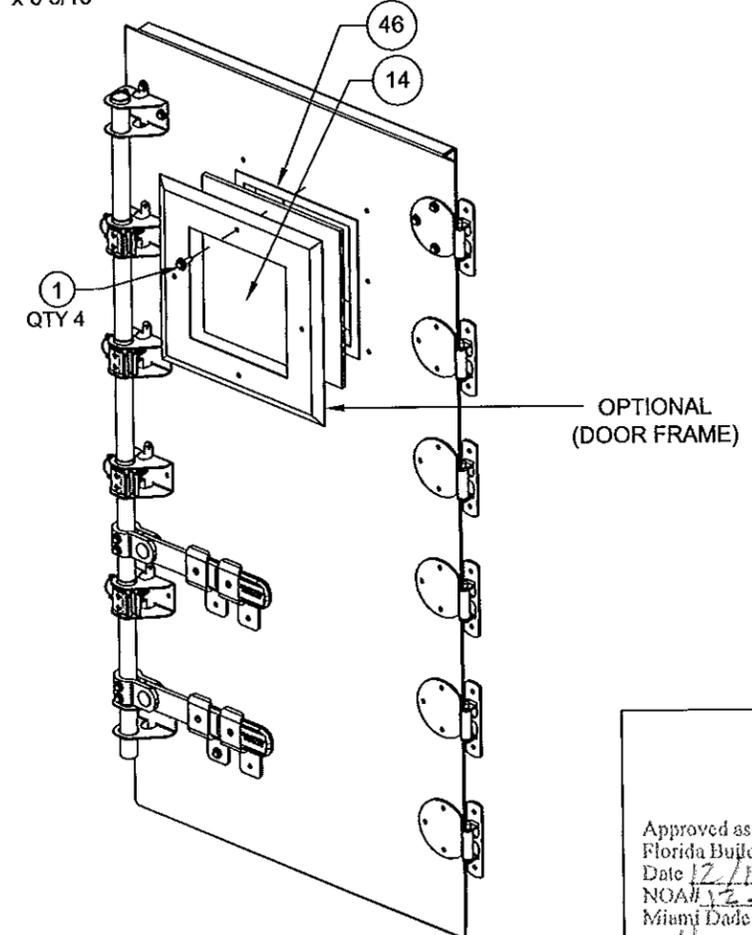

OPTIONAL
(DOOR FRAME)

DOOR WIDTH	A1	A2
14.853	3	3
23.353	7.5	7

Approved as complying with the
 Florida Building Code
 Date 12/12/2013
 NOA# 13-0629.01
 Miami Dade Product Control








By *Scott Wolters*

Scott Wolters
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312

NOV 25 2013

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 10 OF 46	SECTION			MOCK UPDWG SHEET REF: 17-19 OF 63	SCALE: NTS	DATE 16-SEP-2013

1ST LEVEL BASE RAIL DETAILS

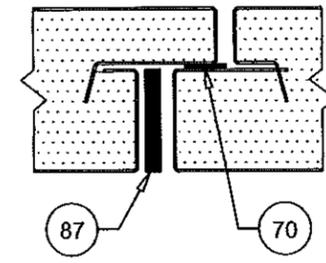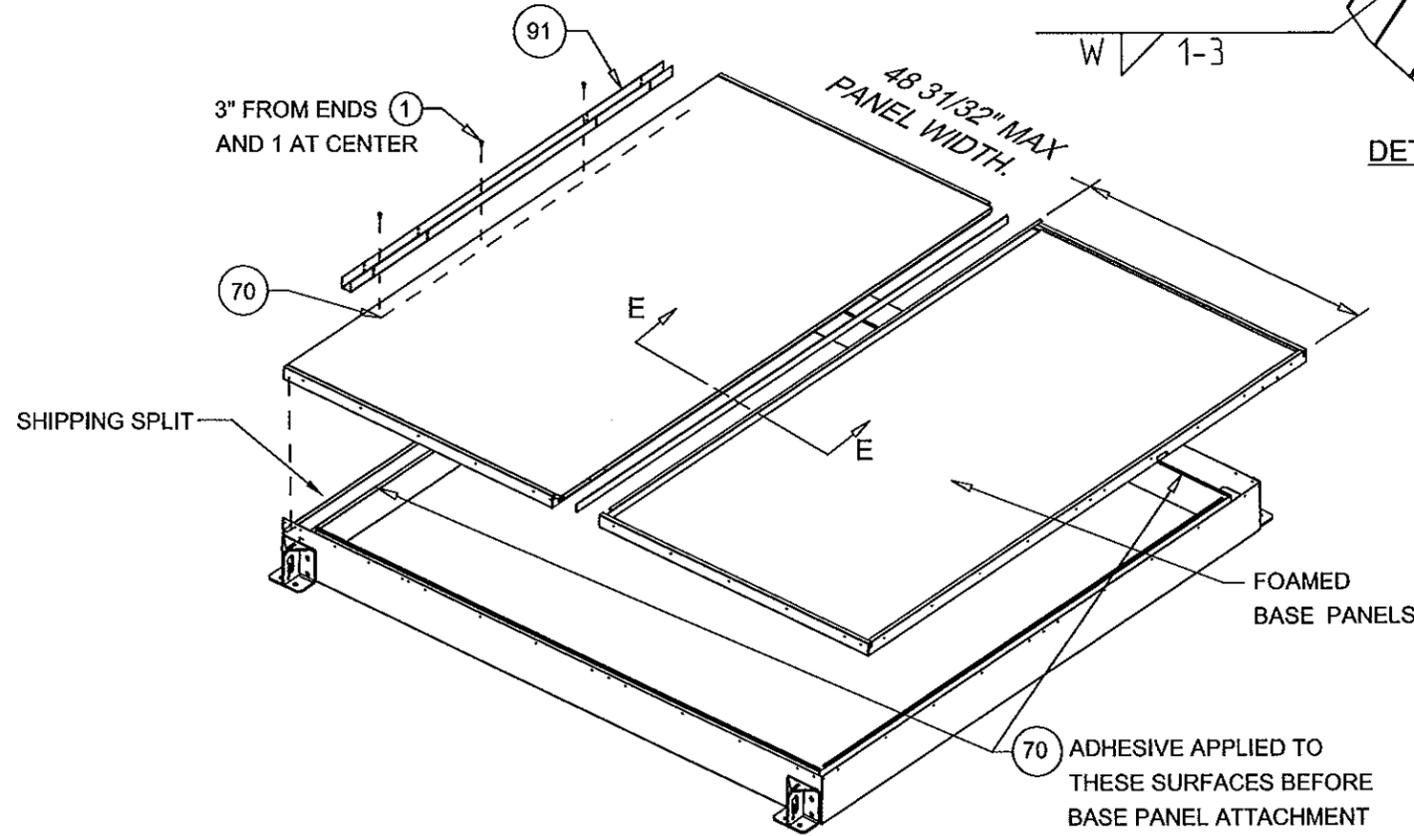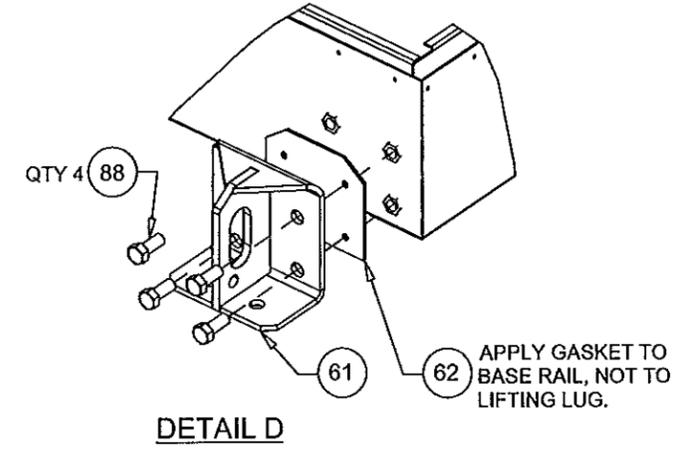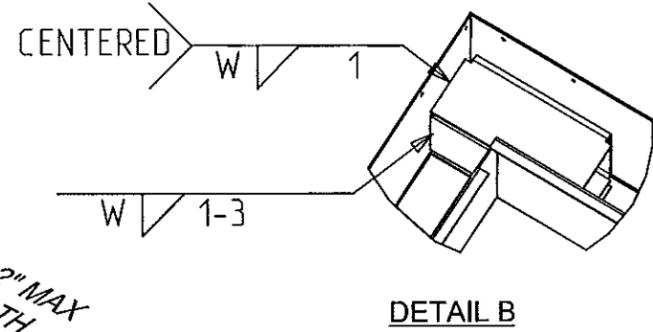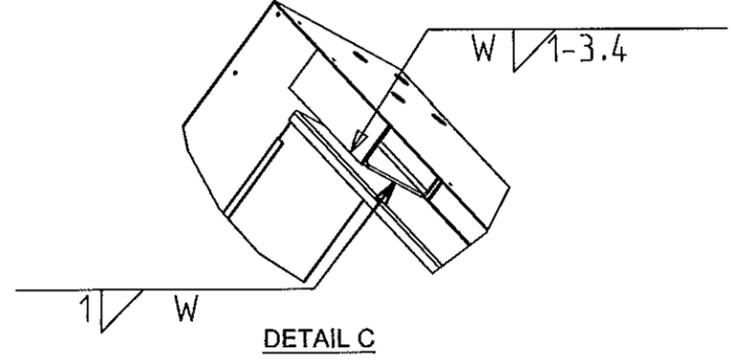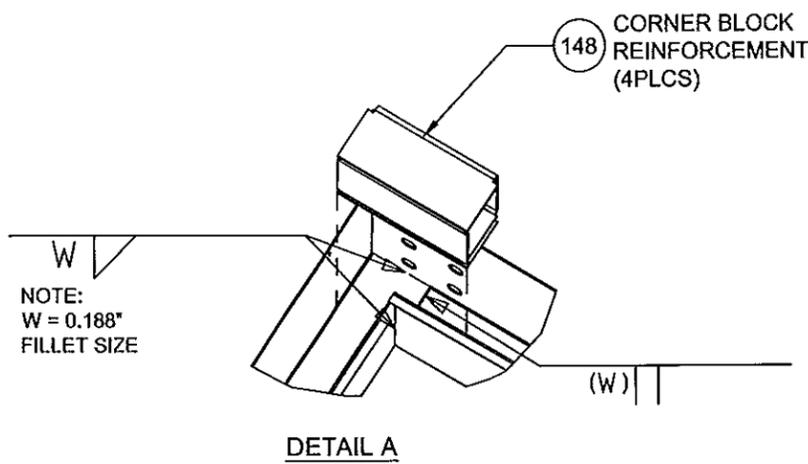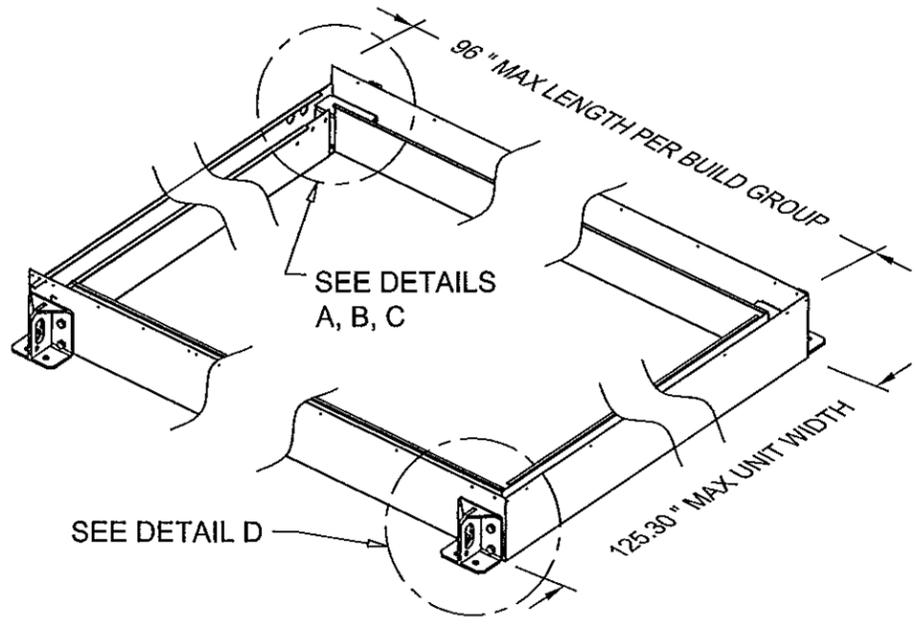


Approved as complying with the Florida Building Code
 Date 12/12/2013
 NOA# 12-0639-01
 Miami Dade Product Control
 By: *[Signature]*


[Signature]
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY ---	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 11 OF 46	SECTION			MOCK UPDWG SHEET REF: 26, 28 OF 53	SCALE: NTS	DATE 16-SEP-2013


2ND LEVEL BASE RAIL DETAILS

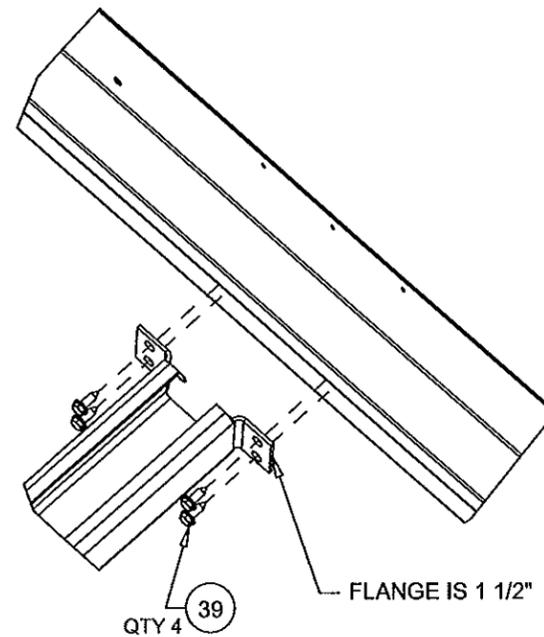

DETAIL B

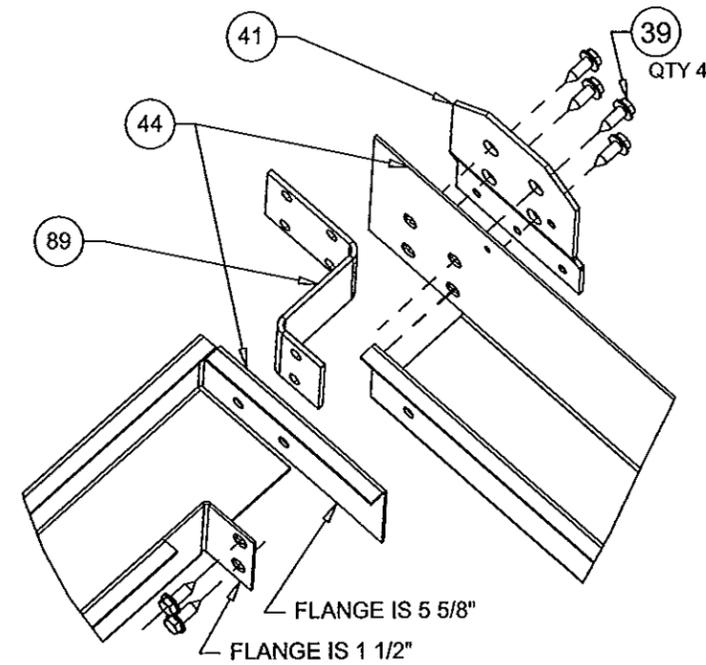

DETAIL C

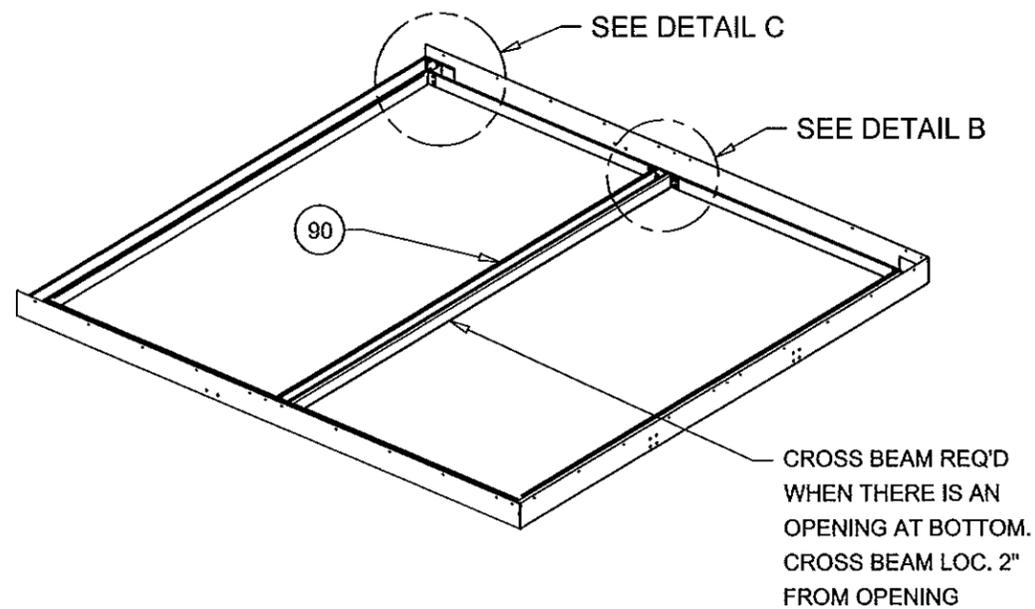


Approved as complying with the
 Florida Building Code
 Date 12/12/2013
 NOA# 12-0629.01
 Miami Dade Product Control
 By *[Signature]*

[Signature]
 SCOTT WALTERS
 FL PE# 62354
 WALTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET	12 OF 46	SECTION			MOCK UP/DWG SHEET REF: 27, 34 OF 53	SCALE: NTS	DATE 16-SEP-2013

TYPICAL WALL PANEL LAYOUT WITH OPENING ON THE END OF THE UNIT.



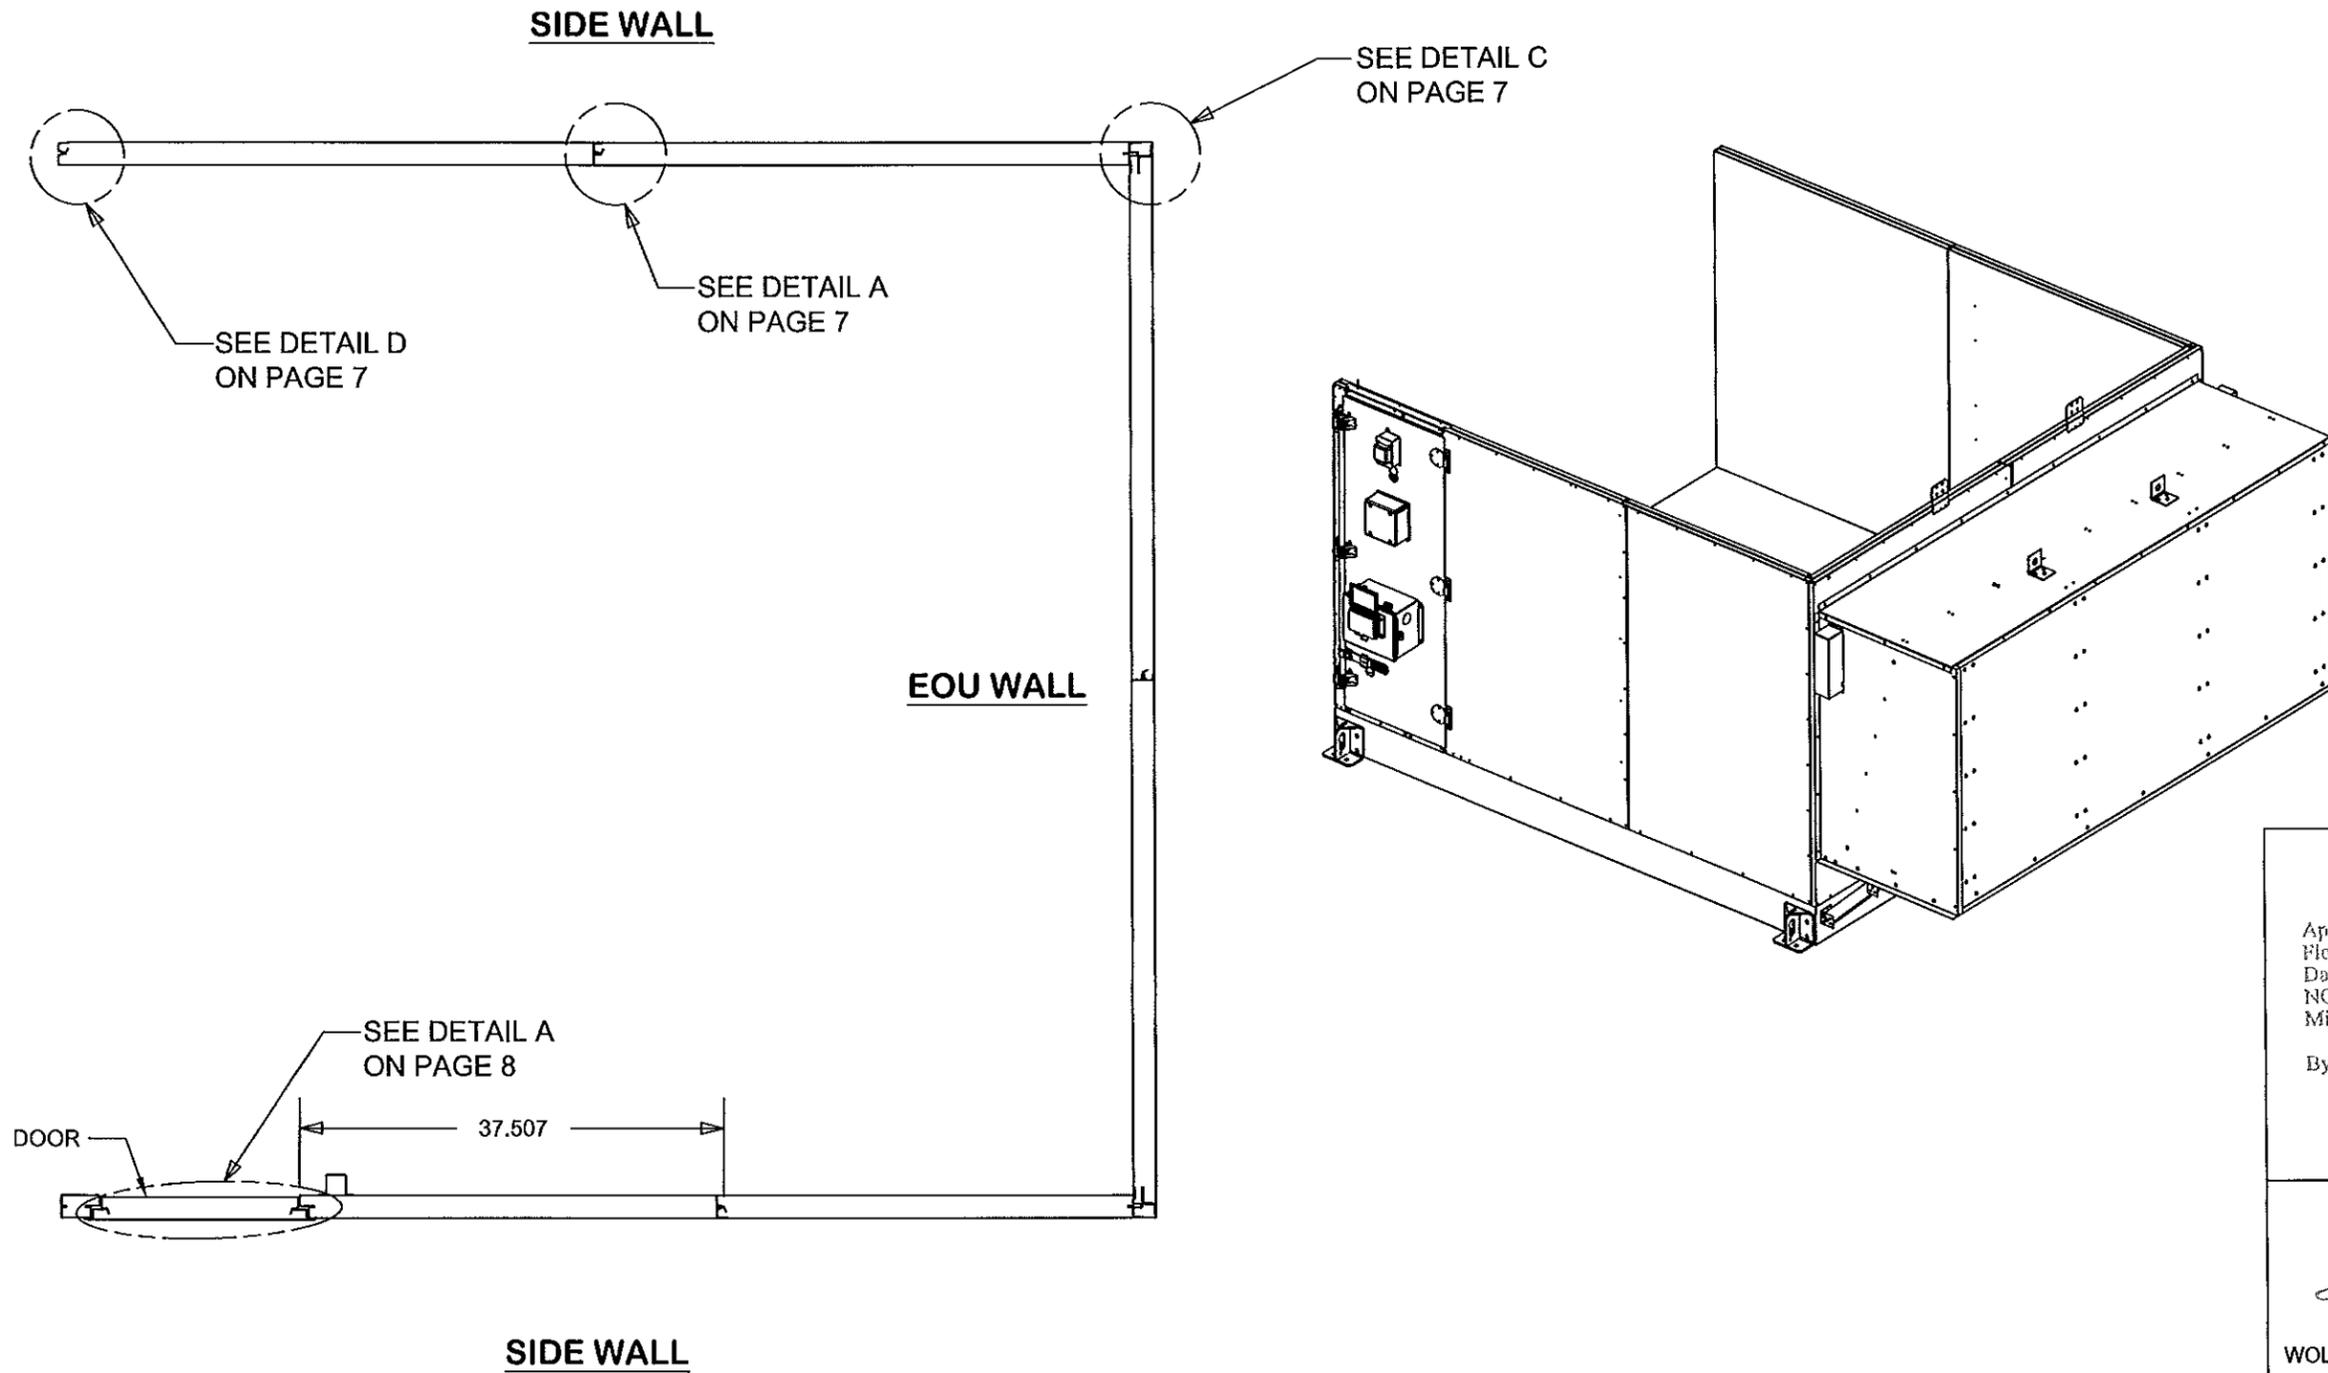


Approved as complying with the
 Florida Building Code
 Date 12/12/2013
 NOA# 12-0629.01
 Miami Dade Product Control
 By *[Signature]*

[Signature]
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 13 OF 46	SECTION			MOCK UPDWG SHEET REF: 27, 34 OF 53	SCALE: NTS	DATE 16-SEP-2013

TYPICAL WALL PANEL LAYOUT AND DOOR JAMB SUPPORT STRUCTURE.

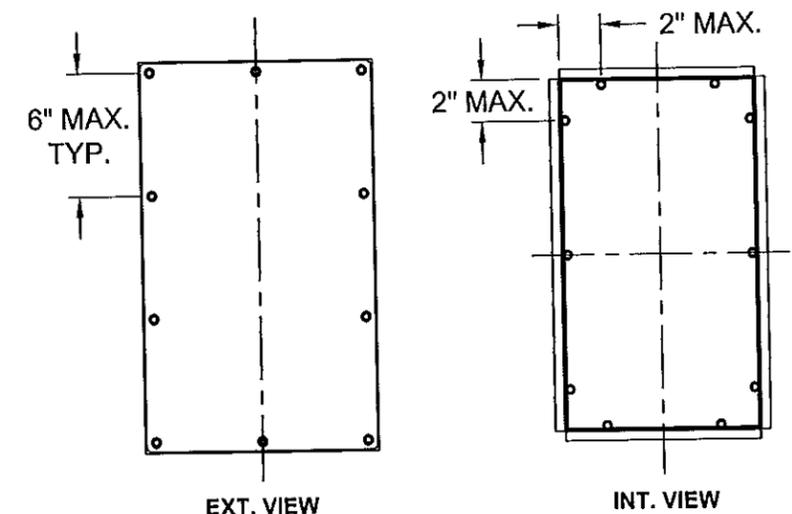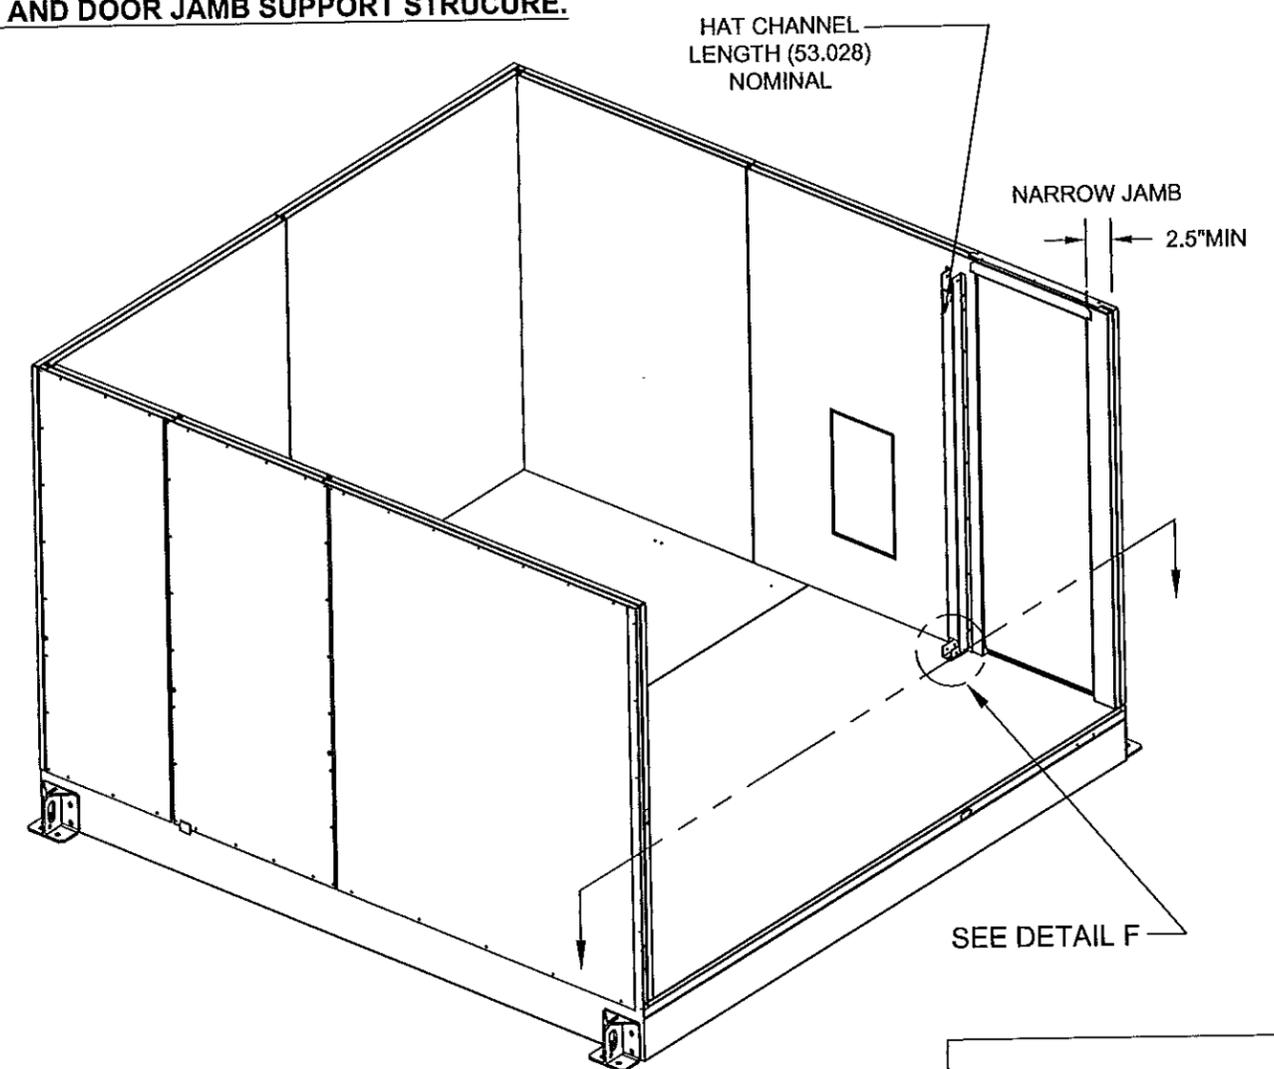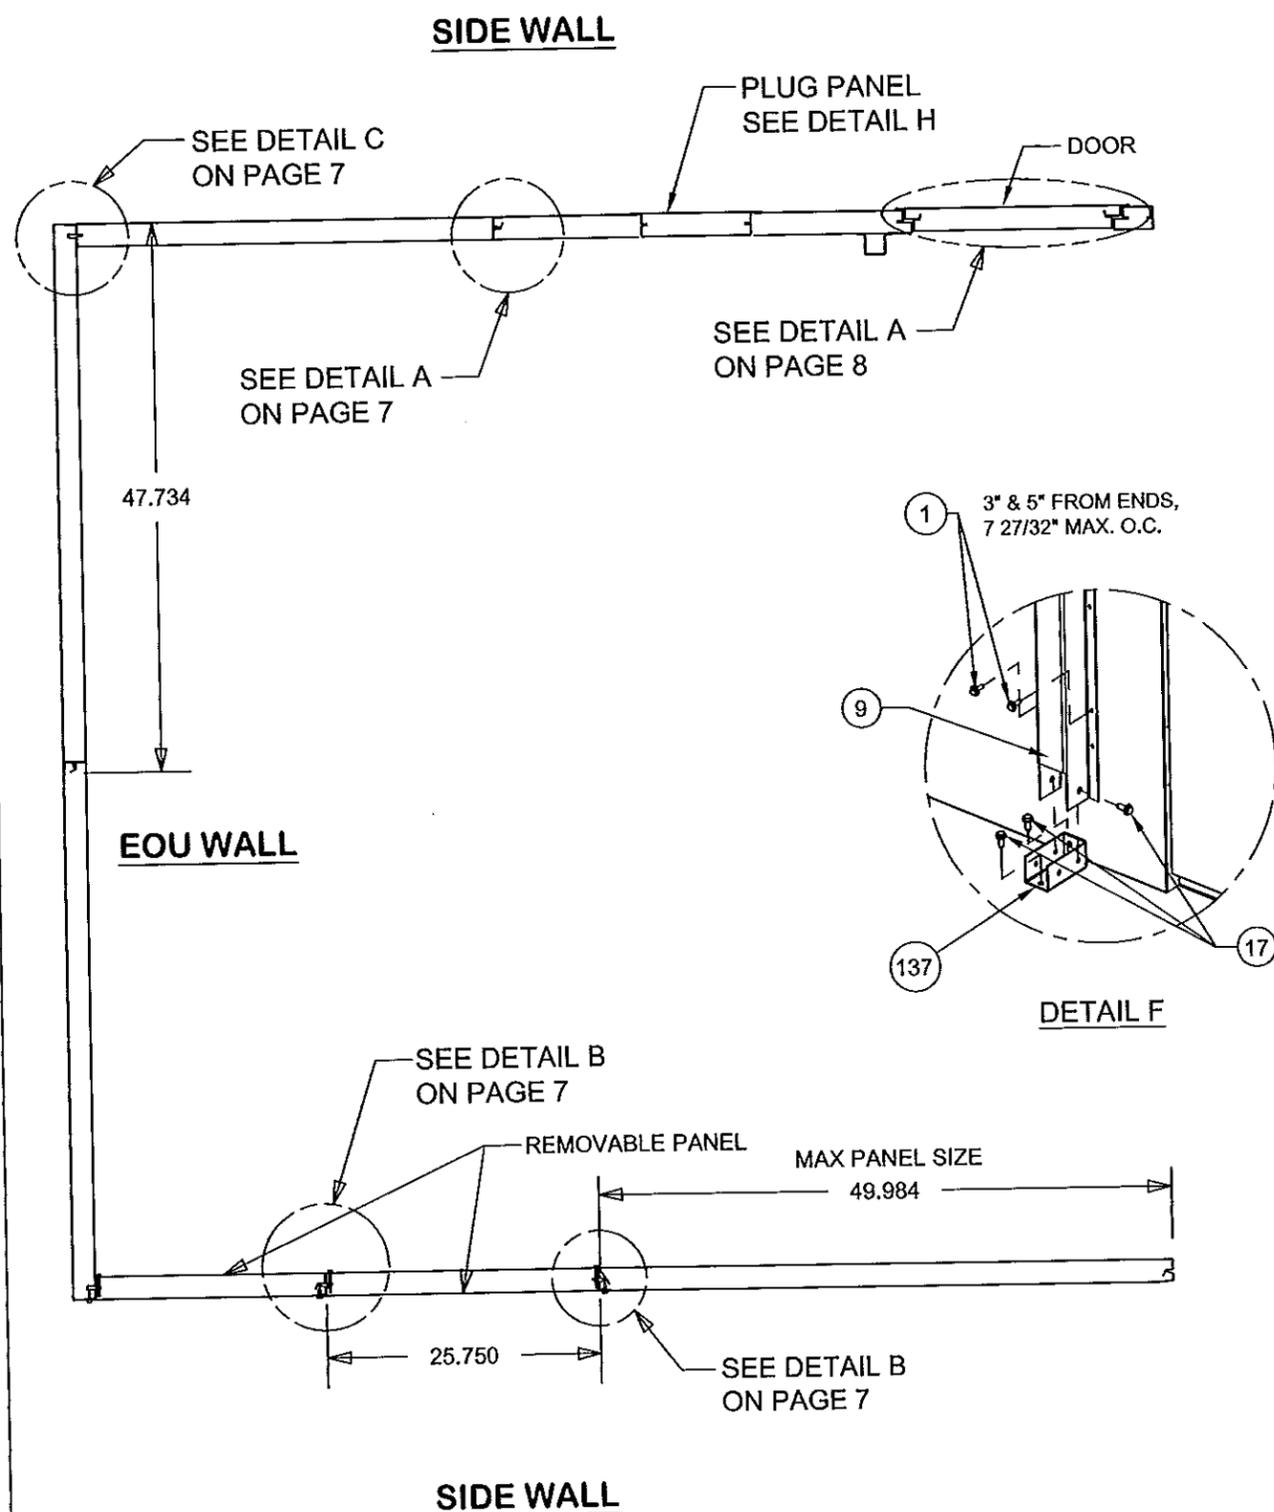


DETAIL H. PLUG PANEL ANCHOR LAYOUT

Approved as complying with the Florida Building Code
 Date 12/12/2013
 NOA# 13-0629.01
 Miami Dade Product Control
 By *Healy A. M. Co.*

Scott Wolters
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 14 OF 46	SECTION			MOCK UP/DWG SHEET REF: 27, 34 OF 53	SCALE: NTS	DATE 16-SEP-2013

TYPICAL WALL PANEL LAYOUT SHOWING JAMB WITH AND WITHOUT SUPPORT STRUCTURE



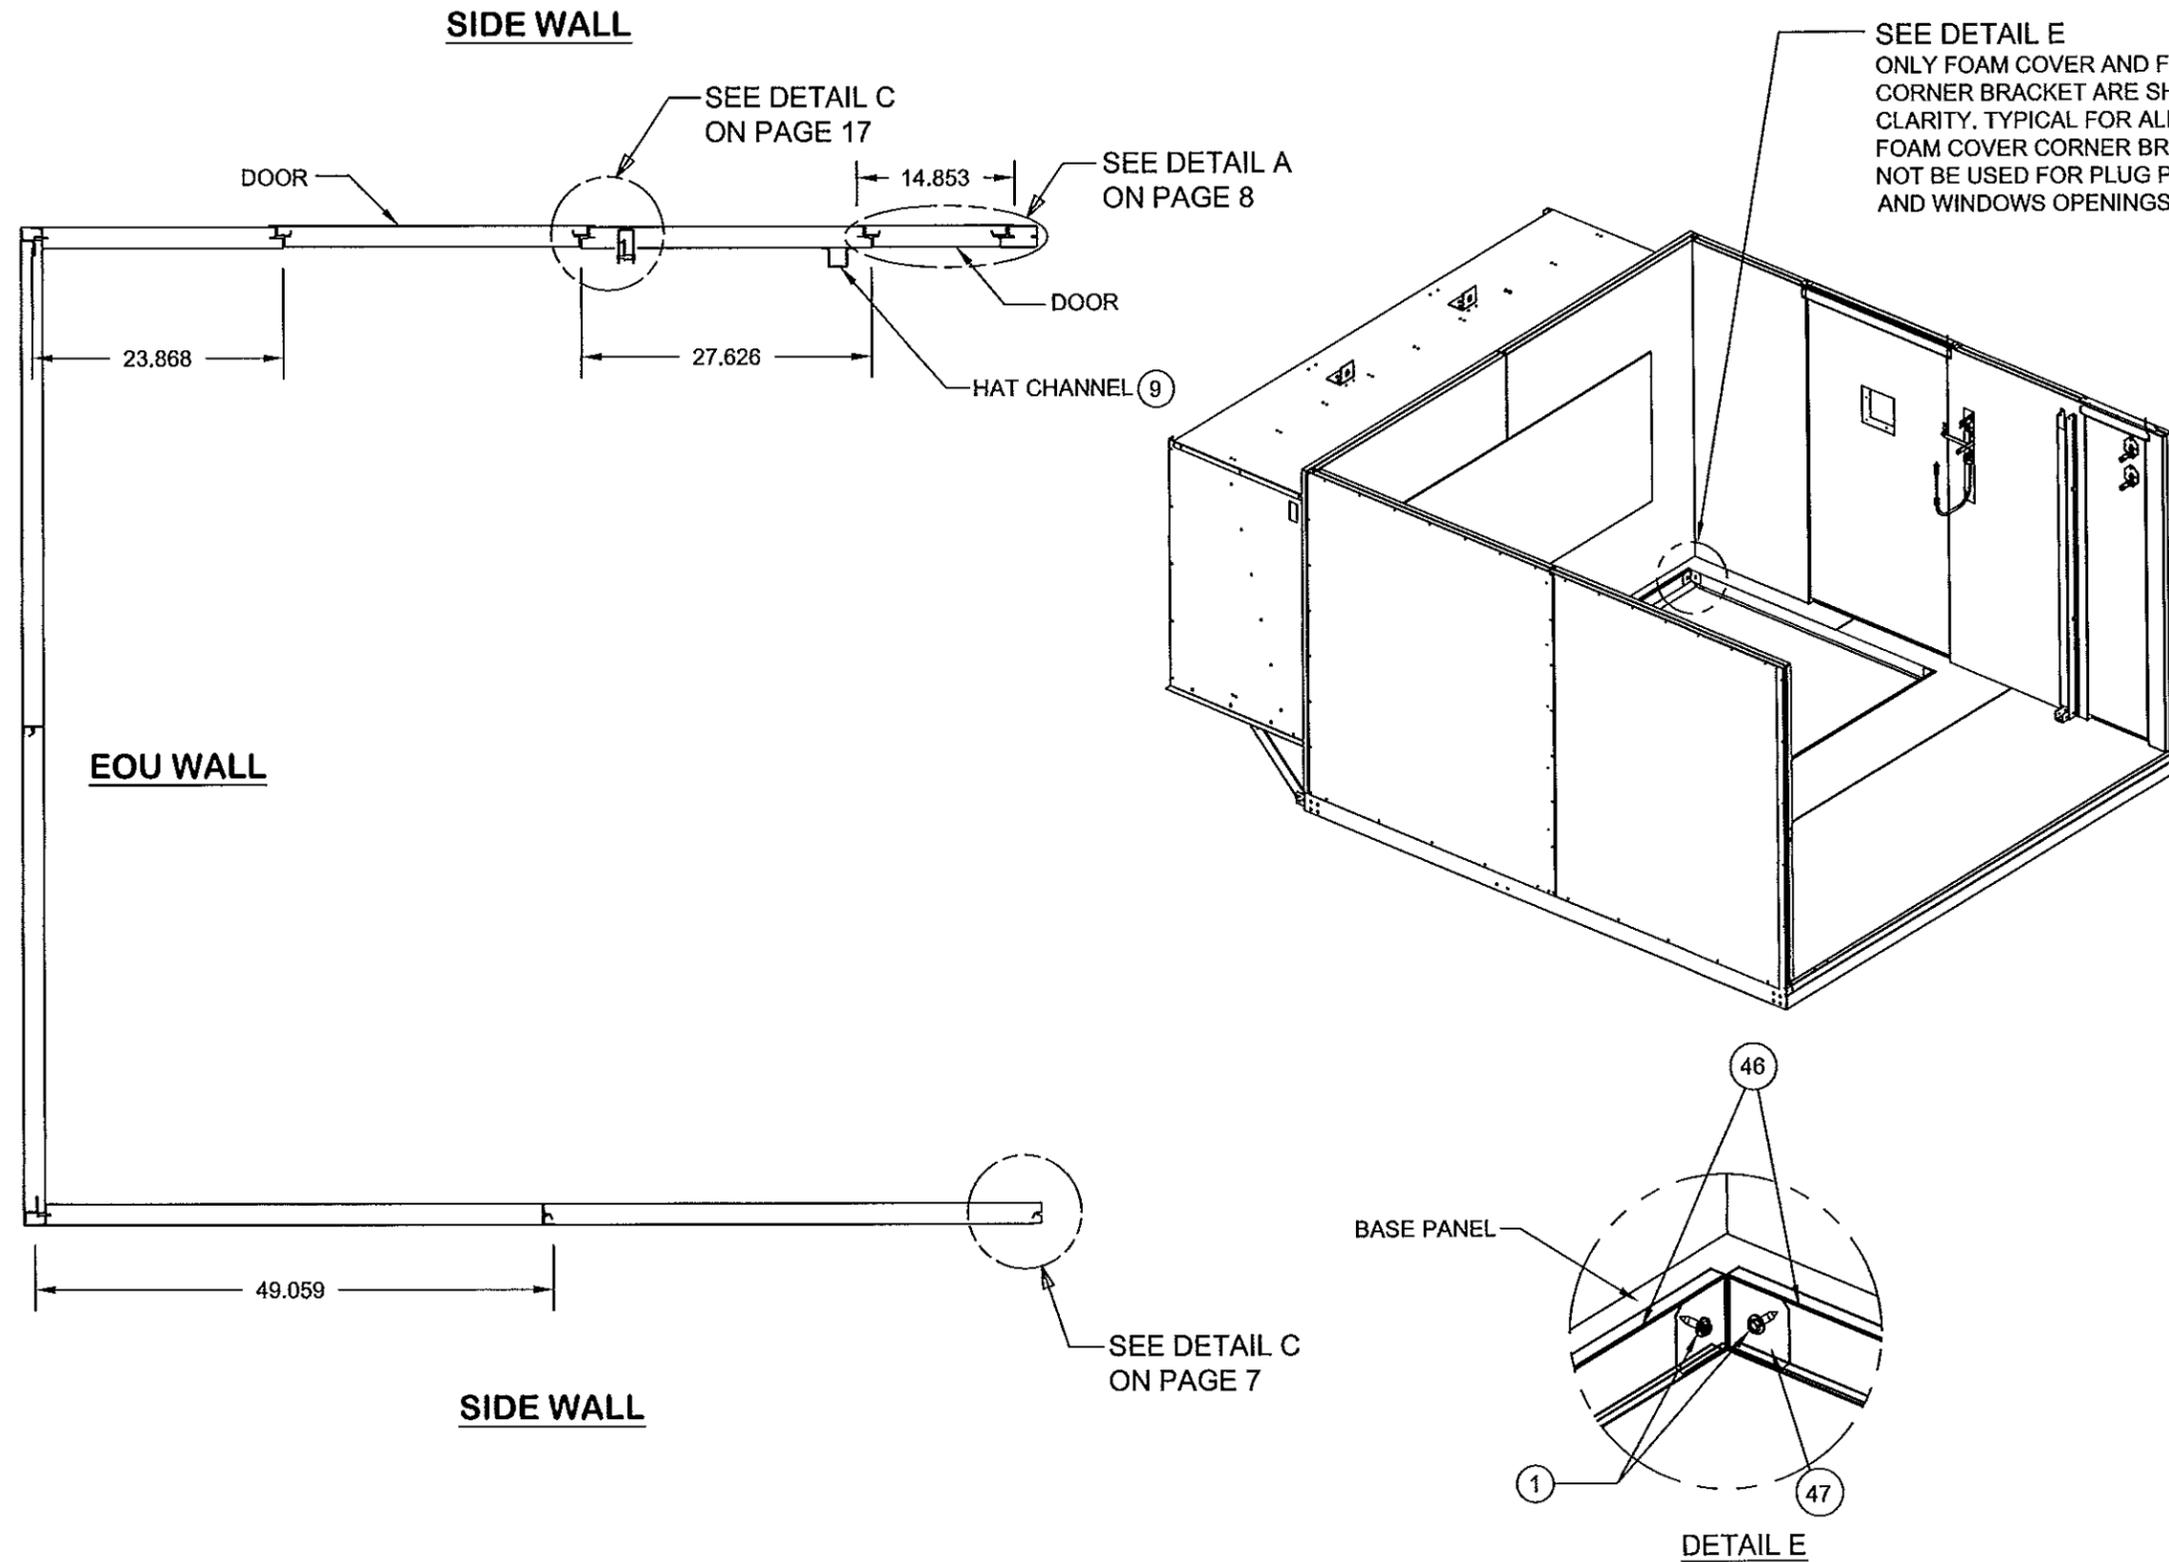


Approved as complying with the Florida Building Code
 Date 12/12/2013
 NOA# 12-0629-01
 Miami Dade Product Control
 By *[Signature]*

[Signature]
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 15 OF 46	SECTION			MOCK UP/DWG SHEET REF: 27, 34 OF 53	SCALE: NTS	DATE 16-SEP-2013

TYPICAL WALL PANEL LAYOUT, WITH OPENING ON THE SIDE PANEL

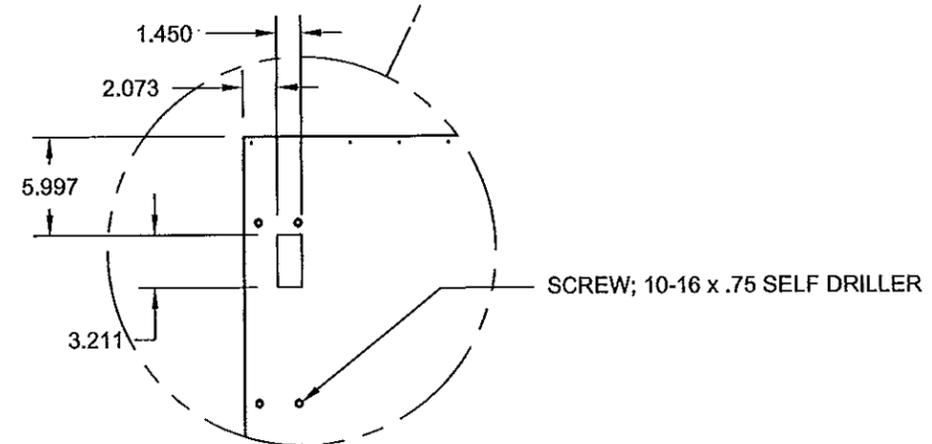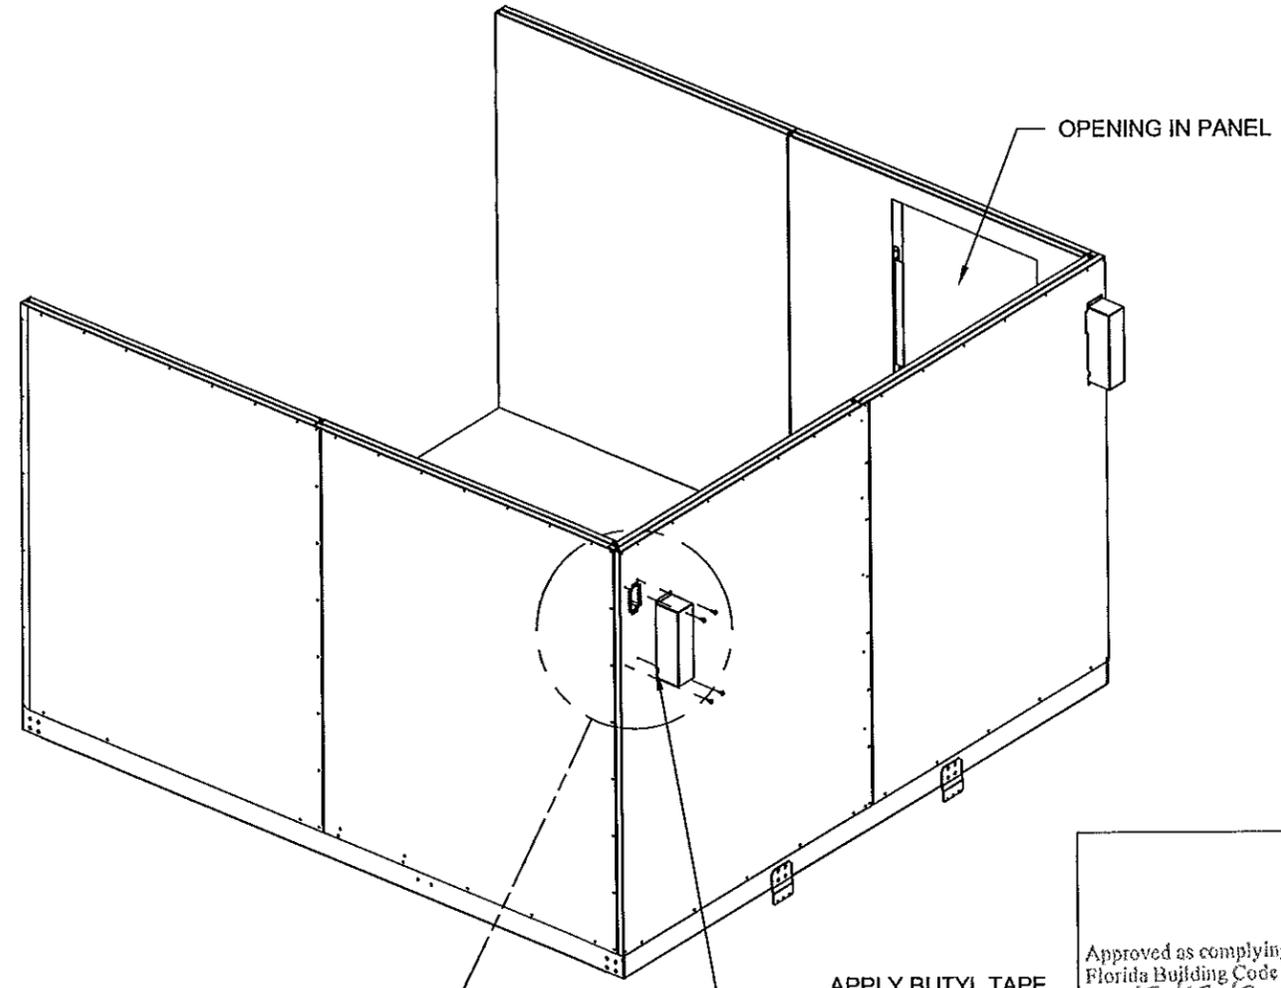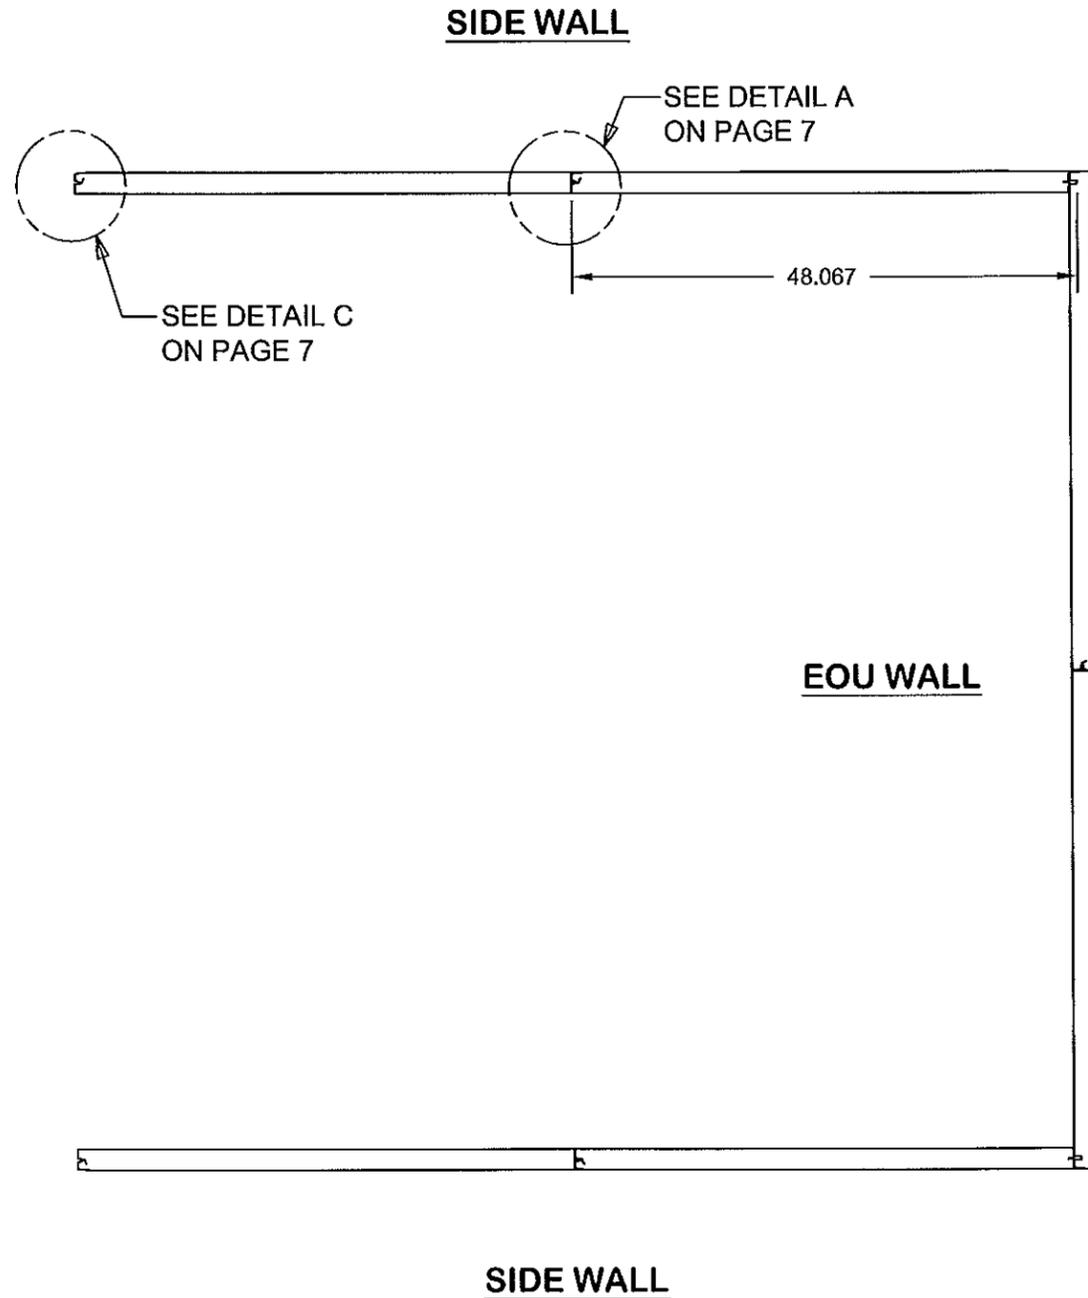


Approved as complying with the Florida Building Code
 Date 12/12/2013
 NOA# 12-0629.01
 Miami Dade Product Control
 By: *Heather A. Miller*


Scott Wolters
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 16 OF 46	SECTION			MOCK UP/DWG SHEET REF: 27, 34 OF 53	SCALE: NTS	DATE 16-SEP-2013



**OPENING SIZES & MULLION DETAILS
ON BASE AND ROOF.**

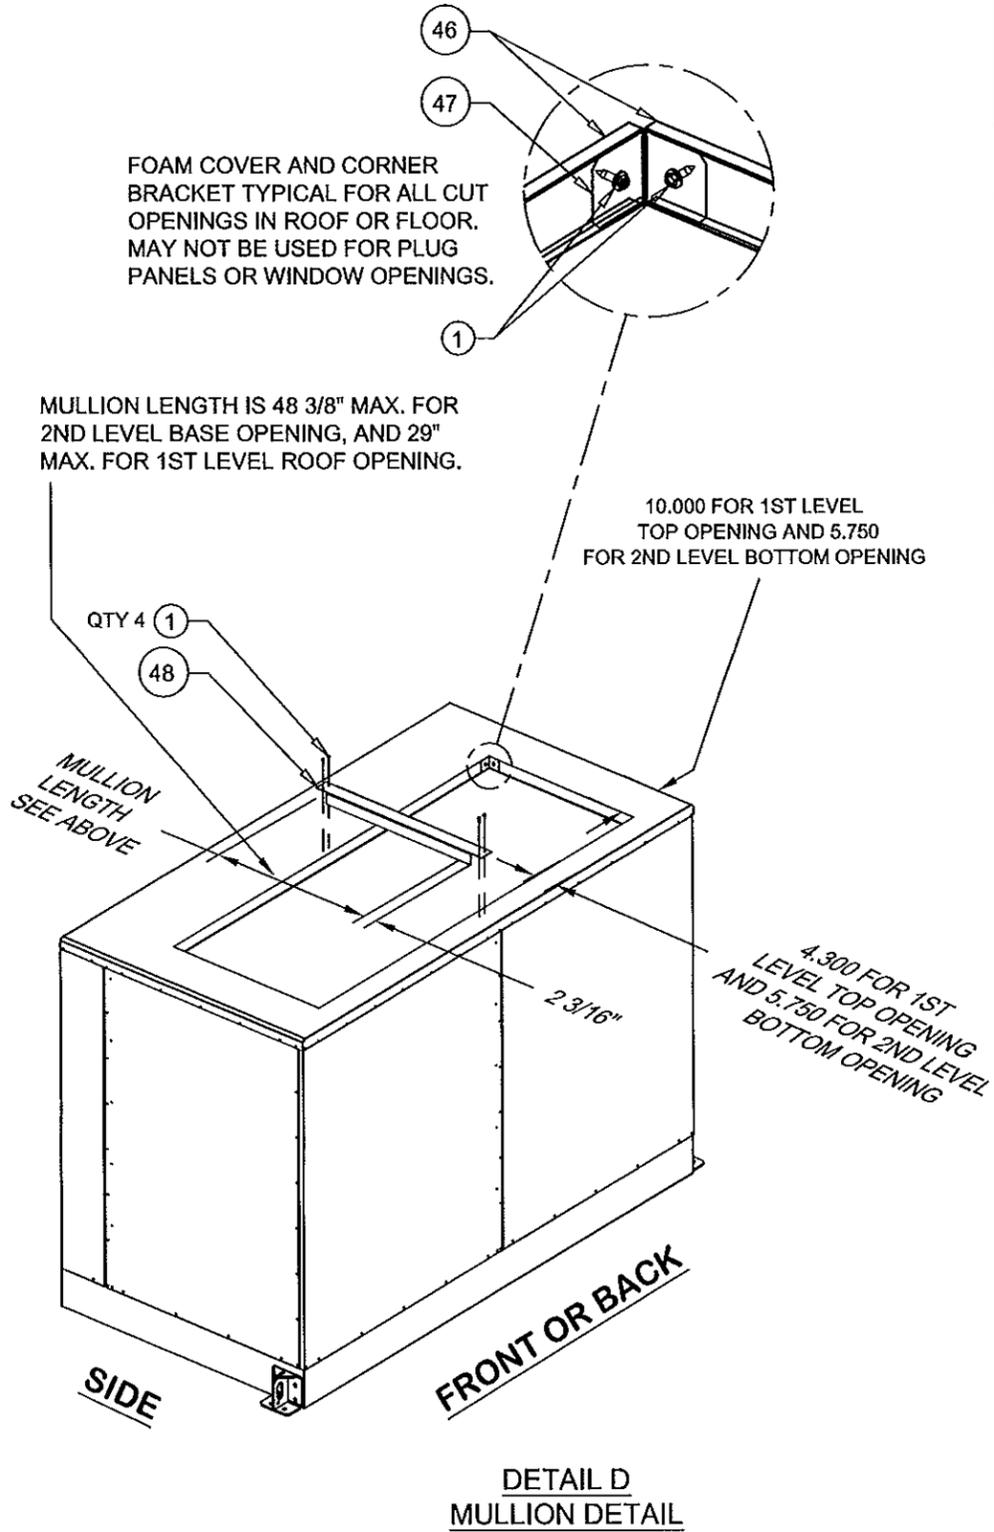


OTHER GENERIC COMPONENT

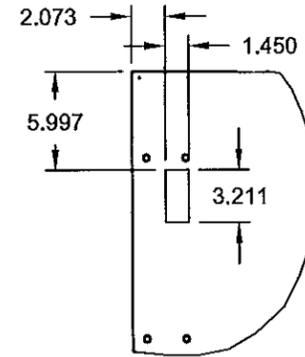


DETAIL A. RACEWAY DETAIL
(ATTACHED TO BACK OR FRONT OF THE UNIT)
IT IS PENETRATION CORE ON THE UNIT TO RUN THE CABLES TO STACKED UNITS

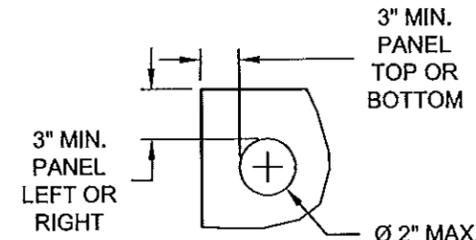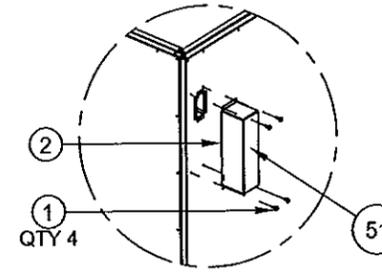

DETAIL B. FIELD-DRILLED HOLE DETAIL
APPLICABLE TO ALL PANELS

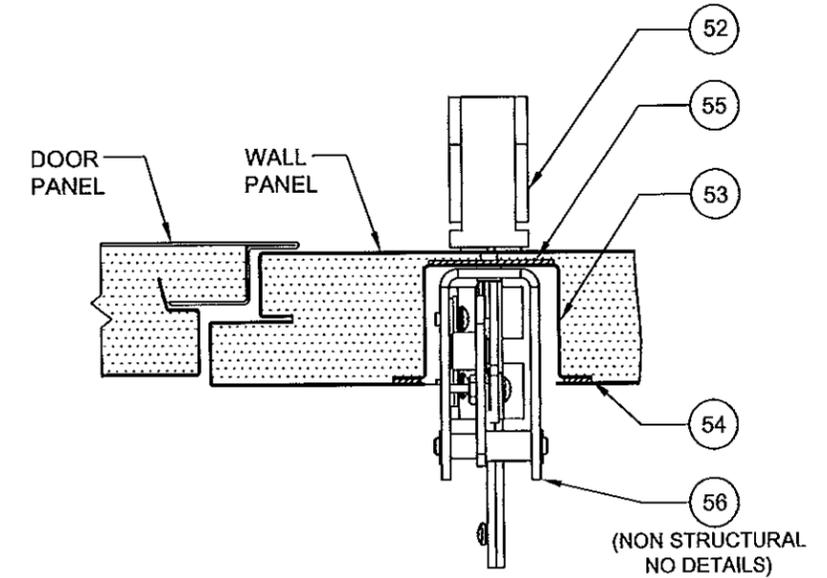

DETAIL C. DISCONNECT HANDLE
APPLICABLE TO ALL THE UNITS

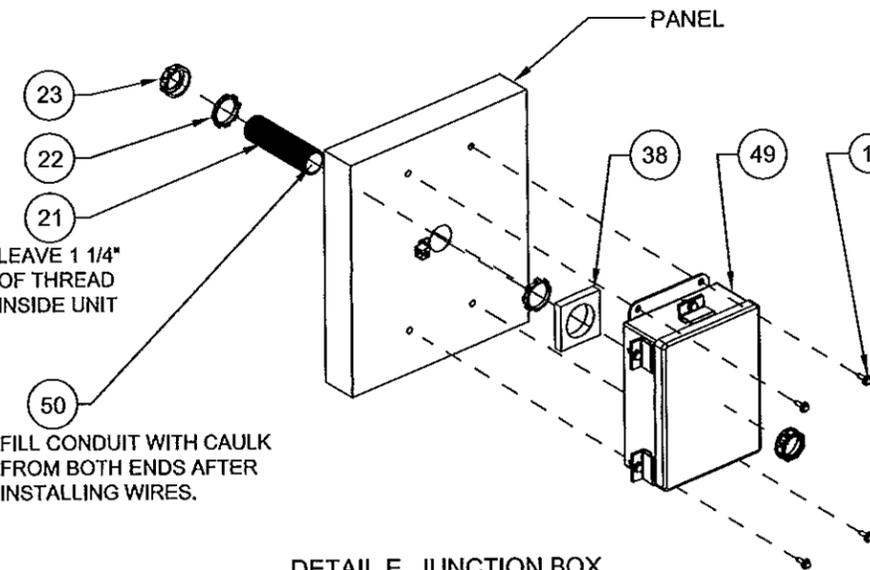

DETAIL E. JUNCTION BOX
APPLICABLE TO ALL THE UNITS

Approved as complying with the Florida Building Code
Date 12/12/2013
NOA# 12-0639.01
Miami Dade Product Control
By *Healy A. Miller*


Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312

NOV 25 2013


DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	REV. HISTORY	---	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	17 OF 46	SECTION		MOCK UP DWG SHEET REF:	7, 11, 21, 22 OF 53	SCALE:	NTS	DATE	16-SEP-2013
TRANE US Inc.									

ROOF PANEL CONSTRUCTION

OUTDOOR ROOF TO ROOF PANEL

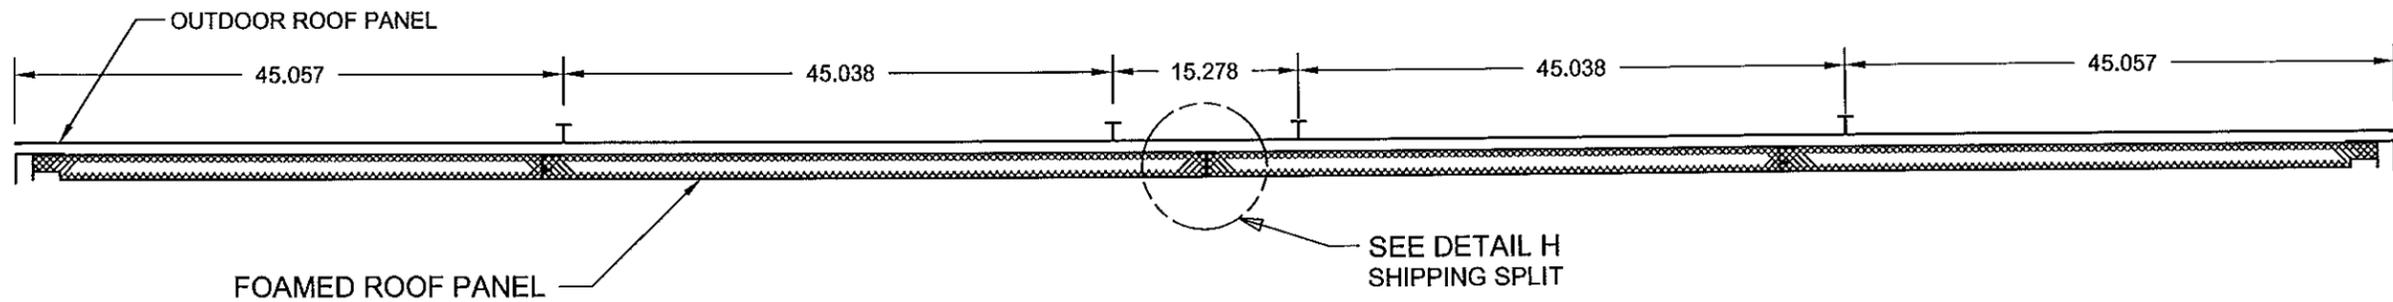


SECTION X-X

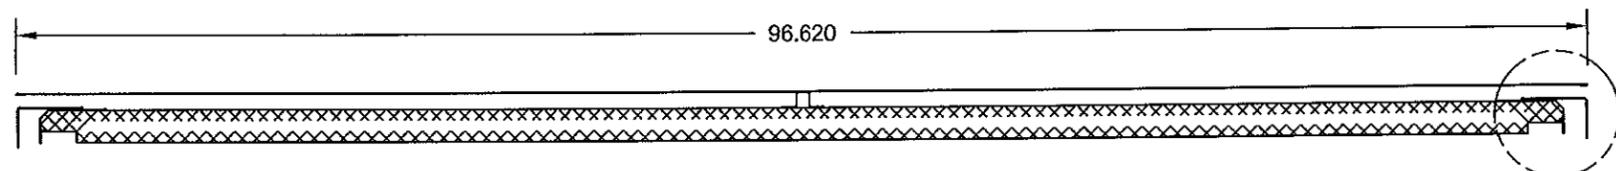

SECTION Y-Y

SEE DETAIL SECTION C-C
ON PAGE 19

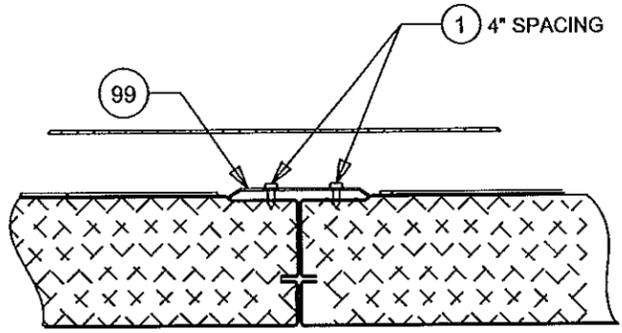



DETAIL H

Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control
By [Signature]


[Signature]
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013

DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	---	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	18 OF 46	SECTION			MOCK UPDWG SHEET REF:	7, 11, 21, 22 OF 53	SCALE:	NTS	DATE	16-SEP-2013


OUTDOOR ROOF DETAILS

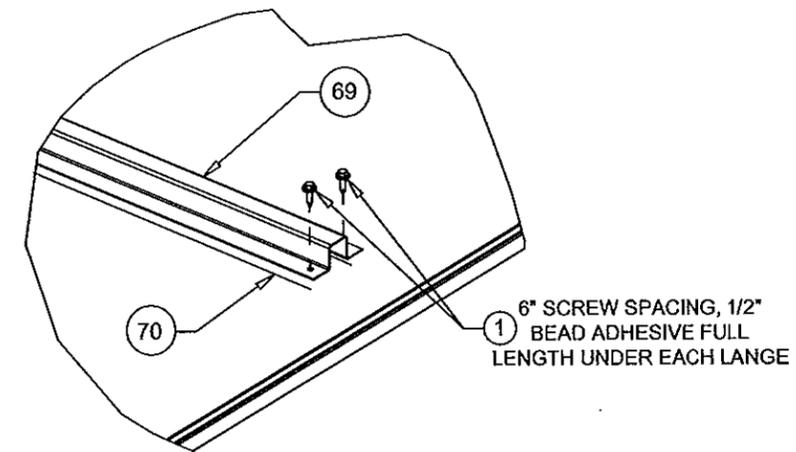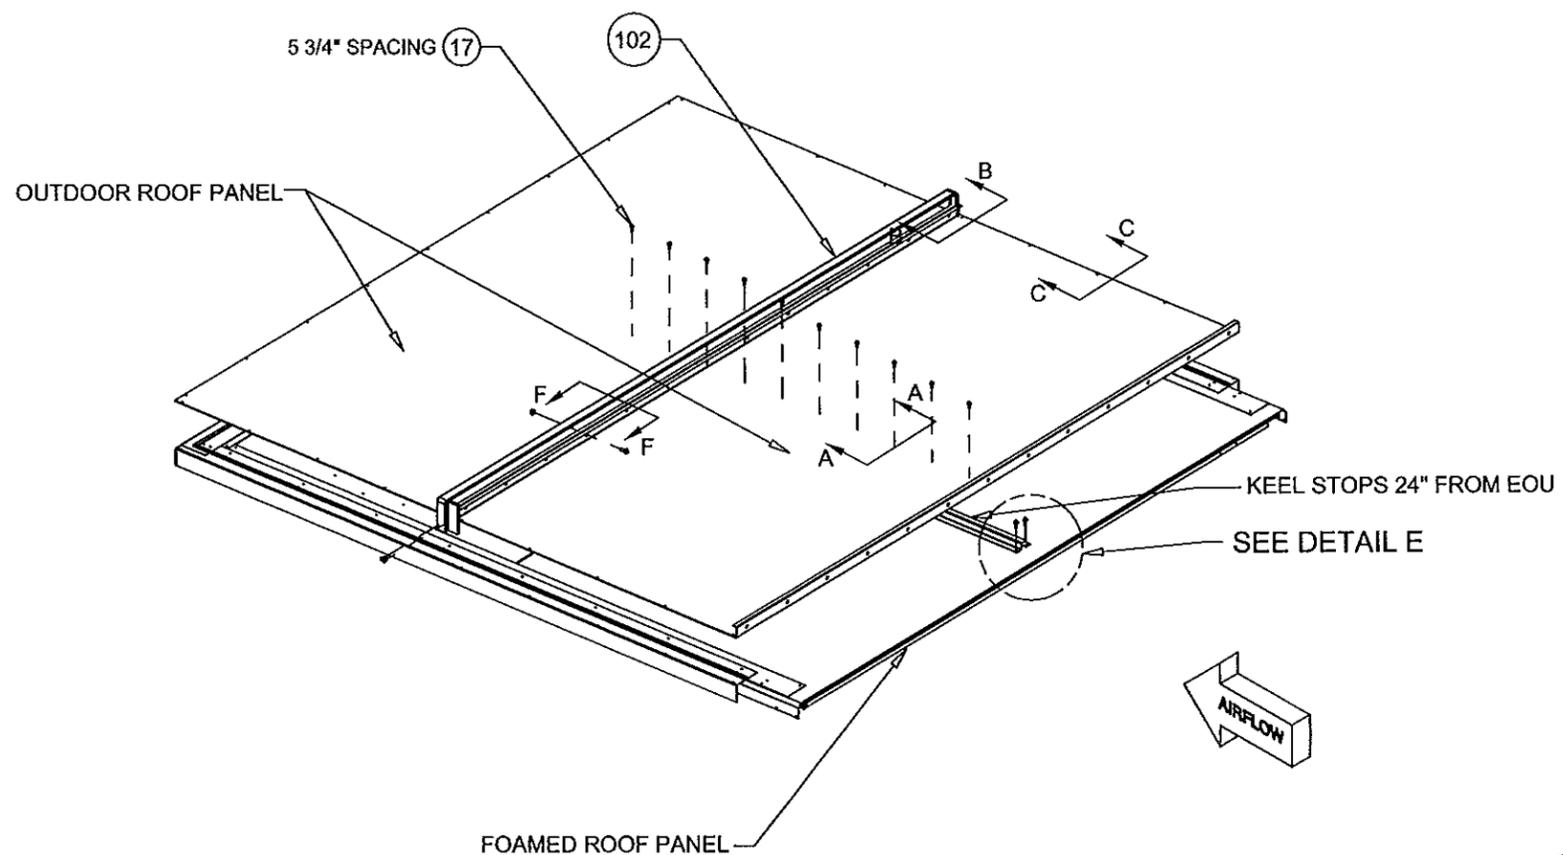


DETAIL E

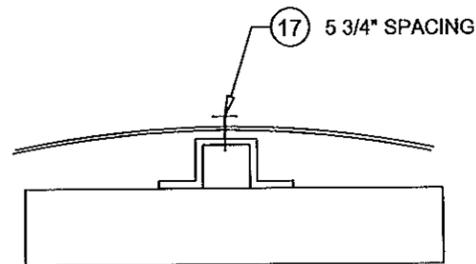


SECTION A-A

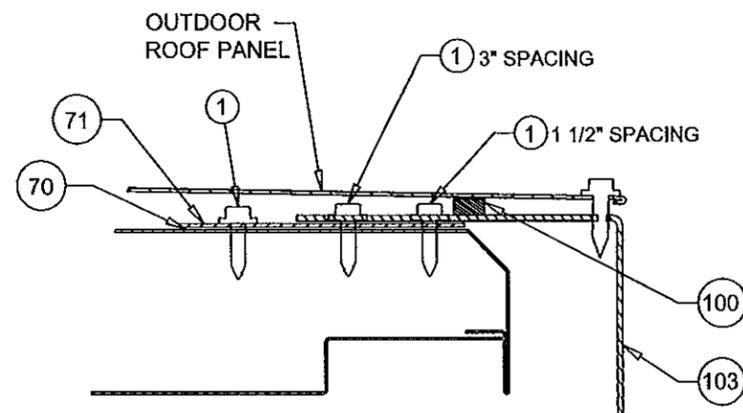

SECTION C-C

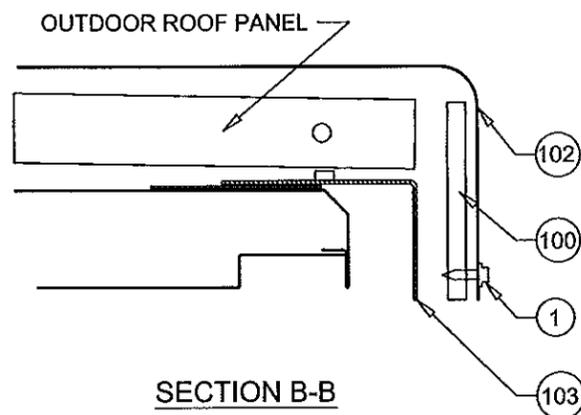

SECTION B-B

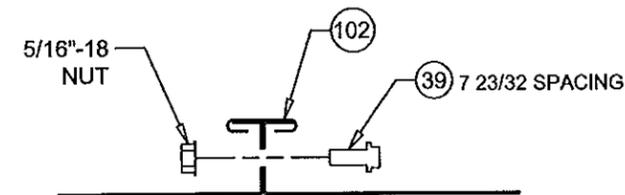



SECTION F-F

Approved as complying with the
 Florida Building Code
 Date 12/12/2013
 NOA# 12-0629.01
 Miami Dade Product Control
 By *[Signature]*

[Signature]
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 19 OF 46	SECTION			MOCK UPDWG SHEET REF: 31, 32 OF 53	SCALE: NTS	DATE 16-SEP-2013

**BUILD GROUP / SHIPPING SPLIT CONSTRUCTION
DETAILS FOR STANDARD UNIT**

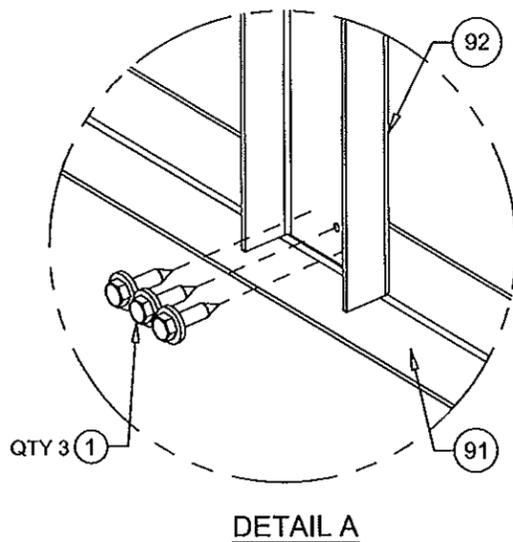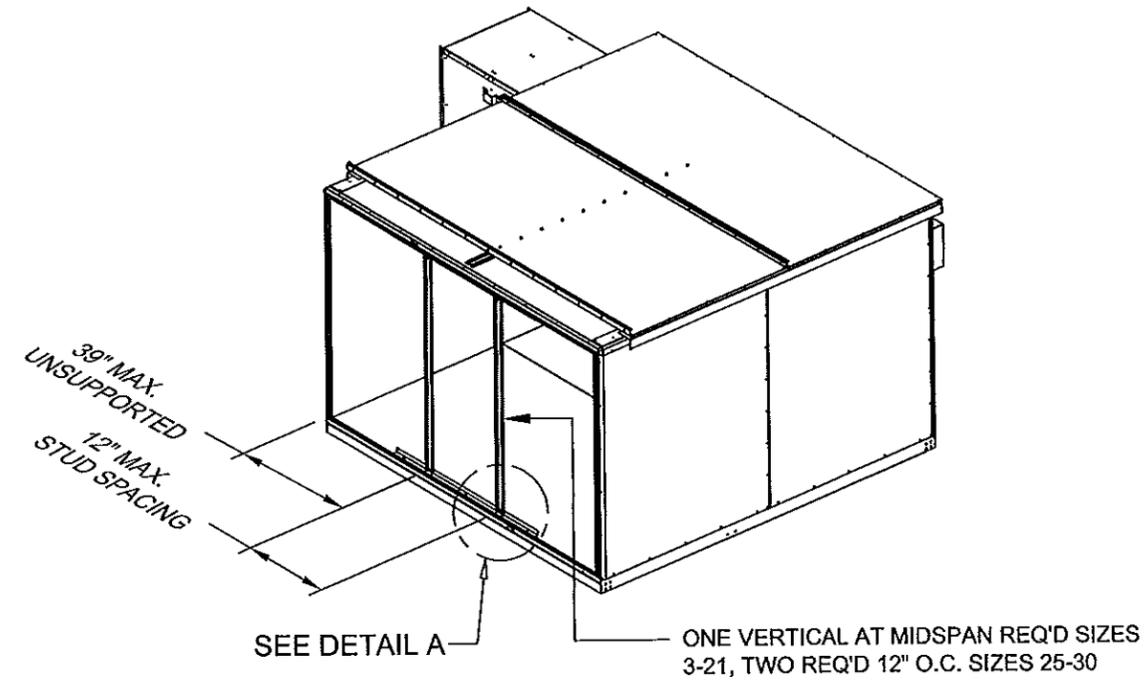


Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control
By Healy A. Martin

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013


DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 20 OF 46	SECTION			MOCK UPDWG SHEET REF: 31, 32 OF 53	SCALE: NTS	DATE 16-SEP-2013

BUILD GROUP/ SHIPPING SPLIT JOIN DETAILS AT THE BASE RAIL.

USE THREADED ROD TO PULL BUILD GROUPS TOGETHER (1ST LEVEL)

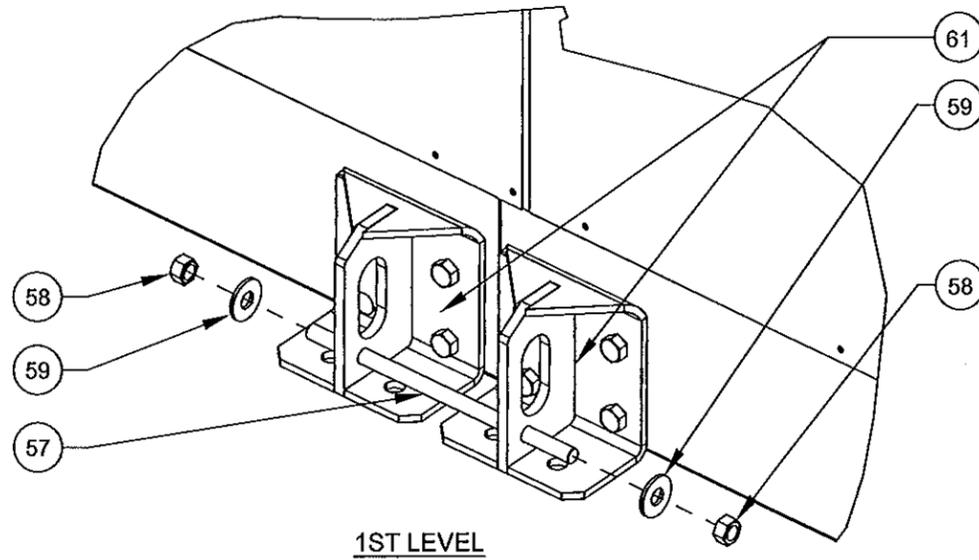


REMOVE LUG FIXTURES AND INSTALL SPLICE PLATE TO HOLD THE BUILD GROUP BASES TOGETHER. IF A LUG IS REQUIRED AT THAT LOCATION, IT SHALL BE CENTERED ON THE SPLICE PLATE.

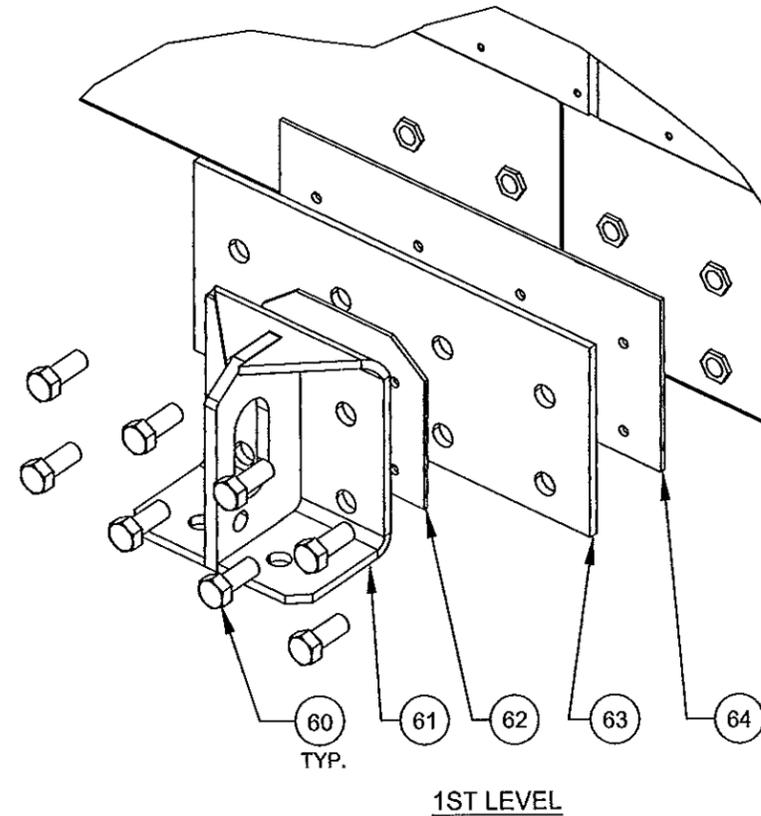


NOTES:

1. SECTIONS / BUILDGROUPS PULLED TOGETHER WITH THREADED ROD.
2. IF NEEDED, THIS CAN BE WITH ITEM 63 OR LEAVE IT AS IS WITH THREADED ROD.
3. FOR 2ND LEVEL, THE THREADED BOLT IS USED TO PULL THE SECTION / BUILD GROUPS TOGETHER AND ONCE FASTENED TOGETHER, THE LIFTING LUGS 68 CAN BE REPLACED BY ITEM 41. SEE THAT ATTACHMENT DETAIL H ON THIS SHEET.

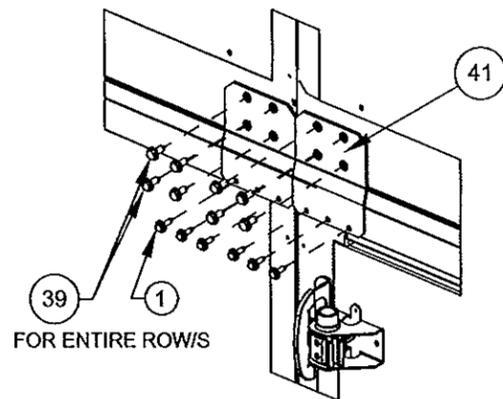

DETAIL H. STACKED UNIT BRACKET
AT SHIPPING SPLIT DETAIL

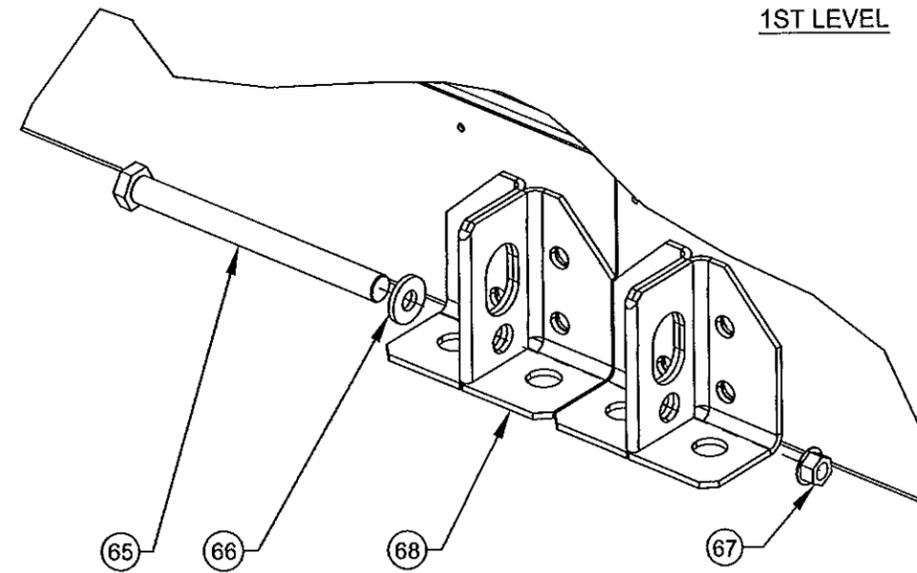


USE HEX MACHINE BOLT TO PULL BUILD GROUPS TOGETHER (2ND LEVEL)

Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control
By *[Signature]*

[Signature]
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013



DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	---	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	21 OF 46	SECTION			MOCK UPDWG SHEET REF:	44 OF 53	SCALE:	NTS	DATE	16-SEP-2013

HOOD ATTACHMENT FEATURES

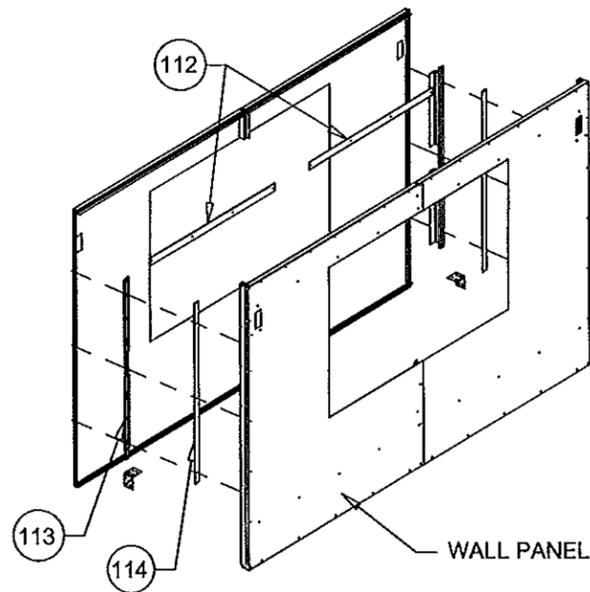



NOTES:

1. BACKING PLATE IN WALL PANEL ATTACHED WITH DOUBLE SIDED TAPE TO THE OUTER SKIN. BACKING PLATE AND WALL ANCHOR LOCATED IN THE PANEL MATCHING THE HOOD PERIMETER.
2. THE L ANGLES (ITEM 110) IN HOODS ARE SANDWICHED BETWEEN THE A FRAMES AND THE METAL SKINS. ADHESIVE (ITEM 70) IS APPLIED BETWEEN THE ANGLES AND THE METAL SKINS AS WELL.

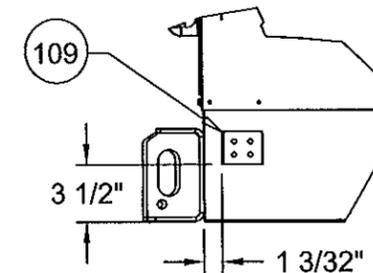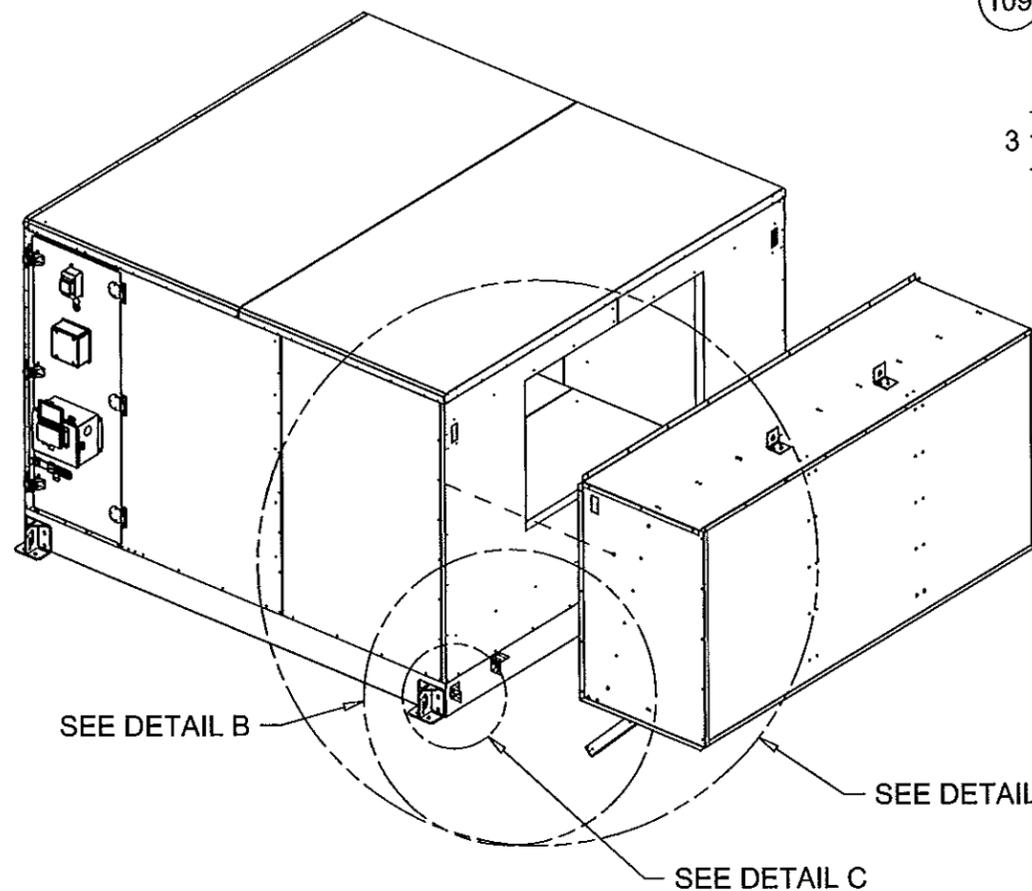


DETAIL C

HOOD ATTACHMENT

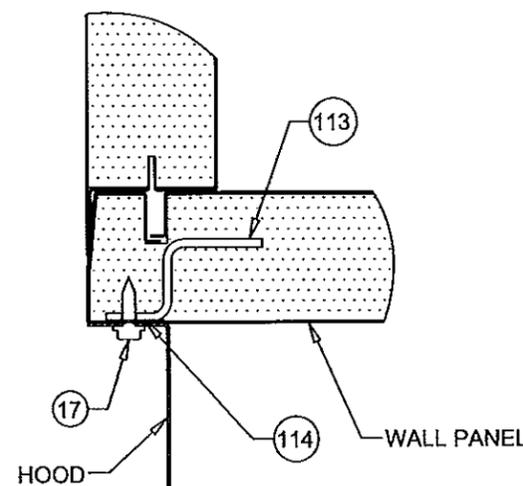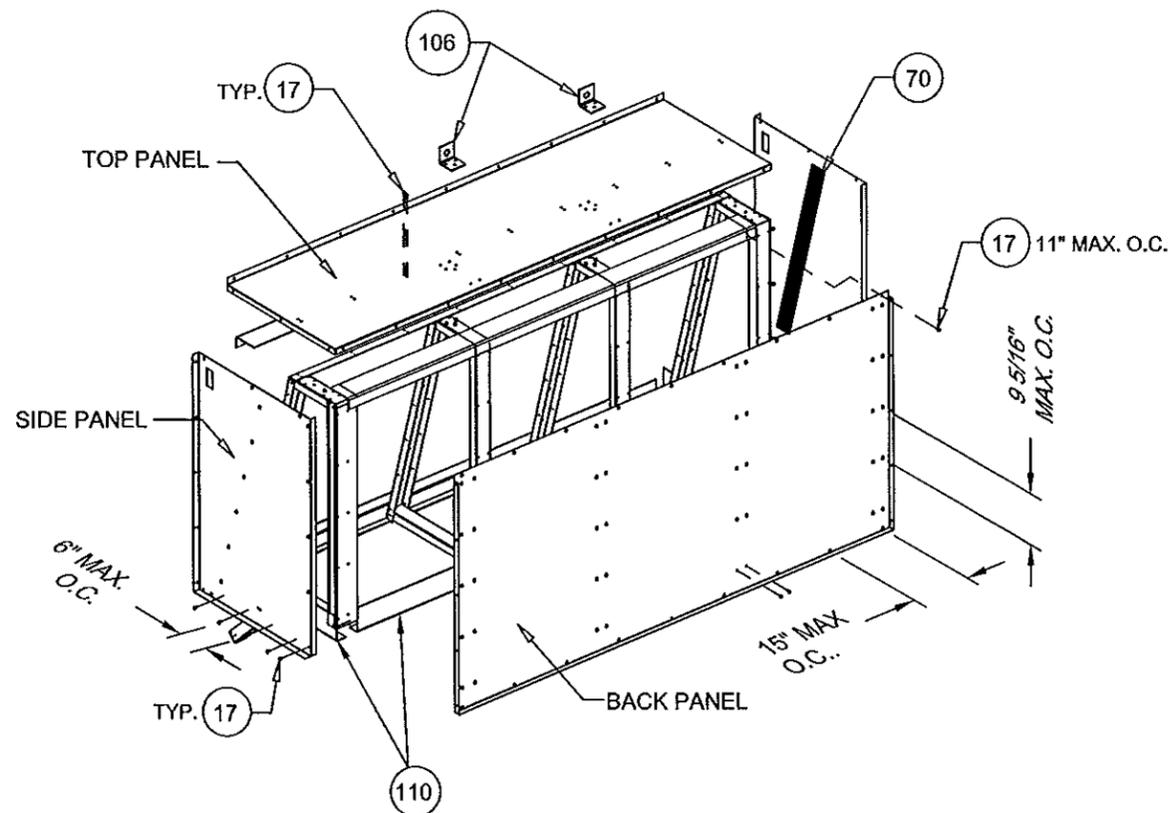

DETAIL A

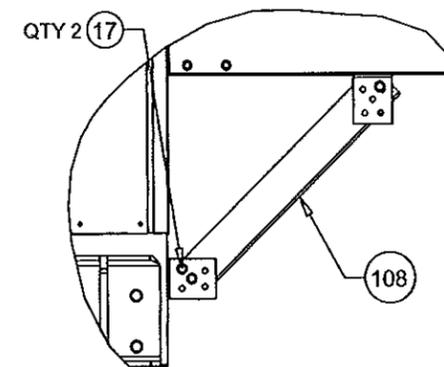

**DETAIL B
FRONT/BACK HOODS ONLY**

Approved as complying with the
Florida Building Code
Date 12/12/2013
NOAH 12-0629.01
Miami Dade Product Control
By *Healy A. Mc...*

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013






DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 22 OF 46	SECTION			MOCK UP/DWG SHEET REF: 40, 42 OF 53	SCALE: NTS	DATE 16-SEP-2013

HOOD ASSEMBLY DETAILS


HOOD DESCRIPTION	LENGTH	WIDTH	HEIGHT
BACK/FRONT HOOD	93 7/16"	27 11/16"	44 9/16"
SIDE HOOD	35 1/8"	27 3/4"	54 1/4"

NOTES:

1. SEE TABLE FOR MAX. HOOD SIZES.
2. ALL METAL SKINS ARE ATTACHED WITH 1/4" SCREWS.
3. ALL A-FRAME PARTS ARE ASSEMBLED WITH 1/4"-14 x 3/4" DRILL SCREWS (ITEM 17).
4. BOTTOM L ANGLE ATTACHED TO BOTTOM PANEL WITH ITEM 17 AT 12" O.C.

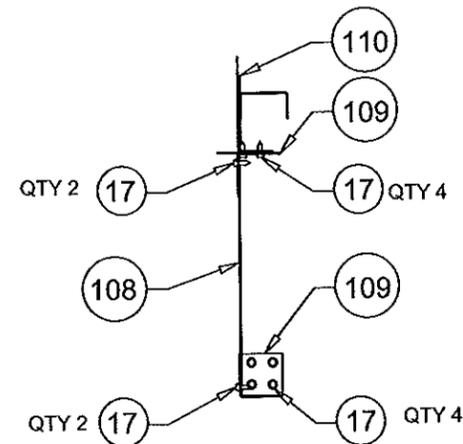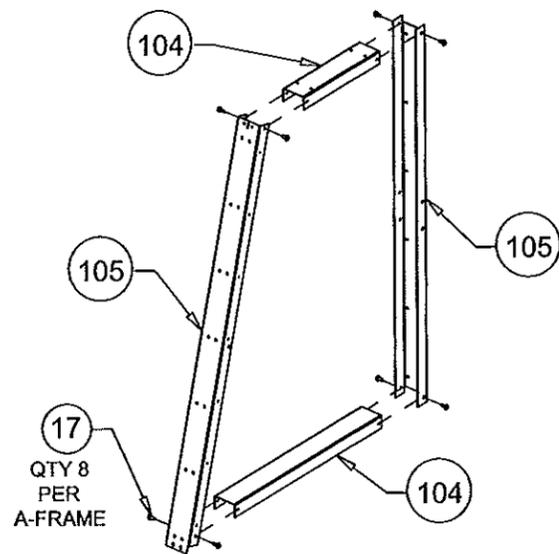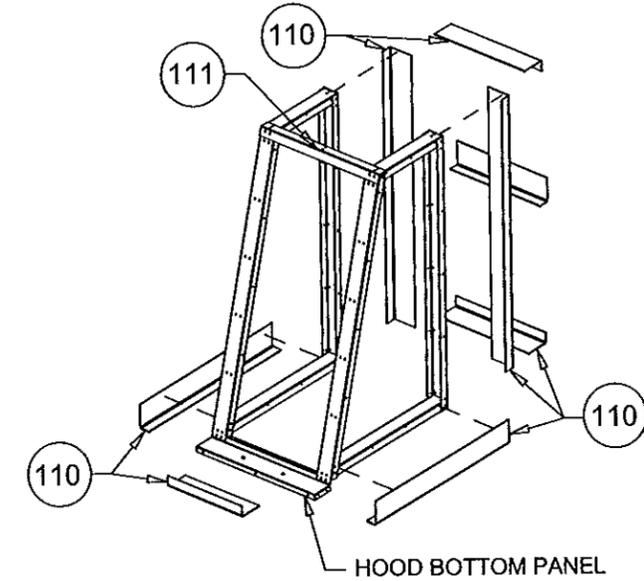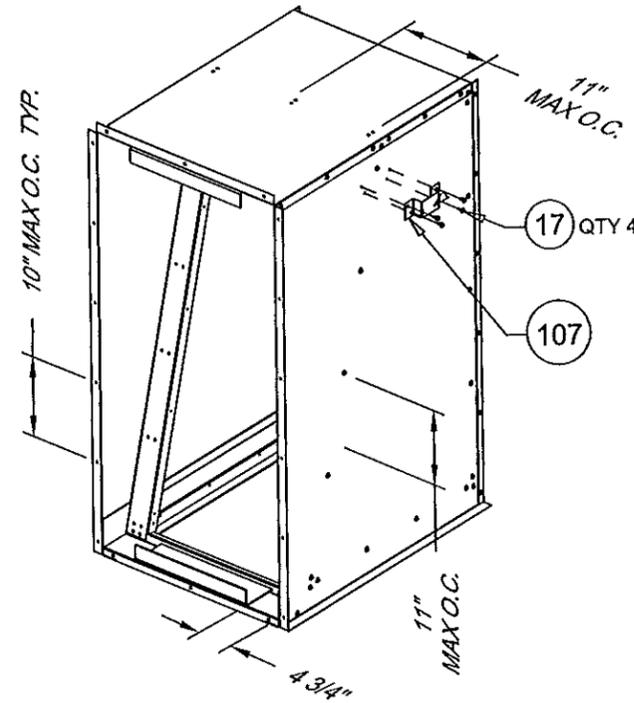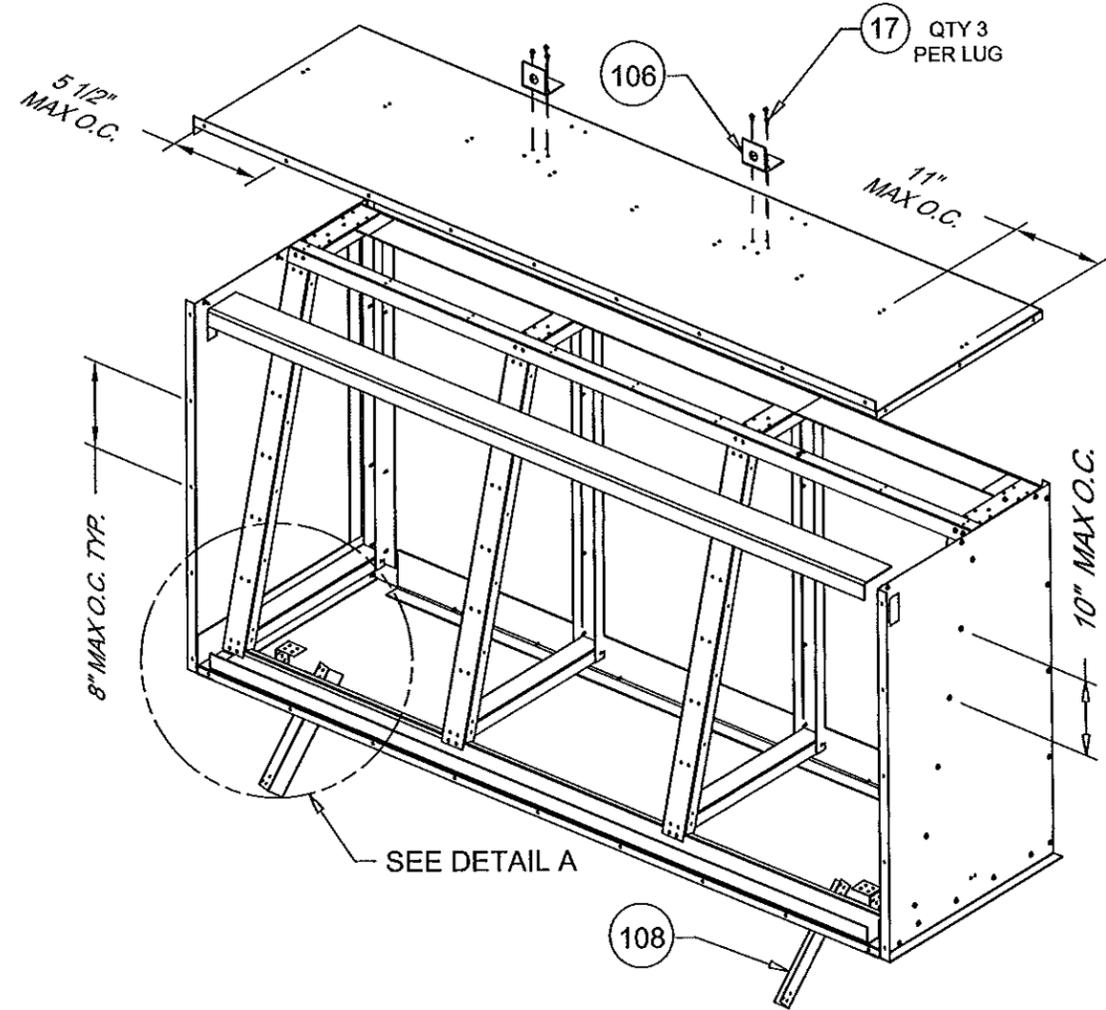

DETAIL A

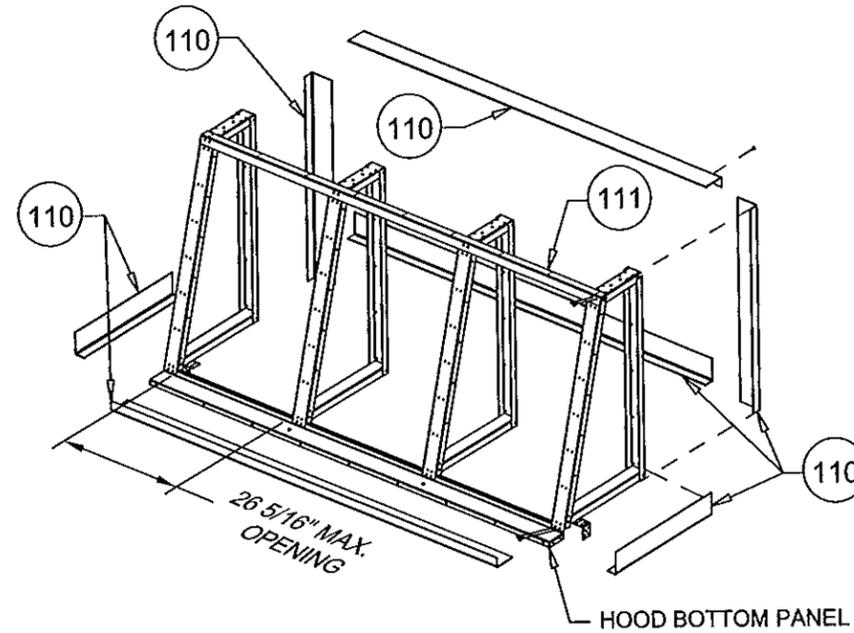



Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control
By *Helga A. Miller*

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013

DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	REV. HISTORY	---	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	23 OF 46	SECTION		MOCK UPDWG SHEET REF:	36 - 41 OF 53	SCALE:	NTS	DATE	16-SEP-2013
TRANE US Inc.									

GAS HEAT INTAKE HOOD ASSEMBLY DETAILS (TESTED WITH SIZE 50)

- NOTES:
1. SKINS ARE ADHERED WITH STRUCTURAL GLUE.
 2. ALL METAL SKINS ARE ATTACHED WITH 1/4" SCREWS.
 3. ALL A-FRAME PARTS ARE ASSEMBLED WITH ITEM 17.
 4. NO BACKING PLATE REQUIRED WHEN INLET IS ATTACHED TO DOOR.
 5. NO ITEM 110 (L ANGLE) USED FOR THIS HOOD.

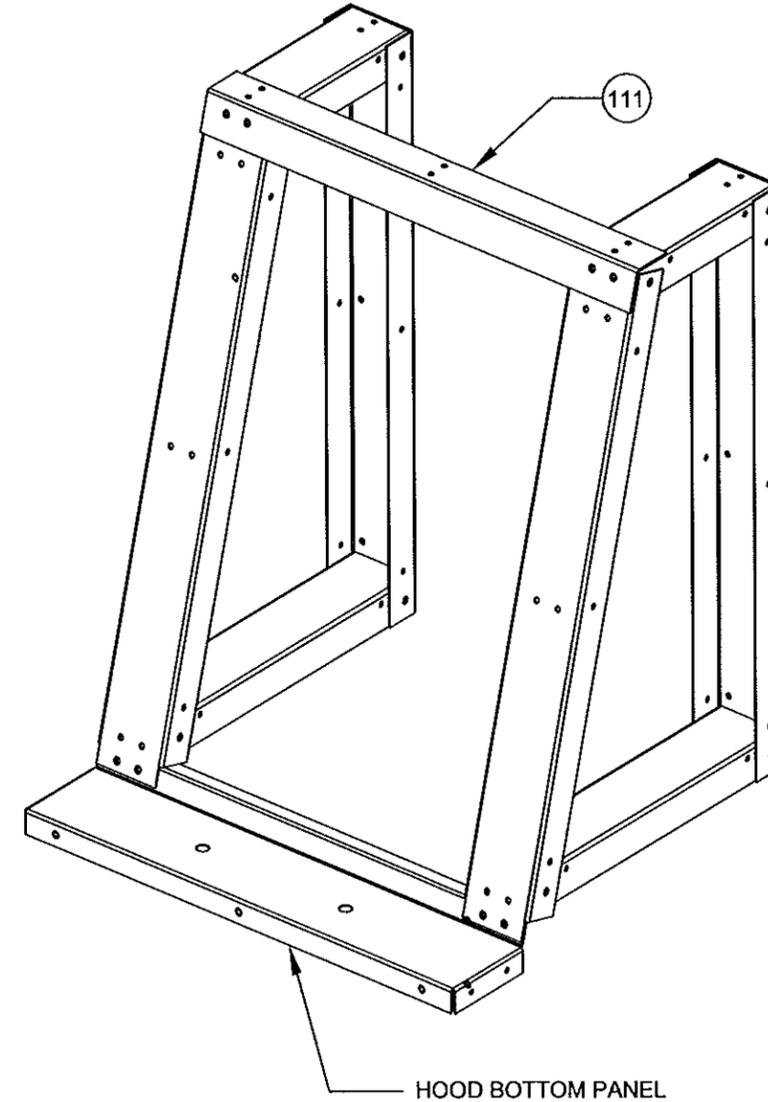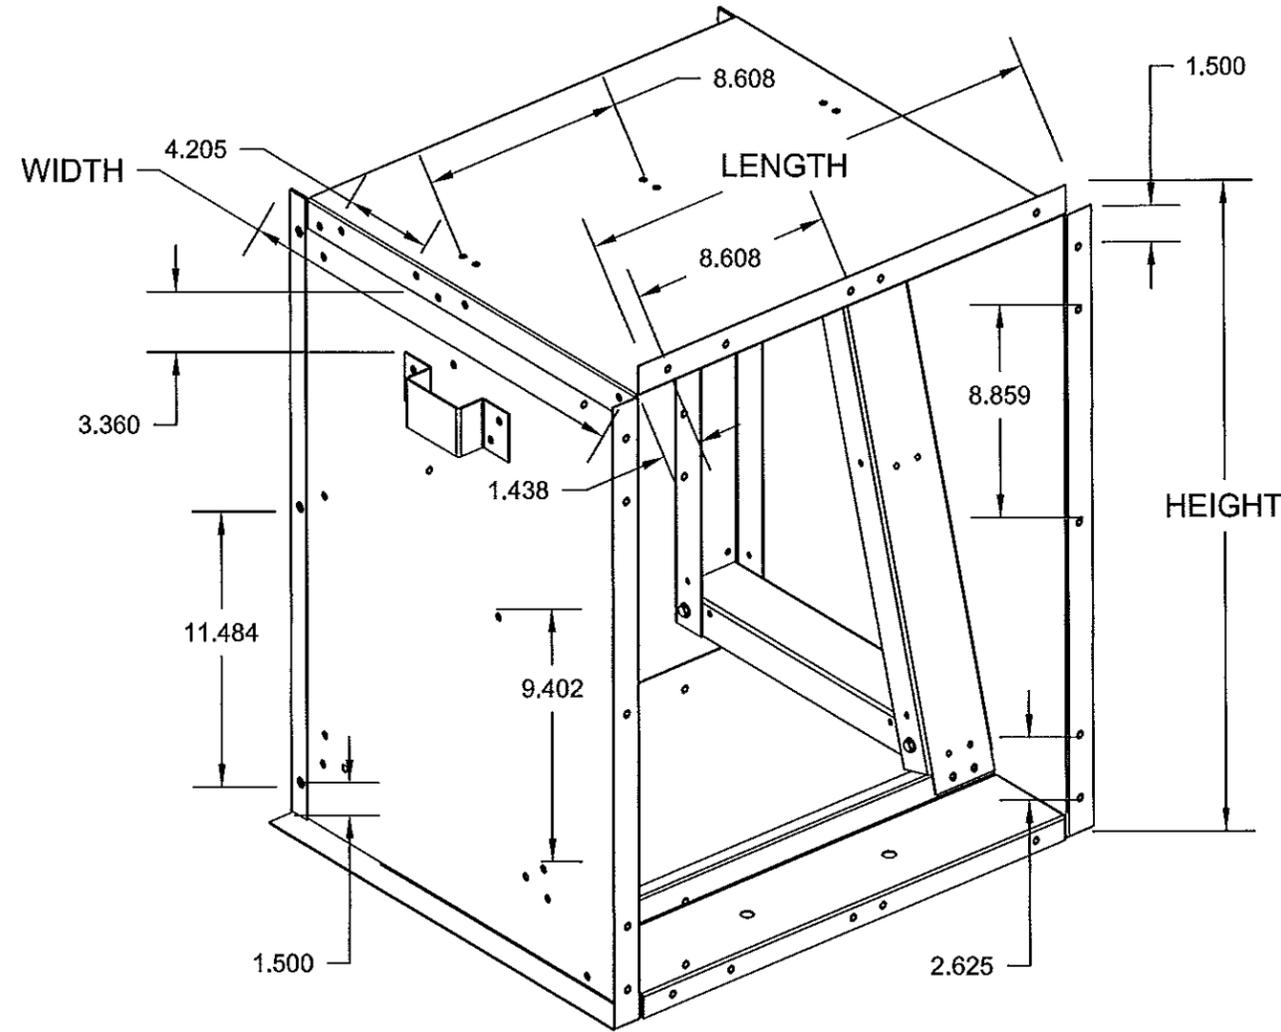

A FRAME ASSEMBLY


Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control
By *Healy A.M.*

Scott Walters
SCOTT WALTERS
FL PE# 62354
WALTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013

HOOD DESCRIPTION	LENGTH	WIDTH	HEIGHT
GAS HEAT INLET HOOD	22.780"	19.646"	27.250"


DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET	24 OF 46	SECTION			MOCK UP/DWG SHEET REF: 47 OF 63	SCALE: NTS	DATE 16-SEP-2013

PIPE CABINET DETAILS

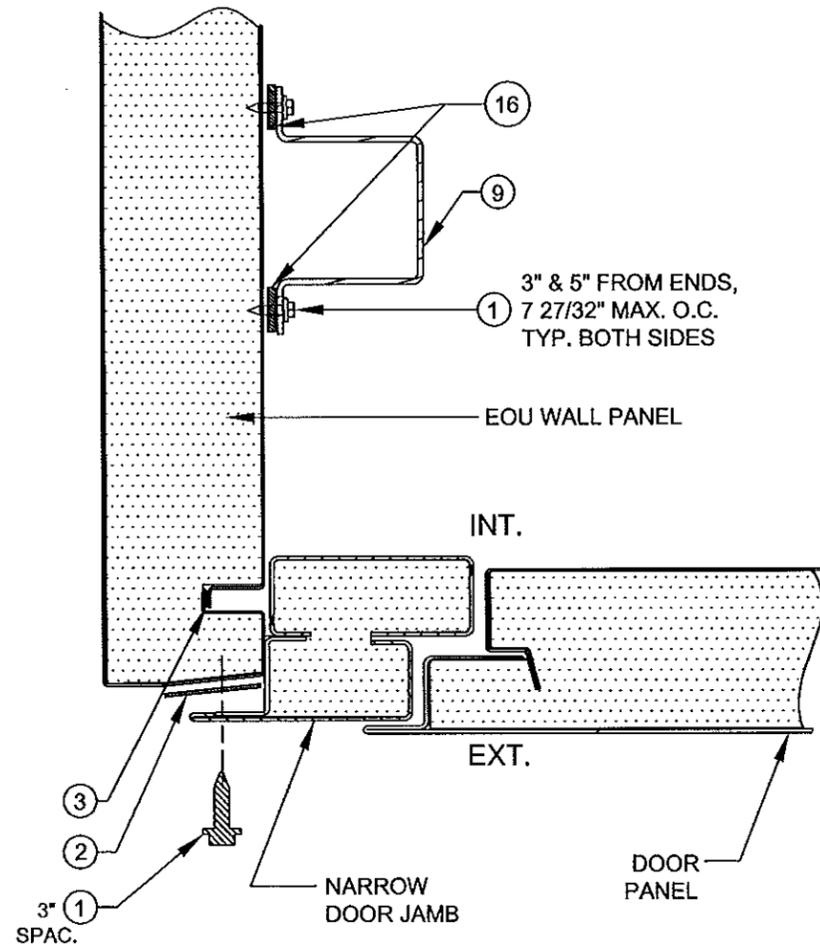


DETAIL P1. DOOR TO EOU


3" & 5" FROM ENDS,
7 27/32" MAX. O.C.
TYP. BOTH SIDES

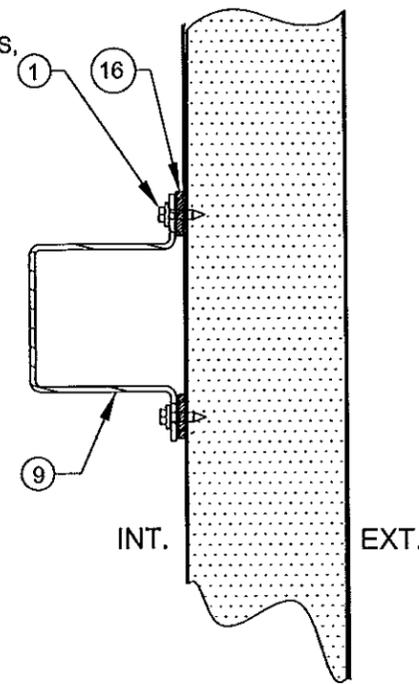

DETAIL P2. HAT CHANNEL TO WALL

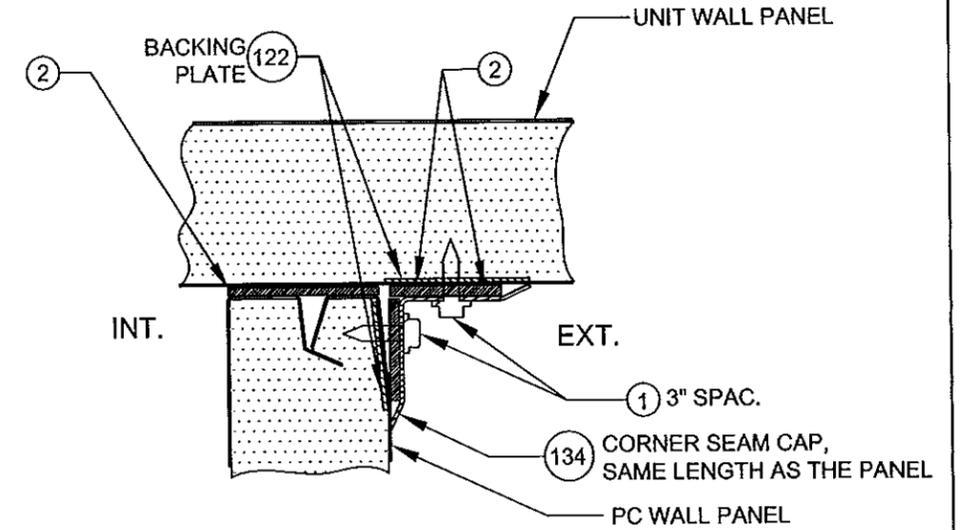

DETAIL P3. PC WALL TO UNIT WALL
TOP VIEW

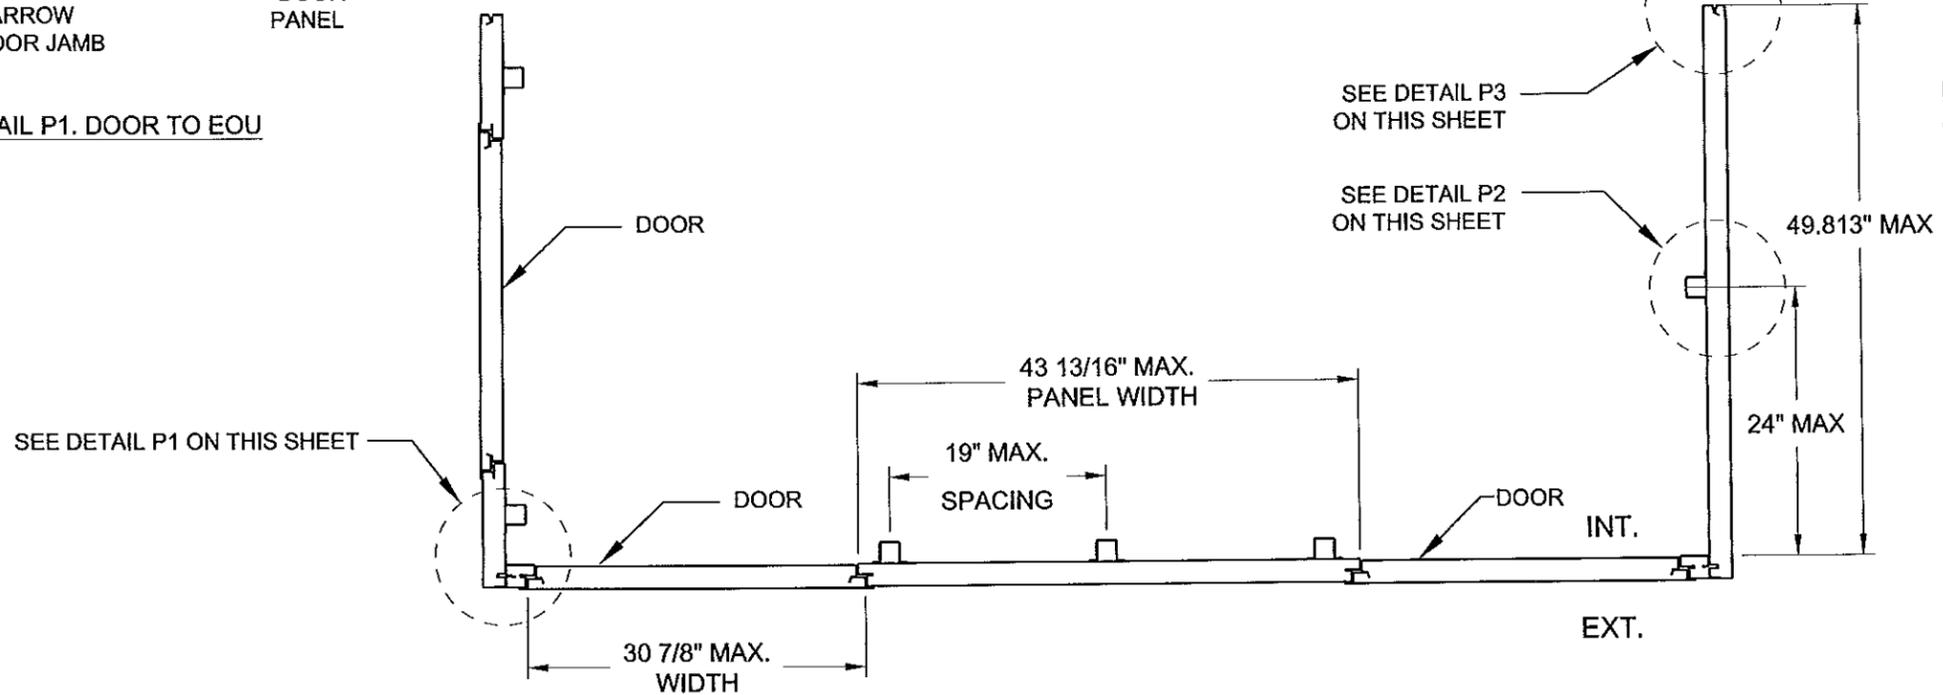

PC VERTICAL SECTIONS



Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control
By *Herby A. ...*

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013


NOTES:
1. DOORS ARE OPTIONAL .

DRAWING # AIRS0705	DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	REV. HISTORY --- MOCK UPDWG SHEET REF: ---	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 26 OF 46	SECTION	TRANE US Inc.	SCALE: NTS	DATE 16-SEP-2013


PIPE CABINET DETAILS

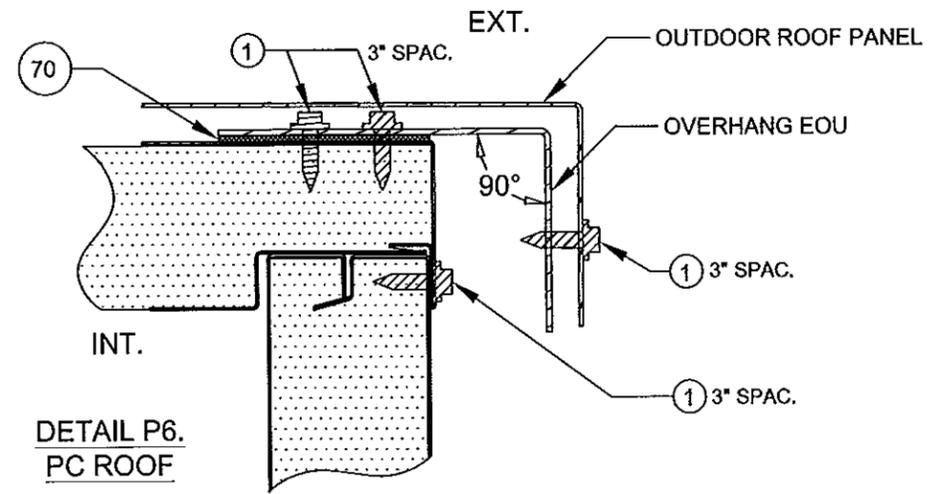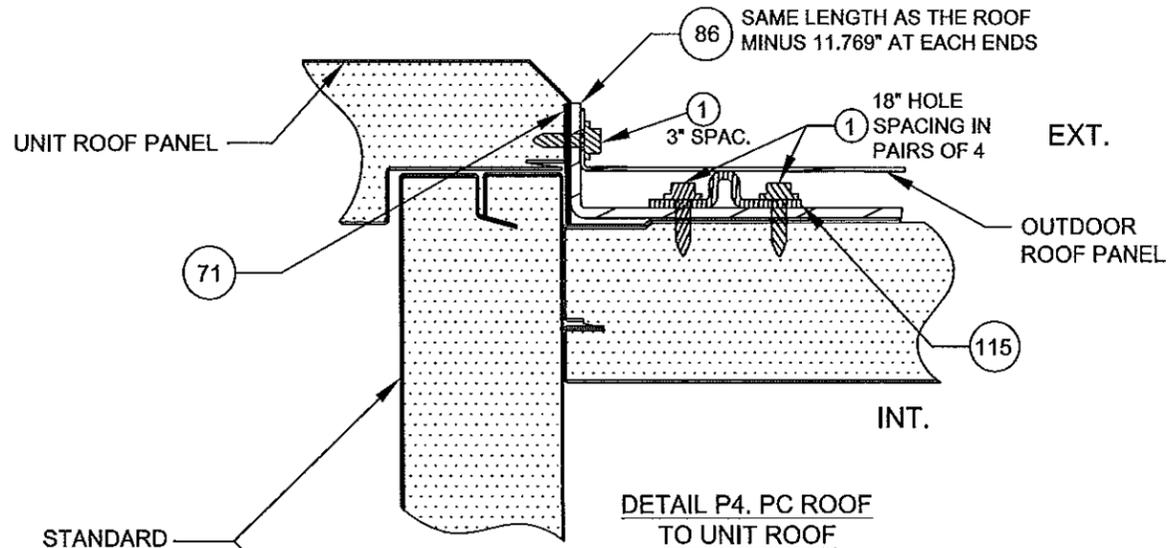

STANDARD AHU SIDE

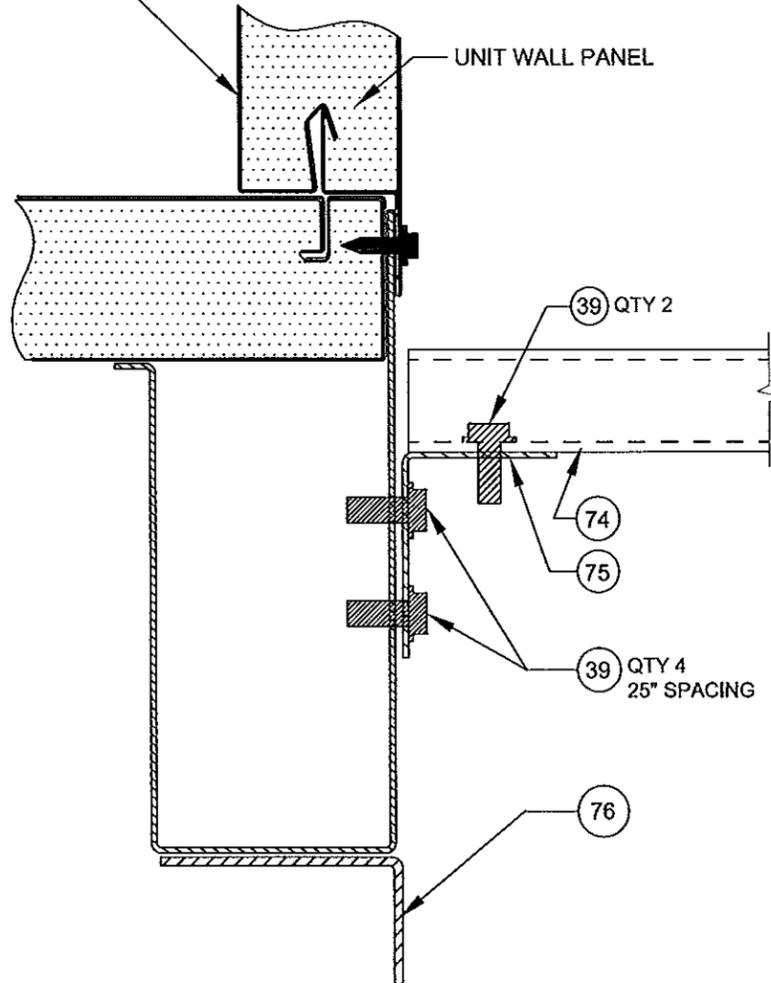

PC HORIZONTAL SECTIONS

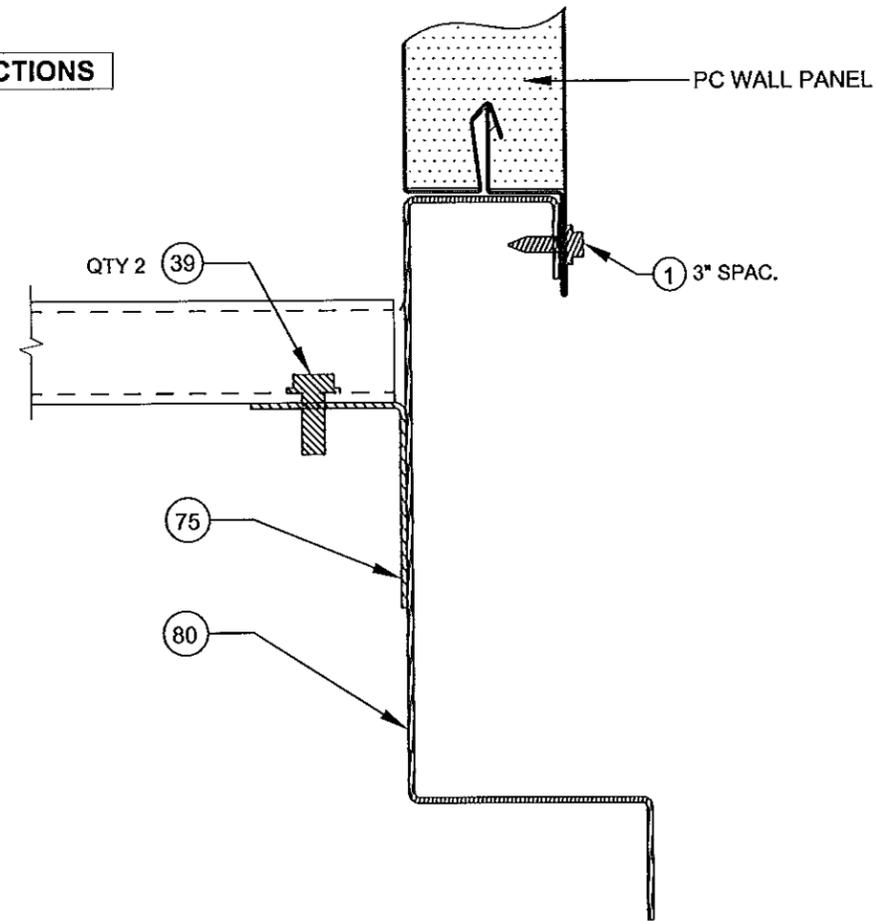

DETAIL P5. PC TO UNIT BASE


DETAIL P7. PC BASE

Approved as complying with the Florida Building Code
 Date 12/12/2013
 NOA# 12-0629.01
 Miami Dade Product Control
 By *Heather H. ...*


Scott Wolters
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 27 OF 46	SECTION			MOCK UP/DWG SHEET REF: 4, 11-13 OF 19	SCALE: NTS	DATE 16-SEP-2013


PIPE CABINET DETAILS

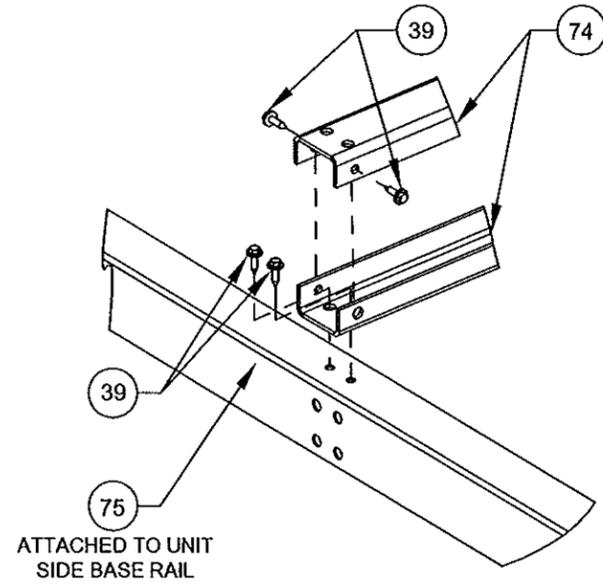


DETAIL P8. MULLION ASSEMBLY ATTACHMENT

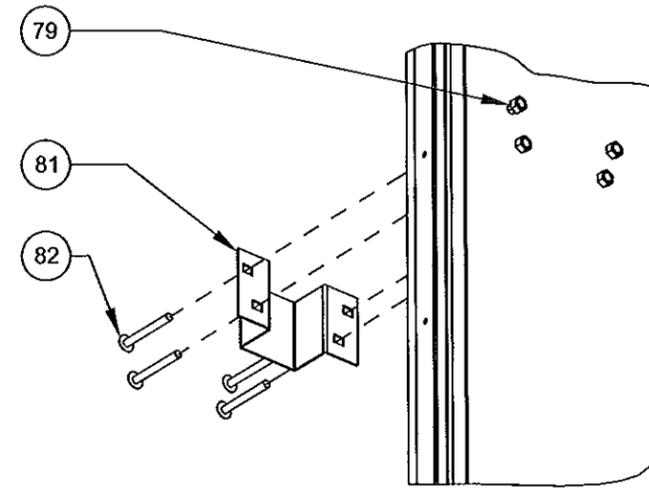

DETAIL P10. CHAIN GUIDE/GUARD ATTACHMENT

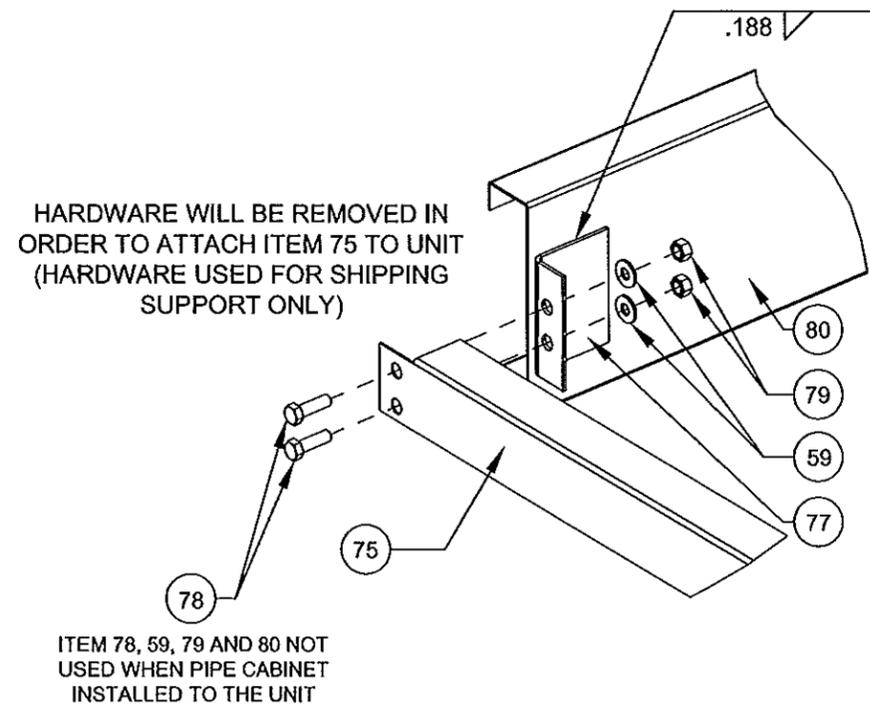

DETAIL P9. SHIPPING CORNER

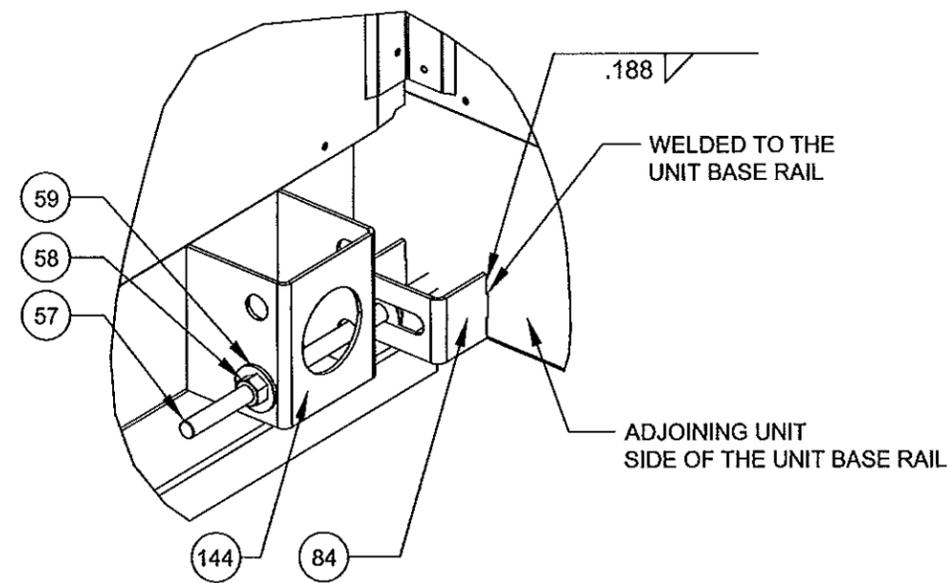


DETAIL P11. LUG CONNECTION

Approved as complying with the
 Florida Building Code
 Date 12/12/2013
 NOA#12-0629.01
 Miami Dade Product Control
 By *[Signature]*

[Signature]
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013



DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY ---	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 28 OF 46	SECTION			MOCK UP/DWG SHEET REF: 3, 6 OF 19	SCALE: NTS	DATE 16-SEP-2013

GAS HEAT FLUE DUCT DETAILS (TESTED WITH SIZE 50)

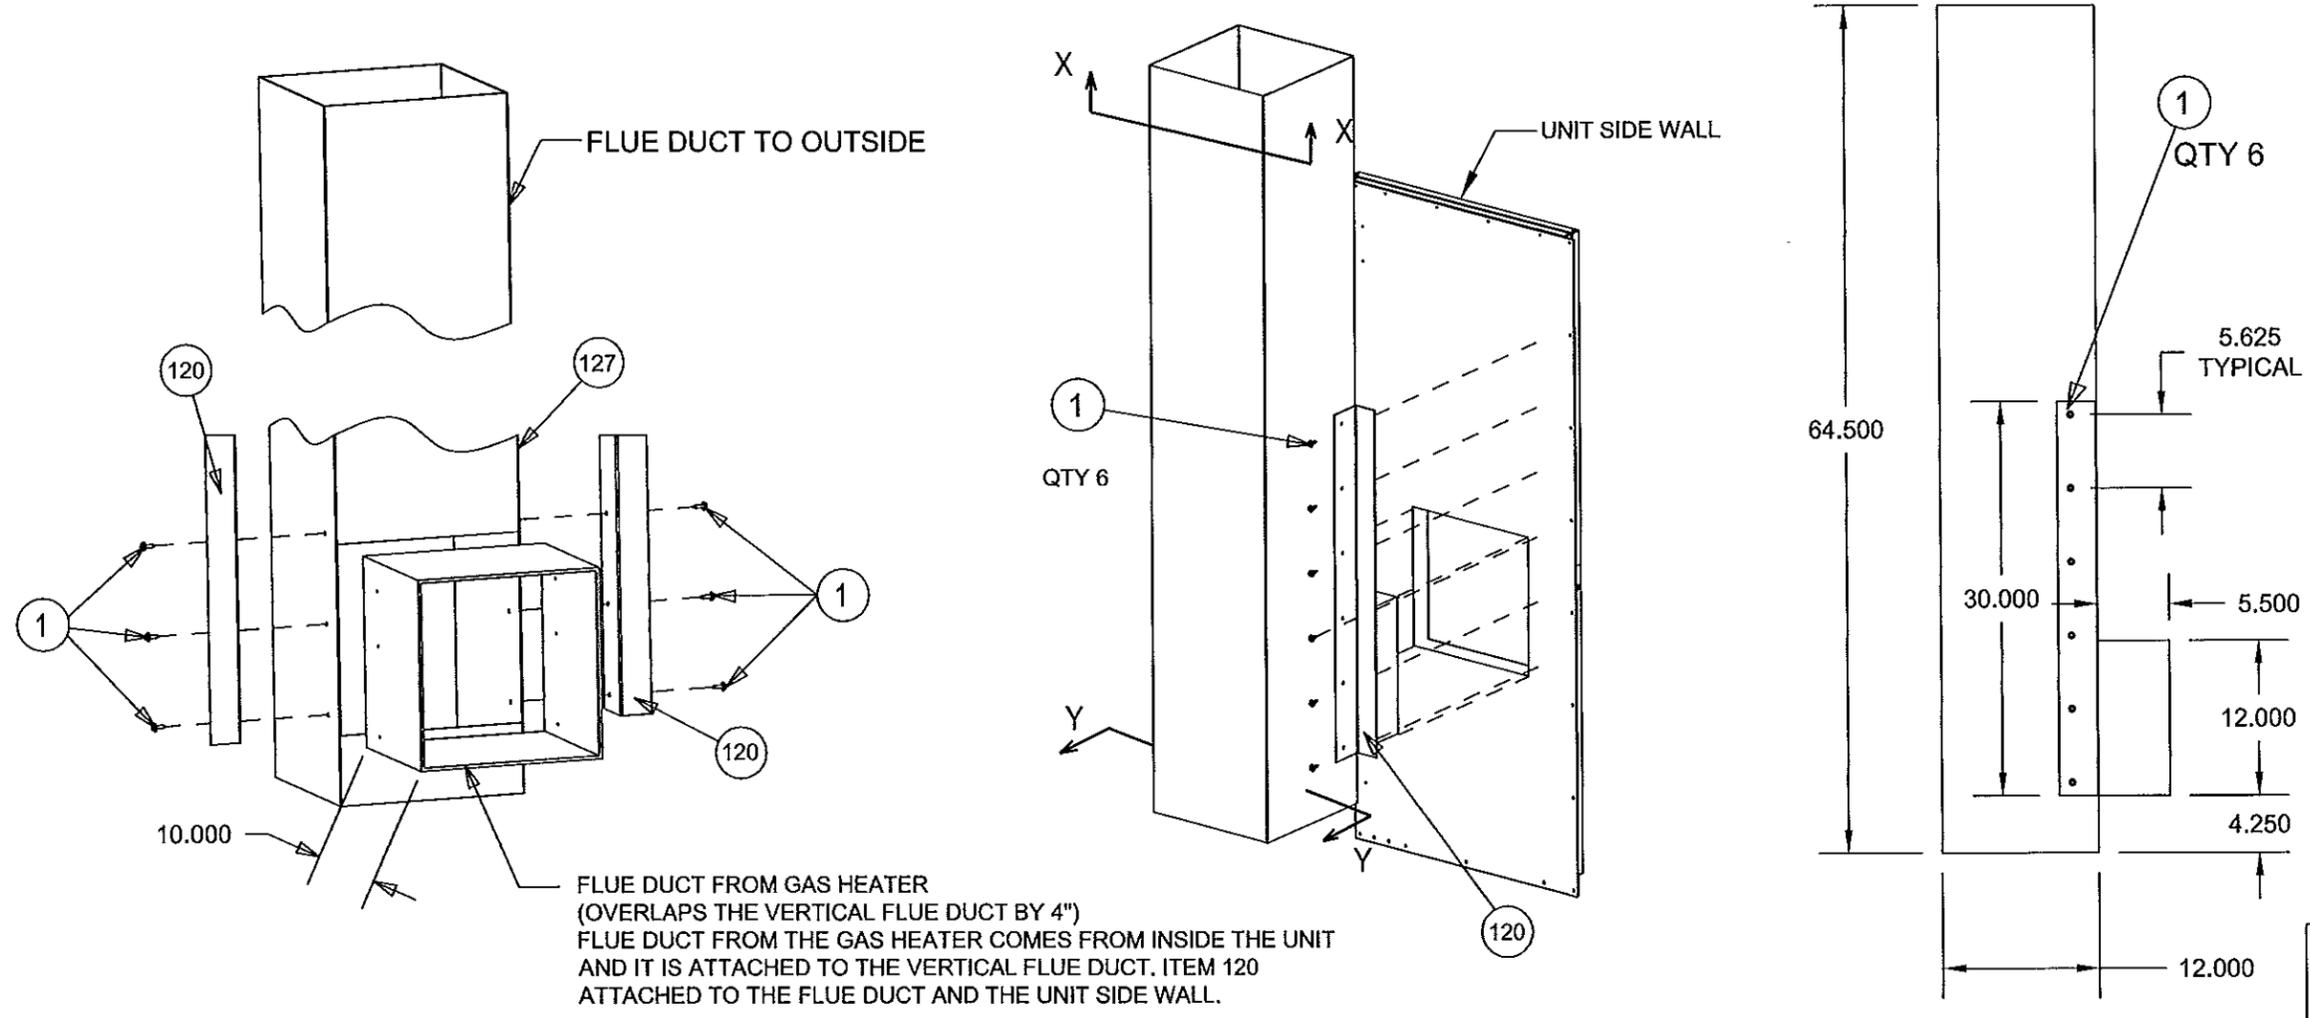

Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629-01
Miami Dade Product Control
By *Harley A. Miller*

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013

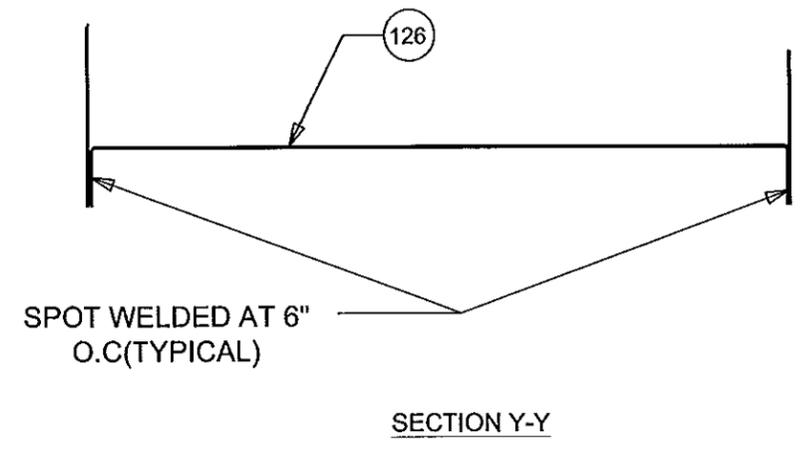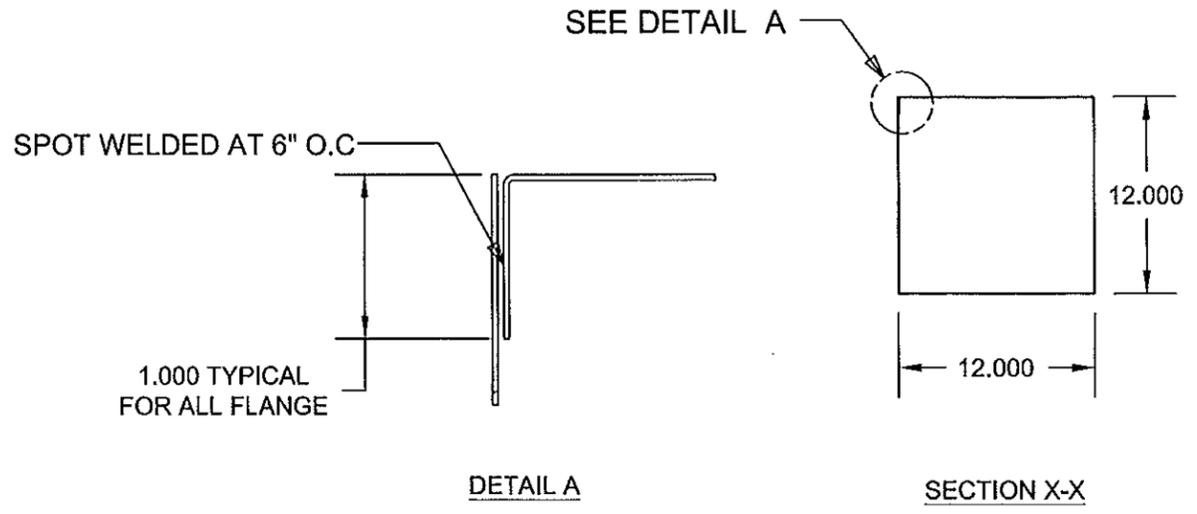


DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	29 OF 46				MOCK UP DWG SHEET REF: 21 OF 63	SCALE: NTS	DATE	16-SEP-2013

**ENERGY WHEEL
(SIZE 3-21)
(SINGLE HEIGHT DOOR)**

NOTES:

1. THIS ENERGY WHEEL SECTION IS COMMONLY REFERENCED AS 2-LEVEL SECTION, THUS THE INTERNAL COMPONENTS ARE NOT LIMITED TO ENERGY WHEEL APPLICATION PROVIDED THAT EXTERNAL STRUCTURE IS AS INDICATED HERE.


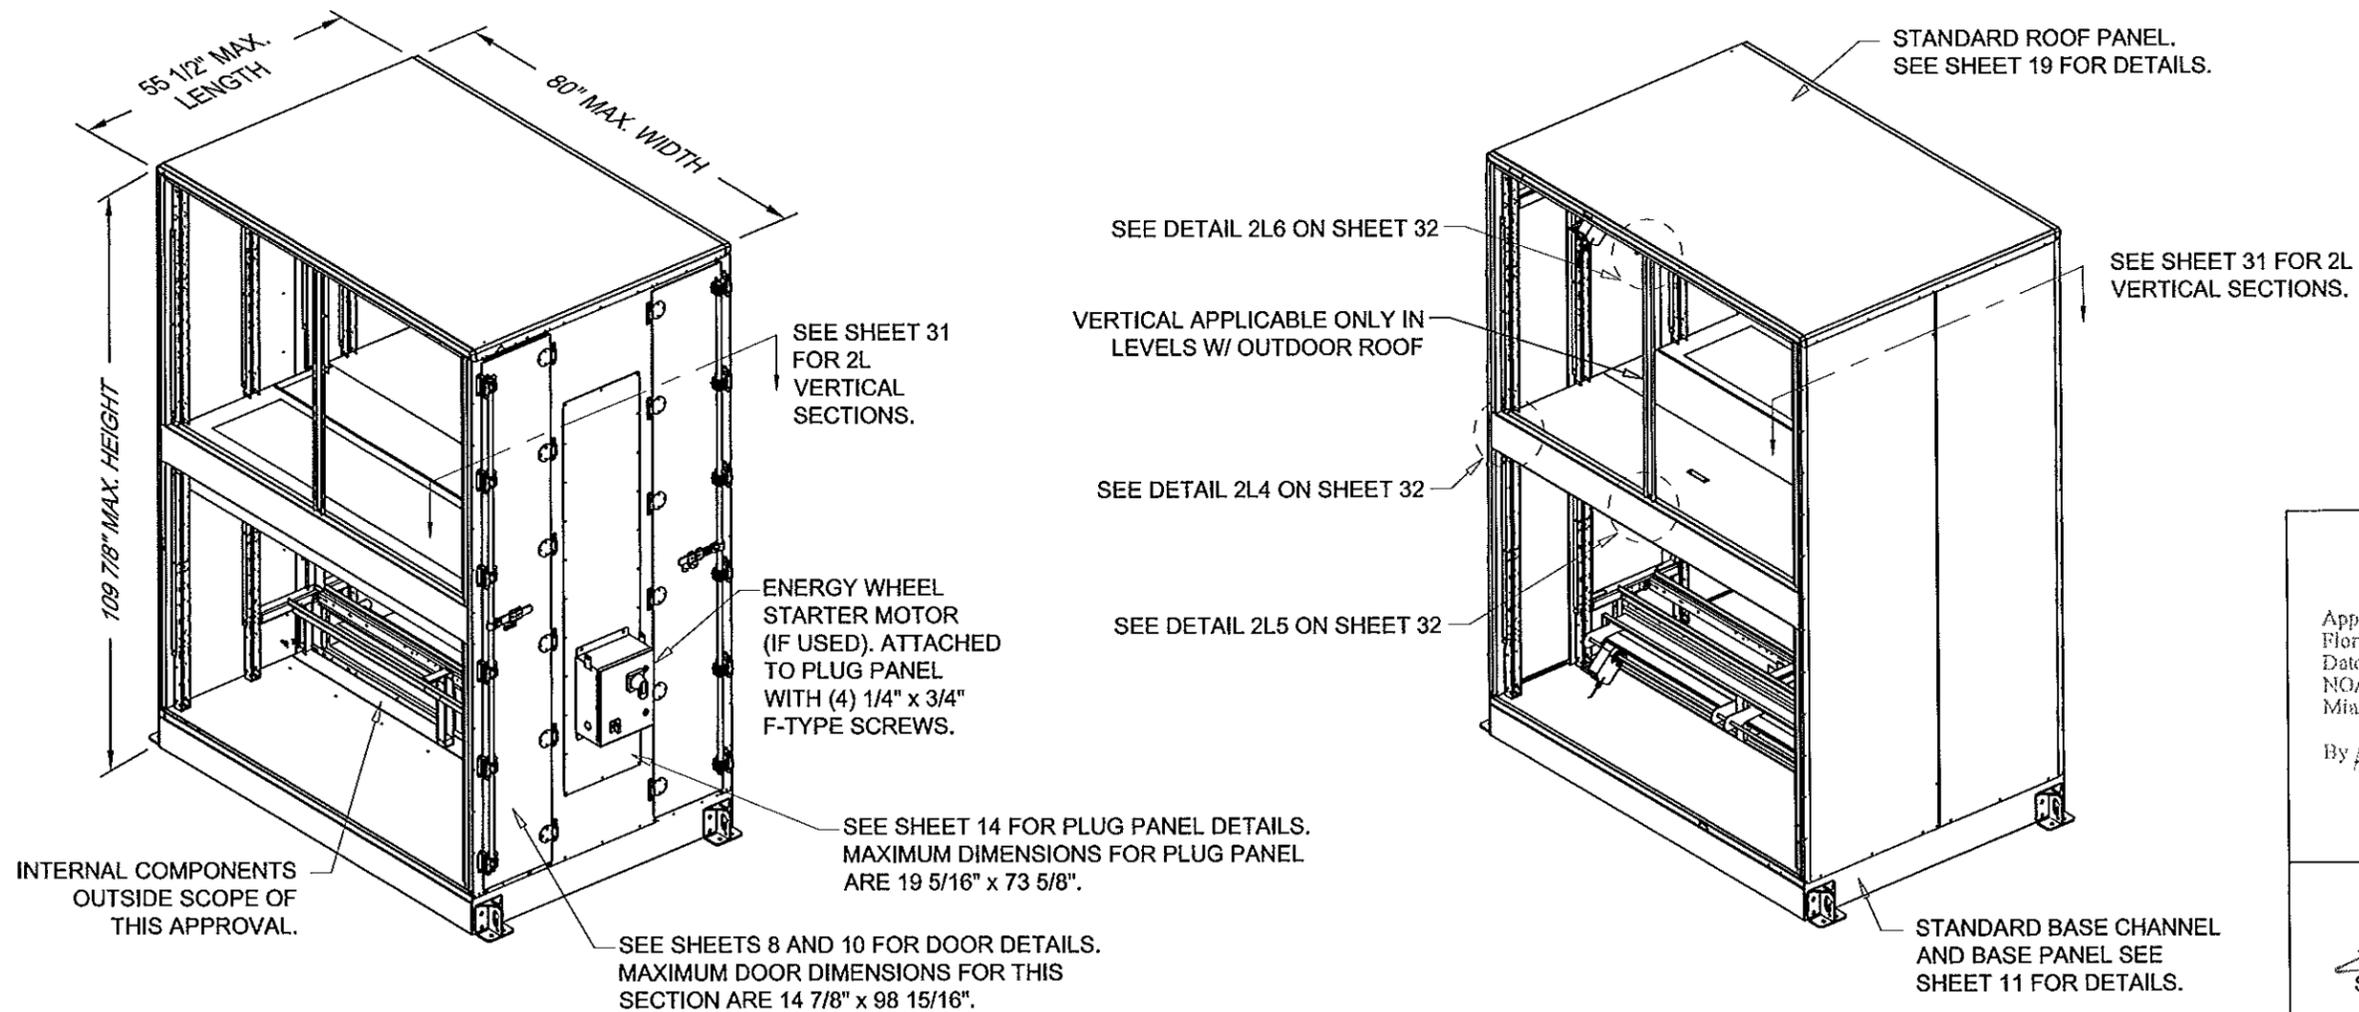


Approved as complying with the Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control
By *Heidi A. Miller*


Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 30 OF 46	SECTION			MOCK UP DWG SHEET REF: 3 OF 32	SCALE: NTS	DATE 16-SEP-2013


**ENERGY WHEEL
(SIZE 3-21)**

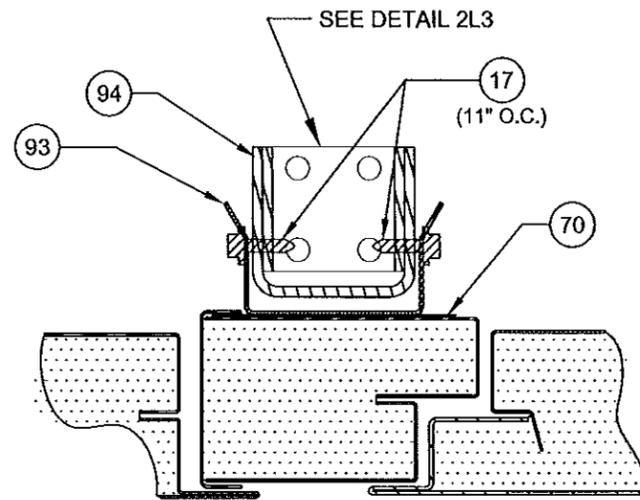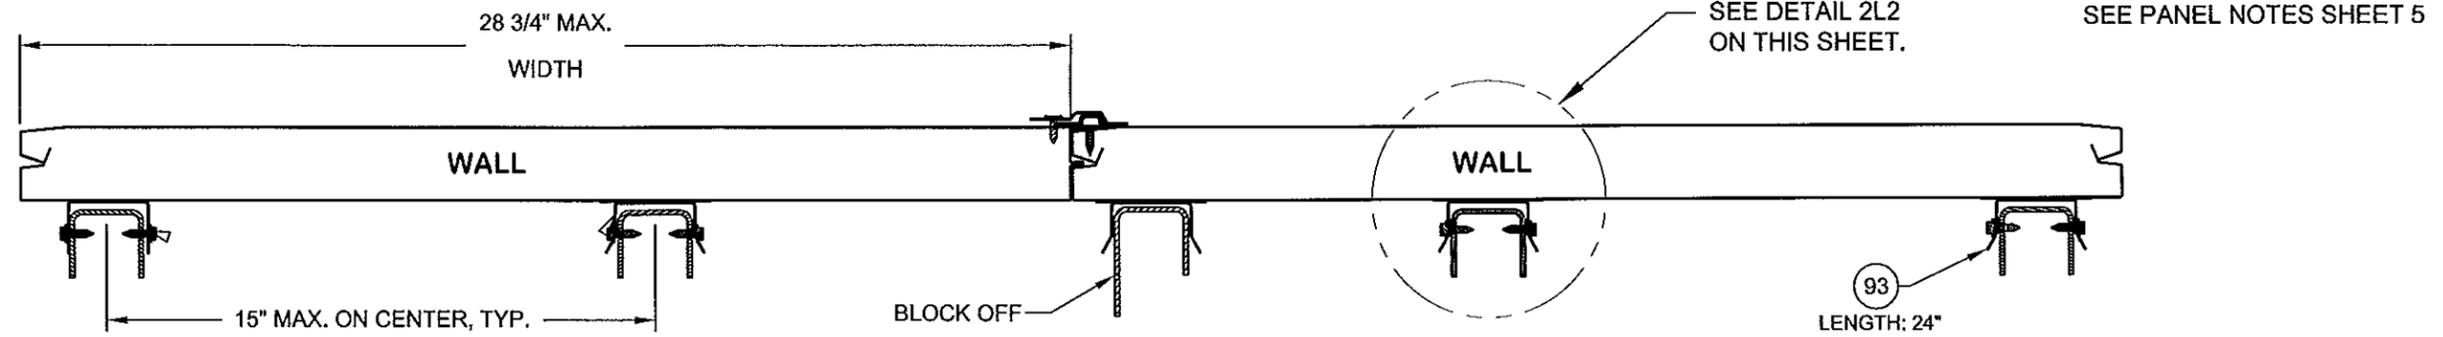


DETAIL 2L1

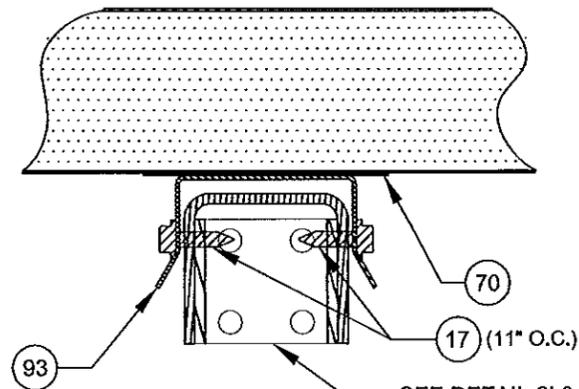

DETAIL 2L2

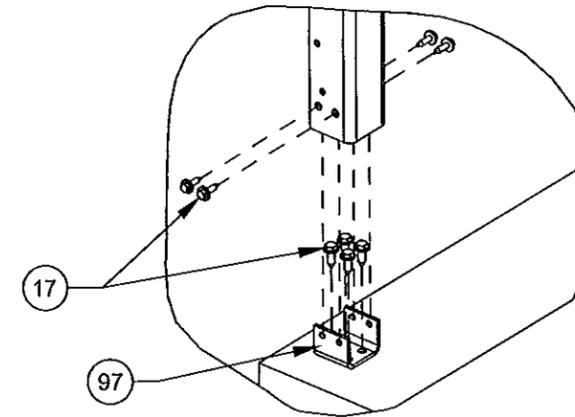

DETAIL 2L3

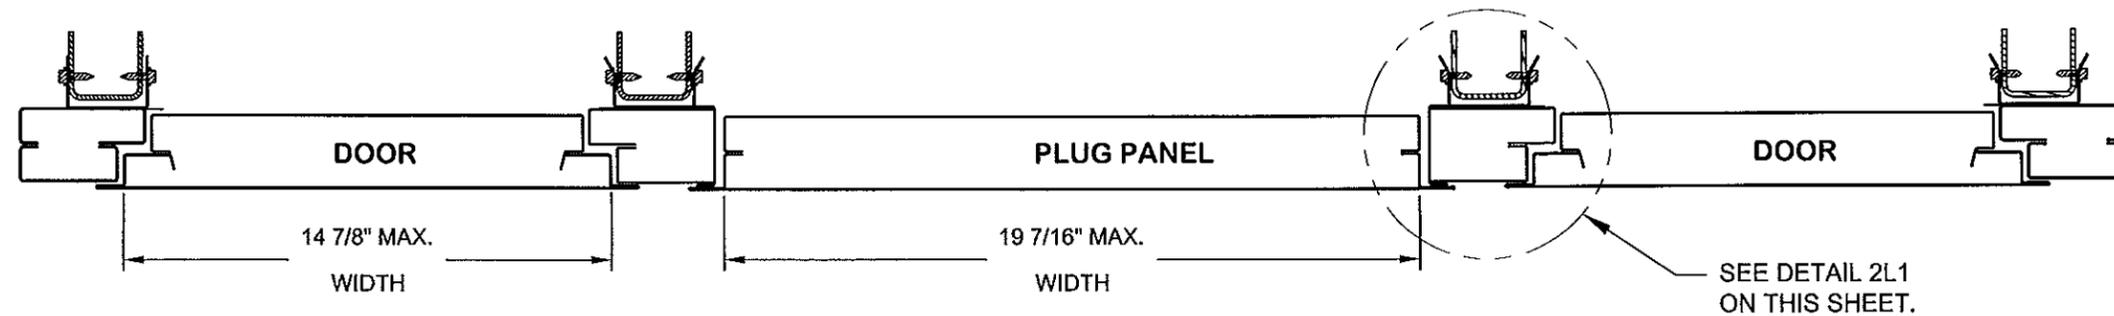

SEE DETAIL 2L1 ON THIS SHEET.



Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control
By *Heather A. Miller*

Scott Walters
SCOTT WALTERS
FL PE# 62354
WALTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013


DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY ---	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 31 OF 46	SECTION			MOCK UP/DWG SHEET REF: 17 OF 32	SCALE: NTS	DATE 16-SEP-2013

**ENERGY WHEEL
(SIZE 3-21)**


INTERNAL STRUCTURE SAME AS SIZE 50, SEE PAGES 35-38

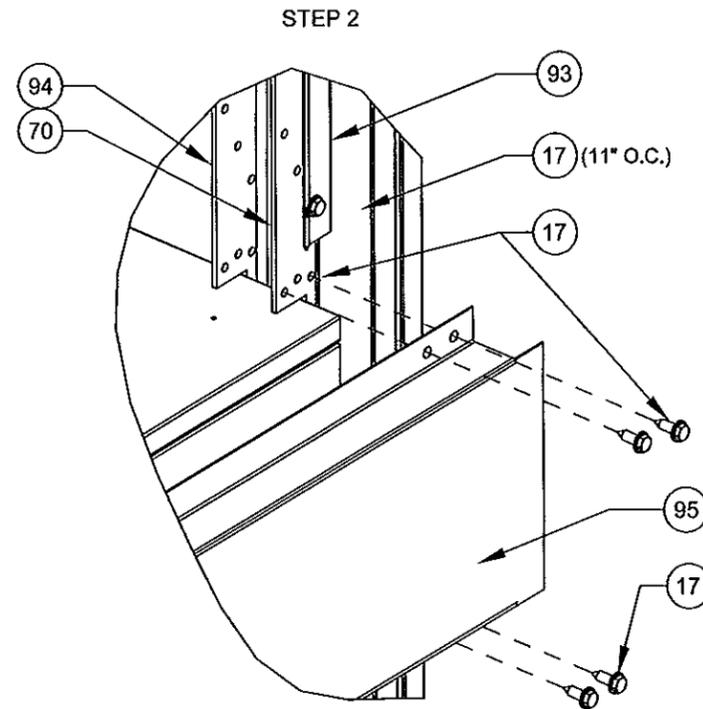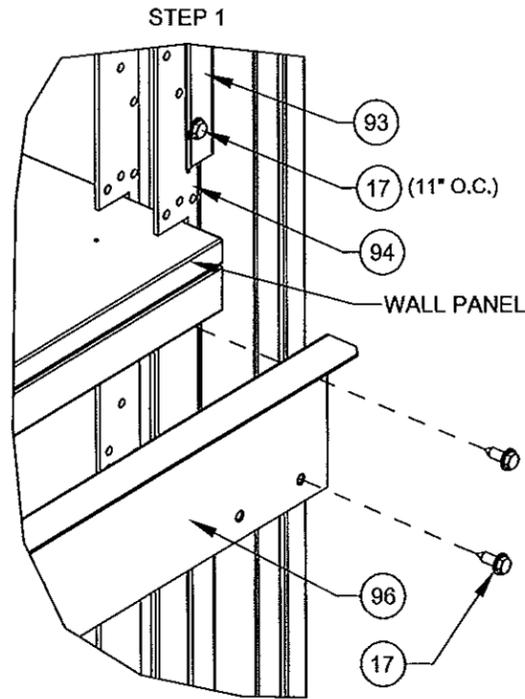

DETAIL 2L4

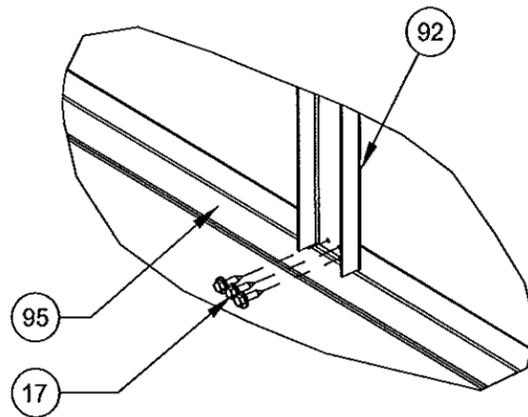

DETAIL 2L5

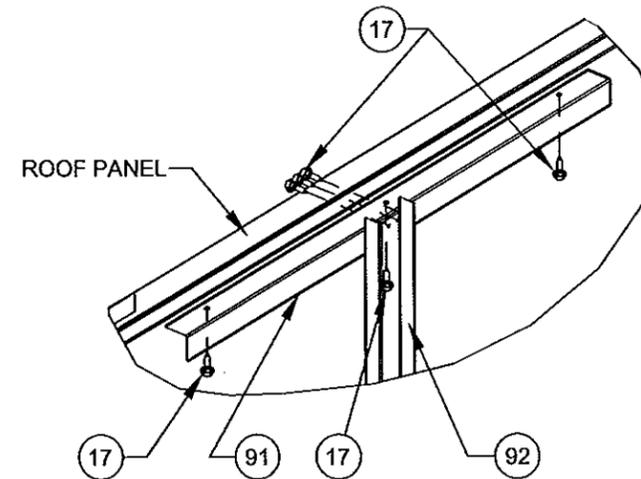

DETAIL 2L6

Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control

By *[Signature]*

[Signature]
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013


DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 32 OF 46	SECTION			MOCK UP/DWG SHEET REF: 2 OF 53	SCALE: NTS	DATE 16-SEP-2013

ENERGY WHEEL

(SIZE 25-30)

NOTES:

1. THIS ENERGY WHEEL SECTION IS COMMONLY REFERENCED AS 2-LEVEL SECTION, THUS THE INTERNAL COMPONENTS ARE NOT LIMITED TO ENERGY WHEEL APPLICATION PROVIDED THAT EXTERNAL STRUCTURE IS AS INDICATED HERE.

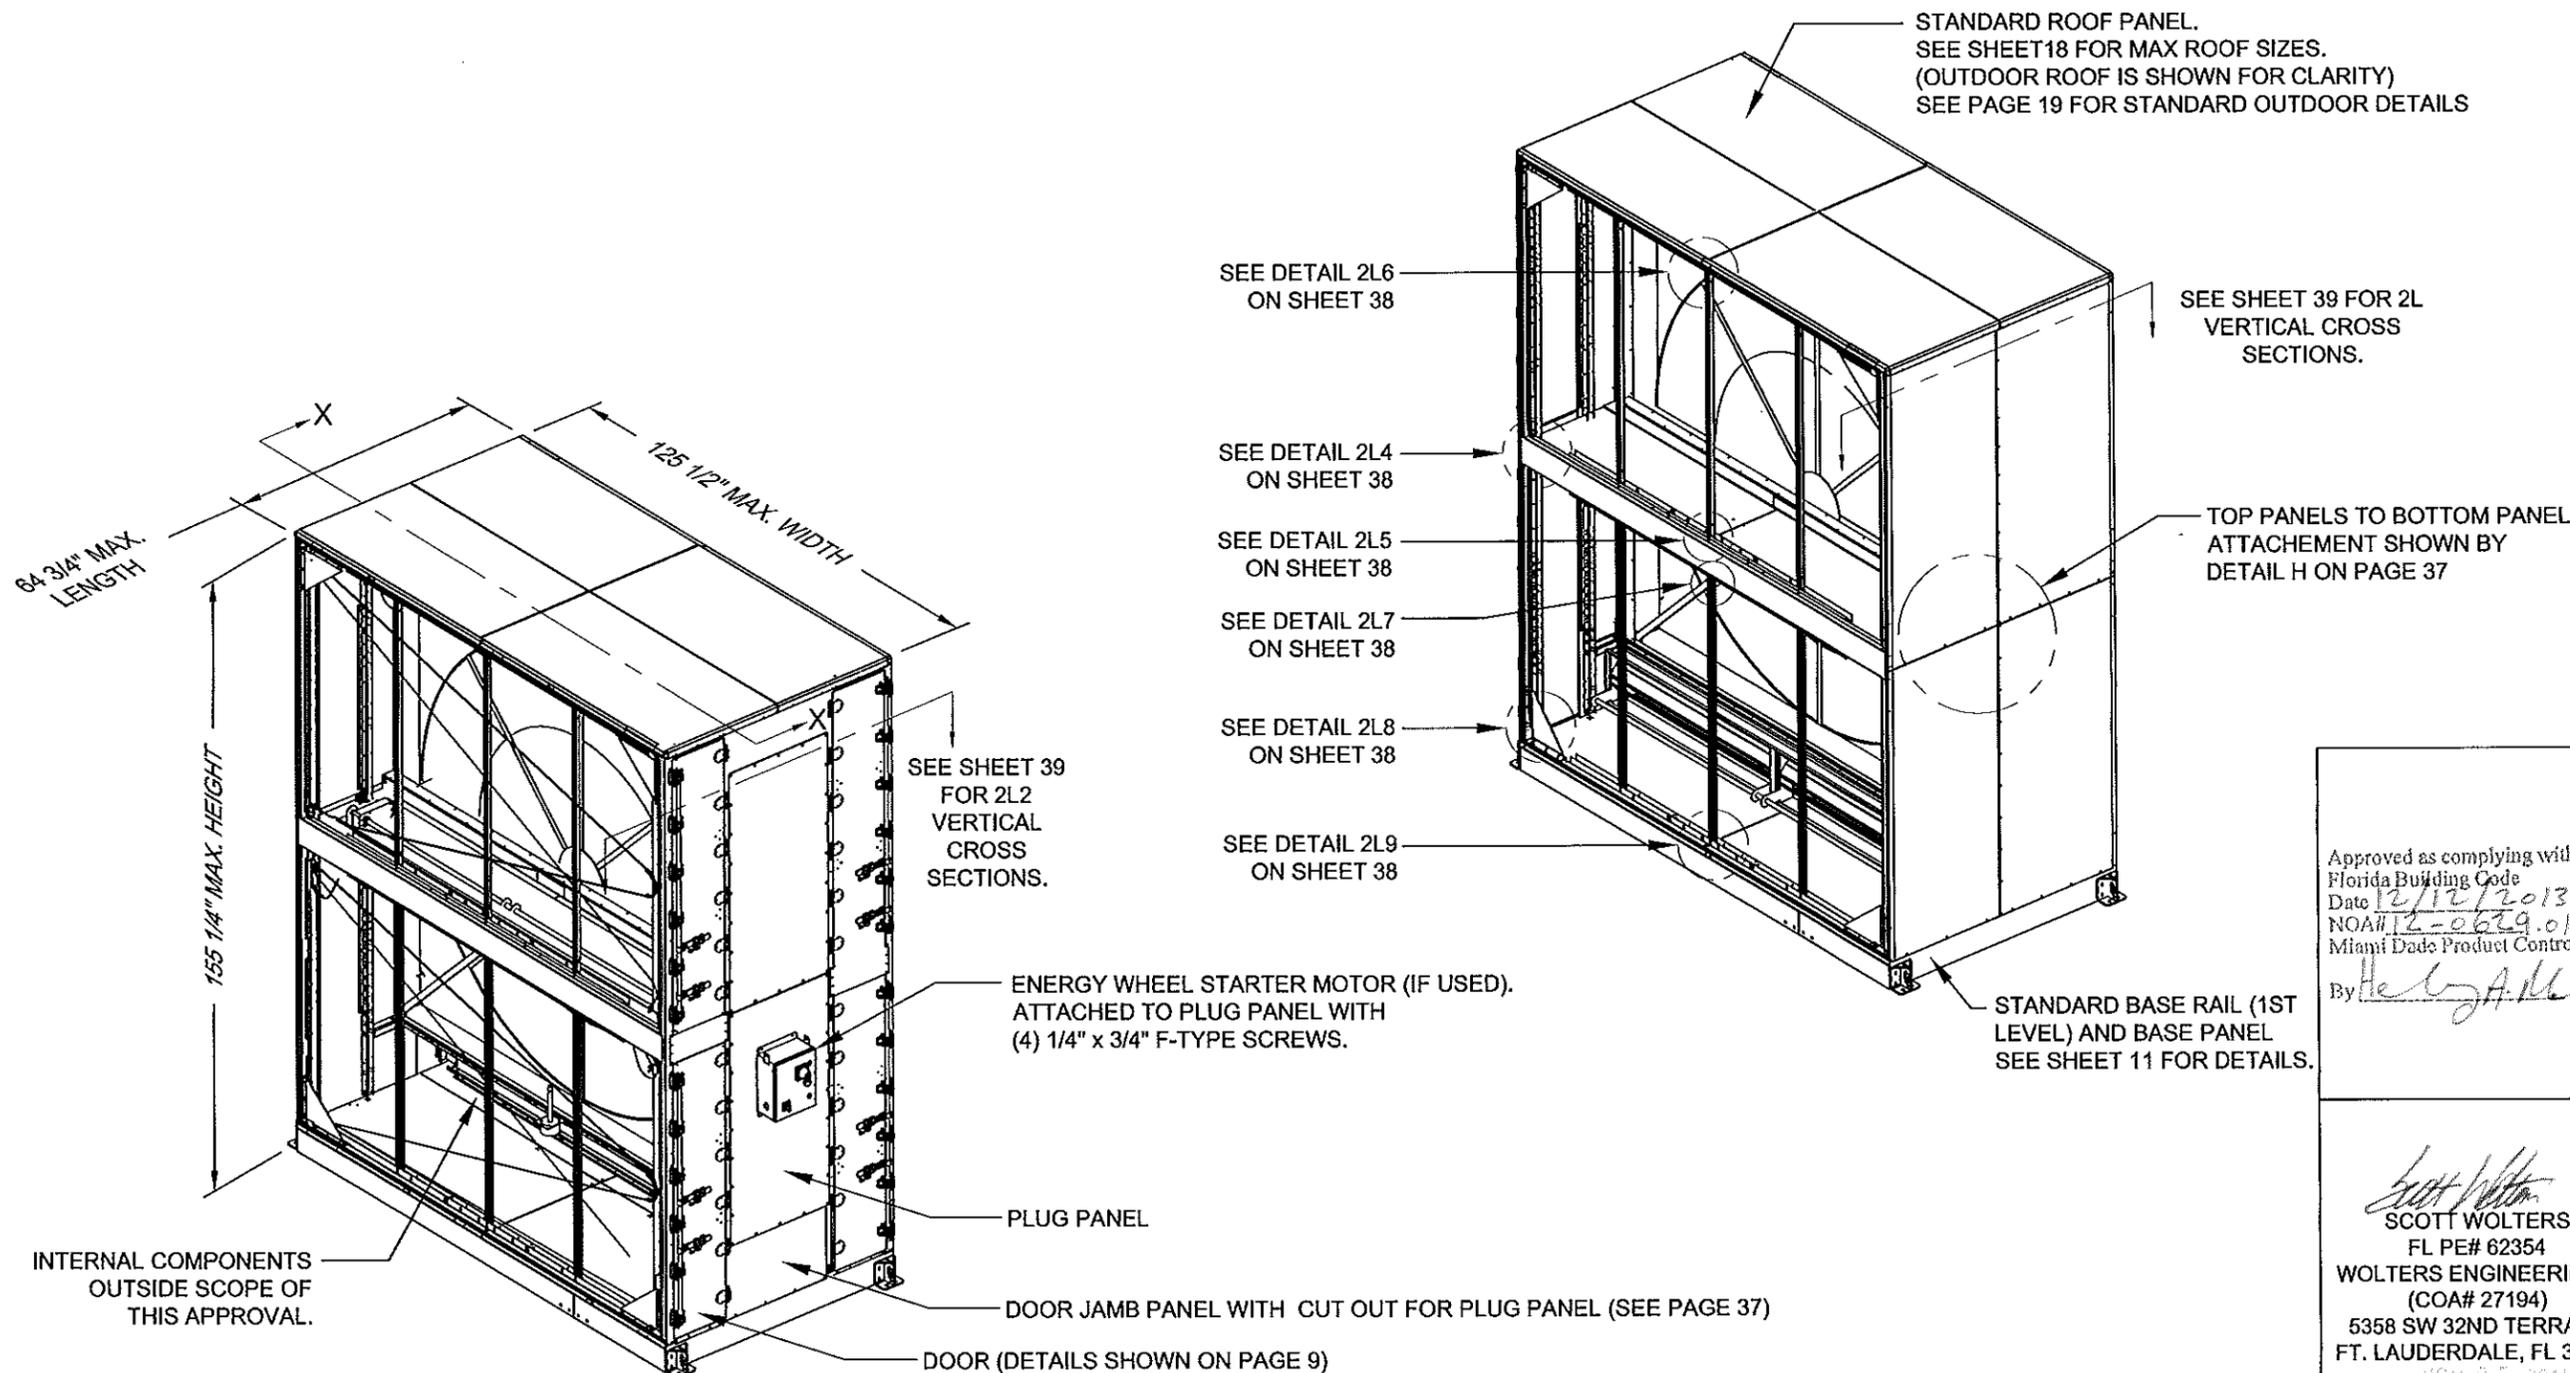

Approved as complying with the Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control



By *Heather A. Miller*

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013


DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT		REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 33 OF 46	SECTION			MOCK UP/DWG SHEET REF: 3 OF 35	SCALE: NTS	DATE 16-SEP-2013

ENERGY WHEEL SIDE WALL DETAILS (Vertical cross sections with internal supports)


NOTES:
1. HERE WE ARE SHOWING VERTICAL CROSS SECTIONS (TOP VIEW) TO SHOW THE PANEL IN WIDTH AND VERTICAL CHANNEL ATTACHMENT TO SLIP FIT CHANNEL AND TO SIDE WALL.

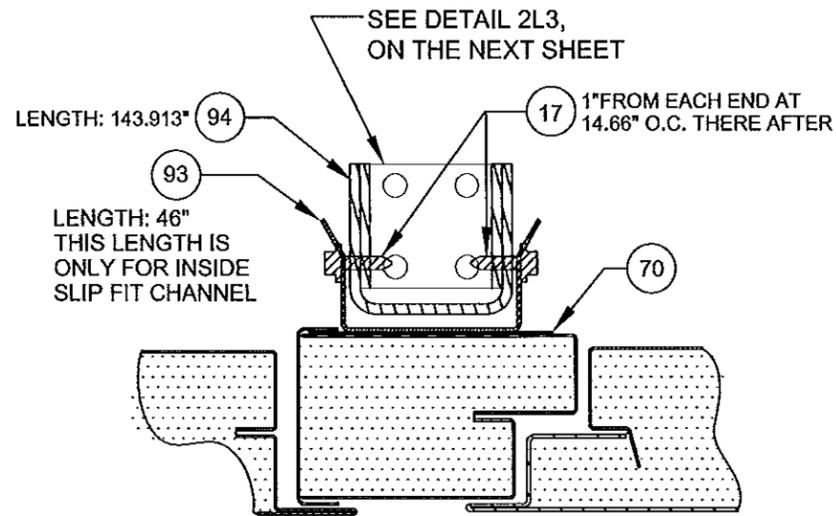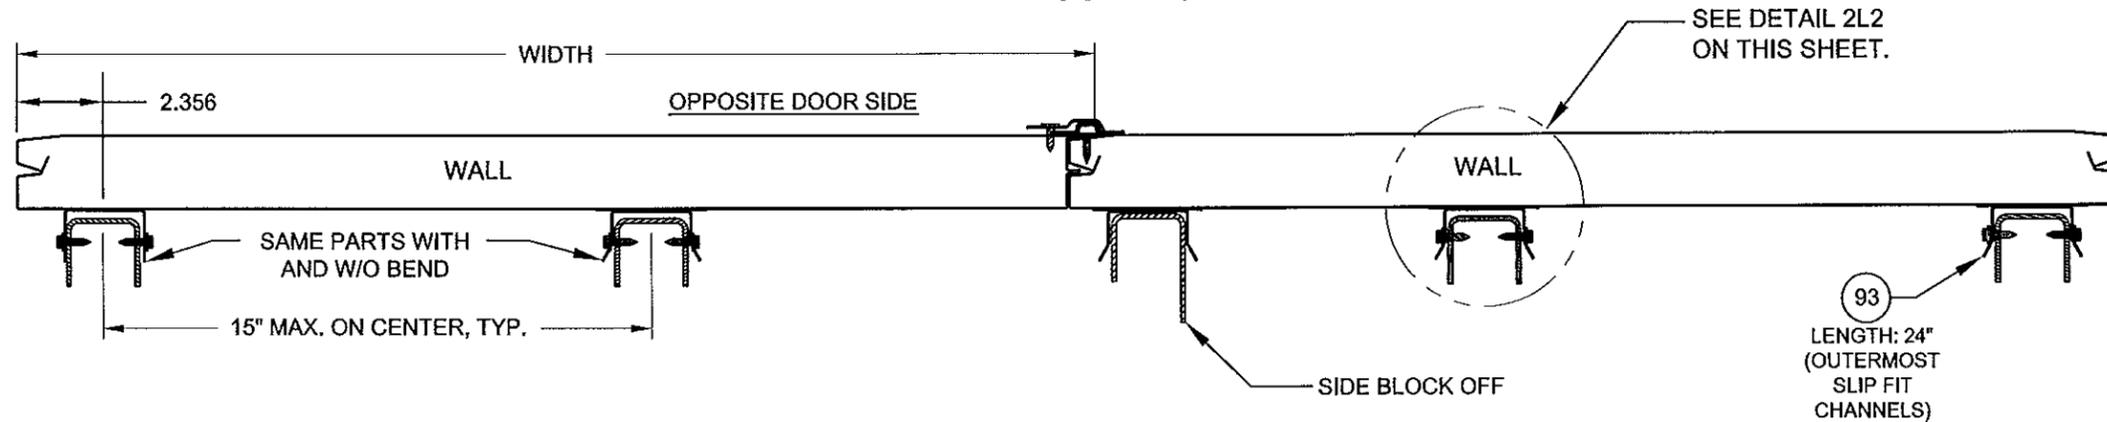

DETAIL 2L1

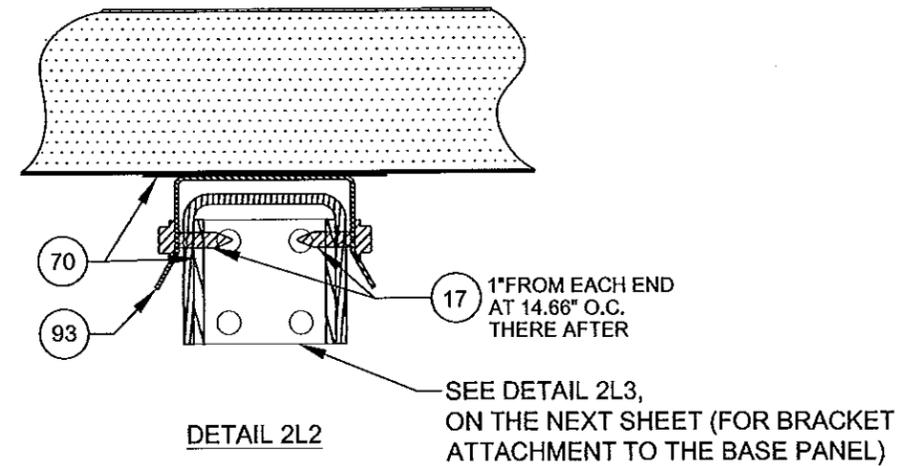

DETAIL 2L2





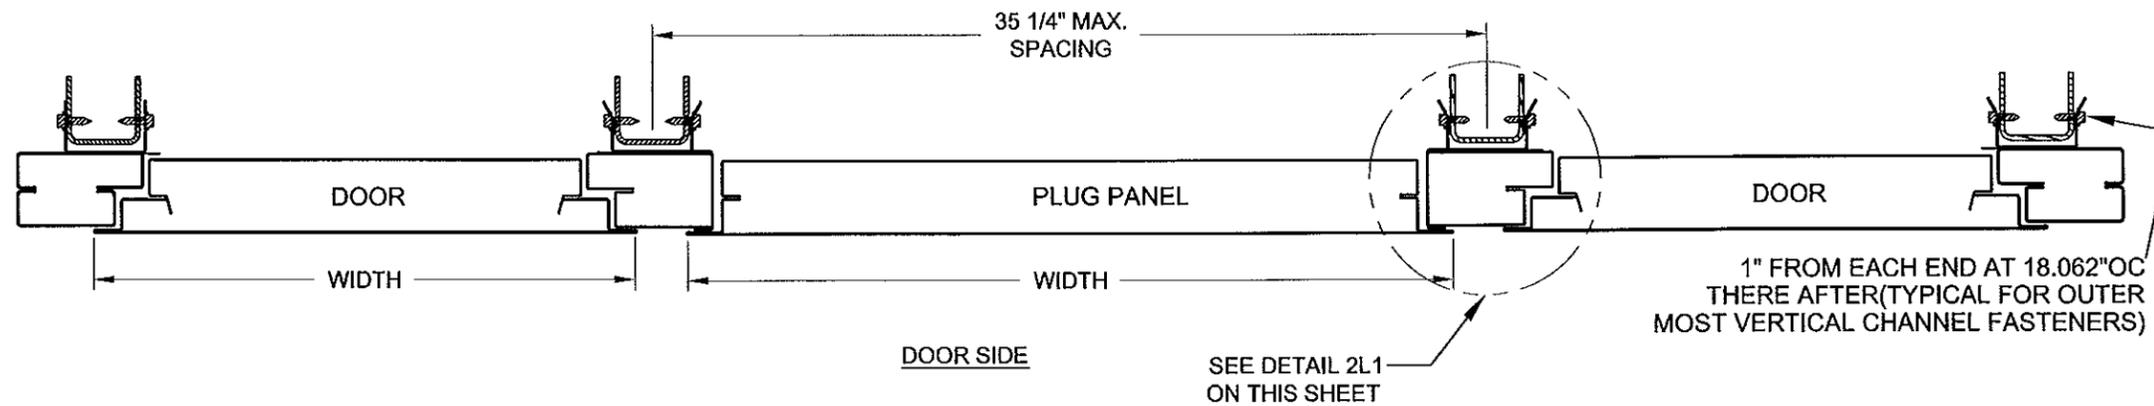


Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control
By Hester

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013

DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	34 OF 46	SECTION			MOCK UP/DWG SHEET REF:	SCALE:	NTS	DATE	16-SEP-2013
					6, 7, 17 OF 35				

ENERGY WHEEL INTERNAL STRUCTURE CONSTRUCTION.

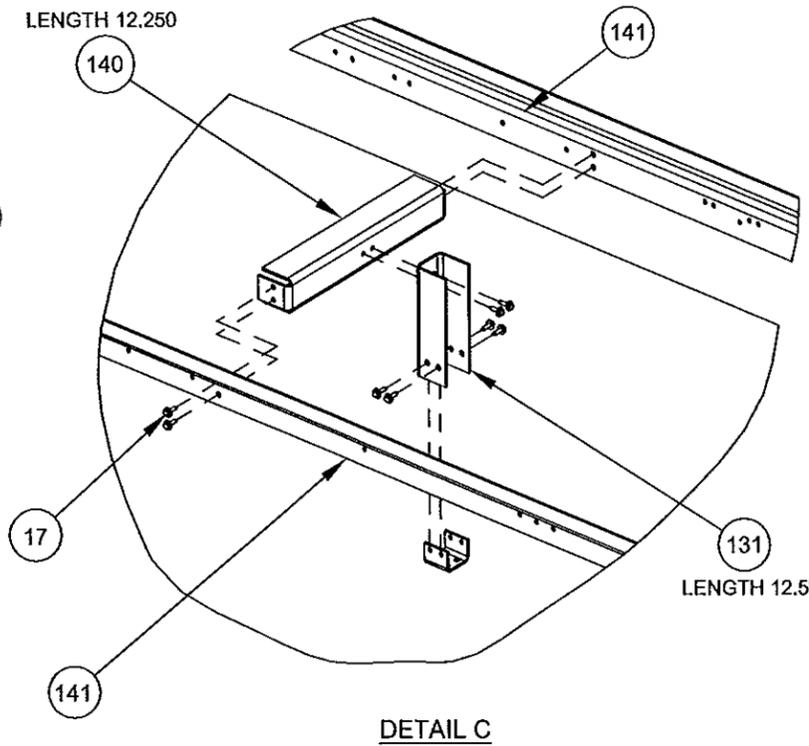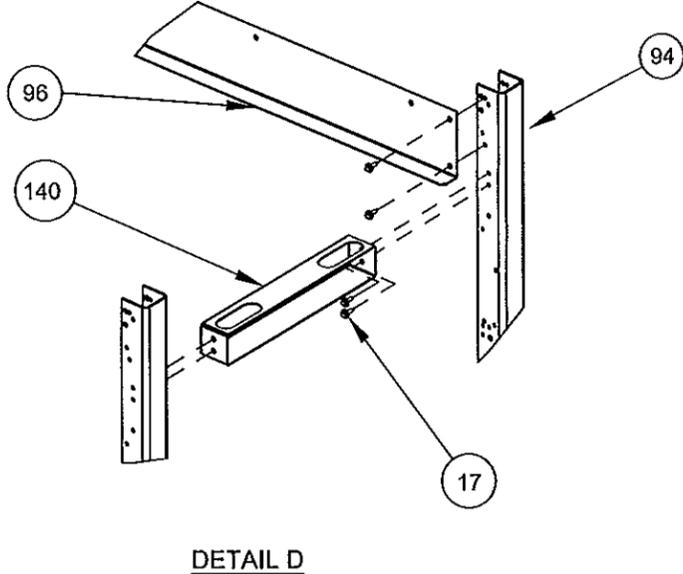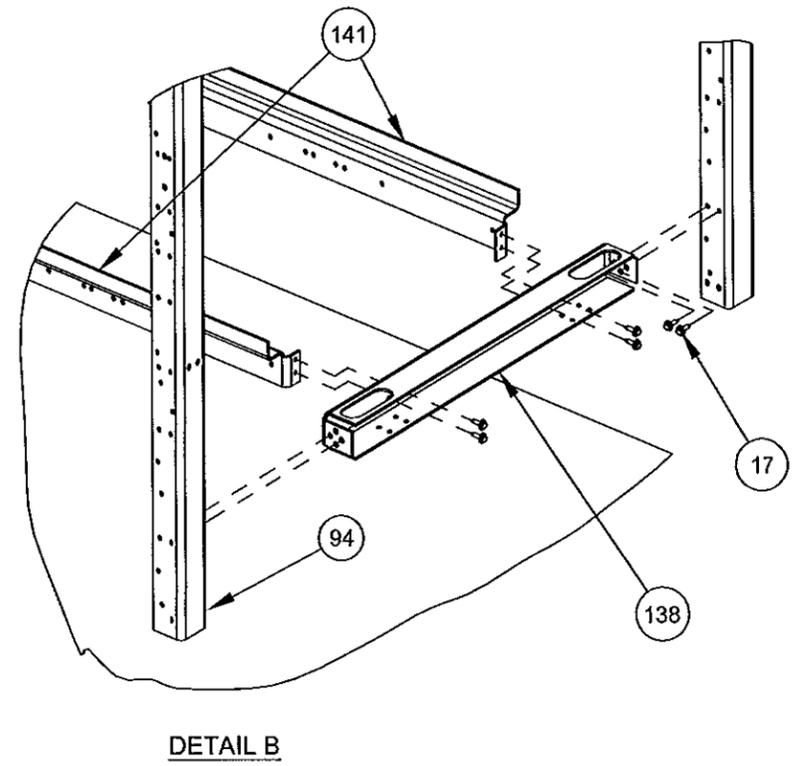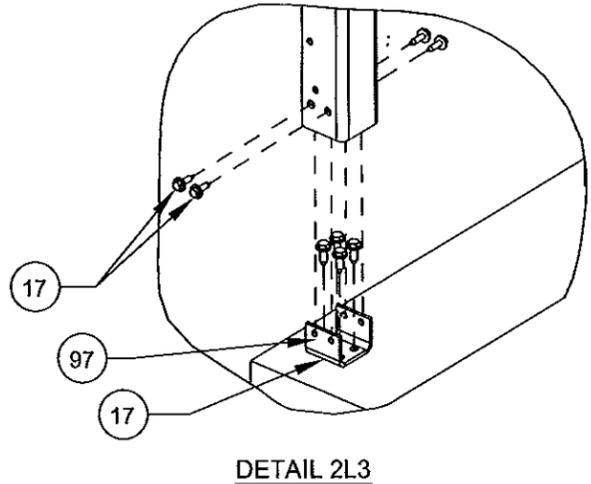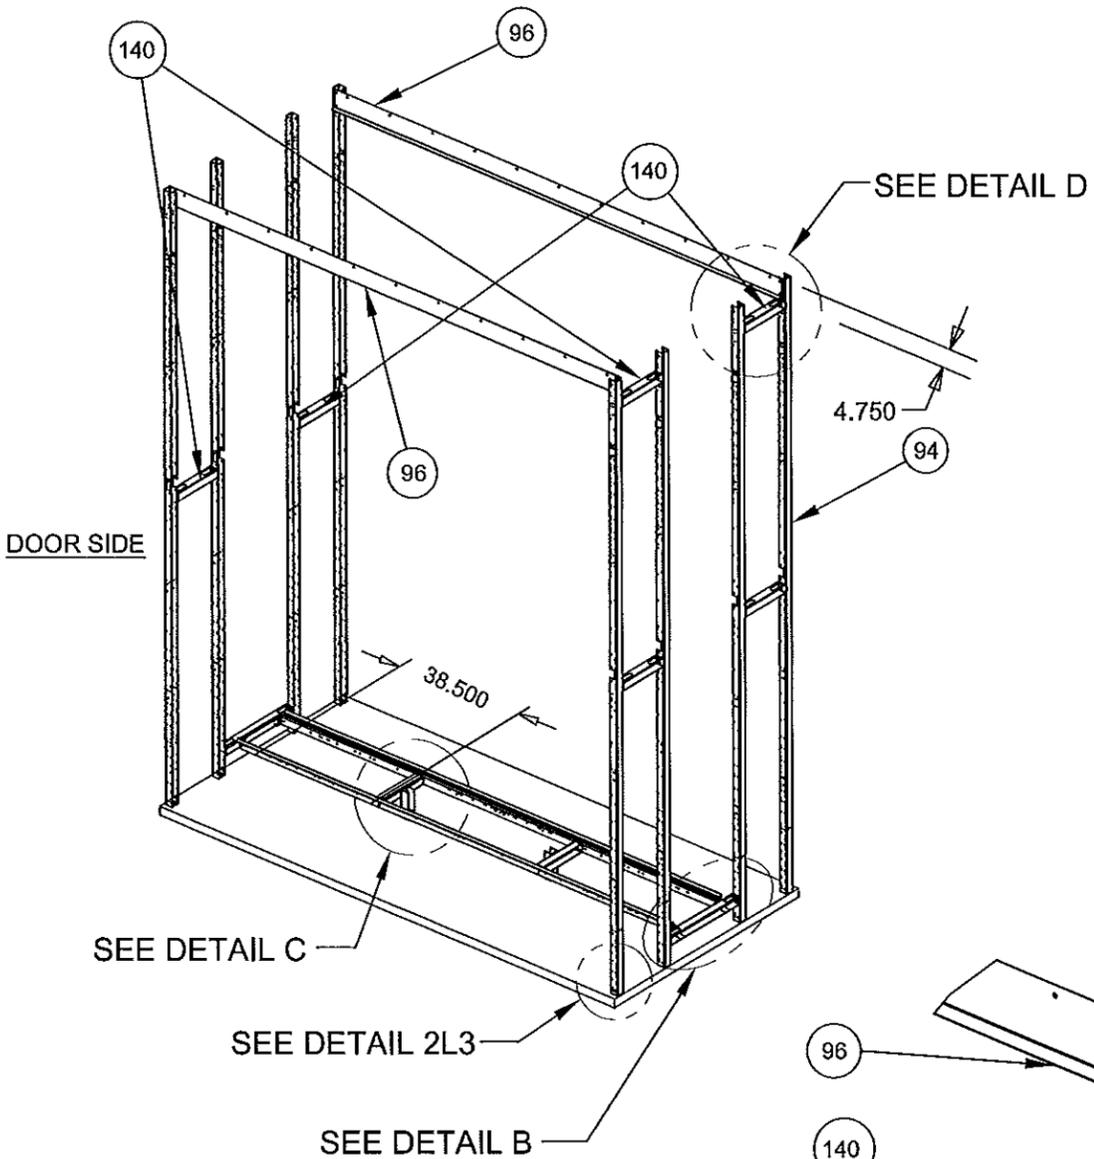

NOTES:
1. ALL OF THESE STRUCTURES ATTACHED WITH ITEM 17.


Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control
By Herby A. Miller

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 23 2013

DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET	35 OF 46	SECTION			MOCK UPDWG SHEET REF: 7 OF 35	SCALE: NTS	DATE 16-SEP-2013

ENERGY WHEEL SEPTUM INSTALLATION (PARTS ARE EXPLODED FOR CLARITY)

- NOTES:
 1. ALL OF THESE STRUCTURES ATTACHED WITH ITEM 17.
 2. 2-L SECTION HAS ROOF PANELS AND BASE PANELS, AND INBETWEEN THERE ARE FOAMED PANELS DIVIDES THE AIR FLOW, WHICH ARE CALLED SEPTUM PANELS.

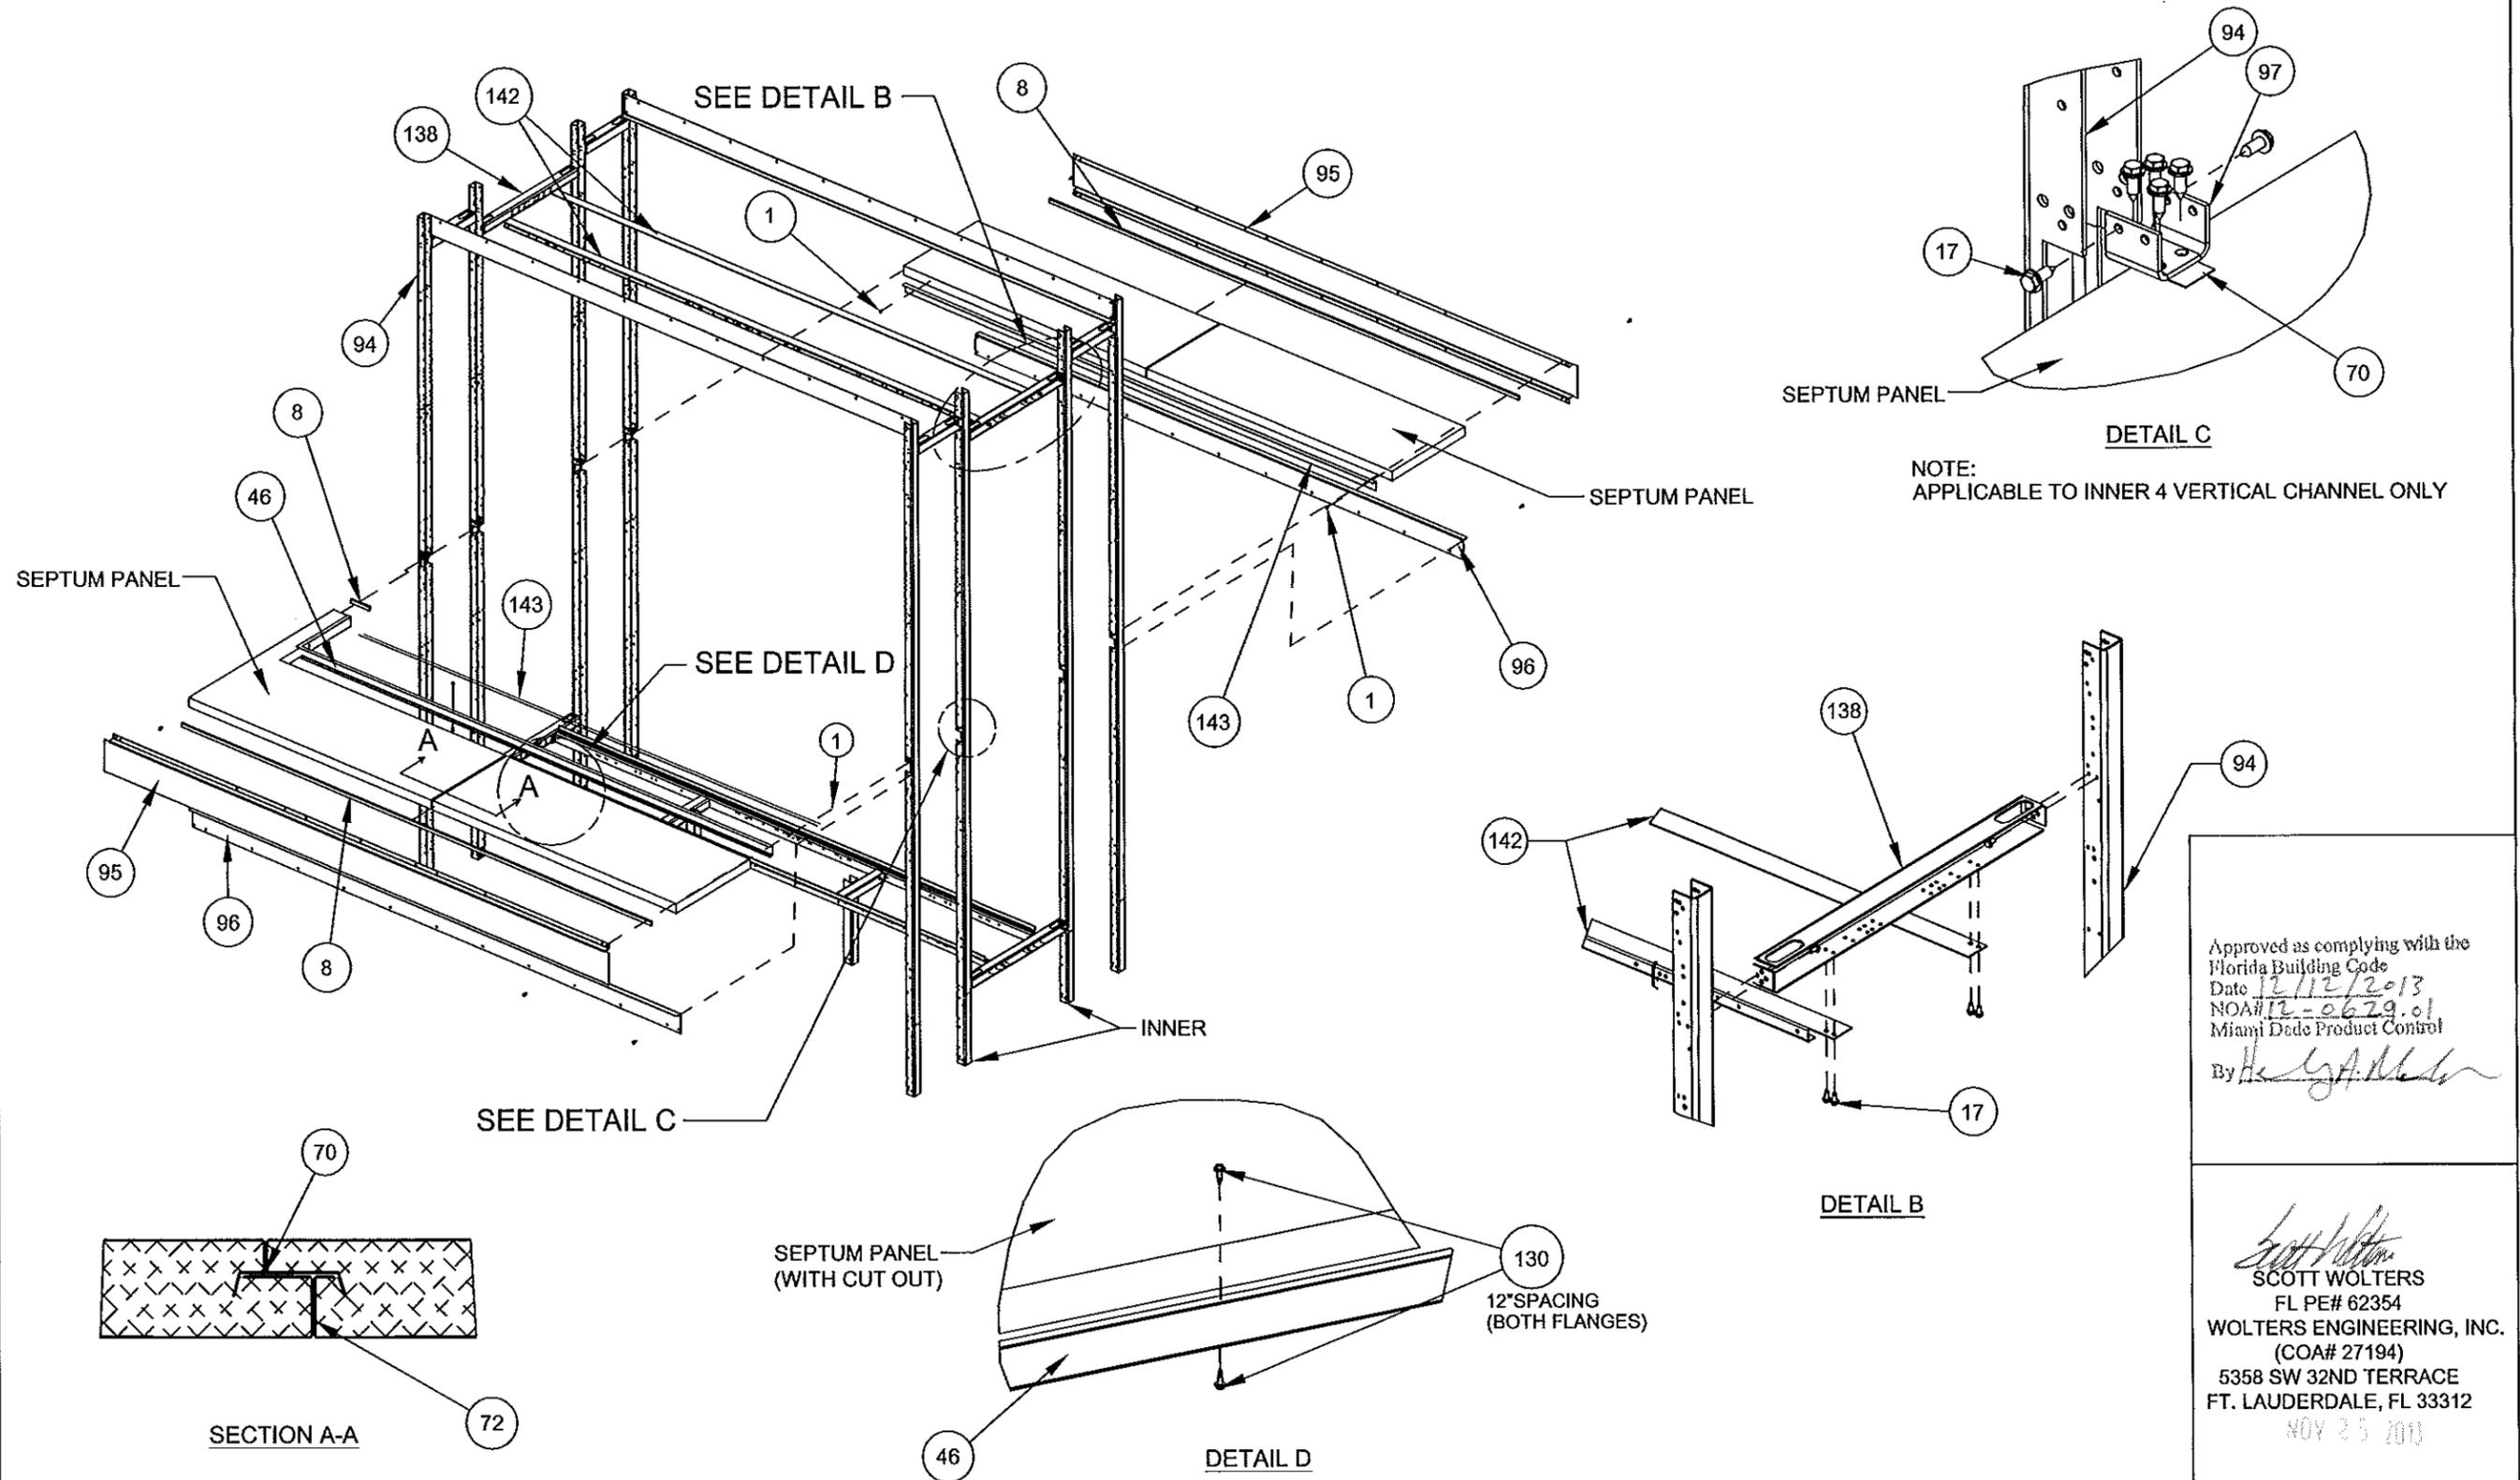

Approved as complying with the
 Florida Building Code
 Date 12/12/2013
 NOA# 12-0679.01
 Miami Dade Product Control
 By *[Signature]*


[Signature]
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2010

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 36 OF 46	SECTION			MOCK UPDWG SHEET REF: 90F 35	SCALE: NTS	DATE 16-SEP-2013

ENERGY WHEEL CROSS SECTION X-X


FROM PAGE 33

(Foam Panel only- Corner Cross Sections are the same as typical base and foamed roof corners of 1st level AHU. See page 5)

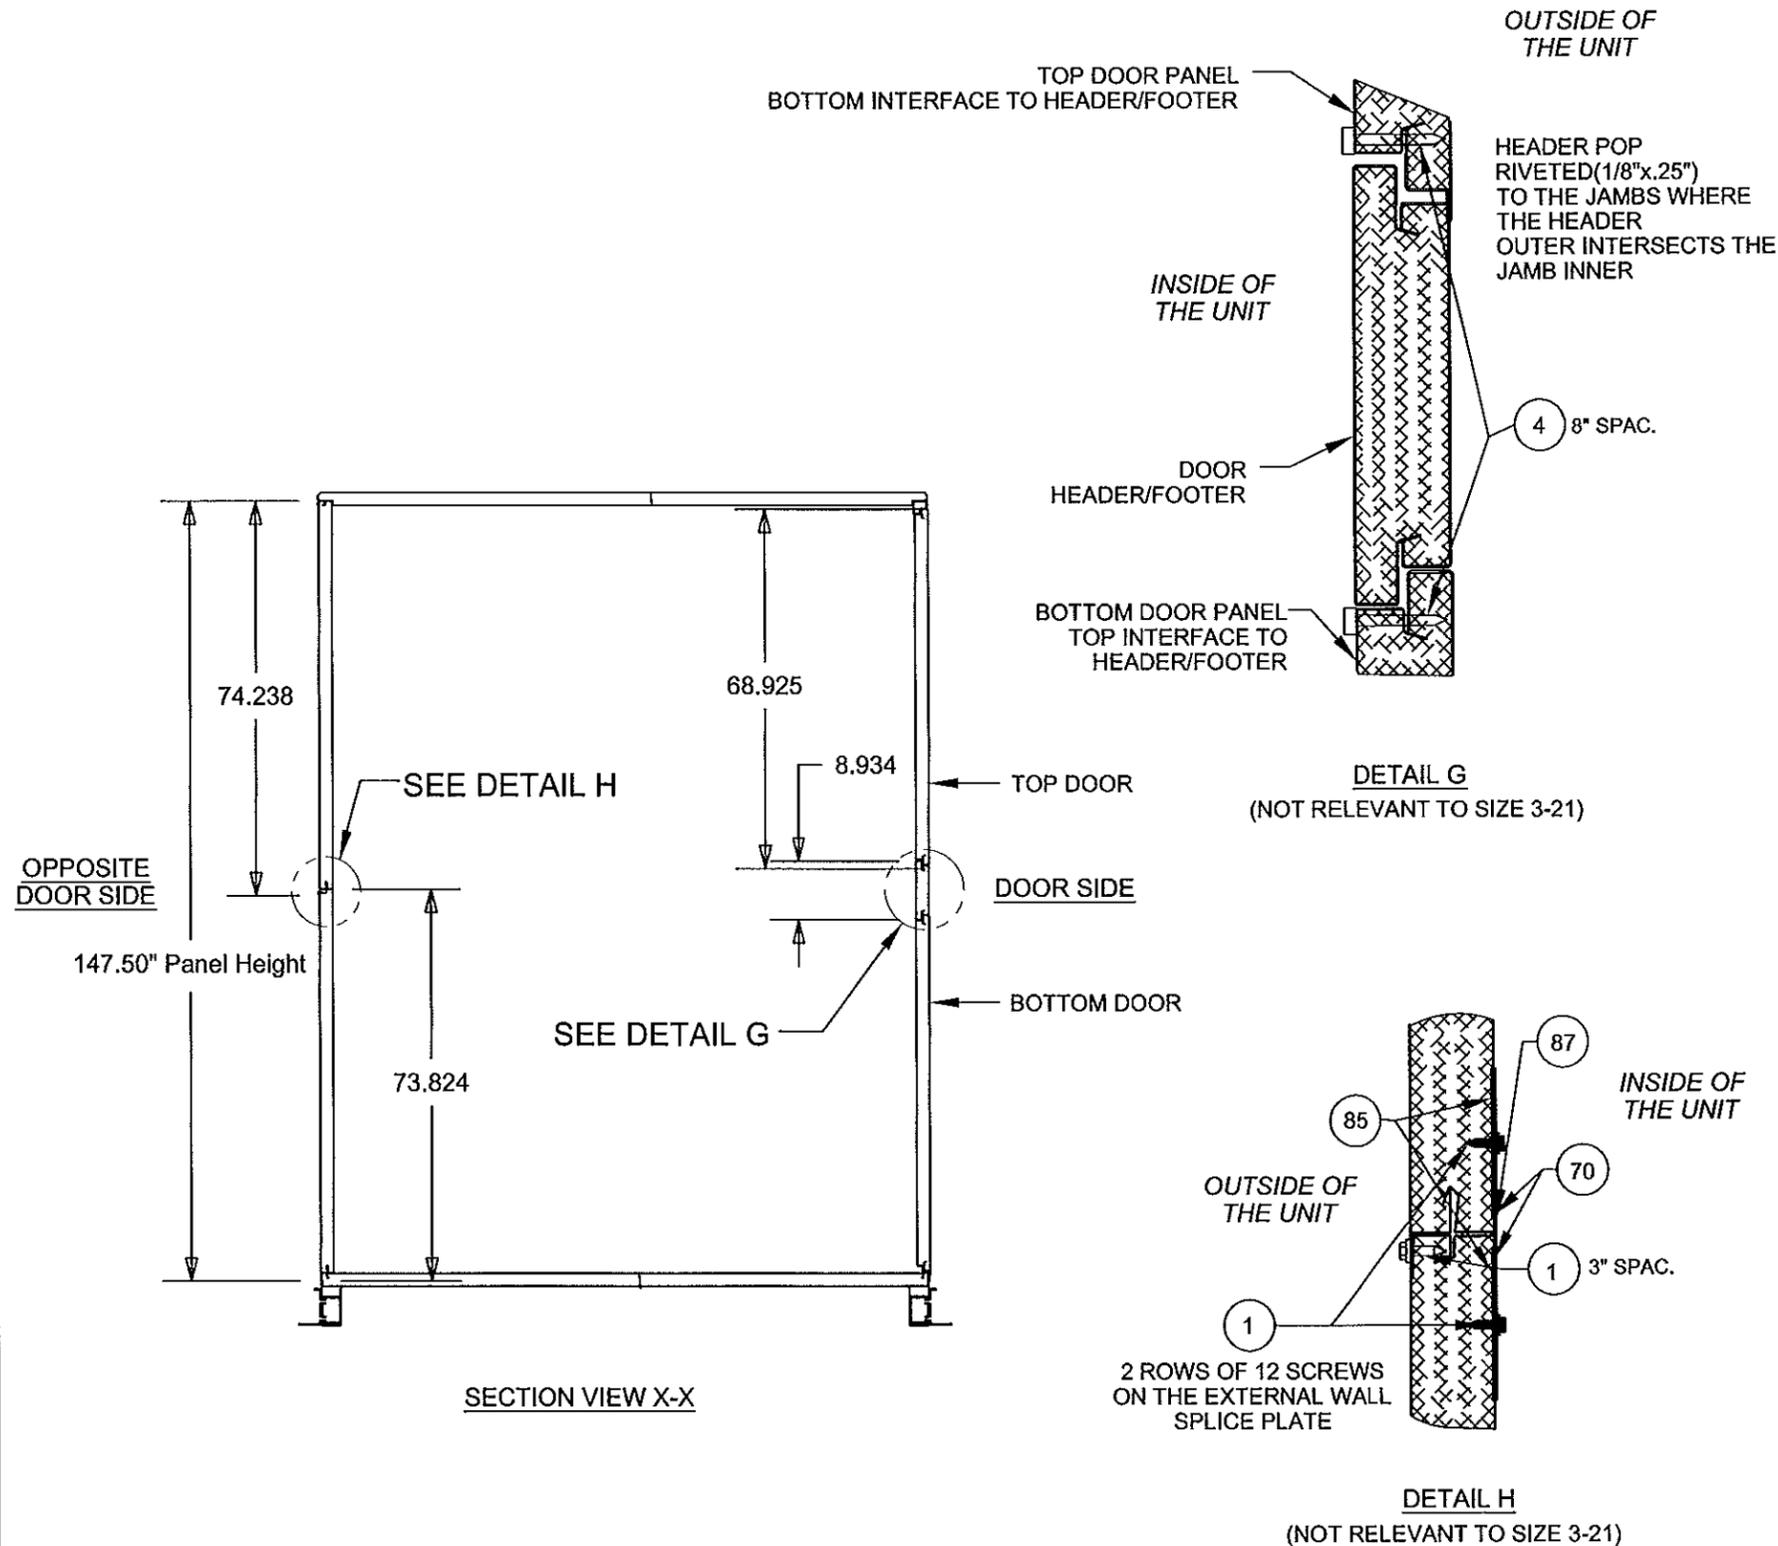

ENERGY WHEEL PLUG PANEL INSTALL

SEE PAGE 33 DOOR SIDE

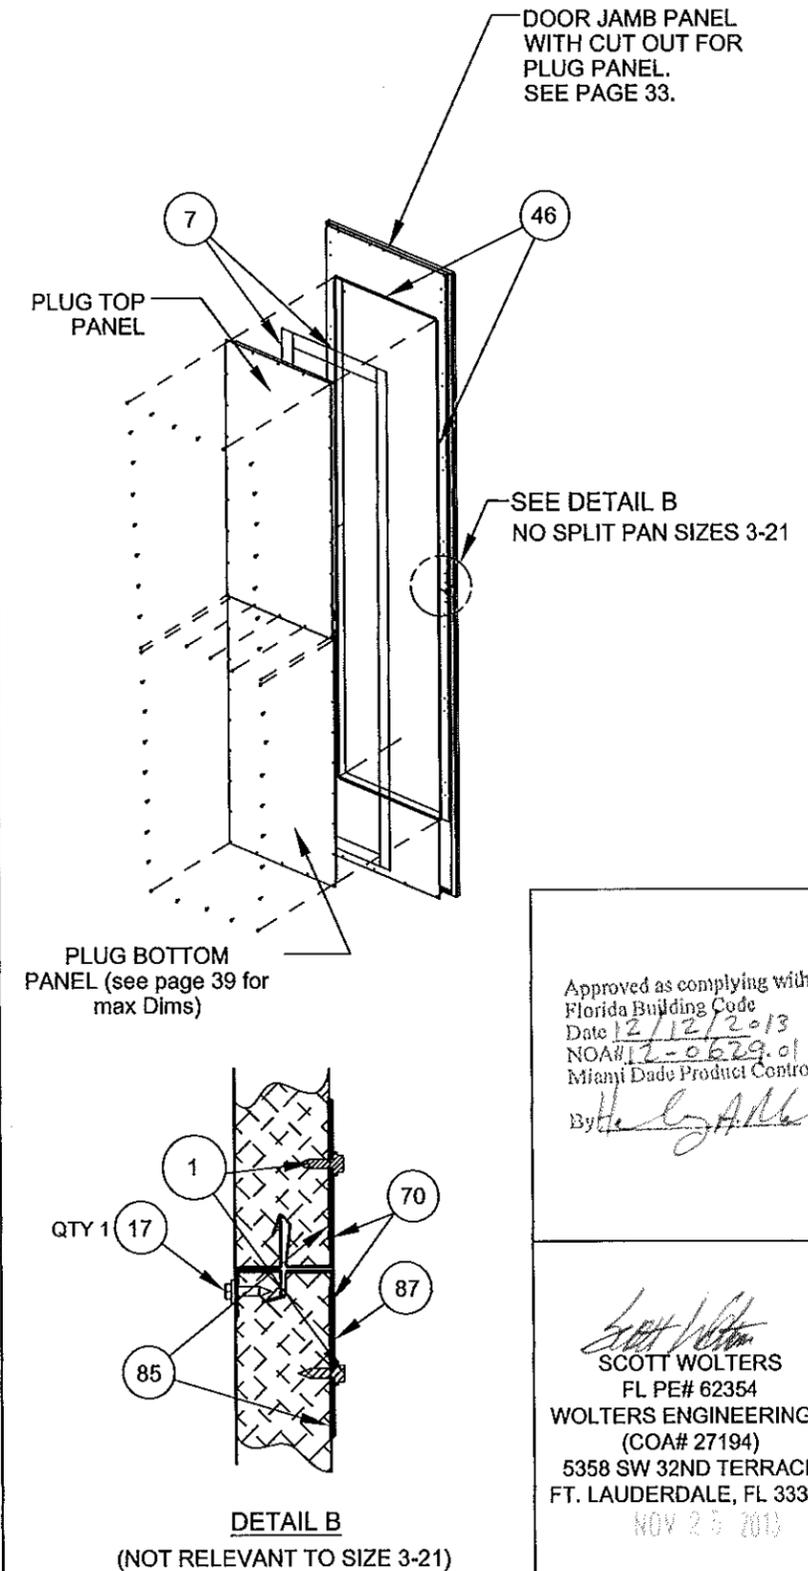


Approved as complying with the Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control
By *[Signature]*

[Signature]
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013



DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	---	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	37 OF 46	SECTION			MOCK UP/DWG SHEET REF:	20, 23 OF 35	SCALE:	NTS	DATE	16-SEP-2013

ENERGY WHEEL SHIPPING SPLIT DETAILS


REFER TO PAGE 33

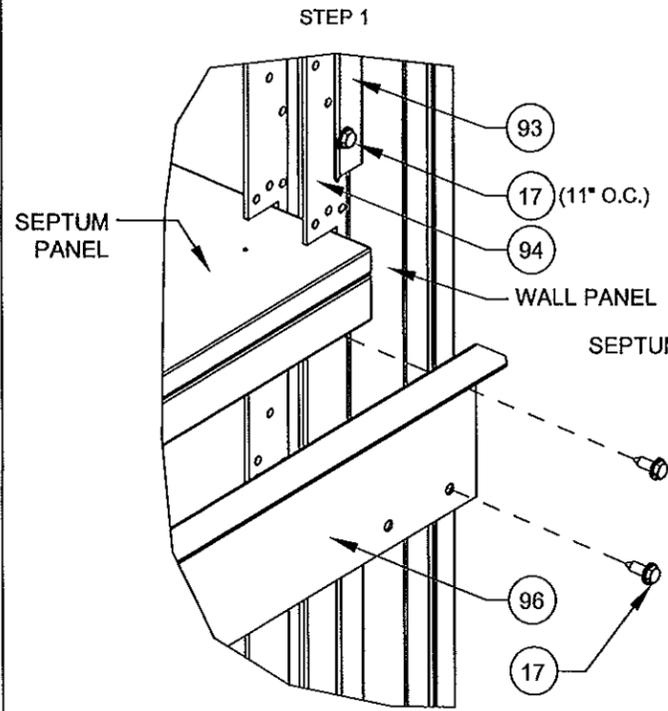


DETAIL 2L4

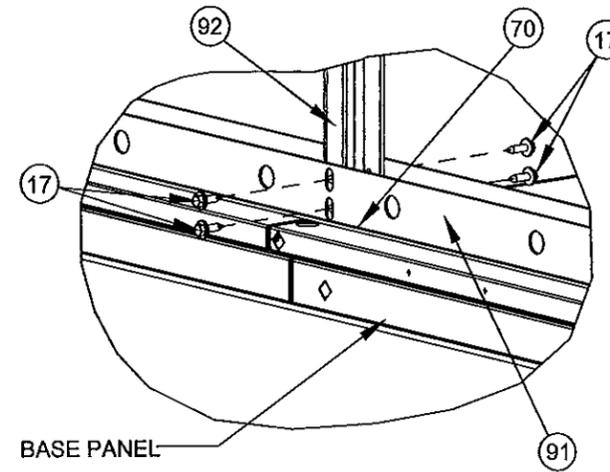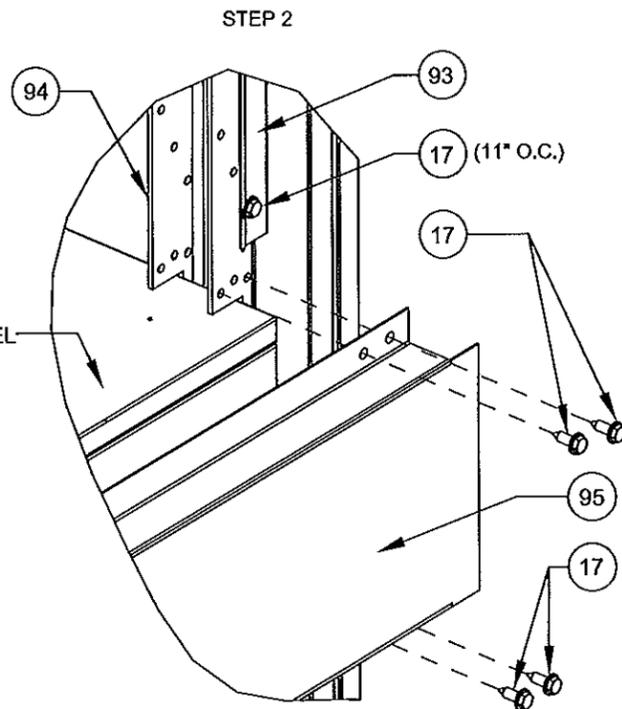


DETAIL 2L9

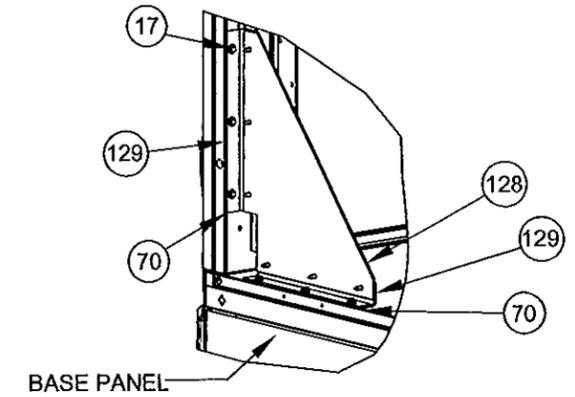


DETAIL 2L8

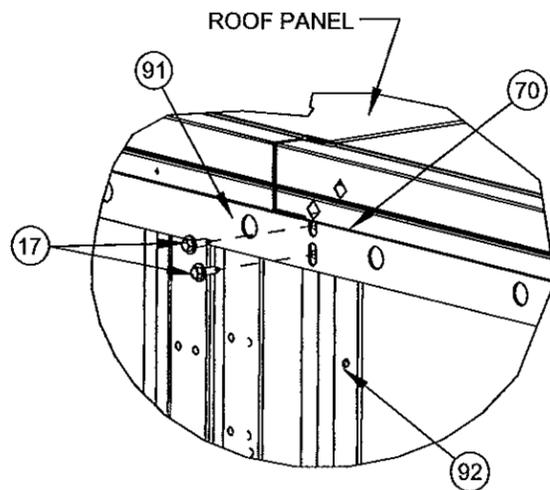

DETAIL 2L6

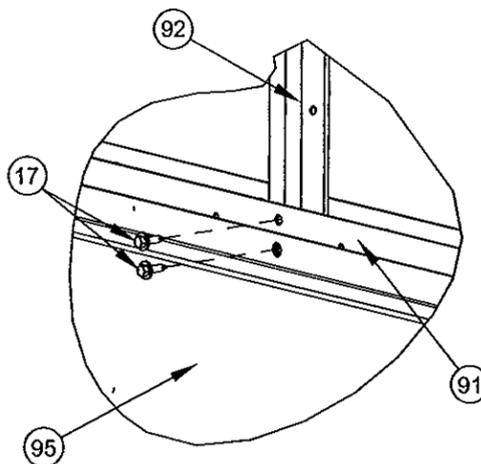

DETAIL 2L5

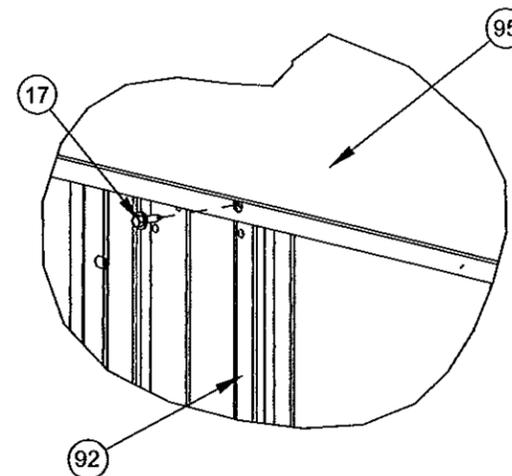

DETAIL 2L7



Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control
By *[Signature]*

[Signature]
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 27 2013


DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 38 OF 46	SECTION			MOCK UP/DWG SHEET REF: 12, 15 OF 35	SCALE: NTS	DATE 16-SEP-2013

ENERGY WHEEL SIDE WALL DETAILS (Vertical Cross Sections)

NOTES:
1. SHOWING TOP VIEW FOR PANEL JOIN AND DIMENSIONS.

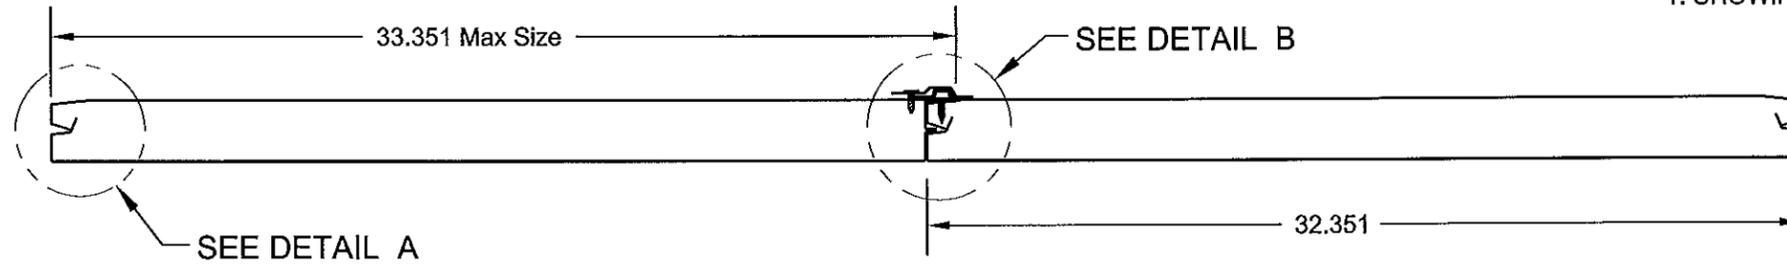


SHIPPING SPLIT WALL PANEL DETAIL A

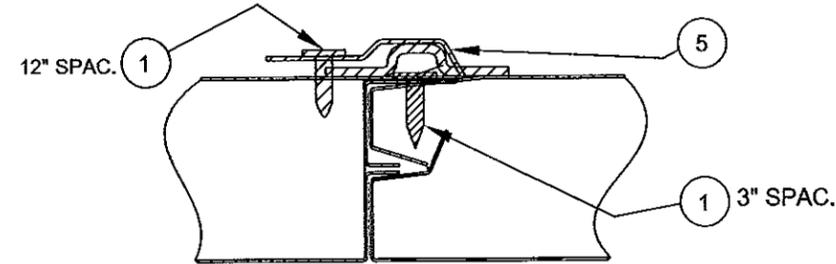


WALL JOINT TONGUE AND GROOVE DETAIL B

DETIAL 2L

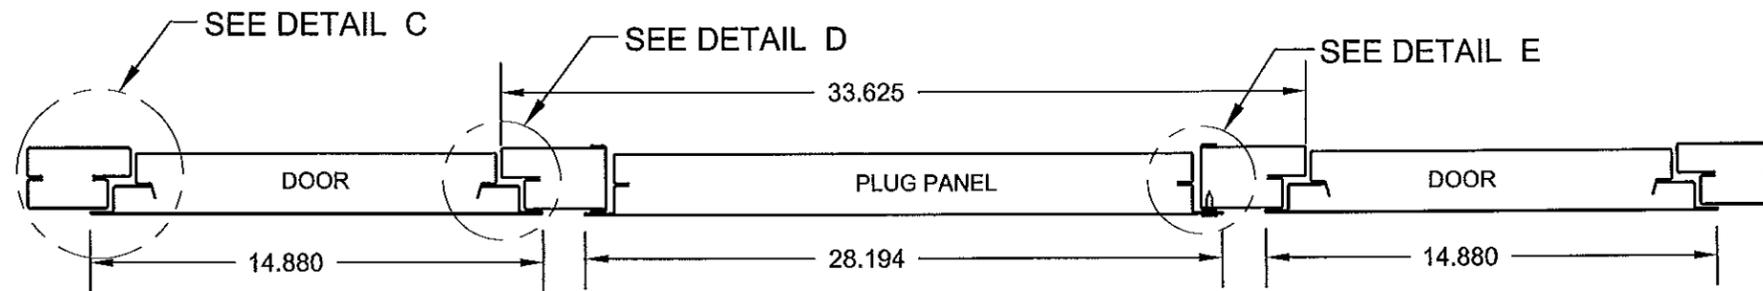


DOOR HEIGHT IS 68.925
QTY OF 2


PLUG PANEL TOP PORTION (L=56.013)
PLUG PANEL BOTTOM PORTION (L=59.041)

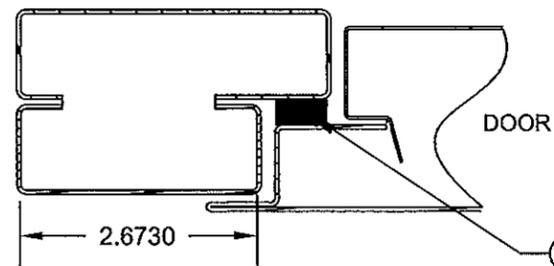

DETAIL C. NARROW DOOR
JAMB TO DOOR

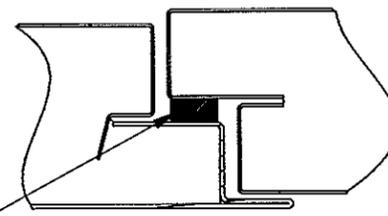

DETAIL D. DOOR TO WALL

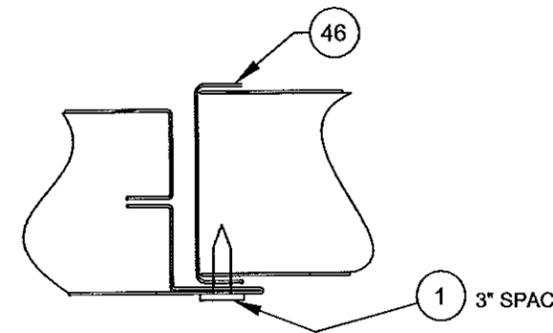

DETAIL E. PLUG
PANEL TO WALL

DETIAL 2L2

Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629.01
Miami Dade Product Control


By *Heather A. Miller*

Scott Wolters
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 27 2013


DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET	39 OF 46	SECTION			MOCK UP/DWG SHEET REF: 16 OF 35	SCALE: NTS	DATE 16-SEP-2013

NOTE:


1. UNIT MAY BE INSTALLED ONTO CONCRETE (3.2 KSI MIN. COMPRESSIVE STRENGTH) OR 1/4" THICK STEEL (36 KSI MIN YIELD) SUBSTRATES WITH ANCHORS THROUGH LIFTING LUGS AND ANGLE CLIPS ATTACHED TO FIRST LEVEL BASE RAIL AS SHOWN IN THIS SHEET. UNIT MAY ALSO BE INSTALLED ONTO A 36KSI YIELD STEEL CURB BY OTHERS, WITH ITEM 17 SMS AS SHOWN IN DETAIL B. FOR PIPE CABINET ANCHORAGE SEE DETAILS P12 AND P13.

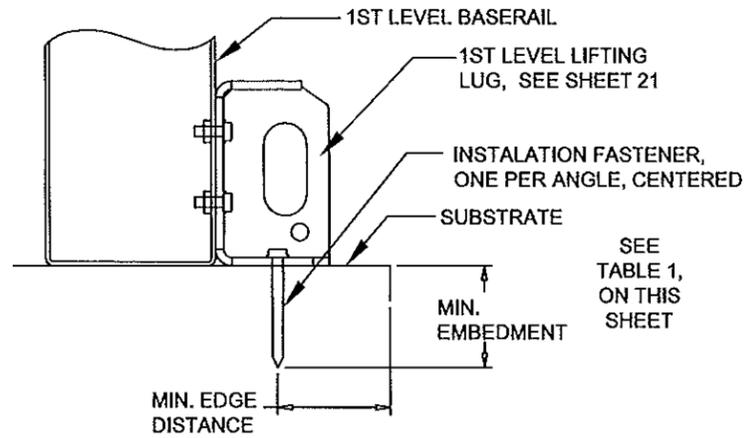

DETAIL A. TYPICAL ANCHORAGE AT LUGS

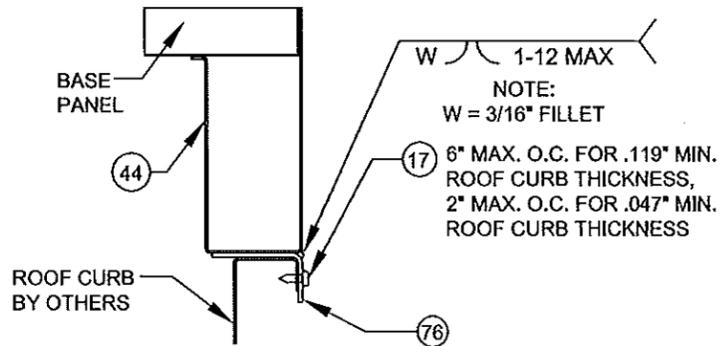


DETAIL B. TYPICAL INSTALLATION BASE RAIL TO CURB

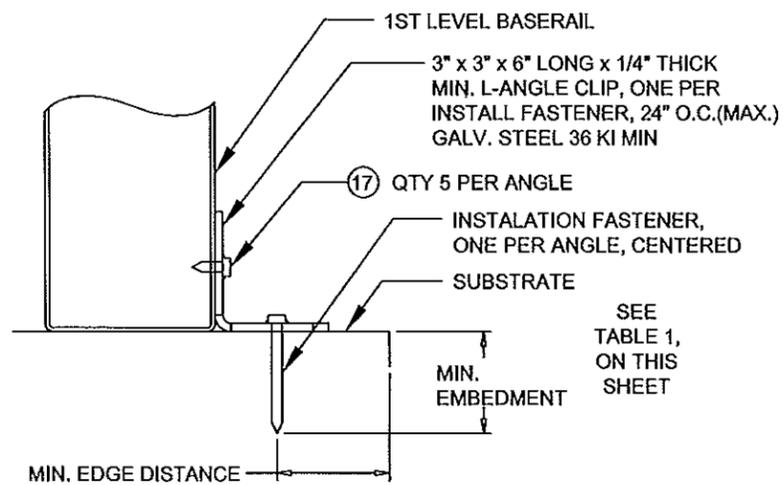


DETAIL C: TYPICAL ANCHORAGE AT ANGLE CLIPS

STANDARD UNIT AND ENERGY WHEEL SECTIONS ANCHORAGE DETAILS

PIPE CABINET ANCHORAGE DETAILS

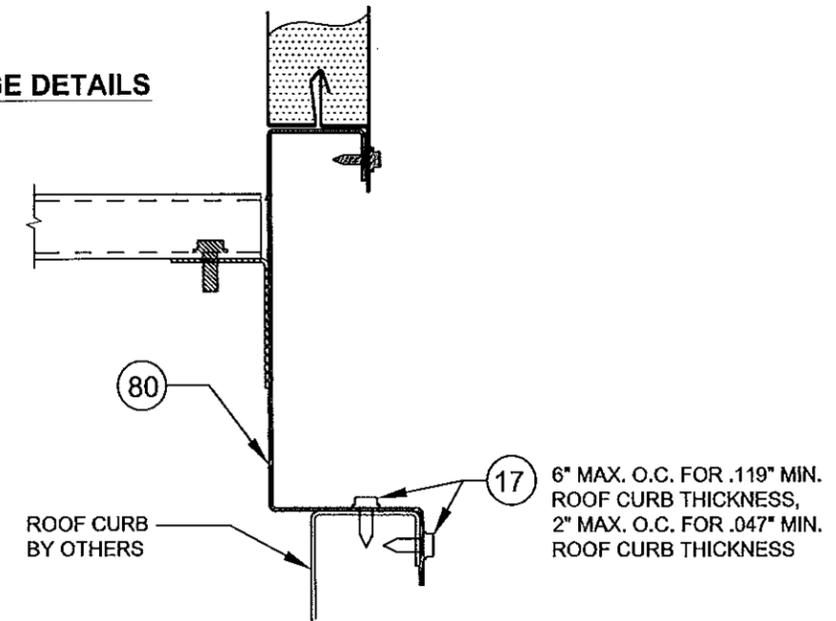

DETAIL P12. ANCHORAGE TO ROOF CURB

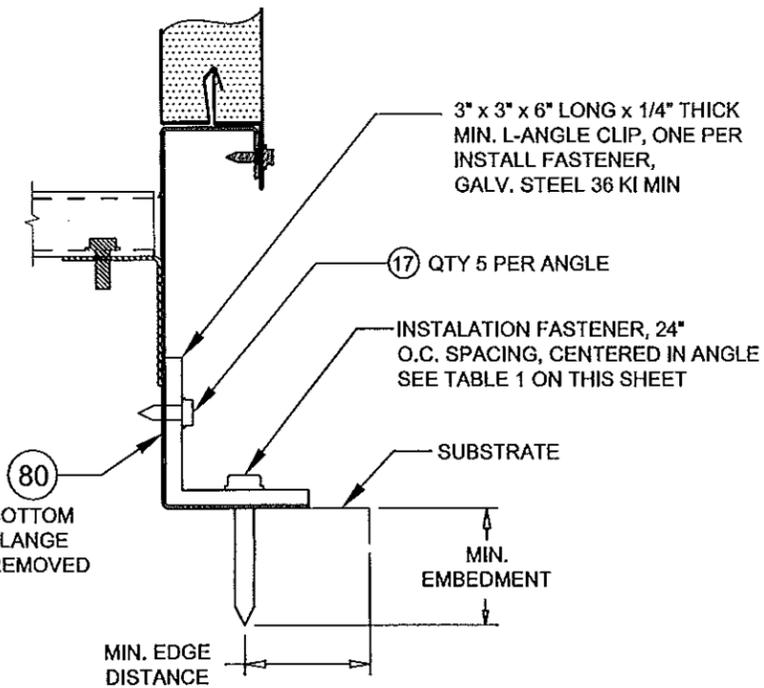

DETAIL P13. DIRECT ANCHORAGE TO SUBSTRATE

TABLE 1. INSTALLATION ANCHOR INFORMATION





ANCHOR / SUBSTRATE	MIN. EMBED.	MIN. EDGE DIST.
1/2" POWERS CHEM- STUD THREADED ROD INSTALLED WITH CHEM-STUD ADHESIVE CAPSULE IN 3.2 KSI MIN CONCRETE SUBSTRATE	1 1/2"	6"
1/2" HH. F-TYPE THREAD CUTTING SCREW INSTALLED IN 36 KSI MIN STEEL 1/4" THICK MIN. (FULL THREAD ENGAGEMENT)	1/4"	1 1/4"

Approved as complying with the Florida Building Code
 Date 12/12/2013
 NOA# 12-0629.01
 Miami Dade Product Control
 By *[Signature]*





[Signature]
SCOTT WOLTERS
 FL PE# 62354
WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 40 OF 46	SECTION			MOCK UP/DWG SHEET REF: 25, 26, 29, 35, 36 OF 63	SCALE: NTS	DATE 16-SEP-2013



BASE PANEL METAL EDGE DETAILS (ALL .028 GALV.)

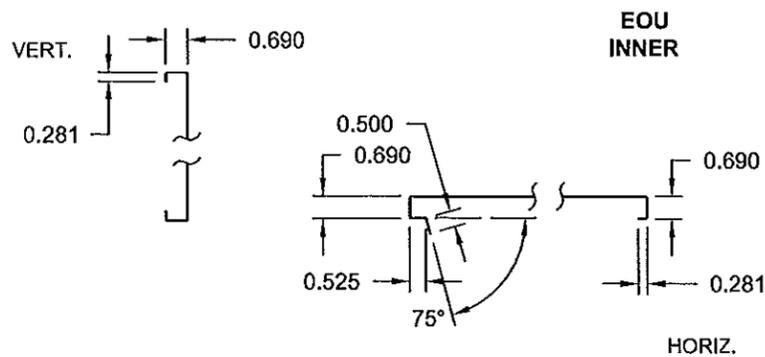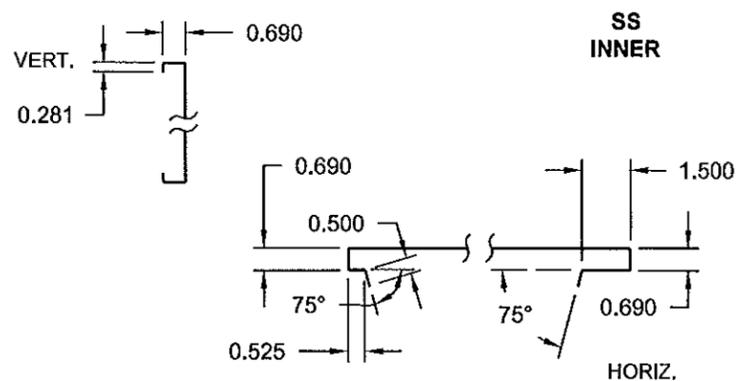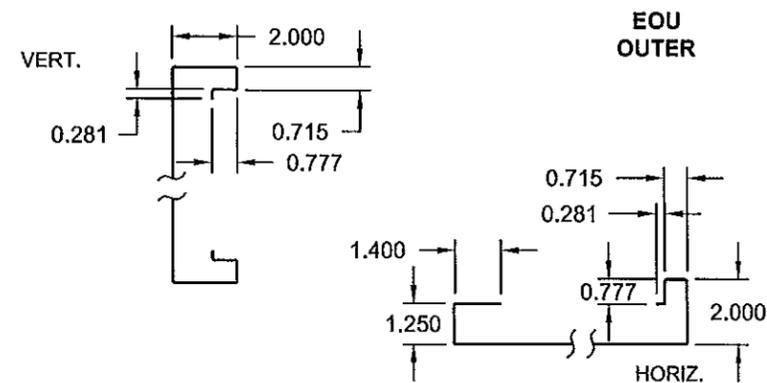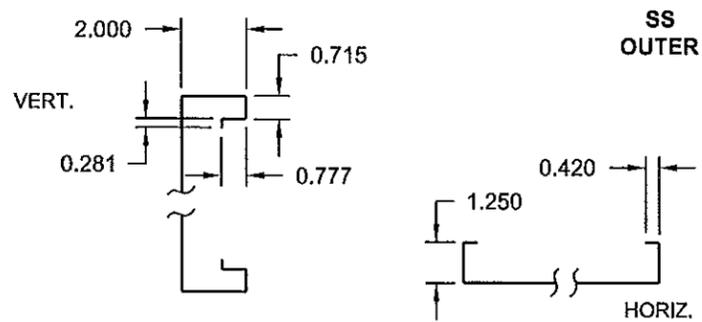


ROOF PANEL METAL EDGE DETAILS (ALL .028 GALV.)

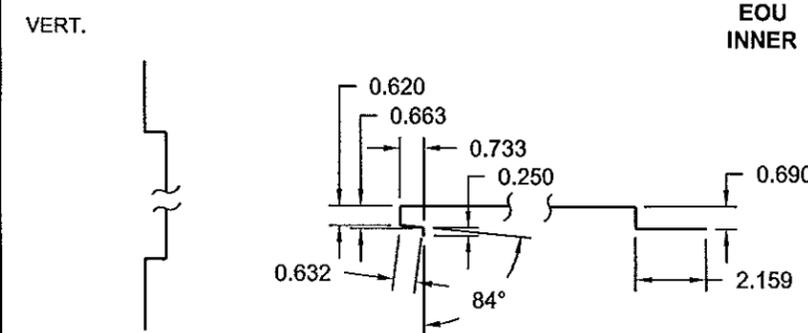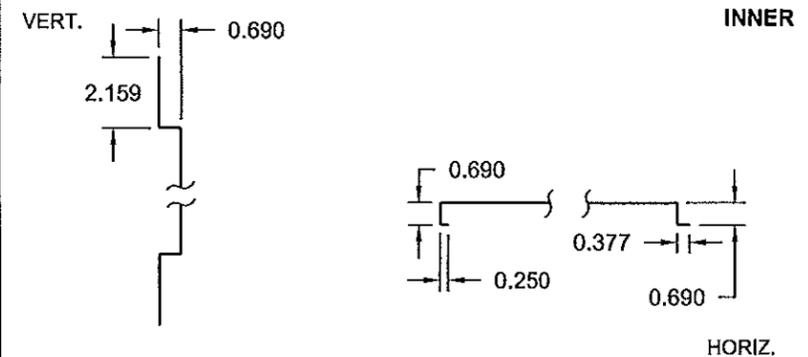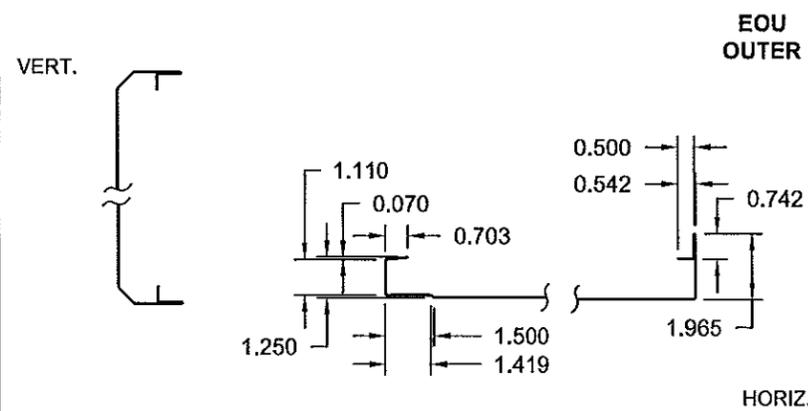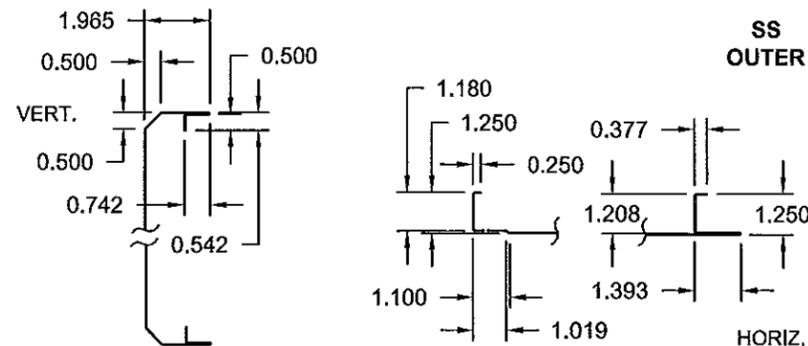


WALL PANEL METAL EDGES HORIZONTAL SECTIONS (ALL .028 GALV.)

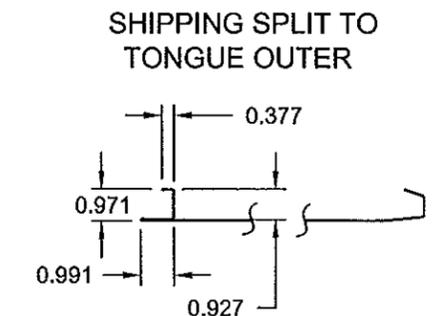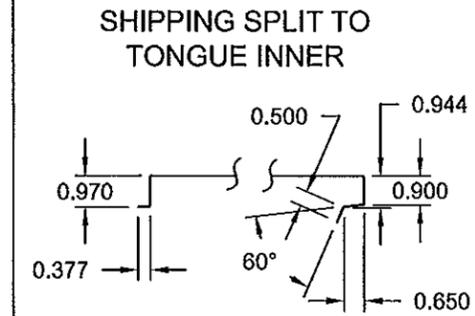


EOU INNER

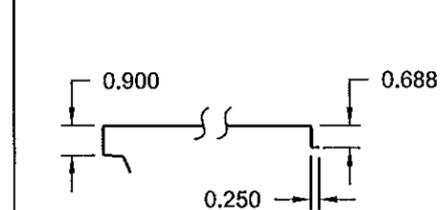


EOU OUTER

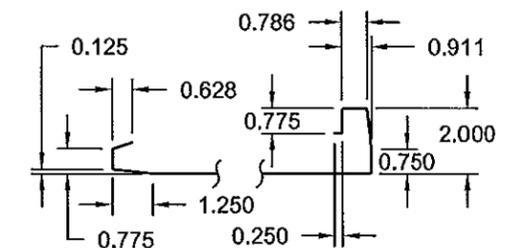

SIDE, CORNER, OR REMOVABLE INNER

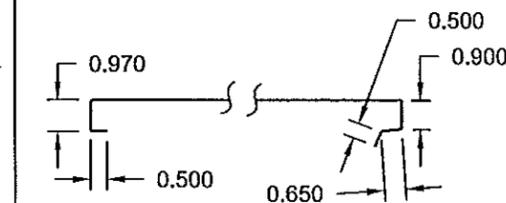


SIDE, CORNER, OR REMOVABLE OUTER

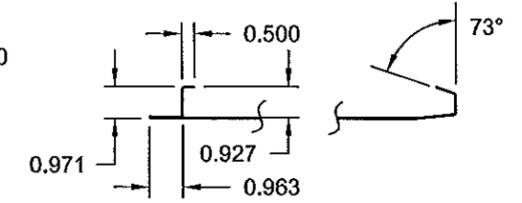


WALL PANEL METAL EDGES VERTICAL SECTIONS (ALL .028 GALV.)

INNER; SS, EOU, SIDE REMOVABLE

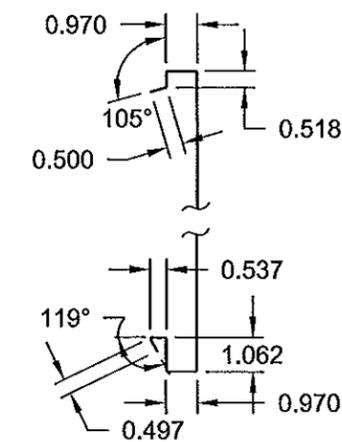

OUTER; SS, EOU, SIDE REMOVABLE

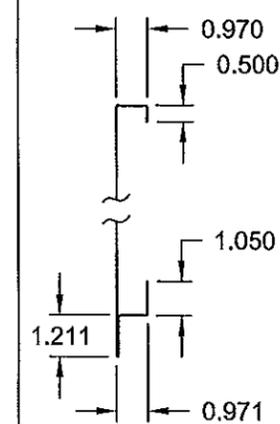

Approved as complying with the Florida Building Code
 Date 12/12/2013
 NOA# 12-0629.01
 Miami Dade Product Control
 By: *Heather A. Miller*

Scott Wolters
SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING #

AIRS0705

DESC.

**TRANE PERFORMANCE CLIMATE CHANGER
 AIR HANDLER - SIZE 3-30 STACKED UNIT**

TRANE
 US Inc.

REV. HISTORY

BY:

**S.MCCLOSKEY
 K.YUVARAJA**

REV.

A

SHEET

41 OF 46

SECTION

MOCK UPDWG
 SHEET REF:





46, 47, 48 OF 53

SCALE:

NTS

DATE





















16-SEP-2013

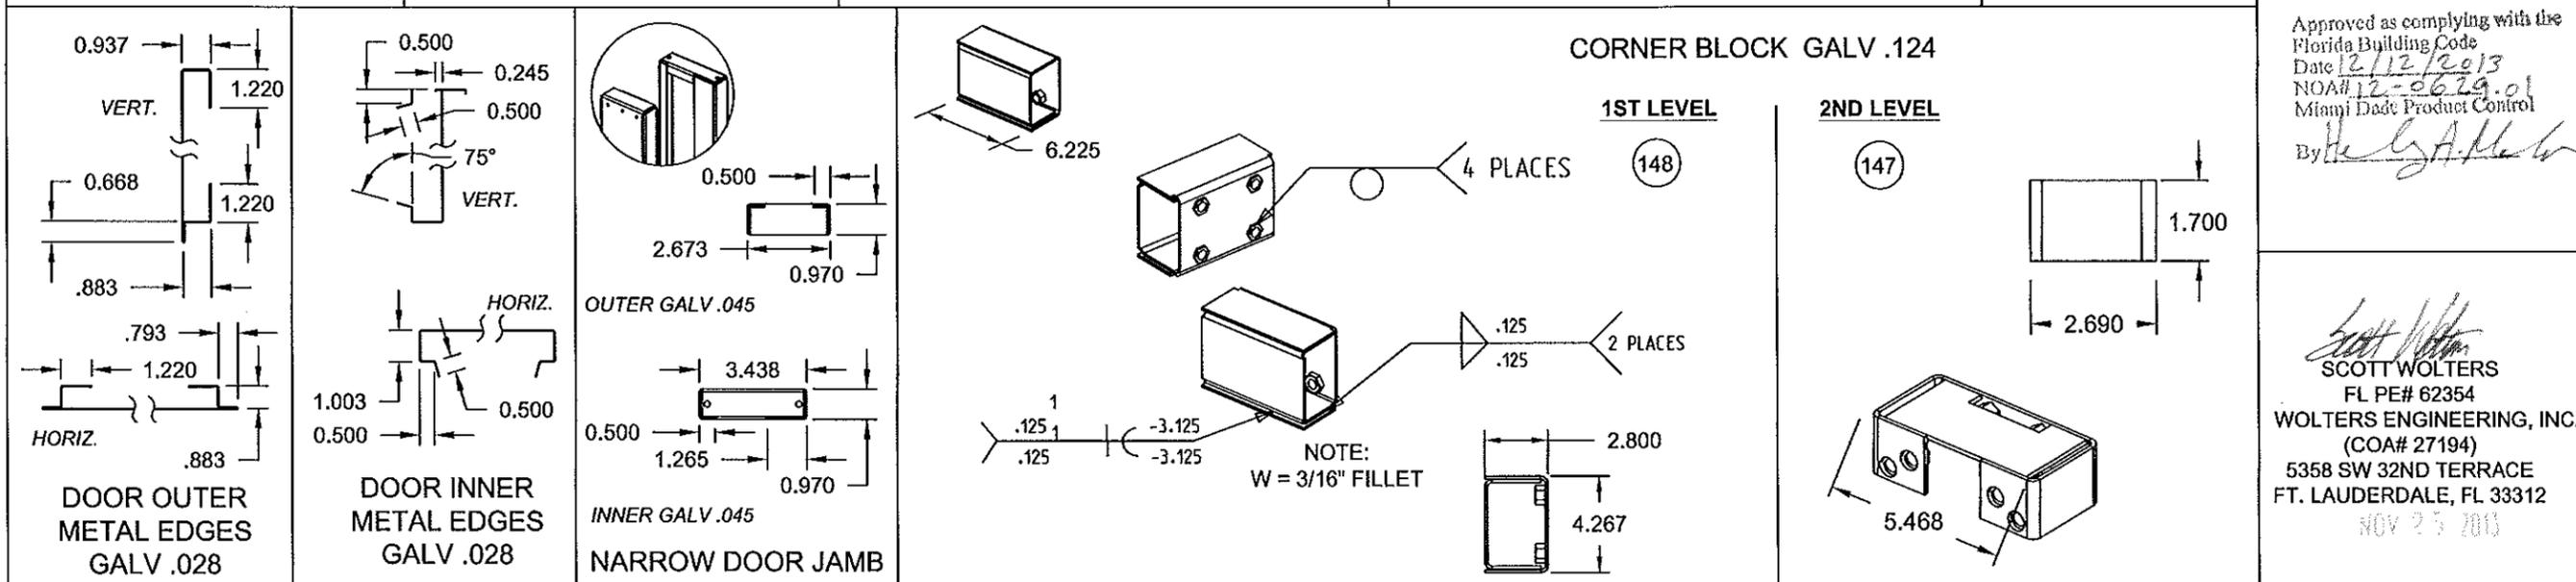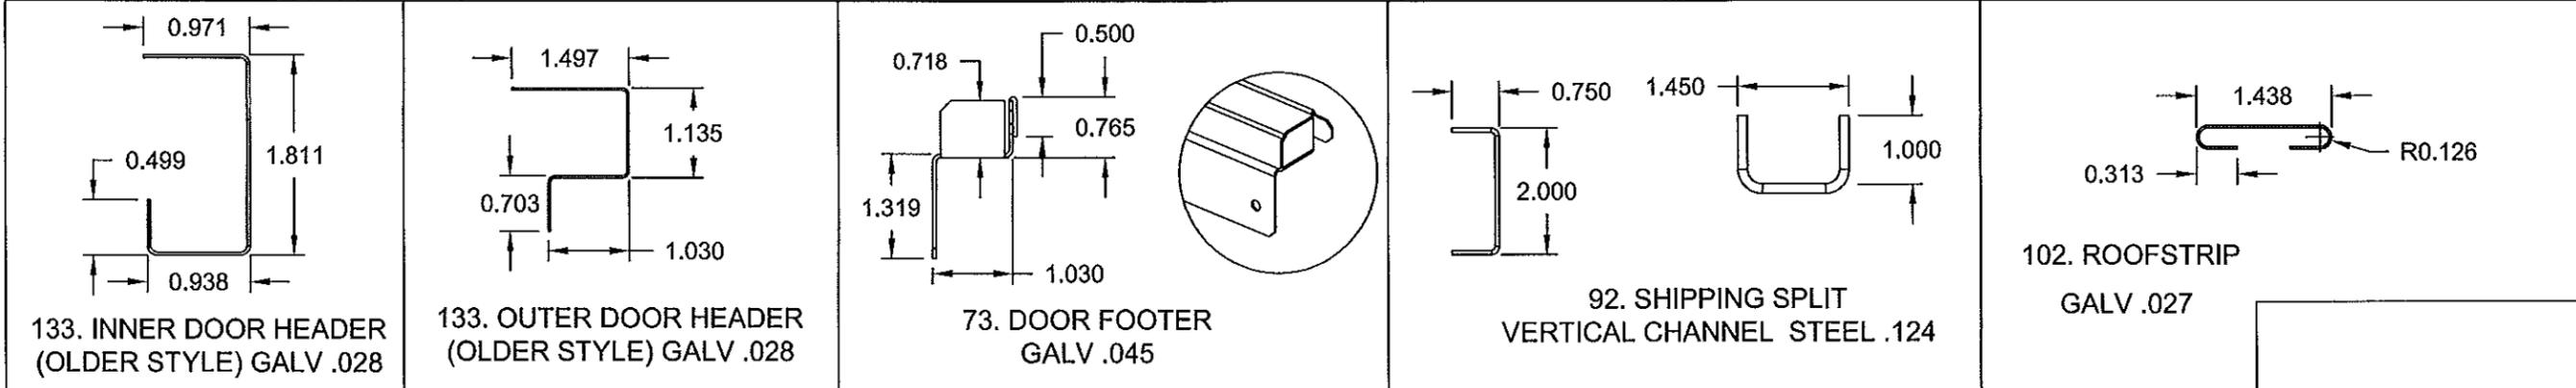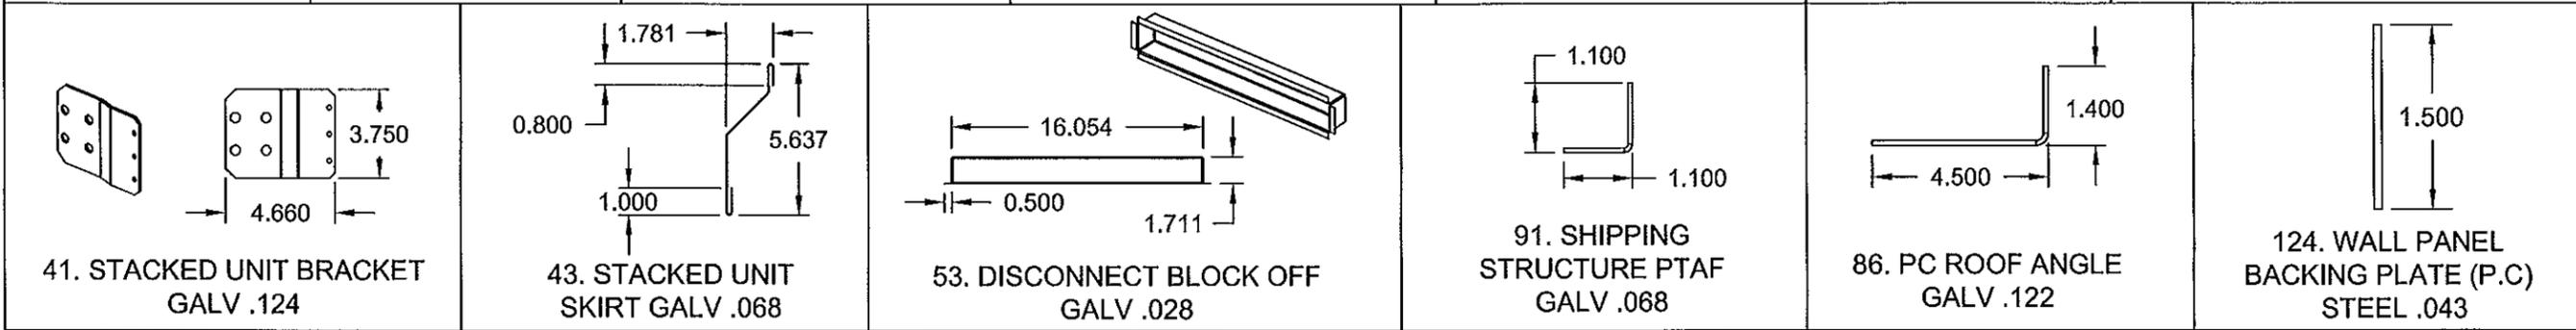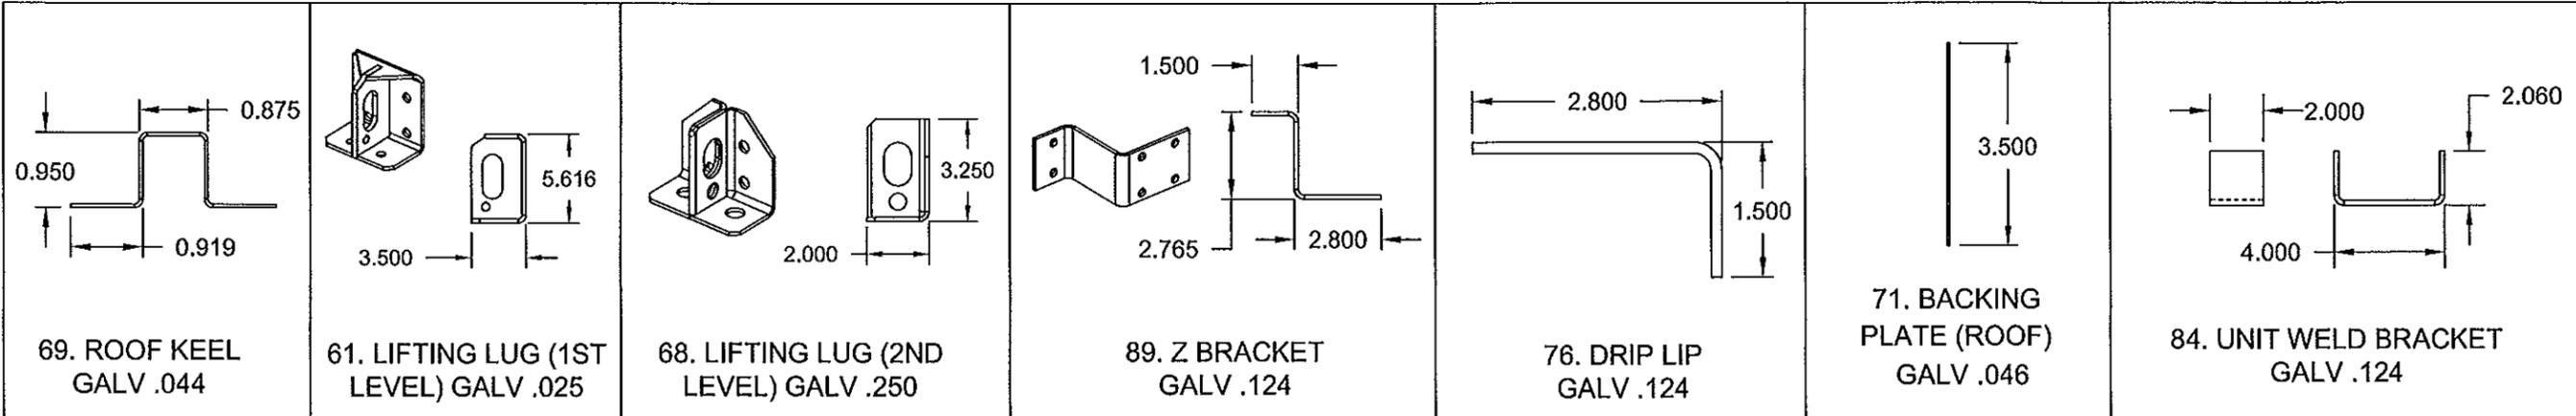

Approved as complying with the Florida Building Code
 Date 12/12/2013
 NOA# 12-2679.01
 Miami Dade Product Control
 By *[Signature]*


[Signature]
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

DRAWING #	AIRS0705	DESC.	TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY	---	BY:	S.MCCLOSKEY K.YUVARAJA	REV.	A
SHEET	42 OF 46	SECTION			MOCK UPDWG SHEET REF:	49, 50, 51, 52 OF 53	SCALE:	NTS	DATE	16-SEP-2013

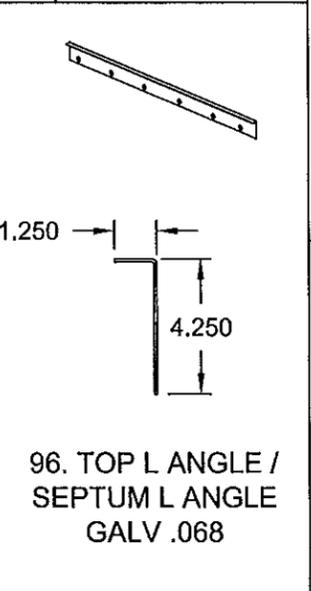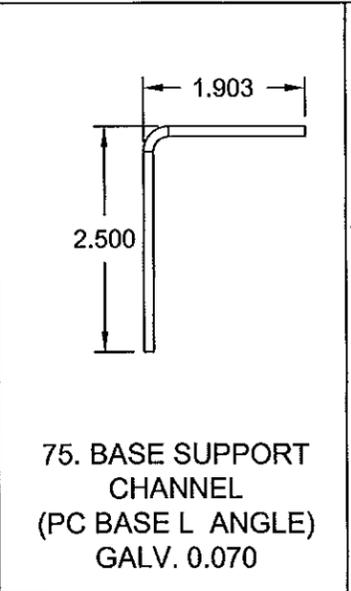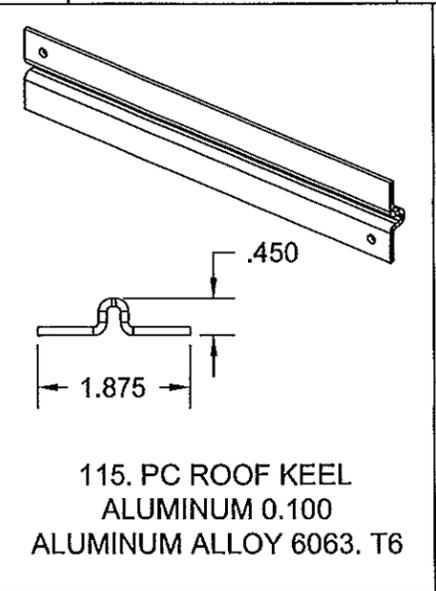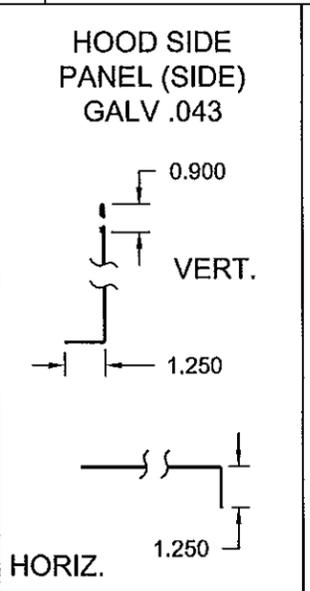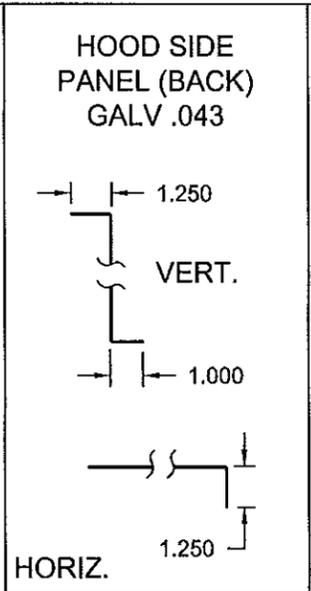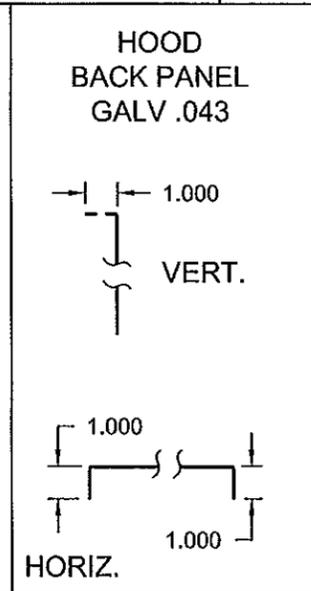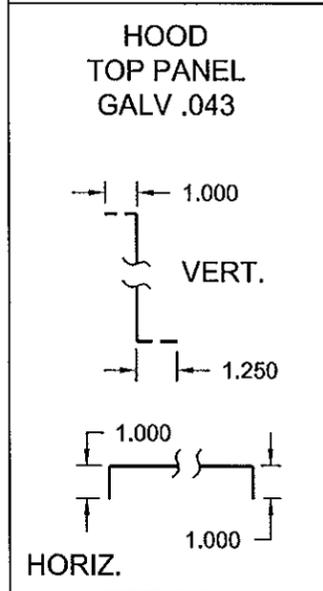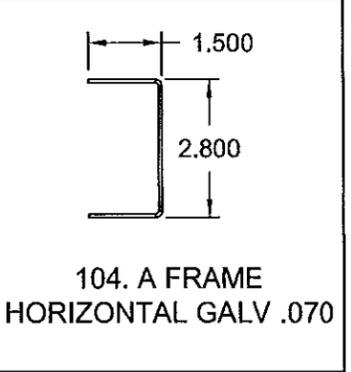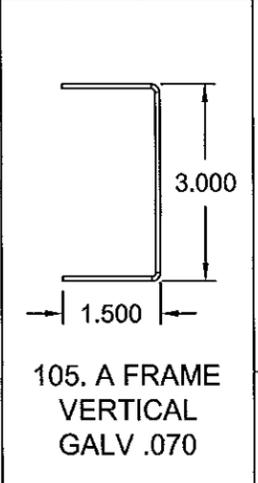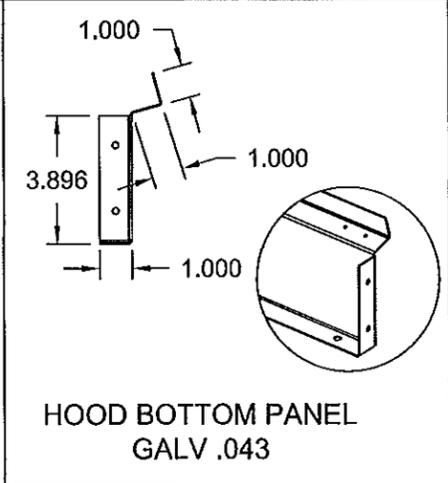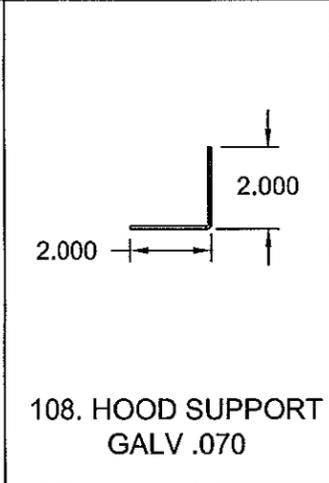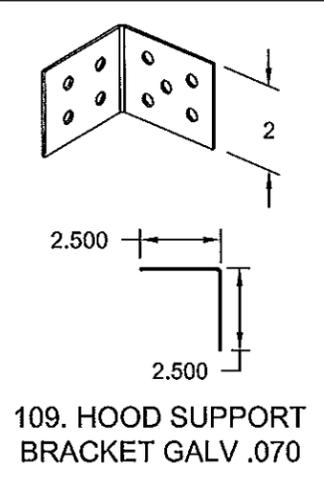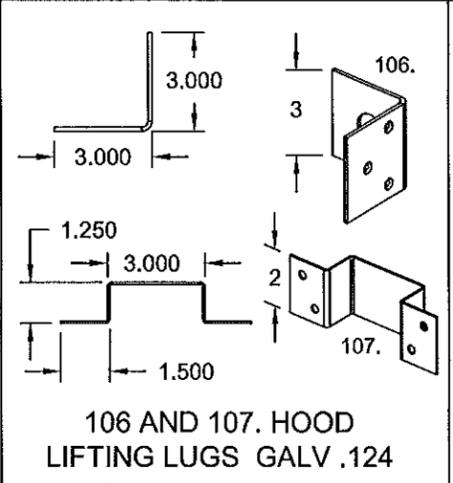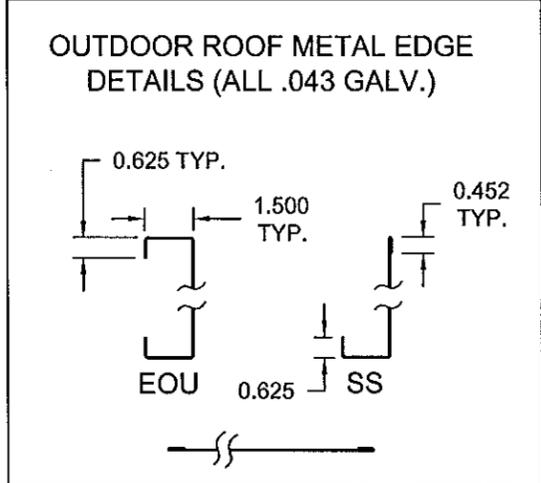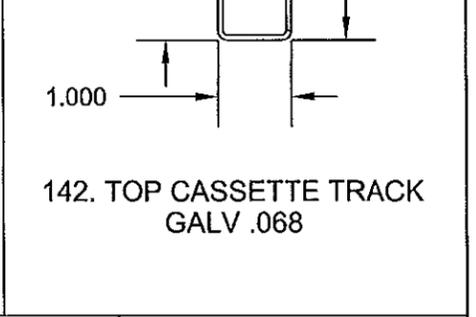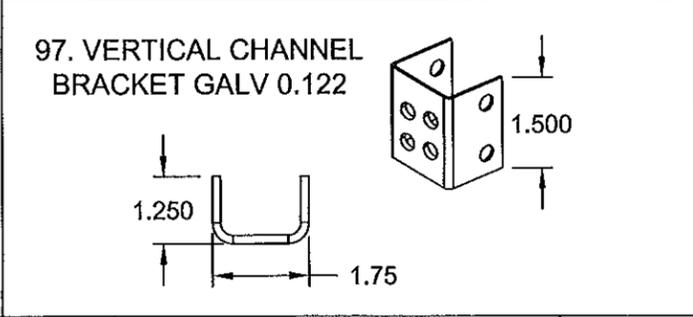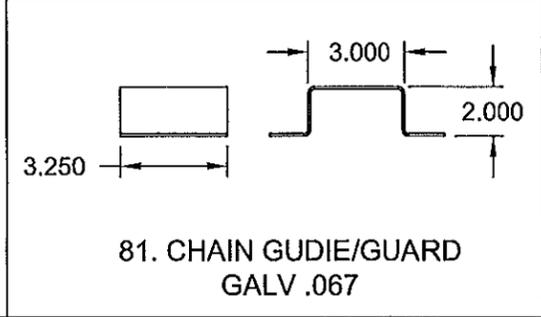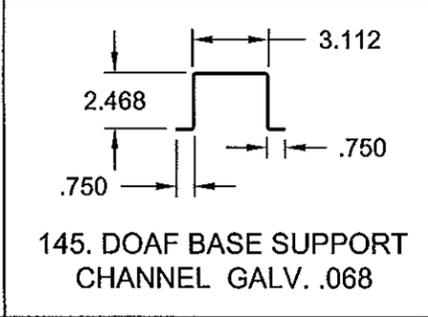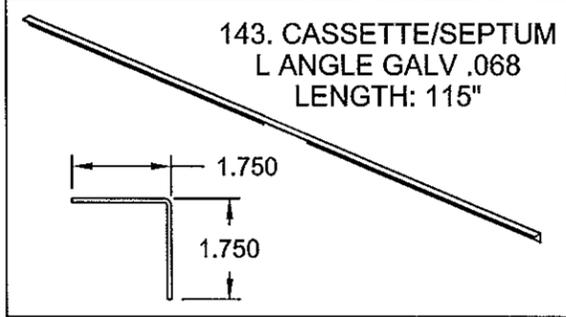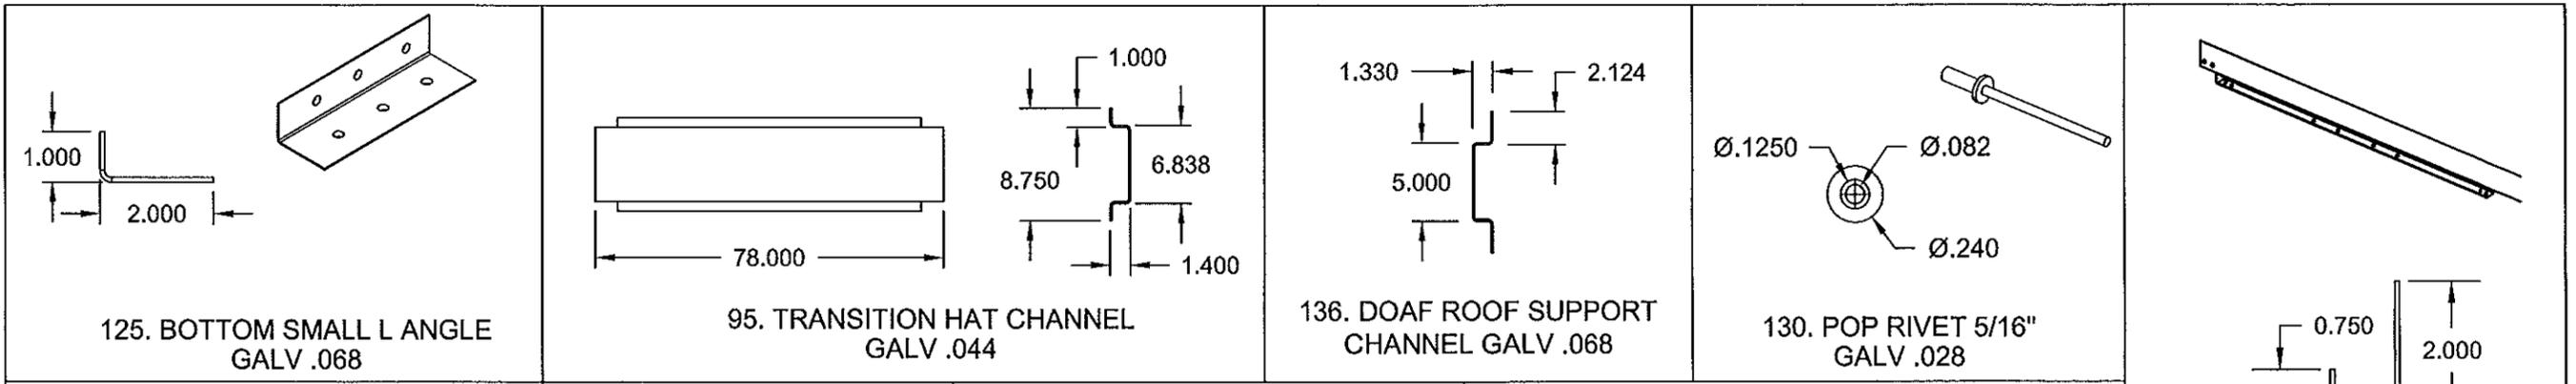


Approved as complying with the Florida Building Code
 Date 12/12/2013
 NOA# 12-0629.01
 Miami Dade Product Control
 By *Healy A. Miller*


Scott Wolters
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

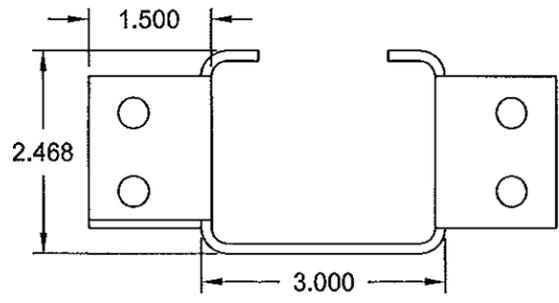


90. CROSS BEAM (2ND LEVEL) GALV .122




46. FOAM COVER GALV .027




112. BACKING PLATE (HOOD) GALV .070

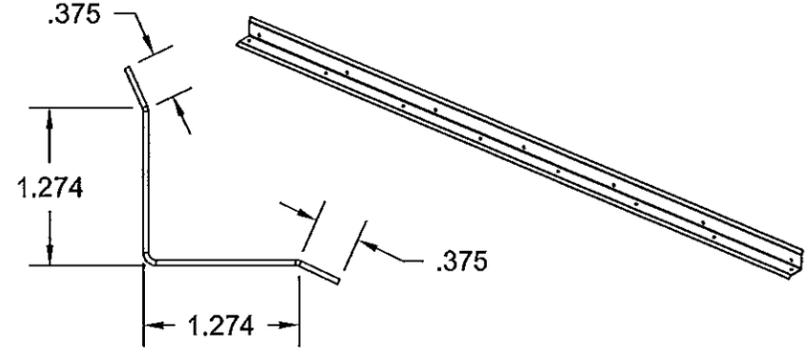


134. CORNER SEAM CAP GALV .070




111. HOOD SUPPORT TOP CHANNEL GALV .068

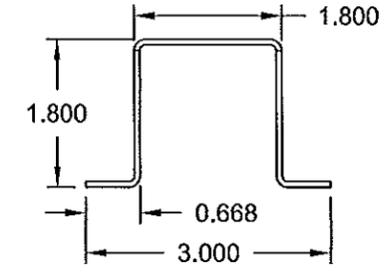


9. HAT CHANNEL GALV .070

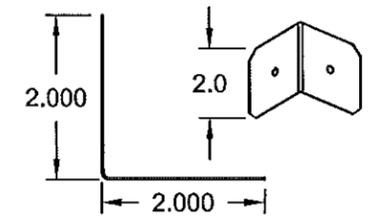


47. FOAM COVER CORNER GALV .027




48. MULLION GALV .055




137. HAT CHANNEL BRACKET 3" X 1.5" X 1.5" STEEL .067

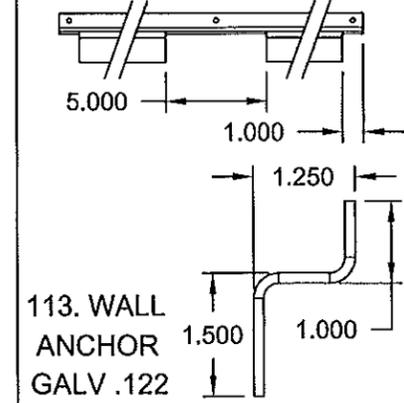


113. WALL ANCHOR GALV .122

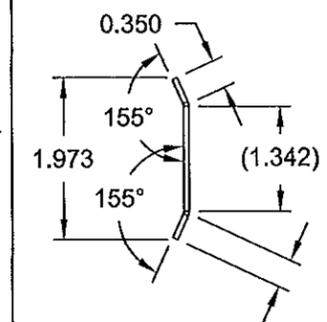


99/101. SEAM CAP GALV .068

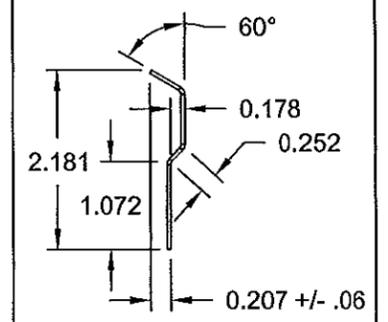


5. DECORATIVE COVER GALV .044

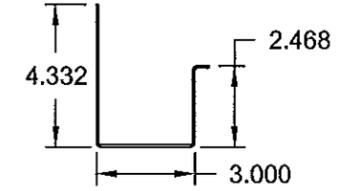


40. 2ND LEVEL BASE RAIL GALV .070




40. 2ND LEVEL BASE RAIL GALV .070

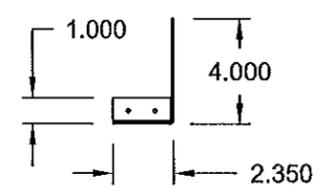


103. OVERHANG GALV .068

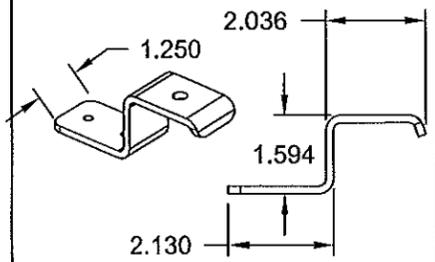


35. PADLOCK BRACKET GALV 0.156 MIN

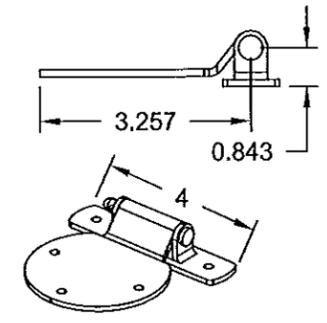


10. DOOR HINGE GALV 0.110

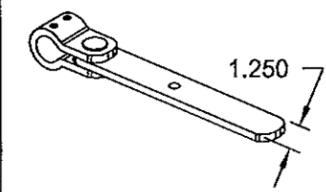


32. GANGED OPERATING HANDLE GALV 0.250




Approved as complying with the Florida Building Code
 Date 12/12/2013
 NOA# 12-0639.01
 Miami Dade Product Control
 By *[Signature]*




44. 1ST LEVEL BASE RAIL GALV .070

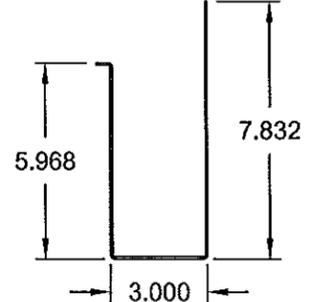


44. 1ST LEVEL BASE RAIL GALV .070

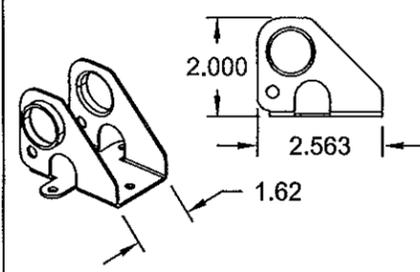


11/117. DOOR CAM BRACKET GALV 0.060

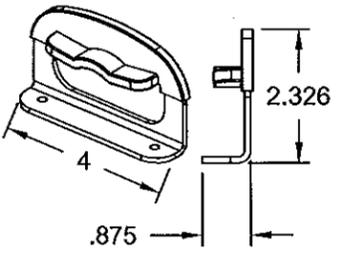

12. STRIKER PLATE GALV 0.110 MIN

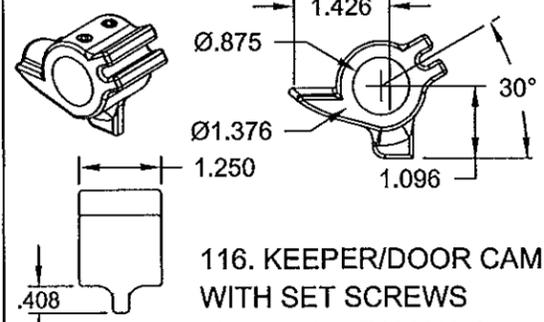


116. KEEPER/DOOR CAM WITH SET SCREWS MATERIAL=ZAMAK#3 DIE CAST PART




149. DOOR TUBE STEEL


[Signature]
 SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING, INC.
 (COA# 27194)
 5358 SW 32ND TERRACE
 FT. LAUDERDALE, FL 33312
 NOV 25 2013

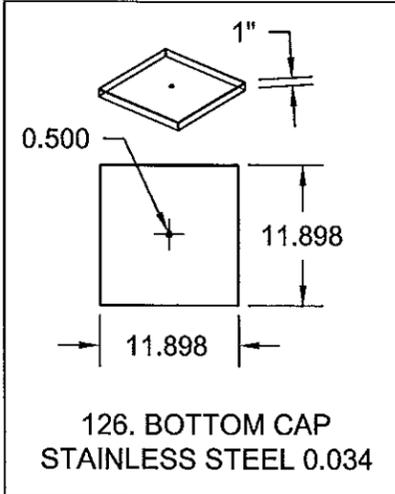


126. BOTTOM CAP
STAINLESS STEEL 0.034

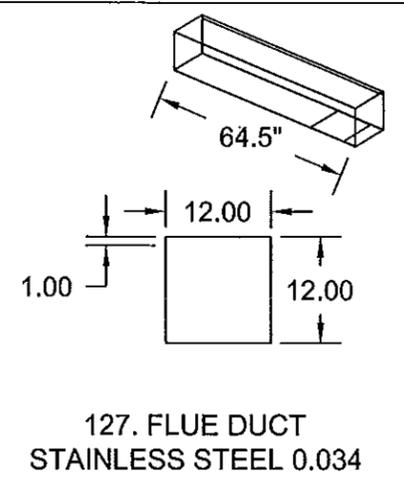


127. FLUE DUCT
STAINLESS STEEL 0.034

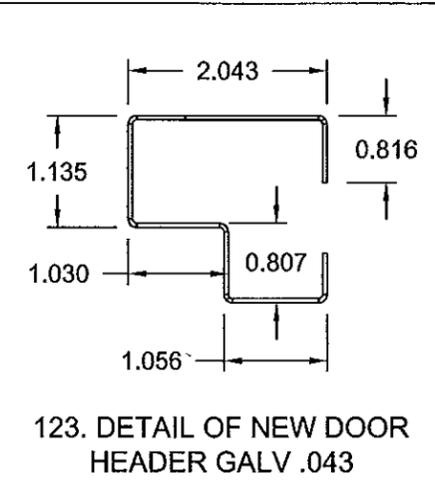


123. DETAIL OF NEW DOOR
HEADER GALV .043

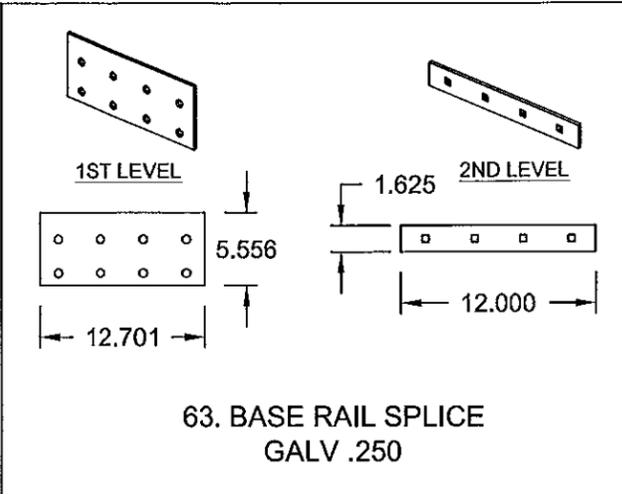


63. BASE RAIL SPLICE
GALV .250

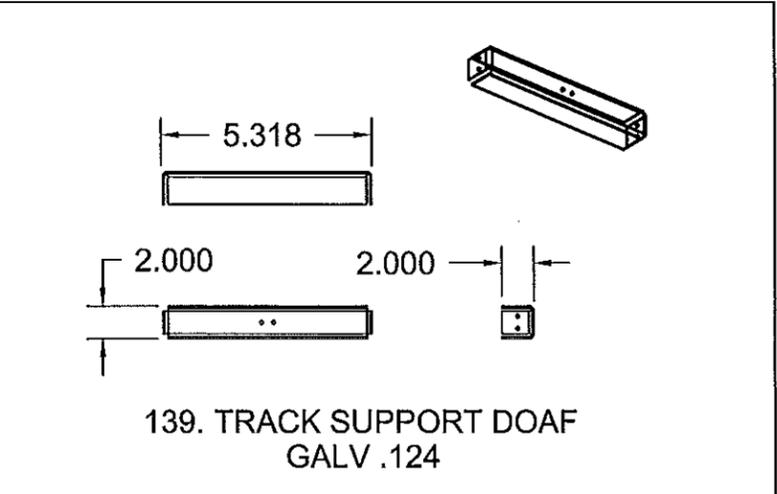


139. TRACK SUPPORT DOAF
GALV .124

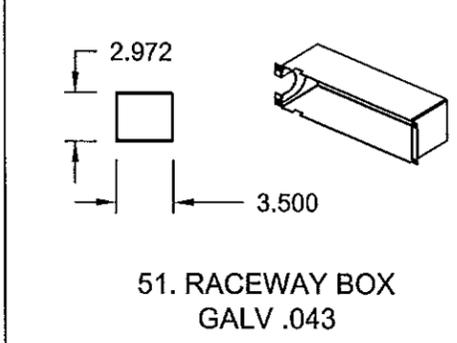


51. RACEWAY BOX
GALV .043

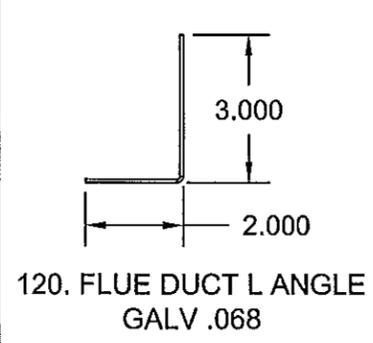


120. FLUE DUCT L ANGLE
GALV .068

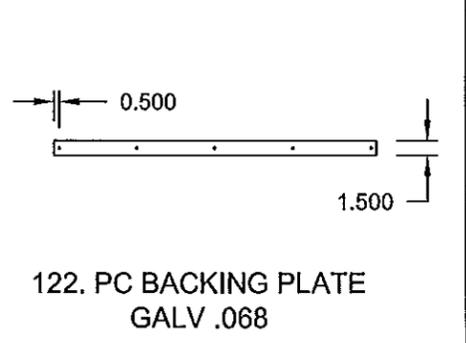


122. PC BACKING PLATE
GALV .068

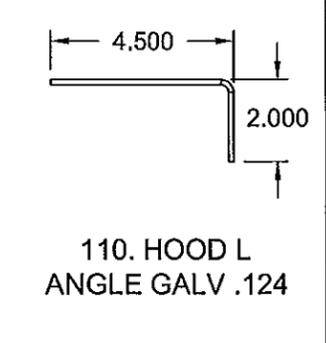


110. HOOD L
ANGLE GALV .124

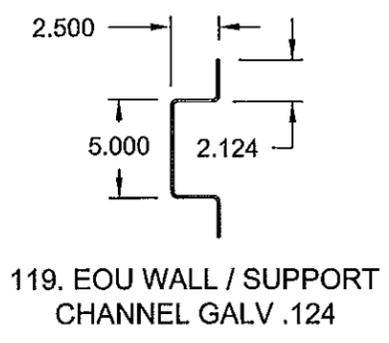


119. EOU WALL / SUPPORT
CHANNEL GALV .124

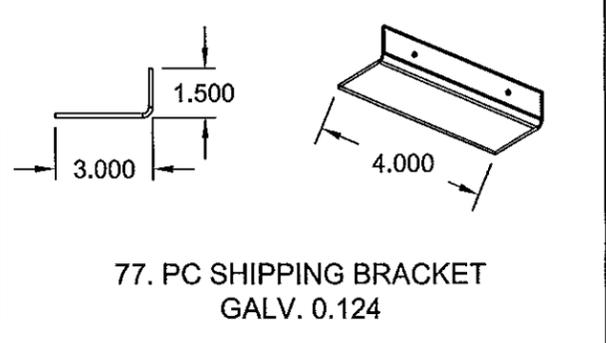


77. PC SHIPPING BRACKET
GALV. 0.124

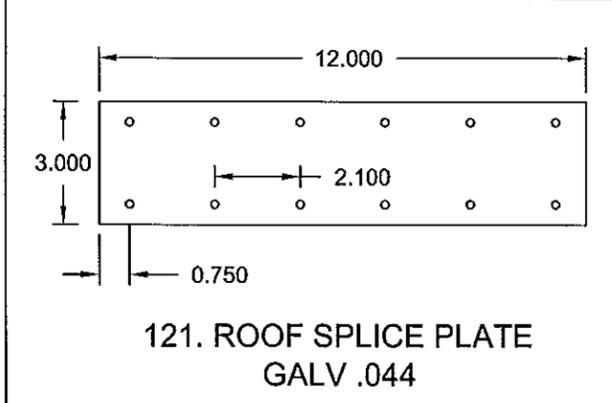


121. ROOF SPLICE PLATE
GALV .044

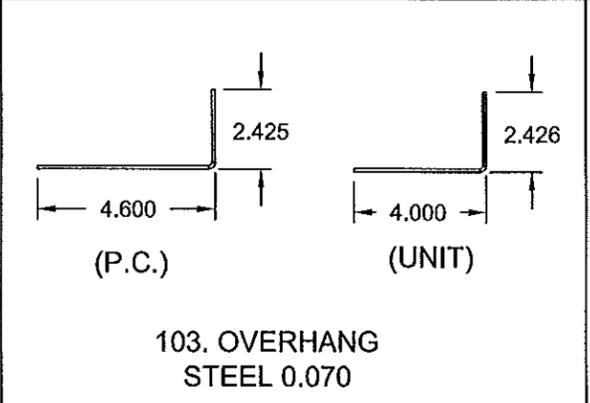

103. OVERHANG
STEEL 0.070

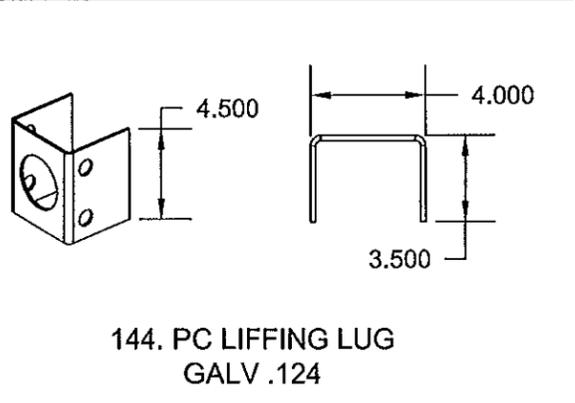


144. PC LIFTING LUG
GALV .124

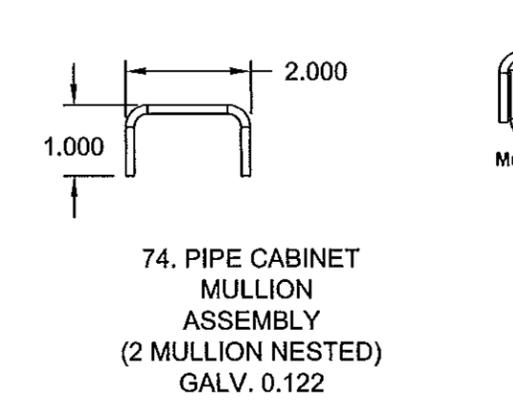


74. PIPE CABINET
MULLION
ASSEMBLY
(2 MULLION NESTED)
GALV. 0.122




Mullion Assembly

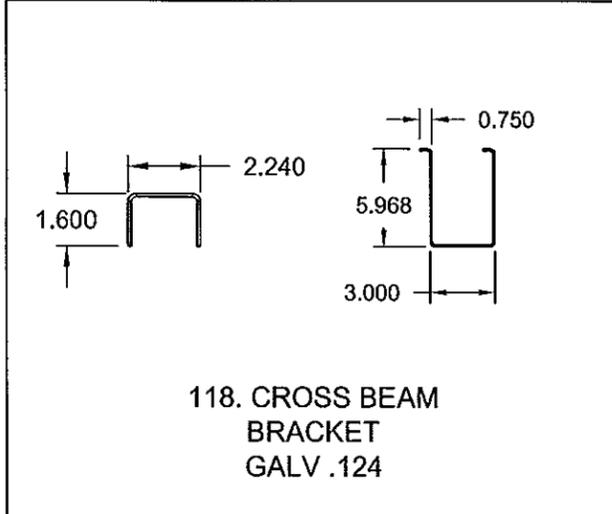


118. CROSS BEAM
BRACKET
GALV .124

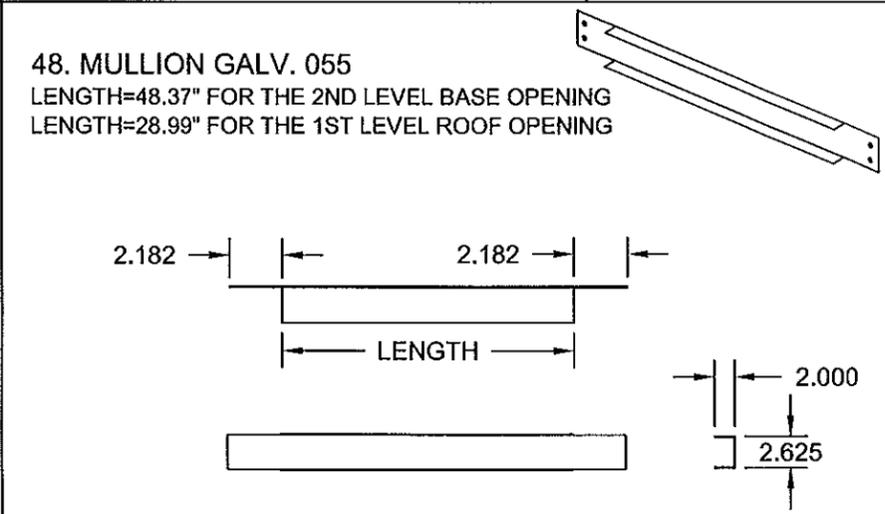

48. MULLION GALV. 055
LENGTH=48.37" FOR THE 2ND LEVEL BASE OPENING
LENGTH=28.99" FOR THE 1ST LEVEL ROOF OPENING

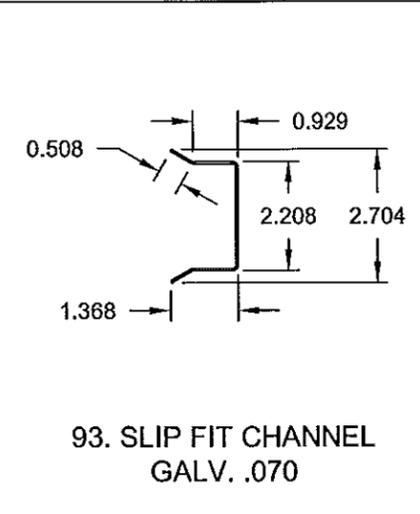

93. SLIP FIT CHANNEL
GALV. .070

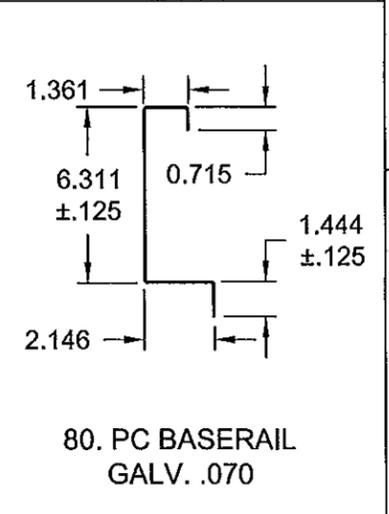


80. PC BASERAIL
GALV. .070

Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA#12-0629.01
Miami Dade Product Control
By *[Signature]*



[Signature]
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013

87. EXTERNAL WALL SPLICE PLATE

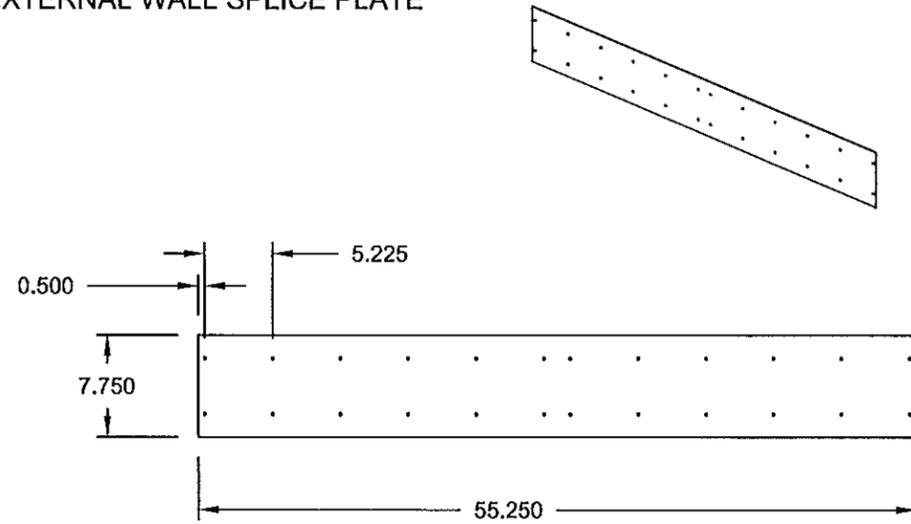


USED ON WALL PANEL
WITHOUT PLUG OPENING
GALV .044


85. INTERNAL WALL SPLICE PLATE

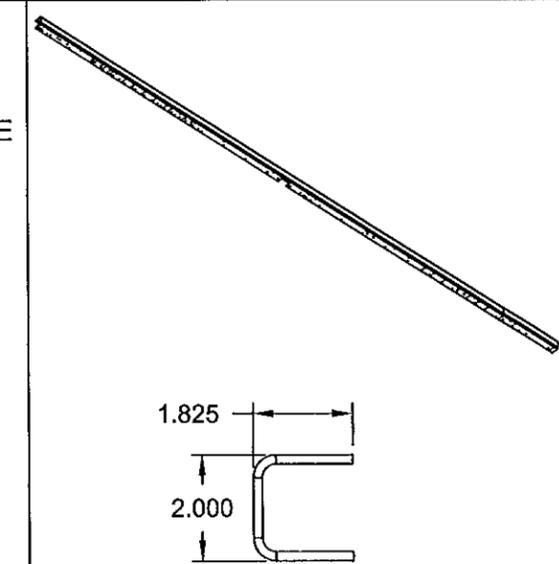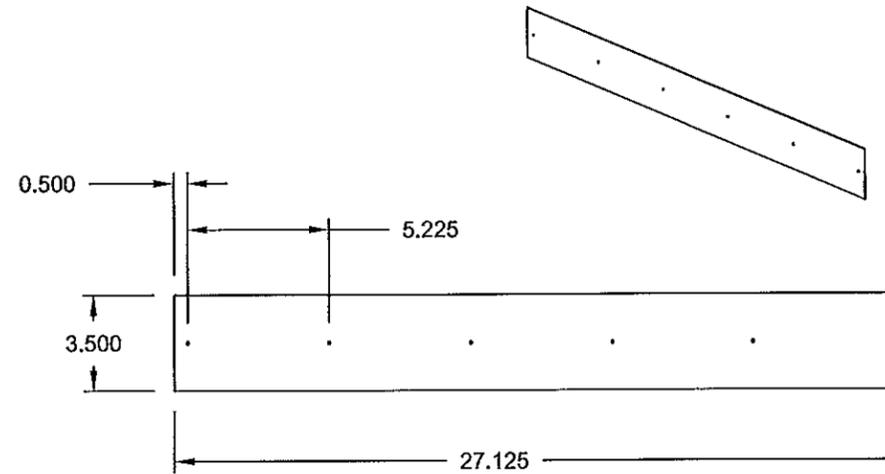


94. VERTICAL CHANNEL
GALV 0.122

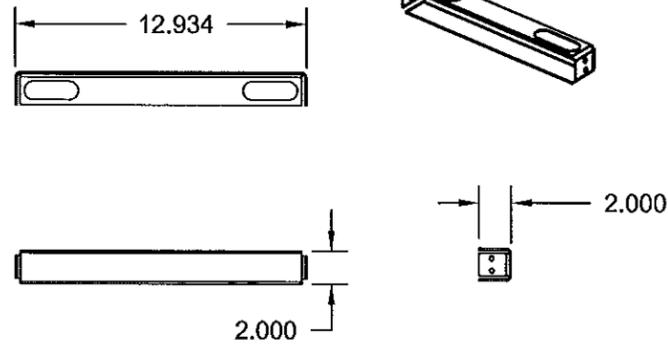


140. HORIZONTAL SUPPORT CHANNEL
GALV .068

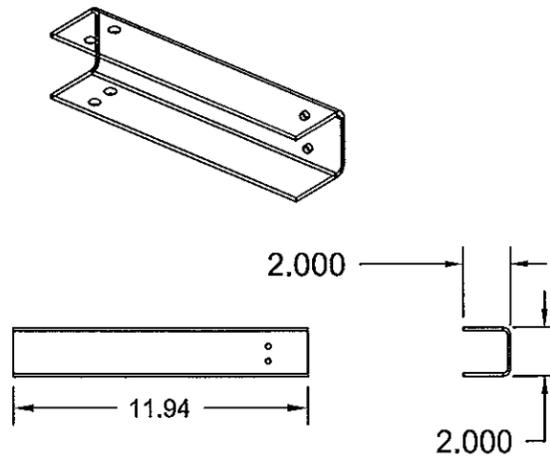


131. CASSETTE TRACK VERTICAL SUPPORT
GALV .124

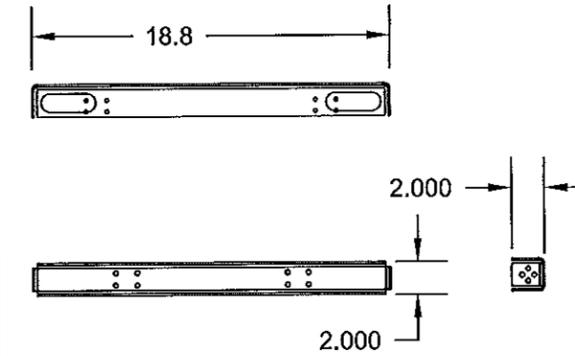

138. COLUMN SPACER
GALV .124

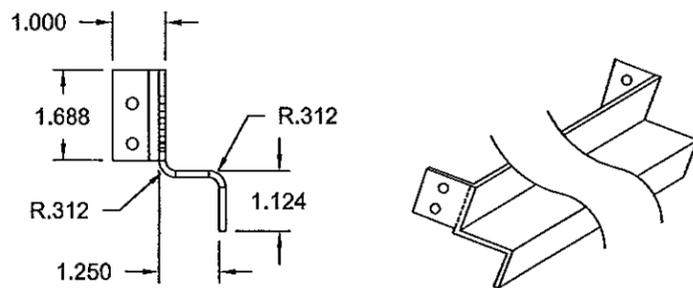

141. CASSETTE TRACK
GALV .124

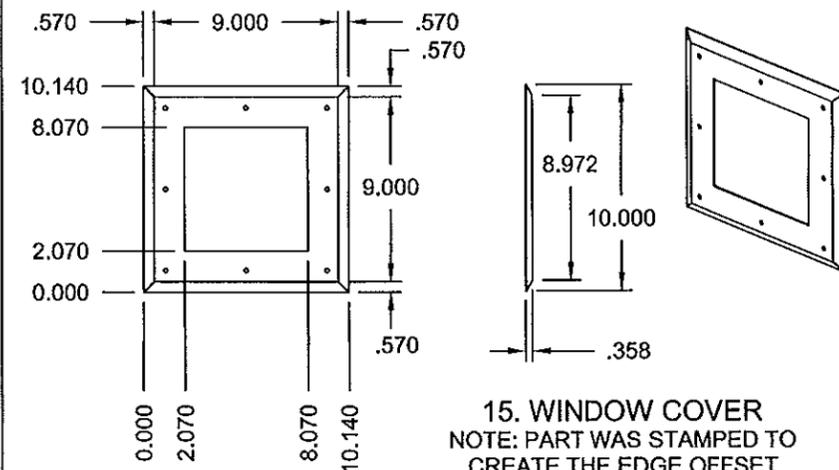

15. WINDOW COVER
NOTE: PART WAS STAMPED TO
CREATE THE EDGE OFFSET

Approved as complying with the
Florida Building Code
Date 12/12/2013
NOA# 12-0629-01
Miami Dade Product Control
By *[Signature]*

[Signature]
SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING, INC.
(COA# 27194)
5358 SW 32ND TERRACE
FT. LAUDERDALE, FL 33312
NOV 25 2013

DRAWING # AIRS0705		DESC. TRANE PERFORMANCE CLIMATE CHANGER AIR HANDLER - SIZE 3-30 STACKED UNIT	TRANE US Inc.	REV. HISTORY ---	BY: S.MCCLOSKEY K.YUVARAJA	REV. A
SHEET 46 OF 46	SECTION			MOCK UP DWG SHEET REF: 28, 29 OF 35 AND 57 - 63 OF 63	SCALE: NTS	DATE 16-SEP-2013