

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER) BOARD AND CODE ADMINISTRATION DIVISION

## NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION 11805 SW 26 Street, Room 208 T (786) 315-2590 F (786) 315-2599 www.miamidade.gov/economy

Continental Glass Systems, Inc. 325 West 74th Place Hialeah, Fl. 33014

Scope:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "6000" Aluminum Horizontal Rolling Window - L.M.I.

APPROVAL DOCUMENT: Drawing No. R.W.-6000-L.M.I., titled "Series 6000 Rolling Window --Large Missile Impact" sheets 1 through 7 of 7, dated 01/09/12, with revision #2 dated 01/23/13, prepared by manufacturer, signed and sealed by Kelvyn Whitfield, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

#### MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by Manuel Perez, P.E.

MIAMI-DADE COUNTY
APPROYED
3/14/13

NOA No. 12-0702.04 Expiration Date: March 21, 2018 Approval Date: March 21, 2013

Page 1

#### Continental Glass Systems, Inc.

#### NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

#### A. DRAWINGS

- 1. Manufacturer's die drawings and sections.
- 2. Drawing No.R.W.-6000-L.M.I., titled "Series 6000 Rolling Window Large Missile Impact", sheets 1 to 7 of 7, dated 01/09/12, with revision #2 dated 01/23/13, prepared by manufacturer, signed and sealed by Kelvyn Whitfield, P.E.

#### B. TESTS

- 1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
  - 5) Large Missile Impact Test per FBC, TAS 201-94
  - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of an aluminum rolling window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-6787**, dated 01/19/12, signed and sealed by Marlin D. Brinson, P.E.

#### C. CALCULATIONS

- 1. Anchor verification calculations and structural analysis, complying with FBC-2010, dated 02/20/12, prepared, signed and sealed by Kelvyn Whitfield, P.E.
- 2. Glazing complies with ASTM E1300-04

#### D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

#### E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. 11–0624.02 issued to E.I. DuPont DeNemours & Co., Inc. for their "DuPont SentryGlas® Interlayer" dated 08/25/11, expiring on 01/14/17.

#### F. STATEMENTS

- 1. Statement letter of conformance, complying with the FBC-2010, dated May 15, 2012, signed and sealed by Kelvyn A. Whitfield, P.E.
- 2. Statement letter of no financial interest, dated May 15, 2012, signed and sealed by Kelvyn A. Whitfield, P.E.
- 3. Proposal No. 11–1506 issued by Product Control Section, dated December 1, 2011, signed by Manuel Perez, P.E.

#### G. OTHER

1. None.

Manuel Perez, P.E. Product Control Examiner NOA No. 12-0702.04

Expiration Date: March 21, 2018 Approval Date: March 21, 2013

## 146" WINDOW WIDTH 70**\*** 38" 3213/16 66 5/8" D.L.O. D.L.O. D.L.O. \_\_\_\_ (16)CAM LOCK CAM LOCK (16) 60" WINDOW HEIGHT 53" DLO ري ري MULLION MULLION 3"|3"|3" 23" 23" 23\* SEE DETAIL SEE DETAIL

## SERIES 6000 ROLLING WINDOW LMI

### NOTES:


- 1. THIS ROLLING WINDOW SYSTEM IS DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2010 (FBC) FLORIDA BUILDING CODE CHAPTER 16 AND 24, UNDER THE SPECIFIC CONDITION SHOWN ON THIS DRAWING. REF. FTL No. 6787 2. ALL EXTRUSIONS ARE ALUMINUM, 6005—T5 ALLOY, WITH A MINIMUM FY OF 35.000 P.S.I. U.O.N.
- 3. LARGE MISSILE IMPACT: INSTALLATION WILL NOT REQUIRE A HURRICANE PROTECTION SYSTEM.
- 4. INSTALLATION ANCHORS ARE  $\frac{1}{4}$ " AND  $\frac{5}{6}$ " I.T.W. TAP—CON. 1  $\frac{1}{2}$ " MIN. EMBEDMENT INTO FILLED CONCRETE BLOCK OR BETTER. NOTE:  $\frac{1}{4}$ " ANCHORS ARE ONLY ALLOWED WHEN THE SHIM SPACE DOES NOT EXCEED  $\frac{1}{4}$ ".
- 5. SHIMS. USE HARD PLASTIC.
- 6. APPROVED STRUCTURAL SILICONE:

  A) 795 DOW CORNING

  B) 983 DOW CORNING
- 7. PERIMETER SEALANT DOW CORNING 790 TYPICAL

## WINDOW ELEVATION EXTERIOR VIEW

Design Load Capacity (P. S. F.)				
Positive	Negative	Reinforcing		
OVER 90 UP TO 110	110	3/8"x1"X40"LG MAX. Steel bar		
90 .	90	None		

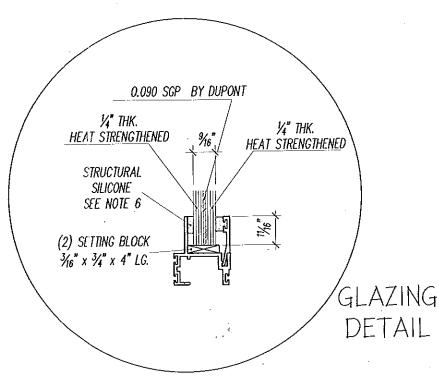

APPROVED

Approved as complying with the Florida Building Code
Date
NOAN
Miami Dade Product Control

By
DATE

ELEVATION

KELVYN WHITFIELD.P.E
1002 NE 116 ST
MIAMI, FL 33161

DATE OF ZS (13)
FLORIDA No-24140
MECHANICAL


Continental Glass Systems 325 West 74 Place Hialeah Florida, 33014

Series 6000
ROLLING WINDOW
LARGE MISSILE
IMPACT

And The Control of th


Checked by G. S.
Drawing No.
R.W.-6000-L.M
Sheet 1 of 7

## SERIES 6000 ROLLING WINDOW

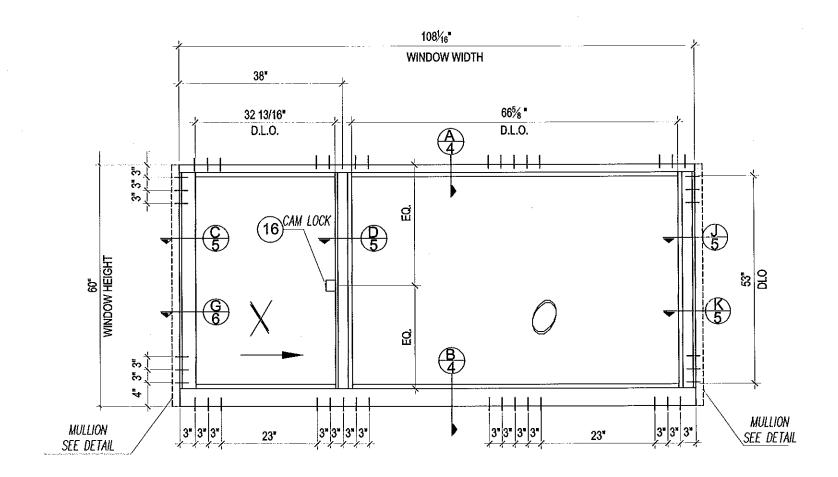

# WINDOW ELEVATION EXTERIOR VIEW

Design Load Capacity (P. S. F.)				
Positive	Negative	Reinforcing		
OVER 90 UP TO 110	110	3/8"x1"X40"LG MAX. Steel bar		
90	90	None		

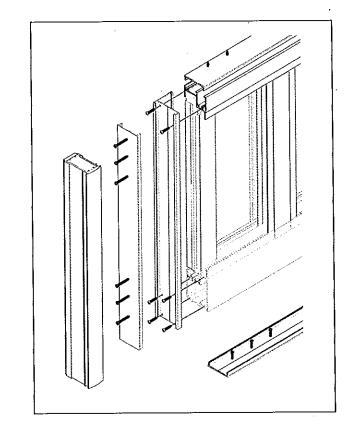

Continental Glass Systems INC. 325 West 74 Place Hialeah Florida, 33014 Series 6000 ROLLING WINDOW LARGE MISSILE IMPACT Drawing No. R.W.-6000-L.M.

APPROVED	ELEVATION
Approved as complying with the Biorida Buiding Code Date NOAI Minul Dade Product Control By	KELVYN WHITFIELD.P.E 1002 NE 116 ST MIAMI, EL 33181  DATE 0 28 3 FLORIDA No-24140 MECHANICAL

