



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY, FLORIDA  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

**NOTICE OF ACCEPTANCE (NOA)**

**Continental Glass Systems, Inc.**  
325 West 74 Place  
Hialeah, FL 33014

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "2200" Aluminum Sliding Glass Door – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. CGS007, titled "Series 2200 Alum. Sliding Glass Door", sheets 1 through 09 of 09, dated 09/02/09, prepared by Building Drops, Inc., with revision "A" dated 07/25/12, signed and sealed by Hermes F. Norero, P. E., bearing the Miami-Dade County Product Control Section Revision Stamp with the Notice of Acceptance Number and Expiration Date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LIMITATION:** The Minimum Specific Gravity of Wood shall be SG = 0.55.

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. 09-0924.17 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



*J. Gascon*  
*10/2/12*

NOA No. 12-0824.06  
Expiration Date: February 24, 2015  
Approval Date: October 11, 2012  
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.  
*(Submitted under previous NOA No. 09-0924.17)*
2. Drawing No. CGS007, titled "Series 2200 Alum. Sliding Glass Door", sheets 1 through 09 of 09, dated 09/02/09, prepared by Building Drops, Inc., with revision "A" dated 07/25/12, signed and sealed by Hermes F. Norero, P. E.

**B. TESTS**

1. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
  - 7) Standard Test Methods for Deglazing Force of Fenestration Products per ASTM E 842-04
  - 8) Standard Test Method for Determination of Operating Force B of Sliding Windows and Doors per ASTM E 2068-00 (2008)along with marked-up drawings and installation diagram of Al. SDG, prepared by Fenestration Testing Laboratory, Inc., Test Report No. FTL-5857, dated 09/02/09, signed and sealed by Julio E. Gonzalez, P. E.  
*(Submitted under previous NOA No. 09-0924.17)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2010, prepared by Building Drops, Inc., dated 08/21/12, signed and sealed by Hermes F. Norero, P. E.
2. Glazing complies with ASTM E1300-04

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. 11-1102.11 issued to **Solutia, Inc.** for their "**Saflex Clear and Color Glass Interlayers**" dated 06/14/12, expiring on 05/21/16



Jaime D. Gascon, P. E.  
Product Control Section Supervisor  
NOA No. 12-0824.06  
Expiration Date: February 24, 2015  
Approval Date: October 11, 2012

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**F. STATEMENTS**

1. Statement letter of no financial interest, conformance and complying with FBC-2010, issued by Building Drops, Inc., dated 08/21/12, signed and sealed by Hermes F. Norero, P. E.
2. Laboratory compliance letter for Test Report No. **FTL-5857**, issued by Fenestration Testing Laboratory, Inc., dated 09/02/09, signed and sealed by Julio E. Gonzalez, P. E. *(Submitted under previous NOA No. 09-0924.17)*

**G. OTHERS**

1. Notice of Acceptance No. **09-0924.17**, issued to Continental Glass Systems, Inc. for their Series "**2200 Aluminum Sliding Glass Door - L.M.I.**", approved on 02/24/10 and expiring on 02/24/15.



---

Jaime D. Gascon, P. E.  
Product Control Section Supervisor  
NOA No. 12-0824.06  
Expiration Date: February 24, 2015  
Approval Date: October 11, 2012

# CONTINENTAL GLASS SYSTEMS

## SERIES 2200 SLIDING GLASS DOOR (LARGE MISSILE IMPACT)



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

**INSTALLATION NOTES:**

1. TWO (2) INSTALLATION ANCHORS ON HEAD AND ONE (1) INSTALLATION ANCHOR ON SILL FOR EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. FOR INSTALLATION DIRECTLY INTO CONCRETE/MASONRY, USE 5/16 INCH DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 3/4 INCH MINIMUM EMBEDMENT.
6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
10. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
  - A. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
  - B. GROUT-FILLED CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.
  - C. HOLLOW BLOCK CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.

**GENERAL NOTES:**

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2010 FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
  - TAS 201-94
  - TAS 202-94
  - TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS. IN HVHZ AREAS, ONE TIME PRODUCT APPROVAL TO BE OBTAINED FROM MIAMI-DADE PERA.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. DOOR FRAME MATERIAL: ALUMINUM 6005-T5 & 6063-T5
7. IN ACCORDANCE WITH THE 2010 FBC SEC. 2003.8.4 DISSIMILAR METALS INCLUDING FASTENERS THAT MAY COME INTO CONTACT WITH ALUMINUM UNIT FRAMING SHALL BE PROTECTED AS DEFINED IN SEC 2003.8.4.2.
8. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300-04 GLASS CHARTS. SEE SHEET 6 FOR GLAZING DETAIL.

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	A	INSTALLATION & GENERAL NOTES
2	A	ELEVATION & ANCHOR LAYOUT
3	A	ELEVATIONS & ANCHOR LAYOUTS
4	A	VERTICAL SECTIONS
5	A	HORIZONTAL SECTIONS
6	A	HORIZONTAL SECTIONS & GLAZING DETAIL
7	A	COMPONENTS & BILL OF MATERIALS
8	A	COMPONENTS
9	A	CORNER ASSEMBLIES

DESIGN PRESSURE RATING		
	DESIGN PRESSURE - ALL SIZES	MISSILE IMPACT RATING
NON-REINFORCED	+70.0 / -70.0 PSF	LARGE MISSILE IMPACT RATED
REINFORCED	+90.0 / -90.0 PSF	LARGE MISSILE IMPACT RATED

TITLE: SERIES 2200 ALUM. SLIDING GLASS DOOR INSTALLATION & GENERAL NOTES

PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738

**REVISIONS**

NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12

HERMES F. NORERO, P.E.  
 FLORIDA P. E. NO. 73179  
 398 EAST DANIA BEACH BLVD. #338  
 DANIA BEACH, FL 33004  
 FBPE CERT. OF AUTHORIZATION NO. 29578


PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No **12-0824.06**  
 Expiration Date **02/24/2015**  
 By   
 Miami Dade Product Control

DATE: 07.13.12  
 DWN BY: JLA  
 CHK BY: HFN  
 SCALE: NTS  
 DWG #: **CGS007**  
 SHEET: 1 OF 9



TITLE: SERIES 2200 ALUM.  
SLIDING GLASS DOOR  
ELEVATION  
& ANCHOR LAYOUT

PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738


**HEAD RECEPTOR**

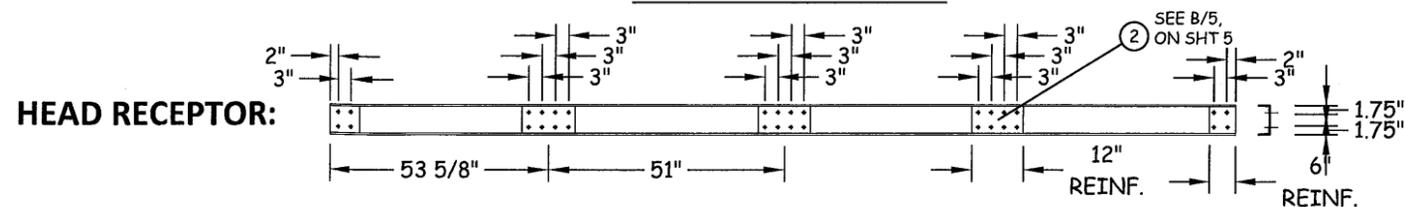

**STANDARD FRAME**

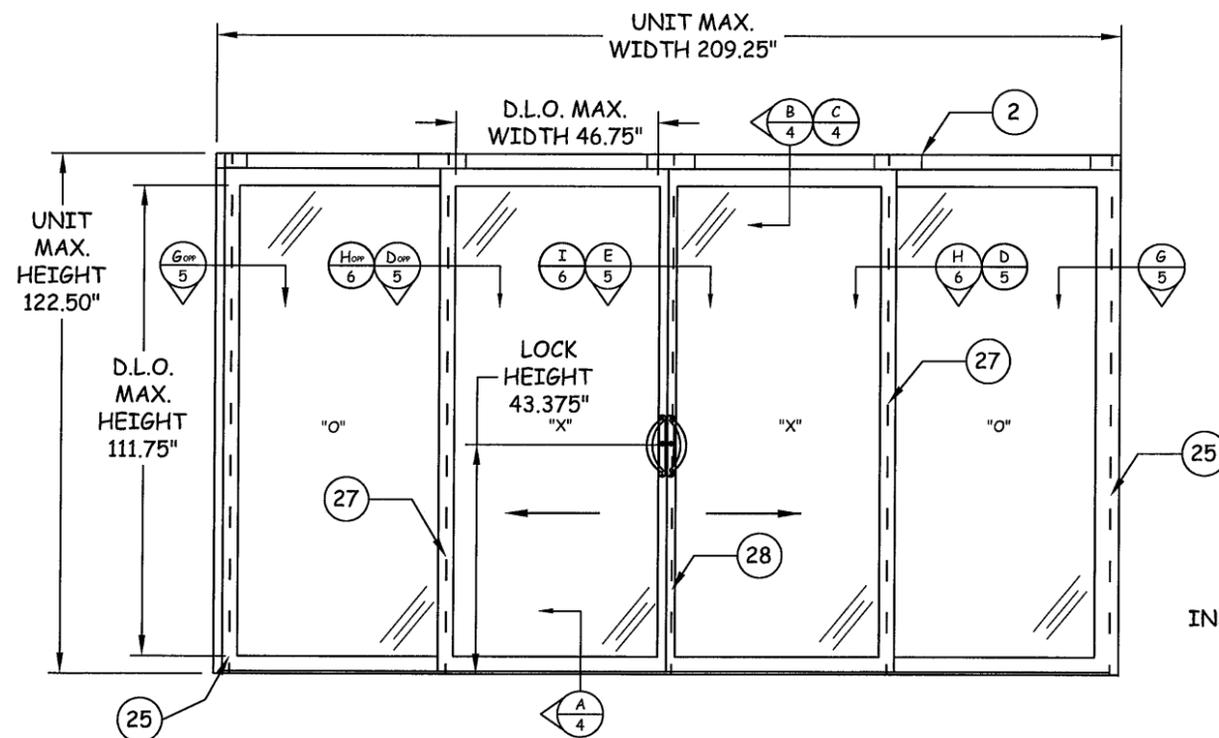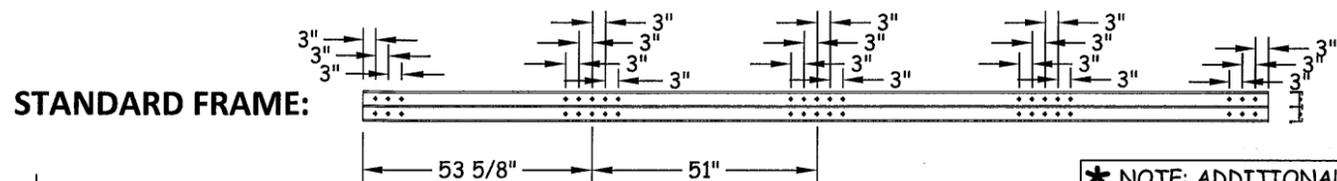

**ELEVATION**

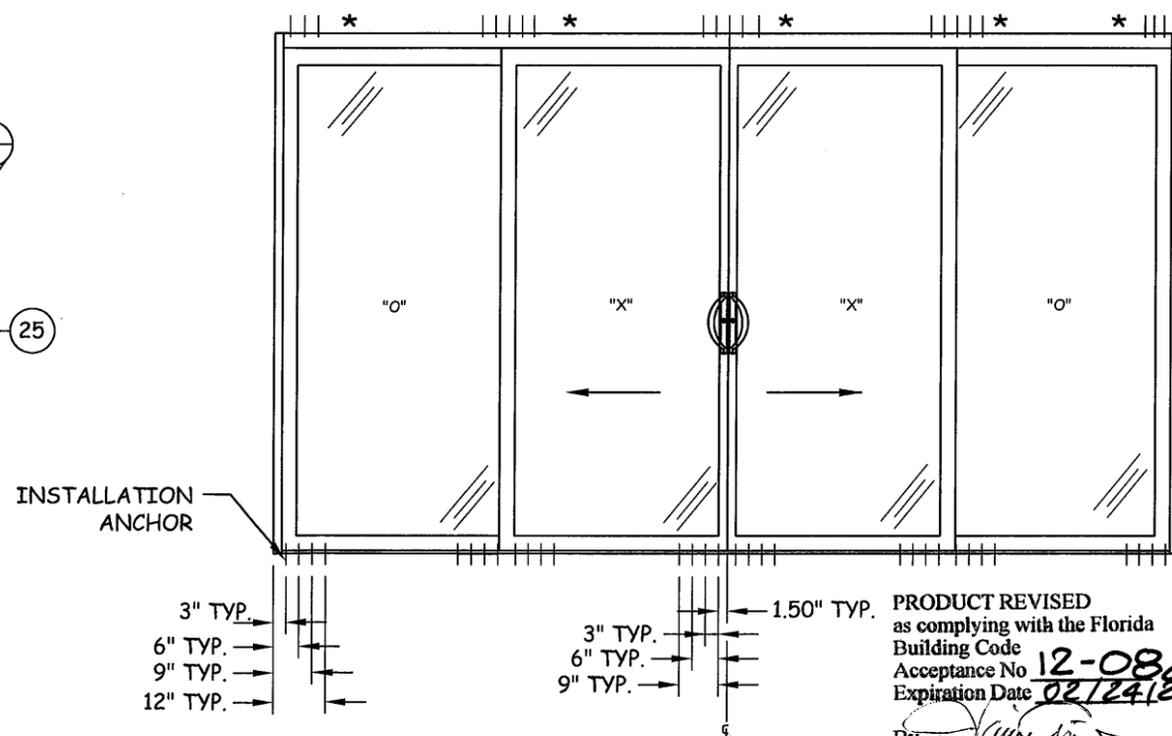

**ANCHOR LAYOUT**

NOTE: TWO (2) INSTALLATION ANCHORS ON HEAD AND ONE (1) INSTALLATION ANCHOR ON SILL FOR EACH ANCHOR LOCATION SHOWN.

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. **12-0824.06**  
Expiration Date **02/24/2015**  
By: *[Signature]*  
Miami Dade Product Control

**REVISIONS**

NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12

*[Signature]*  
6-21-2012  
HERNAN F. NOBREGA, P.E.  
FLORIDA LICENSE NO. 73378  
398 EAST DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
FBPE CERT. OF AUTHORIZATION NO. 29578

DATE: 07.13.12	DWN BY: JLA	CHK BY: HFN	SCALE: NTS
DWG #: <b>CGS007</b>			
SHEET: <b>2 OF 9</b>			

TITLE: SERIES 2200 ALUM.  
SLIDING GLASS DOOR  
ELEVATIONS  
& ANCHOR LAYOUTS

PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738

**REVISIONS**

NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12








**\* NOTE: ADDITIONAL ANCHOR FOR STANDARD FRAME INSTALLATION**

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No **12-0824.06**  
Expiration Date **02/24/2015**  
By *[Signature]*  
Miami Dade Product Control

DATE:	07.13.12
DWN BY:	JLA
CHK BY:	HFN
SCALE:	NTS


DWG #: **CGS007**  
SHEET: **3 OF 9**

**ELEVATIONS**

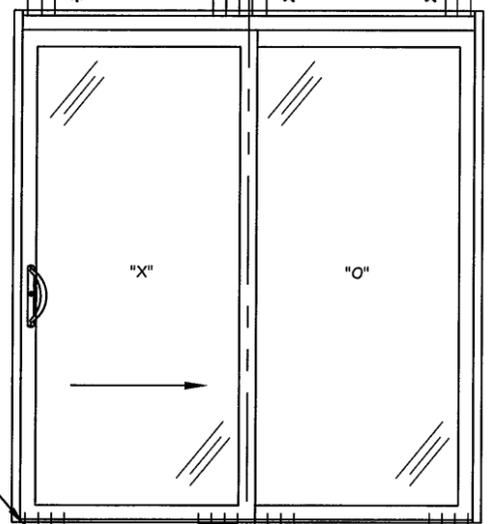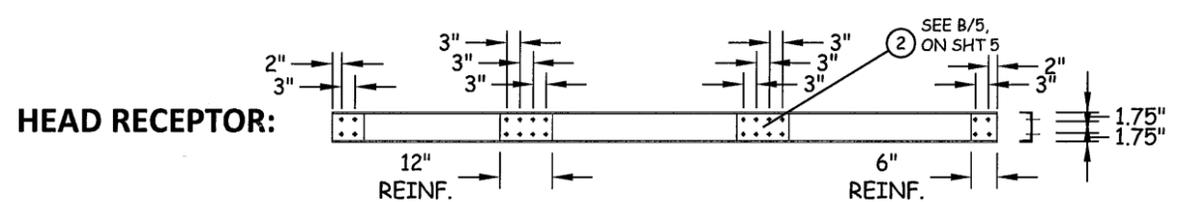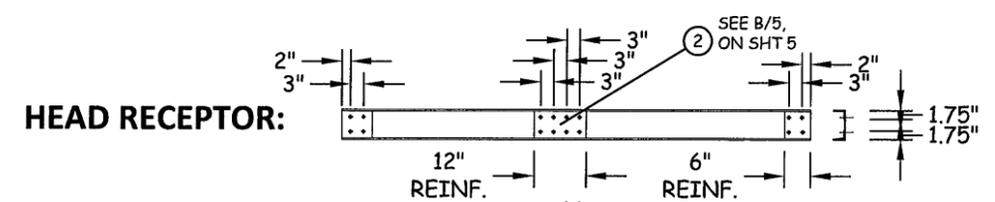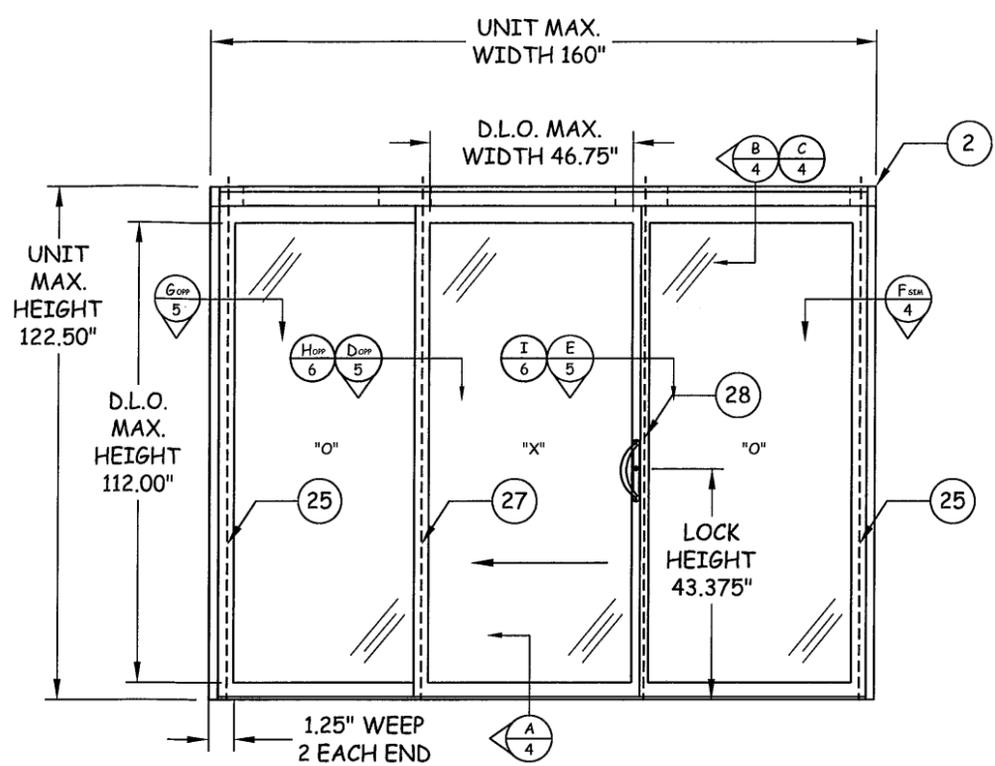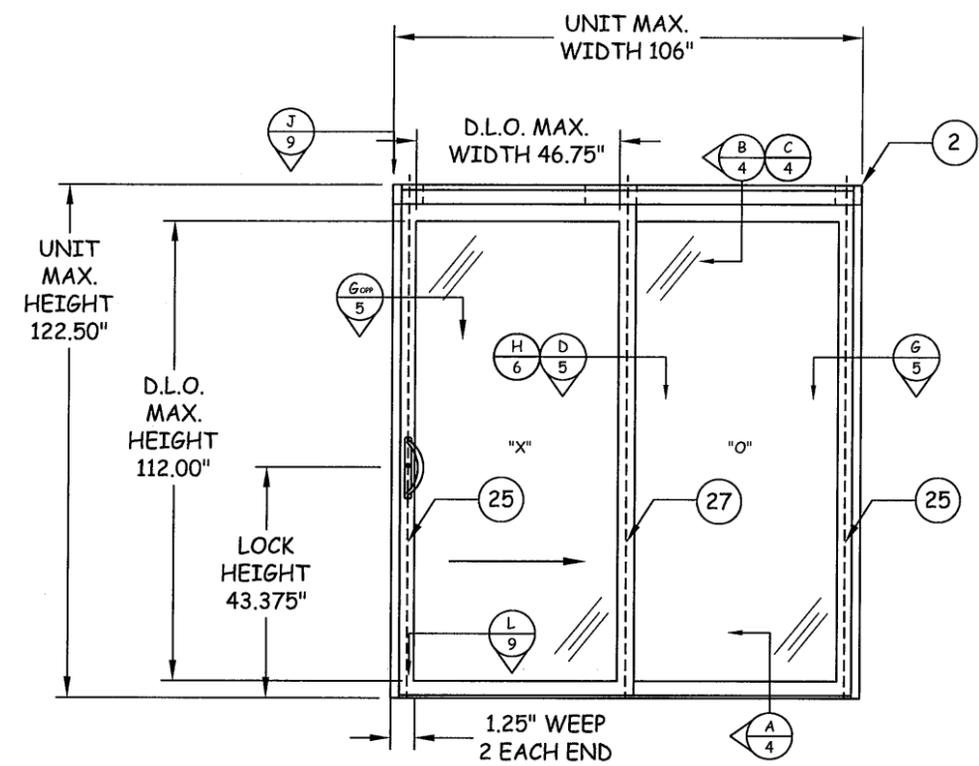

**NOTE: TWO (2) INSTALLATION ANCHORS ON HEAD AND ONE (1) INSTALLATION ANCHOR ON SILL FOR EACH ANCHOR LOCATION SHOWN.**


**ANCHOR LAYOUTS**

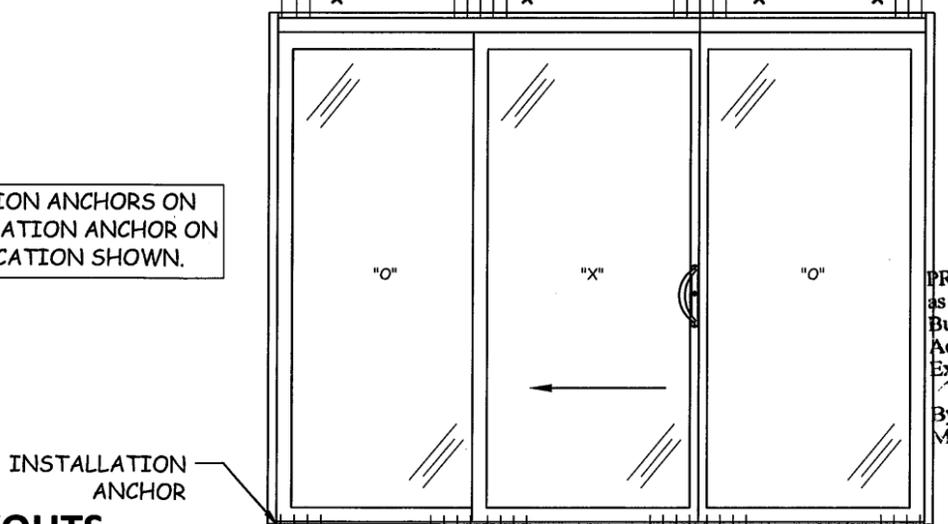

8/20/2012 1:18 PM  
s:\projects\continental glass systems\md-12-0210 2010 fbc code change (previously done nous)\dwgs\cgs007 fbc 2010.dwg


8/20/2012 1:18 PM

s:\projects\continental glass systems\mid-12-0210\_2010\_fbc code change (previous done notes)\dwg\cgs007\_fbc\_2010.dwg

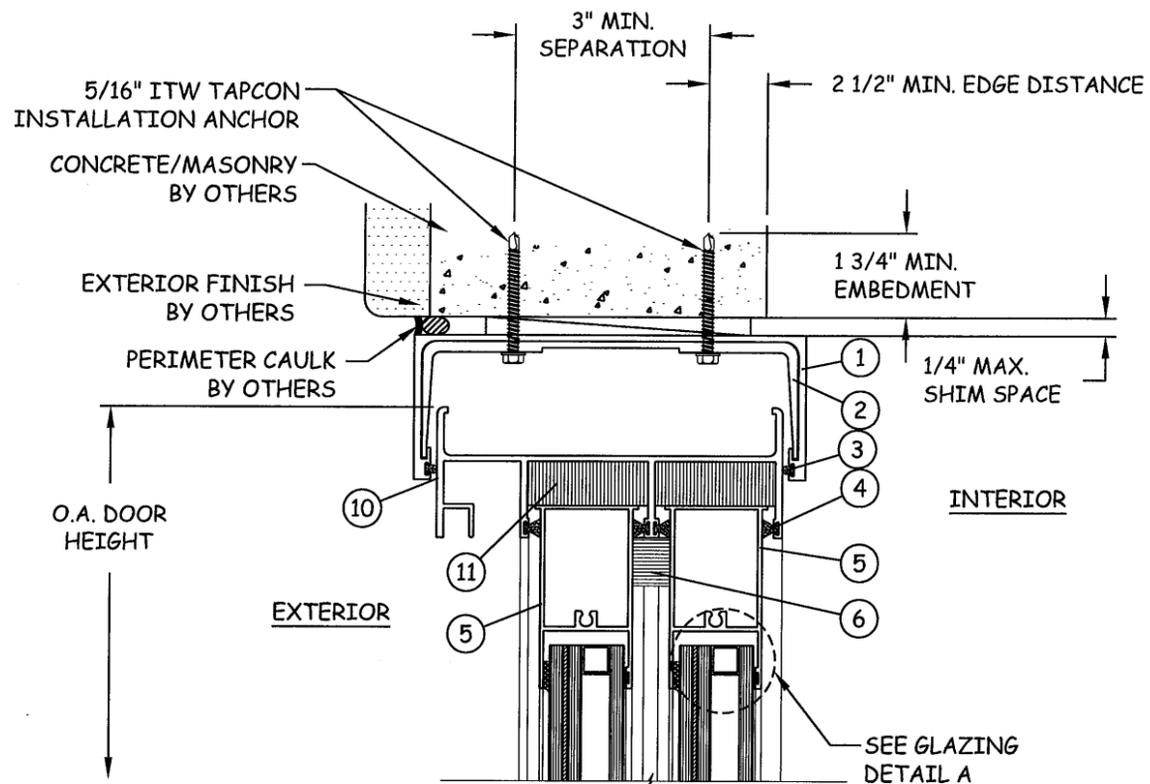


**B**  
**4** VERTICAL SECTION  
REINFORCED HEAD RECEPTOR  
CONCRETE/MASONRY

NOTE: ITEM 11 IS CONTINUOUS THROUGH  
ENTIRE LENGTH OF FRAME HEAD.

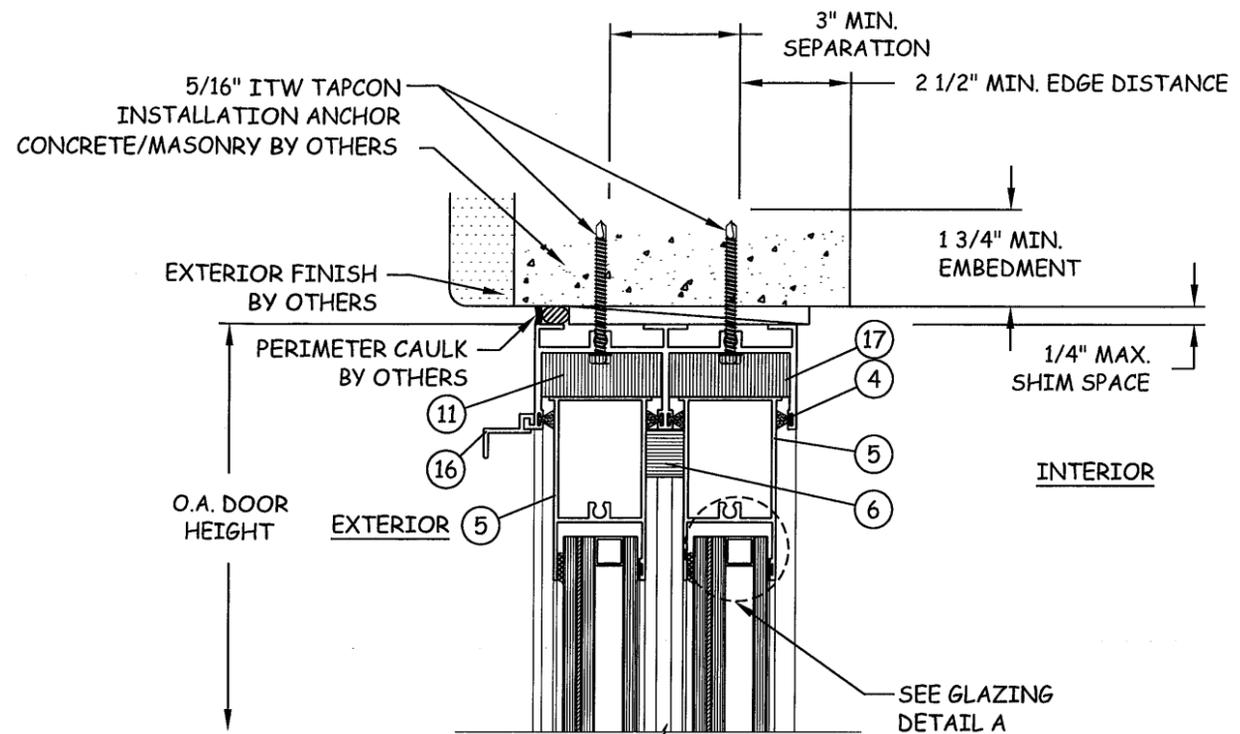

**C**  
**4** VERTICAL SECTION  
STANDARD HEAD - CONCRETE/MASONRY

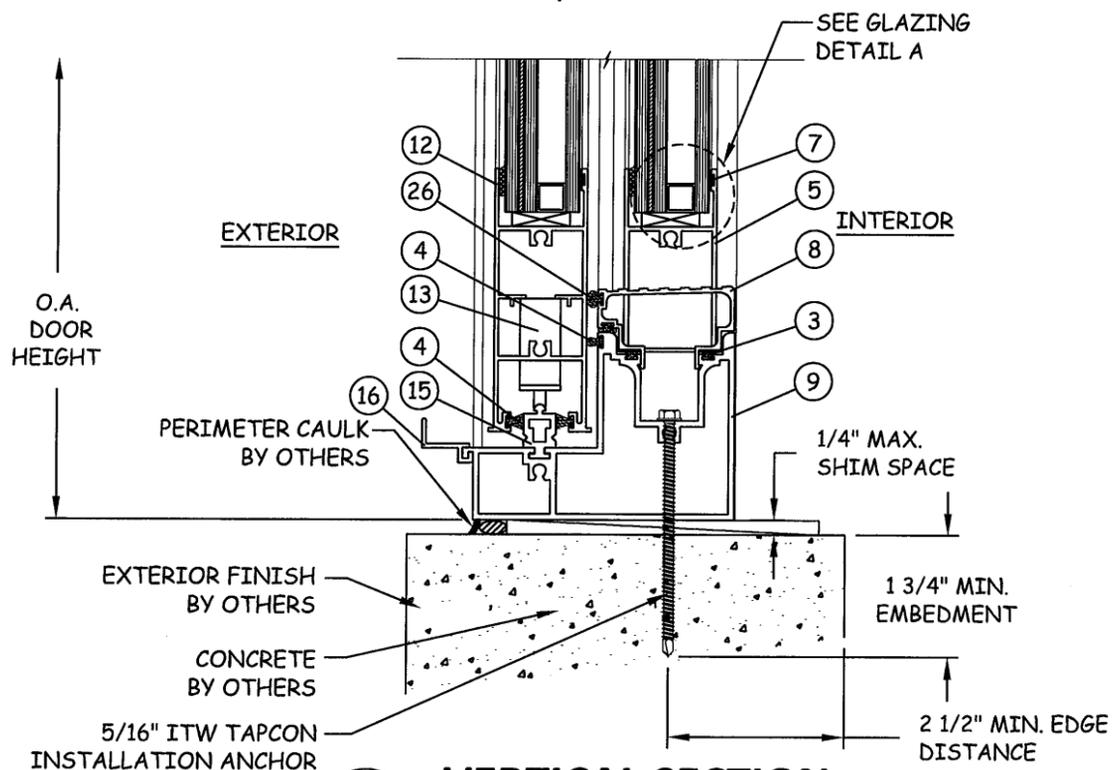

**A**  
**4** VERTICAL SECTION  
SILL - CONCRETE/MASONRY  
PRE-CAST SILL

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No **12-0824.06**  
Expiration Date **02/24/2015**  
By *[Signature]*  
Miami Dade Product Control



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103


TITLE: SERIES 2200 ALUM.  
SLIDING GLASS DOOR  
VERTICAL SECTIONS  
PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738

REVISIONS	
NO.	DESCRIPTION
A	FBC 2010 CODE CHANGE

*[Signature]*  
05-21-2012  
HERMES F. NOBREDO, P.E.  
FLORIDA P. E. NO. 73778  
398 EAST DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
FEPE CERT. OF AUTHORIZATION NO. 29578

DATE:	07.13.12	DWN BY:	JLA	CHK BY:	HFN	SCALE:	NTS
DWG #:	<b>CGS007</b>						
SHEET:	4 OF 9						


GE2000 SEALANT  
JOINT WIDTH  
(MINIMUM 7/16"  
TO MAXIMUM 1-1/4")

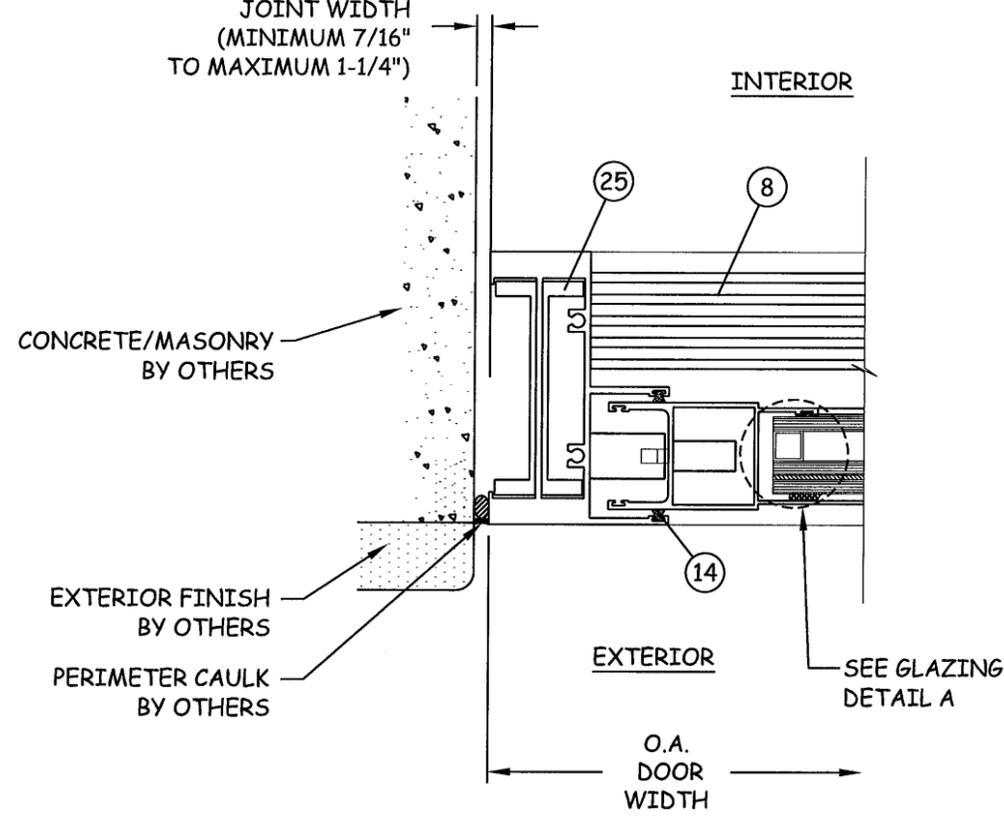

**F**  
**5** **HORIZONTAL SECTION**  
REINFORCED JAMB - CONCRETE/MASONRY


- NOTES:
1. BACKER ROD DIAMETER EQUALS SEAL WIDTH X 120%
  2. SEALANT DEPTH IS 5/8" (-0", +1/16") FOR SEALANT WIDTH UP TO 1-1/4"

GE2000 SEALANT  
JOINT WIDTH  
(MINIMUM 7/16"  
TO MAXIMUM 1-1/4")

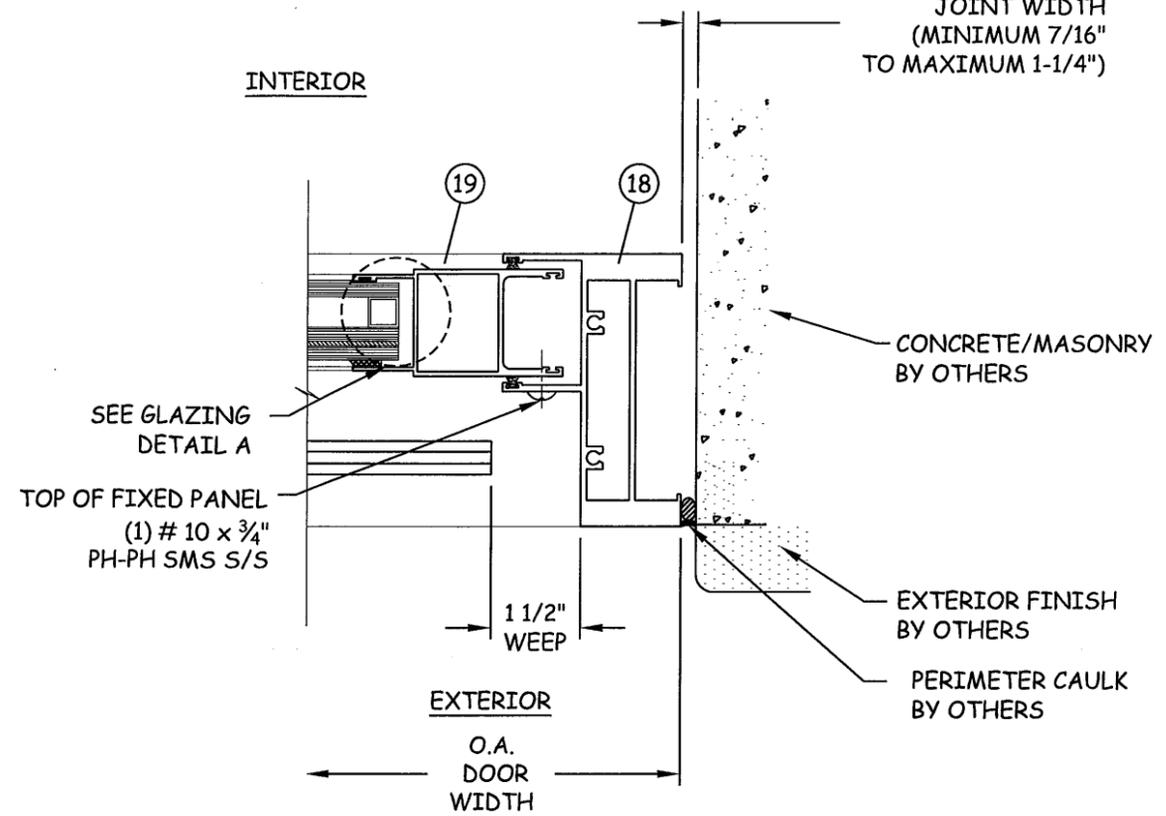


**G**  
**5** **HORIZONTAL SECTION**  
JAMB - CONCRETE/MASONRY

INTERIOR

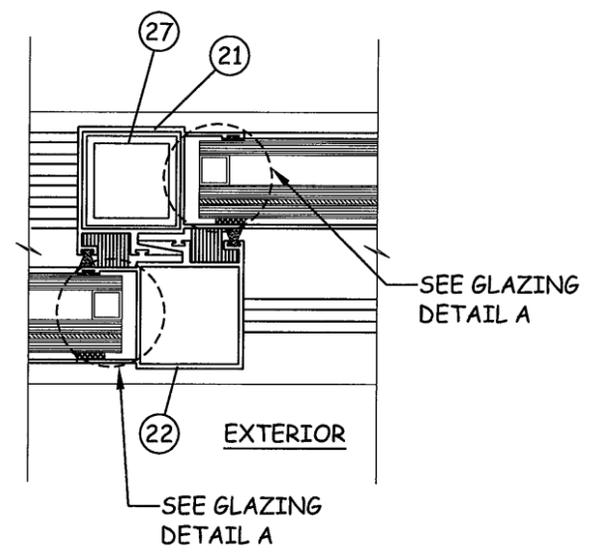

**D**  
**5** **HORIZONTAL SECTION**  
INTERLOCK

INTERIOR

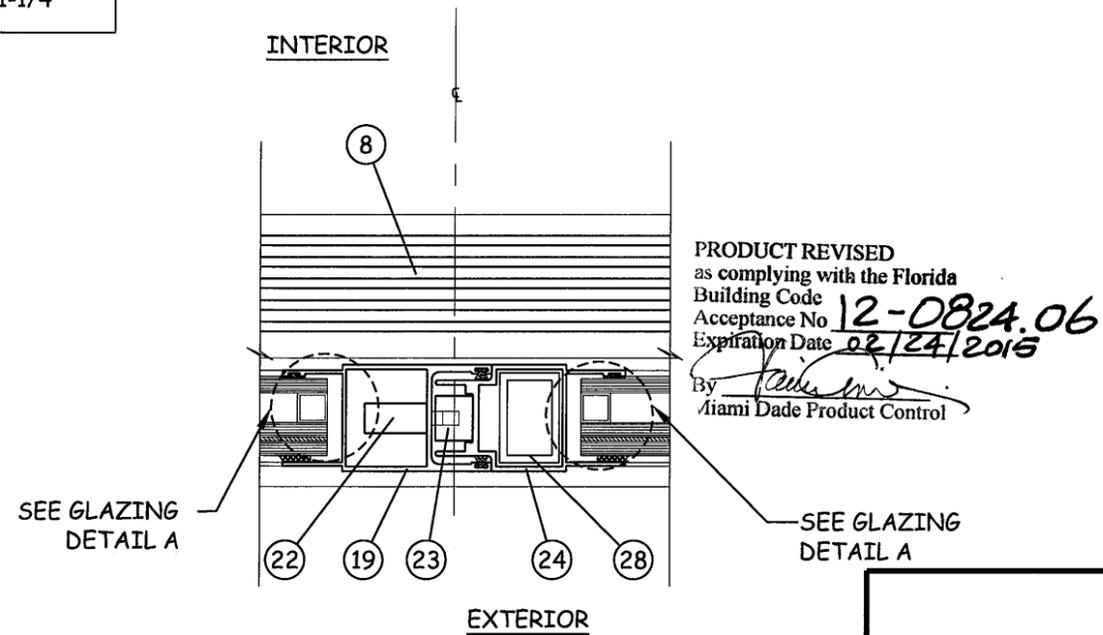

**E**  
**5** **HORIZONTAL SECTION**  
BUTTSTILE



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2200 ALUM. SLIDING GLASS DOOR HORIZONTAL SECTIONS  
PREPARED BY: BUILDING DROPS, INC. 398 E. DANIA BEACH BLVD. #338 DANIA BEACH, FL 33004 PH: 954.399.8478 FX: 954.744.4738

REVISIONS		NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12		

8-21-2012  
HERMES F. MORENO, P.E.  
FLORIDA P. E. NO. 75378  
398 EAST DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
FBPF CERT. OF AUTHORIZATION NO. 29578

DATE: 07.13.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS  
DWG #: CGS007  
SHEET: 5 OF 9

8/20/2012 1:18 PM


s:\projects\continental\_glass\_systems\md-12-0210 2010 fbc code change (previously done nos)\dwgs\cgs007 fbc 2010.dwg

8/20/2012 1:18 PM


s:\projects\continental\_glass\_systems\md-0210\_2010\_fbc\_code\_change\_(previously\_done\_noss)\dwg\CGS007\_fbc\_2010.dwg




325 W. 74TH PLACE  
HTALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

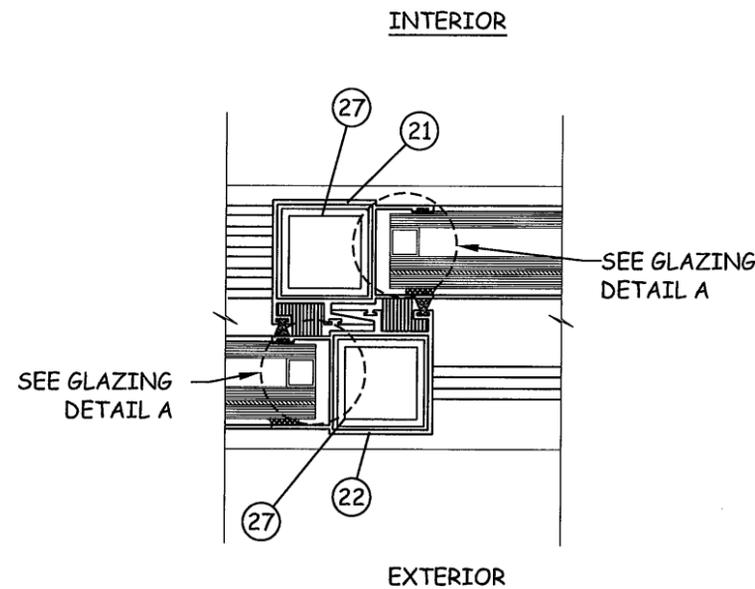

**H**  
**6** **HORIZONTAL SECTION**  
REINFORCED INTERLOCK

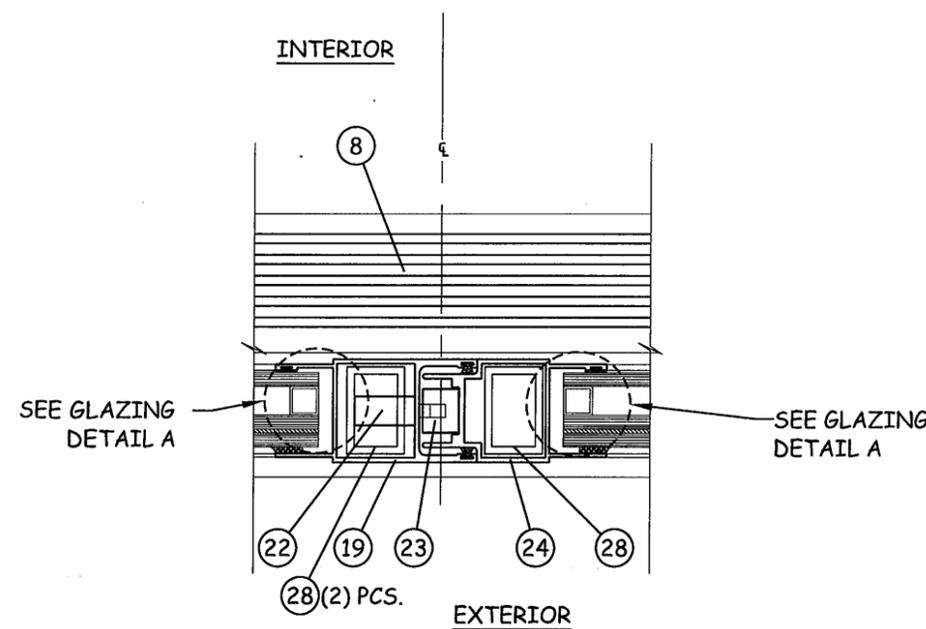

**I**  
**6** **HORIZONTAL SECTION**  
REINFORCED BUTTSTILE

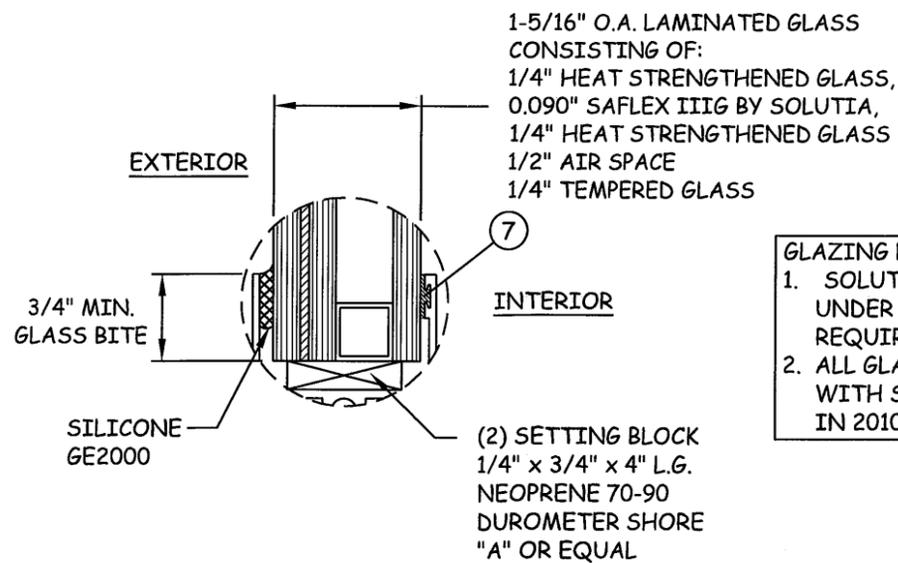

**GLAZING DETAIL A**

**GLAZING NOTES:**

- SOLUTIA SAFLEX IIIG INTERLAYER APPROVED UNDER SEPARATE NOA & MEETS FBC 2010 REQUIREMENTS.
- ALL GLAZING CONFIGURATIONS SHALL COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN 2010 FBC SECTION 2406.

PRODUCT REVISED  
as complying with the Florida  
Building Code **12-0824.06**  
Acceptance No  
Expiration Date **02/24/2015**  
By *[Signature]*  
Miami Dade Product Control

TITLE: SERIES 2200 ALUM.  
SLIDING GLASS DOOR  
HORIZONTAL SECTIONS  
& GLAZING DETAIL

PREPARED BY:  
**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD. #3338  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738

**REVISIONS**





NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12

*[Signature]*  
8-21-2012  
HERNAN F. NOFERO, P.E.  
FLORIDA P. E. NO. 73778  
398 EAST DANIA BEACH BLVD. #3338  
DANIA BEACH, FL 33004  
FBC CERT. OF AUTHORIZATION NO. 29578

DATE: 07.13.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS  
DWG #: **CGS007**  
SHEET: **6 OF 9**

## BILL OF MATERIALS

ITEM NO.	DESCRIPTION	PARTS NUMBERS	MATERIAL	MANUFACTURER
1	HEAD RECEPTOR	2000-07	ALUMINUM 6005-T5	CGS
2	REINFORCING	2000-16	ALUMINUM 6005-T5	CGS
3	VINYL BULB	FP-448-V	PLASTIC	
4	FIN-SEAL .370 X .187		ULTRAFAB	ULTRAFAB
5	TOP & BOTTOM PANEL STILE	2200-09	ALUMINUM 6005-T5	CGS
6	INTERLOCK PAD	P 7509 AFK	ULTRAFAB	ULTRAFAB
7	GLASS SPACING		PLASTIC	
8	THRESHOLD	2000-24	ALUMINUM 6063-T6	CGS
9	SILL	2000-03	ALUMINUM 6005-T5	CGS
10	HEAD	2000-01	ALUMINUM 6005-T5	CGS
11	HEAD PAD	P 10009 AFK	ULTRAFAB	ULTRAFAB
12	BOTTOM MOVING PANEL STILE	2200-38	ALUMINUM 6005-T5	CGS
13	WHEEL	AR-50A		
14	FIN-SEAL .250 X .187		ULTRAFAB	ULTRAFAB
15	SILL TRACK	2000-05	ALUMINUM 6005-T5	CGS
16	SCREEN TRACK	2000-15	ALUMINUM 6005-T5	CGS
17	STANDARD HEAD	2000-02	ALUMINUM 6005-T5	CGS
18	JAMB	2000-36	ALUMINUM 6063-T6	CGS
19	LOCK STILE	2200-10	ALUMINUM 6005-T5	CGS
20	INTERLOCK	2200-11	ALUMINUM 6005-T5	CGS
21	LEFT INTERLOCK	2200-17	ALUMINUM 6005-T5	CGS
22	LOCK	D-60 C		
23	KEEPER	KP-50		
24	ASTRAGAL	2200-18	ALUMINUM 6005-T5	CGS
25	ALUMINUM CHANNEL REINFORCEMENT	2200-37	ALUMINUM 6005-T5	CGS
26	Q-LON	U4332		
27	1/8" X 1 1/2" X 1 1/2" ALUMINUM TUBE	2200-38	ALUMINUM 6005-T5	CGS
28	1/8" X 1" X 1 1/2" ALUMINUM TUBE	2200-39	ALUMINUM 6005-T5	CGS

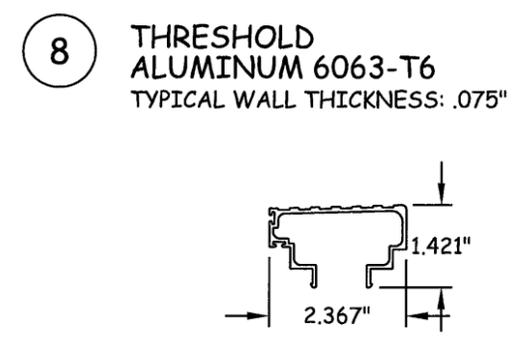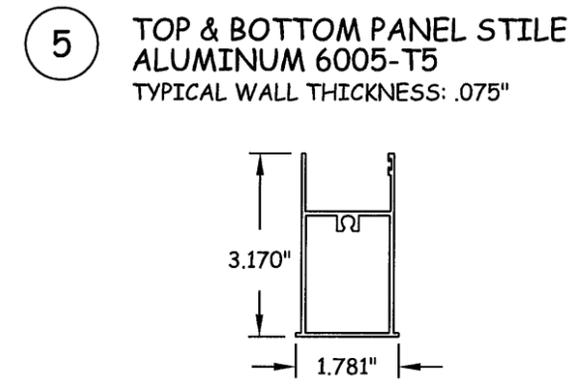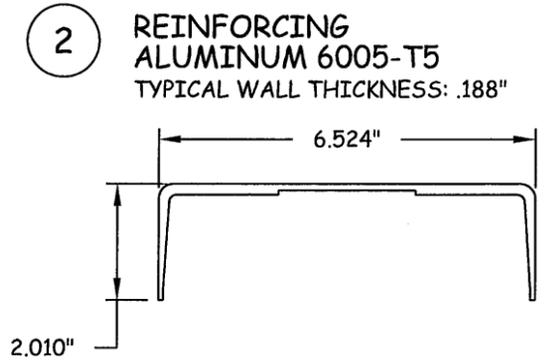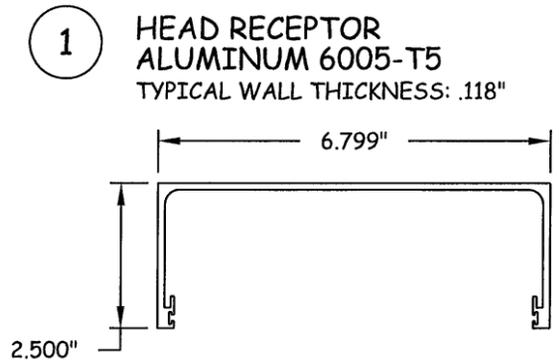

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No **12-0824.06**  
Expiration Date **02/24/2015**  
By *[Signature]*  
Miami Dade Product Control



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2200 ALUM.  
SLIDING GLASS DOOR  
COMPONENTS  
& BILL OF MATERIALS

PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738

REVISIONS		NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12		

*[Signature]*  
8-21-2012  
HERMES F. NOBRO, P.E.  
FLORIDA P. E. NO. 73778  
398 EAST DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
FBPE CERT. OF AUTHORIZATION NO. 29578


DATE:	07.13.12	DWN BY:	JLA	CHK BY:	HFN	SCALE:	NTS
DWG #:	<b>CGS007</b>						
SHEET:	<b>7 OF 9</b>						

P:\projects\continental glass systems\md-12-0210 2010 fbc code change (previously done nos)\dwgs\cgs007 fbc 2010.dwg  
 8/20/2012 1:18 PM


8/20/2012 1:18 PM

s:\projects\continental\_glass\_systems\md-12-0210\_2010\_fbc\_code\_change\_(previously\_done\_noss)\dwgs\cgs007\_fbc\_2010.dwg


9 SILL  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .100"

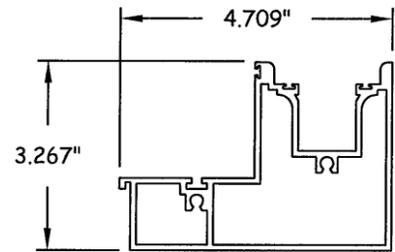


10 HEAD  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .100"

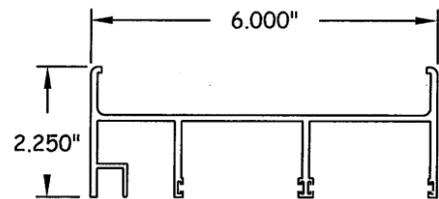


12 BOTTOM MOVING PANEL STILE  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .075"

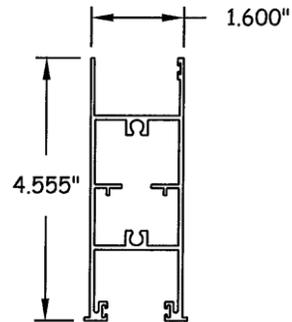


15 SILLTRACK  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .075"

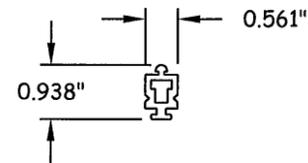


16 SCREEN TRACK  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .075"

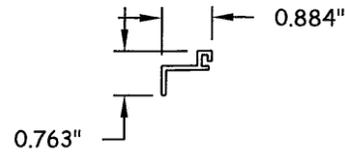


17 STANDARD HEAD  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .100"

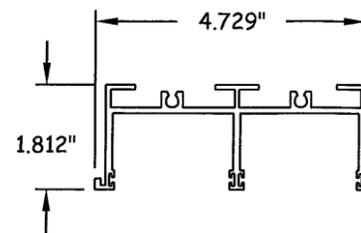


18 JAMB  
ALUMINUM 6063-T6  
TYPICAL WALL THICKNESS: .075"

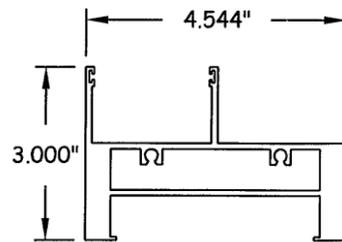


19 LOCK STILE  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .078"




20 INTERLOCK  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .078"




21 LEFT INTERLOCK  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .078"



24 ASTRAGAL  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .078"



25 ALUMINUM CHANNEL REINFORCMENT  
ALUMINUM 6005-T5  
TYPICAL WALL THICKNESS: .019"



PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 12-0824.06  
Expiration Date 02/24/2015  
By [Signature]  
Miami Dade Product Control



325 W. 74TH PLACE  
HTALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2200 ALUM.  
SLIDING GLASS DOOR  
COMPONENTS  
PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #3338  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738

REVISIONS

NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12


[Signature]  
6-21-2012  
HERMES F. NORERO, P.E.  
FLORIDA P. E. NO. 73778  
398 EAST DANIA BEACH BLVD. #3338  
DANIA BEACH, FL 33004  
PEPE CERT OF AUTHORIZATION NO. 29578

DATE: 07.13.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS

DWG #: CGS007

SHEET: 8 OF 9


s:\projects\continental\_glass\_systems\mid-12-0210\_2010\_fbc\_code\_change\_(previously\_done\_nose)\dwg\cgs007\_fbc\_2010.dwg 8/20/2012 1:18 PM

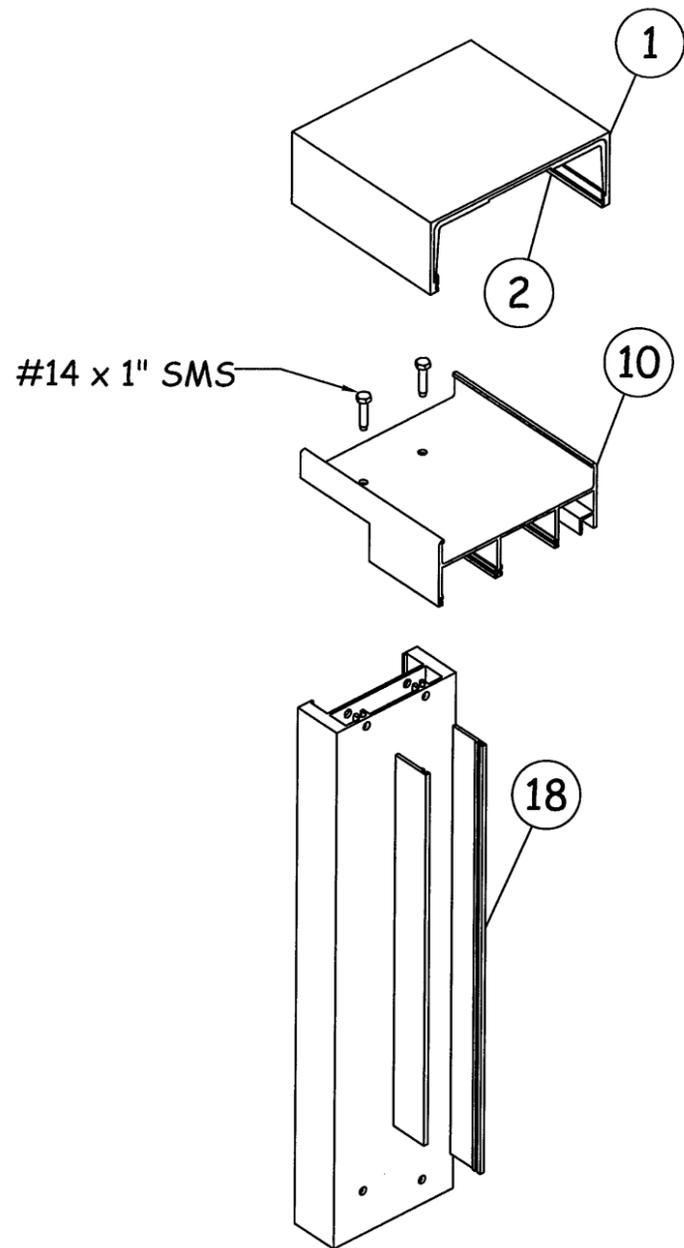

**J**  
**9**

**HEAD RECEPTOR**


HEAD ASSEMBLY  
FRAME CONSTRUCTION

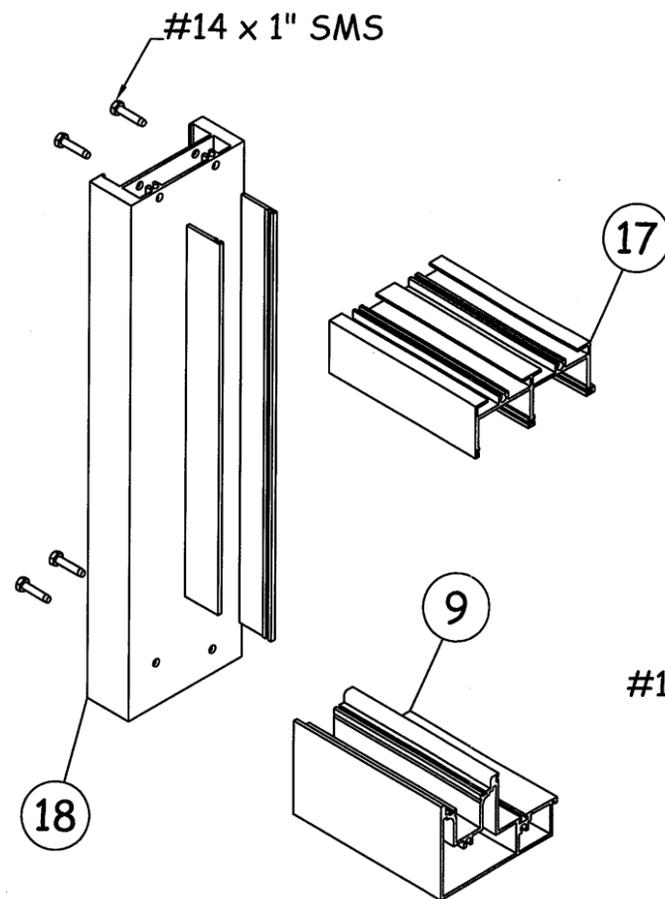

**K**  
**9**

**STANDARD FRAME**

HEAD & SILL ASSEMBLY  
FRAME CONSTRUCTION

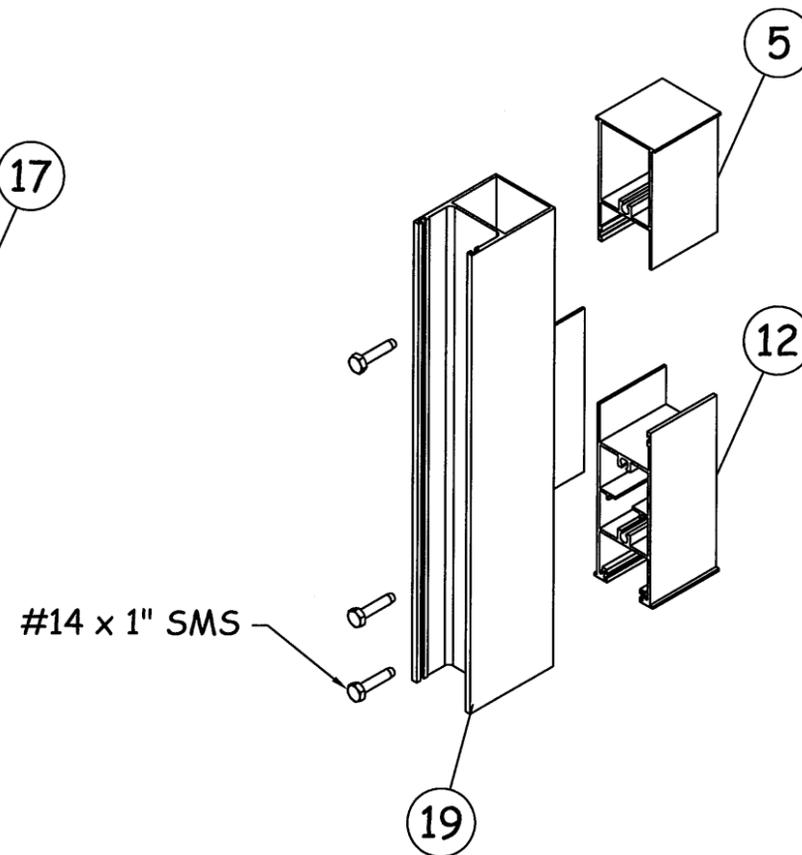

**L**  
**9**

**DOOR PANEL**

TOP & BOTTOM CORNERS  
PANEL CONSTRUCTION

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. **12-0824.06**  
Expiration Date **02/24/2015**  
By *[Signature]*  
Miami Dade Product Control



325 W. 74TH PLACE  
HIALEAH, FL 33014  
PH: (305) 231-1101 FX: (305) 231-1103

TITLE: SERIES 2200 ALUM.  
SLIDING GLASS DOOR  
CORNER ASSEMBLIES  
PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: 954.399.8478 FX: 954.744.4738

**REVISIONS**

NO.	DESCRIPTION	BY	DATE
A	FBC 2010 CODE CHANGE	JLA	07.25.12

*[Signature]*  
8-21-2012  
HERNAN F. NORRERO, P.E.  
FLORIDA P. E. NO. 73770  
398 EAST DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
FBPE CERT. OF AUTHORIZATION NO. 29578

DATE: 07.13.12  
DWN BY: JLA  
CHK BY: HFN  
SCALE: NTS

DWG #: **CGS007**

SHEET: **9 OF 9**