



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
 BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
 PRODUCT CONTROL SECTION
 11805 SW 26 Street, Room 208
 Miami, Florida 33175-2474
 T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/economy

Exeter Architectural Products
 242 West 8th Street
 Wyoming, PA 18644

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER- Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Storm Shield Hurricane Barriers

APPROVAL DOCUMENT: Drawing No. SSHB-EHB, prepared by Exeter Architectural Products, titled "Storm Shield Hurricane Barriers", sheets 1 through 12 of 12, with latest revision #1, dated May 05, 2011, signed and sealed by Thomas H. Maxwell Jr., P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each panel shall bear a permanent label with the manufacturer's name or logo, city, state, the following statement: "Miami-Dade County Product Control Approved", NOA number, and TAS-201, TAS-202, and TAS-203, unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA #11-0127.02 and consists of this page 1, evidence submitted pages E-1 and E-2 as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P.E.**



J. Gascon
 12/11/12

NOA No. 12-1019.20
 Expiration Date: 06/23/2016
 Approval Date: 12/20/2012
 Page 1

Exeter Architectural Products

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 11-0127.02

A. DRAWINGS:

1. *Drawing No. SSHB-EHB sheets 1 through 12 of 12, last revision #1 dated May 05, 2011, titled "Storm Shield Hurricane Barriers", prepared by Exeter Architectural Products, Inc., signed and sealed by T. H. Maxwell Jr., P.E.*

B. TESTS:

1. *Test report on TAS201-Large Missile Impact Test, TAS203-Cyclic Wind Pressure Test and TAS202-Uniform Static Air Pressure Test, prepared by Architectural Testing, Report No. A1022.01-109-18, dated 08/20/10, signed and sealed by Michael D. Stremmel, P.E.*
2. *Test report on TAS201-Large Missile Impact Test, TAS203-Cyclic Wind Pressure Test and TAS202-Uniform Static Air Pressure Test, prepared by Architectural Testing, Report No. A0200.01-109-18, dated 08/20/10, signed and sealed by Michael D. Stremmel, P.E.*
3. *Test report on TAS201-Large Missile Impact Test, TAS203-Cyclic Wind Pressure Test and TAS202-Uniform Static Air Pressure Test, prepared by Architectural Testing, Report No. A3082.01-109-18, dated 12/22/10, signed and sealed by Michael D. Stremmel, P.E.*
4. *Test report on TAS201-Large Missile Impact Test, TAS203-Cyclic Wind Pressure Test and TAS202-Uniform Static Air Pressure Test, prepared by Architectural Testing, Report No. A3081.01-109-18, dated 12/21/10, signed and sealed by Michael D. Stremmel, P.E.*

C. CALCULATIONS:

1. *Anchor analysis of 4x6 side hinged hurricane barrier, sheets 1 through 3 dated 01/15/11, signed and sealed by T. H. Maxwell, Jr., P.E.*
2. *Anchor analysis of 5 x 7 side hinge hurricane barrier, sheets 1 through 3 dated 01/15/11, signed and sealed by T. H. Maxwell Jr. P.E.*
3. *Anchor analysis of 4x6 enhanced single and triple hurricane barriers, sheets 1 and 2 for each, dated 01/15/11, signed and sealed by T. H. Maxwell Jr. P.E.*

D. QUALITY ASSURANCE:

1. *By Miami-Dade County Building and Neighborhood Compliance Department (BNC).*

E. MATERIAL CERTIFICATION:

1. *Certified Tensile Test Report No. A1022.01-109-18, prepared by Architectural Testing, dated 08/20/10, signed and sealed by Michael D. Stremmel, P.E.*
2. *Certified Tensile Test Report No. A0200.01-109-18, prepared by Architectural Testing, dated 08/20/10, signed and sealed by Michael D. Stremmel, P.E.*
3. *Certified Tensile Test Report No. A3082.01-109-18, prepared by Architectural Testing, dated 12/22/10, signed and sealed by Michael D. Stremmel, P.E.*
4. *Certified Tensile Test Report No. A3081.01-109-18, prepared by Architectural Testing, dated 12/21/10, signed and sealed by Michael D. Stremmel, P.E.*



Jaime D. Gascon, P.E.
Product Control Section Supervisor
NOA No. 12-1019.20
Expiration Date: 06/23/2016
Approval Date: 12/20/2012

Exeter Architectural Products

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS:

1. *None.*

B. TESTS:

1. *None.*

C. CALCULATIONS:

1. *None.*

D. QUALITY ASSURANCE:


1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS:

1. *None.*

F. OTHERS:

1. *Letter of compliance with the Florida Building Code, 2010 Edition and ASCE 7-10, issued by Thomas H. Maxwell, Jr., P.E. Consulting Engineer, dated September 30, 2012, signed and sealed by Thomas H. Maxwell, Jr., P.E.*



Jaime D. Gascon, P.E.
Product Control Section Supervisor
NOA No. 12-1019.20
Expiration Date: 06/23/2016
Approval Date: 12/20/2012

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED AS A HURRICANE SHUTTER
2. THESE PRODUCTS SATISFY THE FOLLOWING TESTING CRITERIA FOR LARGE MISSILE IMPACTS AND WIND LOADS IN ACCORDANCE WITH THE FOLLOWING STANDARDS:
FLORIDA BUILDING CODE HIGH VELOCITY HURRICANE ZONE, 2007 EDITION (TAS 201-94, TAS 202-94, TAS 203-94)
3. EACH BARRIER SHALL HAVE A PERMANENT LABEL PLACED IN A VISIBLE LOCATION WITH THE FOLLOWING INFORMATION:

EXETER ARCHITECTURAL PRODUCTS
STORM SHIELD WYOMING, PA
MIAMI-DADE COUNTY
PRODUCT CONTROL APPROVED
TAS-201, TAS-202, TAS-203
NOA# 11-0127.02

EXETER ARCHITECTURAL PRODUCTS
STORM SHIELD NANTICOKE, PA
MIAMI-DADE COUNTY
PRODUCT CONTROL APPROVED
TAS-201, TAS-202, TAS-203
NOA# 11-0127.02

LABEL SIZE: 2" X 3/4"

ALTERNATE MANUFACTURING LOCATION
4. DESIGN PRESSURE CALCULATIONS SHALL BE PERFORMED BY A REGISTERED ARCHITECT OR PROFESSIONAL ENGINEER IN ACCORDANCE WITH ASCE 7-05. THE ALLOWABLE DESIGN PRESSURES FOR EACH PRODUCT TYPE (APPROVED UNDER THIS N.O.A.) ARE LISTED WITH ITS CORRESPONDING DRAWING.
5. ALL ALUMINUM PARTS ARE MADE FROM 6063 T5 SERIES ALUMINUM. THE PERFORATED PANELS SHALL BE .079" (NOMINAL THICKNESS) STAINLESS STEEL, WITH AN OPTION FOR .075" (NOMINAL THICKNESS) GALVANNEALED STEEL (GALVANNEALED OPTION NOT AVAILABLE FOR ALL UNITS) ALL PARTS SHALL BE SUPPLIED WITH A PROTECTIVE FINISH.
6. A FASTENER SCHEDULE FOR EACH PRODUCT CAN BE FOUND ON THE INDIVIDUAL DRAWINGS.
7. BARRIER CONSTRUCTION SHALL BE IN ACCORDANCE WITH DESIGNS AND METHODS SET FORTH BY THE MANUFACTURER CONTAINED HEREIN.
8. TO ENSURE PROPER OPERATION, INSTALLATION SHALL BE PERFORMED USING METHODS AND INSTRUCTIONS SET FORTH BY THE MANUFACTURER CONTAINED WITHIN THESE DRAWINGS.
9. UNITS MUST BE ATTACHED TO CONCRETE OR STRUCTURAL COMPONENTS OF THE BUILDING. OUTER WALL COVERINGS OR DECORATIVE ATTACHMENTS THAT ARE NOT PART OF THE BUILDING STRUCTURE ARE NOT SUITABLE FOR MOUNTING.

DRAWING INDEX

PAGE 1 OF 12 - GENERAL NOTES/INDEX

4 X 6 SIDE-HINGED TEST REPORT# A1022.01-109-18 DATED 08/20/2010

PAGE 2 OF 12 - 4' X 6' SIDE-HINGED 1 X 2, FACE MOUNT UNIT.
PAGE 3 OF 12 - 4' X 6' SIDE-HINGED 1 X 2, INSET MOUNT UNIT.

5 X 7 SIDE-HINGED TEST REPORT# A0200.01-109-18 DATED 08/20/2010

PAGE 4 OF 12 - 5' X 7' SIDE-HINGED, FACE MOUNT UNIT.
PAGE 5 OF 12 - 5' X 7' SIDE-HINGED, INSET MOUNT UNIT.

4 X 6 READY MOUNT (ENHANCED) TEST REPORT# A3081.01-109-18 DATED 12/21/2010
TEST REPORT# A3082.01-109-18 DATED 12/22/2010

PAGE 6 OF 12 - 4' X 6' ENHANCED SINGLE, READY MOUNT, FACE MOUNT UNIT.
PAGE 7 OF 12 - 4' X 6' ENHANCED SINGLE, READY MOUNT, INSET MOUNT UNIT.
PAGE 8 OF 12 - 4' X 6' ENHANCED TRIPLE, READY MOUNT, FACE MOUNT UNIT.
PAGE 9 OF 12 - 4' X 6' ENHANCED TRIPLE, READY MOUNT, INSET MOUNT UNIT.
PAGE 10 OF 12 - SUBFRAME/1 X 2 FRAME ASSEMBLY DETAILS

MATERIALS

PAGE 11 OF 12 - COMPONENT/EXTRUSION DETAILS.
PAGE 12 OF 12 - COMPONENT/EXTRUSION DETAILS. (CONT'D)

PRODUCT REVISED
as complying with the Florida
Building Code
Building Code
Acceptance No. 12-1019-20
Expiration Date 6/25/2016
By *[Signature]*
Miami Dade Product Control

Approved as complying with the
Florida Building Code
Date 06/23/2011
NOA# 11-0127.02
Miami Dade Product Control






By *[Signature]*

[Signature]
5-17-11

CONSULTING ENGINEER
THOMAS H. MAXWELL JR., P.E.
121 N.W. 39 AVE.
MIAMI, FLORIDA 33126
(305) 541-7549

Board of Professional Engineers
Exam: Mechanical-Structural: 1965
State of Florida P.E. Registration
No. 10150
U.S. Army Corps of Engineers:
Civil-Structural Engineer
Florida Power & Light Company:
Electrical Engineer

TITLE/CUSTOMER		STORM SHIELD HURRICANE BARRIERS DRAWING INDEX/NOTES	
SCALE:	NTS		DRAWN BY: RBM
DATE:	5/5/11		REVISED 1
242 W. 8TH ST. WYOMING PA 18644		WWW.STORMSHIELD.NET 	800-972-2478 FAX (570) 693-2575
PRODUCT CONTROL CODE:		DRAWING NO. SSHB-EHB	
PAGE 1 OF 12			

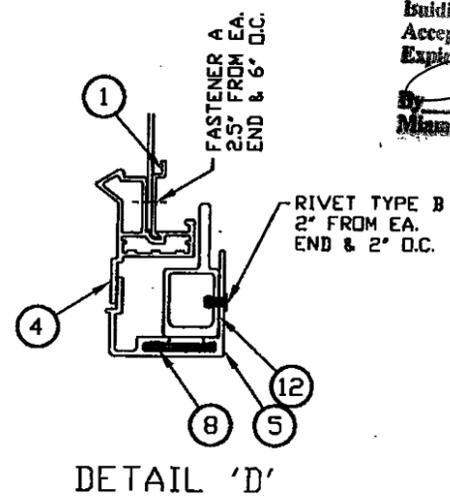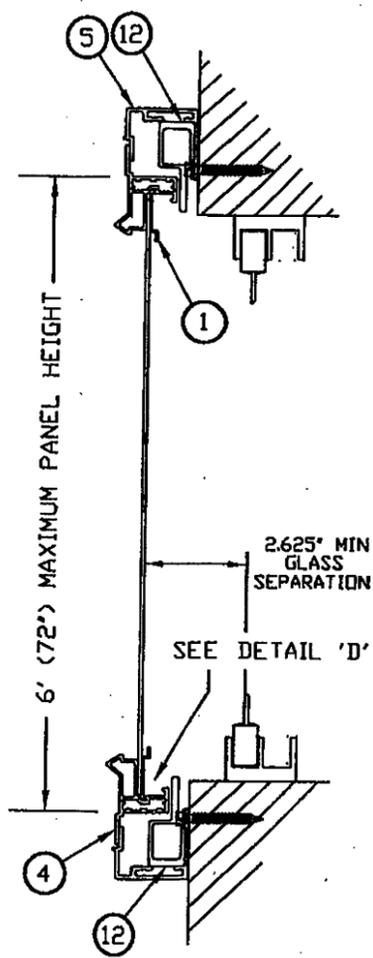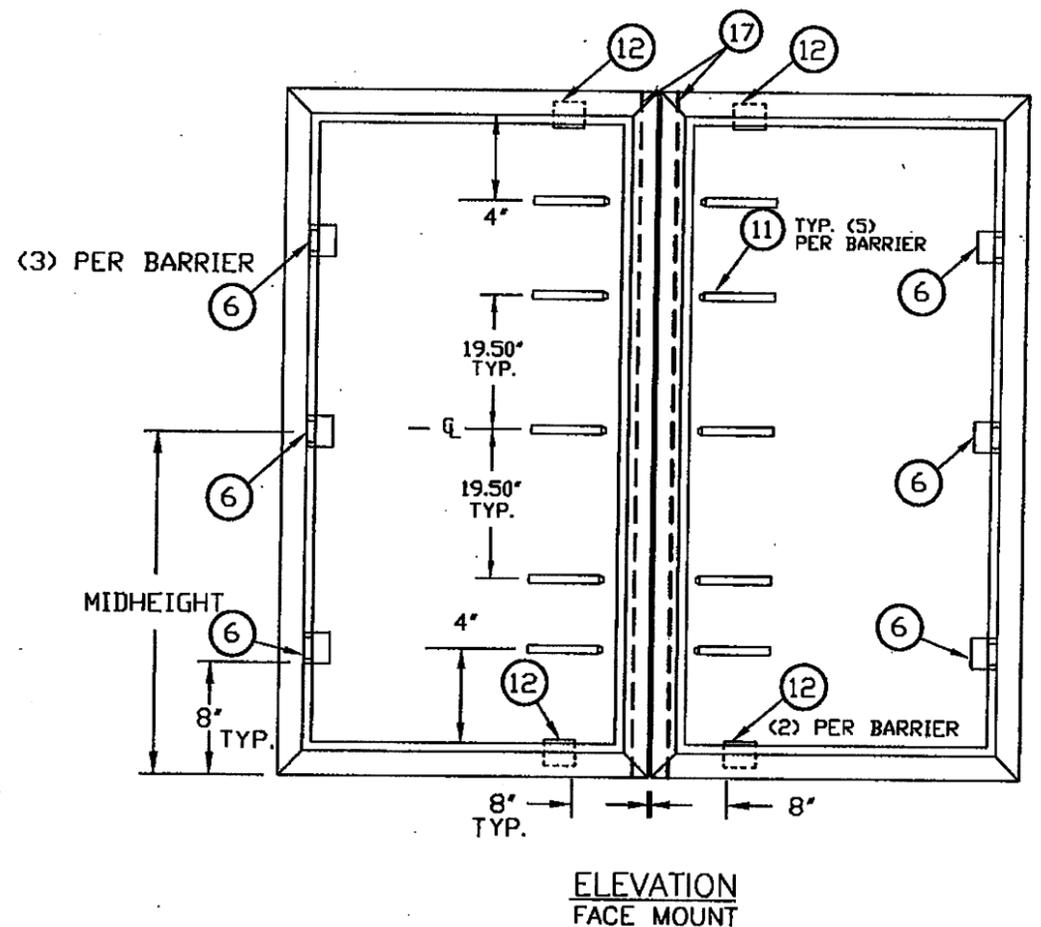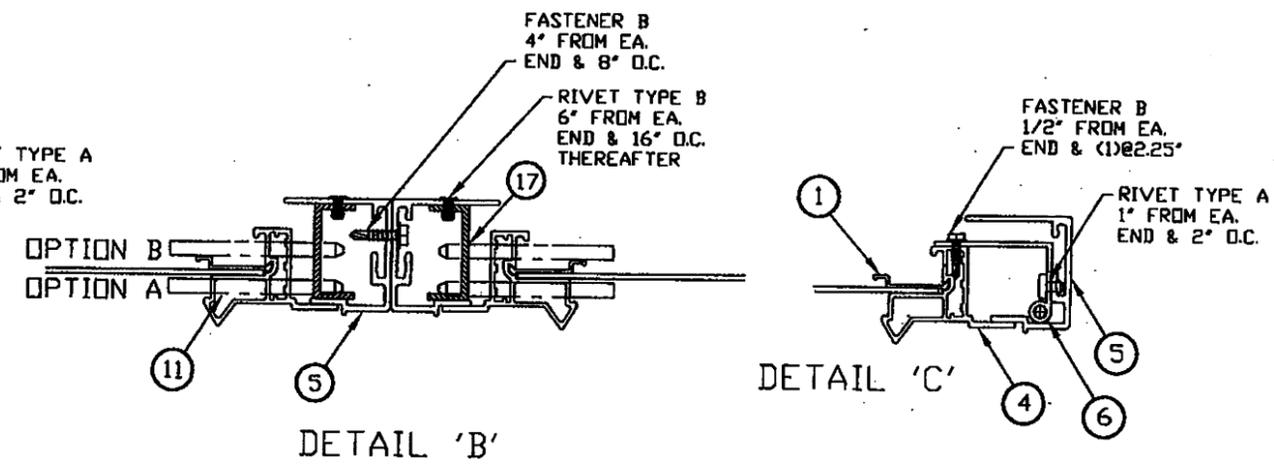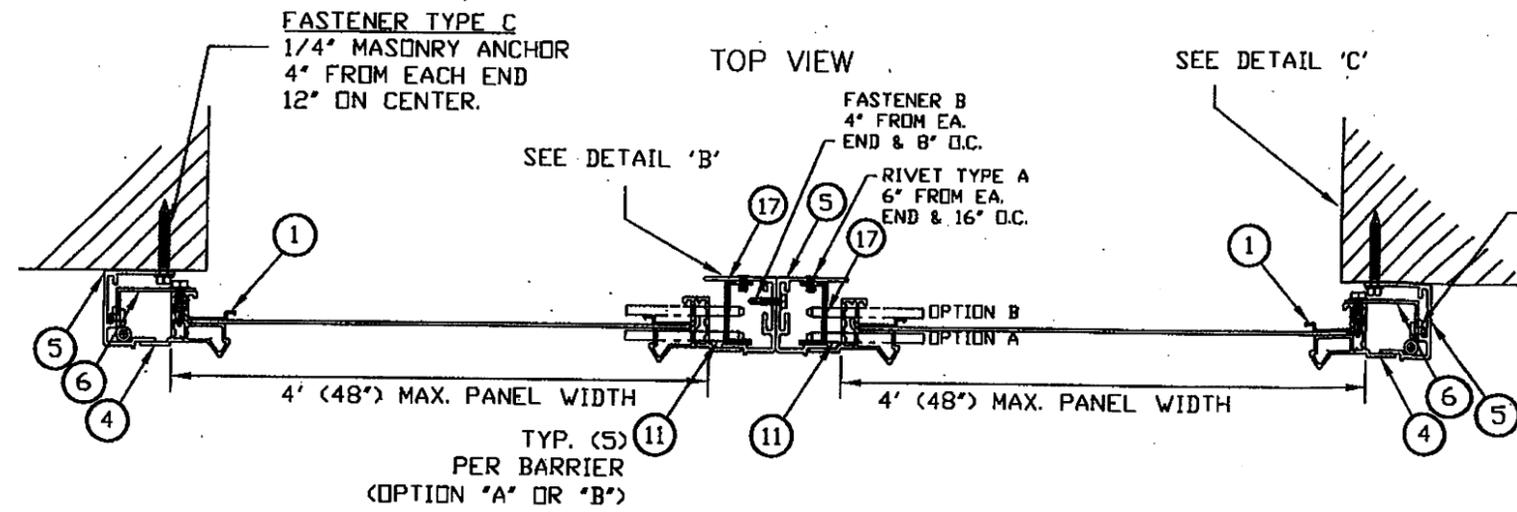

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-1019-20
 Expiration Date 6/23/2016
 By *[Signature]*
 Miami Dade Product Control

Approved as complying with the
 Florida Building Code
 Date 06/23/2011
 NOA# 11-6127-02
 Miami Dade Product Control
 By *[Signature]*

MAT. TYPE	DESIGN PRESSURE RATING	
	POS. (PSF.)	NEG. (PSF.)
GALVANNEAL	77	77
STAINLESS STEEL	77	77

TITLE/CUSTOMER
DETAILS FOR STORM SHIELD HURRICANE BARRIER
 4' X 6' SIDE HINGED 1 X 2 (FACE MOUNT)

SCALE: NTS
 DATE: 5/5/11

WWW.STORMSHIELD.NET
EXETER
 ARCHITECTURAL PRODUCTS

DRAWN BY: RBM
 REVISED 1
 TR#A1022.01-109-18






242 W. 8TH ST.
 WYOMING PA 18644

800-972-2478
 FAX (570) 693-2575

PRODUCT CONTROL CODE:
 DRAWING NO. SSHB-EHB

- NOTES:**
- ITEM # 11, 1/4" X 2.63" SECURING PIN (MIN); S/S FIVE SECURING PINS ON SIDE OPPOSITE HINGE SIDE.
 - FASTENER TYPE A: #10 X 5/8" SS TEK SCREW
 - FASTENER TYPE B: #10 X 3/4" SS TEK SCREW
 - FASTENER TYPE C: 1/4"Ø X 1 3/4" ELCD TAPCON WITH 1.25" MINIMUM EMBEDMENT IN FILLED CELLS. FASTENERS SPACED 4" FROM EACH END AND 12" O.C. THEREAFTER.
 - UNITS LESS THAN 30" IN HEIGHT SHALL SPLIT VERTICAL SECURING PIN LOCATIONS AT THE QUARTER POINTS.
 - UNITS CAN BE MOUNTED AS SINGLE BARRIER.

- CONSULTING ENGINEER
 THOMAS H. MAXWELL JR., P.E.
 121 N.W. 39 AVE.
 MIAMI, FLORIDA 33126
 (305) 541-7549
- Board of Professional Engineers
 Exam: Mechanical-Structural; 1965
 State of Florida P.E. Registration
 No. 10150
 U.S. Army Corps of Engineers:
 Civil-Structural Engineer
 Florida Power & Light Company:
 Electrical Engineer
- RIVET TYPE A: 3/16 STAINLESS STEEL RIVET (1/16-1/8" GRIP RANGE)
 - RIVET TYPE B: 3/16 ALUMINUM RIVET (1/8-1/4" GRIP RANGE)

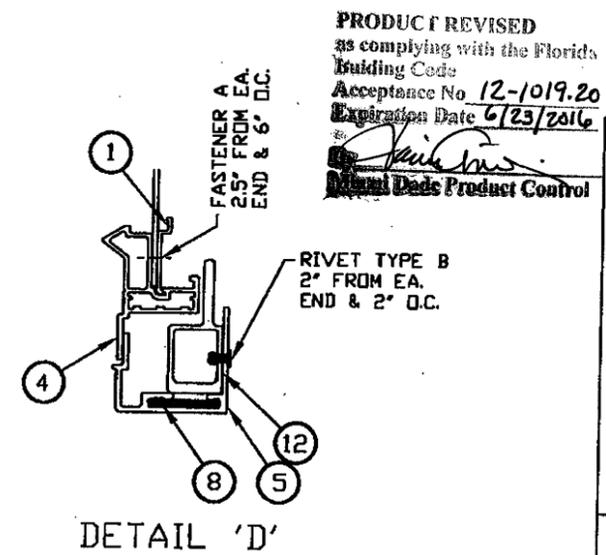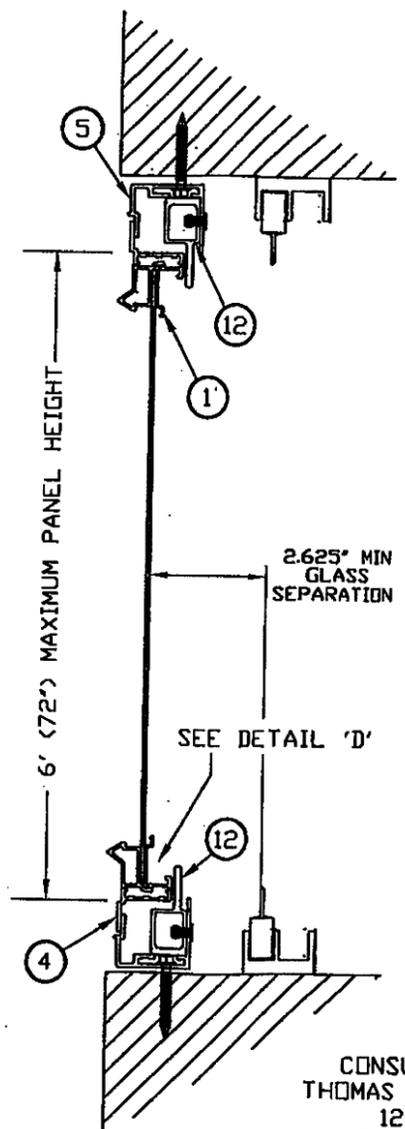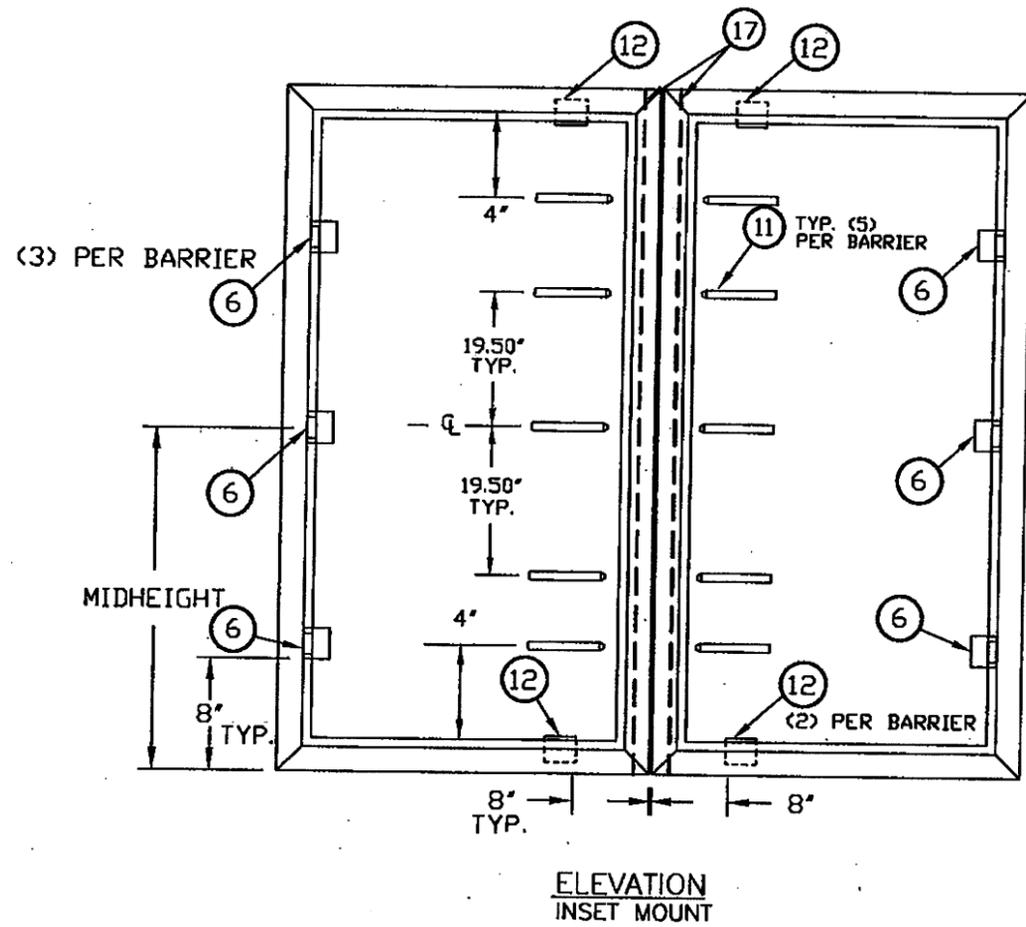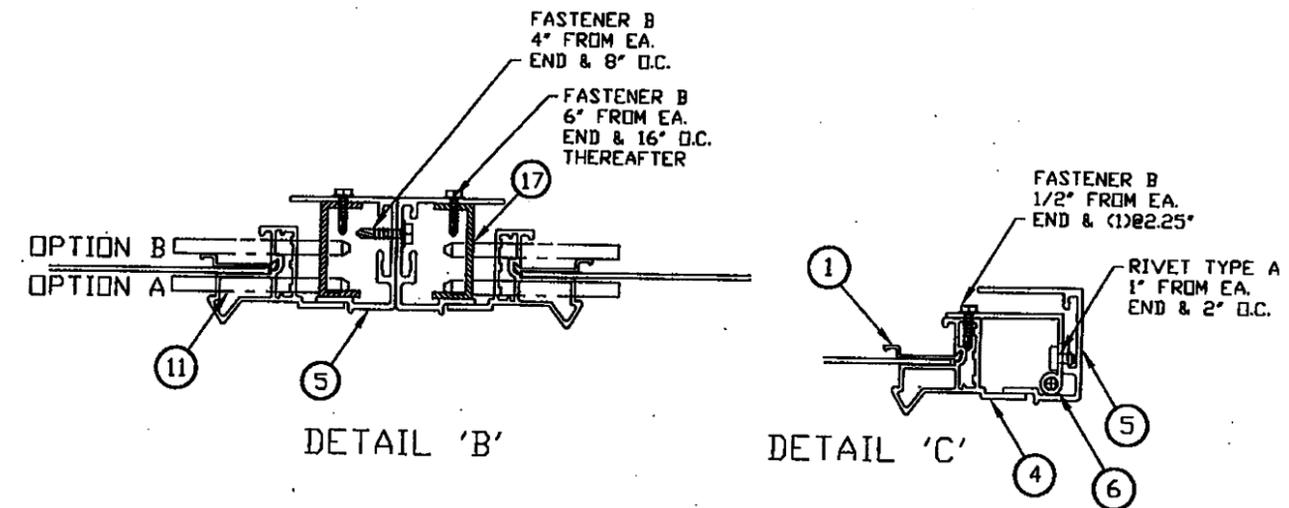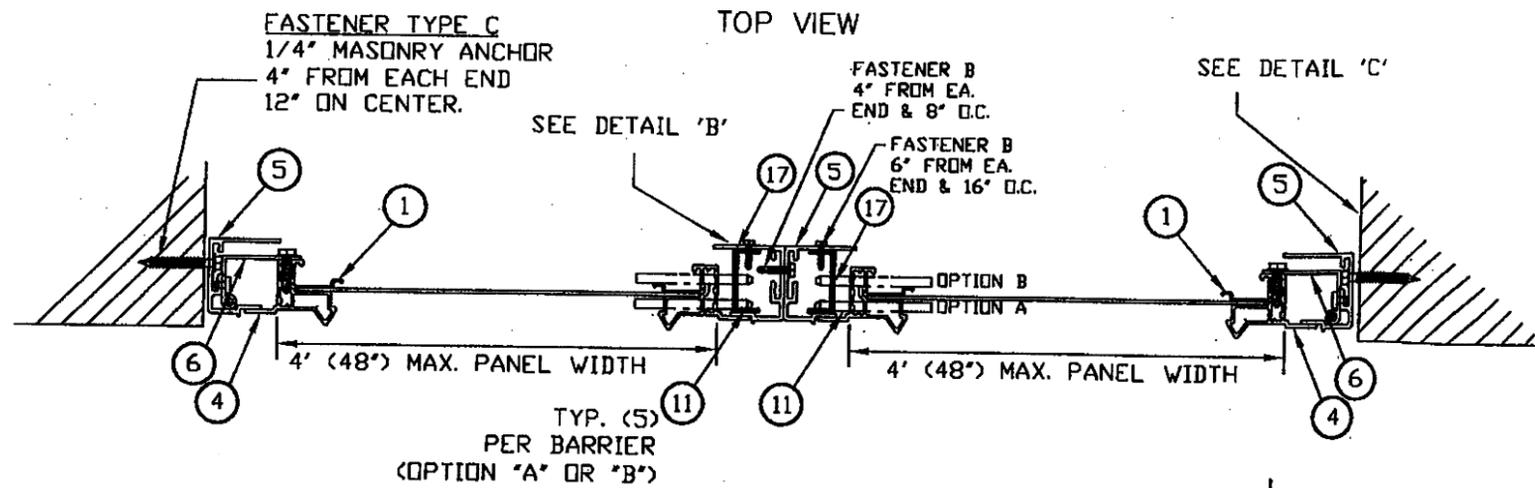

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-1019.20
 Expiration Date 6/23/2016
 Miami Dade Product Control

Approved as complying with the
 Florida Building Code
 Date 06/23/2011
 NOA# 11-012702
 Miami Dade Product Control
 By *Heung A. Ma*

NO MID HEIGHT TUBE REQUIRED

MAT. TYPE	DESIGN PRESSURE RATING	
	POS. (PSF.)	NEG. (PSF.)
GALVANNEAL	77	77
STAINLESS STEEL	77	77

- NOTES:
- ITEM # (11) 1/4" X 2.63" SECURING PIN (MIN); S/S FIVE SECURING PINS ON SIDE OPPOSITE HINGE SIDE.
 - FASTENER TYPE A: #10 X 5/8" SS TEK SCREW
 - FASTENER TYPE B: #10 X 3/4" SS TEK SCREW
 - FASTENER TYPE C: 1/4"Ø X 1 3/4" ELCO TAPCON WITH 1.25" MINIMUM EMBEDMENT IN FILLED CELLS. FASTENERS SPACED 4" FROM EACH END AND 12" O.C. THEREAFTER.
 - UNITS LESS THAN 30" IN HEIGHT SHALL SPLIT VERTICAL SECURING PIN LOCATIONS AT THE QUARTER POINTS.
 - UNITS CAN BE MOUNTED AS SINGLE BARRIER.

- RIVET TYPE A: 3/16 STAINLESS STEEL RIVET (1/16-1/8" GRIP RANGE)
- RIVET TYPE B: 3/16 ALUMINUM RIVET (1/8-1/4" GRIP RANGE)

CONSULTING ENGINEER
 THOMAS H. MAXWELL JR., P.E.
 121 N.W. 39 AVE.
 MIAMI, FLORIDA 33126
 (305) 541-7549

Board of Professional Engineers
 Exam: Mechanical-Structural: 1965
 State of Florida P.E. Registration
 No. 10150
 U.S. Army Corps of Engineers:
 Civil-Structural Engineer
 Florida Power & Light Company:
 Electrical Engineer

TITLE/CUSTOMER
 DETAILS FOR STORM SHIELD HURRICANE BARRIER
 4' X 6' SIDE HINGED 1 X 2 (INSET MOUNT)

SCALE: NTS
 DATE: 5/5/11

WWW.STORMSHIELD.NET








EXETER
 ARCHITECTURAL PRODUCTS

DRAWN BY: RBM
 REVISED 1
 TR#A1022.01-109-18

242 W. 8TH ST.
 WYOMING PA. 18644

800-972-2478
 FAX (570) 693-2575

PRODUCT CONTROL CODE:
 DRAWING NO. SSHB-EHB
 PAGE 3 OF 12

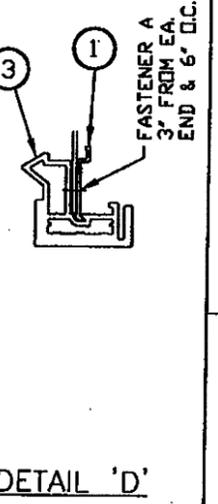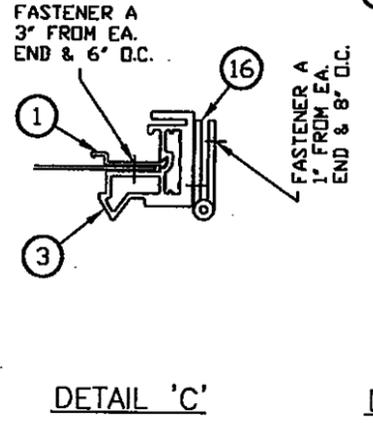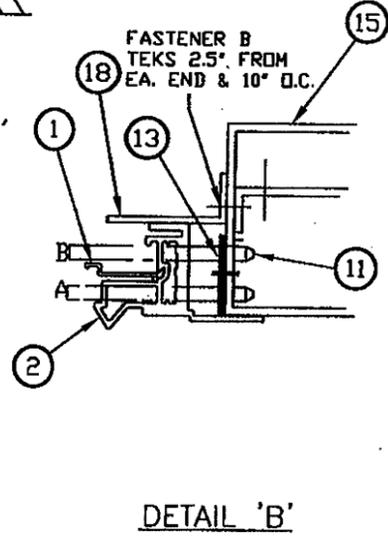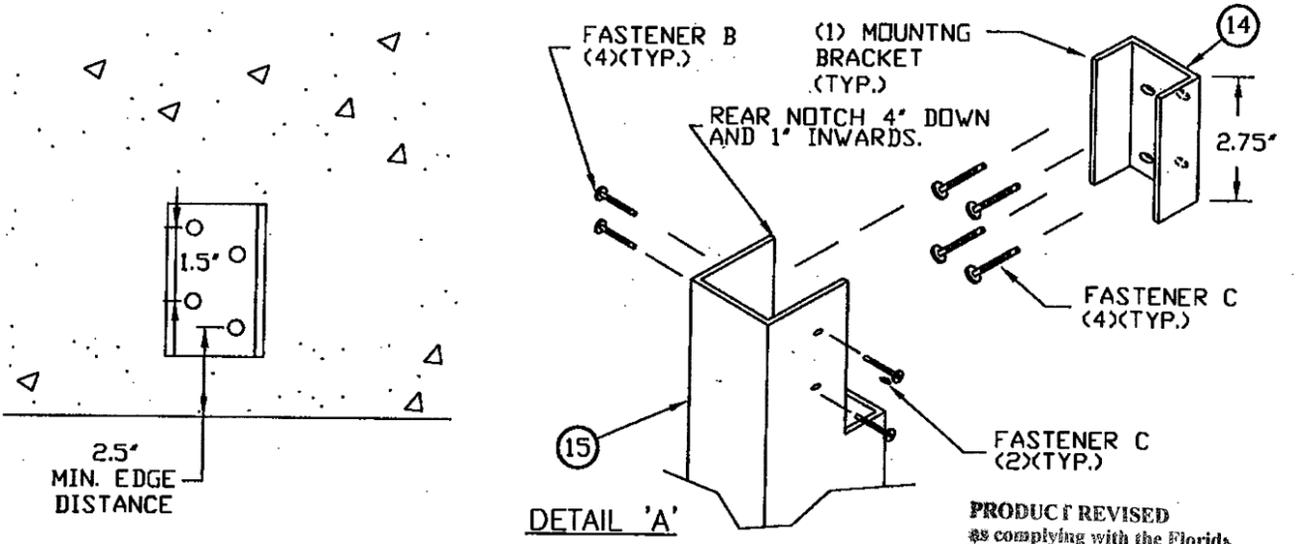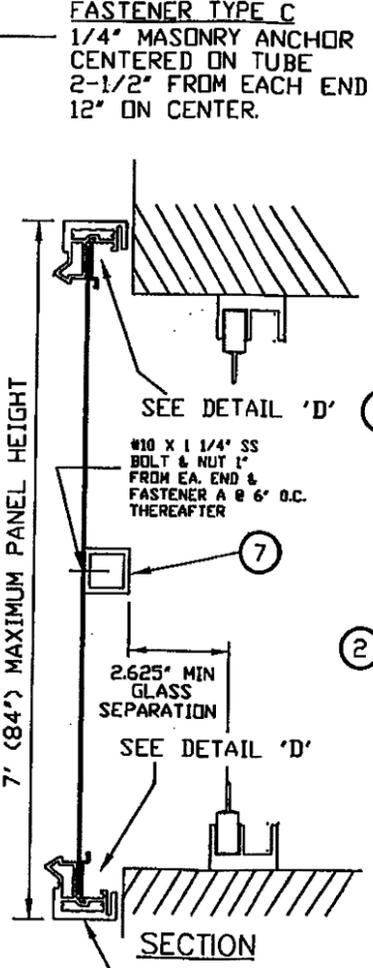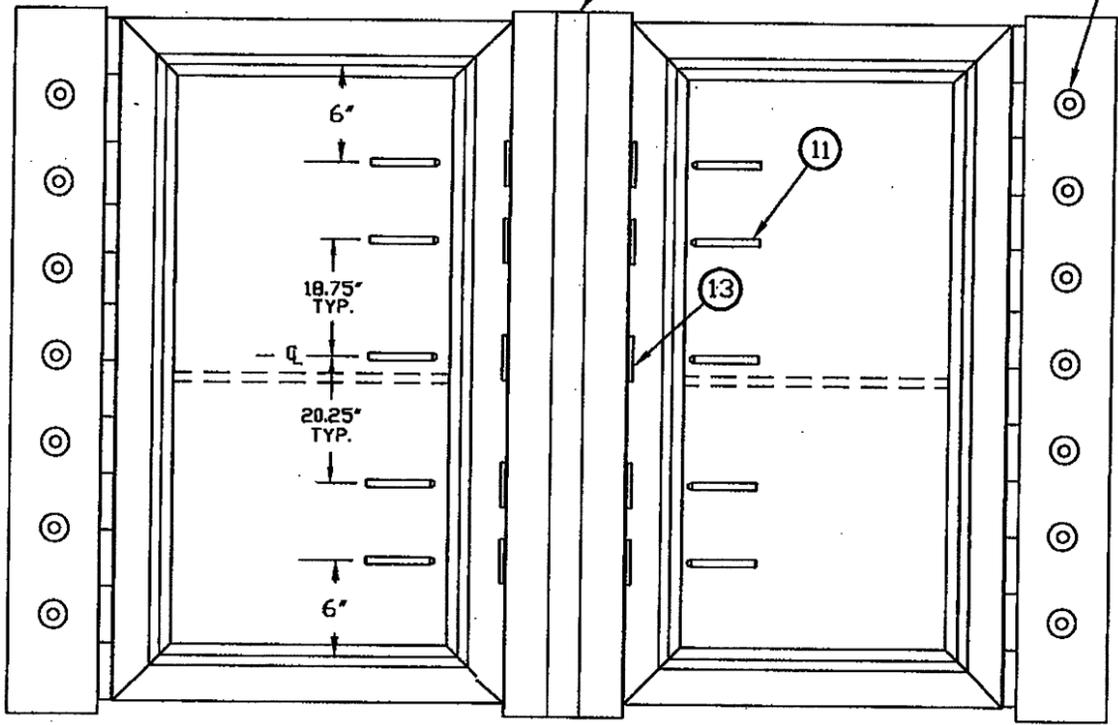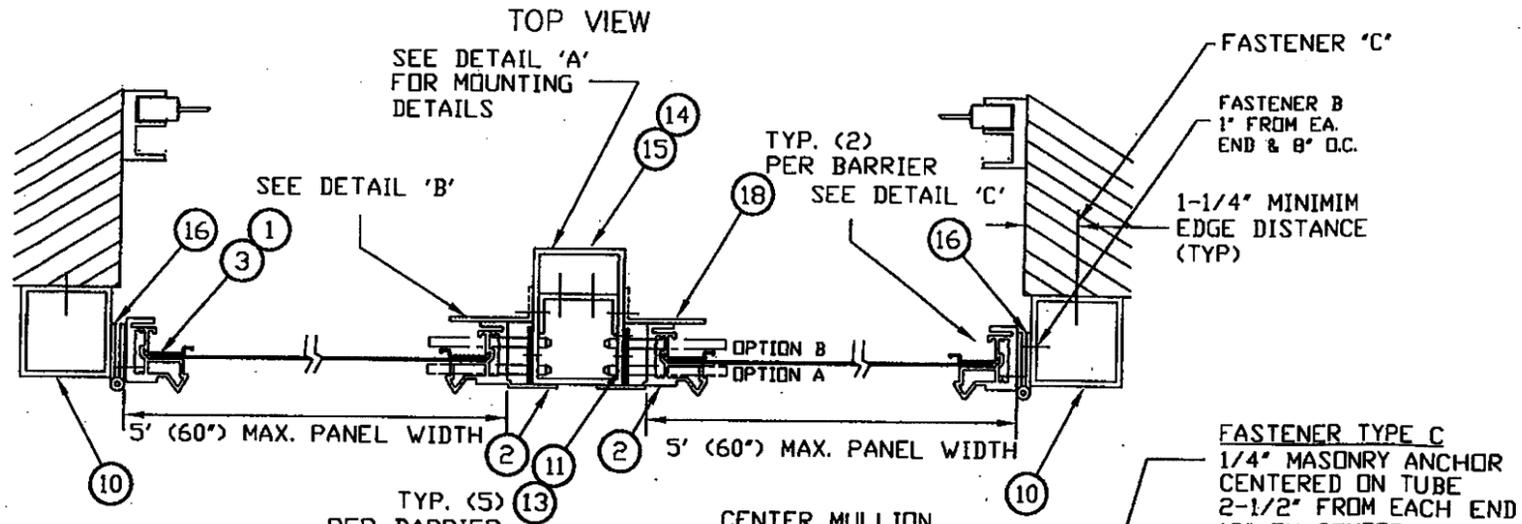

ENLARGED VIEW OF MULLION DETAIL (TOP SHOWN; SAME FOR BOTTOM)

PRODUCT REVISED as complying with the Florida Building Code Acceptance Code
 Acceptance No 12-1019-20
 Expiration Date 6/23/2016

Approved as complying with the Florida Building Code
 Date 06/23/2011
 NOA# 11-0127-02
 Miami Dade Product Control
 By *Heather A. ...*

J. Maxwell
 5/17-11

MID HEIGHT TUBE REQUIRED

MAT. TYPE	DESIGN PRESSURE RATING	
	POS. (PSF.)	NEG. (PSF.)
GALVANNEAL	93	93
STAINLESS STEEL	93	93

- NOTES:
- ITEM # (11) 1/4" X 2.63" SECURING PIN (MIN); S/S FIVE SECURING PINS ON SIDE OPPOSITE HINGE SIDE.
 - FASTENER TYPE A: #10 X 5/8" SS TEK SCREW
 - FASTENER TYPE B: #10 X 3/4" SS TEK SCREW
 - FASTENER TYPE C: 1/4"Ø X 1 3/4" ELCD TAPCON WITH 1.25" MINIMUM EMBEDMENT IN FILLED CELLS. FASTENERS SPACED 2.5" FROM EACH END AND 12" O.C. THEREAFTER.
 - UNITS LESS THAN 30" IN HEIGHT SHALL SPLIT VERTICAL SECURING PIN LOCATIONS AT THE QUARTER POINTS.
 - UNITS CAN BE MOUNTED AS SINGLE BARRIER.

CONSULTING ENGINEER
 THOMAS H. MAXWELL JR., P.E.
 121 N.W. 39 AVE.
 MIAMI, FLORIDA 33126
 (305) 541-7549

Board of Professional Engineers
 Exam: Mechanical-Structural: 1965
 State of Florida P.E. Registration No. 10150
 U.S. Army Corps of Engineers:
 Civil-Structural Engineer
 Florid Power & Light Company:
 Electrical Engineer

TITLE/CUSTOMER
 DETAILS FOR STORM SHIELD HURRICANE BARRIER
 5' X 7' ENHANCED SIDE HINGED (FACE MOUNT)

SCALE: NTS

DATE: 5/5/11

DRAWN BY: RBM

REVISED 1

TR#A0200.01-109-18

242 W. 8TH ST.
 WYOMING PA 18644


800-972-2478
 FAX (570) 693-2575

PRODUCT CONTROL CODE:

DRAWING NO. SSHB-EMB

PAGE 4 OF 12






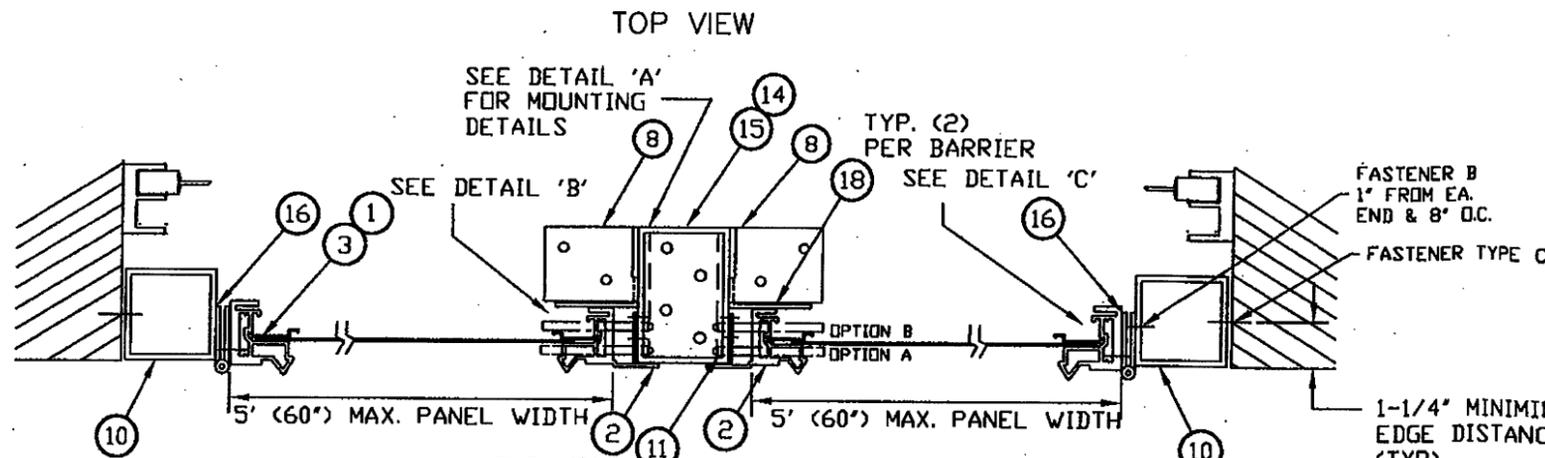

TYP. (5) PER BARRIER (OPTION 'A' OR 'B')

SEE DETAIL 'A' FOR MOUNTING DETAILS.

1/4" MASONRY ANCHOR CENTERED ON TUBE 2-1/2" FROM EACH END 12" ON CENTER. (FASTENER TYPE C)

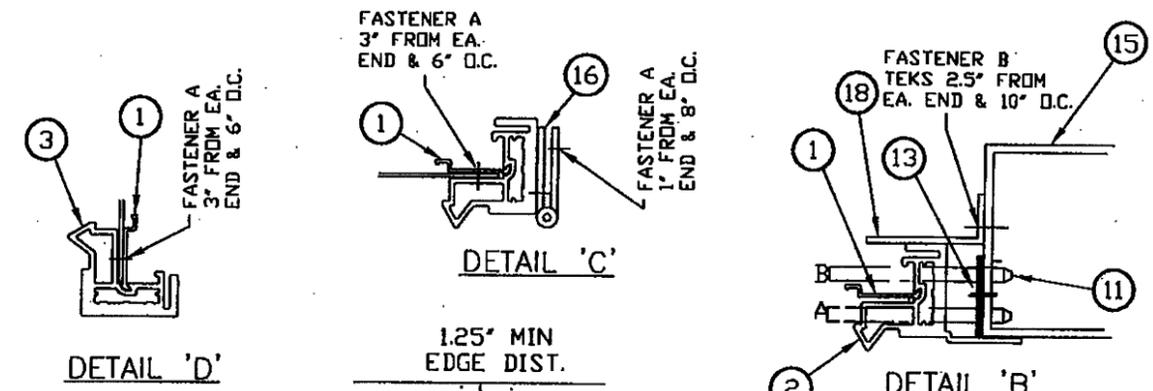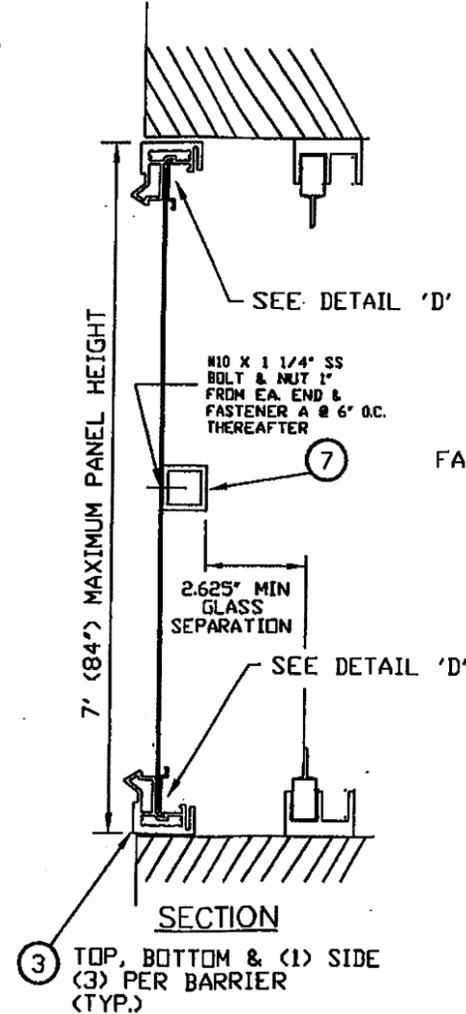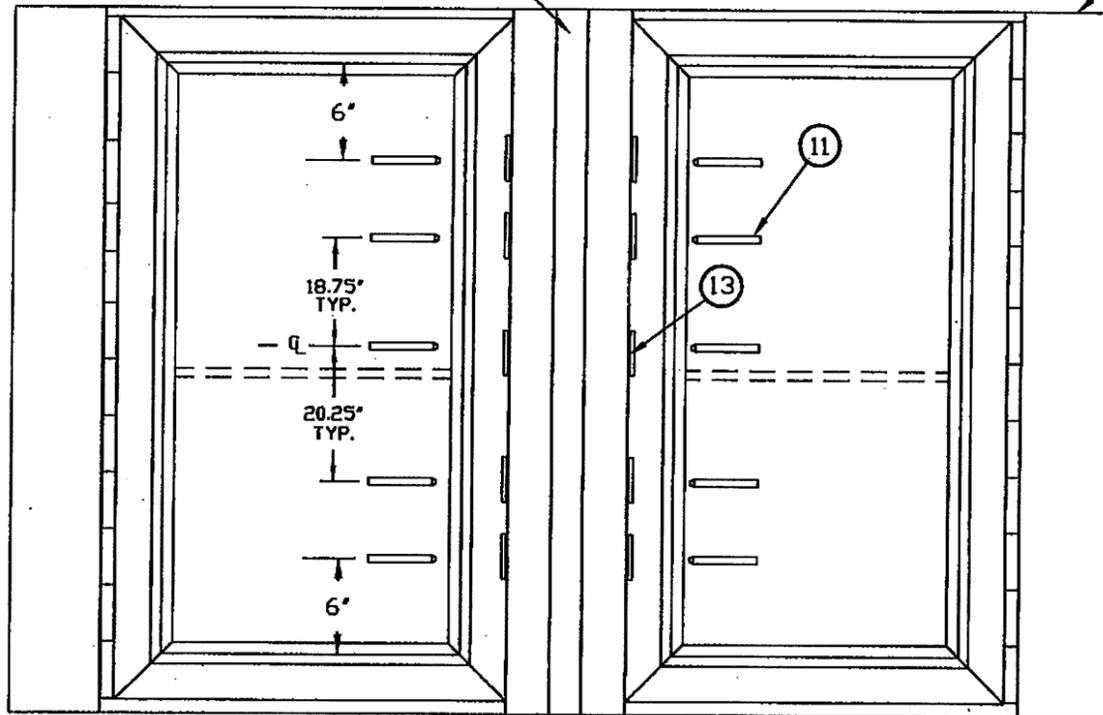


PRODUCT REVISED as complying with the Florida Building Code Acceptance No 12-1019-20 Expiration Date 6/23/2016

By *[Signature]* Miami Dade Product Control

Approved as complying with the Florida Building Code Date 06/23/2011 NOAA# 11-0127-02 Miami Dade Product Control

By *[Signature]*

[Signature] 5-12-11

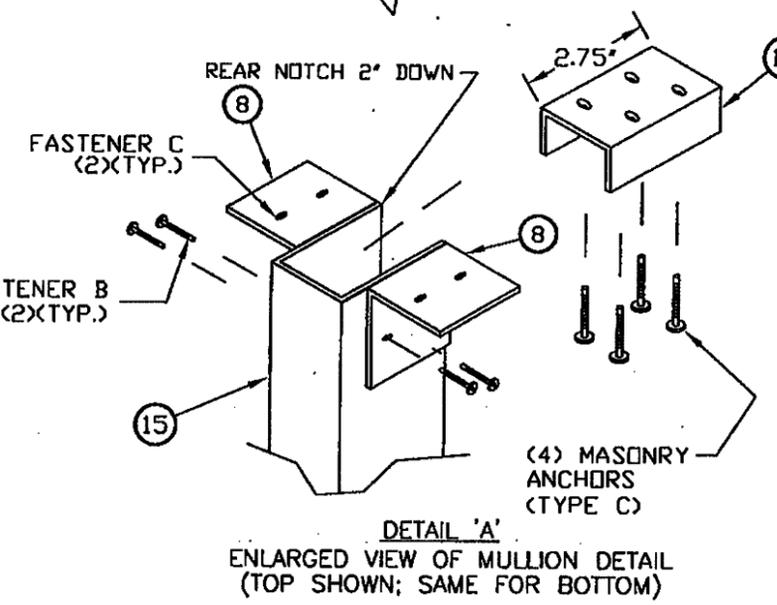

MID HEIGHT TUBE REQUIRED

MAT. TYPE	DESIGN PRESSURE RATING	
	POS. (PSF.)	NEG. (PSF.)
GALVANNEAL	93	93
STAINLESS STEEL	93	93

NOTES:

- ITEM # 11, 1/4" X 2.63" SECURING PIN (MIN); S/S FIVE SECURING PINS ON SIDE OPPOSITE HINGE SIDE.
- FASTENER TYPE A: #10 X 5/8" SS TEK SCREW
- FASTENER TYPE B: #10 X 3/4" SS TEK SCREW
- FASTENER TYPE C: 1/4" X 1 3/4" ELCO TAPCON WITH 1.25" MINIMUM EMBEDMENT IN FILLED CELLS. FASTENERS SPACED 2.5" FROM EACH END AND 12" O.C. THEREAFTER.
- UNITS LESS THAN 30" IN HEIGHT SHALL SPLIT VERTICAL SECURING PIN LOCATIONS AT THE QUARTER POINTS.
- UNITS CAN BE MOUNTED AS SINGLE BARRIER.

CONSULTING ENGINEER
 THOMAS H. MAXWELL JR., P.E.
 121 N.W. 39 AVE.
 MIAMI, FLORIDA 33126
 (305) 541-7549

Board of Professional Engineers
 Exam: Mechanical-Structural: 1965
 State of Florida P.E. Registration
 No. 10150
 U.S. Army Corps of Engineers:
 Civil-Structural Engineer
 Florid Power & Light Company:
 Electrical Engineer

TITLE/CUSTOMER
 DETAILS FOR STORM SHIELD HURRICANE BARRIER
 5' X 7' ENHANCED SIDE HINGED (INSET MOUNT)

SCALE: NTS

DATE: 5/5/11

WWW.STORMSHIELD.NET

DRAWN BY: RBM

REVISED 1

TR#A0200.01-109-18

242 W. 8TH ST.
 WYOMING PA 18644


800-972-2478
 FAX (570) 693-2575

PRODUCT CONTROL CODE:


DRAWING NO. SSHB-EHB

PAGE 5 OF 12




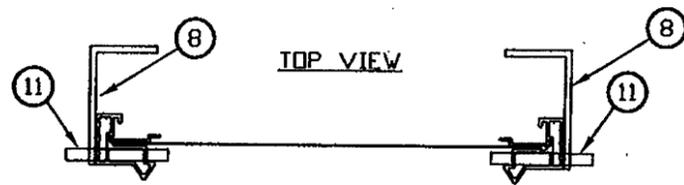


NOTE: PERF NOT SHOWN FOR CLARITY
4' - 0" MAX. PANEL WIDTH

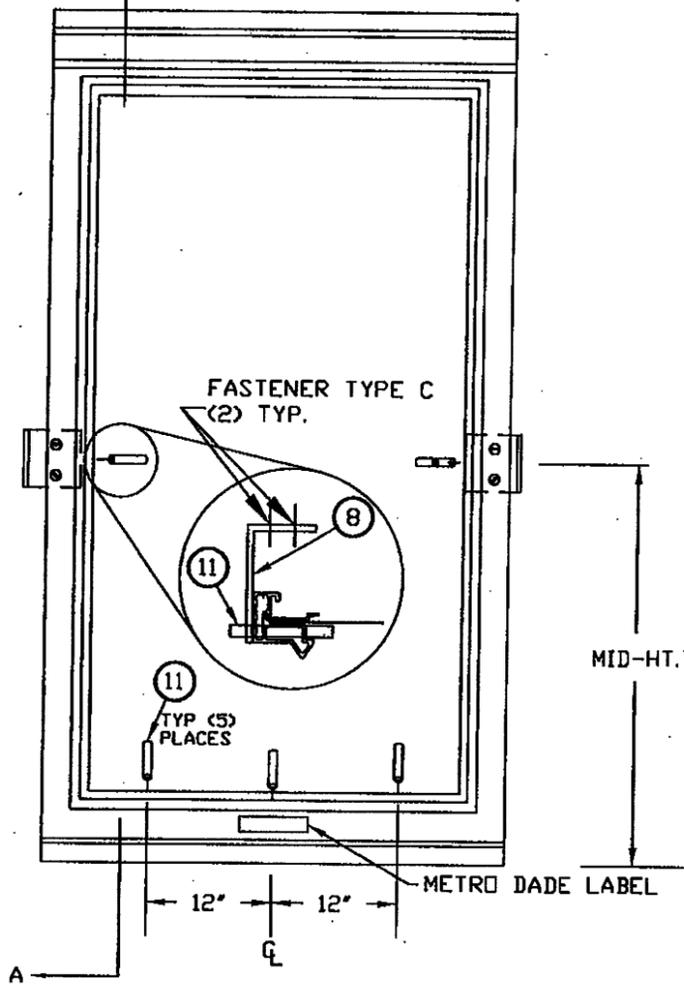


PLAN VIEW

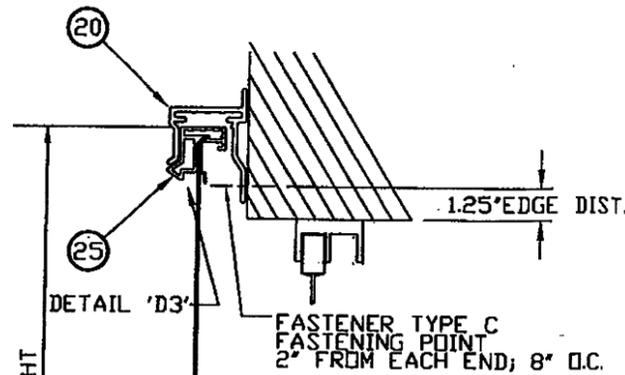


FASTENER TYPE C FASTENING POINT
2" FROM EACH END; 8" O.C.
2.75" MINIMUM SEPARATION OF PERFORATED BARRIER TO GLASS
1.25" EDGE DIST.

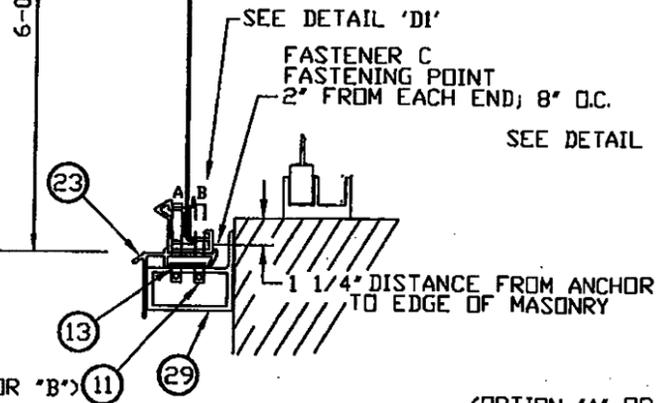


SECTION 'A'
NO BUILD OUT

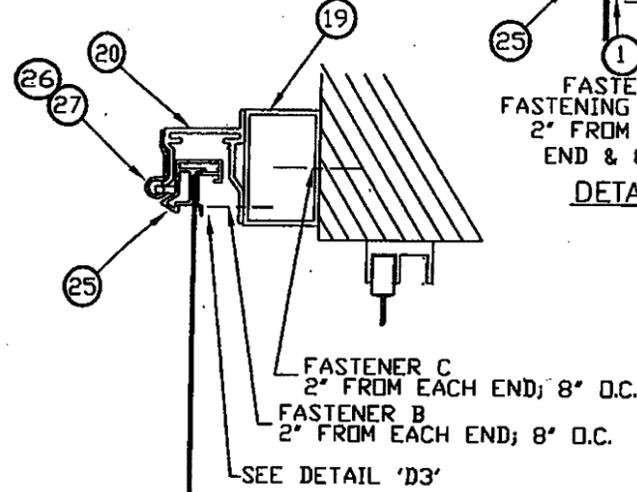

FASTENER C 2" FROM EACH END; 8" O.C.
FASTENER B 2" FROM EACH END; 8" O.C.
SEE DETAIL 'D3'

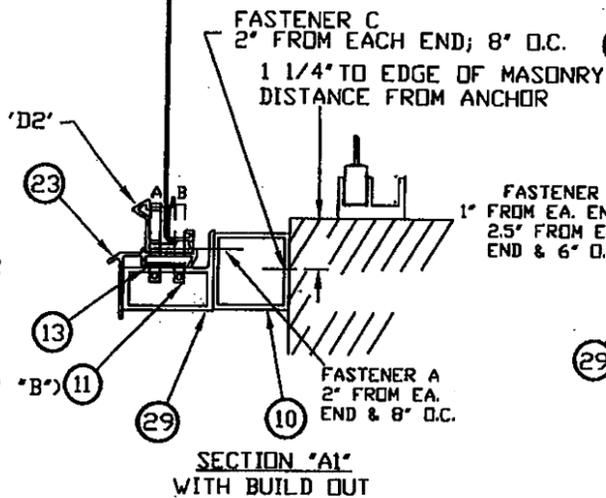

SECTION 'A1'
WITH BUILD OUT

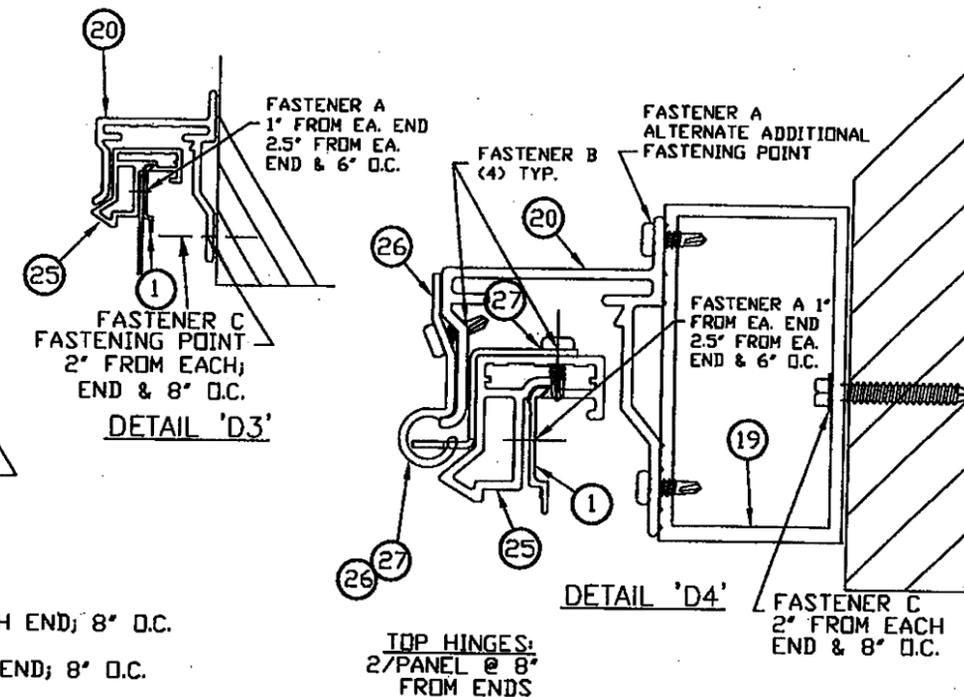

TOP HINGES:
2/PANEL @ 8" FROM ENDS


PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 12-1019-20
Expiration Date 6/23/2016
By *[Signature]*
Miami Dade Product Control

Approved as complying with the Florida Building Code
Date 06/23/2011
NOA# 11-0127-02
Miami Dade Product Control
By *[Signature]*

MAT. TYPE	DESIGN PRESSURE RATING	
	POS. (PSF.)	NEG. (PSF.)
STAINLESS STEEL	155	155

NOTES:

- SECTION 'A' IS STANDARD LAYOUT, WHILE SECTION 'A1' SHOWS OPTIONAL FEATURES.
- FASTENER TYPE A: #10 X 5/8" SS TEK SCREW
- FASTENER TYPE B: #10 X 3/4" SS TEK SCREW
- FASTENER TYPE C: 1/4" X 1 3/4" ELCO TAPCON WITH 1.75" MINIMUM EMBEDMENT WITH FILLED CELLS.
- SEE PAGE 11 & 12 FOR EXTRUSION DETAILS

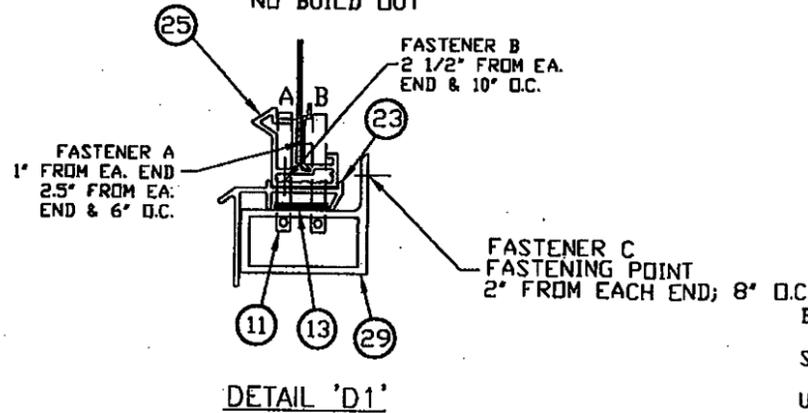



DETAIL 'D1'

CONSULTING ENGINEER
THOMAS H. MAXWELL JR., P.E.
121 N.W. 39 AVE.
MIAMI, FLORIDA 33126
(305) 541-7549

Board of Professional Engineers
Exam: Mechanical-Structural; 1965
State of Florida P.E. Registration
No. 10150
U.S. Army Corps of Engineers:
Civil-Structural Engineer
Florida Power & Light Company:
Electrical Engineer

TITLE/CUSTOMER DETAILS FOR STORM SHIELD HURRICANE BARRIERS "READY MOUNT UNITS" 4' X 6' ENHANCED SINGLE (FACE MOUNT)		
SCALE: NTS	WWW.STORMSHIELD.NET	DRAWN BY: RBM
DATE: 5/5/11		REVISED 1
242 W. 8TH ST. WYOMING PA 18644		TR#A3081.01-109-18
PRODUCT CONTROL CODE:	800-972-2478 FAX (570) 693-2575	DRAWING NO. SSHB-EHB
PAGE 6 OF 12		

[Handwritten Signature]
5-17-11

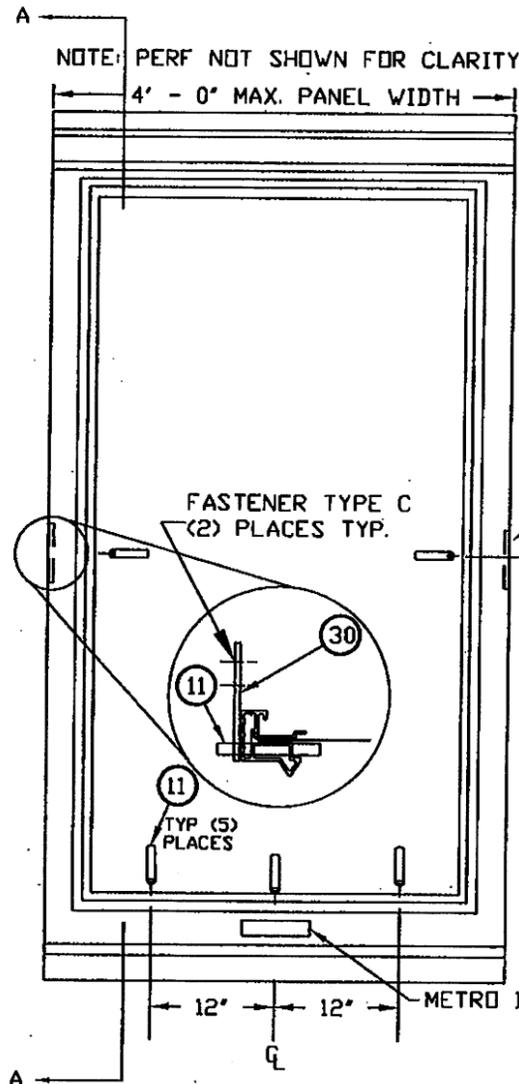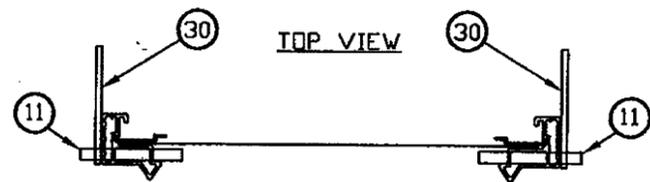


NOTE: PERF NOT SHOWN FOR CLARITY
4' - 0" MAX. PANEL WIDTH

FASTENER TYPE C
(2) PLACES TYP.


TYP. (2)
PER BARRIER

TYP. (5)
PLACES


METRO DADE LABEL

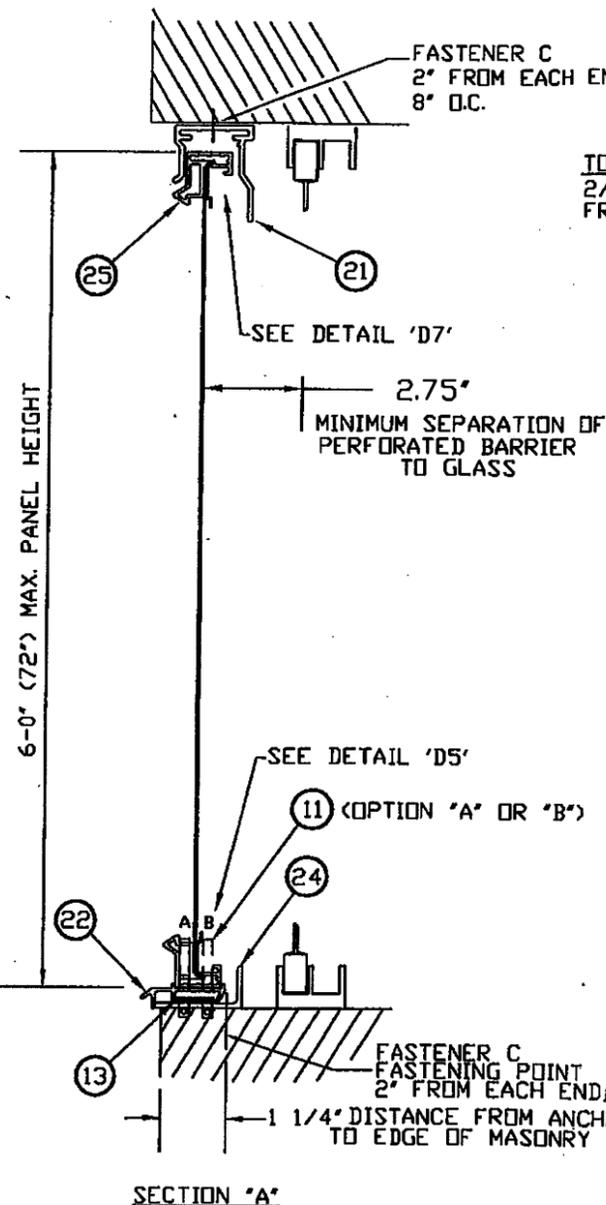


SECTION 'A'

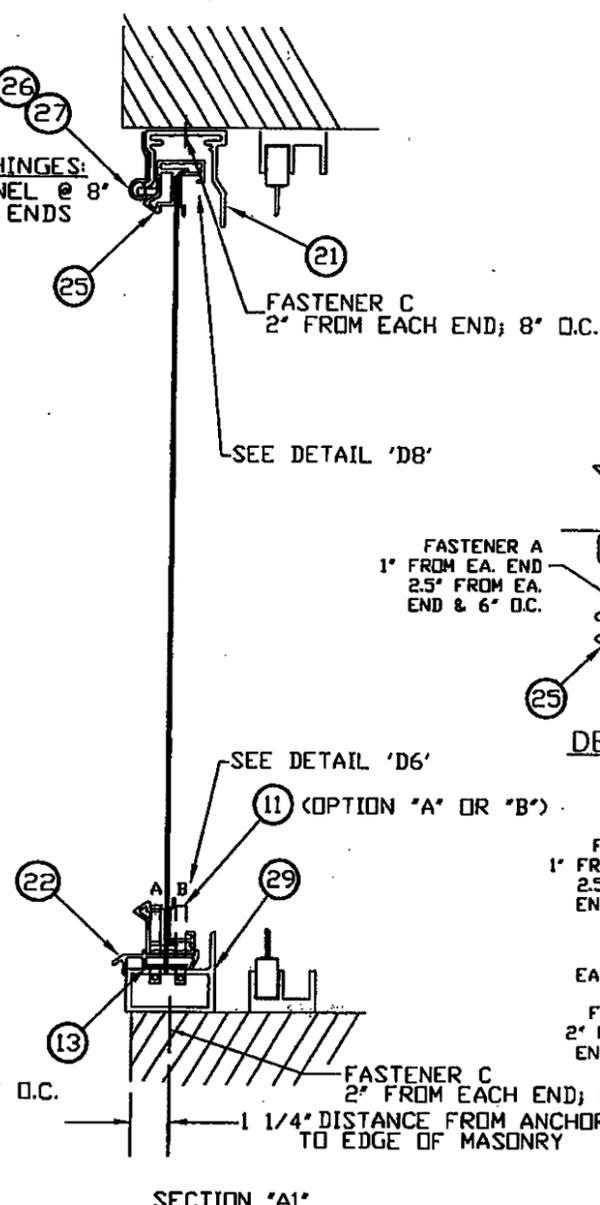


SECTION 'A1'

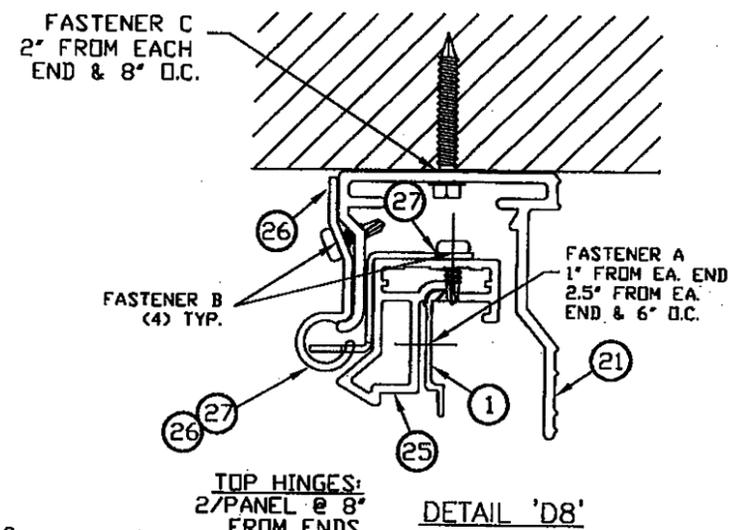

DETAIL 'D8'

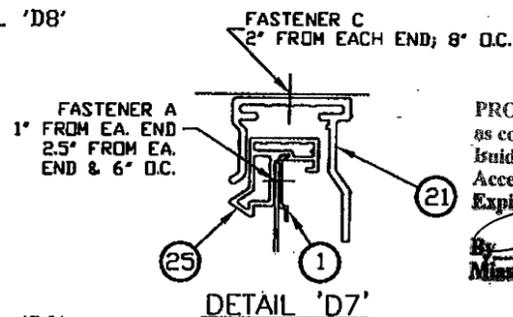

DETAIL 'D7'

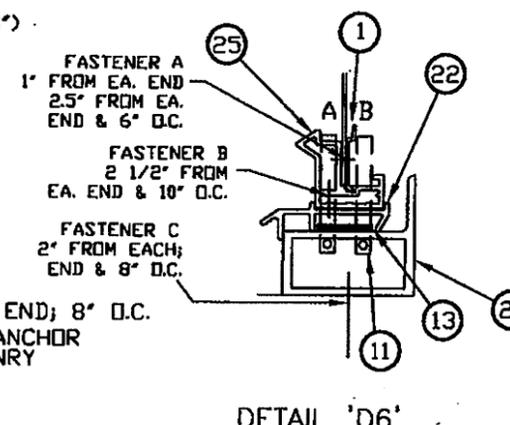


DETAIL 'D6'

MAT. TYPE	DESIGN PRESSURE RATING	
	POS. (PSF.)	NEG. (PSF.)
STAINLESS STEEL	155	155

NOTES:

- SECTION 'A' IS STANDARD LAYOUT, WHILE SECTION 'A1' SHOWS OPTIONAL FEATURES.
- FASTENER TYPE A: #10 X 5/8" SS TEK SCREW
- FASTENER TYPE B: #10 X 3/4" SS TEK SCREW
- FASTENER TYPE C: 1/4" X 1 3/4" ELCO TAPCON WITH 1.75" MINIMUM EMBEDMENT WITH FILLED CELLS.
- SEE PAGE 11 & 12 FOR EXTRUSION DETAILS

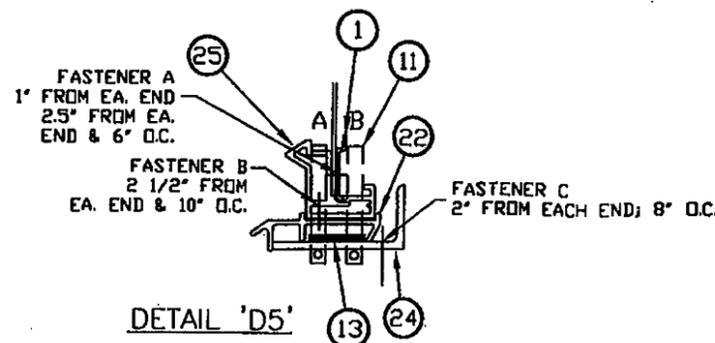

DETAIL 'D5'



CONSULTING ENGINEER
THOMAS H. MAXWELL JR., P.E.
121 N.W. 39 AVE.
MIAMI, FLORIDA 33126
(305) 541-7549

Board of Professional Engineers
Exam: Mechanical-Structural: 1965
State of Florida P.E. Registration
No. 10150
U.S. Army Corps of Engineers:
Civil-Structural Engineer
Florida Power & Light Company:
Electrical Engineer

Approved as complying with the
Florida Building Code
Date: 06/23/2011
Building Code
NOA# 11-0127.02
Acceptance No. 12-1019.20
Expiration Date 6/23/2016
By: *Heung A. Kwon*
Miami Dade Product Control

Handwritten signature and date: 5-17-11

TITLE/CUSTOMER DETAILS FOR STORM SHIELD HURRICANE BARRIERS "READY MOUNT UNITS" 4' X 6' ENHANCED SINGLE (INSET MOUNT)		DRAWN BY: RBM	
SCALE: NTS	WWW.STORMSHIELD.NET	REVISED 1	
DATE: 5/5/11		TR#A3081.01-109-18	
PRODUCT CONTROL CODE:		800-972-2478 FAX (570) 693-2575	
242 W. 8TH ST. WYOMING PA 18644		DRAWING NO. SSSB-EHB	
PAGE 7 OF 12			

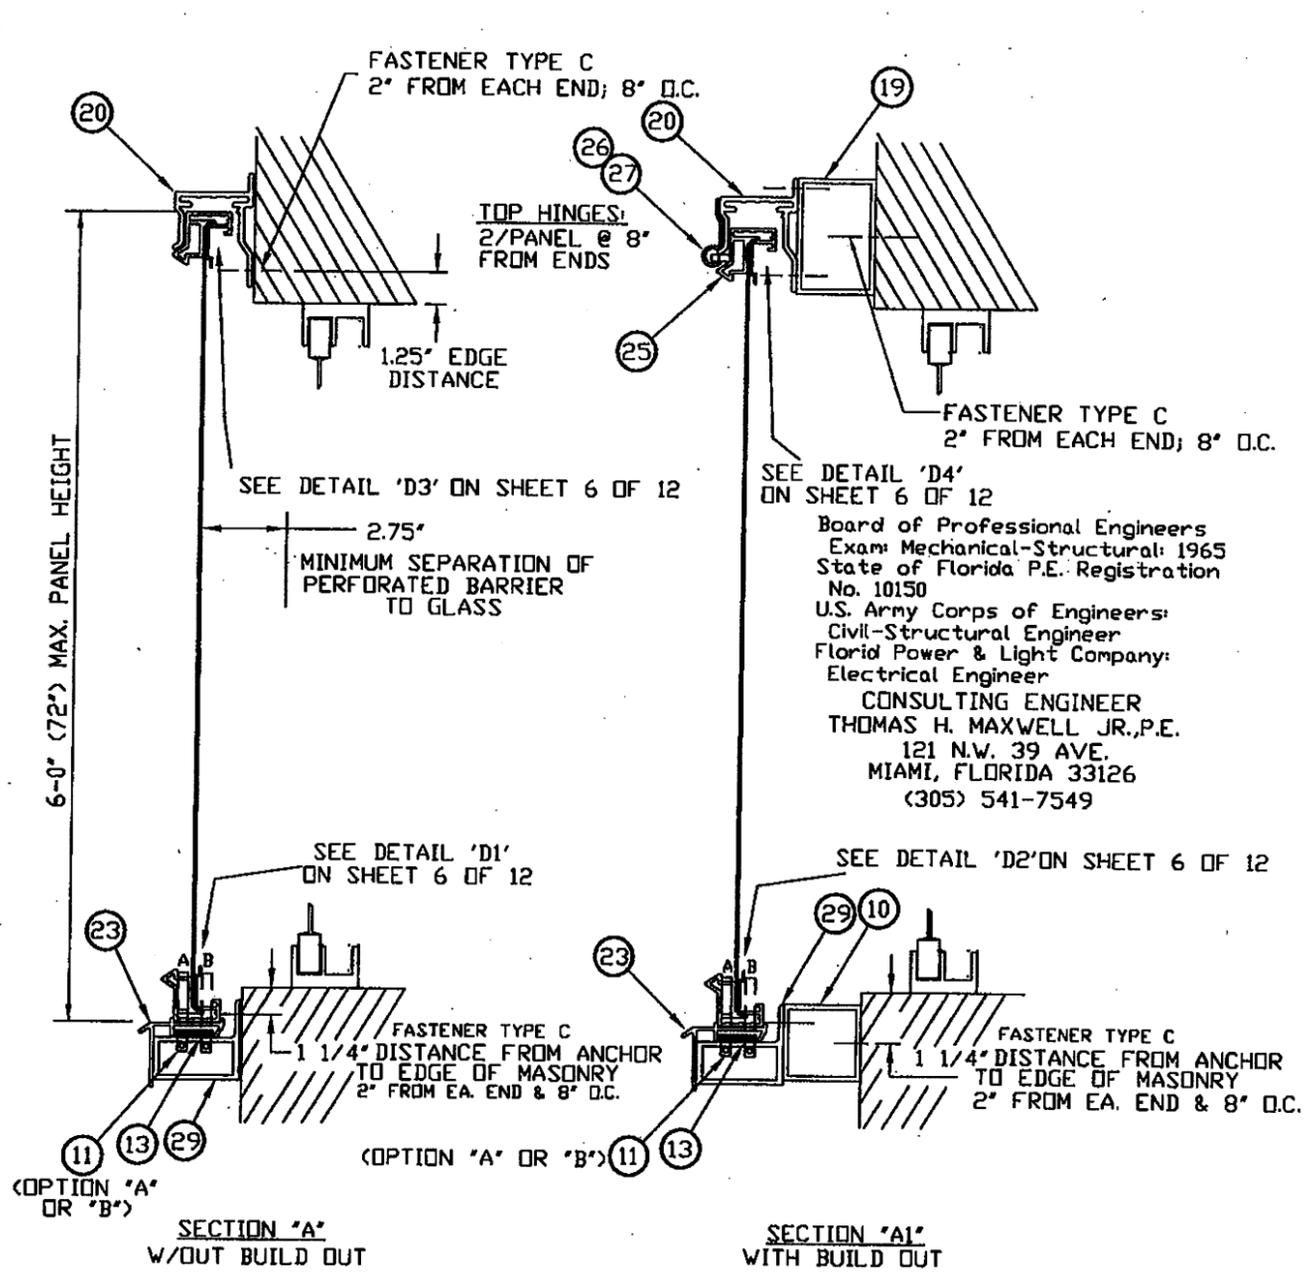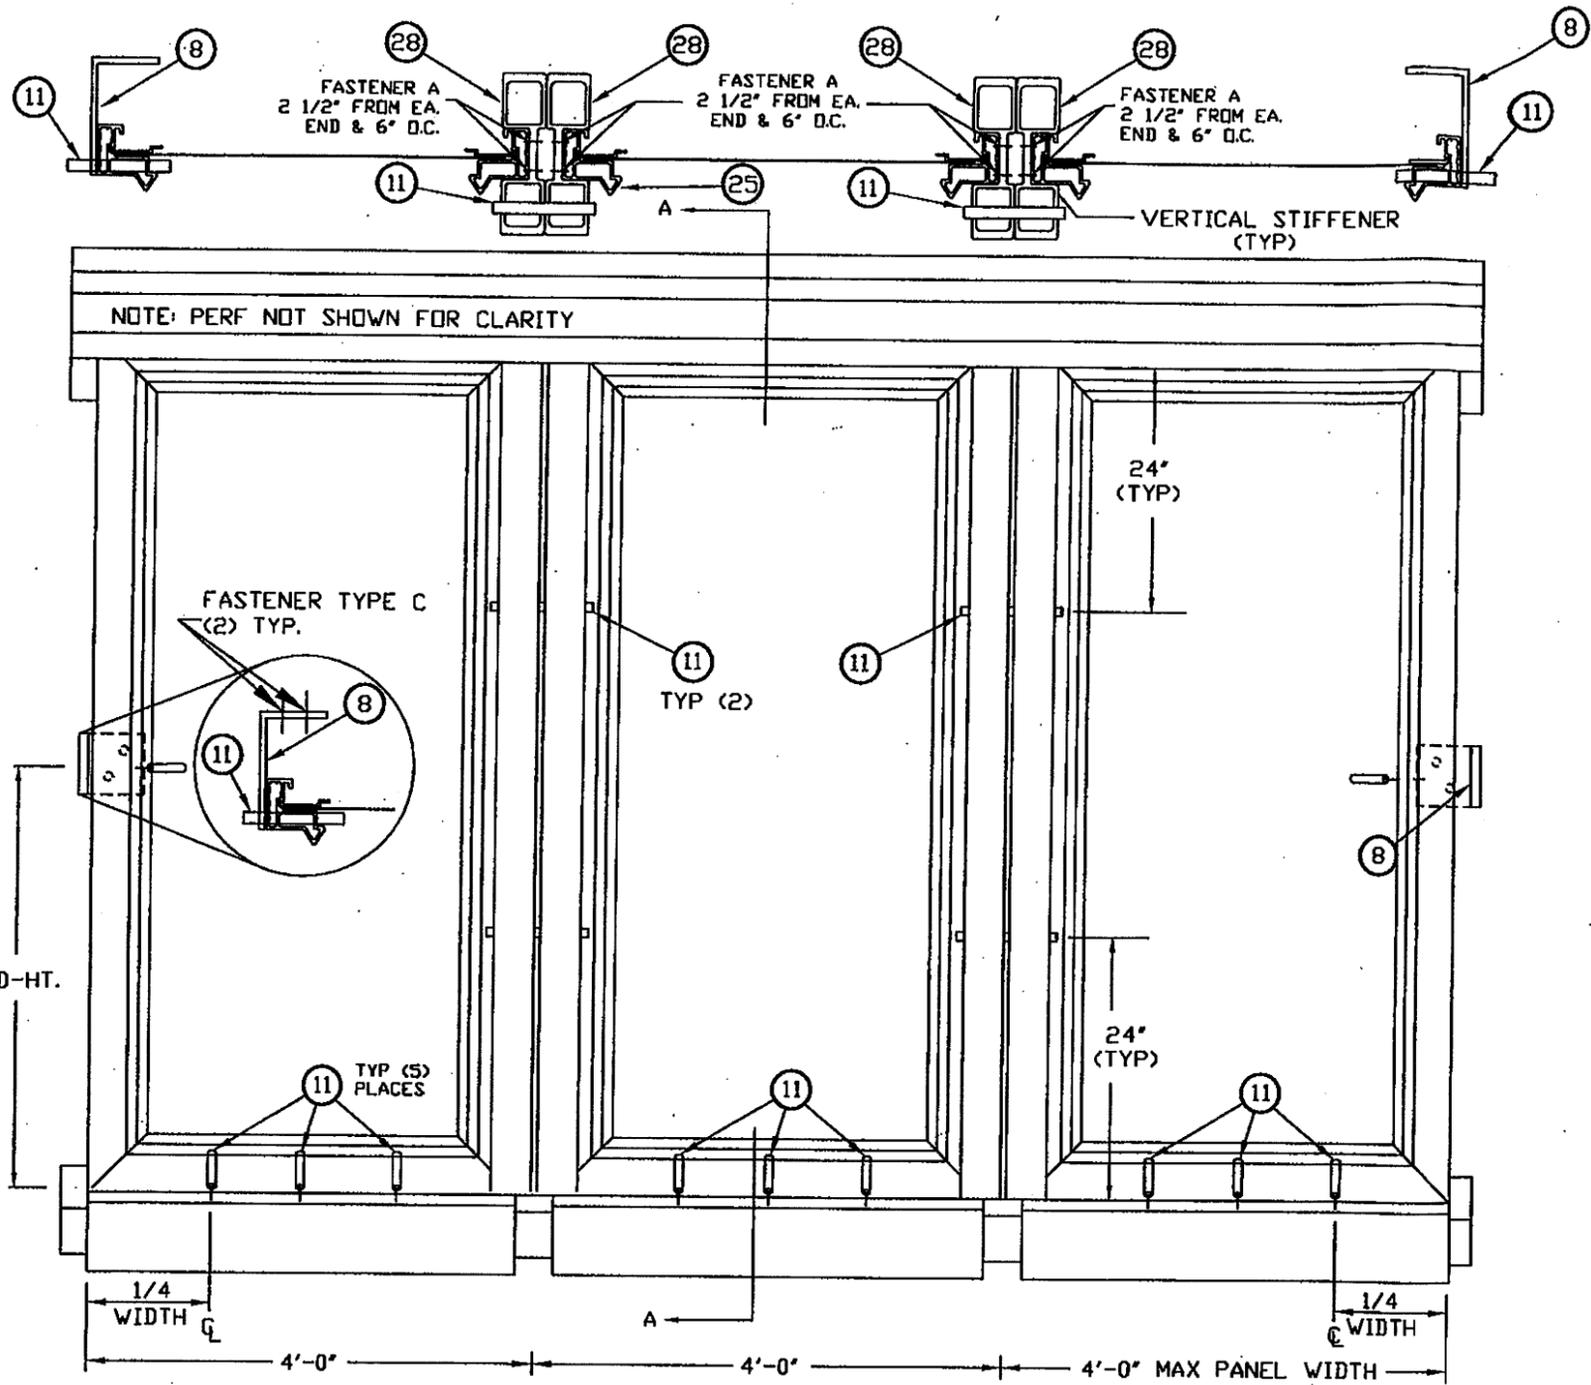

Board of Professional Engineers
 Exam: Mechanical-Structural: 1965
 State of Florida P.E. Registration
 No. 10150
 U.S. Army Corps of Engineers:
 Civil-Structural Engineer
 Florida Power & Light Company:
 Electrical Engineer
CONSULTING ENGINEER
 THOMAS H. MAXWELL JR., P.E.
 121 N.W. 39 AVE.
 MIAMI, FLORIDA 33126
 (305) 541-7549

MAT. TYPE	DESIGN PRESSURE RATING	
	POS. (PSF.)	NEG. (PSF.)
STAINLESS STEEL	124	124



- NOTES:**
- SECTION "A" IS STANDARD LAYOUT, WHILE SECTION "A1" SHOWS OPTIONAL FEATURES.
 - FASTENER TYPE A: #10 X 5/8" SS TEK SCREW
 - FASTENER TYPE B: #10 X 3/4" SS TEK SCREW
 - FASTENER TYPE C: 1/4"Ø X 1 3/4" ELCO TAPCON WITH 1.75" MINIMUM EMBEDMENT WITH FILLED CELLS.
 - SEE PAGE 11 & 12 FOR EXTRUSION DETAILS

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 12-1019-20
 Expiration Date 6/23/2016
 By *[Signature]*
 Miami Dade Product Control

Approved as complying with the Florida Building Code
 Date 06/23/2011
 NOA# 11-0127-02
 Miami Dade Product Control
 By *[Signature]*



TITLE/CUSTOMER DETAILS FOR STORM SHIELD HURRICANE BARRIERS "READY MOUNT UNITS" 4' X 6' ENHANCED TRIPLE (FACE MOUNT)		WWW.STORMSHIELD.NET		DRAWN BY: RBM
SCALE: NTS	DATE: 5/5/11			REVISED 1
PRODUCT CONTROL CODE:				TR#A3082.01-109-18
242 W. 8TH ST. WYOMING PA 18644		800-972-2478 FAX (570) 693-2575		DRAWING NO. SSHB-EHB
PAGE 8 OF 12				

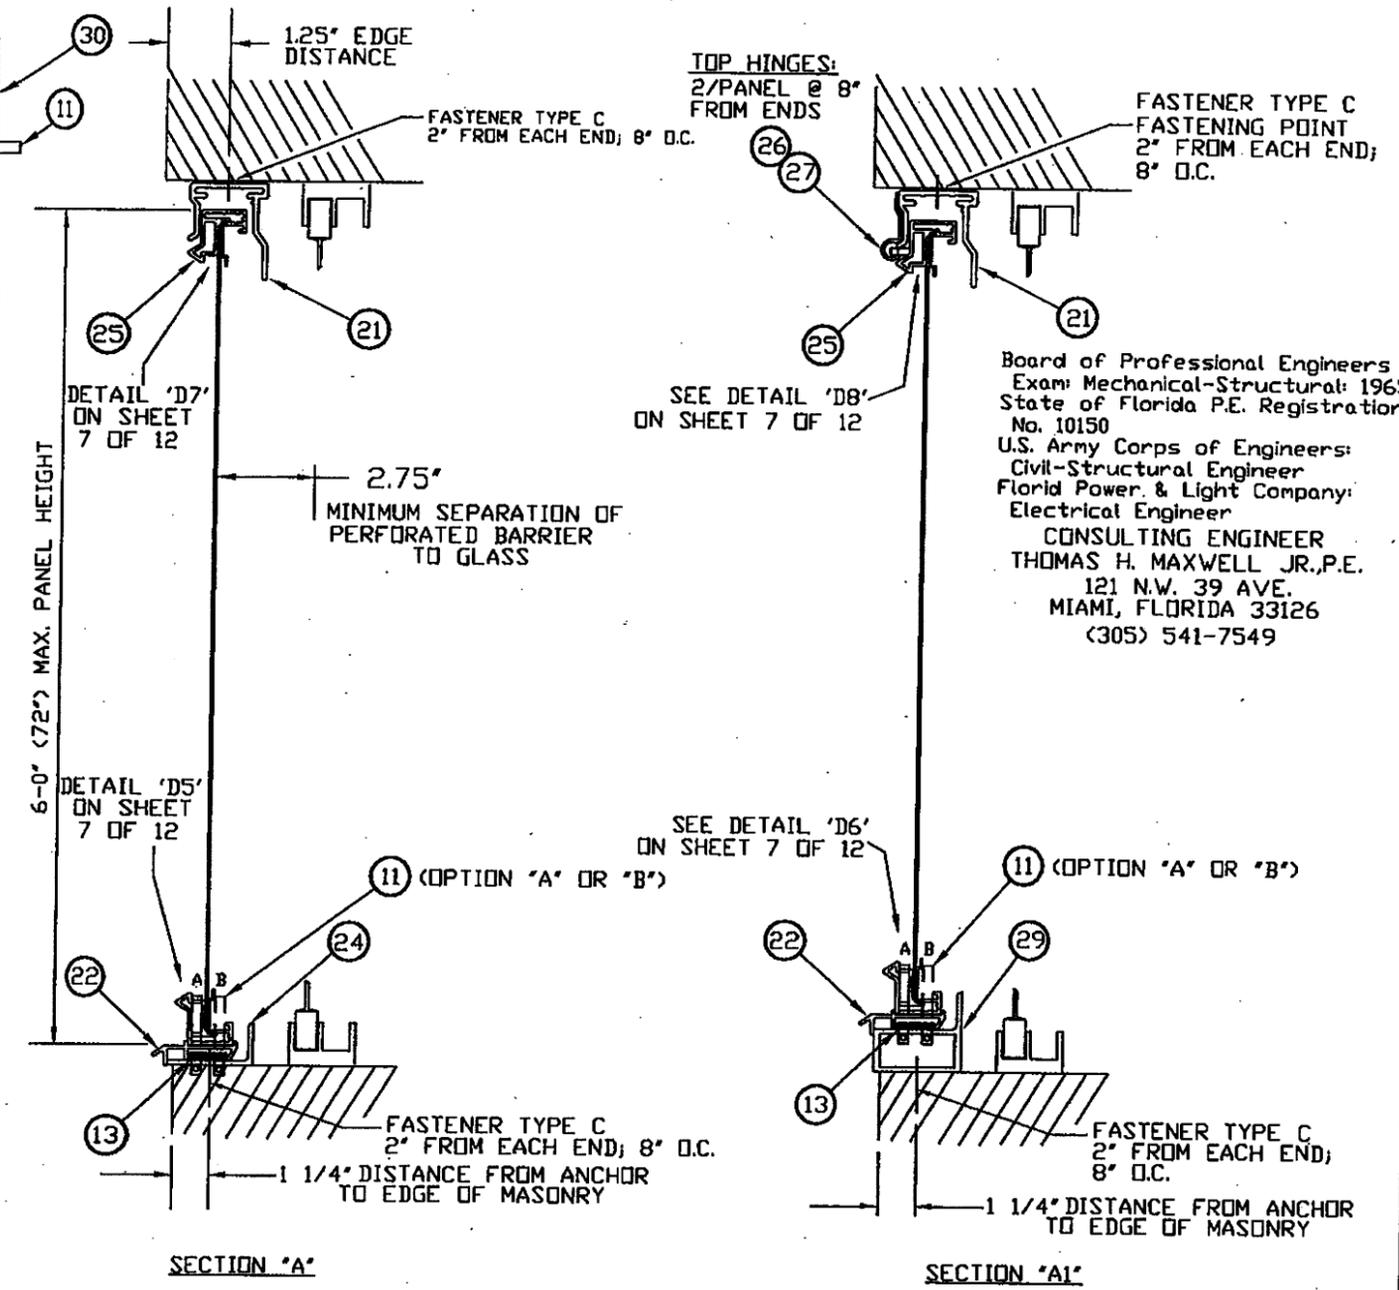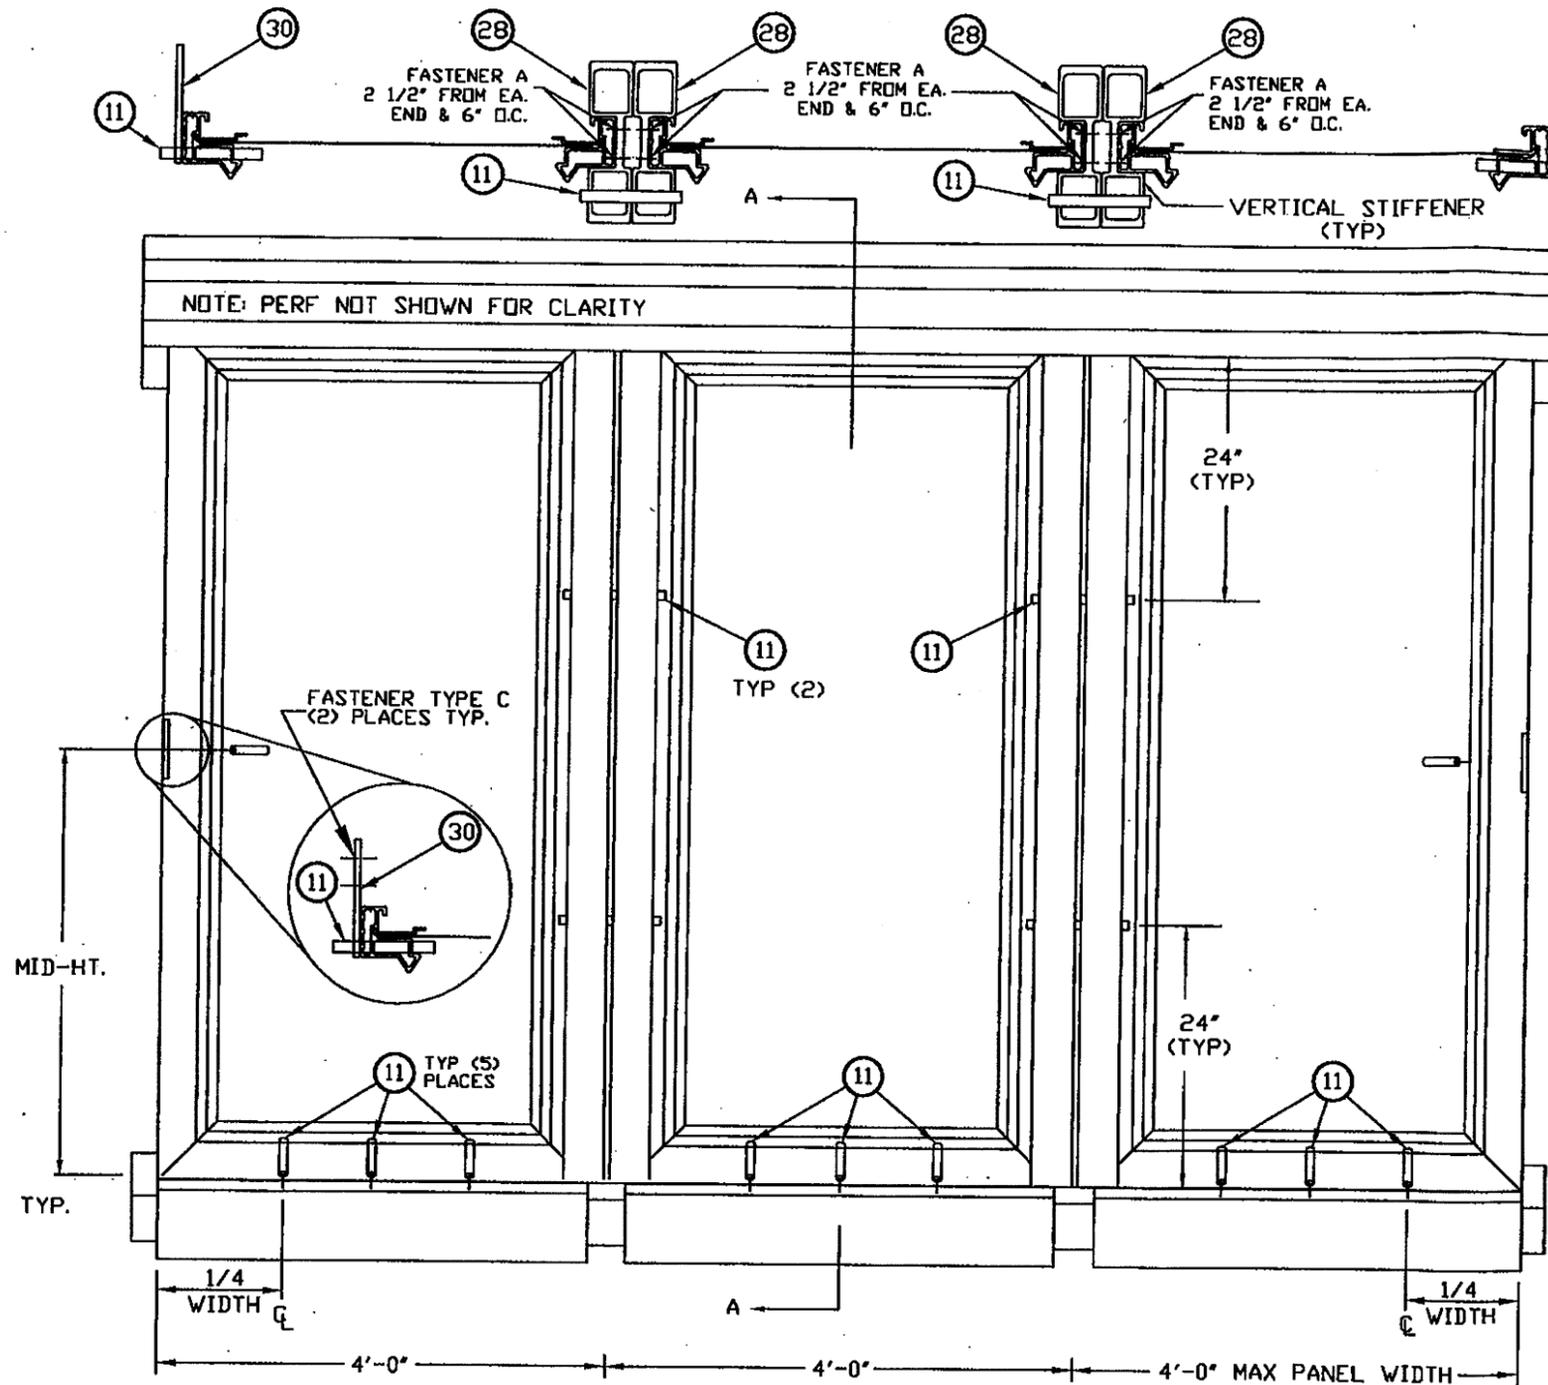

Board of Professional Engineers
 Exam: Mechanical-Structural: 1965
 State of Florida P.E. Registration
 No. 10150
 U.S. Army Corps of Engineers:
 Civil-Structural Engineer
 Florida Power & Light Company:
 Electrical Engineer
CONSULTING ENGINEER
 THOMAS H. MAXWELL JR., P.E.
 121 N.W. 39 AVE.
 MIAMI, FLORIDA 33126
 (305) 541-7549

MAT. TYPE	DESIGN PRESSURE RATING	
	POS. (PSF.)	NEG. (PSF.)
STAINLESS STEEL	124	124

- NOTES:**
- SECTION "A" IS STANDARD LAYOUT, WHILE SECTION "A1" SHOWS OPTIONAL FEATURES.
 - FASTENER TYPE A: #10 X 5/8" SS TEK SCREW
 - FASTENER TYPE B: #10 X 3/4" SS TEK SCREW
 - FASTENER TYPE C: 1/4"Ø X 1-3/4" ELCO TAPCON WITH 1.75" MINIMUM EMBEDMENT WITH FILLED CELLS.
 - SEE PAGE 11 & 12 FOR EXTRUSION DETAILS


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 12-1019-20
 Expiration Date 6/23/2016
 By *[Signature]*
 Miami Dade Product Control

Approved as complying with the
 Florida Building Code
 Date 06/23/2011
 NOA# 11-0127-02
 Miami Dade Product Control
 By *[Signature]*




TITLE/CUSTOMER DETAILS FOR STORM SHIELD HURRICANE BARRIERS "READY MOUNT UNITS" 4' X 6' ENHANCED TRIPLE (INSET MOUNT)		DRAWN BY: RBM	
SCALE: NTS	WWW.STORMSHIELD.NET	REVISED 1	
DATE: 5/5/11		TR#A3082.01-109-18	
PRODUCT CONTROL CODE:		242 W. 8TH ST. WYOMING PA 18644	800-972-2478 FAX (570) 693-2575
		DRAWING NO. SSHB-EHB	
		PAGE 9 OF 12	

HURRICANE BARRIER SUBFRAME ASSEMBLY DETAILS

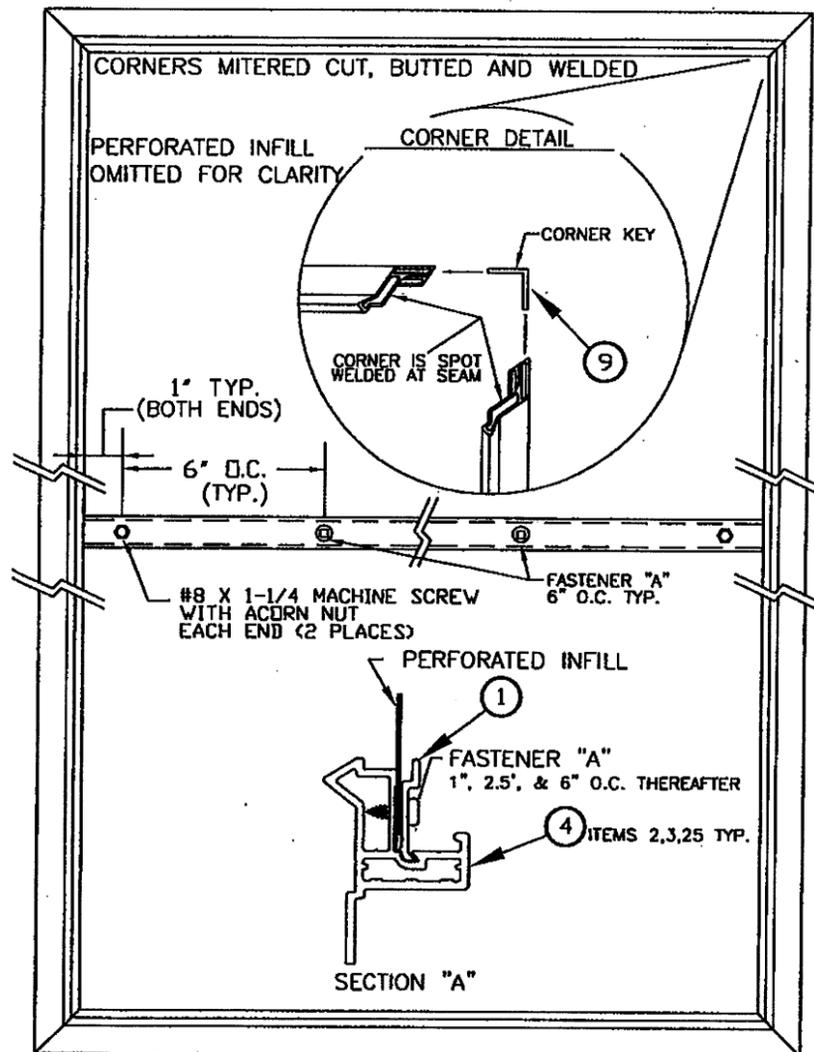


PANEL FRONT

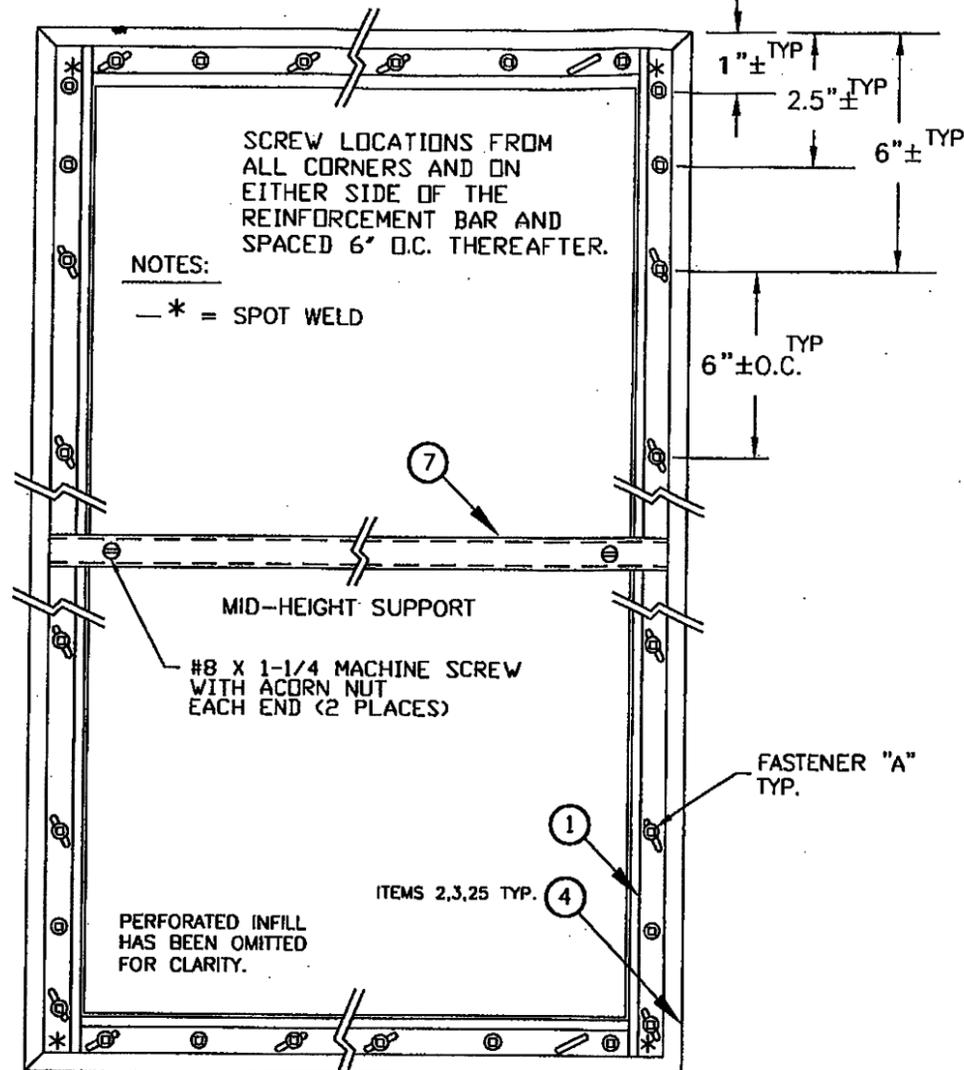

PANEL REAR

1 x 2 OUTER FRAME ASSEMBLY DETAILS

CORNERS MITERED CUT, BUTTED AND WELDED

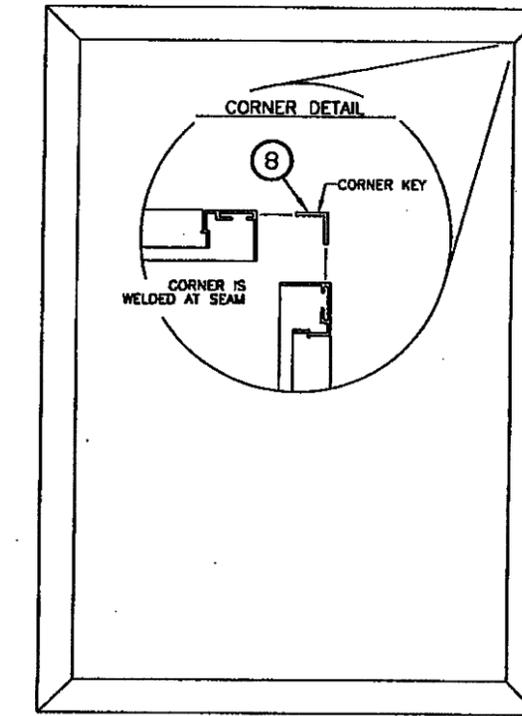

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-1019.20
 Expiration Date 6/23/2016
 By *[Signature]*
 Miami Dade Product Control


Approved as complying with the
 Florida Building Code
 Date 06/23/2011
 NOA# 11-0127-02
 Miami Dade Product Control
 By *[Signature]*

[Handwritten Signature]
 5-17-11

HARDWARE
 FASTENER A



FASTENER A
 #10X5/8" LONG
 ROBERTSON HEAD
 SELF-TAPPING SCREW
 1" & 2.5" FROM CORNER
 AND 6" O.C. THEREAFTER

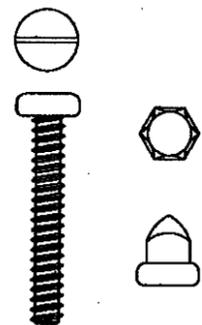

MACHINE SCREW
 #8 X 1-1/4 SS
 WITH ACORN NUT
 1" FROM EA. END
 OF MID-HEIGHT SUPP.

1 X 1 X 1/8 MIDHEIGHT SUPPORT:
 REQUIRED FOR 5 X 7 ONLY

CONSULTING ENGINEER
 THOMAS H. MAXWELL JR., P.E.
 121 N.W. 39 AVE.
 MIAMI, FLORIDA 33126
 (305) 541-7549
 Board of Professional Engineers
 Exam: Mechanical-Structural: 1965
 State of Florida P.E. Registration
 No. 10150
 U.S. Army Corps of Engineers:
 Civil-Structural Engineer
 Florid Power & Light Company:
 Electrical Engineer

TITLE/CUSTOMER

HURRICANE BARRIER SUBFRAME ASSEMBLY DETAILS

SCALE: NTS

DATE: 5/5/11



DRAWN BY: RBM
 REVISED 1


242 W. 8TH ST.
 WYOMING PA 18644

PRODUCT CONTROL CODE:


800-972-2478
 FAX (570) 693-2575

DRAWING NO. SSHB-EHB


PAGE 10 OF 12




① **BARRIER RAIL**
TYP. WALL 0.050
6063 T5 ALLOY




② **ENHANCED SUBFRAME W/STOP**
TYP. WALL .080
6063 T5 ALLOY




③ **ENHANCED SUBFRAME**
TYP. WALL .080
6063 T5 ALLOY




④ **1 X 2 SUBFRAME**
TYP. WALL = .060
6063 T5 ALLOY




⑤ **1 X 2 OUTER FRAME**
TYP. WALL = .080
6063 T5 ALLOY

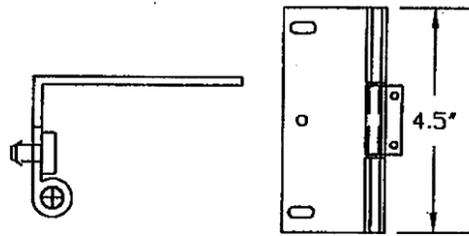


⑥ **HIDDEN HINGE**
THICKNESS = .090
304 STAINLESS STEEL




⑦ **MID-HEIGHT SUPPORT TUBE**
TYP. WALL .125
6063 T5 ALLOY



⑧ **2 X 1.5 CLIP ANGLE**
2 X 1.5 X .125 ANGLE
6063 T5 ALLOY




⑨ **CORNER KEY**
TYP. WALL = .095
6063 T5 ALLOY
(INTERNAL PART)




⑩ **2 X 2 TUBE**
2.000" X 2.000"
X .125" TUBE
6063 T5 ALLOY




⑪ **#14 SHEET METAL SCREW**
LENGTH = 2.5"
OPTION A 18-8 STAINLESS STEEL




⑪ **SECURING PIN**
TYP. DIA. .25"
OPTION B 304 STAINLESS STEEL

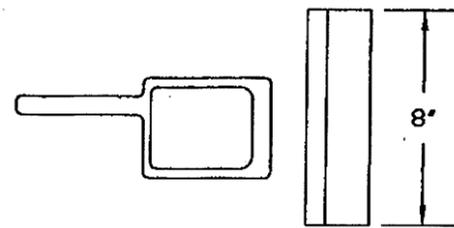


⑫ **SINGLE HOLLOW**
TYP. WALL .094
6063 T5 ALLOY




⑬ **PIN REINFORCEMENT**
TYP. THK. .079
304 STAINLESS STEEL
"PIN LOCATOR"




⑭ **CHANNEL (TUBE MOUNTING)**
TYP. WALL .125
6063 T5 ALLOY

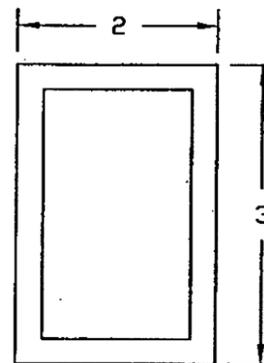

⑮ **BUILD-OUT TUBE**
2.000" X 3.000"
X .250" TUBE
6061 T5 ALLOY

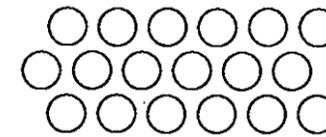

Ø.183

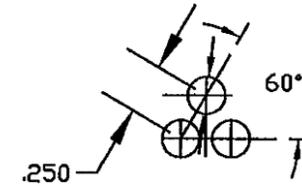

PERFORATED PATTERN:
.1875Ø HOLES ON .25" STAG PATTERN
INVISIPERF II
FULL SCALE

MATERIAL:
.079" (NOMINAL THICKNESS)
GALVANNEALED STEEL
STRUCTURAL QUALITY GRADE
33 WITH A60 GALVANNEAL
COATING PER ASTM A653
FINISHED WITH POLYESTER
POWDER COAT.
.0705" (MIN. THICKNESS)

(GALVANNEALED OPTION NOT
AVAILABLE FOR ALL UNITS)

OPTIONAL MATERIAL:
.079" (NOMINAL THICKNESS)
STAINLESS STEEL
PREPARED USING
ASTM A240 SPECIFICATION.
WITH THESE MIN. REQUIREMENTS
-TENSILE STRENGTH - 75 ksi. MIN.
-YIELD STRENGTH - 58 ksi. MIN.
-ELONGATION - 40% IN 2" MIN.
-HARDNESS - 92 rb MAX.
FINISHED WITH WEATHER
RESISTANT, HIGH PERFORMANCE
ELECTRO-STATIC APPLIED
COATING.
.0711" (MIN. THICKNESS)


CONSULTING ENGINEER
THOMAS H. MAXWELL JR., P.E.
121 N.W. 39 AVE.
MIAMI, FLORIDA 33126
(305) 541-7549

Board of Professional Engineers
Exam: Mechanical-Structural: 1965
State of Florida P.E. Registration
No. 10150
U.S. Army Corps of Engineers:
Civil-Structural Engineer
Florida Power & Light Company:
Electrical Engineer


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-1019-20
Expiration Date 6/23/2016

By *[Signature]*
Miami Dade Product Control
Approved as complying with the
Florida Building Code
Date 06/23/2011
NOA# 11-0127-02
Miami Dade Product Control


By *[Signature]*

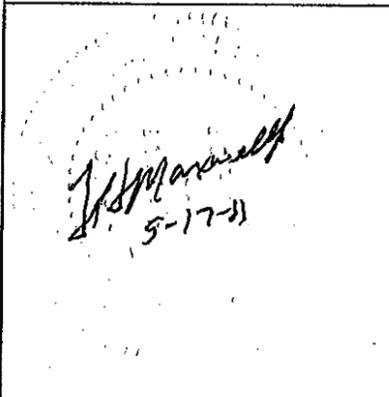


TITLE/CUSTOMER		
TYPICAL EXTRUSION DETAILS FOR STORM SHIELD		
SCALE: NTS		DRAWN BY: RBM
DATE: 5/5/11		REVISED 1
242 W. 8TH ST. WYOMING PA 18644		800-972-2478 FAX (570) 693-2575
PRODUCT CONTROL CODE:		DRAWING NO. S5HB-EHB
PAGE 11 OF 12		

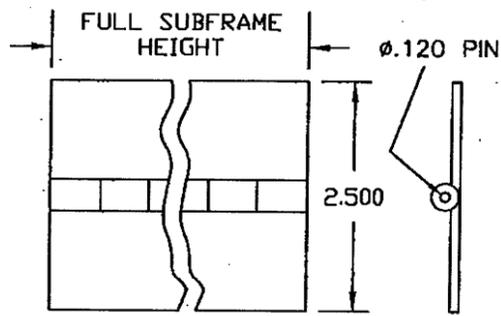


16 CONTINUOUS HINGE
 .075" THK. 304 STAINLESS STEEL




17 1.5 X .75 C-CHANNEL
 TYP. WALL .125
 6063 T5 ALLOY




18 STOP ANGLE
 TYP. WALL 0.094
 6063 T5 ALLOY

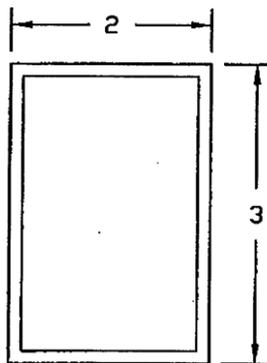


19 BUILD-OUT TUBE
 2.000" X 3.000"
 X .125" TUBE
 6063 T5 ALLOY

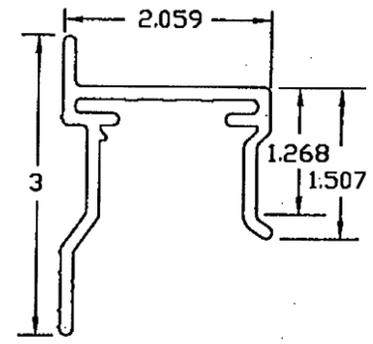


20 FACE MOUNT HEADER
 TYP. WALL .095
 6063 T5 ALLOY

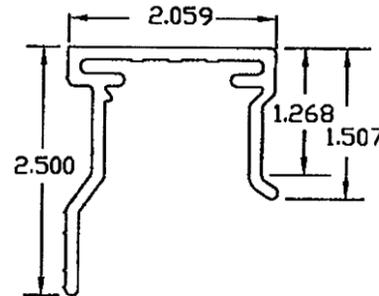


21 INSET MOUNT HEADER
 TYP. WALL .095
 6063 T5 ALLOY




22 MOD. BARRIER BRACKET
 TYP. WALL .080
 6063 T5 ALLOY




23 STANDARD BARRIER BRACKET
 TYP. WALL .080
 6063 T5 ALLOY




24 SILL BRACKET
 TYP. WALL .125
 6063 T5 ALLOY




25 SURROUND FRAME
 TYP. WALL .080
 6063 T6 ALLOY




26 TOP HINGE PART A
 TYP. WALL .070
 6063 T5 ALLOY

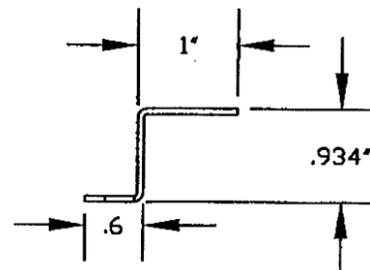

27 TOP HINGE PART B
 TYP. WALL 13 GA.
 STAINLESS STEEL

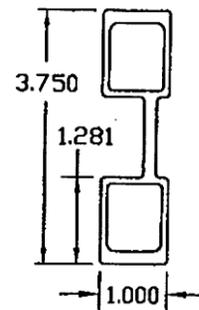


28 VERTICAL STIFFENER
 TYP. WALL = .0938
 6063 T5 ALLOY
 "DOUBLE HOLLOW"

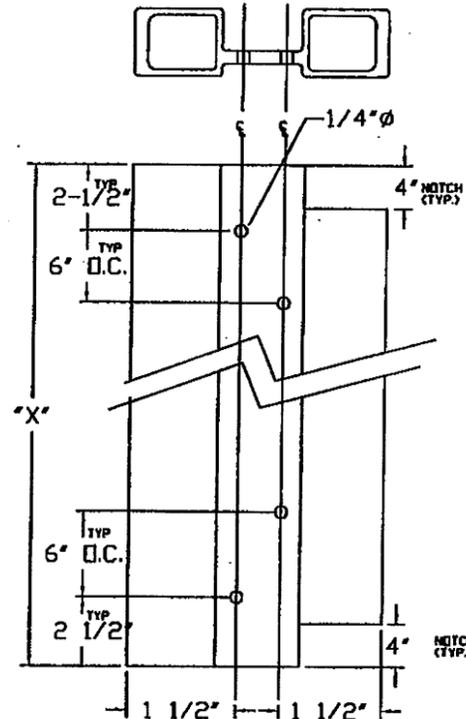


NOTE: SPACING BETWEEN LAST TWO FASTENER HOLES WILL VARY IN THE MIDDLE OF THE EXTRUSION

FACE/INSET READY MOUNT
 VERTICAL STIFFENER HOLE LOCATIONS



29 SECURITY SILL BRACKET
 TYP. WALL .125
 6063 T5 ALLOY

30 MID-HEIGHT SUPPORT FLAT
 ALUMINUM FLAT
 2.000 X 3.000 X .125
 6063 T5 ALLOY



CONSULTING ENGINEER
 THOMAS H. MAXWELL JR., P.E.
 121 N.W. 39 AVE.
 MIAMI, FLORIDA 33126
 (305) 541-7549

Board of Professional Engineers
 Exam: Mechanical-Structural: 1965
 State of Florida P.E. Registration
 No. 10150
 U.S. Army Corps of Engineers:
 Civil-Structural Engineer
 Florid Power & Light Company:
 Electrical Engineer

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-1019-20
 Expiration Date 6/23/2016

By *[Signature]*
 Miami Dade Product Control
 Approved as complying with the
 Florida Building Code
 Date 06/23/2011
 NOA# 11-0127-02
 Miami Dade Product Control
 By *[Signature]*

[Signature]
 5-17-11

TITLE/CUSTOMER		TYPICAL EXTRUSION DETAILS FOR STORM SHIELD (CONT'D)	
SCALE:	NTS	WWW.STORMSHIELD.NET	DRAWN BY: RBM
DATE:	5/5/11		REVISED 1
242 W. 8TH ST. WYOMING PA 18644			800-972-2478 FAX (570) 693-2575
PRODUCT CONTROL CODE:		DRAWING NO. SSHB-EHB	
PAGE 12 OF 12			