



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/economy

Sol-A-Trol Aluminum Products
4101 NW 132nd Street
Opa Locka, FL 33054

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "3000/ 3062" Aluminum Fixed Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W05-08**, titled "Series 3000/ 3062 Alum Fixed Wdw. (L.M.I.)", sheets 01 through 07 of 07, dated 02/16/05 with revision "E" dated 05/06/13, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E., bearing the Miami-Dade County Product Control Section Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. **10-0920.14** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
7/15/13

NOA No. 13-0206.12
Expiration Date: November 03, 2015
Approval Date: July 25, 2013
Page 1

Sol-A-Trol Aluminum Products, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under previous NOA No. 10-0920.14)
2. Drawing No. **W05-08**, titled "Series 3000/ 3062 Alum Fixed WDW. (L.M.I.)", sheets 1 through 7 of 7, dated 02/16/05 with revision "E" dated 05/06/13, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
along with marked-up drawings and installation diagram of series 3000/ 3062 aluminum fixed/ projected-out window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-08-2205A**, dated 11/10/08, signed and sealed by Candido F. Font, P. E.
(Submitted under previous NOA No. 10-0920.14)
2. Test reports on: 1) Large Missile Impact Test, per FBC, TAS 202-94
2) Cyclic Wind Pressure Loading per FBC, TAS 202-94
along with marked-up drawings and installation diagram of series 3000/ 3062 aluminum fixed/ projected-out window, prepared by Hurricane Engineering & Testing Inc., Test Reports No.'s **HETI-08-2205A, HETI-08-2205B, HETI-08-2206, HETI-08-2207, HETI-08-2153B, HETI-07-4387, HETI-08-2089B, HETI-07-4397, HETI-07-4396, HETI-08-2233 & HETI-08-2085**, dated 11/10/08 to 12/30/08, signed and sealed by Candido F. Font, P. E.
(Submitted under previous NOA No. 10-0920.14)
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of series 3000/ 3062 aluminum fixed/ projected-out window, prepared by Hurricane Engineering & Testing Inc., Test Reports No.'s **HETI-08-2089A, HETI-08-2153A, HETI-07-4388, HETI-07-4389** and **HETI-08-2081**, dated 11/10/08, signed and sealed by Candido F. Font, P. E.
(Submitted under previous NOA No. 10-0920.14)
4. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
along with marked-up drawings and installation diagram of series 3000/ 3062 aluminum fixed/ projected-out window zero mullion, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-08-2234**, dated 12/30/08, signed and sealed by Candido F. Font, P. E.
(Submitted under previous NOA No. 10-0920.14)


Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 13-0206.12
Expiration Date: November 03, 2015
Approval Date: July 25, 2013

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (CONTINUED)

5. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of series 3062 aluminum fixed/casement window of XXO configuration, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-04-1409** and **HETI-04-1410**, dated 09/28/04, revised on 03/16/05, signed and sealed by Ivonne Ghia, P. E.
(Submitted under previous NOA No. 05-0414.01)
6. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of series 3062 aluminum fixed/casement window of XXO configuration, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI - 04 - 1918D**, **HETI - 04 - 1918A**, **HETI-04-1918B**, **HETI-04-1918C** and **HETI-04-1918E**, dated 09/28/04, revised on 03/16/05, signed and sealed by Ivonne Ghia, P. E.
(Submitted under previous NOA No. 05-0414.01)

C. CALCULATIONS


1. Anchor verification calculations and structural analysis, complying with **FBC-2010**, prepared by Al-Farooq Corporation, dated 07/20/12, signed and sealed by Javad Ahmad, P. E.
2. **Glazing complies with ASTM E1300-04**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **11-0624.01** issued to **E.I. DuPont DeNemours & Co., Inc.** for their "**DuPont Butacite® PVB Interlayer**" dated 09/08/11, expiring on 12/11/16.
2. Notice of Acceptance No. **11-0624.02** issued to **E.I. DuPont DeNemours & Co., Inc.** for their "**DuPont SentryGlas® Interlayer**" dated 08/25/11, expiring on 01/14/17.
3. Notice of Acceptance No. **12-1231.08** issued to **Eastman Chemical Company (MA)** for their "**Saflex CP - Saflex and Saflex HP Composite Glass Interlayers with PET Core**" dated 03/28/13, expiring on 12/11/18.
4. Notice of Acceptance No. **12-1231.09** issued to **Eastman Chemical Company (MA)** for their "**Saflex HP Clear or Color Glass Interlayers**" dated 03/28/13, expiring on 12/11/18.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 13-0206.12
Expiration Date: November 03, 2015
Approval Date: July 25, 2013

Sol-A-Trol Aluminum Products, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS


1. Statement letter of no financial interest, conformance and complying with **FBC-2010**, issued by Al-Farooq Corporation, dated 07/20/12, signed and sealed by Javad Ahmad, P. E.
2. Laboratory addendum letter for Test Report No. **HETI-08-2089A**, issued by Hurricane Engineering & Testing, Inc., dated 09/22/08, signed and sealed by Candido F. Font, P. E.
(Submitted under previous NOA No. 10-0920.14)
3. Laboratory compliance letter for Test Reports No.'s **HETI-08-2205A, HETI-08-2205B, HETI-08-2206, HETI-08-2207, HETI-08-2153B, HETI-07-4387, HETI-08-2089B, HETI-07-4397, HETI-07-4396, HETI-08-2233, HETI-08-2205A, HETI-08-2085, HETI-08-2234, HETI-08-2089A, HETI-08-2153A, HETI-07-4388, HETI-07-4389** and **HETI-08-2081**, issued by Hurricane Engineering & Testing, Inc., dated 11/10/08 to 12/30/08, signed and sealed by Candido F. Font, P. E.
(Submitted under previous NOA No. 10-0920.14)
4. Department of State Certification of **SOL-A-TROL ALUMINUM PRODUCTS, INC.** as a for profit corporation, active and organized under the laws of the State of Florida, dated 12/28/06 and signed by Kurt S. Browning, Secretary of State.
(Submitted under previous NOA No. 05-0414.01)
5. Laboratory compliance letter for Test Report No.'s **HETI-04-1409, HETI-04-1410, HETI-04-1918D, HETI-04-1918A, HETI-04-1918B, HETI-04-1918C** and **HETI-04-1918E**, issued by Hurricane Engineering & Testing, Inc., dated 09/28/04, signed and sealed by Ivonne Ghia, P. E.
(Submitted under previous NOA No. 05-0414.01)

G. OTHERS


1. Notice of Acceptance No. **10-0920.14**, issued to Sol-A-Trol Aluminum Products, Inc. for their Series "**3000/ 3062**" **Aluminum Fixed Window - L.M.I.**", approved on 12/16/10 and expiring on 11/03/15.




Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 13-0206.12
Expiration Date: November 03, 2015
Approval Date: July 25, 2013

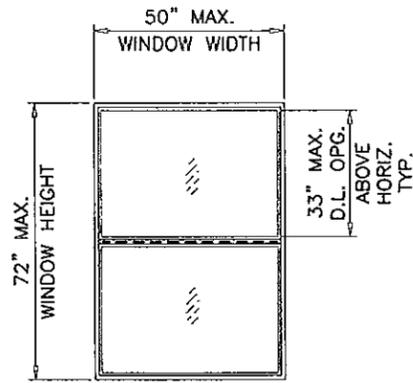


(O/O)

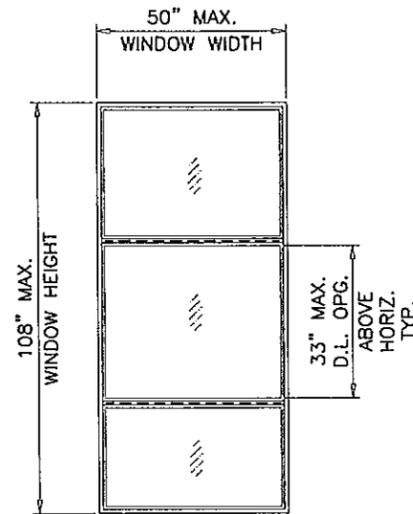

(O/O/O)

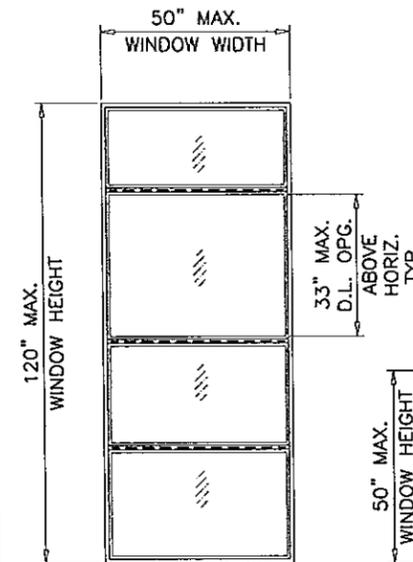



(O/O/O/O)

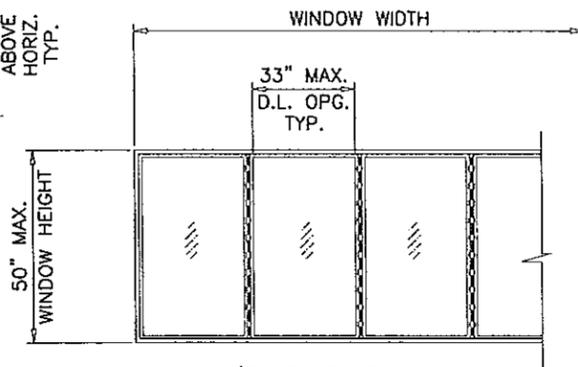

(O-O-O-O...)

APPROVED CONFIGURATIONS

MAXIMUM DESIGN LOADS FOR WINDOWS WITH IMPOSTS IS +80.0, -90.0 PSF FOR GLASS CAPACITY SEE CHART ON SHEET 3
LESSER VALUES FROM THE ABOVE WILL APPLY TO ENTIRE SYSTEM.

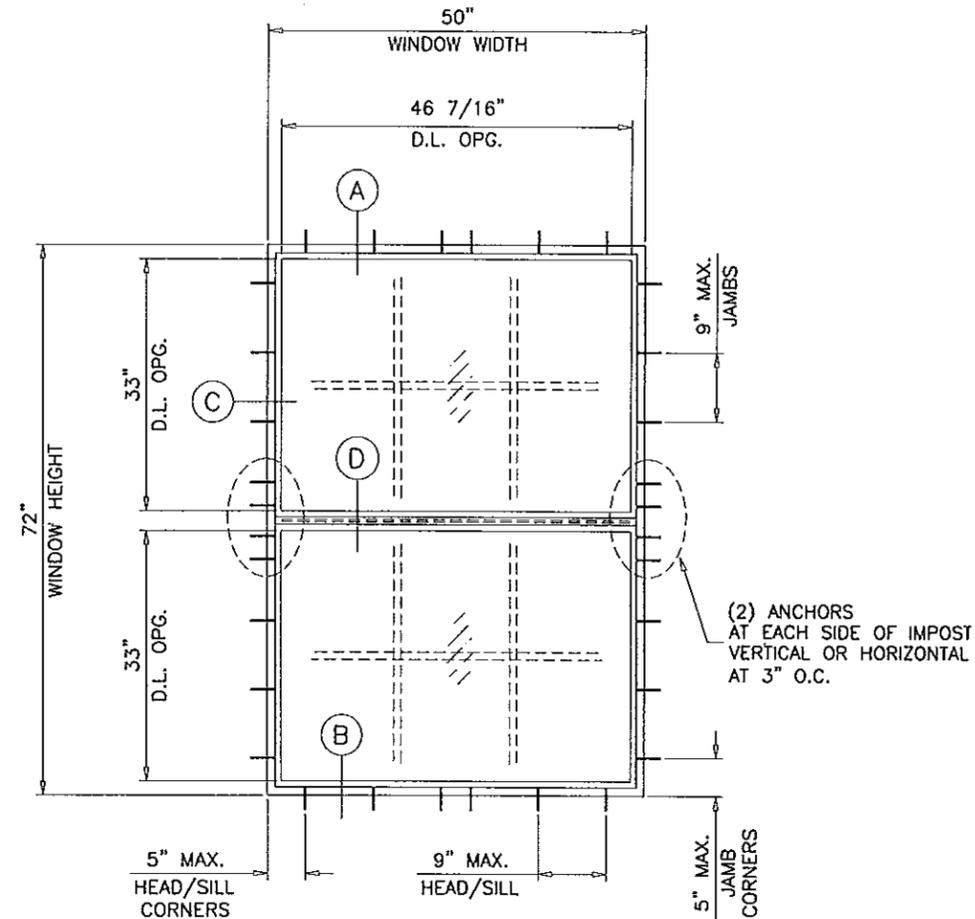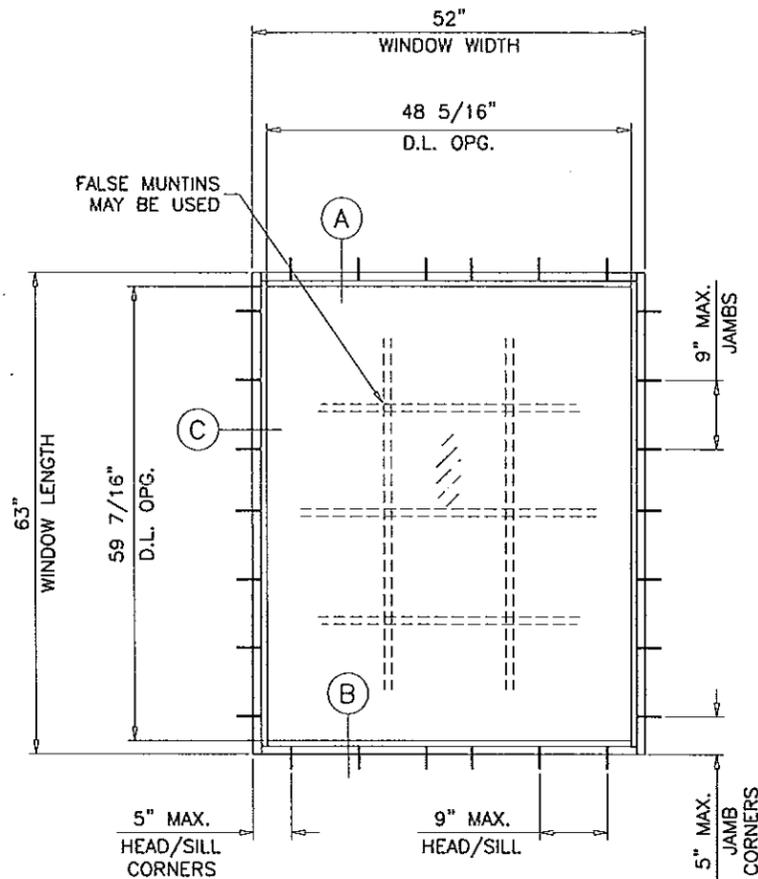

TYPICAL ELEVATIONS

**SERIES-3062/3000
ALUMINUM FIXED WINDOW**

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 3.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIXED/FIXED OR FIXED WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN.
LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BLDG. CODE SECTION 2003.8.4.

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 13-0206.12
Expiration Date 11/03/2015

By [Signature]
Miami Dade Product Control

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
[Signature]
JUN 25 2013


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W05-08SAT

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)
SOL-A-TROL ALUMINUM PRODUCTS INC.
4101 N.W. 132ND STREET
MIAMI, FL. 33054
TEL. (305) 681-2020 FAX. (305) 681-2035


no.	date	by	description
A	09.09.05		UPDATED FOR 2004 FBC
B	08.12.08		UPDATED FOR 2007 FBC
C	10.25.10		REV. PER BCCO COMMENTS
D	07.31.12		UPDATED TO 2010 FBC
E	05.06.13		NO CHANGE THIS SHEET

date: 02-16-05
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:


drawing no. **W05-08**
sheet 1 of 7

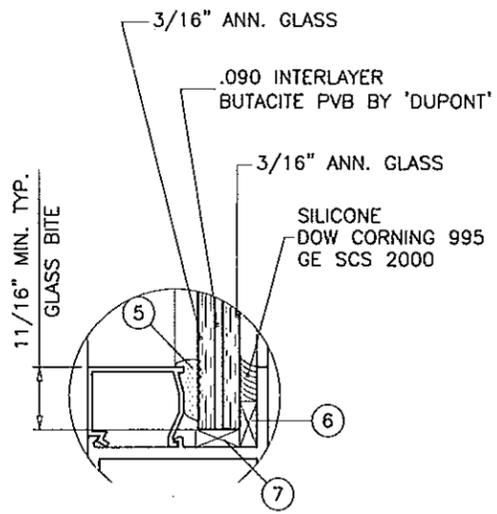


GLASS TYPE 'A'

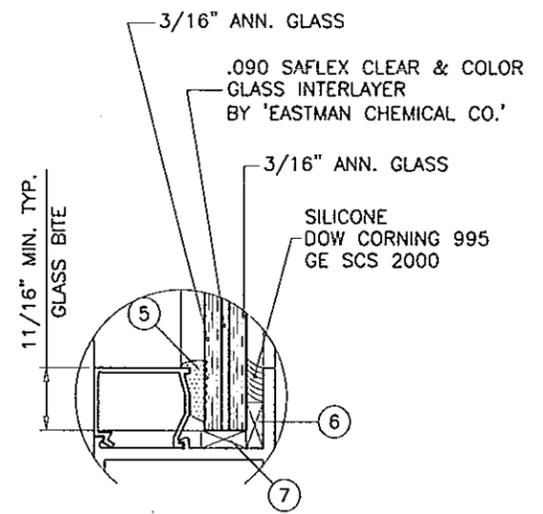


GLASS TYPE 'B'

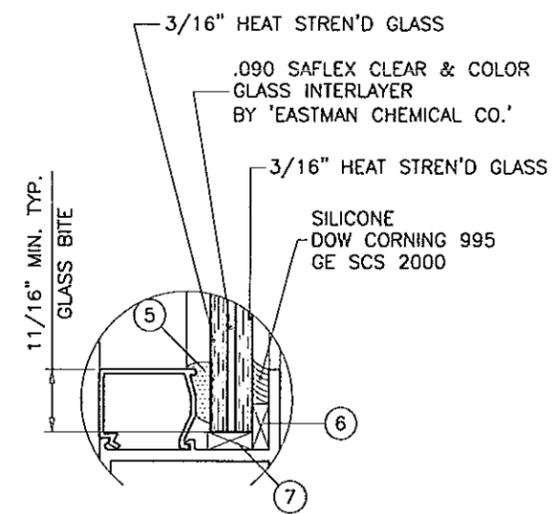


GLASS TYPE 'C'

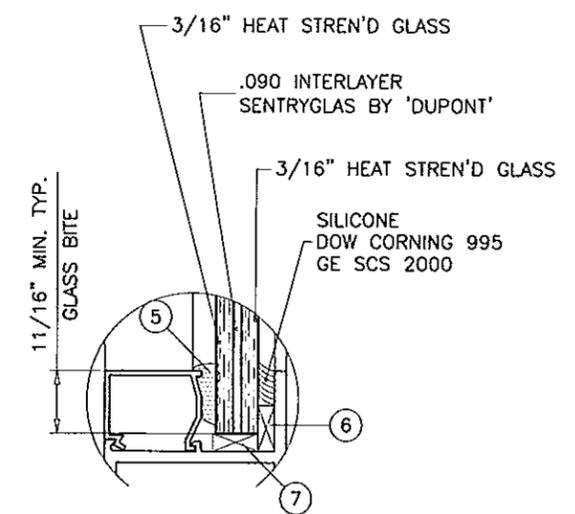


GLASS TYPE 'D'

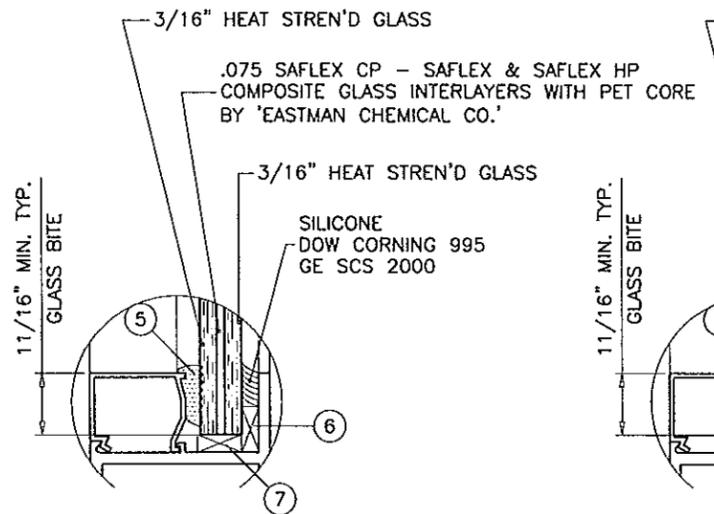

GLASS TYPE 'F'

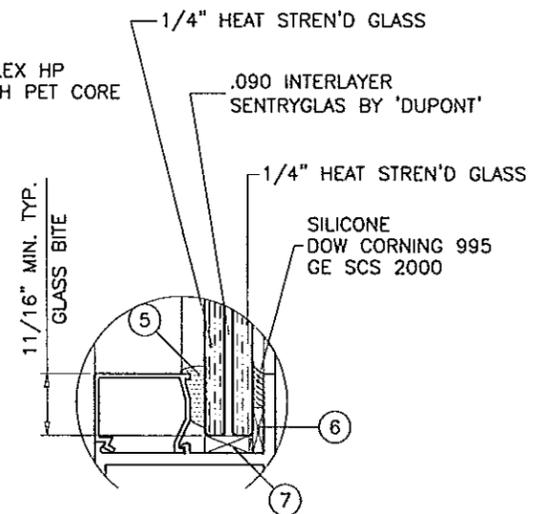

GLASS TYPE 'G'

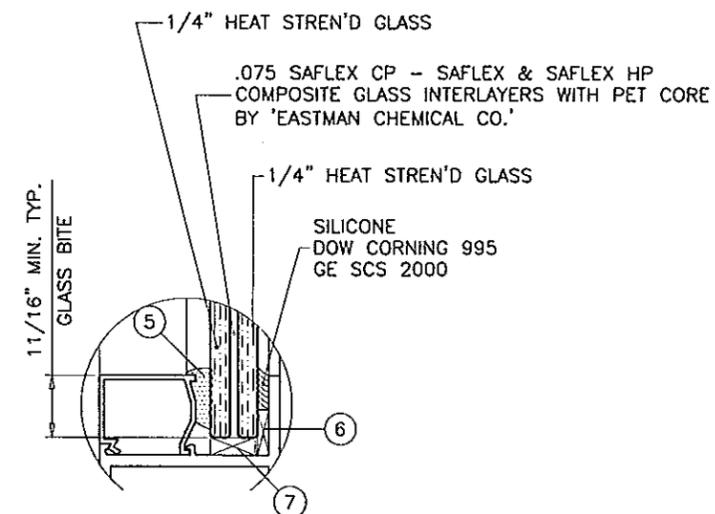

GLASS TYPE 'H'

GLAZING OPTIONS

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W05-08SAT

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)
SOL-A-TROL ALUMINUM PRODUCTS INC.
 4101 N.W. 132ND STREET
 MIAMI, FL. 33054
 TEL. (305) 681-2020 FAX. (305) 681-2035

no	date	by	description
B	08.12.08		UPDATED FOR 2007 FEC
C	10.25.10		NO CHANGE THIS SHEET
D	07.31.12		UPDATED TO 2010 FEC
E	05.06.13		REV. PER RER COMMENTS

date: 02-16-05	scale: 1/2" = 1"
dr. by: HAMID	chk. by:

drawing no.
W05-08
 sheet 2 of 7


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 13-0206.12
 Expiration Date 12/03/2015
 By [Signature]
 Miami Dade Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

 JUN 25 2013

DESIGN LOAD CAPACITY - PSF											
WINDOW DIMS.		GLASS TYPE 'A'&'B'		GLASS TYPE 'C'		GLASS TYPE 'D'		GLASS TYPE 'F'		GLASS TYPE 'G'&'H'	
WIDTH (W)	LENGTH (L)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24"	36"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
36"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
42"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
48"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
54"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	-	-
24"	42"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
36"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
42"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
48"		-	-	80.0	80.0	100.0	100.0	100.0	100.0	-	-
54"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
24"	48"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
36"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
42"		-	-	80.0	80.0	100.0	100.0	100.0	100.0	-	-
48"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
54"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
24"	54"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
36"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	-	-
42"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
48"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
54"		-	-	77.0	77.0	96.3	96.3	-	-	-	-
24"	60"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
36"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
42"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
48"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
54"		-	-	77.0	77.0	96.3	96.3	-	-	-	-
24"	66"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		-	-	80.0	80.0	100.0	100.0	100.0	100.0	-	-
36"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
42"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
48"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
54"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
24"	72"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
36"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
42"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
48"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
54"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
24"	76"	-	-	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
36"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
42"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
48"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
54"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
24"	84"	-	-	80.0	80.0	100.0	100.0	100.0	100.0	-	-
30"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
36"		-	-	80.0	80.0	100.0	100.0	-	-	-	-

DESIGN LOAD CAPACITY - PSF											
WINDOW DIMS.		GLASS TYPE 'A'&'B'		GLASS TYPE 'C'		GLASS TYPE 'D'		GLASS TYPE 'F'		GLASS TYPE 'G'&'H'	
WIDTH (W)	LENGTH (L)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
26-1/2"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
37"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
53-1/8"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
19-1/8"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
26-1/2"	38-3/8"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
37"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
53-1/8"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
19-1/8"	50-5/8"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
26-1/2"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
37"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
53-1/8"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
19-1/8"	63"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
26-1/2"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
37"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
19-1/8"	74-1/4"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
26-1/2"		-	-	80.0	80.0	100.0	100.0	100.0	100.0	-	-
37"		-	-	80.0	80.0	100.0	100.0	-	-	-	-

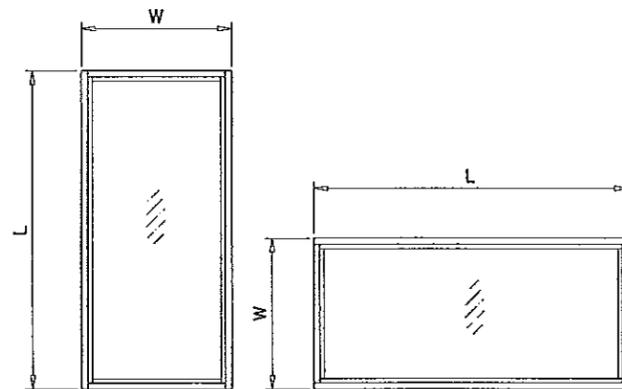

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS).

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 13-0206.12
Expiration Date 11/23/2015
By: *[Signature]*
Miami Dade Product Control





Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
[Signature]
JUN 25 2013

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8400 FAX. (305) 262-6978
COMP-ANL\W05-08SAT

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)
SOL-A-TROL ALUMINUM PRODUCTS INC.
4101 N.W. 132ND STREET
MIAMI, FL. 33054
TEL. (305) 681-2020 FAX. (305) 681-2035

no.	date	by	description
A	09.09.05		NOTE ADDED
B	08.12.08		UPDATED FOR 2007 FBC
C	10.25.10		NO CHANGE THIS SHEET
D	07.31.12		NO CHANGE THIS SHEET
E	10.06.13		NO CHANGE THIS SHEET

date: 02-16-05
scale: 1/2" = 1"
dr. by: HAMID
chk. by:
drawing no.
W05-08
sheet 3 of 7

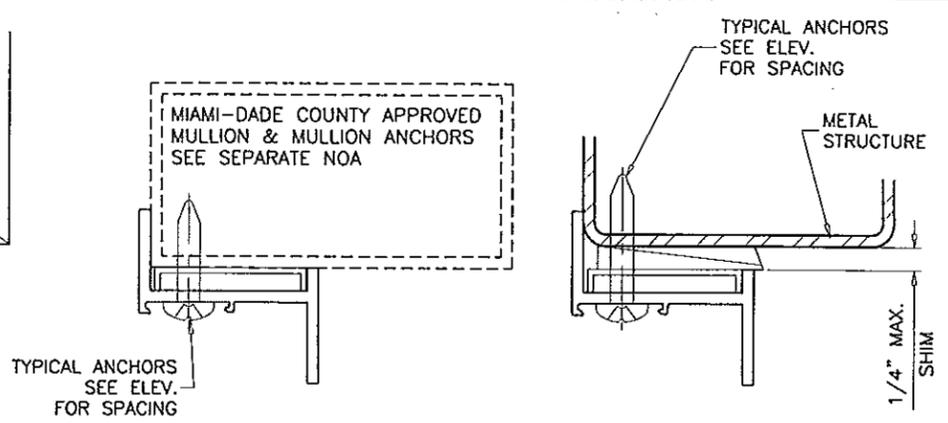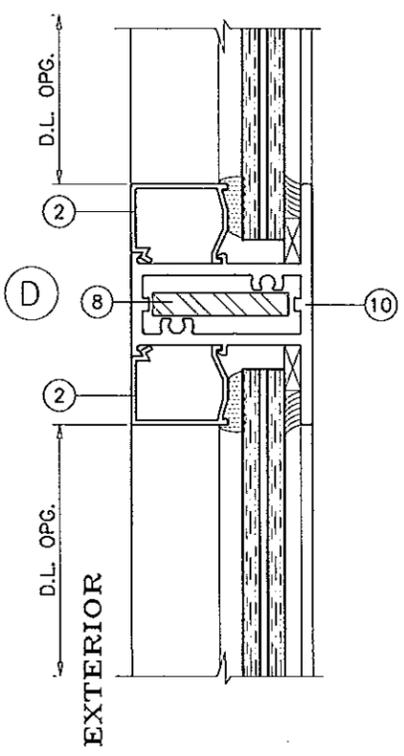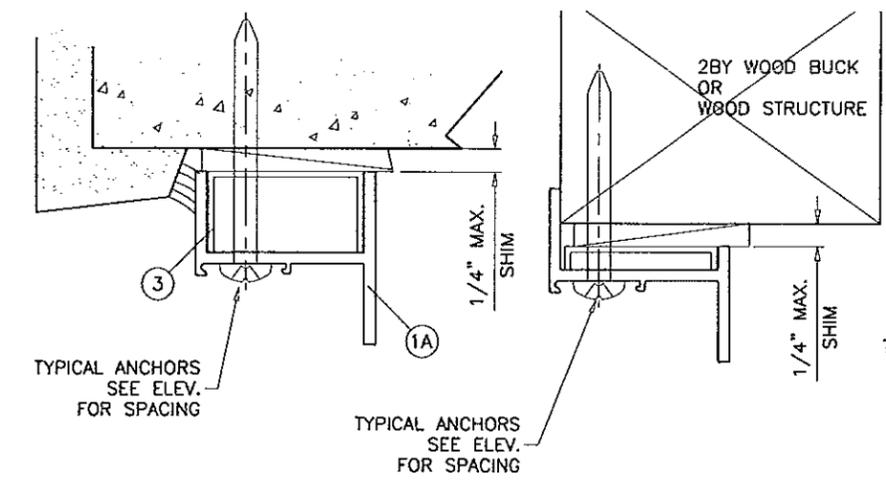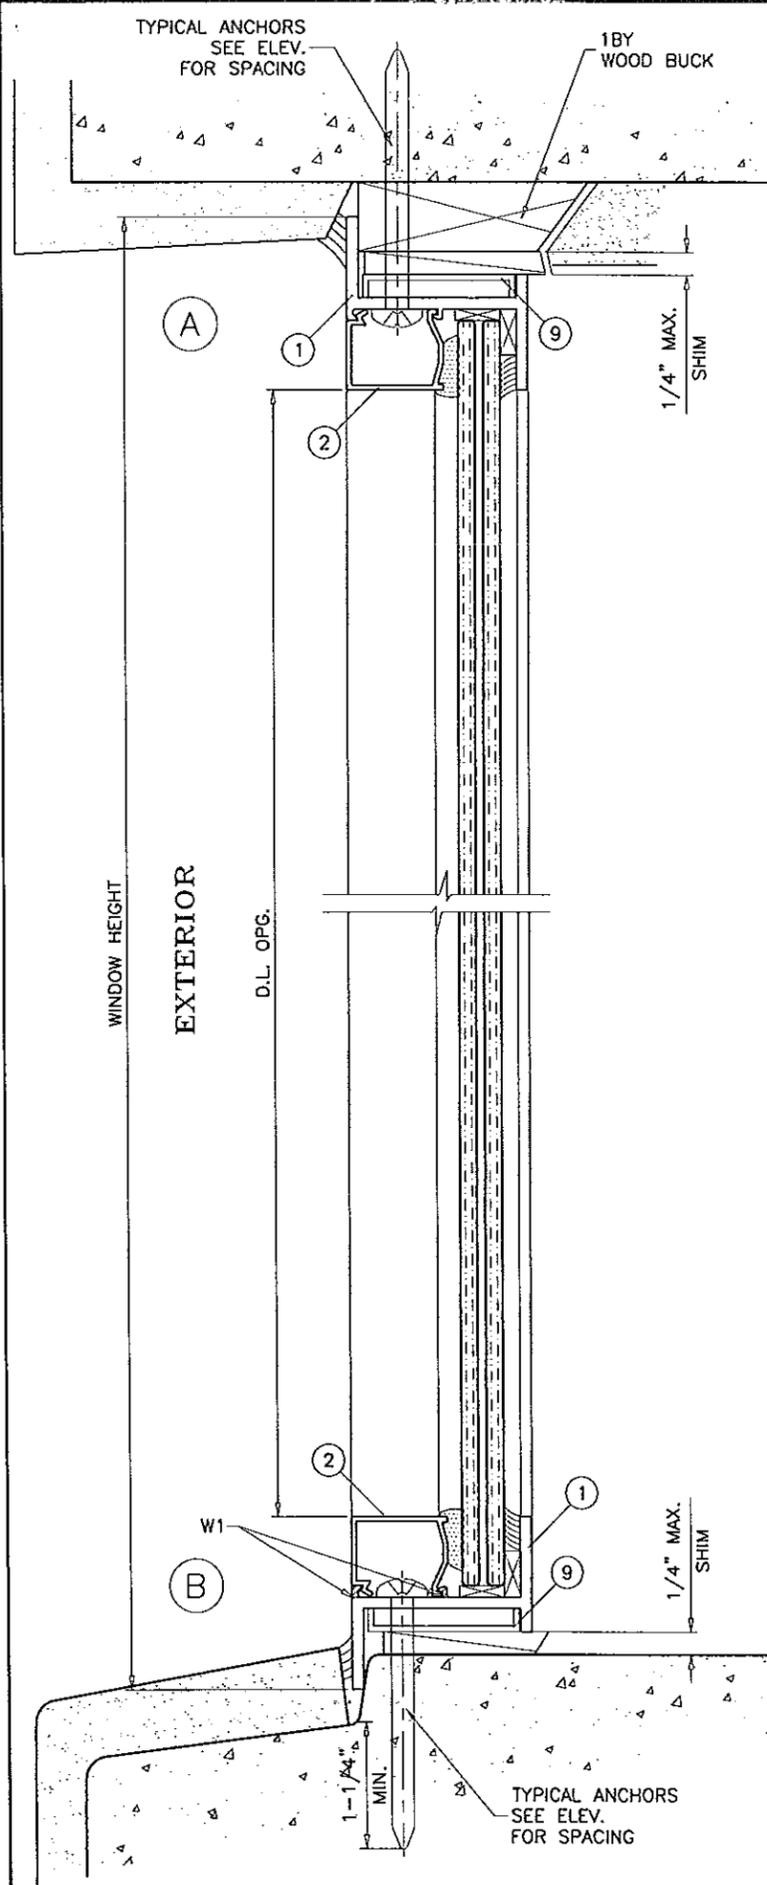

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO METAL STRUCTURES
 STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 (NO SHIM SPACE)
TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 1-1/4" MIN.
 INTO WOOD STRUCTURE = 7/16" MIN.
 INTO METAL STRUCTURE = 7/16" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

SEALANTS:
 ALL FRAME AND VENT CORNERS SEALED WITH JOINT SEALANT.

WEEPHOLES:
 W1 = 3/8" NOTCH AT 7" FROM EACH END

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No **13-0206-12**
 Expiration Date **11/03/2015**
 By *[Signature]*
 Miami Dade Product Control

FLANGE AND EQUAL LEG FRAMES CAN BE USED AT ALL ANCHORAGE CONDITIONS.

WOOD BUCKS AND METAL STRUCTURE NOT BY SOL-A-TROL MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

JUN 25 2013





af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-5100 FAX. (305) 262-6978
 COMP-ANL\W05-08SAT

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)
SOL-A-TROL ALUMINUM PRODUCTS INC.
 4101 N.W. 132ND STREET
 MIAMI, FL. 33054
 TEL. (305) 681-2020 FAX. (305) 681-2035

no	date	by	description
A	09.09.05		NO CHANGE THIS SHEET
B	08.12.08		UPDATED FOR 2007 FBC
C	10.25.10		REV. PER BCCO COMMENTS
D	07.31.12		UPDATED TO 2010 FBC
E	05.06.13		NO CHANGE THIS SHEET

date: 02-16-05
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no. **W05-08**
 sheet 4 of 7

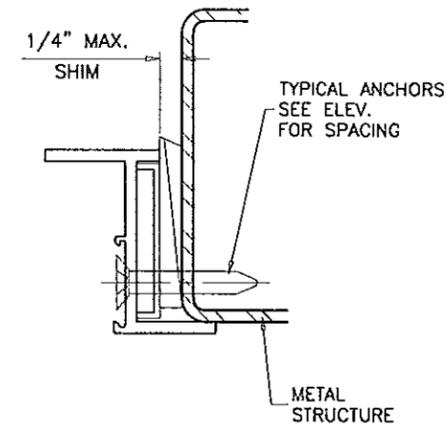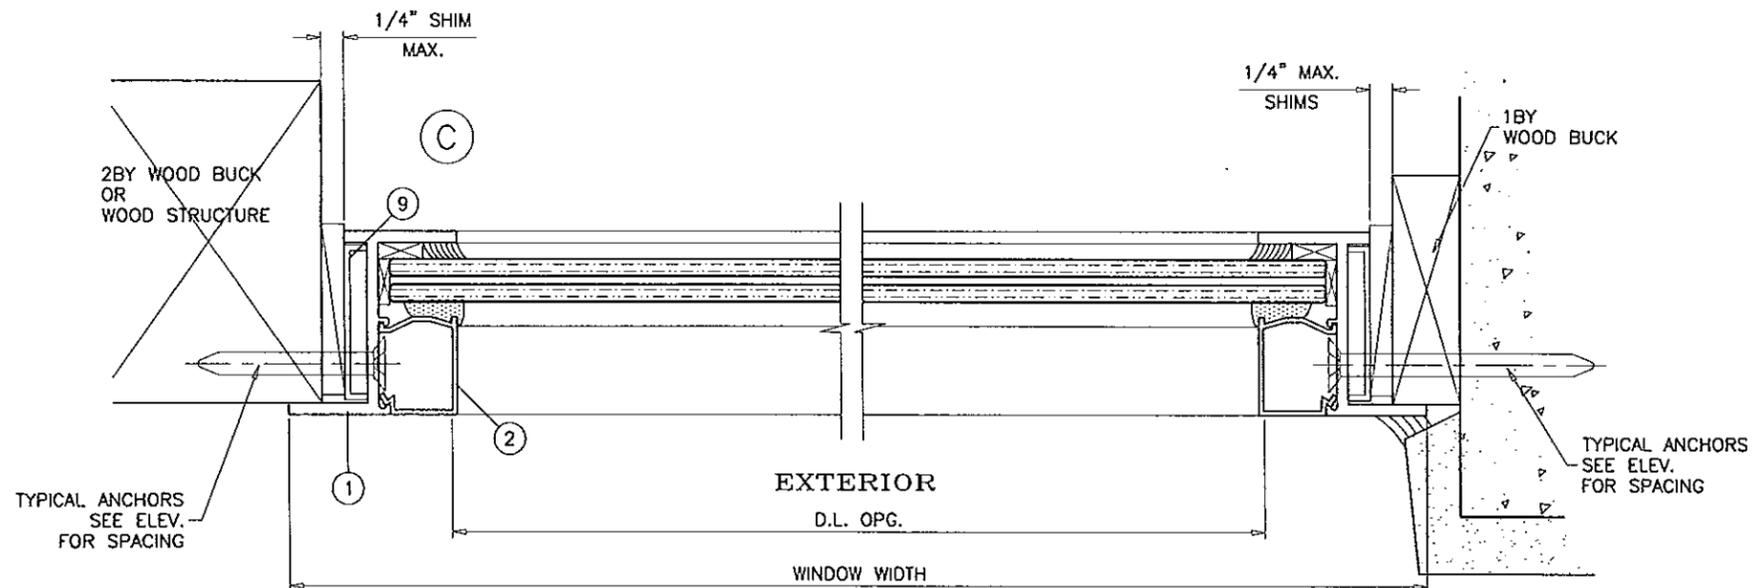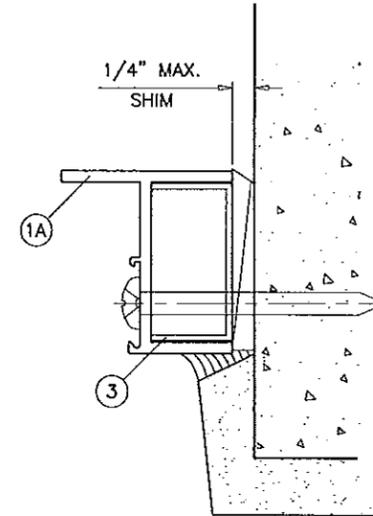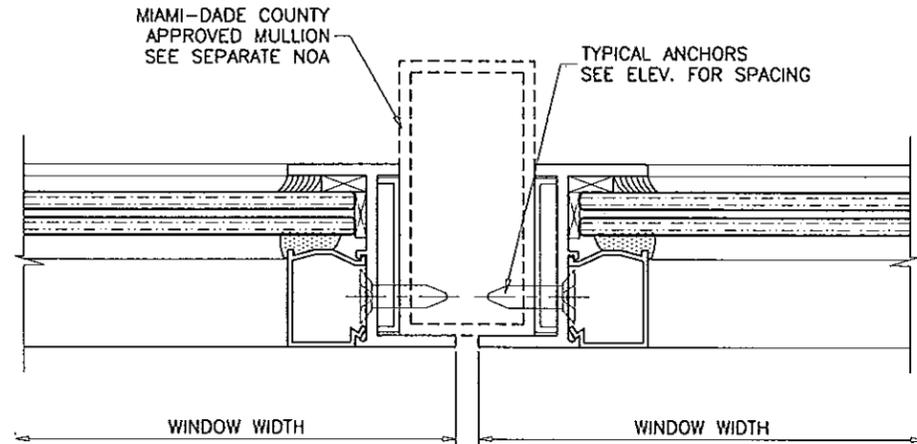

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 13-0206.12
 Expiration Date 11/03/2015
 By [Signature]
 Miami Dade Product Control

Engr. JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
[Signature]
 JUN 25 2013

FLANGE AND EQUAL LEG FRAMES CAN BE
 USED AT ALL ANCHORAGE CONDITIONS.

afC
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W05-08SAT


SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)
SOL-A-TROL ALUMINUM PRODUCTS INC.
 4101 N.W. 132ND STREET
 MIAMI, FL. 33054
 TEL. (305) 681-2020 FAX. (305) 681-2035

revisions:


no	date	by	description
A	09.09.05		NO CHANGE THIS SHEET
B	08.12.08		UPDATED FOR 2007 FBC
C	10.25.10		NO CHANGE THIS SHEET
D	07.31.12		UPDATED TO 2010 FBC
E	05.06.13		NO CHANGE THIS SHEET

date: 02-16-05
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W05-08
 sheet 5 of 7

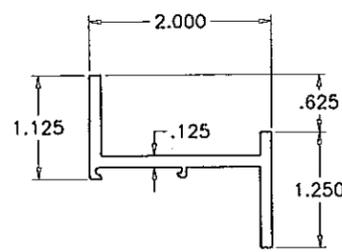


1 FLANGE FRAME HEAD/JAMB/SILL

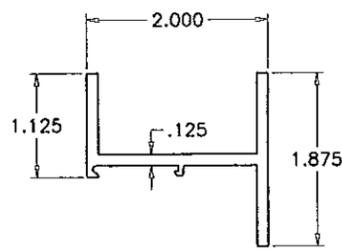


1A EQUAL LEG FRAME HEAD/JAMB/SILL


ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	ARSO-114	4	FLANGE FRAME (HEAD/JAMB/SILL)	6063-T5	-
1A	ARSO-934	4	EQUAL LEG FRAME (HEAD/JAMB/SILL)	6063-T5	-
2	ARSO-169	4	GLAZING BEAD	6063-T5	-
3	-	AS REQD.	SUPPORT CHANNEL, 3" LONG	3003-H14	AT ANCHOR LOCATIONS
4	ARSO-168	-	ZERO MULLION	6063-T5	-
5	FP-40	AS REQD.	GLAZING WEDGE	VINYL	PROTOTYPE PLASTICS, DUROMETER 70-75 SCALE A
6	326-RP-142B	2/ VENT	SETTING BLOCK (1/2" X 1/4" X FULL LENGTH)	PVC	PROTOTYPE PLASTICS, DUROMETER 78 SCALE D
7	326-FP-808B	AS REQD.	SETTING BLOCK (1/2" X 1/4" X 2") AT 6" FROM ENDS	PVC	PROTOTYPE PLASTICS, DUROMETER 70-75 SCALE A
8	-	AS REQD.	IMPOST/MULLION REINFORCING	GALV. STEEL	ASTM A36, Fy 36 KSI
9	-	AS REQD.	ALUMINUM CHANNEL, 3" LONG	3003-H14	AT ANCHOR LOCATIONS
10	ARSO-984	AS REQD.	IMPOST	6063-T6	-
11	#10 X 1-1/2"	2/ CORNER	IMPOST ASSEMBLY SCREWS	-	PH DRILLFLEX SCREWS

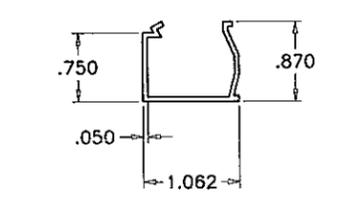


2 GLAZING BEAD

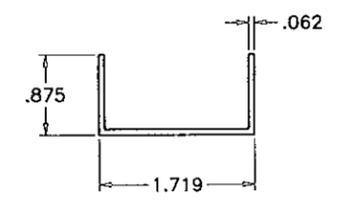


3 SUPPORT CHANNEL

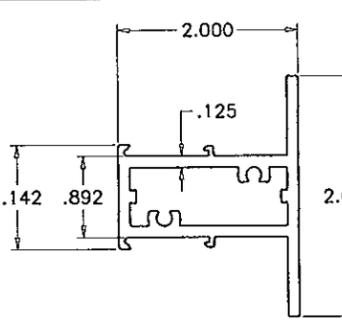


10 IMPOST

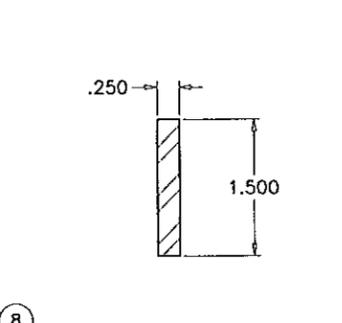


8 IMPOST/MULLION REINFORCING

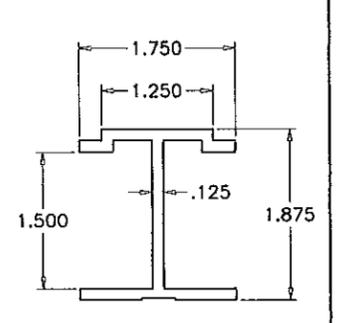

4 ZERO MULLION

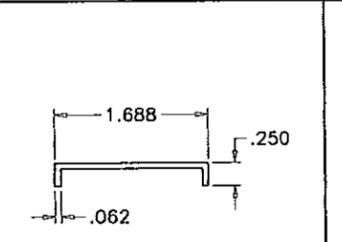


9 ALUM CHANNEL AT ANCHOR LOCATIONS

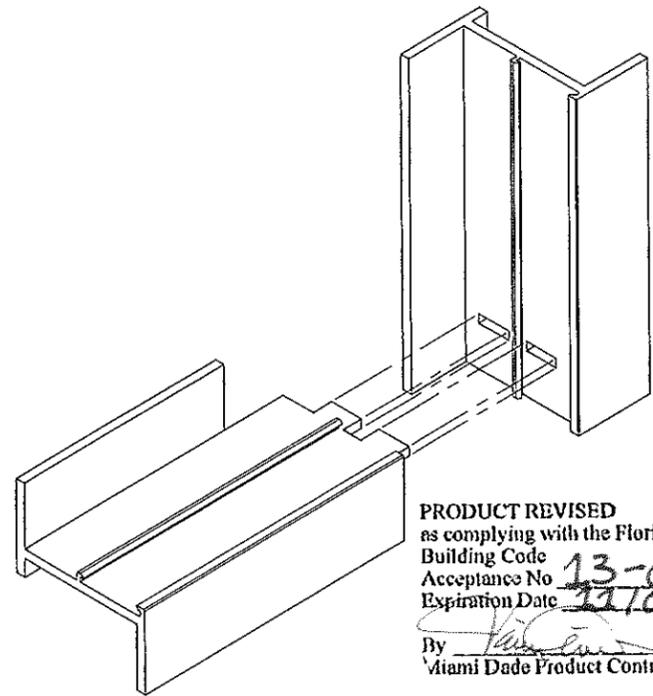

FRAME CORNERS
STAKED MORTISE AND TENON FABRICATION

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 13-0206.12
Expiration Date 11/03/2015
By: *[Signature]*
Miami Dade Product Control

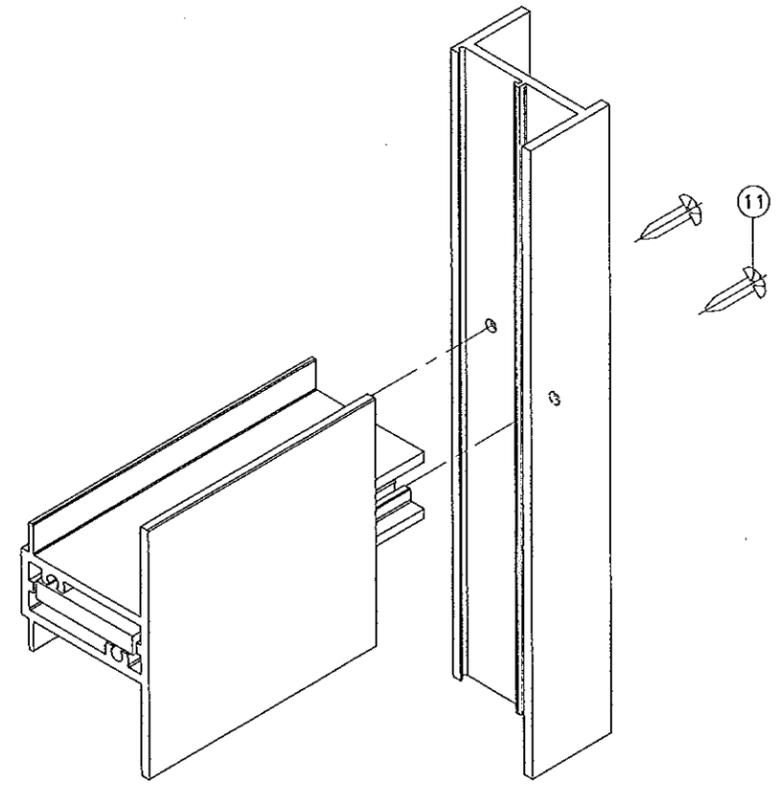

IMPOST CORNERS

Engr: JAVAD AHMAD
CML
FLA. PE # 70592
C.A.N. 3538

JUN 25 2013

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W05-08SAT

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)
SOL-A-TROL ALUMINUM PRODUCTS INC.
4101 N.W. 132ND STREET
MIAMI, FL. 33054
TEL. (305) 681-2020 FAX. (305) 681-2035






no	date	by	description
A	09.09.05		NO CHANGE THIS SHEET
B	08.12.08		UPDATED FOR 2007 FBC
C	10.25.10		REV. PER BCCO COMMENTS
D	07.31.12		UPDATED TO 2010 FBC
E	05.06.13		NO CHANGE THIS SHEET

date: 02-16-05
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W05-08

sheet 6 of 7

MULLION LOAD CAPACITY - PSF				
WINDOW DIMS.		TYPE '1'	TYPE '2'	TYPE '3'
WIDTH (W)	LENGTH (L)	EXT.(+) INT.(-)	EXT.(+) INT.(-)	EXT.(+) INT.(-)
19-1/8"	26"	100.0	100.0	80.0
26-1/2"		100.0	100.0	80.0
37"		100.0	100.0	80.0
53-1/8"		100.0	100.0	80.0
19-1/8"	38-3/8"	100.0	100.0	80.0
26-1/2"		100.0	100.0	80.0
37"		100.0	100.0	80.0
53-1/8"		100.0	100.0	80.0
19-1/8"	50-5/8"	100.0	100.0	80.0
26-1/2"		100.0	100.0	80.0
37"		100.0	100.0	80.0
53-1/8"		100.0	100.0	80.0
19-1/8"	63"	100.0	100.0	80.0
26-1/2"		100.0	100.0	80.0
37"		85.4	100.0	80.0
24"	36"	100.0	100.0	80.0
30"		100.0	100.0	80.0
36"		100.0	100.0	80.0
42"		100.0	100.0	80.0
48"		100.0	100.0	80.0
54"	100.0	100.0	80.0	
24"	42"	100.0	100.0	80.0
30"		100.0	100.0	80.0
36"		100.0	100.0	80.0
42"		100.0	100.0	80.0
48"		100.0	100.0	80.0
54"	100.0	100.0	80.0	
24"	48"	100.0	100.0	80.0
30"		100.0	100.0	80.0
36"		100.0	100.0	80.0
42"		100.0	100.0	80.0
48"		100.0	100.0	80.0
54"	100.0	100.0	80.0	
24"	54"	100.0	100.0	80.0
30"		100.0	100.0	80.0
36"		100.0	100.0	80.0
42"		100.0	100.0	80.0
48"		100.0	100.0	80.0
24"	60"	100.0	100.0	80.0
30"		100.0	100.0	80.0
36"		98.1	100.0	80.0
42"		88.5	100.0	80.0
44"	63"	76.3	95.6	80.0

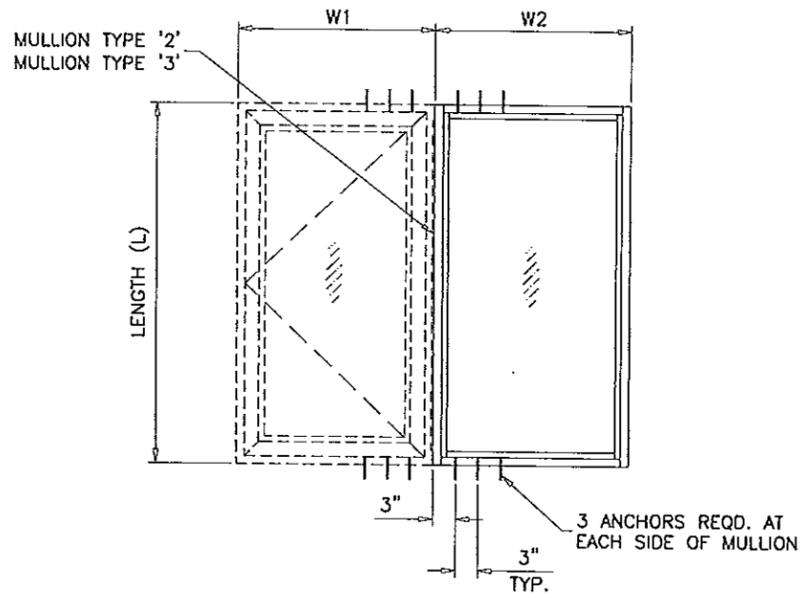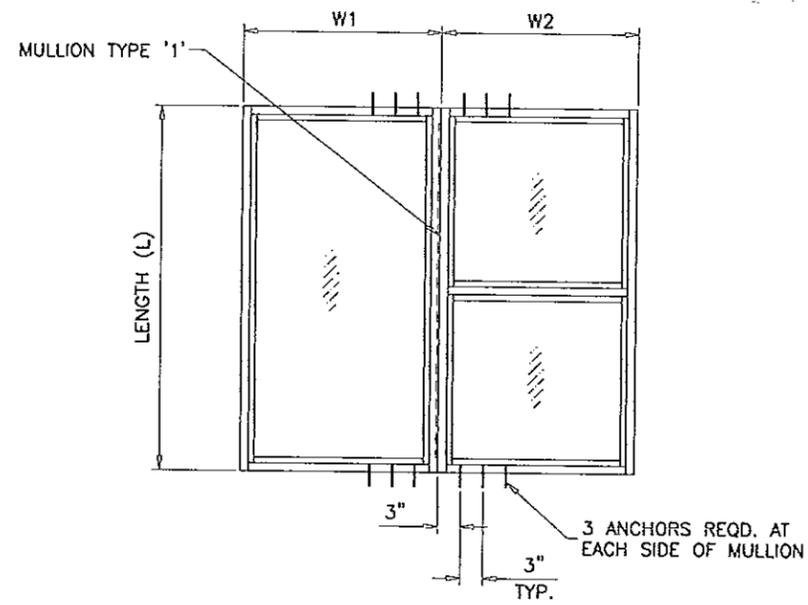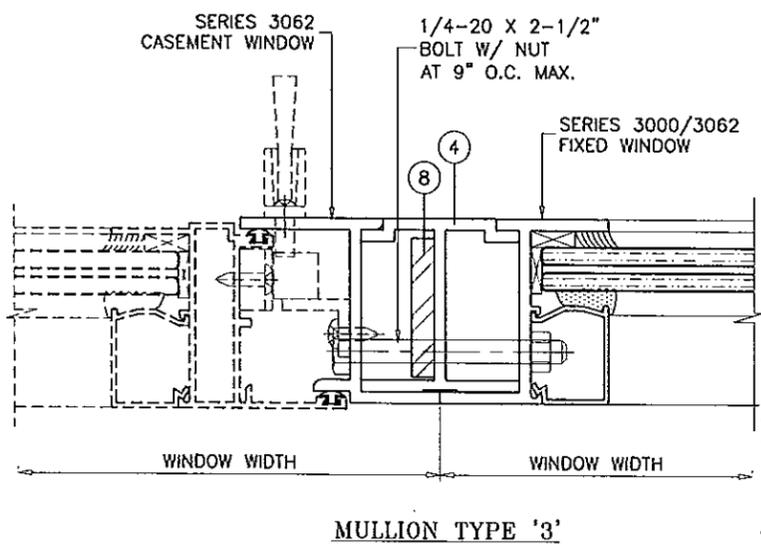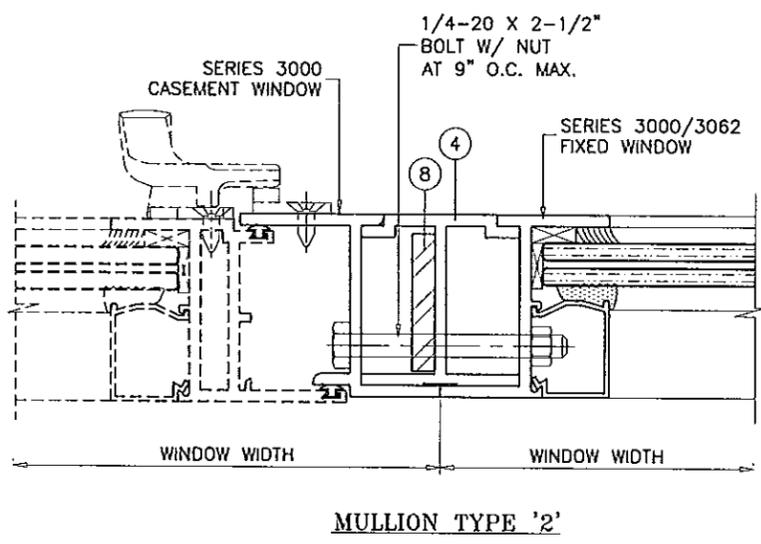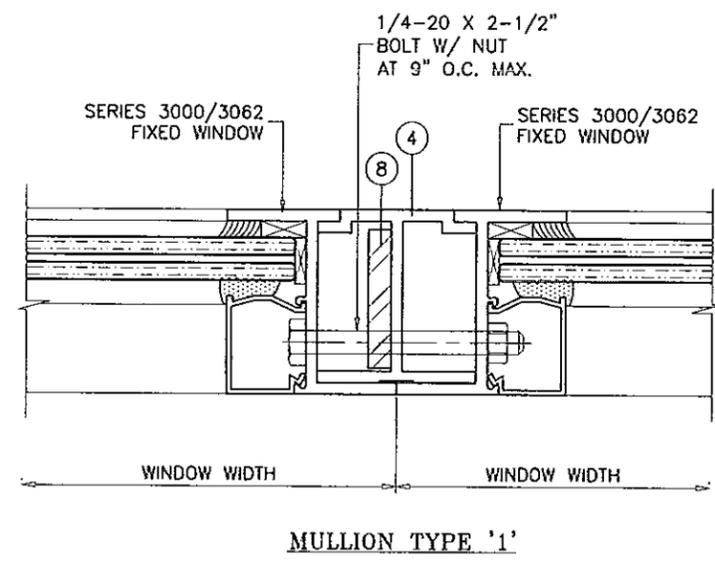

TYPICAL ELEVATIONS
SIDE BY SIDE WINDOWS
SIDE BY SIDE APPLIES TO TWO OR MORE WINDOWS

$$WIDTH (W) = \frac{W1 + W2}{2}$$

- NOTES:**
- USE CHART ON THIS SHEET FOR SIDE BY SIDE CONNECTION CAPACITY OF WINDOW MULLION.
 - FOR FIXED WINDOW CAPACITY SEE SHEET 3 OF 7. FOR IMPOST CAPACITY SEE SHEET 1.
 - FOR CASEMENT WINDOW CAPACITY SEE SEPARATE NOA.
 - LOWER VALUES FROM STEPS 1, 2 OR 3 WILL APPLY TO ENTIRE SYSTEM.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **13-0206.12**
Expiration Date **11/03/2015**
By *[Signature]*
Miami Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

[Signature]
JUN 25 2013

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W05-08SAT

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)
SOL-A-TROL ALUMINUM PRODUCTS INC.
4101 N.W. 132ND STREET
MIAMI, FL. 33054
TEL. (305) 681-2020 FAX. (305) 681-2035

no.	date	description
A	09.09.05	CHART REV.
B	08.12.08	UPDATED FOR 2007 FBC
C	10.25.10	REV. PER BCCO COMMENTS
D	07.31.12	NO CHANGE THIS SHEET
E	05.06.13	NO CHANGE THIS SHEET

date: 02-16-05
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W05-08
sheet 7 of 7